

§ 761.45

40 CFR Ch. I (7-1-20 Edition)

(1) All PCB Large Low Voltage Capacitors not marked under paragraph (a) of this section shall be marked individually, or if one or more PCB Large Low Voltage Capacitors are installed in a protected location such as on a power pole, or structure, or behind a fence, then the owner or operator shall mark the pole, structure, or fence with the M<sub>L</sub> mark, and maintain a record or procedure identifying the PCB Capacitors at the protected location. PCB Large Low Voltage Capacitors in inaccessible locations inside equipment need not be marked individually, provided the owner or operator marks the equipment in accordance with paragraph (k)(2) of this section, and marks the individual capacitors at the time of removal from use in accordance with paragraph (a) of this section.

(2) All equipment not marked under paragraph (a) of this section containing a PCB Transformer or a PCB Large High or Low Voltage Capacitor.

(1)(1) All voltage regulators which contain 1.36 kilograms (3 lbs.) or more of dielectric fluid with a PCB concentration of ≥500 ppm must be marked individually with the M<sub>L</sub> mark as described in §761.45(a).

(2) Locations of voltage regulators which contain 1.36 kilograms (3 lbs.) or more of dielectric fluid with a PCB concentration of ≥500 ppm shall be marked as follows: The vault door, machinery room door, fence, hallway, or means of access, other than grates or manhole covers, must be marked with the M<sub>L</sub> mark as described in §761.45(a).

[44 FR 31542, May 31, 1979. Redesignated at 47 FR 19527, May 6, 1982, and amended at 47 FR 37359, Aug. 25, 1982; 50 FR 29201, July 17, 1985; 50 FR 32176, Aug. 9, 1985; 53 FR 12524, Apr. 15, 1988; 53 FR 27329, July 19, 1988; 63 FR 35443, June 29, 1998; 64 FR 33760, June 24, 1999]

§ 761.45 Marking formats.

The following formats shall be used for marking:

(a) *Large PCB Mark—M<sub>L</sub>*. Mark M<sub>L</sub> shall be as shown in Figure 1, letters and striping on a white or yellow background and shall be sufficiently durable to equal or exceed the life (including storage for disposal) of the PCB Article, PCB Equipment, or PCB Container. The size of the mark shall be at least 15.25 cm (6 inches) on each side. If

the PCB Article or PCB Equipment is too small to accommodate this size, the mark may be reduced in size proportionately down to a minimum of 5 cm (2 inches) on each side.

(b) *Small PCB Mark—M<sub>s</sub>*. Mark M<sub>s</sub> shall be as shown in Figure 2, letters and striping on a white or yellow background, and shall be sufficiently durable to equal or exceed the life (including storage for disposal) of the PCB Article, PCB Equipment, or PCB Container. The mark shall be a rectangle 2.5 by 5 cm (1 inch by 2 inches). If the PCB Article or PCB Equipment is too small to accommodate this size, the mark may be reduced in size proportionately down to a minimum of 1 by 2 cm (.4 by .8 inches).

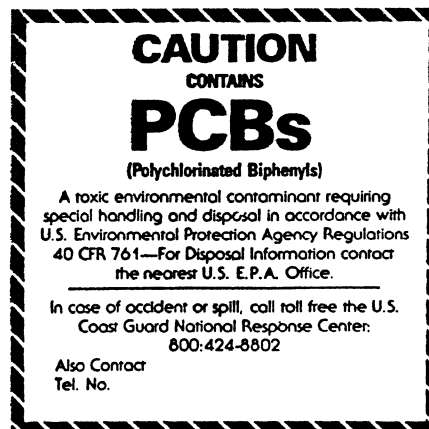


Figure 1

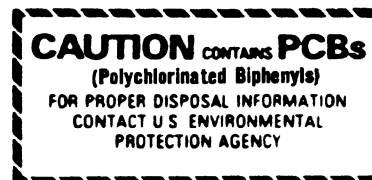


Figure 2

[44 FR 31542, May 31, 1979. Redesignated at 47 FR 19527, May 6, 1982]

Subpart D—Storage and Disposal

§ 761.50 Applicability.

(a) *General PCB disposal requirements.* Any person storing or disposing of PCB waste must do so in accordance with