AUTHENTICATED
U.S. GOVERNMENT
INFORMATION
GPO

federal register

SATURDAY, MAY 29, 1971
WASHINGTON, D.C.
Volume 36 ■ Number 105
Pages 9835–10714

PART I

(Part II begins on page 10465)

HIGHLIGHTS OF THIS ISSUE

This listing does not affect the legal status of any document published in this issue. Detailed table of contents appears inside.

FOOD PRODUCTS—USDA procedures to expedite grading certificates in connection with rabbits, eggs, and poultry; effective 5–29–71 9841

BURLEY TOBACCO—USDA announcement of results of referendum 9843

MILK ORDERS—USDA adoption of uniform administrative provisions for all Federal milk orders; effective 7–1–71 9844

FEDERAL SAVINGS AND LOAN ASSOCIATIONS—FHLBB removal of certain loans from limitation of investment in service corporations; effective 6–1–71 9859

SAVINGS AND LOAN ASSOCIATIONS—FHLBB regulation relating to adjustment of FSLIC insurance premiums in reorganizations; effective 7–1–71 9859

RELEASE OF LOAN INFORMATION—Farm Credit Admin. regulations regarding exceptions to general policy 9860

AIRWORTHINESS DIRECTIVE—FAA modification requirements for certain Cessna airplanes and operating limitations pending modification; effective 6–2–71 9860

(Continued inside)

Current White House Releases

WEEKLY COMPILATION OF PRESIDENTIAL DOCUMENTS

This unique service makes available transcripts of the President's news conferences; messages to Congress; public speeches, remarks, and statements; and other Presidential materials released by the White House.

The Weekly Compilation carries a Monday dateline and covers materials released during the preceding week. It includes an Index of Contents and a system of cumulative indexes. Other finding aids include lists of laws approved by the President and of nominations submitted to the Senate, a checklist of White House releases, and a digest of other White House announcements.

This systematic publication of Presidential items provides users with up-to-date information and a permanent reference source concerning Presidential policies and pronouncements.

Subscription Price: $9.00 per year

Compiled by Office of the Federal Register, National Archives and Records Service, General Services Administration

Order from: Superintendent of Documents
U.S. Government Printing Office,
Washington, D.C. 20402

FEDERAL REGISTER
Area Code 202 Phone 962-8626

Published daily, Tuesday through Saturday (no publication on Sundays, Mondays, or on the day after an official Federal holiday), by the Office of the Federal Register, National Archives and Records Service, General Services Administration, Washington, D.C. 20408, pursuant to the authority contained in the Federal Register Act, approved July 26, 1935 (49 Stat. 500, as amended; 44 U.S.C., Ch. 15), under regulations prescribed by the Administrative Committee of the Federal Register, approved by the President (1 CFR Ch. I). Distribution is made only by the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402.

The FEDERAL REGISTER will be furnished by mail to subscribers, free of postage, for $2.50 per month or $25 per year, payable in advance. The charge for individual copies is 20 cents for each issue, or 20 cents for each group of pages as actually bound. Remit check or money order, made payable to the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402.

The regulatory material appearing herein is keyed to the CODE OF FEDERAL REGULATIONS, which is published, under 50 titles, pursuant to section 11 of the Federal Register Act, as amended (44 U.S.C. 1510). The CODE OF FEDERAL REGULATIONS is sold by the Superintendent of Documents. Prices of new books are listed in the first FEDERAL REGISTER issue of each month.

There are no restrictions on the republication of material appearing in the FEDERAL REGISTER or the CODE OF FEDERAL REGULATIONS.

AIRWORTHINESS DIRECTIVE—FAA emergency inspection requirement on Cessna Model 414 airplanes; effective 6–2–71 9860

AIRWORTHINESS DIRECTIVE—FAA rule requiring repetitive inspection and replacement of hinge fitting on Sikorsky S–61 type helicopters; effective 6–1–71 9861

RULES OF PRACTICE—SEC amendment of time computation requirements 9863

SAVINGS BONDS—Treasury Dept. extensions of terms of Series E bonds 9866

SAFETY AND HEALTH—Labor Dept. issuance of regulations under Occupational Safety and Health Act of 1970; conforming amendments to present regulations (5 documents) 10466

MOTOR VEHICLE SAFETY—DoT amendment of requirements for seat belts and anchorages; effective 7–1–71 9869

AUTO SAFETY—DoT amendment of location of retread tire identification numbers; effective 5–22–71 9869

RAILROAD CARS—ICC expiration of regulations for return of covered hopper cars 9870

FLORIDA AVOCADOS—USDA notice of proposed size, quality, and maturity requirements for Florida avocados; comments by 6–6–71 9871

APRICOTS—USDA proposals to change certain requirements for Washington apricots (2 documents) 9873

COAL MINERS—HEW proposed amendments of rules on X-ray examinations; comments by 6–12–71 9874

NATIONAL RESERVE, WIS.—Interior Dept. establishment of Ice Age National Scientific Reserve 9877

EGGS—USDA modification of egg price and market condition reporting procedure 9888

FOOD ADDITIVE—FDA notice of petition proposing use of additional substance as adjuvant for pesticide use dilutions 9889

NEW ANIMAL DRUGS—FDA notice withdrawing approval of certain arsenic trioxide-vitamin preparations; effective 5–6–71 9890

AIR FARES—CAB notice of hearing concerning domestic passenger fare investigation; hearing date 6–28–71 9891

COTTON TEXTILES—Interagency Textile Adm. Comm. notice of possible restraint of cotton; Nicaragua and Thailand (2 documents) 9894, 9895

PLASTIC SHEETS—Tariff Com. notice of resumption of hearing on articles comprised of plastic sheets having an openwork structure; hearing on 6–28–71 9898

CRUDE OIL—Interior Dept. proposal for importation for topping and use as burner fuel; comments due before 7–6–71 9871

Contents

AGRICULTURAL STABILIZATION AND CONSERVATION SERVICE

Rules and Regulations

Tobacco, burley; marketing quota referendum results 9843

AGRICULTURE DEPARTMENT

See also Agricultural Stabilization and Conservation Service; Consumer and Marketing Service; Packers and Stockyards Administration.

Notices

Kentucky; designation of areas for emergency loans 9888

CIVIL AERONAUTICS BOARD

Notices

Hearings, etc.:

Air Exec, Inc 9890
American-Western merger case 9890
Domestic passenger fare investigation 9891
Trans World Airlines, Inc 9891

COMMERCE DEPARTMENT

See Maritime Administration.

CONSUMER AND MARKETING SERVICE

Rules and Regulations

Lemons grown in California and Arizona; handling limitation 9843

Milk handling in certain marketing areas; orders amending orders:

Eastern Ohio—western Pennsylvania 9849
Middle Atlantic and certain other areas 9844

Nectarines grown in California; shipments limitation 9843

Rabbits, eggs and egg products, and poultry; grading and inspection:

Delinquent accounts billing provisions; correction 9842
Issuance of grading certificates 9841

(Continued on next page)

Proposed Rule Making

Apricots grown in Washington; handling (2 documents) 9873
Avocados grown in Florida; handling 9871
Tomatoes grown in Florida; postponement of hearing 9874

Notices

Egg prices and market conditions; modification of market news 9888

FARM CREDIT ADMINISTRATION

Rules and Regulations

Information and records; borrowers and applicants for loans 9860

FEDERAL AVIATION ADMINISTRATION

Rules and Regulations

Airworthiness directives:
Airglas skis 9860
Cessna airplanes 9860
Sikorsky aircraft 9861
Control zones and transition areas; alterations (2 documents) 9861, 9862
Standard instrument approach procedures; miscellaneous amendments 9862
Transition areas; alterations (2 documents) 9861, 9862

FEDERAL HOME LOAN BANK BOARD

Rules and Regulations

Federal Savings and Loan Insurance Corporation; premium adjustments following mergers, consolidations, or purchases of bulk assets 9859
Federal Savings and Loan System; investments in service corporations 9859

FEDERAL HOUSING ADMINISTRATION

Rules and Regulations

Mortgage insurance on leasehold estates; correction 9864

FEDERAL MARITIME COMMISSION

Notices

Agreements filed:
Atlantic & Gulf/West Coast of Central America and Mexico Conference et al 9891
Compagnie Fabre, S.G.T.M., and Mediterranean Marine Lines 9892
Trans-Pacific Freight Conference of Japan 9892
American Enterprises, Inc.; revocation of independent ocean freight forwarder license 9891
Security for protection of the public; issuance of performance and casualty certificates:
Fairsea Shipping Corp. and Sitmar Cruises, Inc. (2 documents) 9892
Fairwind Shipping Corp. and Sitmar Cruises, Inc. (2 documents) 9893

FEDERAL POWER COMMISSION

Notices

Hearings, etc.:
Colorado Interstate Gas Co 9893
DeQueen, Ark., city of, and Louisiana-Nevada Transit Co 9893
El Paso Natural Gas Co 9893
Washington County Utility District of Washington, Tenn., and East Tennessee Natural Gas Co 9894

FEDERAL RESERVE SYSTEM

Notices

Applications for approval of acquisition of shares of banks:
Bank Shares, Inc 9894
Great Lakes Holding Co 9894

FISCAL SERVICE

Rules and Regulations

Offering of United States Savings Bonds, Series E; miscellaneous amendments 9866

FOOD AND DRUG ADMINISTRATION

Notices

Colloidal Products Corp.; food additive petition 9889
Dr. Mayfield Laboratories et al.; withdrawal of approval of new animal drug applications regarding arsenic trioxide-vitamin preparations 9890

HEALTH, EDUCATION, AND WELFARE DEPARTMENT

See Food and Drug Administration; Public Health Service.

HOUSING AND URBAN DEVELOPMENT DEPARTMENT

See Federal Housing Administration.

INTERAGENCY TEXTILE ADMINISTRATIVE COMMITTEE

Notices

Certain cotton textile products produced or manufactured in certain countries; entry or withdrawal from warehouse for consumption:
Nicaragua 9894
Thailand 9894

INTERIOR DEPARTMENT

See National Park Service; Oil Import Administration.

INTERNAL REVENUE SERVICE

Notices

Granting of relief regarding firearms acquisition, shipment, etc.:
Engler, Richard John 9876
Fowler, Clarence Eugene 9876
Henry, Wilbert 9876
Stevens, Ronald W., Sr 9877

INTERSTATE COMMERCE COMMISSION

Rules and Regulations

Car service; return of covered hopper cars 9870

Notices

Fourth section application for relief 9898
Motor carriers:
Temporary authority applications 9899
Transfer proceedings 9900

LABOR DEPARTMENT

See also Labor Standards Bureau; Occupational Safety and Health Administration; Wage and Hour Division.

Rules and Regulations

Labor standards for Federal service contracts; removal of certain incorporations by reference 9864
Safety and health standards for Federal supply contracts; presumptions, incorporations by reference, and national consensus standards 9865

Notices

Jodi Shoe Co., Inc., and Goldberg Brothers, Inc.; certification of eligibility of workers to apply for adjustment assistance 9898

LABOR STANDARDS BUREAU

Rules and Regulations

Safety and health standards for Federal service contracts; assumptions and incorporations by reference 9865

MARITIME ADMINISTRATION

Proposed Rule Making

Determination of essentiality of U.S.-flag bulk carrier services; correction 9874

Notices

Trinidad Corp.; applications (2 documents) 9889

NATIONAL AERONAUTICS AND SPACE ADMINISTRATION

Rules and Regulations

Termination of contracts; termination claims; correction 9868

NATIONAL HIGHWAY TRAFFIC SAFETY ADMINISTRATION

Rules and Regulations

Federal motor vehicle safety standards; seat belt assembly anchorages and installations 9869
Tire identification and record keeping; locations of identification number for retreaded tires 9869

NATIONAL PARK SERVICE

Notices

Ice Age National Scientific Reserve, Wis.; establishment and boundaries 9877

OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION

Rules and Regulations

Occupational safety and health standards; national consensus standards and established Federal standards 10466

OIL IMPORT ADMINISTRATION

Proposed Rule Making

Imports of crude oil for topping and use as burner fuel, District I and Districts II–IV 9871

PACKERS AND STOCKYARDS ADMINISTRATION

Notices

Big Valley Livestock Auction et al.; changes in names of posted stockyards 9888

PUBLIC HEALTH SERVICE

Proposed Rule Making

Roentgenographic examinations of coal miners 9874

SECURITIES AND EXCHANGE COMMISSION

Rules and Regulations

Rules of practice; business hours and computation of time 9863

Notices

Hearings, etc.:

Advertising and Information Distribution Systems, Inc 9895
Ecological Science Corp 9895
Industrial Manufacturing Corp 9895
New Jersey Power & Light Co 9896
Potomac Edison Co 9896
Utah Power & Light Co 9897

SMALL BUSINESS ADMINISTRATION

Notices

Minority Equity Capital Co., Inc.; issuance of license to operate as minority enterprise small business investment company 9898

TARIFF COMMISSION

Notices

Articles comprised of plastic sheets having openwork structure; resumption of hearing 9898

TRANSPORTATION DEPARTMENT

See Federal Aviation Administration; National Highway Traffic Safety Administration.

TREASURY DEPARTMENT

See Fiscal Service; Internal Revenue Service.

WAGE AND HOUR DIVISION

Rules and Regulations

Labor standards on projects or productions assisted by grants from National Endowment for the Arts; rules of presumption and incorporations by reference 9865

List of CFR Parts Affected

The following numerical guide is a list of the parts of each title of the Code of Federal Regulations affected by documents published in today's issue. A cumulative list of parts affected, covering the current month to date, appears following the Notices section of each issue beginning with the second issue of the month.

A cumulative guide is published separately at the end of each month. The guide lists the parts and sections affected by documents published since January 1, 1971, and specifies how they are affected.

7 CFR

54 (2 documents) 9841, 9842
55 9841
56 (2 documents) 9841, 9842
70 (2 documents) 9842
724 9843
910 9843
916 9843
1000 9845
1001 9847
1002 9847
1004 9847
1006 9847
1007 9847
1011 9848
1012 9848
1013 9848
1015 9848
1030 9848
1032 9849
1033 9849
1036 (2 documents) 9849, 9858
1040 9849
1043 9849
1044 9850
1046 9850
1049 9850
1050 9850
1060 9850
1061 9850
1062 9851
1063 9851
1064 9851
1065 9851
1068 9851
1069 9851
1070 9852
1071 9852
1073 9852
1075 9852
1076 9852
1078 9852
1079 9852
1090 9853
1094 9853
1096 9853
1097 9853
1098 9853
1099 9853
1101 9854
1102 9854
1103 9854
1104 9854
1106 9854
1108 9854
1120 9854
1121 9855
1124 9855
1125 9855
1126 9855
1127 9855
1128 9856
1129 9856
1130 9856
1131 9856
1132 9856
1133 9856
1134 9856
1136 9857
1137 9857
1138 9857

PROPOSED RULES:

915 9871
922 (2 documents) 9873
966 9874

12 CFR

545 9859
563 9859
604 9860

14 CFR

39 (3 documents) 9860, 9861
71 (4 documents) 9861, 9862
97 9862

17 CFR

201 9863

24 CFR

Ch. II 9864

29 CFR

4 9864
505 9865
1516 9865
1910 10466

31 CFR

316 9866

32A CFR

PROPOSED RULES:

Ch. X 9871

41 CFR

18–8 9868
50–204 9868

42 CFR

PROPOSED RULES:

37 9874

46 CFR

PROPOSED RULES:

252 9874

49 CFR

571 9869
574 9869
1033 9870

Rules and Regulations

Title 7—AGRICULTURE

Chapter I—Consumer and Marketing Service (Standards, Inspections, Marketing Practices), Department of Agriculture

SUBCHAPTER C—REGULATIONS AND STANDARDS UNDER THE AGRICULTURAL MARKETING ACT OF 1946

ISSUANCE OF GRADING CERTIFICATES

Under authority contained in the Agricultural Marketing Act of 1946, as amended (7 U.S.C. 1621 et seq.), the U.S. Department of Agriculture hereby amends the Regulations Governing the Grading and Inspection of Domestic Rabbits and Edible Products Thereof; and U.S. Specifications for Classes, Standards, and Grades With Respect Thereto (7 CFR Part 54), the Regulations Governing the Grading and Inspection of Egg Products (7 CFR Part 55), the Regulations Governing the Grading of Shell Eggs and U.S. Standards, Grades, and Weight Classes for Shell Eggs (7 CFR Part 56), and the Regulations Governing the Grading and Inspection of Poultry and Edible Products Thereof; and U.S. Classes, Standards, and Grades With Respect Thereto (7 CFR Part 70) as set forth below:

Statement of considerations. The amendments expedite the issuance of certificates for the voluntary grading programs by providing that graders in resident plants may issue grading certificates on product graded in whole or in part by another grader in the plant when the grader issuing the certificate has knowledge that the product is eligible for certification. Such knowledge would be based on personal examination of the product or official grading records available to the grader. In addition, the section which provides for certificate issuance for gradings other than resident gradings has been clarified to provide that authorized agents of graders holding a power of attorney for such graders shall sign their own and the grader's name on certificates prepared from official grading memorandums signed by the grader. Several minor changes have been made with respect to the disposition of certificates.

The amendments are as follows:

PART 54—GRADING AND INSPECTION OF DOMESTIC RABBITS AND EDIBLE PRODUCTS THEREOF; AND U.S. SPECIFICATIONS FOR CLASSES, STANDARDS, AND GRADES WITH RESPECT THERETO

As to Part 54:

Section 54.171 is amended to read:

§ 54.171 Issuance and disposition.

(a) Resident grading basis: Certificates will be issued only upon a request therefor by the applicant or the Service. When requested, a grader shall issue a certificate covering product graded by him. In addition, a grader may issue a grading certificate covering product graded in whole or in part by another grader when the grader has knowledge that the product is eligible for certification based on personal examination of the product or official grading records.

(b) Other than resident grading: Each grader shall, in person or by his authorized agent, issue a grading certificate covering each product graded by him. A grader's name may be signed on a grading certificate by a person other than the grader, if such person has been designated as the authorized agent of such grader by the National Supervisor: *Provided,* That the certificate is prepared from an official memorandum of grading signed by the grader: *And provided further,* That a notarized power of attorney authorizing such signature has been issued to such person by the grader and is on file in the office of grading. In such case, the authorized agent shall sign both his own and the grader's name, e.g., "John Doe by Richard Roe."

(c) The original and a copy of each grading certificate, issued pursuant to §§ 54.170 to 54.172, and not to exceed two additional copies thereof if requested by the applicant prior to issuance, shall, immediately upon issuance, be delivered or mailed to the applicant or person designated by him. Other copies shall be filed and retained in accordance with the disposition schedule for grading program records. Additional copies of any such certificate may be furnished to any interested party, as provided in § 54.105.

PART 55—GRADING AND INSPECTION OF EGG PRODUCTS

As to Part 55:

1. Section 55.46 is amended to read:

§ 55.46 Grading certificate issuance.

(a) *Resident grading basis.* Certificates will be issued only upon a request therefor by the applicant or the Service. When requested, a grader shall issue a certificate covering product graded by him. In addition, a grader may issue a grading certificate covering product graded in whole or in part by another grader when the grader has knowledge that the product is eligible for certification based on personal examination of the product or official grading records.

(b) *Other than resident grading.* Each grader shall, in person or by his authorized agent, issue a grading certificate covering each product graded by him. A grader's name may be signed on a grading certificate by a person other than the grader, if such person has been designated as the authorized agent of such grader by the National Supervisor: *Provided,* That the certificate is prepared from an official memorandum of grading signed by the grader: *And provided further,* That a notarized power of attorney authorizing such signature has been issued to such person by the grader and is on file in the office of grading. In such case, the authorized agent shall sign both his own and the grader's name, e.g., "John Doe by Richard Roe."

2. Section 55.47 is amended to read:

§ 55.47 Disposition of grading certificates.

The original and a copy of each grading certificate, issued pursuant to § 55.46, and not to exceed two additional copies thereof if requested by the applicant prior to issuance, shall, immediately upon issuance, be delivered or mailed to the applicant or person designated by him. Other copies shall be filed and retained in accordance with the disposition schedule for grading program records. Addi- be supplied to any interested party as provided in § 55.63.

PART 56—GRADING OF SHELL EGGS AND U.S. STANDARDS, GRADES, AND WEIGHT CLASSES FOR SHELL EGGS

As to Part 56:

1. Section 56.56 is amended to read:

§ 56.56 Grading certificate issuance.

(a) *Resident grading basis.* Certificates will be issued only upon request therefor by the applicant for the Service. When requested, a grader shall issue a certificate covering product graded by him. In addition, a grader may issue a grading certificate covering product graded in whole or in part by another grader when the grader has knowledge that the product is eligible for certification based on personal examination of the product or official grading records.

(b) *Other than resident grading.* Each grader shall, in person or by his authorized agent, issue a grading certificate covering each product graded by him. A grader's name may be signed on a grading certificate by a person other than the grader, if such person has been designated as the authorized agent of such grader by the National Supervisor: *Provided,* That the certificate is prepared from an official memorandum of grading signed by the grader: *And provided further,* That a notarized power of attorney authorizing such signature has been issued to such person by the grader and is on file in the office of grading. In such case, the authorized agent shall sign both his own and the grader's name, e.g., "John Doe by Richard Roe."

2. Section 56.57 is amended to read:

§ 56.57 Disposition of grading certificates.

The original and a copy of each grading certificate, issued pursuant to § 56.56, and not to exceed two additional copies thereof if requested by the applicant prior to issuance, shall, immediately upon issuance, be delivered or mailed to the applicant or person designated by him. Other copies shall be filed and retained in accordance with the disposition schedule for grading program records. Additional copies of any such certificate may be supplied to any interested party, as provided in § 56.48.

PART 70—GRADING AND INSPECTION OF POULTRY AND EDIBLE PRODUCTS THEREOF; AND U.S. CLASSES, STANDARDS, AND GRADES WITH RESPECT THERETO

As to Part 70:

Section 70.201 is amended to read:

§ 70.201 Issuance and disposition.

(a) Resident grading basis: Certificates will be issued only upon a request therefor by the applicant or the Service. When requested, a grader shall issue a certificate covering product graded by him. In addition, a grader may issue a grading certificate covering product graded in whole or in part by another grader when the grader has knowledge that the product is eligible for certification based on personal examination of the product or official grading records.

(b) Other than resident grading: Each grader shall, in person or by his authorized agent, issue a grading certificate covering each product graded by him. A grader's name may be signed on a grading certificate by a person other than the grader if such person has been designed as the authorized agent of such grader by the National Supervisor: *Provided,* That the certificate is prepared from an official memorandum of grading signed by the grader: *And provided further,* That a notarized power of attorney authorizing such signature has been issued to such person by the grader and is on file in the office of grading. In such case, the authorized agent shall sign both his own and the grader's name, e.g. "John Doe by Richard Roe."

(c) The original and a copy of each grading certificate, issued pursuant to §§ 70.200 to 70.202, and not to exceed two additional copies thereof if requested by the applicant prior to issuance, shall, immediately upon issuance, be delivered or mailed to the applicant or person designated by him. Other copies shall be filed and retained in accordance with the disposition schedule for grading program records. Additional copies of any such certificate may be furnished to any interested party, as provided in § 70.135.

(Secs. 203, 205, 60 Stat. 1087, 1090, as amended, 7 U.S.C. 1622, 1624; 29 F.R. 16210, as amended; 33 F.R. 10750)

The amendments pertain solely to agency management and procedures and should be made effective promptly in the interests of good administration. Further it does not appear that public rulemaking would result in the Department receiving additional information on these matters.

Accordingly, pursuant to 5 U.S.C. 553, it is found upon good cause that notice and other public procedure with respect to the amendments are impracticable and unnecessary and good cause is found for making the amendments effective less than 30 days after publication in the FEDERAL REGISTER.

Issued at Washington, D.C., this 25th day of May 1971, to become effective on publication (5–29–71).

G. R. GRANGE,
Deputy Administrator,
Marketing Services.

[FR Doc.71–7519 Filed 5–28–71;8:46 am]

DELINQUENT ACCOUNTS BILLING PROVISIONS; CORRECTION

Under authority contained in the Agricultural Marketing Act of 1946, as amended (7 U.S.C. 1621 et seq.), the U.S. Department of Agriculture hereby corrects amendments scheduled to become effective July 1, 1971, in the Regulations Governing the Grading and Inspection of Domestic Rabbits and Edible Products Thereof; and U.S. Specifications for Classes, Standards, and Grades with Respect Thereto (7 CFR Part 54); the Regulations Governing the Grading of Shell Eggs and U.S. Standards, Grades, and Weight Classes for Shell Eggs (7 CFR Part 56); and the Regulations Governing the Grading and Inspection of Poultry and Edible Products Thereof; and U.S. Classes, Standards, and Grades with Respect Thereto (7 CFR Part 70).

Statement of considerations. Amendments were published in the FEDERAL REGISTER on April 2, 1971 (36 F.R. 6071–6072), concerning the voluntary regulations for the grading and inspection of rabbits (7 CFR Part 54), and on April 28, 1971 (36 F.R. 7893–7894), concerning the voluntary regulations for shell egg grading (7 CFR Part 56) and grading and inspection of poultry and edible products thereof (7 CFR Part 70) under the Agricultural Marketing Act of 1946, as amended (7 U.S.C. 1621 et seq.). As a part of these amendments, to become effective July 1, 1971, in the sections pertaining to resident and nonresident service, a change was made in regard to delinquent accounts. The provisions for making an additional charge for accounts due and unpaid after 30 days from date of billing were amended to provide for such charge to apply after 45 days from date of billing. After further study, it has been determined that this is not consistent with general policies of the Consumer and Marketing Service. Therefore, this document corrects said amendments to reinstate provisions for the additional charge for delinquent accounts to apply after 30 days from date of billing.

The corrections are as follows:

PART 54—GRADING AND INSPECTION OF DOMESTIC RABBITS AND EDIBLE PRODUCTS THEREOF; AND U.S. SPECIFICATIONS FOR CLASSES, STANDARDS, AND GRADES WITH RESPECT THERETO

As to the amendments set forth at 36 F.R. 6071–6072, relating to Part 54:

In amendment 1, amending § 54.108, the figure "45" in § 54.108(a) is changed to read "30".

PART 56—GRADING OF SHELL EGGS AND U.S. STANDARDS, GRADES, AND WEIGHT CLASSES FOR SHELL EGGS

As to the amendments set forth at 36 F.R. 7893–7894, relating to Part 56:

1. In amendment 1, amending § 56.52, the figure "45" in § 56.52(a) is changed to read "30".

2. In amendment 3, amending § 56.54, the following phrase is deleted: "paragraph (a) is amended by changing the figure '30' on line 22 to read '45' and".

PART 70—GRADING AND INSPECTION OF POULTRY AND EDIBLE PRODUCTS THEREOF; AND U.S. CLASSES, STANDARDS, AND GRADES WITH RESPECT THERETO

As to the amendments set forth at 36 F.R. 7894, relating to Part 70:

1. In amendment 1, amending § 70.137, the following phrase is deleted: "paragraph (a) is amended by changing the figure '30' on line 22 to read '45' and".

2. In amendment 2, amending § 70.138, the figure "45" in § 70.138(a) is changed to read "30".

The corrections contained herein do not change the regulations presently in effect. Further the facts upon which are based the determination of appropriate charges and billing procedures are peculiarly within the knowledge of this Department and public rulemaking would not result in the Department receiving additional information.

Accordingly, pursuant to the administrative procedure provisions in 5 U.S.C. 553, it is found upon good cause that notice and other public procedure with respect to the foreging amendments are impracticable and unnecessary.

The foregoing amendments shall become effective on July 1, 1971.

Issued at Washington, D.C. this 25th day of May 1971.

G. R. GRANGE,
Deputy Administrator
Marketing Services.

[FR Doc.71–7518 Filed 5–28–71;8:45 am]

Chapter VII—Agricultural Stabilization and Conservation Service (Agricultural Adjustment), Department of Agriculture

SUBCHAPTER B—FARM MARKETING QUOTAS AND ACREAGE ALLOTMENTS

PART 724—BURLEY, FIRE-CURED, DARK AIR-CURED, VIRGINIA SUN-CURED, CIGAR-BINDER (TYPES 51 AND 52), CIGAR-FILLER AND BINDER (TYPES 42, 43, 44, 53, 54, AND 55) AND MARYLAND TOBACCO

Subpart—Proclamation, Determinations, and Announcements of National Marketing Quotas and Referendum Results

MARKET QUOTA REFERENDUM RESULTS

Basis and purpose. Section 724.22 is issued pursuant to and in accordance with sections 312 and 319 of the Agricultural Adjustment Act of 1938, as amended, to proclaim the results of the Burley tobacco marketing quota referendum for the 3 marketing years beginning October 1, 1971, October 1, 1972, and October 1, 1973. Under the provisions of section 319 of the Act, the Secretary proclaimed national marketing quotas on a poundage basis for Burley tobacco for the 1971–72, 1972–73, and 1973–74 marketing years, and announced the amount of the national marketing quota for such kind of tobacco for the 1971–72 marketing year (36 F.R. 7593). The Secretary announced (36 F.R. 7613) that a referendum would be conducted at polling places on May 4, 1971, to determine whether Burley tobacco producers were in favor of or opposed to marketing quotas for the 3 marketing years beginning October 1, 1971, October 1, 1972, and October 1, 1973. Since the only purpose of this document is to proclaim the results of the referendum, it is hereby found and determined that with respect to this proclamation, application of the notice and procedure provisions of 5 U.S.C. 553 in unnecessary.

§ 724.22 Burley tobacco—1971–72, 1972–73, and 1973–74 marketing years.

In a referendum of farmers engaged in the production of the 1970 crop of burley tobacco held on May 4, 1971, 328,608 farmers voted. Of those voting, 317,327 or 96.6 percent, favored quotas for a period of 3 years beginning October 1, 1971; 11,281 or 3.4 percent opposed quotas. Therefore, the national marketing quota of 513 million pounds proclaimed April 21, 1971, which under the provisions of section 319 of the Act results in the allocation of 555 million pounds to producers, will be in effect, and marketing quotas will be in effect for the 3 marketing years beginning October 1, 1971, October 1, 1972, and October 1, 1973.

(Secs. 301, 312, 319, 375, 52 Stat. 38, as amended, 46, as amended, 85 Stat. 23, 52 Stat. 66, as amended; 7 U.S.C. 1301, 1312, 1314e, 1375)

Signed at Washington, D.C., on May 25, 1971.

CARROLL G. BRUNTHAVER,
Acting Administrator, Agricultural Stabilization and Conservation Service.

[FR Doc.71-7564 Filed 5-28-71;8:48 am]

Chapter IX—Consumer and Marketing Service (Marketing Agreements and Orders; Fruits, Vegetables, Nuts), Department of Agriculture

[Lemon Reg. 482]

PART 910—LEMONS GROWN IN CALIFORNIA AND ARIZONA

Limitation of Handling

§ 910.782 Lemon Regulation 482.

(a) *Findings.* (1) Pursuant to the marketing agreement, as amended, and Order No. 910, as amended (7 CFR Part 910), regulating the handling of lemons grown in California and Arizona, effective under the applicable provisions of the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601–674), and upon the basis of the recommendations and information submitted by the Lemon Administrative Committee, established under the said amended marketing agreement and order, and upon other available information, it is hereby found that the limitation of handling of such lemons, as hereinafter provided, will tend to effectuate the declared policy of the act.

(2) It is hereby further found that it is impracticable and contrary to the public interest to give preliminary notice to engage in public rule-making procedure, and postpone the effective date of this section until 30 days after publication hereof in the FEDERAL REGISTER (5 U.S.C. 553) because the time intervening between the date when information upon which this section is based became available and the time when this section must become effective in order to effectuate the declared policy of the act is insufficient, and a reasonable time is permitted, under the circumstances, for preparation for such effective time; and good cause exists for making the provisions hereof effective as hereinafter set forth. The committee held an open meeting during the current week, after giving due notice thereof, to consider supply and market conditions for lemons and the need for regulation; interested persons were afforded an opportunity to submit information and views at this meeting; the recommendation and supporting information for regulation during the period specified herein were promptly submitted to the Department after such meeting was held; the provisions of this section, including its effective time, are identical with the aforesaid recommendation of the committee, and information concerning such provisions and effective time has been disseminated among handlers of such lemons; it is necessary, in order to effectuate the declared policy of the act, to make this section effective during the period herein specified; and compliance with this section will not require any special preparation on the part of persons subject hereto which cannot be completed on or before the effective date hereof. Such committee meeting was held on May 25, 1971.

(b) *Order.* (1) The respective quantities of lemons grown in California and Arizona which may be handled during the period May 30, 1971, through June 5, 1971, are hereby fixed as follows:

(i) District 1: Unlimited;

(ii) District 2: 250,000 cartons;

(iii) District 3: Unlimited.

(2) As used in this section, "handled," "District 1," "District 2," "District 3," and "carton" have the same meaning as when used in the said amended marketing agreement and order.

(Secs. 1–19, 48 Stat. 31, as amended; 7 U.S.C. 601–674)

Dated: May 27, 1971.

FLOYD F. HEDLUND,
Director, Fruit and Vegetable Division, Consumer and Marketing Service.

[FR Doc.71-7599 Filed 5-28-71;8:52 am]

[Nectarine Reg. 1]

PART 916—NECTARINES GROWN IN CALIFORNIA

Limitation of Shipments

Findings. (1) Pursuant to the marketing agreement, as amended, and Order No. 916, as amended (7 CFR Part 916, 36 F.R. 9289), regulating the handling of nectarines grown in the State of California, effective under the applicable provisions of the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601–674), and upon the basis of the recommendations of the Nectarine Administrative Committee, established under the aforesaid marketing agreement and order, and upon other available information, it is hereby found that the limitation of shipments of nectarines, as hereinafter set forth, and in the manner herein provided, will tend to effectuate the declared policy of the act.

(2) The recommendations by the Nectarine Administrative Committee reflect its appraisal of the nectarine crop and current and prospective market conditions. Shipments of earlier varieties of nectarines have begun. All shipments of California nectarines are currently regulated by grade through May 31, 1971, and the grade requirements specified herein for all varieties will prevent the handling, from June 1, 1971, through May 31, 1972, of any nectarines of a lower grade than is hereinafter specified. Shipments of nectarine varieties being regulated by size are expected to begin on or about the effective date of this regulation. The size requirements provided herein will prevent the handling, from June 1, 1971, through October 31, 1971, of any nectarines smaller in size than is hereinafter specified, for the named varieties. Furthermore, the grade and size requirements provided herein are necessary to provide consumers with good quality fruit consistent with (1) the

overall quality of the crop, and (2) maximizing returns to the producers pursuant to the declared policy of the act.

(3) It is hereby further found that it is impracticable, unnecessary, and contrary to the public interest to give preliminary notice, engage in public rulemaking procedure, and postpone the effective date of this regulation until 30 days after publication thereof in the FEDERAL REGISTER (5 U.S.C. 553) in that, as hereinafter set forth, the time intervening between the date when information upon which this regulation is based became available and the time when this regulation must become effective in order to effectuate the declared policy of the act is insufficient; a reasonable time is permitted, under the circumstances, for preparation of such effective time; and good cause exists for making the provisions hereof effective not later than the date hereinafter specified. A reasonable determination as to the supply of, and the demand for, such nectarines must await the development of the crop thereof; adequate information thereon was not available to the Nectarine Administrative Committee until the date hereinafter set forth on which an open meeting was held, after giving due notice thereof, to consider the need for, and the extent of, regulation of shipments of such nectarines; interested persons were afforded an opportunity to submit information and views at this meeting; the recommendation and supporting information for regulation during the period specified herein were promptly submitted to the Department after such meeting was held; shipments of the current crop of such nectarines have begun; this regulation should be applicable to all such shipments, upon expiration date of the currently effective Nectarine Regulation 1 § 916.340 (35 F.R. 7961), in order to effectuate the declared policy of the act; the provisions of this regulation are identical with the aforesaid recommendation of the committee; information concerning such provisions and effective time has been disseminated among handlers of such nectarines; and compliance with the provisions of this regulation will not require of handlers any preparation therefor which cannot be completed by the effective time hereof. Such committee meeting was held on May 18, 1971.

§ 916.342 Nectarine Regulation 1.

(a) *Order.* (1) During the period June 1, 1971, through May 31, 1972, no handler shall handle any package or container of any variety of nectarines unless such nectarines grade at least U.S. No. 1: *Provided,* That nectarines 2 inches in inches in diameter or smaller, or 4 x 4 size or smaller, shall not have fairly light colored, fairly smooth scars which exceed the aggregate area of a circle three-eighth inch in diameter, and nectarines larger than 2 inches in diameter, or larger than 4 x 4 size, shall not have fairly light colored, fairly smooth scars which exceed an aggregate area of a circle one-half inch in diameter: *Provided, further,* That 25 percent of the surface of each fruit of the Sun Free and Golden Grand varieties may be affected by fairly smooth or smooth russeting.

(2) During the period June 1, 1971, through October 31, 1971:

(i) No handler shall handle any package or container of Grand River or Mayfair nectarines unless:

(*a*) Such nectarines, when packed in a standard basket, are of a size not smaller than a size that will pack a 3 x 4 x 5 standard pack;

(*b*) Such nectarines, when packed in a No. 22D standard lug box, are of a size that will pack, in accordance with the requirements of a standard pack, not more than 112 nectarines in the lug box; or

(*c*) Such nectarines, when packed in any container other than the containers specified in (*a*) and (*b*) of this subparagraph (2) (i), measure not less than one and fourteen-sixteenth ($1\frac{1}{16}$) inches in diameter: *Provided,* That not to exceed 10 percent, by count, of the nectarines in any such container may fail to meet such diameter requirement.

(ii) No handler shall handle any package or container of June Belle, June Grand, May Grand, Red June, Sunbright, or Sunrise nectarines unless:

(*a*) Such nectarines, when packed in a standard basket, are of a size not smaller than a size that will pack a 4 x 4 standard pack;

(*b*) Such nectarines, when packed in a No. 22D standard lug box, are of a size that will pack, in accordance with the requirement of a standard pack, not more than 108 nectarines in the lug box; or

(*c*) Such nectarines, when packed in any container other than the containers specified in (*a*) and (*b*) of this subparagraph (2) (ii), measure not less than two (2) inches in diameter: *Provided,* That not to exceed 10 percent, by count, of the nectarines in any such container may fail to meet such diameter requirement.

(iii) No handler shall handle any package or container of Early Sun Grand, Grandandy, Independence, Star Grand I, Star Grand II, Sun Flame, or Sun Grand nectarines unless:

(*a*) Such nectarines, when packed in a No. 22D standard lug box, are of a size that will pack, in accordance with the requirements of a standard pack, not more than 96 nectarines in the lug box; or

(*b*) Such nectarines, when packed in any container other than in a No. 22D standard lug box, measure not less than two and one-eighth ($2\frac{1}{8}$) inches in diameter: *Provided,* That not to exceed 10 percent, by count, of the nectarines in any such container may fail to meet such diameter requirement.

(iv) No handler shall handle any package or container of Autumn Grand, Clinton-Strawberry, Fantasia 88, Flame Kist, Gold King, Granderli, Grandeur, Grand Prize, Hi-Red, Late Le Grand, Le Grand, Red Grand, Regal Grand, Richard's Grand, Royal Grand, September Grand, or Sun Free nectarines, unless:

(*a*) Such nectarines, when packed in a No. 22D standard lug box, are of a size that will pack, in accordance with the requirements of a standard pack, not more than 88 nectarines in the lug box; or

(*b*) Such nectarines, when packed in any container other than in a No. 22D standard lug box, measure not less than two and one-fourth ($2\frac{1}{4}$) inches in diameter: *Provided,* That not to exceed 10 percent, by count, of the nectarines in any such container may fail to meet such diameter requirement.

(3) When used herein, "diameter," "U.S. No. 1," and "standard pack" shall have the same meaning as set forth in the U.S. Standards for Grades of Nectarines (§§ 51.3145–51.3160 of this title); "standard basket" shall mean the standard basket set forth in section 43592 of the Agricultural Code of California; "No. 22D standard lug box" shall have the same meaning as set forth in section 43601 of the Agricultural Code of California; and all other terms shall have the same meaning as when used in the marketing agreement and order.

(Secs. 1–19, 48 Stat. 31, as amended; 7 U.S.C. 601–674)

Dated: May 26, 1971.

PAUL A. NICHOLSON,
Deputy Director, Fruit and Vegetable Division, Consumer and Marketing Service.

[FR Doc.71-7559 Filed 5-28-71;8:47 am]

Chapter X—Consumer and Marketing Service (Marketing Agreements and Orders; Milk), Department of Agriculture

[Docket No. AO-160-A44, etc.]

MILK IN MIDDLE ATLANTIC AND CERTAIN OTHER MARKETING AREAS

Order Amending Orders

7 CFR part	Marketing area	Docket No.
1000	(Applicable to all the following areas.)	
1004	Middle Atlantic	AO-160-A44.
1001	Massachusetts-Rhode Island-New Hampshire.	AO-14-A48.
1002	New York-New Jersey	AO-71-A61.
1006	Upper Florida	AO-356-A7.
1007	Georgia	AO-366-A6.
1011	Appalachian	AO-251-A13.
1012	Tampa Bay	AO-347-A11.
1013	Southeastern Florida	AO-286-A19.
1015	Connecticut	AO-305-A27.
1030	Chicago Regional	AO-361-A4.
1032	Southern Illinois	AO-313-A21.
1033	Ohio Valley	AO-166-A41.
1036	Eastern Ohio-Western Pennsylvania.	AO-179-A33.
1040	Southern Michigan	AO-225-A23.
1043	Upstate Michigan	AO-247-A16.
1044	Michigan Upper Peninsula	AO-299-A18.
1046	Louisville-Lexington-Evansville.	AO-123-A38.
1049	Indiana	AO-319-A17.
1050	Central Illinois	AO-355-A10.
1060	Minnesota-North Dakota	AO-360-A5.
1061	Southeastern Minnesota-Northern Iowa.	AO-367-A3.
1062	St. Louis-Ozarks	AO-10-A43.
1063	Quad Cities-Dubuque	AO-105-A32.
1064	Greater Kansas City	AO-23-A39.
1065	Nebraska-Western Iowa	AO-86-A24.
1068	Minneapolis-St. Paul	AO-178-A26
1069	Duluth-Superior	AO-153-A18
1070	Cedar Rapids-Iowa City	AO-229-A23

7 C F R part	Marketing area	Docket No.
1071	Neosho Valley	AO-227-A25
1073	Wichita	AO-173-A25
1075	Black Hills	AO-248-A13
1076	Eastern South Dakota	AO-260-A16
1078	North Central Iowa	AO-272-A18.
1079	Des Moines	AO-295-A21.
1090	Chattanooga	AO-266-A14.
1094	New Orleans	AO-103-A31.
1096	Northern Louisiana	AO-257-A19.
1097	Memphis	AO-219-A24.
1098	Nashville	AO-184-A30.
1099	Paducah	AO-183-A26.
1101	Knoxville	AO-195-A20.
1102	Fort Smith	AO-237-A19.
1103	Mississippi	AO-346-A13.
1104	Red River Valley	AO-298-A17.
1106	Oklahoma Metropolitan	AO-210-A29.
1108	Central Arkansas	AO-243-A21.
1120	Lubbock-Plainview	AO-328-A12.
1121	South Texas	AO-364-A4.
1124	Oregon-Washington	AO-368-A3.
1125	Puget Sound	AO-226-A22.
1126	North Texas	AO-231-A36.
1127	San Antonio	AO-232-A22.
1128	Central West Texas	AO-238-A25.
1129	Austin-Waco	AO-256-A18.
1130	Corpus Christi	AO-259-A22.
1131	Central Arizona	AO-271-A14.
1132	Texas Panhandle	AO-262-A21.
1133	Inland Empire	AO-275-A22.
1134	Western Colorado	AO-301-A12.
1136	Great Basin	AO-309-A16.
1137	Eastern Colorado	AO-326-A16.
1138	Rio Grande Valley	AO-335-A17.

FINDINGS AND DETERMINATIONS

The findings and determinations hereinafter set forth are supplementary and in addition to the findings and determinations previously made in connection with the issuance of each of the aforesaid orders and of the previously issued amendments thereto; and all of the said previous findings and determinations are hereby ratified and affirmed, except insofar as such findings and determinations may be in conflict with the findings and determinations set forth herein.

The following findings are hereby made with respect to each of the aforesaid orders:

(a) *Findings upon the basis of the hearing record.* Pursuant to the provisions of the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601 et seq.), and the applicable rules of practice and procedure governing the formulation of marketing agreements and marketing orders (7 CFR Part 900), a public hearing was held upon certain proposed amendments to the tentative marketing agreements and to the orders regulating the handling of milk in the respective marketing areas.

Upon the basis of the evidence introduced at such hearing and the record thereof, it is found that:

(1) The said order as hereby amended, and all of the terms and conditions thereof, will tend to effectuate the declared policy of the Act;

(2) The parity prices of milk, as determined pursuant to section 2 of the Act, are not reasonable in view of the price of feeds, available supplies of feeds, and other economic conditions which affect market supply and demand for milk in the said marketing area, and the minimum prices specified in the order as hereby amended, are such prices as will reflect the aforesaid factors, insure a sufficient quantity of pure and wholesome milk, and be in the public interest; and

(3) The said order as hereby amended, regulates the handling of milk in the same manner as, and is applicable only to persons in the respective classes of industrial or commercial activity specified in, a marketing agreement upon which a hearing has been held.

(b) *Determinations.* It is hereby determined that:

(1) The refusal or failure of handlers (excluding cooperative associations specified in section 8c(9) of the Act) of more than 50 percent of the milk, which is marketed within each of the respective marketing areas, to sign a proposed marketing agreement, tends to prevent the effectuation of the declared policy of the Act;

(2) The issuance of this order, amending each of the specified orders, is the only practical means pursuant to the declared policy of the Act of advancing the interests of producers as defined in the respective orders as hereby amended;

(3) The issuance of the order amending each of the specified orders, except the Austin-Waco, North Central Iowa, Fort Smith, Memphis, and Michigan Upper Peninsula orders, is approved or favored by at least two-thirds of the producers who, during the determined representative period, were engaged in the production of milk for sale in the respective marketing areas; and

(4) The issuance of the order amending the Austin-Waco, North Central Iowa, Fort Smith, Memphis, and Michigan Upper Peninsula orders is approved or favored by at least three-fourths of the producers who, during the determined representative period, were engaged in the production of milk for sale in the respective marketing areas.

Order relative to handling. It is therefore ordered, that on and after the effective date hereof, the handling of milk in each of the aforesaid marketing areas shall be in conformity to and in compliance with the terms and conditions of the aforesaid orders, as amended, and as hereby further amended, as follows:

PART 1000—GENERAL PROVISIONS OF FEDERAL MILK MARKETING ORDERS

Sec.

1000.1 Scope and purpose of Part 1000.
1000.2 Definitions.
1000.3 Market administrator.
1000.4 Continuity and separability of provisions.
1000.5 Handler responsibility for records and facilities.
1000.6 Termination of obligations.

§ 1000.1 Scope and purpose of Part 1000.

This part sets forth certain terms, definitions, and provisions which shall be common to and part of each Federal milk marketing order except as specifically defined otherwise, or modified, or otherwise provided, in an individual order.

§ 1000.2 Definitions.

The following terms shall have the following meanings as used in the order:

(a) *Act.* "Act" means Public Act No. 10, 73d Congress, as amended and as reenacted and amended by the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601 et seq.).

(b) *Order.* "Order" means the applicable part of Title 7 of the Code of Federal Regulations issued pursuant to section 8c of the Act as a Federal milk marketing order (as amended).

(c) *Department.* "Department" means the U.S. Department of Agriculture.

(d) *Secretary.* "Secretary" means the Secretary of Agriculture of the United States or any officer or employee of the Department to whom authority has heretofore been delegated, or to whom authority may hereafter be delegated to act in his stead.

(e) *Person.* "Person" means any individual, partnership, corporation, association, or other business unit.

§ 1000.3 Market administrator.

(a) *Designation.* The agency for the administration of the order shall be a market administrator selected by the Secretary and subject to removal at the Secretary's discretion. The market administrator shall be entitled to compensation determined by the Secretary.

(b) *Powers.* The market administrator shall have the following powers with respect to each order under his administration:

(1) Administer the order in accordance with its terms and provisions;

(2) Make rules and regulations to effectuate the terms and provisions of the order;

(3) Receive, investigate, and report complaints of violations to the Secretary; and

(4) Recommend amendments to the Secretary.

(c) *Duties.* The market administrator shall perform all the duties necessary to administer the terms and provisions of each order under his administration, including, but not limited to, the following:

(1) Execute and deliver to the Secretary a bond covering himself and a bond covering any person designated by the Secretary to act in his stead. The respective bond shall be:

(i) Delivered within 45 days after he (or the acting market administrator) enters upon his duties;

(ii) Effective as of the date he (or the acting market administrator) enters upon his duties;

(iii) Conditioned upon the faithful performance of the market administrator's duties; and

(iv) In an amount and with surety thereon satisfactory to the Secretary;

(2) Employ and fix the compensation of persons necessary to enable him to exercise his powers and perform his duties;

(3) Pay out of funds provided by the administrative assessment, except expenses associated with functions for which the order provides a separate charge, all expenses necessarily incurred in the maintenance and functioning of his office and in the performance of his

duties, including his own bond and compensation and the necessary bonds of his employees;

(4) Keep records which will clearly reflect the transactions provided for in the order, and upon request by the Secretary, surrender the records to his successor or such other person as the Secretary may designate;

(5) Furnish information and reports requested by the Secretary and submit his records to examination by the Secretary;

(6) Announce publicly at his discretion, unless otherwise directed by the Secretary, by such means as he deems appropriate, the name of any handler who, after the date upon which he is required to perform such act, has not:

(i) Made reports required by the order;

(ii) Made payments required by the order; or

(iii) Made available records and facilities as required pursuant to § 1000.5;

(7) Prescribe reports required of each handler under the order. Verify such reports and the payments required by the order by examining records (including such papers as copies of income tax reports, fiscal and product accounts, correspondence, contracts, documents or memoranda of the handler, and the records of any other persons that are relevant to the handler's obligation under the order), by examining such handler's milk handling facilities; and by such other investigation as the market administrator deems necessary for the purpose of ascertaining the correctness of any report or any obligation under the order. Reclassify skim milk and butterfat received by any handler if such examination and investigation discloses that the original classification was incorrect.

(8) Furnish each regulated handler a written statement of such handler's accounts with the market administrator promptly each month. Furnish a corrected statement to such handler if verification discloses that the original statement was incorrect; and

(9) Prepare and disseminate publicly for the benefit of producers, handlers, and consumers such statistics and other information concerning operation of the order and facts relevant to the provisions thereof (or proposed provisions) as do not reveal confidential information.

§ 1000.4 Continuity and separability of provisions.

(a) *Effective time.* The provisions of the order or any amendment to the order shall become effective at such time as the Secretary may declare and shall continue in force until suspended or terminated.

(b) *Suspension or termination.* The Secretary shall suspend or terminate any or all of the provisions of the order whenever he finds that such provision(s) obstructs or does not tend to effectuate the declared policy of the Act. The order shall terminate whenever the provisions of the Act authorizing it cease to be in effect.

(c) *Continuing obligations.* If upon the suspension or termination of any or all of the provisions of the order, there are any obligations arising under the order, the final accrual or ascertainment of which requires acts by any handler, by the market administrator, or by any other person, the power and duty to perform such further acts shall continue notwithstanding such suspension or termination.

(d) *Liquidation.* (1) Upon the suspension or termination of any or all provisions of the order, the market administrator, or such other liquidating agent designated by the Secretary, shall if so directed by the Secretary liquidate the business of the market administrator's office, dispose of all property in his possession or control, including accounts receivable and execute and deliver all assignments or other instruments necessary or appropriate to effectuate any such disposition; and

(2) If a liquidating agent is so designated, all assets and records of the market administrator shall be transferred promptly to such liquidating agent. If, upon such liquidation, the funds on hand exceed the amounts required to pay outstanding obligations of the office of the market admininstrator and to pay necessary expenses of liquidation and distribution, such excess shall be distributed to contributing handlers and producers in an equitable manner.

(e) *Separability of provisions.* If any provision of the order or its application to any person or circumstances is held invalid, the application of such provision and of the remaining provisions of the order to other persons or circumstances shall not be affected thereby.

§ 1000.5 Handler responsibility for records and facilities.

Each handler shall maintain and retain records of his operations and make such records and his facilities available to the market administrator. If adequate records of a handler, or of any other persons, that are relevant to the obligation of such handler are not maintained and made available, any skim milk and butterfat required to be reported by such handler for which adequate records are not available shall not be considered accounted for or established as used in a class other than the highest priced class.

(a) *Records to be maintained.* (1) Each handler shall maintain records of his operations (including, but not limited to, records of purchases, sales, processing, packaging, and disposition) as are necessary to verify whether such handler has any obligation under the order, and if so, the amount of such obligation. Such records shall be such as to establish for each plant or other receiving point for each month:

(i) The quantities of skim milk and butterfat contained in, or represented by, products received in any form, including inventories on hand at the beginning of the month, according to form, time, and source of each receipt;

(ii) The utilization of all skim milk and butterfat showing the respective quantities of such skim milk and butterfat in each form disposed of or on hand at the end of the month; and

(iii) Payments to producers, dairy farmers and cooperative associations, including the amount and nature of any deductions and the disbursement of money so deducted.

(2) Each handler shall keep such other specific records as the market administrator deems necessary to verify or establish such handler's obligation under the order.

(b) *Availability of records and facilities.* Each handler shall make available all records pertaining to such handler's operations and all facilities the market administrator finds are necessary for such market administrator to verify the information required to be reported by the order and/or to ascertain such handler's reporting, monetary or other obligation under the order. Each handler shall permit the market administrator to weigh, sample, and test milk and milk products and observe plant operations and equipment and make available to the market administrator such facilities as are necessary to carry out his duties.

(c) *Retention of records.* All records required under the order to be made available to the market administrator shall be retained by the handler for a period of 3 years to begin at the end of the month to which such records pertain. If, within such 3-year period, the market administrator notifies the handler in writing that the retention of such records, or of specified records, is necessary in connection with a proceeding under section 8c(15)(A) of the Act or a court action specified in such notice, the handler shall retain such records, or specified records, until further written notification from the market administrator. The market administrator shall give further written notification to the handler promptly upon the termination of the litigation or when the records are no longer necessary in connection therewith.

§ 1000.6 Termination of obligations.

The provisions of this section shall apply to any obligation under the order for the payment of money:

(a) Except as provided in paragraphs (b) and (c) of this section, the obligation of any handler to pay money required to be paid under the terms of the order shall terminate 2 years after the last day of the month during which the market administrator receives the handler's report of receipts and utilization on which such obligation is based, unless within such 2-year period, the market administrator notifies the handler in writing that such money is due and payable. Service of such written notice shall be complete upon mailing to the handler's last known address and it shall contain but need not be limited to the following information:

(1) The amount of the obligation;

(2) The month(s) on which such obligation is based; and

(3) If the obligation is payable to one or more producers or to a cooperative

association (except an obligation to be prorated to producers under an individual handler pool), the name of such producer(s) or such cooperative association, or if the obligation is payable to the market administrator, the account for which it is to be paid;

(b) If a handler fails or refuses, with respect to any obligation under the order, to make available to the market administrator all records required by the order to be made available, the market administrator may notify the handler in writing, within the 2-year period provided for in paragraph (a) of this section, of such failure or refusal. If the market administrator so notifies a handler, the said 2-year period with respect to such obligation shall not begin to run until the first day of the month following the month during which all such records pertaining to such obligation are made available to the market administrator;

(c) Notwithstanding the provisions of paragraphs (a) and (b) of this section, a handler's obligation under the order to pay money shall not be terminated with respect to any transaction involving fraud or willful concealment of a fact, material to the obligation, on the part of the handler against whom the obligation is sought to be imposed; and

(d) Unless the handler files a petition pursuant to section 8c(15)(A) of the Act and the applicable rules and regulations (7 CFR 900.50 et seq.) within the applicable 2-year period indicated below, the obligation of the market administrator:

(1) To pay a handler any money which such handler claims to be due him under the terms of the order shall terminate 2 years after the end of the month during which the skim milk and butterfat involved in the claim were received; or

(2) To refund any payment made by a handler (including a deduction or offset by the market administrator) shall terminate 2 years after the end of the month during which payment was made by the handler.

PART 1001—MILK IN THE MASSACHUSETTS-RHODE ISLAND-NEW HAMPSHIRE MARKETING AREA

1. The center headings are revised as follows: "General Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1001.1, 1001.5, 1001.6, 1001.30, 1001.31, 1001.44, 1001.45, 1001.90, 1001.91, 1001.92, 1001.93, 1001.94, 1001.95, 1001.96, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1001.1 is added as follows:

§ 1001.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1001.32 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1001.32 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

5. In § 1001.42 a new paragraph (e) is added as follows:

§ 1001.42 Reports regarding individual producers and dairy farmers.

* * * * *

(e) Each handler shall submit to the market administrator, within 10 days after his request made not earlier than 20 days after the end of the month, his producer payroll for the month, which shall show for each producer:

(1) The daily and total pounds of milk delivered and its average butterfat test; and

(2) The net amount of the handler's payments to the producer, with the prices, deductions, and charges involved.

PART 1002—MILK IN NEW YORK-NEW JERSEY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1002.1, 1002.2, 1002.4, 1002.20, 1002.21, 1002.33, 1002.34, 1002.43, 1002.91, 1002.92 1002.93, 1002.94, 1002.95, and the center heading "Miscellaneous" are revoked.

3. A new § 1002.1 is added as follows:

§ 1002.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1002.12(e) the reference to "§ 1002.33" is changed to "§ 1000.5".

5. In § 1002.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1002.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1004—MILK IN MIDDLE ATLANTIC MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1004.1, 1004.2, 1004.3, 1004.4, 1004.20, 1004.21, 1004.32, 1004.33, 1004.43, 1004.89a, 1004.90, 1004.91, 1004.92, 1004.93, 1004.100, 1004.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions," are revoked.

3. A new § 1004.1 is added as follows:

§ 1004.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1004.22 paragraphs (a) through (i) are revoked and the section title and introductory text are revised as follows:

§ 1004.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1006—MILK IN UPPER FLORIDA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1006.1, 1006.2 1006.3, 1006.4, 1006.20, 1006.21, 1006.33, 1006.34, 1006.80, 1006.90, 1006.91, 1006.92, 1006.93, 1006.100, 1006.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1006.1 is added as follows:

§ 1006.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1006.17, the reference "pursuant to § 1006.33" is revoked.

5. In § 1006.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1006.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1006.40 the proviso is revoked and the colon preceding it is changed to a period.

PART 1007—MILK IN GEORGIA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1007.1, 1007.2, 1007.3, 1007.4, 1007.25, 1007.26, 1007.33, 1007.34, 1007.80, 1007.90, 1007.91, 1007.92, 1007.93, 1007.100, 1007.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1007.1 is added as follows:

§ 1007.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby

incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1007.17, the reference "pursuant to § 1007.33" is revoked.

5. In § 1007.27 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1007.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1007.40 the proviso is revoked and the colon preceding it is changed to a period.

PART 1011—MILK IN APPALACHIAN MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1011.1, 1011.2, 1011.3, 1011.4, 1011.20, 1011.21, 1011.33, 1011.34, 1011.43, 1011.73, 1011.99, 1011.100, 1011.101, 1011.102, 1011.103, 1011.110, 1011.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1011.1 is added as follows:

§ 1011.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1011.22 paragraphs (a) through (h) and paragraph (j) are revoked, and the section title and introductory text are revised as follows:

§ 1011.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1012—MILK IN TAMPA BAY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1012.1, 1012.2, 1012.3, 1012.4, 1012.20, 1012.21, 1012.33, 1012.34, 1012.80, 1012.90, 1012.91, 1012.92, 1012.93, 1012.100, 1012.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1012.1 is added as follows:

§ 1012.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1012.17, the reference "pursuant to § 1012.33" is revoked.

5. In § 1012.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1012.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1012.40 the proviso is revoked and the colon preceding the proviso is changed to a period.

PART 1013—MILK IN SOUTHEASTERN FLORIDA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1013.1, 1013.2, 1013.3, 1013.4, 1013.25, 1013.26, 1013.32, 1013.33, 1013.43, 1013.74, 1013.87, 1013.100, 1013.101, 1013.102, 1013.103, 1013.110, 1013.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1013.1 is added as follows:

§ 1013.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1013.17, the reference "pursuant to § 1013.32" is revoked.

5. In § 1013.27 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1013.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1015—MILK IN CONNECTICUT MARKETING AREA

1. The center headings are revised as follows: "General Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1015.1, 1015.5, 1015.6, 1015.30, 1015.31, 1015.44, 1015.45, 1015.90, 1015.91, 1015.92, 1015.93, 1015.94, 1015.95, 1015.96 and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1015.1 is added as follows:

§ 1015.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1015.32 paragraphs (a) through (f) and paragraphs (h) through (j) are revoked, and the section title and introductory text are revised as follows:

§ 1015.32 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

5. In § 1015.42 a new paragraph (d) is added as follows:

§ 1015.42 Reports regarding individual producers.

* * * * *

(d) Each handler under § 1015.9 (a), (c), and (d) shall submit to the market administrator, within 5 days after his request made not earlier than 22 days after the end of the month, his producer payroll for the month, which shall show for each producer or with respect to producer milk received from a cooperative association in its capacity as a handler under § 1015.9(d):

(1) The daily and total pounds of milk delivered and its average butterfat test; and

(2) The net amount of the handler's payments to the producer, or cooperative association with the prices, deductions, and charges involved.

6. In § 1015.80 the last sentence is revoked.

PART 1030—MILK IN CHICAGO REGIONAL MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1030.1, 1030.2, 1030.3, 1030.4, 1030.20, 1030.21, 1030.32, 1030.33, 1030.43, 1030.89, 1030.90, 1030.91, 1030.92, 1030.93, 1030.100, 1030.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new §1030.1 is added as follows:

§ 1030.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1030.16 paragraph (b) is revised as follows:

§ 1030.16 Producer milk.

* * * * *

(b) Received at a pool plant from a cooperative association handler pursuant to § 1030.13(e). The utilization value of such milk at class prices shall be included in the receiving handler's net pool obligation pursuant to § 1030.70;

* * * * *

5. In § 1030.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1030.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1032—MILK IN SOUTHERN ILLINOIS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1032.1, 1032.2, 1032.3, 1032.4, 1032.20, 1032.21, 1032.34, 1032.35, 1032.42, 1032.72, 1032.90, 1032.100, 1032.101, 1032.102, 1032.103, 1032.104, 1032.105, and the center headings "Termination of Obligations" and "Miscellaneous Provisions" are revoked.

3. A new § 1032.1 is added as follows:

§ 1032.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1032.22 paragraphs (a) through (g) and paragraph (j) are revoked, and the section title and introductory text are revised as follows:

§ 1032.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1033—MILK IN OHIO VALLEY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1033.1, 1033.2, 1033.3, 1033.4, 1033.25, 1033.26, 1033.32, 1033.33, 1033.44, 1033.80, 1033.81, 1033.82, 1033.83, 1033.90, 1033.91, 1033.92 and the center headings "Effective Time and Suspension or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1033.1 is added as follows:

§ 1033.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1033.18 the reference "pursuant to § 1033.32" is revoked.

5. In § 1033.27 paragraphs (a) through (j) and subparagraph (1) of paragraph (l) are revoked, and the section title and introductory text are revised as follows:

§ 1033.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1036—MILK IN EASTERN OHIO-WESTERN PENNSYLVANIA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1036.1, 1036.2, 1036.3, 1036.4, 1036.25, 1036.26, 1036.33, 1036.34, 1036.63, 1036.79, 1036.90, 1036.91, 1036.92, 1036.93, 1036.100, 1036.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1036.1 is added as follows:

§ 1036.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1036.17 the reference "pursuant to § 1036.33" is revoked.

5. In § 1036.27 paragraphs (a) through (g) and paragraphs (i) and (k) are revoked, and the section title and introductory text are revised as follows:

§ 1036.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1036.40 the proviso is revoked and the colon preceding it is changed to a period.

PART 1040—MILK IN SOUTHERN MICHIGAN MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Handler Reports, Records, and Facilities" to "Reports."

2. Sections 1040.1, 1040.2, 1040.3, 1040.4, 1040.25, 1040.26, 1040.32, 1040.33, 1040.67, 1040.100, 1040.101, 1040.102, 1040.103, 1040.104, 1040.110, 1040.111, and the center headings "Effective Time, Suspension or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1040.1 is added as follows:

§ 1040.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1040.27 paragraphs (a) through (f) and paragraphs (h) through (j) are revoked, and the section title and introductory text are revised as follows:

§ 1040.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties.

* * * * *

5. Section 1040.44 is revised as follows:

§ 1040.44 Bulk deliveries by a cooperative association.

Milk in bulk delivered by a cooperative association as a handler under § 1040.7 (c) or from the pool plant of a cooperative association to a handler's pool plant shall be classified according to use or disposition by the latter handler and the value thereof at the class prices shall be included in his net pool obligation pursuant to § 1040.60.

6. Section 1040.90 is revised as follows:

§ 1040.90 Handler exemption.

Only §§ 1040.31 and 1000.5 of this chapter, as incorporated by § 1040.1, shall apply to a handler who operates a plant, other than a plant described in § 1040.16 (b), located outside the marketing area from which fluid milk products are disposed of within the marketing area on a route(s) but from which the disposition of fluid milk products on all routes operated wholly or partly within the marketing area averages less than 600 pounds per day for the month, and from which no milk is transferred to other handlers.

7. In § 1040.91 paragraph (a) is revised as follows:

§ 1040.91 Handlers subject to other Federal orders.

(a) Only § 1040.31, paragraph (b) of this section, and § 1000.5 of this chapter, as incorporated by § 1040.1, shall apply to a handler who operates a plant at which during the month milk is fully subject to the classification, pricing, and payment provisions of another order issued pursuant to the Act and the disposition of fluid milk products, except filled milk, in the other Federal marketing area exceeds that in the Southern Michigan marketing area.

* * * * *

8. Section 1040.92 is revised as follows:

§ 1040.92 Producer handler exemption.

Only §§ 1040.31 and 1000.5 of this chapter, as incorporated by § 1040.1, shall apply to a producer-handler.

PART 1043—MILK IN UPSTATE MICHIGAN MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1043.1, 1043.2, 1043.3, 1043.4, 1043.20, 1043.21, 1043.34, 1043.35, 1043.44, 1043.64, 1043.78, 1043.90, 1043.91, 1043.92, 1043.93, 1043.100, 1043.101, and the center headings "Effective Time, Suspension or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1043.1 is added as follows:

§ 1043.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1043.22 paragraphs (a) through (h) are revoked, and the section title and introductory text are revised as follows:

§ 1043.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market

administrator shall perform the following duties:

* * * * *

5. Section 1043.81 is revised as follows:

§ 1043.81 Producer-handler exemption.

Only §§ 1043.32 and 1000.5 of this chapter, as incorporated by § 1043.1, shall apply to a producer-handler.

6. Section 1043.82 is revised as follows:

§ 1043.82 Handler exemption.

Only §§ 1043.33 and 1000.5 of this chapter, as incorporated by § 1043.1, shall apply to a handler who operates a plant from which an average of less than 100 points (one point being defined as one pint of half-and-half or one quart of any other Class I product) of Class I milk per day is disposed of in the marketing area during the month on routes.

PART 1044—MILK IN MICHIGAN UPPER PENINSULA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1044.1, 1044.2, 1044.3, 1044.4, 1044.20, 1044.21, 1044.34, 1044.35, 1044.44, 1044.64, 1044.75, 1044.90, 1044.91, 1044.92, 1044.93, 1044.100, 1044.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1044.1 is added as follows:

§ 1044.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1044.22 paragraphs (a) through (h) are revoked, and the section title and introductory text are revised as follows:

§ 1044.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

5. Section 1044.80 is revised as follows:

§ 1044.80 Producer-handler exemption.

Only §§ 1044.33 and 1000.5 of this chapter, as incorporated by § 1044.1, shall apply to a producer handler.

6. Section 1044.81 is revised as follows:

§ 1044.81 Exempt handler.

Only §§ 1044.33 and 1000.5 of this chapter, as incorporated by § 1044.1, shall apply to a handler who operates a fluid milk plant, of the type specified in § 1044.8(a), located outside the marketing area from which an average of less than 600 pounds of fluid milk products per day are disposed of during the month in the marketing area on route(s).

PART 1046—MILK IN LOUISVILLE-LEXINGTON-EVANSVILLE MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1046.1, 1046.2, 1046.3, 1046.4, 1046.20, 1046.21, 1046.33, 1046.34, 1046.43, 1046.89, 1046.90, 1046.91, 1046.92, 1046.93, 1046.100, 1046.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1046.1 is added as follows:

§ 1046.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1046.22 paragraphs (a) through (i) and paragraph (l) are revoked, and the section title and introductory text are revised as follows:

§ 1046.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1049—MILK IN INDIANA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1049.1, 1049.2, 1049.3, 1049.4, 1049.25, 1049.26, 1049.33, 1049.34, 1049.43, 1049.87, 1049.90, 1049.91, 1049.92, 1049.93, 1049.100, 1049.101, and the center headings "Effective Time, Suspension or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1049.1 is added as follows:

§ 1049.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1049.27 paragraphs (a) through (i) and paragraph (l) are revoked, and the section title and introductory text are revised as follows:

§ 1049.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1050—MILK IN CENTRAL ILLINOIS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1050.1, 1050.2, 1050.3, 1050.4, 1050.20, 1050.21, 1050.34, 1050.35, 1050.42, 1050.72, 1050.90, 1050.100, 1950.101, 1050.102, 1050.103, 1050.104, 1050.105, and the center headings "Termination of Obligations" and "Miscellaneous Provisions" are revoked.

3. A new § 1050.1 is added as follows:

§ 1050.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1050.22 paragraphs (a) through (g) and paragraph (j) are revoked, and the section title and introductory text are revised as follows:

§ 1050.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1060—MILK IN MINNESOTA-NORTH DAKOTA MARKETING AREA

1. The center headings are revised as follows: "General Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1060.1, 1060.4, 1060.6, 1060.7, 1060.30, 1060.31, 1060.38, 1060.39, 1060.43, 1060.89, 1060.90, 1060.91, 1060.92, 1060.93, 1060.100, 1060.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1060.1 is added as follows:

§ 1060.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1060.32 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1060.32 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c), of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1061—MILK IN SOUTHEASTERN MINNESOTA-NORTHERN IOWA (DAIRYLAND) MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1061.1, 1061.2, 1061.3, 1061.4, 1061.20, 1061.21, 1061.32, 1061.33, 1061.43, 1061.93, 1061.94, 1061.95, 1061.100, 1061.101, 1061.102, 1061.103, and the center heading "Effective Time, Suspension, or Termination" are revoked.

3. A new § 1061.1 is added as follows:

§ 1061.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1061.22 paragraphs (a) through (g) are revoked, and paragraph (i), the section title and introductory text are revised as follows:

§ 1061.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

(i) On or before the 12th day after the end of each month, announce the uniform price computed pursuant to § 1061.71 and the producer butterfat differential pursuant to § 1061.81.

* * * * *

PART 1062—MILK IN ST. LOUIS-OZARKS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1062.1, 1062.2, 1062.3, 1962.4, 1062.20, 1062.21, 1062.33, 1062.34, 1062.43, 1062.72, 1062.89, 1062.90, 1062.91, 1062.92, 1062.93, 1062.94, 1062.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1062.1 is added as follows:

§ 1062.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1062.22 paragraphs (a) through (h) and paragraph (j) are revoked, and the section title and introductory text are revised as follows:

§ 1062.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1063—MILK IN QUAD CITIES-DUBUQUE MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1063.1, 1063.2, 1063.3, 1063.4, 1063.20, 1063.21, 1063.32, 1063.33, 1063.43, 1063.89, 1063.90, 1063.91, 1063.92, 1063.93, 1063.94, 1063.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1063.1 is added as follows:

§ 1063.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1063.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1063.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1064—MILK IN GREATER KANSAS CITY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1064.1, 1064.2, 1064.3, 1064.4, 1064.20, 1064.21, 1064.33, 1064.34, 1064.43, 1064.89, 1064.90, 1064.91, 1064.92, 1064.93, 1064.100, 1064.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1064.1 is added as follows:

§ 1064.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1064.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1064.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1065—MILK IN NEBRASKA-WESTERN IOWA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1065.1, 1065.2, 1065.3, 1065.4, 1065.20, 1065.21, 1065.33, 1065.34, 1065.43, 1065.74, 1065.87, 1065.90, 1065.91, 1065.92, 1065.93, 1065.94, 1065.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1065.1 is added as follows:

§ 1065.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1065.15, the reference "pursuant to § 1065.33" is revoked.

5. In § 1065.22 revoke paragraphs (a) through (i) and revise the section title and introductory text as follows:

§ 1065.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1065.61 the introductory text is revised as follows:

§ 1065.61 Plants subject to other Federal orders.

Only §§ 1065.32, 1000.5 of this chapter, as incorporated by § 1065.1, and paragraph (c) of this section shall apply to a handler with respect to the operation of plants described in paragraphs (a) or (b) of this paragraph.

* * * * *

PART 1068—MILK IN MINNEAPOLIS-ST. PAUL, MINN., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1068.1, 1068.2, 1068.3, 1068.5, 1068.6, 1068.20, 1068.21, 1068.33, 1068.34, 1068.43, 1068.73, 1068.93, 1068.94, 1068.100, 1068.101, 1068.102, 1068.103, and the center heading "Effective Time, Suspension, or Termination" are revoked.

3. A new § 1068.1 is added as follows:

§ 1068.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1068.22 paragraphs (a) through (f) are revoked, and the section title and introductory text are revised as follows:

§ 1068.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

5. In the introductory paragraph of § 1068.62, the reference "§ 1068.33" is changed to "§ 1000.5 of this chapter."

PART 1069—MILK IN DULUTH-SUPERIOR MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1069.1, 1069.2, 1069.3, 1069.4, 1069.20, 1069.21, 1069.33, 1069.34, 1069.43, 1069.72, 1069.89, 1069.90, 1069.91, 1069.92, 1069.93, 1069.94, 1069.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1069.1 is added as follows:

§ 1069.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1069.22 paragraphs (a) through (h) and paragraph (j) are revoked, and the section title and introductory text are revised as follows:

§ 1069.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1070—MILK IN CEDAR RAPIDS-IOWA CITY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1070.1, 1070.2, 1070.3, 1070.4, 1070.20, 1070.21, 1070.32, 1070.33, 1070.43, 1070.89, 1070.90, 1070.91, 1070.92, 1070.93, 1070.100, 1070,101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1070.1 is added as follows:

§ 1070.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1070.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1070.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1071—MILK IN NEOSHO VALLEY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1071.1, 1071.2, 1071.3, 1071.4, 1071.20, 1071.21, 1071.33, 1071.34, 1071.43, 1071.98, 1071.100, 1071.101, 1071.102, 1071.103, 1071.110, 1071.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1071.1 is added as follows:

§ 1071.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1071.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1071.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1073—MILK IN WICHITA, KANS., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1073.1, 1073.2, 1073.3, 1073.4, 1073.20, 1073.21, 1073.33, 1073.34, 1073.43, 1073.72, 1073.89, 1073.90, 1073.91, 1073.92, 1073.93, 1073.94, 1073.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1073.1 is added as follows:

§ 1073.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1073.22 paragraphs (a) through (h) and paragraph (j) are revoked, and the section title and introductory text are revised as follows:

§ 1073.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1075—MILK IN BLACK HILLS, S. DAK., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1075.1, 1075.2, 1075.3, 1075.4, 1075.25, 1075.26, 1075.32, 1075.33, 1075.43, 1075.74, 1075.89, 1075.90, 1075.91, 1075.92, 1075.93, 1075.94, 1075.95, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1075.1 is added as follows:

§ 1075.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1075.27 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1075.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1076—MILK IN EASTERN SOUTH DAKOTA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1076.1, 1076.2, 1076.3, 1076.4, 1076.25, 1076.26, 1076.33, 1076.34, 1076.43, 1076.76, 1076.86, 1076.100, 1076.101, 1076.102, 1076.103, 1076.104, 1076.105, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1076.1 is added as follows:

§ 1076.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1076.27 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1076.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

5. In § 1076.61 the introductory text is revised as follows:

§ 1076.61 Plants subject to other Federal orders.

Only §§ 1076.32, 1000.5 of this chapter, as incorporated by § 1076.1, and paragraph (c) of this section shall apply to a handler with respect to the operation of plants described in paragraph (a) or (b) of this section.

* * * * *

PART 1078—MILK IN NORTH CENTRAL IOWA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1078.1, 1078.2, 1078.3, 1078.4, 1078.20, 1078.21, 1078.32, 1078.33, 1078.43, 1078.86, 1078.90, 1078.91, 1078.92, 1078.93, 1078.100, 1078.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1078.1 is added as follows:

§ 1078.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1078.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1078.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1079—MILK IN DES MOINES, IOWA, MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1079.1, 1079.2, 1079.3, 1079.4, 1079.25, 1079.26, 1079.32, 1079.33, 1079.43, 1079.89, 1079.90, 1079.91, 1079.92, 1079.93, 1079.100, 1079.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1079.1 is added as follows:

§ 1079.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1079.27 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1079.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1090—MILK IN CHATTANOOGA, TENN., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1090.1, 1090.2, 1090.4, 1090.19, 1090.25, 1090.26, 1090.32, 1090.33, 1090.43, 1090.75, 1090.87, 1090.100, 1090.101, 1090.102, 1090.103, 1090.110, 1090.111, and center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1090.1 is added as follows:

§ 1090.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In §1090.27 paragraphs (a) through (g) and paragraphs (i) and (j) are revoked, and the section title and introductory text are revised as follows:

§ 1090.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1094—MILK IN NEW ORLEANS, LA., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1094.1, 1094.2, 1094.3, 1094. 5, 1094.20, 1094.21, 1094.34, 1094.35, 1094.43, 1094.77, 1094.87, 1094.100, 1094.101, 1094.102, 1094.103, 1094.110, 1094.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1094.1 is added as follows:

§ 1094.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1094.16 the reference "pursuant to § 1094.34" is revoked.

5. In § 1094.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1094.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. Section 1094.60 is revised as follows:

§ 1094.60 Producer-handler exemption.

Only §§ 1094.32 and 1000.5 of this chapter, as incorporated by § 1094.1, shall apply to a producer-handler.

7. The introductory text of § 1094.63 is revised as follows:

§ 1094.63 Plants subject to other Federal orders.

Only §§ 1094.32 and 1000.5 of this chapter, as incorporated by § 1094.1, and paragraph (c) of this section shall apply to a handler operating a plant specified in paragraphs (a) or (b) of this section.

* * * * *

PART 1096—MILK IN NORTHERN LOUISIANA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1096.1, 1096.2, 1096.3, 1096.4, 1096.25, 1096.26, 1096.33, 1096.34, 1096.43, 1096.87, 1096.90, 1096.91, 1096.92, 1096.93, 1096.94, 1096.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1096.1 is added as follows:

§ 1096.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1096.27 paragraphs (a) through (i) and paragraph (l) are revoked, and the section title and introductory text are revised as follows:

§ 1096.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1097—MILK IN MEMPHIS, TENN., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1097.1, 1097.2, 1097.3, 1097.4, 1097.20, 1097.21, 1097.32, 1097.33, 1097.43, 1097.98, 1097.100, 1097.101, 1097.-102, 1097.103, 1097.110, 1097.111, and the center headings "Effective Time, Suspension or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1097.1 is added as follows:

§ 1097.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1097.22 paragraphs (a) through (h) and paragraphs (j) and (l) are revoked, and the section title and introductory text are revised as follows:

§ 1097.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1098—MILK IN NASHVILLE, TENN., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1098.1, 1098.2, 1098.3, 1098.4, 1098.20, 1098.21, 1098.33, 1098.34, 1098.43, 1098.73, 1098.88, 1098.100, 1098.101, 1098.102, 1098.103, 1098.104, 1098.105, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1098.1 is added as follows:

§ 1098.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1098.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1098.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1099—MILK IN PADUCAH, KY., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1099.1, 1099.2, 1099.3, 1099.4, 1099.20, 1099.21, 1099.33, 1099.34, 1099.42, 1099.89, 1099.90, 1099.91, 1099.92, 1099.93, 1099.100, 1099.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1099.1 is added as follows:

§ 1099.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1099.22 paragraphs (a) through (g) and paragraphs (i) and (j) are revoked, and the section title and introductory text are revised as follows:

§ 1099.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1101—MILK IN KNOXVILLE, TENN., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1101.1, 1101.2, 1101.3, 1101.4, 1101.20, 1101.21, 1101.32, 1101.33, 1101.43, 1101.73, 1101.89, 1101.100, 1101.101, 1101.102, 1101.103, 1101.110, 1101.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1101.1 is added as follows:

§ 1101.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1101.22 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1101.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1102—MILK IN FORT SMITH, ARK., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1102.1, 1102.2, 1102.3, 1102.4, 1102.20, 1102.21, 1102.33, 1102.34, 1102.43, 1102.85, 1102.100, 1102.101, 1102.102, 1102.103, 1102.110, 1102.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1102.1 is added as follows:

§ 1102.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1102.22 paragraphs (a) through (h) and paragraph (l) are revoked, and the section title and introductory text are revised as follows:

§ 1102.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the followduties:

* * * * *

PART 1103—MILK IN MISSISSIPPI MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1103.1, 1103.2, 1103.3, 1103.4, 1103.20, 1103.21, 1103.33, 1103.34, 1103.43, 1103.100, 1103.105, 1103.106, 1103.107, 1103.108, 1103.109, 1103.110, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1103.1 is added as follows:

§ 1103.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1103.22 paragraphs (a) through (h) and paragraphs (k) and (l) are revoked, and the section title and introductory text are revised as follows:

§ 1103.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1104—MILK IN RED RIVER VALLEY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1104.1, 1104.2, 1104.3, 1104.5, 1104.25, 1104.26, 1104.33, 1104.34, 1104.43, 1104.87, 1104.90, 1104.91, 1104.92, 1104.93, 1104.100, 1104.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1104.1 is added as follows:

§ 1104.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1104.27 paragraphs (a) through (g) and paragraphs (i) and (j) are revoked, and the section title and introductory text are revised as follows:

§ 1104.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1106—MILK IN OKLAHOMA METROPOLITAN MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1106.1, 1106.2, 1106.3, 1106.4, 1106.20, 1106.21, 1106.33, 1106.34, 1106.43, 1106.89, 1106.90, 1106.91, 1106.92, 1106.93, 1106.100, 1106.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1106.1 is added as follows:

§ 1106.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1106.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1106.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1108—MILK IN CENTRAL ARKANSAS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1108.1, 1108.2, 1108.3, 1108.5, 1108.25, 1108.26, 1108.32, 1108.33, 1108.43, 1108.75, 1108.87, 1108.100, 1108.101, 1108.102, 1108.103, 1108.110, 1108.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1108.1 is added as follows:

§ 1108.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1108.27 paragraphs (a) through (g) and paragraph (j) are revoked, and the section title, introductory text, and paragraph (i) are revised as follows:

§ 1108.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

(i) On or before the 11th day after the end of each of the months March through July, the market administrator shall notify each handler of the amount of base milk and excess milk received from each producer.

* * * * *

PART 1120—MILK IN LUBBOCK-PLAINVIEW, TEX., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1120.1, 1120.2, 1120.3, 1120.4, 1120.25, 1120.26, 1120.32, 1120.33,

1120.43, 1120.88, 1120.90, 1120.91, 1120.92, 1120.93, 1120.94, 1120.95, and the center heading "Miscellaneous Provisions" are revoked.

3. A new § 1120.1 is added as follows:

§ 1120.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1120.16 the reference "pursuant to § 1120.32" is revoked.

5. In § 1120.27 paragraphs (a) through (i) and paragraph (l) are revoked, and the section title and introductory text are revised as follows:

§ 1120.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1121—MILK IN SOUTH TEXAS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1121.1, 1121.2, 1121.3, 1121.4, 1121.20, 1121.21, 1121.33, 1121.34, 1121.43, 1121.89, 1121.90, 1121.91, 1121.92, 1121.93, 1121.100, 1121.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1121.1 is added as follows:

§ 1121.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1121.17 the reference "pursuant to § 1121.33" is revoked.

5. In § 1121.22 paragraphs (a) through (h) and paragraphs (j) and (k) are revoked, and the section title and introductory text are revised as follows:

§ 1121.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1124—MILK IN OREGON-WASHINGTON MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1124.1, 1124.2, 1124.3, 1124.4, 1124.20, 1124.21, 1124.33, 1124.34, 1124.43, 1124.88, 1124.90, 1124.91, 1124.92, 1124.93, 1124.100, 1124.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1124.1 is added as follows:

§ 1124.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (c) of § 1124.14 the reference "pursuant to § 1124.33" is revoked.

5. In § 1124.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title, introductory text, and paragraph (j) are revised as follows:

§ 1124.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

(j) On or before the 14th day after the end of each month report to each cooperative association which so requests the amount and class utilization of producer milk delivered from members of such association to each proprietary handler receiving such milk. For the purpose of this report, the milk so received shall be prorated to each class in accordance with the total utilization of producer milk by such handler;

* * * * *

PART 1125—MILK IN PUGET SOUND, WASH., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions," "Reports, Records, and Facilities" to "Reports," and "Miscellaneous Provisions" to "Class I Base Provisions."

2. Sections 1125.1, 1125.2, 1125.3, 1125.4, 1125.20, 1125.21, 1125.33, 1125.34, 1125.43, 1125.89, 1125.90, 1125.91, 1125.92, 1125.93, 1125.100, 1125.101, and the center heading "Effective Time, Suspension, or Termination" are revoked.

3. A new § 1125.1 is added as follows:

§ 1125.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1125.14(e) the reference to "§ 1125.33" is changed to "§ 1000.5".

5. In § 1125.22 paragraphs (a) through (h) and paragraphs (j) and (l) are revoked, and the section title and introductory text are revised as follows:

§ 1125.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. The introductory text of § 1125.66 is revised as follows:

§ 1125.66 Plants subject to other Federal orders.

Only §§ 1125.30(e), 1125.32, paragraph (c) of this section, and § 1000.5, as incorporated by § 1125.1, shall apply to a handler with respect to the operation of plants described as follows:

* * * * *

PART 1126—MILK IN NORTH TEXAS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1126.1, 1126.2, 1126.3, 1126.4, 1126.25, 1126.26, 1126.33, 1126.34, 1126.43, 1126.98, 1126.100, 1126.101, 1126.102, 126.103, 1126.110, 1126.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1126.1 is added as follows:

§ 1126.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1126.27 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1126.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1127—MILK IN SAN ANTONIO, TEX., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1127.1, 1127.2, 1127.3, 1127.20, 1127.21, 1127.33, 1127.34, 1127.43, 1127.89, 1127.90, 1127.91, 1127.92, 1127.93, 1127.100, 1127.101 and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1127.1 is added as follows:

§ 1127.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1127.22 paragraphs (a) through (h) and paragraph (k) are revoked and the section title and introductory text are revised as follows:

§ 1127.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1128—MILK IN CENTRAL WEST TEXAS MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1128.1, 1128.2, 1128.3, 1128.4, 1128.20, 1128.21, 1128.33, 1128.34, 1128.43, 1128.99, 1128.100, 1128.101, 1128.102, 1128.103, 1128.110, 1128.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1128.1 is added as follows:

§ 1128.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1128.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1128.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1129—MILK IN AUSTIN-WACO, TEX., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1129.1, 1129.2, 1129.3, 1129.4, 1129.25, 1129.26, 1129.33, 1129.34, 1129.43, 1129.96, 1129.100, 1129.101, 1129.102, 1129.103, 1129.110, 1129.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1129.1 is added as follows:

§ 1129.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1129.27 paragraphs (a) through (h) and paragraphs (j) and (l) are revoked, and the section title and introductory text are revised as follows:

§ 1129.27 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1130—MILK IN CORPUS CHRISTI, TEX., MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1130.1, 1130.2, 1130.3, 1130.4, 1130.20, 1130.21, 1130.33, 1130.34, 1130.43, 1130.89, 1130.90, 1130.91, 1130.92, 1130.93, 1130.100, 1130.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1130.1 is added as follows:

§ 1130.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1130.22 paragraphs (a) through (h) and paragraphs (j) and (k) are revoked, and the section title and introductory text are revised as follows:

§ 1130.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1131—MILK IN CENTRAL ARIZONA MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1131.1, 1131,2, 1131.3, 1131.4, 1131.12, 1131.20, 1131.21, 1131.32, 1131.33, 1131.43, 1131.74, 1131.87, 1131.100, 1131.101, 1131.102, 1131.103, 1131.110, 1131.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1131.1 is added as follows:

§ 1131.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1131.22 paragraphs (a) through (g) and paragraphs (i) and (j) are revoked, and the section title and introductory text are revised as follows:

§ 1131.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1132—MILK IN TEXAS PANHANDLE MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1132.1, 1132.2, 1132.3, 1132.4, 1132.25, 1132.26, 1132.32, 1132.33, 1132.43, 1132.90, 1132.100, 1132.101, 1132.102, 1132.103, 1132.110, 1132.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1132.1 is added as follows:

§ 1132.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1132.12 the paragraphs are redesignated as follows: "paragraph (b)" is "paragraph (a–1)"; "paragraph (c)" is "paragraph (b)"; "paragraph (d)" is "paragraph (c)"; "paragraph (e)" is "paragraph (d)".

5. In § 1132.27 paragraphs (a) through (i) are revoked, and the section title and introductory text are revised as follows:

§ 1132.27 Additional duties of the market administrator.

In addition to the duties, specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1133—MILK IN INLAND EMPIRE MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1133.1, 1133.2, 1133.3, 1133.4, 1133.20, 1133.21, 1133.33, 1133.34, 1113.43, 1133.89, 1133.90, 1133.91, 1133.92, 1133.93, 1133.100, 1133.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1133.1 is added as follows:

§ 1133.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1133.22 paragraphs (a) through (h) and paragraphs (j) and (l) are revoked, and the section title and introductory text are revised as follows:

§ 1133.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

PART 1134—MILK IN WESTERN COLORADO MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1134.1, 1134.2, 1134.3, 1134.4, 1134.20, 1134.21, 1134.33, 1134.34, 1134.43, 1134.72, 1134.89, 1134.90, 1134.91, 1134.92, 1134.93, 1134.100, 1134.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1134.1 is added as follows:

§ 1134.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1134.15 the reference "pursuant to § 1134.33" is revoked.

5. In § 1134.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1134.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1134.44 paragraph (a) is revised as follows:

§ 1134.44 Transfers.

* * * * *

(a) At the utilization indicated in writing to the market administrator by the operators of both plants, on or before the seventh day after the end of the month within which such transfer occurred, otherwise as Class I milk, if transferred from a pool plant to the pool plant of another handler (except that for the purpose of this paragraph milk that was physically received at a pool plant from a handler pursuant to § 1134.11(d) or in bulk from a plant operated by a cooperative association shall be considered as a receipt of producer milk at the transferee plant), subject to the following conditions:

* * * * *

7. In § 1134.46 the introductory text is revised as follows:

§ 1134.46 Allocation of skim milk and butterfat classified.

After making the computations under § 1134.45 the market administrator shall determine each month for each handler the classification of milk received from producers by each handler under § 1134.11 (c) and (d) which was not received at a pool plant, and the classification of milk received from producers, in bulk from pool plants operated by cooperative associations and from handlers under § 1134.11(d) at a pool plant(s). For the purpose of this section, milk that was physically received at a pool plant from a handler pursuant to § 1134.11(d) or transferred in bulk from a pool plant operated by a cooperative association shall be considered as a receipt of producer milk at the transferee plant.

* * * * *

PART 1136—MILK IN GREAT BASIN MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1136.1, 1136.2, 1136.3, 1136.4, 1136.20, 1136.21, 1136.33, 1136.34, 1136.40, 1136.74, 1136.87, 1136.90, 1136.91, 1136.92, 1136.93, 1136.110, 136.111, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1136.1 is added as follows:

§ 1136.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1136.14 the reference "pursuant to § 1136.33" is revoked.

5. In § 1136.22 paragraphs (a) through (g) and paragraphs (i) and (j) are revoked, and the section title and introductory text are revised as follows:

§ 1136.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1136.44 the introductory text is revised as follows:

§ 1136.44 Allocation of skim milk and butterfat classified.

After making the computations pursuant to § 1136.43, the market administrator shall determine each month the classification of milk received from producers by each cooperative association handler pursuant to § 1136.9 (b) and (c) which was not received at a pool plant and the classification of milk received from producers and from cooperative association handlers pursuant to § 1136.9(c) by each handler. For the purpose of this section, milk that was physically received at a pool plant from a handler pursuant to § 1136.9(c) shall be considered as a receipt of producer milk at such plant.

* * * * *

PART 1137—MILK IN EASTERN COLORADO MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1137.1, 1137.2, 1137.3, 1137.4, 1137.20, 1137.21, 1137.33, 1137.34, 1137.43, 1137.72, 1137.89, 1137,90, 1137.91, 1137.92, 1137.93, 1137.100, 1137.101, and center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1137.1 is added as follows:

§ 1137.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In paragraph (b) of § 1137.13 the reference "pursuant to § 1137.33" is revoked.

5. In § 1137.22 paragraphs (a) through (h) and paragraph (k) are revoked, and the section title and introductory text are revised as follows:

§ 1137.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

6. In § 1137.44 paragraph (a) is revised as follows:

§ 1137.44 Transfers.

* * * * *

(a) At the utilization indicated by the operator of both plants, otherwise as Class I milk, if transferred from a pool plant to another pool plant (except that for the purpose of this paragraph milk that was physically received at a pool plant from a handler pursuant to § 1137.9 (d) or transferred in bulk from a pool plant operated by a cooperative association shall be considered as a receipt of producer milk at the transferee plant), subject to the following conditions:

* * * * *

7. In § 1137.46 the introductory text is revised as follows:

§ 1137.46 Allocation of skim milk and butterfat classified.

After making the computations pursuant to § 1137.45, the market administrator shall determine each month for each handler the classification of milk received from producers by each handler pursuant to § 1137.9 (c) and (d) which was not received at a pool plant and the classification of milk received from producers, in bulk from pool plants operated by cooperative associations and from handlers pursuant to § 1137.9(d) at a pool plant(s). For the purpose of this section, milk that was physically received at a pool plant from a handler pursuant to § 1137.9(d) or transferred in bulk from a pool plant operated by a cooperative association shall be considered as a receipt of producer milk at the transferee plant.

* * * * *

PART 1138—MILK IN RIO GRANDE VALLEY MARKETING AREA

1. The center headings are revised as follows: "Definitions" to "General Provisions and Definitions" and "Reports, Records, and Facilities" to "Reports."

2. Sections 1138.1, 1138.2, 1138.3, 1138.4, 1138.20, 1138.21, 1138.34, 1138.35, 1138.43, 1138.72, 1138.89, 1138.90, 1138.91, 1138.92, 1138.93, 1138.100, 1138.101, and the center headings "Effective Time, Suspension, or Termination" and "Miscellaneous Provisions" are revoked.

3. A new § 1138.1 is added as follows:

§ 1138.1 General provisions.

The terms, definitions, and provisions in Part 1000 of this chapter are hereby incorporated by reference and made a part of this order.

4. In § 1138.22 paragraphs (a) through (h) and paragraph (k) are revoked, and

the section title and introductory text are revised as follows:

§ 1138.22 Additional duties of the market administrator.

In addition to the duties specified in § 1000.3(c) of this chapter, the market administrator shall perform the following duties:

* * * * *

5. In § 1138.46 the introductory text is revised as follows:

§ 1138.46 Allocation of skim milk and butterfat classified.

After making the computations pursuant to § 1138.45, the market administrator shall determine the classification of producer milk received at each pool plant for each handler each month pursuant to the provisions of this section. Milk received at a pool plant from a cooperative association in its capacity as a handler pursuant to § 1138.9(c) shall be classified and allocated as producer milk.

* * * * *

6. In § 1138.70 the introductory text is revised and a new paragraph (a–1) is added as follows:

§ 1138.70 Computation of the net pool obligation of each pool handler.

The net pool obligation of each pool handler at each pool plant and of each cooperative association in its capacity as a handler pursuant to § 1138.9(b) or as a handler pursuant to § 1138.9(c) only for milk not delivered to a pool plant, during each month, shall be a sum of money computed as follows:

* * * * *

(a–1) Multiply the quantity of producer milk in each class as computed pursuant to §§ 1138.40 through 1138.46 for each cooperative association as a handler pursuant to § 1138.9(b) or as a handler pursuant to § 1138.9(c) for the milk not delivered to a pool plant, by the applicable class prices adjusted pursuant to §§ 1138.52 and 1138.53;

* * * * *

7. Section 1138.88 is revised as follows:

§ 1138.88 Expense of administration.

As his pro rata share of the expense of administration of the order, each handler shall pay to the market administrator on or before the 16th day after the end of the month five cents per hundredweight or such lesser amount as the Secretary may prescribe, with respect to (a) producer milk including such handler's own production, provided that for the purpose of this section milk received at a pool plant from a handler pursuant to § 1138.9(c) shall be considered as a receipt of producer milk by the handler operating such pool plant and shall be excluded from the producer milk of the handler pursuant to § 1138.9(c), (b) other source milk allocated to Class I pursuant to § 1138.46(a)(2)(i), (3) and (7) and the corresponding steps of § 1138.46(b), except other source milk on which no handler obligation applies pursuant to § 1138.70(e) and (c) Class I milk disposed of from a partially regulated distributing plant on routes in the marketing area that exceeds Class I milk specified in § 1138.62(b)(2): *Provided*, That if a handler with respect to milk pursuant to (a), (b), or (c) of this section elects pursuant to § 1138.36 to use two accounting periods in any month the applicable rate of assessment for such handler shall be the rate set forth above multiplied by two or such lesser rate as the Secretary may determine is demonstrated as appropriate in terms of the particular cost of administering the additional accounting period.

(Secs. 1–19, 48 Stat. 31, as amended; 7 U.S.C. 601–674)

Effective date: July 1, 1971.

Signed at Washington, D.C., on May 26, 1971.

RICHARD E. LYNG,
Assistant Secretary.

[FR Doc.71-7588 Filed 5-28-71;8:51 am]

[Milk Order No. 36; Docket No. AO-179-A34]

PART 1036—MILK IN EASTERN OHIO-WESTERN PENNSYLVANIA MARKETING AREA

Order Amending Order

Findings and determinations. The findings and determinations hereinafter set forth are supplementary and in addition to the findings and determinations previously made in connection with the issuance of the aforesaid order and of the previously issued amendments thereto; and all of said previous findings and determinations are hereby ratified and affirmed, except insofar as such findings and determinations may be in conflict with the findings and determinations set forth herein.

(a) *Findings.* A public hearing was held upon certain proposed amendments to the tentative marketing agreement and to the order regulating the handling of milk in the Eastern Ohio-Western Pennsylvania marketing area. The hearing was held pursuant to the provisions of the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601 et seq.), and the applicable rules of practice and procedure (7 CFR Part 900).

Upon the basis of the evidence introduced at such hearing and the record thereof, it is found that:

(1) The said order as hereby amended, and all of the terms and conditions thereof, will tend to effectuate the declared policy of the Act;

(2) The parity prices of milk, as determined pursuant to section 2 of the Act, are not reasonable in view of the price of feeds, available supplies of feeds, and other economic conditions which affect market supply and demand for milk in the said marketing area, and the minimum prices specified in the order as hereby amended, are such prices as will reflect the aforesaid factors, insure a sufficient quantity of pure and wholesome milk, and be in the public interest; and

(3) The said order as hereby amended regulates the handling of milk in the same manner as, and is applicable only to persons in the respective classes of industrial or commercial activity specified in, a marketing agreement upon which a hearing has been held.

(b) *Determinations.* It is hereby determined that:

(1) The refusal or failure of handlers (excluding cooperative associations specified in section 8c(9) of the Act) of more than 50 percent of the milk, which is marketed within the marketing area, to sign a proposed marketing agreement, tends to prevent the effectuation of the declared policy of the Act;

(2) The issuance of this order, amending the order, is the only practical means pursuant to the declared policy of the Act of advancing the interests of producers as defined in the order as hereby amended; and

(3) The issuance of the order amending the order is approved or favored by at least two-thirds of the producers who during the determined representative period were engaged in the production of milk for sale in the marketing area.

Order relative to handling. It is therefore ordered, that on and after the effective date hereof, the handling of milk in the Eastern Ohio-Western Pennsylvania marketing area shall be in conformity to and in compliance with the terms and conditions of the aforesaid order, as amended, and as hereby further amended, as follows:

§ 1036.70 Time and method of payment.

(a) Except as provided in paragraph (b) of this section, each handler shall make payment for producer milk as follows:

(1) On or before the last day of the month, to each producer who has not discontinued delivery of milk to such handler, not less than the amount determined by multiplying the pounds of producer milk received from such producer during the first 15 days of the month by the Class III price for the preceding month, without adjustment for butterfat content, less proper deductions authorized by the producer; and

(2) On or before the 18th day after the end of the month, to each producer not less than the amount determined by multiplying the pounds of producer milk received from such producer during the month by the uniform price as adjusted pursuant to §§ 1036.71 and 1036.72, less the following amounts:

(i) The payment made pursuant to subparagraph (1) of this paragraph for such month;

(ii) Proper deductions authorized by the producer;

(iii) Any marketing service deduction pursuant to § 1036.76; and

(iv) If before such date the handler has not received full payment from the market administrator pursuant to § 1036.75 for such month, he may reduce pro rata his payments to producers by not more than the amount of such underpayment. Payment to producers shall be

completed thereafter not later than the date for making payments pursuant to this subparagraph next following after receipt of the balance due from the market administrator.

(b) Upon receipt of a written request from a cooperative association which the Secretary determines is authorized by its members to collect payment for their milk and receipt of a written promise to reimburse the handler the amount of any actual loss incurred by him because of any improper claim on the part of the cooperative association, each handler shall pay to the cooperative association for producer milk received from such members an amount equal to the sum of the individual payments otherwise payable to such producers pursuant to subparagraph (1) or (2), as the case may be, of paragraph (a) of this section. Such payment shall be made on or before the second day prior to the date specified in such applicable subparagraph. Payments under this paragraph shall be subject to the following conditions:

(1) Each handler shall submit to the cooperative association with such payments written information which shows for each such producer:

(i) The total pounds of milk received from him during the period for which the payment applies;

(ii) With respect to the payment described in paragraph (a) (2) only of this section, the total pounds of butterfat contained in such milk;

(iii) The number of days on which milk was received; and

(iv) The amount of any deductions authorized by the producer;

(2) Payments to a cooperative association and the submission of information by handlers pursuant to this paragraph shall be made with respect to that milk of each producer whom the cooperative association certifies is a member which is received on and after the first day of the calendar month next following the receipt of such certification through the last day of the month next preceding the receipt of a notice from the cooperative association of a termination of membership or until the original request is rescinded in writing by the cooperative association; and

(3) A copy of each such request, promise to reimburse, and certified list, of members shall be filed simultaneously with the market administrator by the cooperative association and shall be subject to verification at his discretion through audit of the records of the cooperative association pertaining thereto. Exceptions, if any, to the accuracy of such certification by a producer claimed to be a member, or by a handler, shall be made by written notice to the market administrator and shall be subject to his determination.

(c) On or before the 15th day after the end of the month, each handler shall pay a cooperative association at not less than the class prices applicable pursuant to § 1036.51 for milk he receives:

(1) By transfer or diversion from a pool plant operated by such cooperative association; or

(2) From such cooperative association in its capacity as a handler pursuant to § 1036.13(d), if such cooperative association also operates a pool plant.

(Secs. 1–19, 48 Stat. 31, as amended; 7 U.S.C. 601–674)

Effective date: July 1, 1971.

Signed at Washington, D.C., on May 26, 1971.

RICHARD E. LYNG,
Assistant Secretary.

[FR Doc.71-7589 Filed 5-28-71;8:51 am]

Title 12—BANKS AND BANKING

Chapter V—Federal Home Loan Bank Board

SUBCHAPTER C—FEDERAL SAVINGS AND LOAN SYSTEM

[No. 71-484]

PART 545—OPERATIONS

Investments in Service Corporations

MAY 25, 1971.

Resolved that the Federal Home Loan Bank Board considers it advisable to amend § 545.9–1 of the rules and regulations for the Federal Savings and Loan System (12 CFR 545.9–1) for the purpose of removing certain secured loans by Federal savings and loan associations to service corporations from the limitation on total investment by such associations in service corporations. Accordingly, the Federal Home Loan Bank Board hereby amends § 545.9–1 by revising paragraph (c) thereof to read as follows, effective June 1, 1971:

§ 545.9–1 Service corporations.

* * * * *

(c) *Limitations.* A Federal association may make any investment under this section if its aggregate outstanding investment in the capital stock, obligations, or other securities of service corporations and subsidiaries thereof (including all loans, secured and unsecured, to service corporations, or any subsidiaries thereof, and to joint ventures of such service corporations or subsidiaries, whether or not the Federal association is a stockholder in such service corporations) would not thereupon exceed 1 percent of the association's assets. For the purposes of this section, the term "aggregate outstanding investment" means the sum of amounts paid for the acquisition of capital stock or securities and amounts invested in obligations of service corporations less amounts received from the sale of capital stock or securities of service corporations and amounts paid to the Federal association to retire obligations of service corporations. The limitation in the first sentence of this paragraph shall not be applicable to secured loans which are made under authority other than the investment authority contained in this section to any service corporation which qualifies as a service corporation under paragraph (a) of this section or to any service corporation in which the lending association does not have any investment made under the authority of this section.

* * * * *

(Sec. 5, 48 Stat. 132, as amended; 12 U.S.C. 1464. Reorg. Plan No. 3 of 1947, 12 F.R. 4981. 3 CFR, 1943–48 Comp., p. 1071)

Resolved further that, since the above amendment relieves restriction, the Board hereby finds that notice and public procedure on said amendment are unnecessary under the provisions of 12 CFR 508.11 and 5 U.S.C. 553(b); and the Board also finds, for the same reason, that publication for the 30-day period specified in 12 CFR 508.14 and 5 U.S.C. 553(d) prior to the effective date of the amendment is unnecessary; and the Board hereby provides that the amendment shall become effective as hereinbefore set forth.

By the Federal Home Loan Bank Board.

[SEAL] GRENVILLE L. MILLARD, JR.,
Assistant Secretary.

[FR Doc.71-7557 Filed 5-28-71;8:47 am]

SUBCHAPTER D—FEDERAL SAVINGS AND LOAN INSURANCE CORPORATION

[No. 71-483]

PART 563—OPERATIONS

Premium Adjustments Following Mergers, Consolidations, or Purchases of Bulk Assets

MAY 25, 1971.

Resolved that, notice and public procedure having been duly afforded (36 F.R. 5250) and all relevant material presented or available having been considered by it, the Federal Home Loan Bank Board, upon the basis of such consideration, determines that it is advisable to amend § 563.16 of the rules and regulations for insurance of accounts (12 CFR 563.16) for the purpose of establishing a completion date for the computation of premium payments following mergers, consolidations, or purchases of bulk assets. Accordingly, the Federal Home Loan Bank Board hereby amends said section by revising it to read as follows, effective July 1, 1971:

§ 563.16 Premiums in mergers, consolidations, or purchases of bulk assets.

In the event of the purchase of bulk assets by an insured institution or of the absorption by an insured institution of another institution through merger or consolidation and the issuance of accounts of an insurable type in connection therewith, such insured institution will be billed for an additional premium based upon the aggregate of the increase of its accounts of an insurable type issued in connection with such transaction. Such premium shall be computed at the rate prescribed by law and shall be that proportion of the amount so computed which the unexpired portion of such insured institution's insurance year bears to its entire insurance year. For the purpose of computing such additional premium and as the basis for such compu-

tation, such merger, consolidation, or purchase of bulk assets shall be deemed completed upon the last day of the month in which the Board grants its approval, or upon such other date as the Board shall prescribe: *Privided, however,* That if the institution which is absorbed by such insured institution by such merger, consolidation, or purchase of bulk assets is an insured institution, the insured institution which has so absorbed such other insured institution shall receive a credit upon its future premiums of the unearned portion of any premium of such absorbed institution to the extent that the same has been paid, and the unearned portion of any premium of such absorbed institution shall, to the extent the same has not been paid, be canceled.

(Secs. 402, 404, 48 Stat. 1256, 1258, as amended; 12 U.S.C. 1725, 1727. Reorg. Plan No. 3 of 1947, 12 F.R. 4981, 3 CFR, 1943–48 Comp., p. 1071)

By the Federal Home Loan Bank Board.

[SEAL] GRENVILLE L. MILLARD, Jr.,
Assistant Secretary.

[FR Doc.71-7556 Filed 5-28-71;8:46 am]

Chapter VI—Farm Credit Administration

SUBCHAPTER A—ADMINISTRATIVE PROVISIONS

PART 604—INFORMATION AND RECORDS

Borrowers and Applicants for Loans

Chapter VI of Title 12 of the Code of Federal Regulations is amended by revising § 604.10 (c) through (g) to read as follows:

§ 604.10 Data regarding borrowers and loan applicants.

* * * * *

(c) Full information concerning borrowers who are individuals may be given for the confidential use of any bank or association of the Farm Credit System, or any Government agency, in response to inquiries made in contemplation of the extension of credit primarily for agricultural, as distiguished from personal, family, or household, purposes. To the extent that such information relates to the character and personal traits of a borrower, it shall be ascribed to reports from unnamed sources, believed to be reliable, and shall be accompanied by the statement that no responsibility is assumed for the accuracy of such reports.

(d) Impersonal information based solely on transactions or experiences between the bank and association furnishing such information and the individual borrower, such as amounts of loans, terms, and payment records, may be given for the confidential use of any bank or association of the Farm Credit System, any Government agency, and reliable lending and mercantile institutions in response to inquiries made in contemplation of the extension of credit for any purpose.

(e) Credit information concerning any borrower which is not an individual may be given when such borrower consents thereto in writing: *Provided, however,* That opinions as to the ability of such borrower to meet its obligations and commitments may be given to creditors and prospective creditors of such borrower without its consent upon the following conditions: (1) That the opinion is to be held in strict confidence by the creditor or prospective creditor; (2) that the opinion is for the private use of the creditor or prospective creditor; and (3) that the opinion be accompanied by a statement that no responsibility for its accuracy is assumed.

(f) The loan application and any supplementary statements signed by a borrower may be examined and their contents may be proved in court by the borrower who signed them, or by his accredited representative, or by the successor in interest of a deceased borrower.

(g) An unsuccessful applicant for credit which primarily is for personal, family, or household purposes, if his application was rejected either wholly or partly because of information contained in a consumer report from a consumer reporting agency shall be advised as required in section 615(a) of Public Law 91–508 (Fair Credit Reporting Act), and if his application was rejected either wholly or partly because of information obtained from a person other than a consumer reporting agency shall be advised as required in section 615(b) thereof.

(Sec. 6, 47 Stat. 14, as amended; 12 U.S.C. 665)

E. A. JAENKE,
Governor,
Farm Credit Administration.

[FR Doc.71-7516 Filed 5-28-71;8:45 am]

Title 14—AERONAUTICS AND SPACE

Chapter I—Federal Aviation Administration, Department of Transportation

[Docket No. 71-CE-14-AD; Amdt. 39-1218]

PART 39—AIRWORTHINESS DIRECTIVES

Airglas LW-3600-180A Skis

There have been reports of Airglas Engineering Co., Inc., LW-3600-180A two position skis installed on Cessna 180 and 185 series airplanes dropping down to a dangerous angle in normal flight. This condition places the skis in a negative angle of attack causing the aircraft to assume a dive attitude with resultant possible hazardous flight conditions when occurring at low altitudes and subsequent hazardous landing conditions. Analysis of these inflight ski rotation reports disclosed that this situation occurred due to improper rigging. Since this condition is likely to occur or develop in other aircraft on which these skis are installed, an Airworthiness Directive is being issued requiring rigging of the skis in accordance with the Service Bulletin dated April 14, 1971. Pending compliance with the Service Bulletin the AD will restrict affected airplanes to an airspeed of 120 M.P.H. IAS and will require the installation of an operational placard reading: "Airspeed Restricted to 120 M.P.H. IAS."

Since immediate action is required in the interest of safety, compliance with the notice and public procedure provisions of the Administrative Procedure Act is impractical and good cause exists for making this amendment effective in less than thirty (30) days.

In consideration of the foregoing and pursuant to the authority delegated to me by the Administrator (31 F.R. 13697), § 39.13 of Part 39 of the Federal Aviation Regulations is amended by adding the following new AD.

AIRGLAS. Applies to LW-3600-180A two position skis installed on Cessna 180 and 185 airplanes.

Compliance: Required as indicated, unless already accomplished.

To preclude the possibility of the ski dropping down during normal flight with resultant adverse flight characteristics and subsequent hazardous landing problems, accomplish the following:

(A) Effective immediately, operation of airplanes, on which LW-3600-180A skis are installed, in excess of 120 M.P.H. IAS is prohibited until paragraph C is accomplished.

(B) Prior to further flight, on airplanes on which LW-3600-180A skis are installed, install a placard on the instrument panel in plain view of the pilot to read as follows:

"Airspeed Restricted to 120 M.P.H. IAS".

(C) Within 50 hours' time in service after the effective date of this AD, or thereafter at any time the skis are installed, rig and modify the LW-3600-180A ski check cables in accordance with Airglas Service Bulletin dated April 14, 1971, or later FAA-approved revision.

(D) Upon accomplishment of the rigging and modication provided in paragraph C, compliance with the provisions of paragraphs A and B are no longer required.

This amendment becomes effective June 2, 1971.

(Secs. 313(a), 601, 603, Federal Aviation Act of 1958, 49 U.S.C. 1354(a), 4121, 1423; sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in Kansas City, Mo., on May 21, 1971.

DANIEL E. BARROW,
Acting Director, Central Region.

[FR Doc.71-7573 Filed 5-28-71;8:49 am]

[Docket No. 71-CE-15-AD; Amdt. 39-1219]

PART 39—AIRWORTHINESS DIRECTIVES

Cessna Model 414 Airplanes

An airworthiness directive was adopted on May 19, 1971, and made effective immediately as to all known owners of Cessna Model 414 airplanes. This AD was

issued because of inadequate rudder travel adjustments on these model airplanes. The lack of rudder travel affects the minimum control speed of these model airplanes and will create a hazarodus situation in the event of single engine power loss during critical phases of flight. In order to correct this condition the directive requires, before further flight, inspection of the rudder travel on Cessna Model 414 airplanes in accordance with the aircraft maintenance manual for adequate adjustment, namely, 32° plus 1° minus 0° both left and right. If found out of tolerance, the rudder stops must be adjusted accordingly.

Since it was found that immediate corrective action was required, notice and public procedure hereon was impracticable and contrary to the public interest and good cause existed for making the AD effective immediately to the owners of Cessna Model 414 airplanes by individual air mail letters dated May 20, 1971. These conditions still exist and the AD is hereby published in the FEDERAL REGISTER as an amendment to § 39.13 of Part 39 of the Federal Aviation Regulations to make it effective as to all persons.

In consideration of the foregoing and pursuant to the authority delegated to me by the Administrator (31 F.R. 13697), § 39.13 of Part 39 of the Federal Aviation Regulations is amended by adding the following new AD.

CESSNA. Applies to Model 414 airplanes.

Compliance: Required as indicated, unless already accomplished.

To prevent loss of directional control following single engine failure during high power settings as minimum airspeeds, accomplish the following:

Prior to further flight, inspect the rudder travel in accordance with the aircraft maintenance manual for adequate adjustment, namely, 32° plus 1° minus 0° both left and right. If found out of tolerance, readjust the rudder stops accordingly. To accomplish this inspection, the airplane may be flown to a base where the inspection and adjustment, if necessary, can be performed, providing the aircraft is operated so as to avoid high power settings below a minimum airspeed of 105 m.p.h.

This amendment becomes effective June 2, 1971, to all persons except those to whom it was made effective by letter dated May 20, 1971.

(Secs. 313(a), 601, 603, Federal Aviation Act of 1958, 49 U.S.C. 1354(a), 1421, 1423; sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in Kansas City, Mo., on May 21, 1971.

EDWARD C. MARSH,
Director, Central Region.

[FR Doc.71-7574 Filed 5-28-71;8:49 am]

[Docket No. 71-EA-47; Amdt. 39-1216]

PART 39—AIRWORTHINESS DIRECTIVES

Sikorsky Aircraft

The Federal Aviation Administration is amending § 39.13 of Part 39 of the Federal Aviation Regulations so as to issue an airworthiness directive applicable to Sikorsky S-61 type helicopters.

There has been a report of a failure of a rear fuselage fitting on the helicopter causing the complete tail rotor pylon to separate from the helicopter. A subsequent investigation determined that the deficiency occurred from a fatigue failure initiated at a burr on one of the hinge fittings of the pylon.

Since this deficiency could exist or develop on helicopters of similar type design, an airworthiness directive is being issued requiring a repetitive inspection and replacement where necessary of the hinge fitting.

As a situation exists which requires expeditious adoption of this amendment, notice and public procedure hereon are impractical and the amendment may be made effective in less than 30 days.

In consideration of the foregoing and pursuant to the authority delegated to me by the Administrator, 14 CFR 11.89 (31 F.R. 13697), § 39.13 of Part 39 of the Federal Aviation Regulations is amended by adding the following new Airworthiness Directive:

SIKORSKY AIRCRAFT. Applies to S-61 type helicopters excepting the S-61N certificated in all categories.

Compliance required as indicated.

To prevent fatigue failures of the Rear Fuselage Upper and Lower Hinge Fitting Assemblies, P/N S6120-65118-3 and P/N S6120-65121-0 accomplish the following:

(a) Within the next 15 hours' time in service after the effctive date of this AD, unless already accomplished, inspect the hinge fittings in accordance with section 2A of Sikorsky Service Bulletin No. 61B20-6 dated March 19, 1971, or later approved revisions or an equivalent inspection method approved by the Chief, Engineering and Manufacturing Branch, FAA, Eastern Region and daily thereafter in accordance with section 2B of said bulletin.

(b) Within 120 days of the effective date of this AD and every 120 days thereafter inspect the hinge fittings in accordance with section 2C of Sikorsky Service Bulletin No. 61B20-6 dated March 19, 1971, or later approved revisions, or an equivalent inspection method approved by the Chief, Engineering and Manufacturing Branch, FAA, Eastern Region.

(c) If a crack is found remove the hinge fittings from service prior to further flight.

This amendment is effective June 1, 1971.

(Secs. 313(a), 601, 603, Federal Aviation Act of 1958, 49 U.S.C. 1354(a), 1421, 1423; sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in Jamaica, N.Y., on May 19, 1971.

GEORGE M. GARY,
Director, Eastern Region.

[FR Doc.71-7575 Filed 5-28-71;8:49 am]

[Airspace Docket No. 71-SO-51]

PART 71—DESIGNATION OF FEDERAL AIRWAYS, AREA LOW ROUTES, CONTROLLED AIRSPACE, AND REPORTING POINTS

Alteration of Transition Area

On April 16, 1971, a notice of proposed rule making was published in the FEDERAL REGISTER (36 F.R. 7257), stating that the Federal Aviation Administration was considering an amendment to Part 71 of the Federal Aviation Regulations that would alter the Brunswick, Ga., transition area.

Interested persons were afforded an opportunity to participate in the rule making through the submission of comments. All comments received were favorable.

Subsequent to publication of the notice, the geographic coordinate for Jekyll Island Airport (lat. 31°04'00" N., long. 81°25'40" W.) was refined by National Ocean Survey, and the procedure turn bearing for NDB RWY-7 Instrument Approach Procedure to NAS Glynco will be changed to the 271° bearing, effective July 22, 1971. It is necessary to alter the description to reflect these changes. Since these amendments are editorial or minor in nature, notice and public procedure hereon are unnecessary.

In consideration of the foreging, Part 71 of the Federal Aviation Regulations is amended, effective 0901 G.m.t., July 22, 1971, as hereinafter set forth.

In § 71.181 (36 F.R. 2140), the Brunswick, Ga., transition area is amended to read:

BRUNSWICK, GA.

That airspace extending upward from 700 feet above the surface within an 8.5-mile radius of NAS Glynco (lat. 31°15'30" N., long. 81°28'50" W.); within 4.5 miles each side of Glynco TACAN 055° radial, extending from the 8.5-mile-radius area to 7 miles northeast of the TACAN; within 4.5 miles each side of Glynco TACAN 250° radial, extending from the 8.5-mile-radius area to 8.5 miles west of the TACAN; within 3 miles each side of the 271° bearing from Glynco RBN, extending from the 8.5-mile-radius area to 8.5 miles west of the RBN; within an 8.5-mile radius of Malcolm-McKinnon Airport (lat. 31°09'05" N., long. 81°23'20" W.); within a 5-mile radius of Jekyll Island Airport (lat. 31°04'00" N., long. 81°25'40" W.); within 5 miles each side of Brunswick VOR 203° radial, extending from the Malcolm-McKinnon Airport 8.5-mile and Jekyll Island Airport 5-mile-radius areas to 8.5 miles south of the VOR; excluding the portion outside the continental limits of the United States.

(Sec. 307(a), Federal Aviation Act of 1958, 49 U.S.C. 1348(a); sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in East Point, Ga., on May 20, 1971.

GORDON A. WILLIAMS, Jr.,
Acting Director, Southern Region.

[FR Doc. 71-7576 Filed 5-28-71;8:49 am]

[Airspace Docket No. 71-SO-55]

PART 71—DESIGNATION OF FEDERAL AIRWAYS, AREA LOW ROUTES, CONTROLLED AIRSPACE, AND REPORTING POINTS

Alteration of Control Zone and Transition Area

On April 16, 1971, a notice of proposed rule making was published in the FEDERAL REGISTER (36 F.R. 7257), stating that the Federal Aviation Administration was considering an amendment to Part 71 of the Federal Aviation Regulations that would alter the Alma, Ga., control zone and transition area.

Interested persons were afforded an opportunity to participate in the rule making through the submission of comments. All comments received were favorable.

Subsequent to publication of the notice, it was disclosed that the final approach radial for VOR RWY–15 Instrument Approach Procedure was cited as "344" in lieu of "334." It is necessary to alter the control zone description to reflect this change. Since this amendment is minor in nature, notice and public procedure hereon are unnecessary and action is taken herein to alter the description accordingly.

In consideration of the foregoing, Part 71 of the Federal Aviation Regulations is amended, effective 0901 G.m.t., July 22, 1971, as hereinafter set forth.

In § 71.171 (36 F.R. 2055), the Alma, Ga., control zone is amended to read:

ALMA, GA.

Within a 5-mile radius of Bacon County Airport (lat. 31°32'17" N., long. 82°30'33" W.); within 3 miles each side of Alma VORTAC 146° and 334° radials, extending from the 5-mile-radius zone to 8.5 miles southeast and northwest of the VORTAC. This control zone is effective from 0600 to 2200 hours, local time, daily.

In § 71.181 (36 F.R. 2140), the Alma, Ga., transition area is amended to read:

ALMA, GA.

That airspace extending upward from 700 feet above the surface within a 6-mile radius of Bacon County Airport (lat. 31°32'17" N., long. 82°30'33" W.). This transition area is effective from 0600 to 2200 hours, local time, daily.

(Sec. 307(a), Federal Aviation Act of 1958, 49 U.S.C. 1348(a); sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in East Point, Ga., on May 20, 1971.

GORDON A. WILLIAMS, Jr.,
Acting Director, Southern Region.

[FR Doc.71–7577 Filed 5–28–71;8:49 am]

[Airspace Docket No. 71–SO–57]

PART 71—DESIGNATION OF FEDERAL AIRWAYS, AREA LOW ROUTES, CONTROLLED AIRSPACE, AND REPORTING POINTS

Alteration of Control Zones and Transition Area

On April 16, 1971, a notice of proposed rule making was published in the FEDERAL REGISTER (36 F.R. 7258), stating that the Federal Aviation Administration was considering an amendment to Part 71 of the Federal Aviation Regulations that would alter the Albany, Ga. (Albany-Dougherty County Airport), and NAS Albany, Ga., control zones and the Albany, Ga., transition area.

Interested persons were afforded an opportunity to participate in the rule making through the submission of comments. All comments received were favorable.

In consideration of the foregoing, Part 71 of the Federal Aviation Regulations is amended, effective 0901 G.m.t., July 22, 1971, as hereinafter set forth.

In § 71.171 (36 F.R. 2055), the following control zones are amended to read:

ALBANY, GA. (ALBANY-DOUGHERTY COUNTY AIRPORT)

Within a 5-mile radius of Albany-Dougherty County Airport (lat. 31°32'07" N., long. 84°11'41" W.); within 2.5 miles each side of Albany VORTAC 145° radial, extending from the 5-mile-radius zone to 1 mile southeast of the VORTAC.

NAS ALBANY, GA.

Within a 5-mile radius of NAS Albany (lat. 31°35'50" N., long. 84°05'06" W.); within 3.5 miles each side of the 031° bearing from NAS Albany UHF RBN, extending from the 5-mile-radius zone to 11.5 miles northeast of the RBN; within 2 miles each side of Albany VORTAC 110° radial, extending from the 5-mile-radius zone to the VORTAC; excluding the portion within Albany-Dougherty County Airport control zone.

In § 71.181 (36 F.R. 2140), the Albany, Ga., transition area is amended to read:

ALBANY, GA.

That airspace extending upward from 700 feet above the surface within a 9.5-mile radius of Albany-Dougherty County Airport (lat. 31°32'07" N., long. 84°11'41" W.); within 2 miles each side of Albany VORTAC 145° radial, extending from the 9.5-mile-radius area to the VORTAC; within a 5.5-mile radius of Sylvester Airport (lat. 31°33'25" N., long. 83°53'33" W.); within 3 miles each side of the 194° bearing from Sylvester RBN (lat. 31°33'27" N., long. 83°53'34" W.), extending from the 5.5-mile-radius area to 8.5 miles south of the RBN; within a 10-mile radius of NAS Albany (lat. 31°35'50" N., long. 84°05'06" W.).

(Sec. 307(a), Federal Aviation Act of 1958, 49 U.S.C. 1348(a); sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in East Point, Ga., on May 20, 1971.

GORDON A. WILLIAMS, Jr.,
Acting Director, Southern Region.

[FR Doc.71–7578 Filed 5–28–71;8:49 am]

[Airspace Docket No. 71–SO–65]

PART 71—DESIGNATION OF FEDERAL AIRWAYS, AREA LOW ROUTES, CONTROLLED AIRSPACE, AND REPORTING POINTS

Alteration of Transition Area

On April 27, 1971, a notice of proposed rule making was published in the FEDERAL REGISTER (36 F.R. 7864), stating that the Federal Aviation Administration was considering an amendment to Part 71 of the Federal Aviation Regulations that would alter the Jacksonville, N.C., transition area.

Interested persons were afforded an opportunity to participate in the rule making through the submission of comments. All comments received were favorable.

In consideration of the foregoing, Part 71 of the Federal Aviation Regulations is amended, effective 0901 G.m.t., July 22, 1971, as hereinafter set forth.

In § 71.181 (36 F.R. 2140), the Jacksonville, N.C., transition area is amended to read:

JACKSONVILLE, N.C.

That airspace extending upward from 700 feet above the surface within an 8.5-mile radius of New River MCAS (lat. 34°42'25" N., long. 77°26'35" W.); within an 8.5-mile radius of Albert J. Ellis Airport (lat. 34°49'49" N., long. 77°36'42" W.); within 3 miles each side of the 045° and 220° bearings from Onslow RBN (lat. 34°49'53" N., long. 77°36'51" W.,) extending from the 8.5-mile-radius area to 8.5 miles northeast and southwest of the RBN; excluding the portion within R–5306B and C.

(Sec. 307(a), Federal Aviation Act of 1958, 49 U.S.C. 1348(a); sec. 6(c), Department of Transportation Act, 49 U.S.C. 1655(c))

Issued in East Point, Ga., on May 20, 1971.

GORDON A. WILLIAMS, Jr.,
Acting Director, Southern Region.

[FR Doc.71–7579 Filed 5–28–71;8:49 am]

[Docket No. 11108; Amdt. 758]

PART 97—STANDARD INSTRUMENT APPROACH PROCEDURES

Miscellaneous Amendments

This amendment to Part 97 of the Federal Aviation Regulations incorporates by reference therein changes and additions to the Standard Instrument Approach Procedures (SIAPs) that were recently adopted by the Administrator to promote safety at the airports concerned.

The complete SIAPs for the changes and additions covered by this amendment are described in FAA Forms 3139, 8260–3, 8260–4, or 8260–5 and made a part of the public rule making dockets of the FAA in accordance with the procedures set forth in Amendment No. 97–696 (35 F.R. 5610).

SIAPs are available for examination at the Rules Docket and at the National Flight Data Center, Federal Aviation Administration, 800 Independence Avenue SW., Washington, DC 20590. Copies of SIAPs adopted in a particular region are also available for examination at the headquarters of that region. Individual copies of SIAPs may be purchased from the FAA Public Document Inspection Facility, HQ–405, 800 Independence Avenue SW., Washington, DC 20590, or from the applicable FAA regional office in accordance with the fee schedule prescribed in 49 CFR 7.85. This fee is payable in advance and may be paid by check, draft or postal money order payable to the Treasurer of the United States. A weekly transmittal of all SIAP changes and additions may be obtained by subscription at an annual rate of $125 per annum from the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402.

Since a situation exists that requires immediate adoption of this amendment, I find that further notice and public procedure hereon is impracticable and good cause exists for making it effective in less than 30 days.

In consideration of the foregoing, Part 97 of the Federal Aviation Regulations is amended as follows, effective on the dates specified:

1. Section 97.11 is amended by establishing, revising, or canceling the following L/MF–ADF(NDB)–VOR SIAPs, effective June 24, 1971:

Walla Walla, Wash.—Walla Walla City County Airport; ADF 1, Amdt. 1; Canceled.
Walla Walla, Wash.—Walla Walla City County Airport; VOR–20, Amdt. 3; Canceled.

2. Section 97.19 is amended by establishing, revising, or canceling the following Radar SIAPs, effective June 24, 1971:

Walla Walla, Wash.—Walla Walla City County Airport; Radar–1, Amdt. 2; Canceled.

3. Section 97.21 is amended by establishing, revising, or canceling the following L/MF SIAPs, effective June 24, 1971:

Cordova, Alaska—Cordova Mile 13 Airport; LFR–A, Amdt. 12; Canceled.
Cordova, Alaska—Cordova Mile 13 Airport; LFR–B, Amdt. 13; Canceled.

4. Section 97.23 is amended by establishing, revising, or canceling the following VOR–VOR/DME SIAPs, effective June 24, 1971:

Andover, N.J.—Aeroflex-Andover Airport; VOR–A, Amdt. 4; Revised.
Ashland, Ky.—Ashland-Boyd County Airport; VOR Runway 10, Amdt. 3; Revised.
Baudette, Minn.—Baudette International Airport; VOR Runway 20, Amdt. 1; Revised.
Charleston, S.C.—Charleston AFB/Municipal Airport; VOR Runway 15, Amdt. 6; Revised.
Columbus, Nebr.—Columbus Municipal Airport; VOR Runway 14, Amdt. 4; Revised.
Columbus, Nebr.—Columbus Municipal Airport; VOR Runway 32, Amdt. 5; Revised.
El Monte, Calif.—El Monte Airport; VOR–1, Original; Canceled.
El Monte, Calif.—El Monte Airport; VOR–A, Original; Established.
El Paso, Tex.—El Paso International Airport; VOR Runway 26, Amdt. 23; Revised.
Everett, Wash.—Snohomish County (Paine Field); VOR Runway 16, Original; Established.
Grand Forks, N. Dak.—Grand Forks International Airport; VOR Runway 17, Amdt. 3; Revised.
Grand Forks, N. Dak.—Grand Forks International Airport; VOR Runway 35, Amdt. 3; Revised.
Kent, Ohio—Andrew W. Paton of Kent State University Airport; VOR–A, Amdt. 4; Revised.
Marion, Ill.—Williamson County Airport; VOR Runway 2, Amdt. 3; Revised.
Marion, Ill.—Williamson County Airport; VOR Runway 20, Amdt. 3; Revised.
Marshall, Minn.—Marshall Municipal Airport; VOR Runway 12, Original; Established.
Midland, Tex.—Midland-Odessa Regional Air Terminal; VOR Runway 16R, Amdt. 17; Revised.
Mount Holly, N.J.—Burlington County Airpark; VOR–A, Original; Established.
Nashville, Tenn.—Nashville Metropolitan Airport; VOR Runway 31, Amdt. 19; Revised.
Novato, Calif.—Gnoss Field; VOR–A, Original; Canceled.
Oxnard, Calif.—Ventura County Airport; VOR Runway 25, Amdt. 2; Revised.
Pocahontas, Ark.—Pocahontas Municipal Airport.; VOR Runway 36, Amdt. 1; Revised.
St. Louis, Mo.—Arrowhead Airport; VOR–A, Original; Established.
St. Louis, Mo.—Arrowhead Airport; VOR Runway 2, Original; Established.
Terre Haute, Ind.—Hulman Field; VOR Runway 23, Amdt. 9; Revised.
Terre Haute, Ind.—Hulman Field; VOR Runway 5, Amdt. 7; Revised.
Walla Walla, Wash.—Walla Walla City County Airport; VOR–A, Original; Established.
Walla Walla, Wash.—Walla Walla City County Airport; VOR Runway 2, Amdt. 5; Revised.
Walla Walla, Wash.—Walla Walla City County Airport; VOR Runway 16, Amdt. 7; Revised.
Yakutat, Alaska—Yakutat Airport; VOR Runway 11, Amdt. 7; Revised.
Baxley, Ga.—Baxley Municipal Airport; VOR/DME–A, Original; Established.
El Monte, Calif.—El Monte Airport; VOR/DME–A, Original; Established.
Jackson, Miss.—Allen C. Thompson Field; VOR/DME Runway 33R, Amdt. 9; Revised.
Macon, Ga.—Herbert Smart Airport; VOR/DME–A, Amdt. 4; Revised.
McPherson, Kans. — McPherson Airport; VOR/DME Runway 36, Amdt. 2; Revised.
Midland, Tex.—Midland-Odessa Regional Air Terminal; VOR/DME Runway 34L, Amdt. 4; Revised.

5. Section 97.25 is amended by establishing, revising, or canceling the following LOC–LDA SIAPs, effective June 24, 1971:

Cordova, Alaska—Cordova Mile 13 Airport; LOC/DME Runway 27, Original; Established.
Midland, Tex.—Midland-Odessa Regional Air Terminal; LOC (BC) Runway 28, Amdt. 6; Revised.
Terre Haute, Ind.—Hulman Field; LOC (BC) Runway 23, Amdt. 9; Revised.

6. Section 97.27 is amended by establishing, revising, or canceling the following NDB/ADF SIAPs, effective June 24, 1971:

Boone, Iowa—Boone Municipal Airport; NDB Runway 14, Amdt. 1; Revised.
Columbus, Nebr.—Columbus Municipal Airport; NDB Runway 14, Amdt. 4; Revised.
Cordova, Alaska—Cordova Mile 13 Airport; NDB–A, Original; Established.
El Paso, Tex.—El Paso International Airport; NDB Runway 22, Amdt. 22; Revised.
Kent, Ohio—Andrew W. Paton of Kent State University Airport; NDB Runway 1, Amdt. 3; Revised.
Louisville, Miss.—Louisville Winston County Airport; NDB–A, Original; Established.
McMinnville, Tenn.—Warren County Memorial Airport; NDB Runway 5, Original; Established.
McMinnville, Tenn.—Warren County Memorial Airport; NDB Runway 23, Original; Established.
Midland, Tex.—Midland-Odessa Regional Air Terminal; NDB Runway 10, Amdt. 4; Revised.
Montague, Calif.—Siskiyou County Airport; NDB–A, Amdt. 1; Revised.
Perry, Iowa—Perry Municipal Airport; NDB Runway 31, Amdt. 1; Revised.
Portsmouth, Va. — Chesapeake-Portsmouth Airport; NDB Runway 2, Original; Established.
Terre Haute, Ind.—Hulman Field; NDB Runway 5, Amdt. 7; Revised.
Traverse City, Mich.—Cherry Capital Airport; NDB Runway 28, Amdt. 1; Revised.
Walla Walla, Wash.—Walla Walla City County Airport; NDB Runway 20, Original; Established.

7. Section 97.29 is amended by establishing, revising, or canceling the following ILS SIAPs, effective June 24, 1971:

El Paso, Tex.—El Paso International Airport; ILS Runway 22, Amdt. 22; Revised.
Everett, Wash.—Snohomish County (Paine Field); ILS Runway 16, Amdt. 9; Revised.
Manchester, N.H.—Grenier Field/Manchester Municipal Airport; ILS Runway 35, Amdt. 4; Revised.
Memphis, Tenn.—Memphis International Airport; ILS Runway 9, Amdt. 15; Revised.
Midland, Tex.—Midland-Odessa Regional Air Terminal; ILS Runway 10, Amdt. 6; Revised.
Salem, Oreg.—McNary Field; ILS Runway 31, Amdt. 12; Revised.
Terre Haute, Ind.—Hulman Field; ILS Runway 5, Amdt. 12; Revised.
Traverse City, Mich.—Cherry Capital Airport; ILS Runway 28, Amdt. 1; Revised.

8. Section 97.31 is amended by establishing, revising, or canceling the following Radar SIAPs, effective June 24, 1971:

Macon, Ga.—Lewis B. Wilson Airport; Radar–1, Amdt. 9; Revised.
Montague, Calif.—Siskiyou County Airport; Radar–1, Original; Canceled.
Nashville, Tenn.—Nashville Metropolitan Airport; Radar–1, Amdt. 12; Revised.
Portsmouth, Va.—Chesapeake-Portsmouth Airport; Radar–1, Original; Established.

(Secs. 307, 313, 601, 1110, Federal Aviation Act of 1958; 49 U.S.C. 1438, 1354, 1421, 1510; sec. 6(c) Department of Transportation Act, 49 U.S.C. 1655(c), 5 U.S.C. 552(a)(1))

Issued in Washington, D.C., on May 20, 1971.

R. S. SLIFF,
Acting Director,
Flight Standards Service.

NOTE: Incorporation by reference provisions in §§ 97.10 and 97.20 (35 F.R. 5610) approved by the Director of the Federal Register on May 12, 1969.

[FR Doc.71-7473 Filed 5-28-71;8:45 am]

Title 17—COMMODITY AND SECURITIES EXCHANGES

Chapter II—Securities and Exchange Commission

[Releases Nos. 33-5150, 34-9176, 35-17130, 39-294, IC-6524, IAA-286]

PART 201—RULES OF PRACTICE

Business Hours and Computation of Time

To avoid unnecessary hardship on counsel in proceedings before the Commission, the Commission hereby amends its rules of practice to provide that when time periods prescribed or allowed therein are 7 days or less, intermediate Saturdays, Sundays, or legal holidays shall not be counted. The term legal holiday consists of those days specified in Rule 5, which is intended to be interpreted pursuant to 5 U.S.C. 6103.

Commission action. Pursuant to authority contained in section 19(a) of the Securities Act of 1933, section 23(a) of

the Securities Exchange Act of 1934, section 20 of the Public Utility Holding Company Act of 1935, section 319 of the Trust Indenture Act of 1939, section 38 of the Investment Company Act of 1940 and section 211 of the Investment Advisers Act of 1940, the Securities and Exchange Commission hereby amends § 201.5 and paragraph (j) of § 201.22 of Chapter II of Title 17 of the Code of Federal Regulations as set forth below:

§ 201.5 Business hours.

The principal Office of the Commission, at 500 North Capitol Street, Washington, DC 20549, is open each day, except Saturdays, Sundays, and legal holidays, from 9 a.m. to 5:30 p.m., eastern standard time or eastern daylight saving time, whichever is currently in effect in Washington. Legal holidays consist of New Year's Day, Washington's Birthday, Memorial Day, Independence Day, Labor Day, Columbus Day, Veterans Day, Thanksgiving Day, Christmas Day, and any other day appointed as a holiday in the District of Columbia by the President or the Congress of the United States.

§ 201.22 Filing; formalities; computation of time.

* * * * *

(j) *Computation of time.* In computing any period of time prescribed or allowed by these rules or by order of the Commission the day of the act, event, or default from which the designated period of time begins to run is not to be included. The last day of the period so computed is to be included unless it is a Saturday, a Sunday, or a legal holiday (as defined in § 201.5) in which event the period runs until the end of the next day which is neither a Saturday, a Sunday nor a legal holiday. Intermediate Saturdays, Sundays, and legal holidays shall be excluded from the computation when the period of time prescribed or allowed is 7 days or less.

* * * * *

The Commission finds that the foregoing amendments relieve certain restrictions by excluding certain days from the computation of periods of time in certain cases for filing material with the Commission under the rules of practice and, therefore, notice and procedures specified in 5 U.S.C. 553 are unnecessary. Accordingly, the foregoing amendments shall be effective on May 17, 1971.

(Sec. 19(a), 48 Stat. 85, sec. 209, 48 Stat. 908, 15 U.S.C. 77s; sec. 23(a), 48 Stat. 901, sec. 8, 49 Stat. 1379, 15 U.S.C. 78w; sec. 20, 49 Stat. 833, 15 U.S.C. 79t; sec. 319, 53 Stat. 1173, 15 U.S.C. 77sss; sec. 38, 54 Stat. 841, 15 U.S.C. 80a-37; sec. 211, 54 Stat. 855, sec. 14, 74 Stat. 888, 15 U.S.C. 80b-11)

By the Commission, May 17, 1971.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7581 Filed 5-28-71;8:50 am]

Title 24—HOUSING AND HOUSING CREDIT

Chapter II—Federal Housing Administration, Department of Housing and Urban Development

MORTGAGE INSURANCE ON LEASEHOLD ESTATES; CORRECTION

In F.R. Doc. 71-6144, amending Title 24, filed on April 30, 1971 (36 F.R. 8211, May 1, 1971), the second sentence of the first paragraph of the amendatory language is corrected to read as follows: "The revisions provide that the value of the leased fee shall be subtracted from the value in fee simple before multiplying by the allowable loan ratio instead of the previous system of subtracting after multiplying."

EUGENE A. GULLEDGE,
Federal Housing Commissioner.

[FR Doc.71-7544 Filed 5-28-71;8:51 am]

Title 29—LABOR

Subtitle A—Office of the Secretary of Labor

PART 4—LABOR STANDARDS FOR FEDERAL SERVICE CONTRACTS

Removal of Certain Incorporations by Reference

Pursuant to sections 2(a)(3) and 4 of the Service Contract Act of 1965 (41 U.S.C. 351, 353), Part 4 of Title 29, Code of Federal Regulations, dealing among other things with certain safety and health requirements under the Act, is hereby amended in order to conform the section to amendments to Part 1516 of Title 29, Code of Federal Regulations, which are published in the FEDERAL REGISTER on this date. The reason for the amendments is explained in the preamble to Part 1516 document. In addition, the amendments provide for variation procedures similar to those that may be adopted under section 6(d) of the Williams-Steiger Occupational Safety and Health Act of 1970 (84 Stat. 1590) to the extent that occupational safety or health issues are involved.

Part 4 is amended as indicated below.

1. Section 4.6(f) of Title 29, Code of Federal Regulations, is amended to read as follows:

§ 4.6 Labor standards clauses for Federal service contracts exceeding $2,500.

* * * * *

(f) The contractor or subcontractor shall not permit any part of the services called for by this contract to be performed in buildings or surroundings or under working conditions provided by or under the control or supervision of the contractor or subcontractor which are unsanitary or hazardous or dangerous to the health or safety of service employees engaged to furnish these services, and the contractor or subcontractor shall comply with the safety and health standards applied under part 1516 of this title.

* * * * *

2. Paragraph (b) of § 4.123 is amended to read as follows:

§ 4.123 Administrative limitations, variations, tolerances, and exemptions.

* * * * *

(b) (1) *Administrative action under section 4(b) of the Act.* The authority conferred on the Secretary by section 4(b) of the Act will be exercised with due regard to the remedial purpose of the statute to protect prevailing labor standards and to avoid the undercutting of such standards which could result from the award of Government work to contractors who will not observe such standards, and whose saving in labor cost therefrom enables them to offer a lower price to the Government than can be offered by the fair employers who maintain the prevailing standards. Administrative action consistent with this statutory purpose may be taken under section 4(b) with or without a request therefor, when found necessary and proper in accordance with the statutory standards. No formal procedures have been prescribed for requesting such action, except as provided in subparagraph (2) of this paragraph. However, a request for exemption from the Act's provisions will be granted only upon a strong and affirmative showing that it is necessary and proper in the public interest or to avoid serious impairment of Government business. If the request for administrative action under section 4(b) is not made by the headquarters office of the contracting agency to which the contract services are to be provided, the views of such office on the matter should be obtained and submitted with the request or the contracting officer may forward such a request through channels to the agency headquarters for submission with the latter's views to the Administrator of the Wage and Hour Division, Department of Labor, whenever any wage payment issues are involved. Any request relating to an occupational safety or health issue shall be submitted to the Assistant Secretary for Occupational Safety and Health, Department of Labor.

(2) *Occupational safety and health issues.* In considering any request for a variation on any occupational safety or health issue arising under the contract clause prescribed in § 4.6(f), there shall be provided procedural safeguards equivalent to those prescribed in section 6(d) of the Occupational Safety and Health Act of 1970 (84 Stat. 1596). Pending the adoption of rules of procedure applying

the aforementioned section 6(d), the applicable rules of procedure shall be specified in the notice of any hearing which may be provided.

* * * * *

(Secs. 2(a) (3) and 4, 74 Stat. 1034, 1035; 41 U.S.C. 351, 353, 5 U.S.C. 301)

Signed at Washington, D.C., this 20th day of May 1971.

J. D. HODGSON,
Secretary of Labor.

[FR Doc.71-7457 Filed 5-28-71;8:45 am]

Chapter V—Wage and Hour Division, Department of Labor

PART 505—LABOR STANDARDS ON PROJECTS OR PRODUCTIONS ASSISTED BY GRANTS FROM THE NATIONAL ENDOWMENT FOR THE ARTS

Removal of Rules of Presumption; Certain Incorporations by Reference

Pursuant to section 5(j)(2) of the National Foundation on the Arts and Humanities Act of 1965 (79 Stat. 848, 20 U.S.C. 954(j)(2)), Part 505 of Title 29 of the Code of Federal Regulations is amended as indicated below.

Under section 4(b)(2) of the Williams-Steiger Occupational Safety and Health Act of 1970 (84 Stat. 1592), standards issued under the laws listed in that provision, including the National Foundation on the Arts and Humanities Act of 1965, must be deemed to be "occupational safety and health standards" issued under the Occupational Safety and Health Act (OSHA) as well as under the listed laws. The term "occupational safety and health standard" is defined in section 3(8) of OSHA as meaning a "standard which requires conditions, or the adoption or use of one or more practices, means, methods, operations, or processes, reasonably necessary or appropriate to provide safe or healthful employment and places of employment." The term "standard" itself is not defined, but the quoted definition and the duty prescribed in section 5(a)(2) of OSHA indicate that in this context the term refers to a substantive rule; i.e., a rule having the force and effect of law.

The ordinary incorporations by reference of public and private safety and health standards are deleted. In lieu thereof, the amendments provide for the incorporation by reference of the standards adopted under the Walsh-Healey Public Contracts Act, which are published in 41 CFR Part 50-204, and which are also amended by a document published in the FEDERAL REGISTER on this date.

Further, the document is intended to amend Part 505 so that its terms are consistent with the provisions of section 4(b)(2) of the Williams-Steiger Occupational Safety and Health Act of 1970, reflecting the intent of Congress that where an employer is covered by both the National Foundation on the Arts and Humanities Act of 1965 (or the other laws listed in section 4(b)(2)) and the Williams-Steiger Occupational Safety and Health Act of 1970, the same standards will be applicable under each of the statutes. The procedures under the Williams-Steiger Occupational Safety and Health Act of 1970 will be utilized in the first instance to enforce these occupational safety and health standards and in any proceeding under the National Foundation on the Arts and Humanities Act to enforce such standards, the principle of collateral estoppel will apply.

No delay in effective date is provided for the amendments, except that the national consensus standards incorporated therein (41 CFR 50-204.2(a)) will be effective 90 days from the publication of this document in the FEDERAL REGISTER.

Section 505.6 is amended to read as follows:

§ 505.6 Safety and health standards.

(a) *Standards.* Section 5(j)(2) of the Act provides that "(2) no part of any project or production which is financed in whole or in part under this section will be performed or engaged in under working conditions which are unsanitary or hazardous or dangerous to the health and safety of the employees engaged in such project or production. Compliance with the safety and sanitary laws of the State in which the performance or part thereof is to take place shall be prima facie evidence of compliance. The Secretary of Labor shall have the authority to prescribe standards * * * as he may deem necessary or appropriate to carry out" this provision. The applicable safety and health standards shall be those published in 41 CFR Part 50-204, including matters incorporated by reference therein. Evidence of compliance with State laws relating to health and sanitation will be considered prime facie evidence of compliance with the safety and health requirements of the Act and any contract subject thereto, and it shall be sufficient unless rebutted or overcome by a preponderance of evidence of a failure to comply with any applicable safety and health standards published in 41 CFR Part 50-204, including matters incorporated by reference therein.

(b) *Variances.* (1) Variances from standards applied under paragraph (a) of this section may be granted under the same circumstances in which variances may be granted under section 6(b)(6)(A) or 6(d) of the Williams-Steiger Occupational Safety and Health Act of 1970 (29 U.S.C. 655). The procedures for the granting of variances and for related relief are those published in Part 1905 of this title.

(2) Any requests for variances shall also be considered requests for variances under the Williams-Steiger Occupational Safety and Health Act of 1970, and any variance from a standard applied under paragraph (a) of this section and in Part 1910 of this title shall be deemed a variance from the standards under both the National Foundation on the Arts and Humanities Act of 1965 and the Williams-Steiger Occupational Safety and Health Act of 1970.

(Sec. 5(j)(2), 79 Stat. 848, sec. 4(b)(2), 84 State. 1590; 20 U.S.C. 954(j)(2))

Signed at Washington, D.C., this 20th day of May 1971.

J. D. HODGSON,
Secretary of Labor.

[FR Doc.71-7458 Filed 5-28-71;8:45 am]

Chapter XIII—Bureau of Labor Standards, Department of Labor

PART 1516—SAFETY AND HEALTH STANDARDS FOR FEDERAL SERVICE CONTRACTS

Removal of Assumptions; Certain Incorporations by Reference

Pursuant to sections 2(a)(4) and 4 of the Service Contract Act of 1965 (41 U.S.C. 351, 353), Part 1516 of Title 29, Code of Federal Regulations, is hereby amended as indicated below.

The reasons for the amendments are briefly these. Under section 4(b)(2) of the Williams-Steiger Occupational Safety and Health Act of 1970 (OSHA), 84 Stat. 1592, standards issued under the laws listed in that provision, including the Service Contract Act, must be deemed to be "occupational safety and health standards" issued under the Occupational Safety and Health Act (OSHA) as well as under the listed laws. The term "occupational safety and health standards" is defined in section 3(8) of OSHA as meaning a "standard which requires conditions, or the adoption or use of one or more practices, means, methods, operations, or processes, reasonably necessary or appropriate to provide safe or healthful employment and places of employment." The term "standard" itself is not defined, but the quoted definition and the duty prescribed in section 5(a)(2) of OSHA indicate that in this context the term refers to a substantive rule; i.e., a rule having the force and effect of law. Under these circumstances, it is considered necessary and appropriate to amend the safety and health rules under the Service Contract Act in order to make the changes needed to give substantive effect to these rules by removing certain rules of presumption, ordinary incorporations by reference, and other changes related to giving substantive effect to the rules involved.

Further, the document is intended to amend Part 1516 so that its terms are consistent with the provisions of section 4(b)(2) of the Williams-Steiger Occupational Safety and Health Act of 1970, reflecting the intent of Congress that where an employer is covered both by the Service Contract Act of 1965 (or the other laws listed in section 4(b)(2)) and the Williams-Steiger Occupational Safety and Health Act of 1970, the same standards will be applicable under each of the statutes. The procedures under the Williams-Steiger Occupational Safety and Health Act of 1970 will be utilized in the first instance to enforce these occupational safety and health standards and in any proceeding under the Service Contract Act of 1965 to enforce such

standards, the principle of collateral estoppel will apply.

The substantive rules which are adopted are those under the Walsh-Healey Public Contracts Act (41 CFR Part 50–204), as amended by changes published in the FEDERAL REGISTER on this date. No delay in effective date for the rules is provided except as to the national consensus standards incorporated in the Walsh-Healey rules on this date, concerning which the effective date provision specified therein shall govern.

1. Section 1516.1 is amended as follows:

§ 1516.1 Scope of application.

* * * * *

(b)(1) Investigators conducting investigations and all officers of the Department of Labor evaluating, reviewing and analyzing investigations, as well as officers of the Department determining whether there are or have been violations of the safety and health requirements of the Service Contract Act of 1965 or any contract subject thereto and the terms on which there may be a settlement of issues arising from an investigation without resort to administrative or judicial litigation, will consider a failure to comply with the safety and health measures provided in § 1516.2 to result in working conditions which are "unsanitary or hazardous or dangerous to the health or safety of service employees" within the meaning of section 2(a)(3) of the Act and the contract stipulation it requires.

(c) [Deleted]

* * * * *

2. Section 1516.2 is revised to read as follows:

§ 1516.2 Safety and health standards.

Every contractor and subcontractor shall comply with the safety and health standards published in 41 CFR Part 50–204, including any matters incorporated by reference therein.

(Secs. 2(a)(3) and 4, 74 Stat. 1034, 1035, 41 U.S.C. 351, 353, 5 U.S.C. 301)

Signed at Washington, D.C., this 20th day of May 1971.

J. D. HODGSON,
Secretary of Labor.

[FR Doc.71-7456 Filed 5-28-71;8:45 am]

Title 31—MONEY AND FINANCE: TREASURY

Chapter II—Fiscal Service, Department of the Treasury

SUBCHAPTER B—BUREAU OF THE PUBLIC DEBT

PART 316—OFFERING OF UNITED STATES SAVINGS BONDS, SERIES E

Miscellaneous Amendments

Department Circular No. 653, Eighth Revision, dated December 12, 1969, and the tables incorporated therein, as amended (31 CFR Part 316), are further amended by revision of paragraph (a), renumbering of subparagraph (2) of paragraph (b) as (3), and insertion of a new subparagraph, numbered (2), in § 316.8; the revision of subparagraph (1), paragraph (b), of § 316.9; and addition of Tables 2–A and 3–A as follows:

§ 316.8 Extended terms and improved yields for outstanding bonds.

(a) *Extended maturity periods*—(1) *General.* The terms "extended maturity periods," "second extended maturity period," and "third extended maturity period," when used herein, refer to the intervals after the original maturity dates during which owners may retain their bonds and continue to earn interest on the maturity values or the extended maturity values.[8] No special action is required of owners desiring to take advantage of any extensions heretofore or herein granted.

(2) *Bonds with issue dates May 1, 1941, through April 1, 1952.* Owners of Series E bonds with issue dates of May 1, 1941, through April 1, 1952, may retain their bonds for a third and final extended maturity period of 10 years.

[8] The redemption value of any bond at the maturity date, the extended maturity date or the second extended maturity date is the base, in each instance, upon which interest will accrue during the period following.

(3) *Bonds with issue dates May 1, 1952, through January 1, 1957.* Owners of Series E bonds with issue dates of May 1, 1952, through January 1, 1957, may retain their bonds for a second extended maturity period of 10 years.

(4) *Bonds with issue dates of February 1, 1957, or thereafter.* Owners of Series E bonds with issue dates of February 1, 1957, or thereafter, may retain their bonds for an extended maturity period of 10 years.

(b) *Improved yields.* * * *

(2) *Bonds entering third extended maturity period.* The investment yield (interest) for the third extended maturity period for all outstanding bonds entering this period will be at the rate prevailing for Series E bonds being issued at the time the extension begins. Tables showing the yields and the redemption values will be published prior to or as the bonds enter the extension. The yields shown in Tables 2–A and 3–A hereof apply to bonds with issue dates May 1, 1941, and June 1, 1941. Table 3–A will also apply to bonds with issue dates of July 1, 1941, through November 1, 1941, inclusive, unless tables showing different yields are published prior to or as these bonds enter the third extended maturity period.

* * * * *

§ 316.9 Taxation.

* * * * *

(b) *Federal income tax on bonds.* * * *

(1) Defer reporting of the increase to the year of final maturity, actual redemption, or other disposition, whichever is earlier; or

* * * * *

The foregoing revisions and amendments, adopted on April 30, 1971, were effected under authority of section 22 of the Second Liberty Bond Act, as amended (49 Stat. 21, as amended; 31 U.S.C. 757c) and 5 U.S.C. 301. Notice and public procedures thereon are unnecessary as public property and contracts are involved.

Dated: May 20, 1971.

[SEAL] JOHN K. CARLOCK,
Fiscal Assistant Secretary.

BONDS BEARING ISSUE DATE MAY 1, 1941

Issue price / Denomination	$18.75 / 25.00	$37.50 / 50.00	$75.00 / 100.00	$375.00 / 500.00	$750.00 / 1,000.00	Approximate investment yield (annual percentage rate)		
Period after second extended maturity (beginning 30 years after issue date)	(1) Redemption values during each half-year period (values increase on first day of period shown) — THIRD EXTENDED MATURITY PERIOD					(2) From beginning of third extended maturity period to beginning of each half-year period	(3) From beginning of each half-year period to beginning of next half-year period	(4) From beginning of each half-year period to third extended maturity [2]
						Percent	*Percent*	*Percent*
First ½ year [1] (5/1/71)	$50.28	$100.56	$201.17	$1,005.60	$2,011.20	0.00	5.49	5.50
½ to 1 year (11/1/71)	51.66	103.32	206.64	1,033.20	2,066.40	5.49	5.50	5.50
1 to 1½ years (5/1/72)	53.08	106.16	213.32	1,061.60	2,123.20	5.49	5.50	5.50
1½ to 2 years (11/1/72)	54.54	109.08	218.16	1,090.80	2,181.60	5.50	5.50	5.50
2 to 2½ years (5/1/73)	56.04	112.08	224.16	1,120.80	2,241.60	5.50	5.50	5.50
2½ to 3 years (11/1/73)	57.58	115.16	230.32	1,151.60	2,303.20	5.50	5.52	5.50
3 to 3½ years (5/1/74)	59.17	118.34	236.68	1,183.40	2,366.80	5.50	5.51	5.50
3½ to 4 years (11/1/74)	60.80	121.60	243.20	1,216.00	2,432.00	5.50	5.49	5.50
4 to 4½ years (5/1/75)	62.47	124.94	249.88	1,249.40	2,498.80	5.50	5.47	5.50
4½ to 5 years (11/1/75)	64.18	128.36	256.72	1,283.60	2,567.20	5.50	5.52	5.50
5 to 5½ years (5/1/76)	65.95	131.90	263.80	1,319.00	2,638.00	5.50	5.49	5.50
5½ to 6 years (11/1/76)	67.76	135.52	271.04	1,355.20	2,710.40	5.50	5.52	5.50
6 to 6½ years (5/1/77)	69.63	139.26	278.52	1,392.60	2,785.20	5.50	5.49	5.50
6½ to 7 years (11/1/77)	71.54	143.08	286.16	1,430.80	2,861.60	5.50	5.51	5.50
7 to 7½ years (5/1/78)	73.51	147.02	294.04	1,470.20	2,940.40	5.50	5.50	5.50
7½ to 8 years (11/1/78)	75.53	151.06	302.12	1,510.60	3,021.20	5.50	5.51	5.50
8 to 8½ years (5/1/79)	77.61	155.22	310.44	1,552.20	3,104.40	5.50	5.49	5.50
8½ to 9 years (11/1/79)	79.74	159.48	318.96	1,594.80	3,189.60	5.50	5.49	5.50
9 to 9½ years (5/1/80)	81.93	163.86	327.72	1,638.60	3,277.20	5.50	5.52	5.50
9½ to 10 years (11/1/80)	84.19	168.38	336.76	1,683.80	3,367.60	5.50	5.49	5.49
THIRD EXTENDED MATURITY VALUE (40 years from issue date) (5/1/81)	86.50	173.00	346.00	1,730.00	3,460.00	5.50		

[1] Month, day, and year on which issues of May 1, 1941, enter each period.
[2] Based on third extended maturity value in effect on the beginning date of the half-year period.
[3] Yield on purchase price from issue date to third extended maturity date is 3.86 percent.

TABLE 3–A

BONDS BEARING ISSUE DATE JUNE 1, 1941 [1]

Issue price / Denomination	$18.75 / 25.00	$37.50 / 50.00	$75.00 / 100.00	$375.00 / 500.00	$750.00 / 1,000.00	Approximate investment yield (annual percentage rate)		
Period after second extended maturity (beginning 30 years after issue date)	(1) Redemption values during each half-year period (values increase on first day of period shown) — THIRD EXTENDED MATURITY PERIOD					(2) From beginning of third extended maturity period to beginning of each half-year period	(3) From beginning of each half-year period to beginning of next half-year period	(4) From beginning of each half-year period to third extended maturity [3]
						Percent	*Percent*	*Percent*
First ½ year [2] (6/1/71)	$50.80	$101.60	$203.20	$1,016.00	$2,032.00	0.00	5.51	5.50
½ to 1 year (12/1/71)	52.20	104.40	208.80	1,044.00	2,088.00	5.51	5.48	5.50
1 to 1½ years (6/1/72)	53.63	107.26	214.52	1,072.60	2,145.20	5.50	5.52	5.50
1½ to 2 years (12/1/72)	55.11	110.22	220.44	1,102.20	2,204.40	5.50	5.48	5.50
2 to 2½ years (6/1/73)	56.62	113.24	226.48	1,132.40	2,264.80	5.50	5.51	5.50
2½ to 3 years (12/1/73)	58.18	116.36	232.72	1,163.60	2,327.20	5.50	5.50	5.50
3 to 3½ years (6/1/74)	59.78	119.56	239.12	1,195.60	2,391.20	5.50	5.49	5.50
3½ to 4 years (12/1/74)	61.42	122.84	245.68	1,228.40	2,456.80	5.50	5.50	5.50
4 to 4½ years (6/1/75)	63.11	126.22	252.54	1,262.20	2,524.40	5.50	5.51	5.50
4½ to 5 years (12/1/75)	64.85	129.70	259.40	1,297.00	2,594.00	5.50	5.49	5.50
5 to 5½ years (6/1/76)	66.63	133.26	266.52	1,332.60	2,665.20	5.50	5.49	5.50
5½ to 6 years (12/1/76)	68.46	136.92	273.84	1,369.20	2,738.40	5.50	5.52	5.50
6 to 6½ years (6/1/77)	70.35	140.70	281.40	1,407.00	2,814.00	5.50	5.49	5.50
6½ to 7 years (12/1/77)	72.28	144.56	289.12	1,445.60	2,891.20	5.50	5.51	5.50
7 to 7½ years (6/1/78)	74.27	148.54	297.08	1,485.40	2,970.80	5.50	5.49	5.50
7½ to 8 years (12/1/78)	76.31	152.62	305.24	1,526.20	3,052.40	5.50	5.50	5.50
8 to 8½ years (6/1/79)	78.41	156.82	313.64	1,568.20	3,136.40	5.50	5.51	5.50
8½ to 9 years (12/1/79)	80.57	161.14	322.28	1,611.40	3,222.80	5.50	5.49	5.50
9 to 9½ years (6/1/80)	82.78	165.56	331.12	1,655.60	3,311.20	5.50	5.51	5.51
9½ to 10 years (12/1/80)	85.06	170.12	340.24	1,701.20	3,402.40	5.50	5.50	5.50
THIRD EXTENDED MATURITY VALUE (40 years from issue date) 6–1–81	87.40	174.80	349.60	1,748.00	3,496.00	45.50		

[1] Yields also apply to bonds with issue dates July 1 through November 1, 1941, unless tables showing different yields are published. (See Sec. 316.8(b)(2).)
[2] Month, day, and year on which issues of June 1, 1941, enter each period. For subsequent issue months add the appropriate number of months.
[3] Based on third extended maturity value in effect on the beginning date of the half-year period.
[4] Yield on purchase price from issue date to third extended maturity date is 3.89 percent.

[FR Doc.71–7359 Filed 5–28–71;8:45 am]

Title 41—PUBLIC CONTRACTS AND PROPERTY MANAGEMENT

Chapter 18—National Aeronautics and Space Administration

PART 18–8—TERMINATION OF CONTRACTS

Termination Claims

Correction

In F.R. Doc. 71–4616 appearing at page 6345 in the issue of Saturday, April 3, 1971, the section heading and first five lines of § 18–8.101–25 appearing at the beginning of the first column on page 6348 should be transferred to the beginning of the third column on page 6347 directly above the five lines of undesignated text.

Chapter 50—Public Contracts, Department of Labor

PART 50–204—SAFETY AND HEALTH STANDARDS FOR FEDERAL SUPPLY CONTRACTS

Presumptions and Incorporations by Reference; Specific National Consensus Standards

Pursuant to section 4 of the Walsh-Healey Public Contracts Act (41 U.S.C. section 35), Part 50–204 of Title 41, Code of Federal Regulations is hereby amended as indicated below.

The reasons for the amendments are briefly these. Under section 4(b)(2) of the Williams-Steiger Occupational Safety and Health Act of 1970 (29 U.S.C. 653) standards issued under the laws listed in that provision, including the Walsh-Healey Public Contracts Act, must be deemed to be "occupational safety and health standards" issued under the Williams-Steiger Occupational Safety and Health Act of 1970 (OSHA) as well as under the listed laws. The term "occupational safety and health standard" is defined in section 3(8) of OSHA (29 U.S.C. 652) as meaning a "standard which requires conditions, or the adoption or use of one or more practices, means, methods, operations, or processes, reasonably necessary or appropriate to provide safe or healthful employment and places of employment." The term "standard" itself is not defined, but the quoted definition and the duty prescribed in section 5(a)(2) of OSHA (29 U.S.C. 654) indicate that in this context the term refers to a substantive rule; i.e., a rule having the force and effect of law. Under these circumstances, it is considered necessary and appropriate to amend the rules under the Walsh-Healey Public Contracts Act in order to make the changes needed to reflect the substantive effect given to the safety and health standards by removing certain rules of presumption, ordinary incorporations by reference, and other changes related to the substantive effect of the rules involved. The variations provisions of the rules are also amended to conform with the procedural requirements of section 6 of OSHA (29 U.S.C. 655).

The ordinary incorporations by reference of private safety and health standards are replaced by the incorporation by reference of the national consensus standards which are adopted under section 6(a) of the Williams-Steiger Occupational Safety and Health Act of 1970 (29 U.S.C. 655) and which are published on this date in Part 1910 of Title 29 of the Code of Federal Regulations. The specific national consensus standards now incorporated and given substantive effect are determined to be more effective than the general references to private standards which have heretofore existed, and therefore the general references are in any event superseded by the specific national consensus standards under the express terms of section 4(b)(2) of OSHA.

Further, the document is intended to amend Part 50–204 so that its terms are consistent with the provision in section 4(b)(2) of the Williams-Steiger Occupational Safety and Health Act of 1970 reflecting the intent of Congress that where an employer is covered both by the Walsh-Healey Public Contracts Act (or the other laws listed in section 4(b)(2)) and the Williams-Steiger Occupational Safety and Health Act, the same standard will be applicable under each of the statutes. The procedures under the Williams-Steiger Occupational Safety and Health Act will be utilized in the first instance to enforce these occupational safety and health standards and in any proceeding under the Walsh-Healey Public Contracts Act to enforce such standards, the principle of collateral estoppel will apply.

Good cause is found for not providing notice and public procedure in the adoption of the substantive amendments. Such procedures are unnecessary because the changes are considered to reflect only those accomplished by operation of law as of April 28, 1971, by virtue of section 4(b)(2) of OSHA.

There is no delay in effective date for the amendments except in the case of the national consensus standards incorporated in § 50–204.2(a) which will be effective 90 days from the publication of this document in the FEDERAL REGISTER. The delay in effective date of the national consensus standards does not reduce the employers' general statutory and contractual requirement that no part of a contract subject to the Walsh-Healy Public Contracts Act be performed in any plants, factories, buildings or surroundings, or under working conditions which are unsanitary or hazardous or dangerous to the health and safety of employees engaged in the performance of such a contract. See 41 CFR § 50–204.1(d).

1. In § 50–204.1, paragraph (b) is amended and paragraphs (c) and (f) are revoked. As amended, § 50–204.1 reads as follows:

§ 50–204.1 Scope and application.

* * * * *

(b) (1) Every investigator conducting investigations and every officer of the Department of Labor determining whether there are or have been violations of the safety and health requirements of the Walsh-Healey Public Contracts Act and of any contract subject thereto; and whether a settlement of the resulting issues should be made without resort to administrative or court litigation, shall treat a failure to comply with, or violation of, any of the safety and health measures contained in this Part 50–204 as resulting in working conditions which are "unsanitary or hazardous or dangerous to the health and safety of employees" within the meaning of section 1(e) of the Act and the contract stipulation it requires. Evidence of compliance with the safety, sanitary, and factory inspection laws of a State in which the work, or part thereof, is performed will be considered prima facie evidence of compliance with the safety and health requirements of the Act and of any contract subject thereto, and it shall be sufficient unless rebutted or overcome by a preponderance of evidence of a failure to comply with any applicable safety and health rules contained in this part.

(2) Every investigator shall have technical competence in safety, industrial hygiene, or both as may be appropriate, in the matters under investigation.

* * * * *

2. Section 50–204.1a is revised to read as follows:

§ 50–204.1a Variances.

(a) Variances from standards in this part may be granted in the same circumstances in which variances may be granted under sections 6(b)(6)(A) or 6(d) of the Williams-Steiger Occupational Safety and Health Act of 1970 (29 U.S.C. 655). The procedures for the granting of variances and for related relief under this part are those published in Part 1905 of Title 29, Code of Federal Regulations.

(b) Any requests for variances shall also be considered requests for variances under the Williams-Steiger Occupational Safety and Health Act of 1970, and any variance from a standard which is contained in this part and which is incorporated in Part 1910 of Title 29, Code of Federal Regulations, shall be deemed a variance from the standard under both the Walsh-Healey Public Contracts Act and the Williams-Steiger Occupational Safety and Health Act of 1970.

3. Paragraphs (a) and (b) of § 50–204.2 are amended to read as follows:

§ 50–204.2 General safety and health standards.

(a) Every contractor shall protect the safety and health of his employees by complying with the standards described in the subparagraphs of this paragraph whenever a standard deals with an occupational safety or health subject or issue involved in the performance of the contract.

(1) U.S. Department of Labor—Title 29 CFR—

Part 1501—Safety and Health Regulations for Ship Repairing.
Part 1502—Safety and Health Regulations for Shipbuilding.
Part 1503—Safety and Health Regulations for Shipbreaking.
Part 1504—Safety and Health Regulations for Longshoring.
Part 1910—Subpart C through Subpart S (national consensus standards).

(2) U.S. Department of Interior, Bureau of Mines.

(i) In Chapter I of Title 30, Code of Federal Regulations, the standards requiring safe and healthful working conditions or surroundings in:

Subchapter B—Respiratory Protective Apparatus; Tests for Permissibility; Fees.
Subchapter C—Explosives and Related Articles; Tests for Permissibility and Suitability.
Subchapter D—Electrical Equipment, Lamps, Methane Detectors; Tests for Permissibility; Fees.
Subchapter O—Coal Mine Health and Safety.

(ii) In Chapter II of Title 30 the standards requiring safe and healthful working conditions or surroundings in:

Part 211—Coal-Mining Operating and Safety Regulations.
Part 216—Operating and Safety Regulations Governing the Mining of Coal in Alaska.
Part 221—Oil and Gas Operating Regulations.
Part 231—Operating and Safety Regulations Governing the Mining of Potash; Oil Shale, Sodium, and Phosphate; Sulphur; and Gold, Silver, or Quicksilver; and Other Nonmetallic Minerals, Including Silica Sand.

(3) U.S. Department of Transportation: 49 CFR Parts 171–179 and 14 CFR Part 103 Hazardous material regulation—Transportation of compressed gases.

(4) U.S. Department of Agriculture Respiratory Devices for Protection against Certain Pesticides—ARS–33–76–2.

(b) Information concerning the applicability of the standards prescribed in paragraph (a) of this section may be obtained from the following offices:

(1) Office of the Bureau of Labor Standards, U.S. Department of Labor, Railway Labor Building, Washington, D.C. 20210.

(2) The regional and field offices of the Bureau of Labor Standards which are listed in the U.S. Government Organization Manual, 1970–71 edition at p. 324.

* * * * *

(Secs. 1, 4, 49 Stat. 1036, 1038, as amended; 41 U.S.C. 35, 38)

Signed at Washington, D.C., this 20th day of May 1971.

J. D. HODGSON,
Secretary of Labor.

[FR Doc.71–7455 Filed 5–28–71;8:45 am]

Title 49—TRANSPORTATION

Chapter V—National Highway Traffic Safety Administration, Department of Transportation

PART 571—FEDERAL MOTOR VEHICLE SAFETY STANDARDS

Seat Belt Assembly Anchorages and Seat Belt Installations; Reconsideration and Amendment

The purpose of this notice is to amend Motor Vehicle Safety Standards No. 208 and 210, with respect to the installation of shoulder belts in multipurpose passenger vehicles exceeding 10,000 pounds GVWR and the provision of anchorages for shoulder belts in vehicles other than passenger cars.

1. The seat belt installation standard was amended on September 30, 1970, to require installation of seat belts in multipurpose passenger vehicles, trucks, and buses manufactured after July 1, 1971 (35 F.R. 15222). Exemptions from the requirement for shoulder belt installation were provided for certain types and weights of vehicles.

During the course of the subsequent rulemaking activity which led to the issuance of the occupant crash protection standard, it was determined that the larger weight classes of trucks and multipurpose passenger vehicles should not be required to install shoulder belts (35 F.R. 14941, 35 F.R. 16937, 36 F.R. 4600). The standard therefore required lap belts, but not shoulder belts, for vehicles over 10,000 pounds GVWR, effective January 1, 1972. The September 30 amendment, which is to become effective 6 months earlier than the occupant crash protection rule, had provided a similar exemption for large trucks but not for multipurpose passenger vehicles, with the result that shoulder belts would have been required for many large multipurpose passenger vehicles during the period July 1, 1971–January 1, 1972, but not afterward. To correct this inconsistency, the seat belt installation standard is amended, effective July 1, 1971, to exempt multipurpose passenger vehicles of more than 10,000 pounds GVWR from the shoulder belt requirement.

In accordance with the foregoing, section S3.1 of Standard No. 208 (§ 571.21), as published September 30, 1970 (35 F.R. 15222) is amended effective July 1, 1971, to read as follows:

S3.1 A Type 1 seat belt assembly shall be installed for each designated seating position in convertibles, open-body type vehicles, walk-in van-type trucks, and trucks and multipurpose passenger vehicles that have a gross vehicle weight rating of more than 10,000 pounds, and for the driver's seating position in buses.

2. Standard No. 210, "Seat Belt Assembly Anchorages," presently requires vehicles other than passenger cars to have shoulder belt anchorages installed at front outboard seating positions by July 1, 1971, and at rear outboard seating positions by January 1, 1972 (35 F.R. 15293, 35 F.R. 18116, 36 F.R. 4291). The Recreational Vehicle Institute has petitioned for an amendment of the standard, to delete the requirement for shoulder belt anchorages at positions where shoulder belt installation is not required by Standard No. 208.

It has been found that this petition has merit. The probability of shoulder belt installation by the owners of these vehicles is very small, and the difficulty of anchorage installation, particularly in multipurpose passenger vehicles, is often greater than in passenger cars. The amendment is therefore considered to be in the public interest.

The request by RVI for a postponement of the July 1, 1971, effective date for installation of shoulder belt anchorages has not been found justified, and the petition is in that respect denied.

In accordance with the foregoing, section S4.1.1 of the present Motor Vehicle Safety Standard No. 210 (effective July 1, 1971), and the amended Standard No. 210 as published November 26, 1970 (35 F.R. 18116, effective January 1, 1972), in 49 CFR 571.21, are both amended to read as follows:

S4.1.1 Seat belt anchorages for a Type 2 seat belt assembly shall be installed for each forward-facing outboard designated seating position in passenger cars, and for each designated seating position for which a Type 2 seat belt assembly is required by Standard No. 208 in vehicles other than passenger cars.

The effective dates of the amendments made by this notice are as indicated above. Because the amendments relieve restrictions and impose no additional burden on any person, notice and request for comments on such notice are found to be unnecessary, and it is found, for good cause shown, that an effective date earlier than 180 days after issuance is in the public interest.

(Sec. 103, 119, National Traffic and Motor Vehicle Safety Act, 15 U.S.C. 1392, 1407; delegation of authority at 49 CFR 1.51)

Issued on May 21, 1971.

DOUGLAS W. TOMS,
Acting Administrator.

[FR Doc.71–7512 Filed 5–28–71;8:45 am]

[Docket No. 70–12; Notice No. 9]

PART 574—TIRE IDENTIFICATION AND RECORD KEEPING

Location of Tire Identification Number for Retreaded Tires

The purpose of this amendment is to provide retreaders with an alternative

location for the placement of the tire identification number.

On January 26, 1971, the National Highway Traffic Safety Administration published Docket No. 70–12, Notice No. 5, a revised version of the Tire Identification and Recordkeeping Regulation, 49 CFR Part 574 (36 F.R. 1196). Section 574.5 requires retreaders to permanently mold or brand into or onto one sidewall a tire identification number in the manner specified in Figure 2 of the regulation. Figure 2 requires that the tire identification number be located in the area of the shoulder between the tread edge and the maximum section width of the tire. The regulation specified this location because, generally, it is the area upon which retreaders apply new retread material.

Bandag, Inc., has petitioned for rulemaking to allow the tire identification to be below the section width of the tire. The petition requests this relief because the Bandag process only affects the tread surface, a comparatively smooth surface is needed for application of the identification number, and many casings have no smooth area between the tread edge and the maximum section width.

Therefore, in view of the above, Figure 2 of Part 574 (36 F.R. 1200) is hereby amended as set forth below to require that the tire identification number be on one sidewall of the tire, either on the upper segment between the maximum section width and the tread edge, or on the lower segment between the maximum section width and bead in a location such that the number will not be covered by the rim flange when the tire is inflated. In no event should the number be on the surface of the scuff rib or ribs.

(Secs. 103, 112, 119, 201, National Traffic and Motor Vehicle Safety Act, as amended (15 U.S.C. 1392, 1401, 1407, 1421); delegations of authority at 49 CFR 1.51 and 49 CFR 501.8)

Effective date: May 22, 1971.

Because this amendment relieves a restriction and does not impose any additional burden on any person it is found that notice and public procedure thereon are unnecessary and impracticable, and that, for good cause shown, an effective date less than 30 days after the date of issuance is in the public interest.

Issued on May 21, 1971.

DOUGLAS W. TOMS,
Acting Administrator.

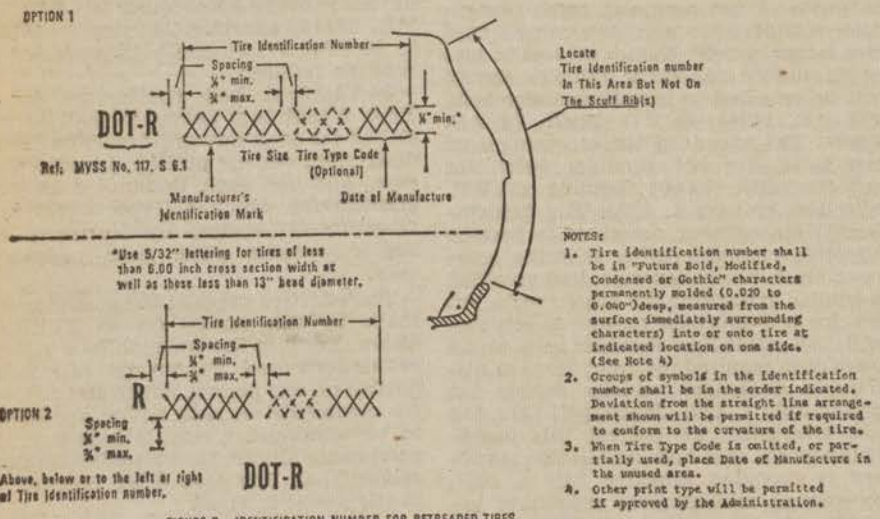

FIGURE 2 - IDENTIFICATION NUMBER FOR RETREADED TIRES.

[FR Doc.71-7545 Filed 5-28-71;8:51 am]

Chapter X—Interstate Commerce Commission

SUBCHAPTER A—GENERAL RULES AND REGULATIONS

[S.O. 1025, Amdt. 6]

PART 1033—CAR SERVICE

Return of Covered Hopper Cars

At a session of the Interstate Commerce Commission, Railroad Service Board, held in Washington, D.C., on the 24th day of May 1971.

Upon further consideration of Service Order No. 1025 (34 F.R. 7451, 9870; 35 F.R. 894, 5334, 18318) as amended, and good cause appearing therefore:

It is ordered, That § 1033.1025 *Service Order No. 1025* (Regulations for return of covered hopper cars) be, and it is hereby, amended by substituting the following paragraph (f) for paragraph (f) thereof:

(f) *Expiration date.* This order shall expire at 11:59 p.m., December 31, 1971, unless otherwise modified, changed, or suspended by order of this Commission.

Effective date. This amendment shall become effective at 11:59 p.m., May 31, 1971.

(Secs. 1, 12, 15, and 17(2), 24 Stat. 379, 383, 384, as amended; 49 U.S.C. 1, 12, 15, and 17(2). Interprets or applies secs. 1(10–17), 15(4), and 17(2), 40 Stat. 101, as amended, 54 Stat. 911; 49 U.S.C. 1(10–17), 15(4), and 17(2))

It is further ordered, That copies of this amendment shall be served upon the Association of American Railroads, Car Service Division, as agent of the railroads subscribing to the car service and per diem agreement under the terms of that agreement, and upon the American Short Line Railroad Association; and that notice of this order shall be given to the general public by depositing a copy in the Office of the Secretary of the Commission at Washington, D.C., and by filing it with the Director, Office of the Federal Register.

By the Commission, Railroad Service Board.

[SEAL] ROBERT L. OSWALD,
Secretary.

[FR Doc.71-7553 Filed 5-28-71;8:52 am]

Proposed Rule Making

DEPARTMENT OF THE INTERIOR

Oil Import Administration

[32A CFR Ch. X]

[Oil Import Reg. 1 (Rev. 5)]

IMPORTS OF CRUDE OIL FOR TOPPING AND USE AS BURNER FUEL; DISTRICT I AND DISTRICTS II–IV

Notice of Proposed Rule Making

Paragraph (g) of section 1A of Proclamation 3279, as amended, provides for imports of crude oil for topping and use as burner fuel under such conditions as the Secretary of the Interior may by regulation provide. A proposal to implement this paragraph of the Proclamation was published in the FEDERAL REGISTER for October 21, 1970 (35 F.R. 16411). Further consideration has been given to this matter in the light of the comments received, and a revised proposal is set forth below in the form of a section which it is proposed to add to Oil Import Regulation 1 (Revision 5), as amended. Final action upon the revised proposal will be subject to the concurrence of the Director of the Office of Emergency Preparedness.

Interested persons are invited to submit written comments upon the proposal to the Administrator, Oil Import Administration, Department of the Interior, Washington, D.C. 20240, before July 6, 1971. Each person who submits comments is asked to provide fifteen (15) copies.

T. C. SNEDEKER,
Acting Administrator,
Oil Import Administration.

MAY 28, 1971.

Sec. ------ Imports of crude oil for topping.

(a) This section prescribes the conditions under which crude oil to be topped and used as burner fuel may be imported into District I and Districts II–IV, pursuant to paragraph (g) of section 1A of Proclamation 3279, as amended (35 F.R. 16358).

(b) Crude oil for topping and use as burner fuel may be entered for consumption or withdrawn from warehouse for consumption in District I or Districts II–IV under a certificate of approval issued by the Administrator. A separate certificate of approval shall be required for each entry, or withdrawal from warehouse, for consumption. In Districts II–IV, certificates of approval will be issued only for imports of crude oil from Canada.

(c) Crude oil imported pursuant to a certificate of approval must be processed by the importer and all topped crude oil and other products derived from the processing operations must be used by the importer as burner fuel in his own facilities. The Administrator shall issue certificates of approval only in instances in which he is satisfied that the applicants will comply with the requirements of this paragraph.

(d) An application for a certificate of approval under this section must be filed with the Administrator, Oil Import Administration, Department of the Interior, Washington, D.C. 20240, not later than 15 days before the expected date of the commencement of importation of the crude oil. The application shall certify in detail such information as the Administrator may require including the following:

(1) The location of the facilities in which the crude oil will be processed and used as burner fuel.

(2) The nature of the unit in which the crude oil will be processed and of any facility of which the unit is part.

(3) A description of the method to be used in segregating (and accounting for) the feedstocks and products of the processing unit from the feedstocks and products of other facilities of the applicant.

(4) The quantity of crude oil to be imported and processed in the processing unit for use as burner fuel in the applicant's facilities.

(5) The date importation will commence.

(e) Neither crude oil imported under a certificate of approval nor topped crude or other products derived from the processing of such crude oil shall qualify as refinery inputs or petrochemical plant inputs for the purpose of eligibility for allocations under section 4 of this regulation or for the purpose of computing allocations under section 9, 10 or 25.

(f) No certificate of approval issued pursuant to this section may be sold, assigned, or otherwise transferred.

[FR Doc.71–7641 Filed 5–28–71;9:46 am]

DEPARTMENT OF AGRICULTURE

Consumer and Marketing Service

[7 CFR Part 915]

AVOCADOS GROWN IN SOUTH FLORIDA

Handling

Consideration is being given to the following proposal, as hereinafter set forth, which would limit the handling of avocados grown in Florida by establishing size, quality, and maturity requirements, pursuant to § 915.51 *Issuance of regulations,* which was recommended by the Avocado Administrative Committee, established pursuant to the marketing agreement, as amended, and Order No. 915, as amended (7 CFR Part 915; 35 F.R. 16627) regulating the handling of avocados grown in south Florida. This program is effective under the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601–674).

All persons who desire to submit written data, views, or arguments in connection with the proposal should file the same with the Hearing Clerk, Room 112A, U.S. Department of Agriculture, Washington, D.C. 20250, not later than the seventh day after the publication of this notice in the FEDERAL REGISTER. All written submissions made pursuant to this notice will be made available for public inspection at the office of the Hearing Clerk during regular business hours (7 CFR 1.27(b)).

The recommendation of the Avocado Administrative Committee reflects its appraisal of the avocado crop and current and prospective market conditions. Shipments of avocados are expected to begin on or about June 14, 1971, the committee has considered and recommended the sizes, quality, and maturity standards, including shipping periods, for the various varieties of avocados, so as to prevent the handling of immature or other undesirable fruit and to provide consumers with good quality fruit and maximize returns to growers pursuant to the declared policy of the act.

Such proposal reads as follows:

§ 915.313 Avocado Regulation 13.

(a) Order:

(1) During the period June 14, 1971, through April 30, 1972, no handler shall handle any avocados unless such avocados grade at least U.S. No. 3 grade;

(2) On and after the effective time of this regulation, except as otherwise provided in subparagraphs (9) and (10) of this paragraph, no avocados of the varieties listed in Column 1 of the following Table I shall be handled prior to the date listed for the respective variety in Column 2 of such table, except that avocados of the Arue variety which weigh at least 17 ounces or are at least $3^{9}/_{16}$ inches in diameter may be handled prior to the effective date of this section, and thereafter each such variety shall be handled only in conformance with subparagraph (3), (4), (5), and (6) of this paragraph.

TABLE 1

Variety	Date	Minimum weight or diameter	Date	Minimum weight or diameter	Date	Minimum weight or diameter	Date
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
Arue		17 oz. 3⁹⁄₁₆ in.	6-14-71	14 oz. 3⁹⁄₁₆ in.	7-19-71		
Fuchs	6-21-71	14 oz. 3⁹⁄₁₆ in.	7- 5-71	12 oz. 3⁹⁄₁₆ in.	7-19-71	10 oz. 2¹⁵⁄₁₆ in.	8- 2-71
K-5	6-28-71	16 oz. 3⁹⁄₁₆ in.	7-12-71	14 oz. 3⁹⁄₁₆ in.	7-26-71		
Dr. DuPuis No. 2	6-21-71	16 oz. 3⁹⁄₁₆ in.	7- 5-71	14 oz. 3⁷⁄₁₆ in.	7-19-71		
Hardee	7- 5-71	14 oz. 3⁵⁄₁₆ in.	7-12-71	12 oz. 2¹⁵⁄₁₆ in.	8- 2-71		
Pollock	7- 5-71	18 oz. 3¹³⁄₁₆ in.	7-12-71	16 oz. 3⁷⁄₁₆ in.	7-26-71		
Simmonds	7- 5-71	16 oz. 3⁹⁄₁₆ in.	7-12-71	14 oz. 3⁷⁄₁₆ in.	7-26-71		
Nadir	7- 5-71	14 oz. 3⁵⁄₁₆ in.	7-12-71	12 oz. 3¹⁄₁₆ in.	7-19-71	10 oz. 2¹⁵⁄₁₆ in.	8- 2-71
Katherine	7- 5-71	16 oz.	7-19-71	14 oz.	8- 2-71		
Dawn	7-19-71	12 oz. 3⁵⁄₁₆ in.	8- 2-71	10 oz. 3⁹⁄₁₆ in.	8-16-71		
Peterson	7-26-71	14 oz. 3⁵⁄₁₆ in.	8- 9-71	10 oz. 3⁵⁄₁₆ in.	8-23-71	8 oz. 2¹⁵⁄₁₆ in.	9-6-71
Trapp	8- 9-71	14 oz. 3¹³⁄₁₆ in.	8-23-71	12 oz. 3⁷⁄₁₆ in.	9- 6-71		
Waldin	8-16-71	16 oz. 3⁹⁄₁₆ in.	8-30-71	14 oz. 3⁷⁄₁₆ in.	9-13-71	12 oz. 3⁵⁄₁₆ in.	9-27-71
Ruehle	7-19-71	18 oz. 3¹¹⁄₁₆ in.	8- 2-71	16 oz. 3⁹⁄₁₆ in.	8-16-71	14 oz. 3⁷⁄₁₆ in.	8-30-71
Pinelli	8- 2-71	18 oz. 3¹³⁄₁₆ in.	8-16-71	16 oz. 3¹³⁄₁₆ in.	8-30-71		
Webb 2	7-19-71	18 oz.	8- 2-71	16 oz.			8-16-71
Nesbitt	8-16-71	18 oz.	8-23-71	16 oz.	9-13-71		
Tonnage	8-30-71	14 oz. 3⁵⁄₁₆ in.	9- 6-71	12 oz. 3¹³⁄₁₆ in.	9-13-71	10 oz. 2¹³⁄₁₆ in.	9-20-71
Booth 8	9-13-71	16 oz. 3⁹⁄₁₆ in.	9-27-71	15 oz. 3⁷⁄₁₆ in.	10-11-71	13 oz. 3⁵⁄₁₆ in.	
Fairchild	8-30-71	16 oz. 3¹³⁄₁₆ in.	9-13-71	14 oz. 3⁷⁄₁₆ in.	9-27-71	12 oz. 3⁵⁄₁₆ in.	10- 4-71
Nirody	8-30-71	18 oz. 3¹⁵⁄₁₆ in.	9-13-71	16 oz. 3¹³⁄₁₆ in.	9-27-71		
Black Prince	9-13-71	23 oz.	9-27-71	16 oz.	10-18-71		
Catalina	9-13-71	24 oz.	9-20-71	22 oz.	10- 4-71		
Blair	9-27-71	14 oz. 3⁹⁄₁₆ in.	10-18-71				
Collinson	9-27-71	16 oz. 3¹³⁄₁₆ in.	10-25-71				
Chica	9-27-71	12 oz. 3⁷⁄₁₆ in.	10-11-71	10 oz. 3⁵⁄₁₆ in.	10-25-71		
Rue	9-27-71	30 oz. 4³⁄₁₆ in.	10- 4-71	24 oz. 3¹⁵⁄₁₆ in.	10-18-71	18 oz. 3⁹⁄₁₆ in.	11- 1-71
Booth 5	10- 4-71	16 oz. 3¹¹⁄₁₆ in.	10-25-71				
Hickson	10- 4-71	15 oz. 3⁵⁄₁₆ in.	10-18-71	12 oz. 3¹⁄₁₆ in.	10-25-71		
Simpson	10- 4-71	16 oz. 3⁹⁄₁₆ in.	10-25-71				
Vaca	10- 4-71	16 oz. 3⁹⁄₁₆ in.	10-25-71				
Sherman	10- 4-71	16 oz.	10-18-71	14 oz.	11- 1-71	10 oz.	11-22-71
Marcus	10- 4-71	32 oz.	11-15-71				
Booth 10	10-11-71	16 oz. 3¹⁹⁄₁₆ in.	11- 8-71				
Booth 7	10-11-71	16 oz. 3¹⁹⁄₁₆ in.	10-25-71	14 oz. 3⁵⁄₁₆ in.	11- 8-71		
Avon	10-11-71	15 oz. 3¹³⁄₁₆ in.	11- 1-71				
Booth 11	10-11-71	16 oz. 3¹³⁄₁₆ in.	11- 1-71				
Leona	10-11-71	14 oz. 3¹⁹⁄₁₆ in.	10-25-71				
Winslowson	10-11-71	18 oz. 3¹³⁄₁₆ in.	11- 1-71				
Nelson	10-11-71	14 oz. 3⁵⁄₁₆ in.	10-25-71	12 oz. 3⁵⁄₁₆ in.	11- 8-71	10 oz. 3⁵⁄₁₆ in.	11-29-71
Hall	10-11-71	26 oz. 3¹⁵⁄₁₆ in.	10-25-71	20 oz. 3⁹⁄₁₆ in.	11- 8-71		
Lula	10-18-71	18 oz. 3¹¹⁄₁₆ in.	11- 1-71	14 oz. 3⁵⁄₁₆ in.	11-15-71		
Choquette	10-18-71	24 oz. 4¹⁄₁₆ in.	11- 1-71	20 ox. 3¹⁵⁄₁₆ in.	11-22-71		
Monroe	10-18-71	24 oz. 4¹⁄₁₆ in.	11- 1-71	20 oz. 3¹⁵⁄₁₆ in.	11-22-71		
Herman	10-18-71	16 oz. 3⁹⁄₁₆ in.	11- 1-71	14 oz. 3⁵⁄₁₆ in.	11-15-71		
Murphy	10-18-71	16 oz.	11- 1-71	14 oz.	11-15-71	11 oz.	12- 6-71
Ajax (B7-B)	10-25-71	18 oz. 3¹⁵⁄₁₆ in.	11-15-71				
Booth 1	10-25-71	16 oz. 3¹³⁄₁₆ in.	11-15-71				
Booth 3	10-25-71	16 oz. 3¹⁹⁄₁₆ in.	11-15 71				
Taylor	10-25-71	14 oz. 3⁵⁄₁₆ in.	11- 8-71	12 oz. 3⁵⁄₁₆ in.	11-22-71		
Dunedin	11- 8-71	16 oz. 3¹⁹⁄₁₆ in.	11-22-71	14 oz. 3⁵⁄₁₆ in.	12- 6-71	10 oz. 3⁵⁄₁₆ in.	12-27-71
Byars	11-15-71	16 oz. 3¹⁵⁄₁₆ in.	12- 6-71				
Linda	11-15-71	18 oz. 3¹³⁄₁₆ in.	12- 6-71				
Nabal	11-15-71	14 oz. 3⁹⁄₁₆ in.	12 -6-71				
Wagner	12- 6-71	12 oz. 3⁵⁄₁₆ in.	12-20-71	10 oz. 3⁵⁄₁₆ in.	1- 3-71		
Schmidt	1-17-71						
Itsamna	2-14-71						

(3) From the date listed for the respective variety in Column 2 of Table I to the date listed for the respective variety in Column 4 of such table, no handler shall handle any avocados of such variety unless the individual fruit weighs at least the ounces specified for the respective variety in Column 3 of such table or is of at least the diameter specified for such variety in said Column 3;

(4) From the date listed for the respective variety in Column 4 of Table I to the date listed for the respective variety of Column 6 of such table, no handler shall handle any avocados of such variety unless the individual fruit weighs at least the ounces specified for the respective variety in Column 5 of such table or is of at least the diameter specified for such variety in said Column 5;

(5) From the date listed for the respective variety in Column 6 of Table I to the date listed for the respective variety in Column 8 of such table, no handler shall handle any avocados of such variety unless the individual fruit weighs at least the ounces specified for the respective variety in Column 7 of such table or is of at least the diameter specified for such variety in said Column 7;

(6) From October 25, 1971, through November 8, 1971, no handler shall handle any avocados of the Booth 8 variety unless the individual fruit in each lot of such avocados weighs at least 10 ounces or is at least 3¹⁄₁₆ inches in diameter, and from November 9, 1971, through November 15, 1971, no handler shall handle any avocados of the Booth 8 variety unless the individual fruit in each lot of such avocados weighs at least 8 ounces or is at least 2¹³⁄₁₆ inches in diameter;

(7) Except as otherwise provided in subparagraphs (9) and (10) of this paragraph, varieties of the West Indian type of avocados not listed in Table I shall not be handled except in accordance with the following terms and conditions:

(i) Such avocados shall not be handled prior to July 5, 1971.

(ii) From July 5, 1971, through July 11, 1971, the individual fruit in each lot of such avocados shall weigh at least 18 ounces.

(iii) From July 12, 1971, through August 1, 1971, the individual fruit in each lot of such avocados shall weigh at least 16 ounces.

(iv) From August 2, 1971, through August 29, 1971, the individual fruit in each lot of such avocados shall weigh at least 14 ounces.

(v) From August 30, 1971, through September 19, 1971, the individual fruit in each lot of such avocados shall weigh at least 12 ounces.

(8) Except as otherwise provided in subparagraphs (9) and (10) of this paragraph, varieties of avocados not covered by subparagraphs (2) through (7) of this paragraph shall not be handled except in accordance with the following terms and conditions:

(i) Such avocados shall not be handled prior to September 20, 1971.

(ii) From September 20, 1971, through October 17, 1971, the individual fruit in

each lot of such avocados shall weigh at least 15 ounces.

(iii) From October 18, 1971, through December 19, 1971, the individual fruit in each lot of such avocados shall weigh at least 13 ounces.

(9) Notwithstanding the provisions of subparagraphs (2) through (8) of this paragraph regarding the minimum weight or diameter for individual fruit, up to 10 percent, by count, of the individual fruit contained in each lot may weigh less than the minimum specified weight and be less than the minimum specified diameter: *Provided*, That such avocados weigh not more than 2 ounces less than the applicable specified weight for the particular variety as prescribed in Column 3, 5, or 7 of Table I or in subparagraphs (6), (7), and (8) of this paragraph. Such tolerances shall be on a lot basis, but not to exceed double such tolerances shall be permitted for an individual container in a lot.

(10) The provisions of subparagraph (2) through (9) of this paragraph shall not apply to any variety, except the Linda variety, of avocados which, when mature, normally change color to any shade of red or purple and any portion of the skin of the individual fruit has changed to the color for that fruit when mature.

(b) Terms used in the amended marketing agreement and order, when used herein, have the same meaning as is given to the respective term in said marketing agreement and order; the term "diameter" shall mean the greatest dimension measured at right angles to a line from the stem to the blossom end of the fruit; and the term "U.S. No. 3" shall have the same meaning as set forth in the U.S. Standards for Florida Avocados (§§ 51.3050–51.3069 of this title).

(c) The provisions of this section shall become effective June 14, 1971.

Dated: May 26, 1971.

PAUL A. NICHOLSON,
Deputy Director, Fruit and Vegetable Division, Consumer and Marketing Service.

[FR Doc.71–7563 Filed 5–28–71;8:48 am]

[7 CFR Part 922]

APRICOTS GROWN IN DESIGNATED COUNTIES IN WASHINGTON

Handling

Notice is hereby given that the Department is considering the following proposal of the Washington Apricot Marketing Committee, established under the marketing agreement, as amended, and Order No. 922, as amended (7 CFR Part 922), regulating the handling of apricots grown in designated counties in Washington, effective under the applicable provisions of the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601–674).

The telescope fiberboard carton with inside dimensions of 7 x 11½ x 18 inches has been successfully employed as an experimental container for shipping apricots and has furnished a satisfactory alternative to the wooden box which is reported to be in short supply in the specified dimensions. Presently, containers with inside dimensions of 7 x 11½ x 18 inches must be unlidded. Additional authorization is needed to permit the use of the telescope fiberboard carton because in the fully telescoped position the fiberboard carton is lidded although not securely fastened. Accordingly, it is proposed that paragraph (a) (1) of § 922.306 be amended to read as follows:

§ 922.306 Apricot Regulation 6.

(a) * * *

(1) In open containers or telescope fibreboard cartons with inside dimensions of 7 x 11½ x 18 inches and the net weight of the apricots is not less than 28 pounds;

* * * * *

All persons who desire to submit written data, views, or arguments in connection with the aforesaid proposal should file the same, in quadruplicate, with the Hearing Clerk, U.S. Department of Agriculture, Room 112–A, Administration Building, Washington, D.C. 20250, not later than the seventh day after publication of this notice in the FEDERAL REGISTER. All written submissions made pursuant to this notice will be made available for public inspection at the Office of the Hearing Clerk during regular business hours (7 CFR 1.27(b)).

Dated: May 26, 1971.

PAUL A. NICHOLSON,
Deputy Director, Fruit and Vegetable Division, Consumer and Marketing Service.

[FR Doc.71–7561 Filed 5–28–71;8:48 am]

[7 CFR Part 922]

APRICOTS GROWN IN DESIGNATED COUNTIES IN WASHINGTON

Handling

Notice is hereby given that the Department is considering the following proposals of the Washington Apricot Marketing Committee, established under the marketing agreement, as amended, and Order No. 922, as amended (7 CFR Part 922), regulating the handling of apricots grown in designated counties in Washington, effective under the applicable provisions of the Agricultural Marketing Agreement Act of 1937, as amended (7 U.S.C. 601–674).

The recommendations by the Washington Apricot Marketing Committee reflect its appraisal of the crop and current and prospective market conditions. Shipments of apricots from the production area are expected to begin on or about June 21, 1971. The grade, maturity and size requirements proposed herein are necessary to prevent the handling, on and after June 21, 1971, of any apricots of lower grades and smaller sizes than those herein specified, so as to provide consumers with good quality fruit, consistent with (1) the overall size and quality of the crop and (2) maximizing returns to the producers pursuant to the declared policy of the act.

Apricots of the Moorpark variety shipped in open containers are required to be generally well matured. Provision is made for apricots of the Blenheim, Blenril, and Tilton varieties to be of a smaller size when packed in unlidded containers. These three varieties are of a somewhat smaller size than other varieties at comparable stages of maturity. There is a demand for fruit meeting the foregoing specifications in local markets. Due to the nearness to the source of supply, shipments of more mature fruit and fruit of the specified varieties of smaller sizes in less expensive unlidded containers is feasible and the disposition of such fruit in such markets tends to improve the overall returns to growers. Individual shipments, not exceeding 500 pounds of apricots sold for home use and not for resale are exempted from regulation in that such shipments do not materially affect the demand in commercial channels. Certain safeguards respecting such shipments are imposed, consistent with the order, to prevent such apricots from entering into regulated channels of trade.

The proposal is as follows:

§ 922.311 Apricots Regulation 11.

(a) Order: Apricot Regulation 10 (35 F.R. 8916), is hereby terminated on June 21, 1971.

(b) During the period June 21, 1971, through June 30, 1972, no handler shall handle any container of apricots unless such apricots meet the following applicable requirements, or are handled in accordance with subparagraph (3) of this paragraph:

(1) Minimum grade and maturity requirements: Such apricots grade not less than Washington No. 1 and are at least reasonably uniform in color: *Provided*, That if such apricots are the Moorpark variety in open containers they are generally well matured; and

(2) Minimum size requirements: Such apricots measure not less than 1⅝ inches in diameter except that apricots of the Blenheim, Blenril, and Tilton varieties when packed in unlidded containers may measure not less than 1¼ inches: *Provided*, That not more than 10 percent, by count, of such apricots may fail to meet the applicable minimum diameter requirement.

(3) Notwithstanding any other provision of this section, any individual shipment of apricots which meets each of the following requirements may be handled without regard to the provisions of this paragraph, of § 922.41 (Assessments), and of § 922.55 (Inspection and Certification):

(i) The shipment consists of apricots sold for home use and not for resale.

(ii) The shipment does not, in the aggregate, exceed 500 pounds, net weight, of apricots; and

(iii) Each container is stamped or marked with the words "not for resale" in letters at least one-half inch in height.

(c) Terms used in the amended marketing agreement and order shall, when used herein, have the same meaning as is given to the respective term in said amended marketing agreement and order; "diameter" and "Washington No. 1" shall have the same meaning as when used in the State of Washington Department of Agriculture Standards for Apricots, effective May 31, 1966; "reasonably uniform in color" means that the apricots in the individual container do not show sufficient variation in color to materially affect the general appearance of the apricots; and "generally well matured" means that, with respect to not less than 90 percent, by count, of the apricots in any lot of containers, and not less than 85 percent, by count, of such apricots in any container in such lot, at least 40 percent of the surface area of the fruit is at least as yellow as Shade 4 on the U.S. Standard Ground Color Chart for Apples and Pears in the Western States.

All persons who desire to submit written data, views, or arguments in connection with the aforesaid proposals should file the same, in quadruplicate, with the Hearing Clerk, U.S. Department of Agriculture, Room 112-A, Administration Building, Washington, D.C. 20250, not later than the seventh day after publication of this notice in the FEDERAL REGISTER. All written submissions made pursuant to this notice will be made available for public inspection at the Office of the Hearing Clerk during regular business hours (7 CFR 1.27(b)).

Dated: May 26, 1971.

PAUL A. NICHOLSON,
Deputy Director, Fruit and Vegetable Division, Consumer and Marketing Service.

[FR Doc.71-7562 Filed 5-28-71;8:48 am]

[7 CFR Part 966]

[Docket No. AO-265-A3]

TOMATOES GROWN IN FLORIDA

Postponement of Public Hearing on Proposed Amendment of Marketing Agreement and Order

Notice of a public hearing with respect to proposed amendment of Marketing Agreement No. 125 and Order No. 966, both as amended (7 CFR Part 966), was published in the FEDERAL REGISTER of April 28, 1971 (36 F.R. 7969).

The notice stated the hearing would begin at 9 a.m., local time, June 2, 1971, at the Auditorium of the Florida Fruit and Vegetable Association, 4401 Colonial Drive, Orlando, FL.

At the request of attorneys representing importers of tomatoes, this hearing has been postponed. A new date will be announced later.

Dated: May 27, 1971.

JOHN C. BLUM,
Deputy Administrator, Regulatory Programs.

[FR Doc.71-7601 Filed 5-28-71;8:52 am]

DEPARTMENT OF COMMERCE

Maritime Administration

[46 CFR Part 252]

DETERMINATION OF ESSENTIALITY OF U.S.-FLAG BULK CARRIER SERVICES

Notice of Proposed Rule Making

Correction

In F.R. Doc. 71-7270 appearing on page 9334 in the issue of Saturday, May 22, 1971, the penultimate line of § 252.2(a)(1) reading "export foreign commerce of the United" should read "export and import foreign commerce of the United".

DEPARTMENT OF HEALTH, EDUCATION, AND WELFARE

Public Health Service

[42 CFR Part 37]

ROENTGENOGRAPHIC EXAMINATIONS OF COAL MINERS

Notice of Proposed Rule Making

Pursuant to section 203 of the Federal Coal Mine Health and Safety Act (30 U.S.C. 843), it is proposed to amend Part 37 of Title 42, Code of Federal Regulations, as set forth below.

On August 19, 1970, regulations setting forth the specifications for giving, reading, classifying and submitting the chest roentgenograms required under the Act were adopted (35 F.R. 13206). With a short time remaining before June 30, 1971, the deadline prescribed by the Act for providing initial chest roentgenographic examinations of underground miners, the Department finds that miners have failed to avail themselves of these examinations on the grounds that the regulations allegedly do not assure adequate confidentiality of roentgenographic findings. In proposing these amendments the Department seeks to improve confidentiality and to assure that a substantial number of miners will avail themselves of these examinations.

Accordingly, § 37.4(a)(6) would be amended to require assurance from the operators conducting plans approved by the Department that they will not solicit X-ray findings and that they have instructed the physicians giving the X-ray examinations that duplicate roentgenograms shall not be taken or made. In addition, § 37.6 would be amended to provide that where a determination has been made that an operator's X-ray program has been ineffective because less than 50 percent of the eligible miners have participated, the Secretary would himself give or make arrangements with an appropriate person, agency, or institution to give the chest X-ray examinations required under this subpart, and in such instances, reimbursement for the cost of conducting such examination would be required from the appropriate operator. Where an operator is conducting a roentgenographic examination program under a plan approved by the Department and the plan does not comply with one or more provisions of the amendments, the operator would be given 15 days following the effective date of the new amendments to amend the plan to conform to the new requirements.

It is proposed to make the amendments effective on the date of their republication in the FEDERAL REGISTER.

Inquiries and comments concerning the proposed amendments may be submitted, in duplicate, to the Bureau of Occupational Safety and Health, 5600 Fishers Lane, Rockville, MD 20852.

In view of the deadline for initial X-ray examinations, the Department finds good cause to limit the time for submitting comments to 14 days following the publication of these proposed amendments in the FEDERAL REGISTER.

Part 37 would be amended as follows:

1. Section 37.4(a)(6) would be revised to read as follows:

§ 37.4 Plans for initial chest roentgenographic examinations.

(a) * * *

(6) Assurances that (i) the operator will not solicit a physician's roentgenographic findings and (ii) instructions have been given to the physician(s) giving the roentgenographic examinations that duplicate roentgenograms will not be taken or made.

* * * * *

2. Section 37.6(a) would be amended by adding the following new subparagraph:

§ 37.6 Roentgenographic examinations conducted by the Secretary.

(a) * * *

(4) Where, after miners have been given an opportunity for an initial chest roentgenographic examination under an approved plan, the Secretary determines that the program has been ineffective because of limited participation of the eligible miners in the operator's program (50 percent will normally be used as a guideline in judging effectiveness).

* * * * *

§ 37.20 [Amended]

3. Section 37.20 would be amended by adding the following sentence at the end of paragraph (d)(5): "No other identifying information such as the miner's name or clinic number shall be recorded on the film."

4. A new § 37.42 would be added to read as follows:

§ 37.42 **Amendments to assure confidentiality.**

(a) With approximately a month remaining before June 30, 1971, the deadline prescribed by section 203 of the Act for providing initial chest roentgenographic examinations of underground miners, it has come to the attention of the Department that miners have failed to avail themselves of these examinations on the grounds that this Part 37 does not assure confidentiality of roentgenographic findings.

(b) The Department seeks to strengthen the provisions assuring confidentiality since the health of miners is its greatest responsibility under the Act, and the program to prevent pneumoconiosis by early roentgenographic detection will surely fail if miners do not participate.

(c) Accordingly, the new amendments guard against the taking or making of duplicate roentgenograms and the furnishing of X-ray findings to the operator. The new amendments also prohibit recording any information on the film that would identify the miner other than his social security number.

(d) Operators who have submitted plans previously approved by the Department will have 15 days following the effective date of the new amendments to amend their plans, where appropriate, to comply with these amendments.

Approved: May 24, 1971.

ELLIOT L. RICHARDSON,
Secretary.

[FR Doc.71-7538 Filed 5-28-71;8:47 am]

Notices

DEPARTMENT OF THE TREASURY

Internal Revenue Service

RICHARD JOHN ENGLER

Notice of Granting of Relief

Notice is hereby given that Richard John Engler, 305 North Main Street, Edgerton, WI, has applied for relief from disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms incurred by reason of his conviction on September 7, 1967, in the Federal District Court, Madison, Wis., of a crime punishable by imprisonment for a term exceeding 1 year. Unless relief is granted, it will be unlawful for Richard J. Engler because of such conviction, to ship, transport, or receive in interstate or foreign commerce any firearm or ammunition, and he would be ineligible for a license under chapter 44, title 18, United States Code as a firearms or ammunition importer, manufacturer, dealer, or collector. In addition, under title VII of the Omnibus Crime Control and Safe Streets Act of 1968, as amended (82 Stat. 236; 18 U.S.C., Appendix), because of such conviction, it would be unlawful for Richard J. Engler to receive, possess, or transport in commerce or affecting commerce, any firearm.

Notice is hereby given that I have considered Richard J. Engler's application and:

(1) I have found that the conviction was made upon a charge which did not involve the use of a firearm or other weapon or a violation of chapter 44, title 18, United States Code, or of the National Firearms Act; and

(2) It has been established to my satisfaction that the circumstances regarding the conviction and the applicant's record and reputation are such that the applicant will not be likely to act in a manner dangerous to public safety, and that the granting of the relief would not be contrary to the public interest.

Therefore, pursuant to the authority vested in the Secretary of the Treasury by section 925(c), title 18, United States Code and delegated to me by 26 CFR 178144: *It is ordered,* That Richard J. Engler be, and he hereby is, granted relief from any and all disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms and incurred by reason of the conviction hereinabove described.

Signed at Washington, D.C., this 17th day of May 1971.

[SEAL] DEAN J. BARRON,
Acting Commissioner of Internal Revenue.

[FR Doc.71-7534 Filed 5-28-71;8:47 am]

CLARENCE EUGENE FOWLER

Notice of Granting of Relief

Notice is hereby given that Clarence Eugene Fowler, 20437 Tracey Street, Detroit, MI, has applied for relief from disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms incurred by reason of his conviction on August 29, 1960, in the Recorder's Court of the city of Detroit, Mich., of a crime punishable by imprisonment for a term exceeding 1 year. Unless relief is granted, it will be unlawful for Clarence E. Fowler because of such conviction, to ship, transport, or receive in interstate or foreign commerce any firearm, or ammunition, and he would be ineligible for a license under chapter 44, title 18, United States Code as a firearms or ammunition importer, manufacturer, dealer, or collector. In addition, under title VII of the Omnibus Crime Control and Safe Streets Act of 1968, as amended (82 236; 18 U.S.C., Appendix), because of such conviction, it would be unlawful for Clarence E. Fowler to receive, possess, or transport in commerce or affecting commerce, any firearm.

Notice is hereby given that I have considered Clarence E. Fowler's application and:

(1) I have found that the conviction was made upon a charge which did not involve the use of a firearm or other weapon or a violation of chapter 44, title 18, United States Code, or of the National Firearms Act; and

(2) It has been established to my satisfaction that the circumstances regarding the conviction and the applicant's record and reputation are such that the applicant will not be likely to act in a manner dangerous to public safety, and that the granting of the relief would not be contrary to the public interest.

Therefore, pursuant to the authority vested in the Secretary of the Treasury by section 925(c), title 18, United States Code and delegated to me by 26 CFR 178.144: *It is ordered,* That Clarence E. Fowler be, and he hereby is, granted relief from any and all disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms and incurred by reason of the conviction hereinabove described.

Signed at Washington, D.C., this 17th day of May 1971.

[SEAL] DEAN J. BARRON,
Acting Commissioner of Internal Revenue.

[FR Doc.71-7535 Filed 5-28-71;8:47 am]

WILBERT HENRY

Notice of Granting of Relief

Notice is hereby given that Wilbert Henry, Route 1, Box 301, Willard, NC, has applied for relief from disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms incurred by reason of his conviction on November 22, 1957, in the United States District Court, Wilmington, N.C., of a crime punishable by imprisonment for a term exceeding 1 year. Unless relief is granted, it will be unlawful for Wilbert Henry because of such conviction, to ship, transport, or receive in interstate or foreign commerce any firearm or ammunition, and he would be ineligible for a license under chapter 44, title 18, United States Code as a firearms or ammunition importer, manufacturer, dealer, or collector. In addition, under title VII of the Omnibus Crime Control and Safe Streets Act of 1968, as amended (82 Stat. 236; 18 U.S.C., Appendix), because of such conviction, it would be unlawful for Wilbert Henry to receive, possess, or transport in commerce or affecting commerce, any firearm.

Notice is hereby given that I have considered Wilbert Henry's application and:

(1) I have found that the conviction was made upon a charge which did not involve the use of a firearm or other weapon or a violation of chapter 44, title 18, United States Code, or of the National Firearms Act; and

(2) It has been established to my satisfaction that the circumstances regarding the conviction and the applicant's record and reputation are such that the applicant will not be likely to act in a manner dangerous to public safety, and that the granting of the relief would not be contrary to the public interest.

Therefore, pursuant to the authority vested in the Secretary of the Treasury by section 925(c), title 18, United States Code and delegated to me by 26 CFR 178.144: *It is ordered,* That Wilbert Henry be, and he hereby is, granted relief from any and all disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms and incurred by reason of the conviction hereinabove described.

Signed at Washington, D.C., this 17th day of May 1971.

[SEAL] DEAN J. BARRON,
Acting Commissioner of Internal Revenue.

[FR Doc.71-7536 Filed 5-28-71;8:47 am]

RONALD W. STEVENS, SR.

Notice of Granting of Relief

Notice is hereby given that Ronald W. Stevens, Sr., 951 Hayward Street, Manchester, NH 03103, has applied for relief from disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms incurred by reason of his conviction on January 10, 1963, in Grafton County Superior Court, Lebanon, N.H., of a crime punishable by imprisonment for a term exceeding 1 year. Unless relief is granted, it will be unlawful for Ronald W. Stevens, Sr., because of such conviction, to ship, transport, or receive in interstate or foreign commerce any firearm or ammunition, and he would be ineligible for a license under chapter 44, title 18, United States Code as a firearms or ammunition importer, manufacturer, dealer, or collector. In addition, under title VII of the Omnibus Crime Control and Safe Streets Act of 1968, as amended (82 Stat. 236; 18 U.S.C., Appendix), because of such conviction, it would be unlawful for Ronald W. Stevens, Sr., to receive, possess, or transport in commerce or affecting commerce, any firearm.

Notice is hereby given that I have considered Ronald W. Stevens, Sr.'s application and:

(1) I have found that the conviction was made upon a charge which did not involve the use of a firearm or other weapon or a violation of chapter 44, title 18, United States Code, or of the National Firearms Act; and

(2) It has been established to my satisfaction that the circumstances regarding the conviction and the applicant's record and reputation are such that the applicant will not be likely to act in a manner dangerous to public safety, and that the granting of the relief would not be contrary to the public interest.

Therefore, pursuant to the authority vested in the Secretary of the Treasury by section 925(c), title 18, United States Code and delegated to me by 26 CFR 178.144: *It is ordered*, That Ronald W. Stevens, Sr., be, and he hereby is, granted relief from any and all disabilities imposed by Federal laws with respect to the acquisition, receipt, transfer, shipment, or possession of firearms and incurred by reason of the conviction hereinabove described.

Signed at Washington, D.C., this 13th day of May 1971.

[SEAL] HAROLD T. SWARTZ,
Acting Commissioner of Internal Revenue.

[FR Doc.71-7537 Filed 5-28-71;8:47 am]

DEPARTMENT OF THE INTERIOR

National Park Service

ICE AGE NATIONAL SCIENTIFIC RESERVE, WISCONSIN

Notice of Establishment and Boundaries

Whereas, the act of October 13, 1964 (78 Stat. 1087), authorizes the Secretary of the Interior to cooperate with the State of Wisconsin in the designation and administration of the Ice Age National Scientific Reserve in the State of Wisconsin, and—

Whereas, paragraph 2(a) of that act provides that the Secretary, in cooperation with State and local governmental authorities of Wisconsin, may formulate a comprehensive plan for the protection, preservation, and interpretation of outstanding examples of continental glaciation in Wisconsin, and—

Whereas, paragraph 2(b) of that act authorizes the Secretary to publish notice of establishment of the national scientific reserve and of the boundaries thereof when he is satisfied that State legislation exists for the preservation of the nationally significant features of the reserve, open to the people of the entire nation; and when the comprehensive plan has been completed and submitted to the President of the Senate and the Speaker of the House of Representatives and ninety days have passed, and consultation has been conducted with the Governor of the State of Wisconsin, and—

Whereas, the requirements stated in the paragraphs above have been met,

Now, therefore, notice is given that the Ice Age National Scientific Reserve is hereby established.

Paragraph 2(b) of the Act of October 13, 1964, provides for publication of notice of the boundaries of the national scientific reserve. Therefore, in accordance with paragraph 2(b) of the act, and 245 DM-1 (27 F.R. 6395, as amended), the following ten maps, which depict the boundaries of the national scientific reserve, are published.

Dated: May 3, 1971.

GEORGE B. HARTZOG, Jr.,
Director, National Park Service.

PROPOSED UNITS

ICE AGE NATIONAL SCIENTIFIC RESERVE

1. Two Creeks Buried Forest
2. Sheboygan Marsh County Park
3. Kettle Moraine State Forest, North Unit
4. Campbellsport Drumlins
5. Cross Plains
6. Devil's Lake State Park
7. Mill Bluff State Park
8. Bloomer Area
9. Interstate Park

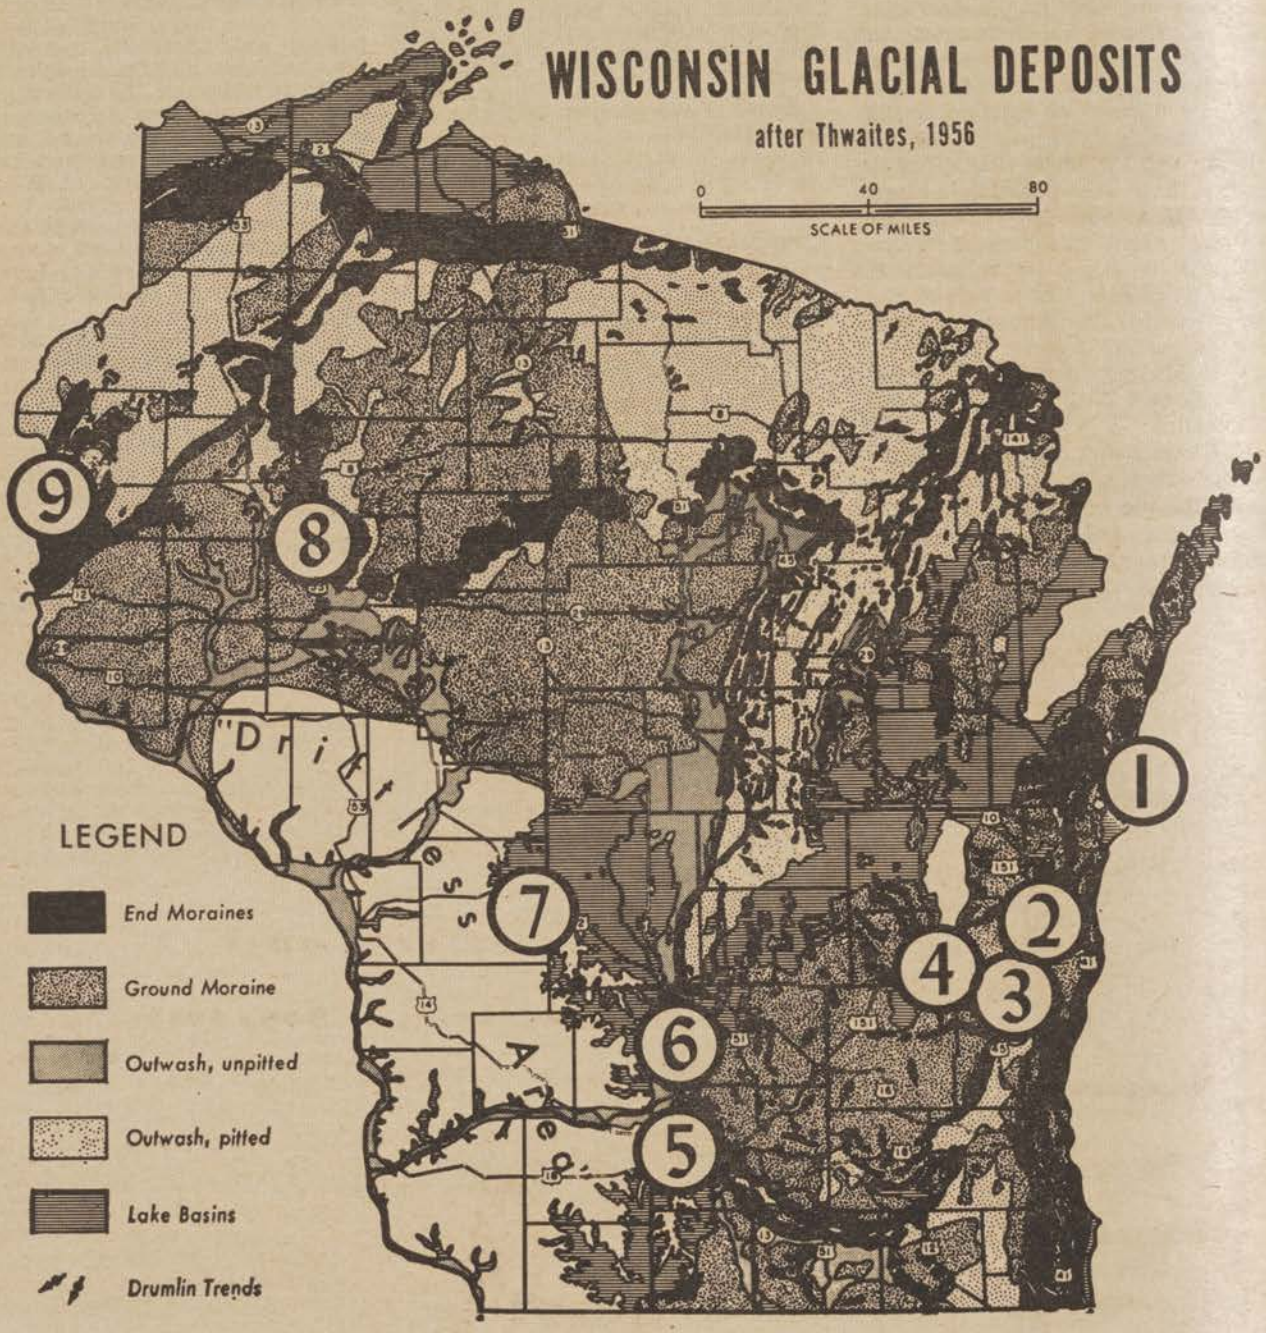

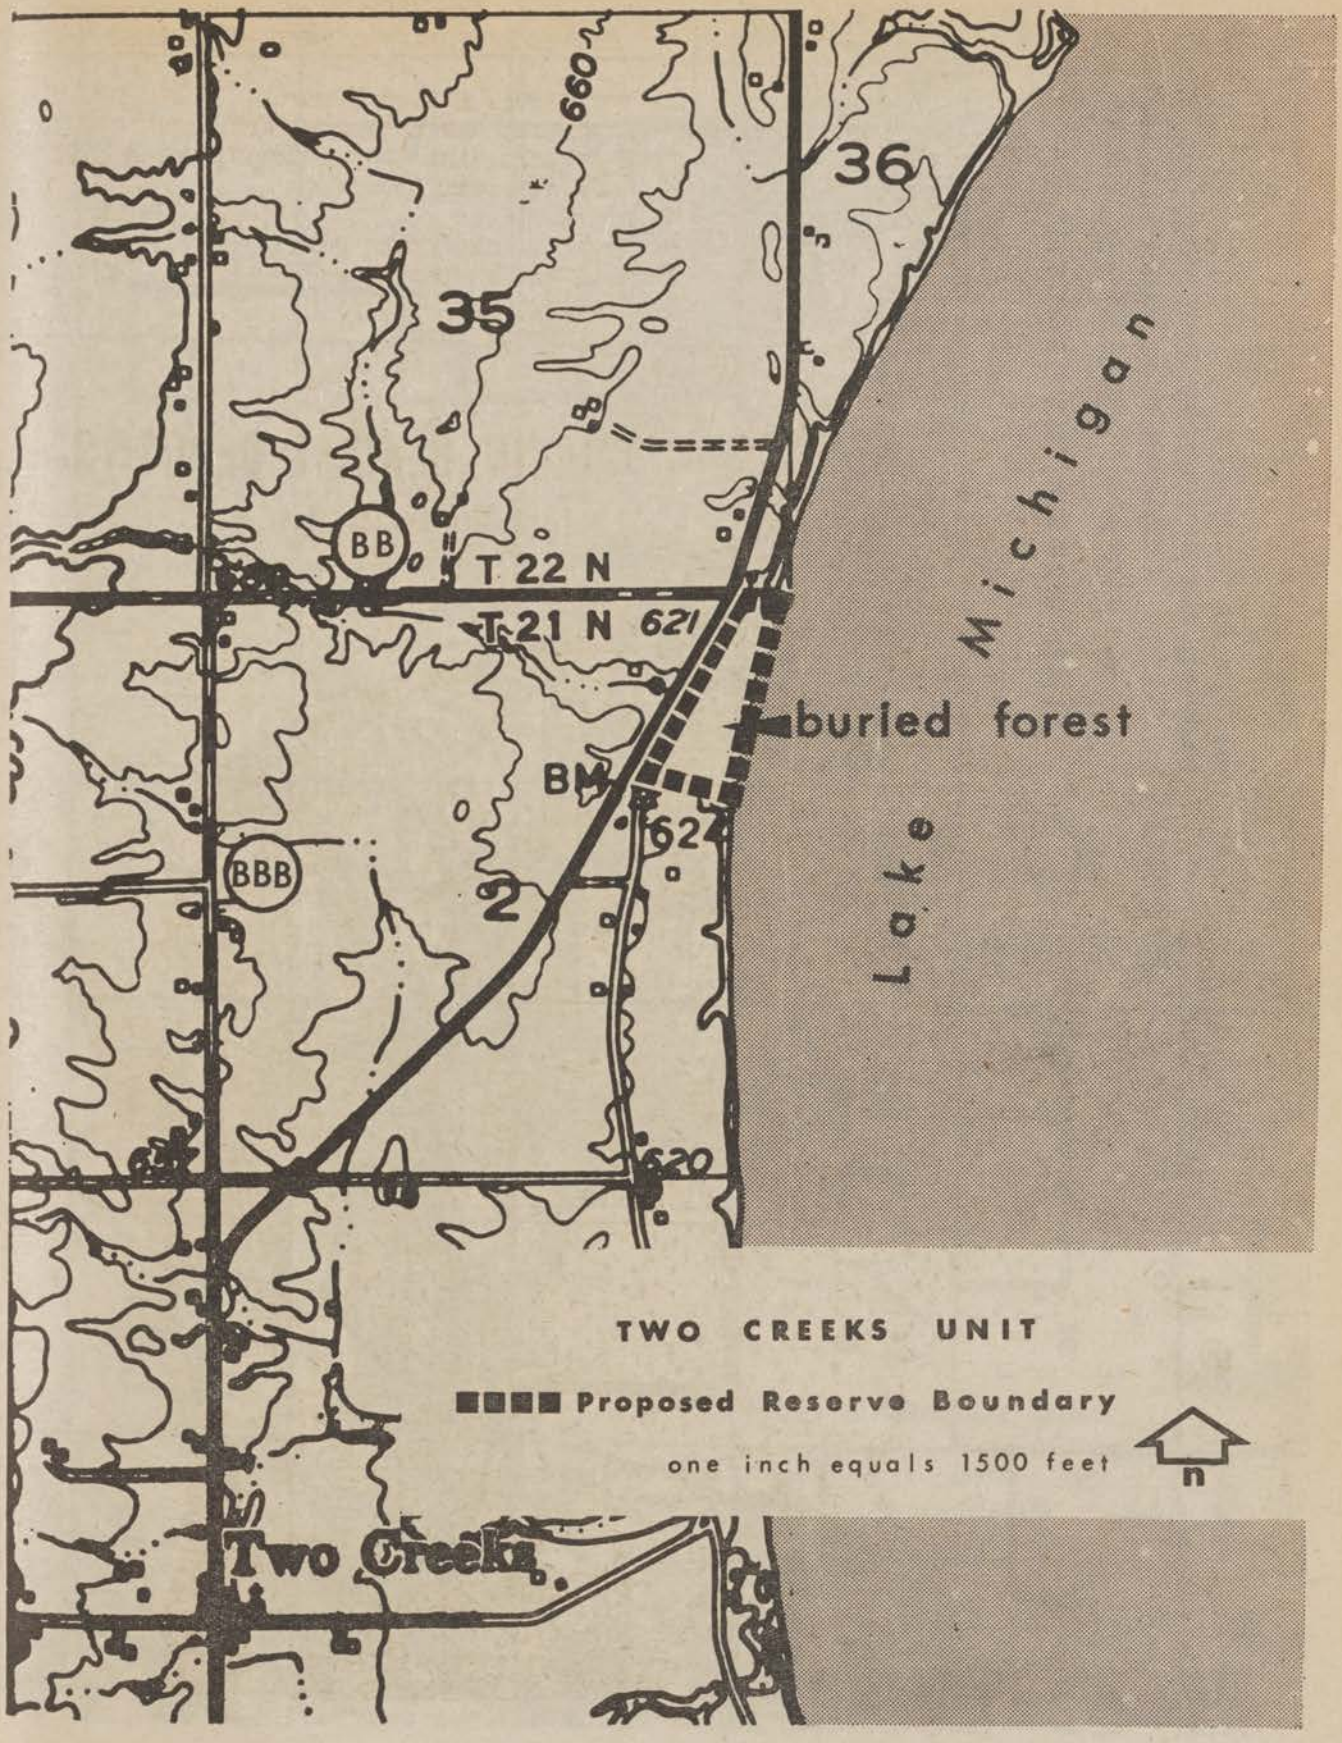
660
36
35
BB
T 22 N
T 21 N
621
buried forest
Lake Michigan
BM
624
BBB
2
620
TWO CREEKS UNIT
Proposed Reserve Boundary
one inch equals 1500 feet
N
Two Creeks

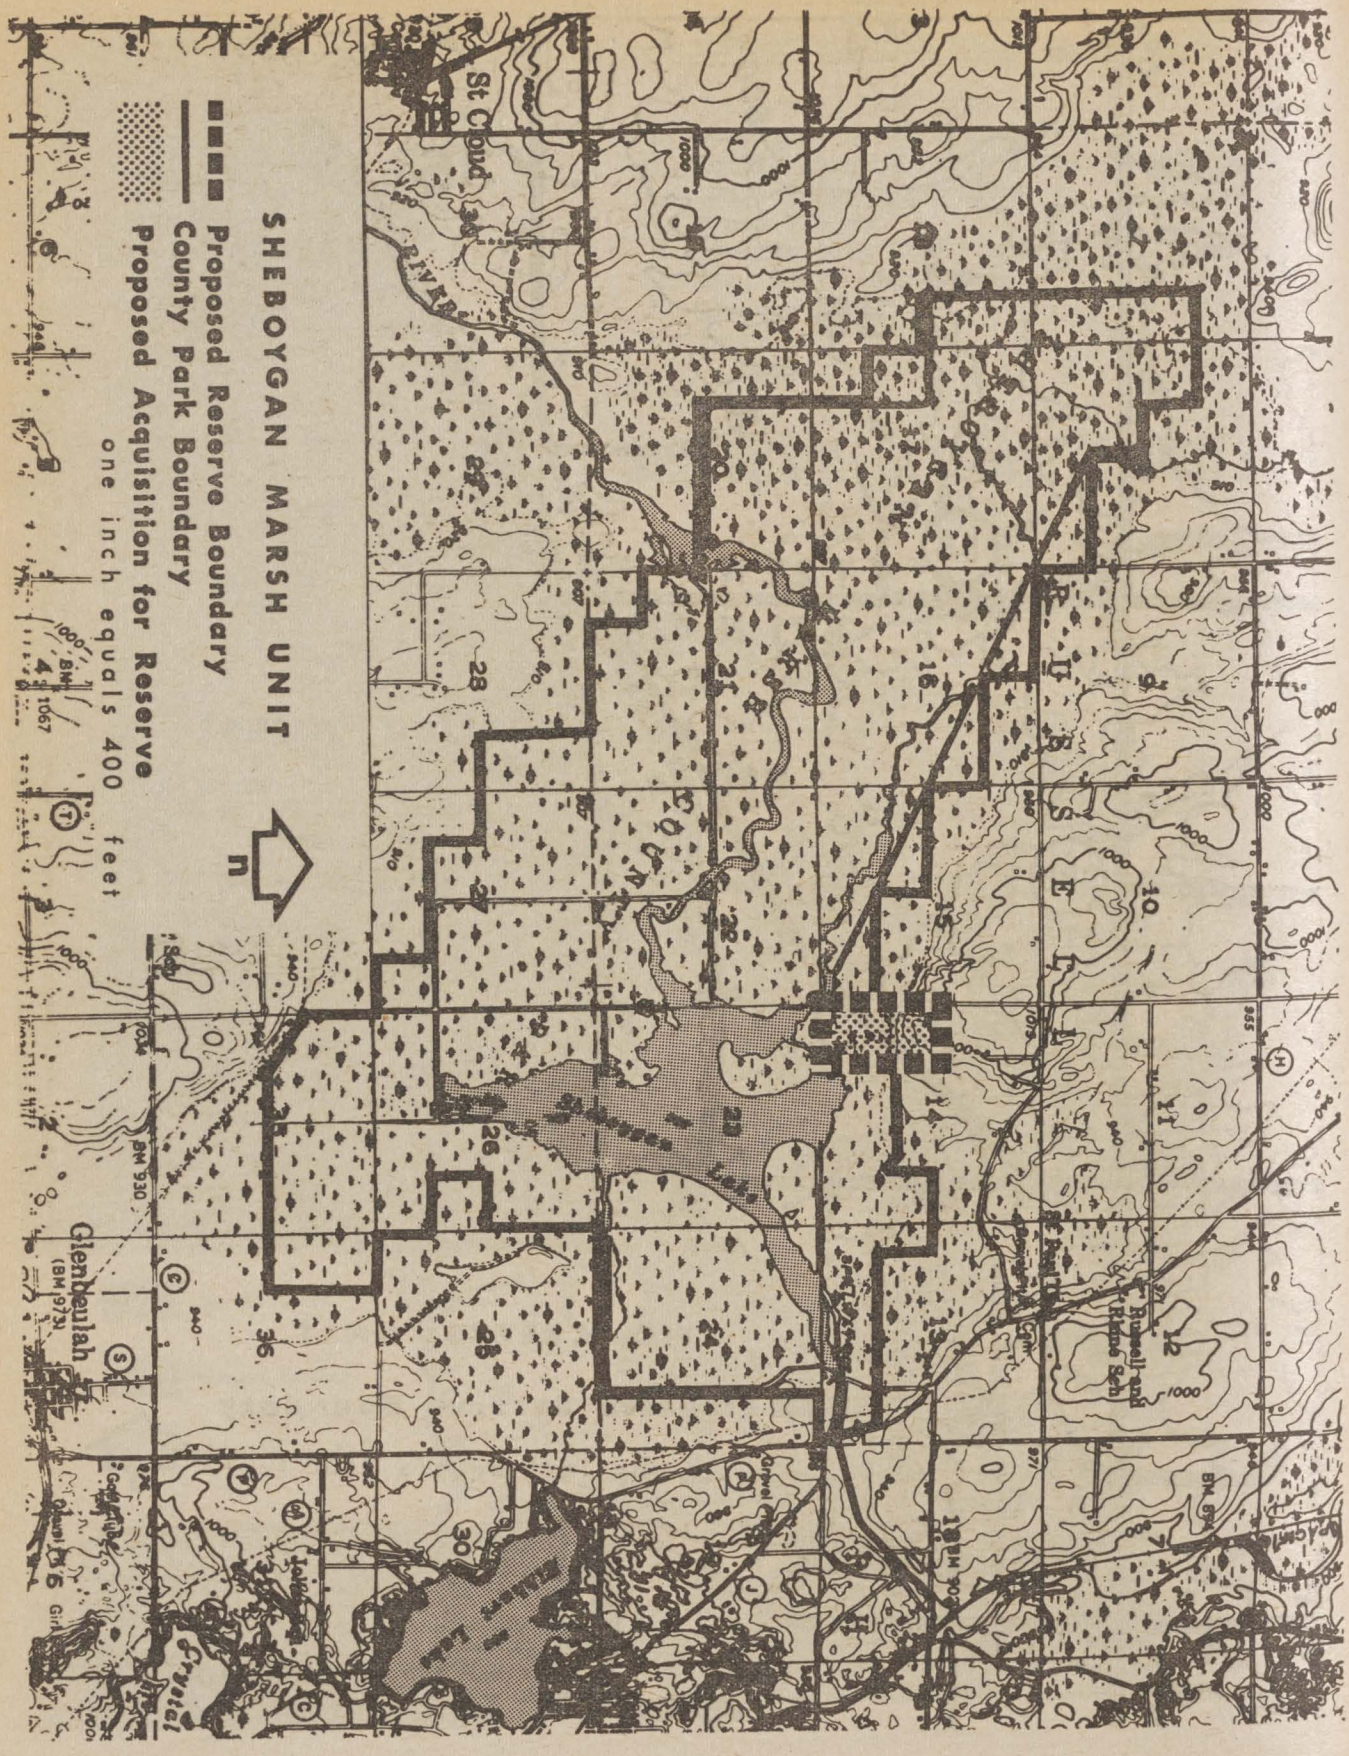
SHEBOYGAN MARSH UNIT
Proposed Reserve Boundary
County Park Boundary
Proposed Acquisition for Reserve
one inch equals 400 feet
St Cloud
Glenbeulah
Sheboygan Marsh
Sheboygan Marsh
Russell Hill
Russell Hill
Ridge Sch
Ridge Sch
Glenbeulah
Glenbeulah
Glenbeulah

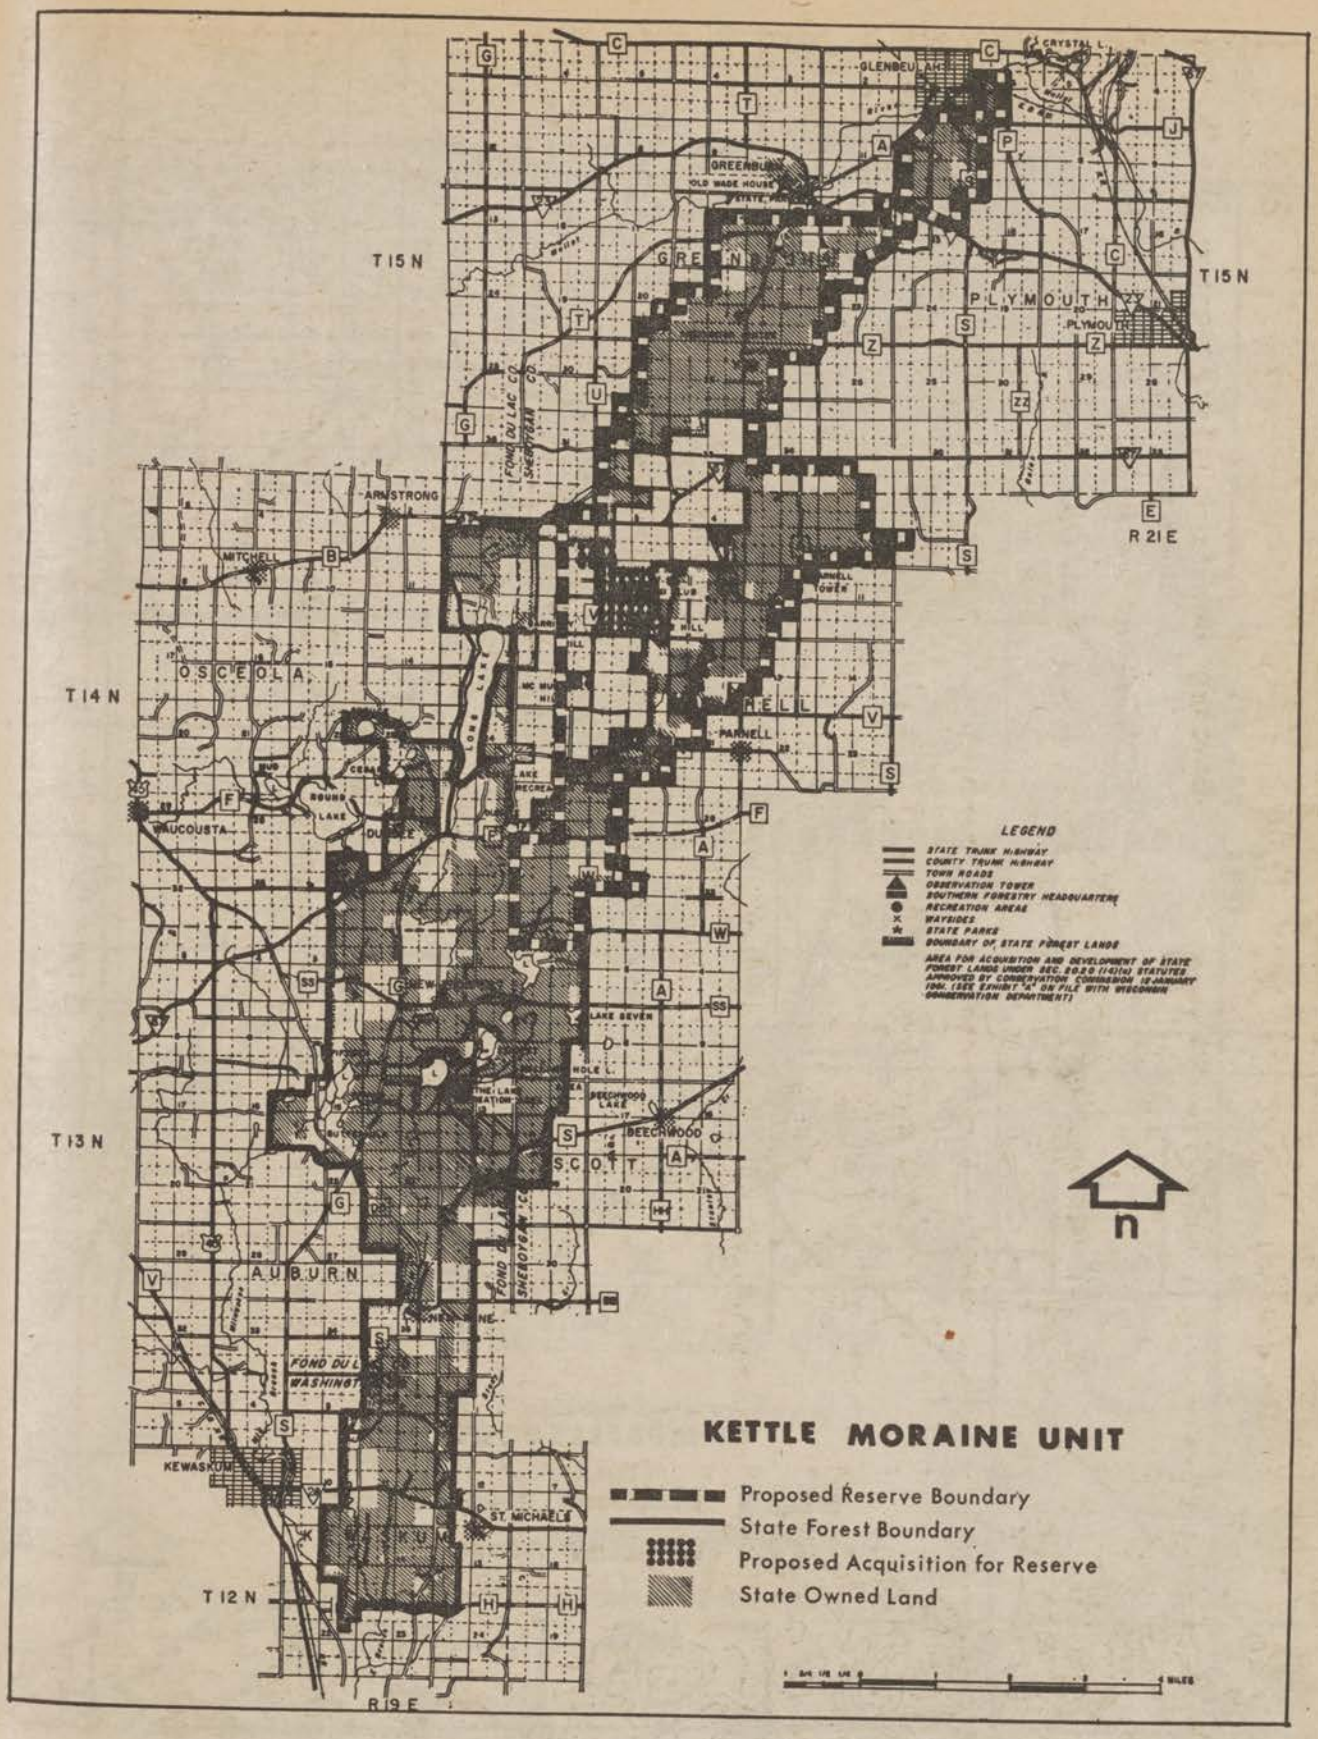
T 15 N
T 14 N
T 13 N
T 12 N
R 21 E
R 19 E
GREENBUSH
GLENBEULAH
PLYMOUTH
PLYMOUTH
ARMSTRONG
MITCHELL
OSCEOLA
PARNELL
PARNELL
MAUCOUSTA
LAKE SEVEN
BEECHWOOD
BEECHWOOD LAKE
SCOTT
AUBURN
KEWASKUM
ST. MICHAELS
FOND DU LAC CO.
SHEBOYGAN CO.
WASHINGTON CO.
LEGEND
STATE TRUNK HIGHWAY
COUNTY TRUNK HIGHWAY
TOWN ROADS
OBSERVATION TOWER
SOUTHERN FORESTRY HEADQUARTERS
RECREATION AREAS
WAYSIDES
STATE PARKS
BOUNDARY OF STATE FOREST LANDS
AREA FOR ACQUISITION AND DEVELOPMENT OF STATE FOREST LANDS UNDER SEC. 20.20 (14)(a) STATUTES APPROVED BY CONSERVATION COMMISSION 10 JANUARY 1961. (SEE EXHIBIT "A" ON FILE WITH WISCONSIN CONSERVATION DEPARTMENT)
KETTLE MORAINE UNIT
Proposed Reserve Boundary
State Forest Boundary
Proposed Acquisition for Reserve
State Owned Land

Campbellsport
Ashford
CAMPBELLSPORT UNIT
Proposed Reserve Boundary
Wayside Areas
one inch equals 4000 ft.

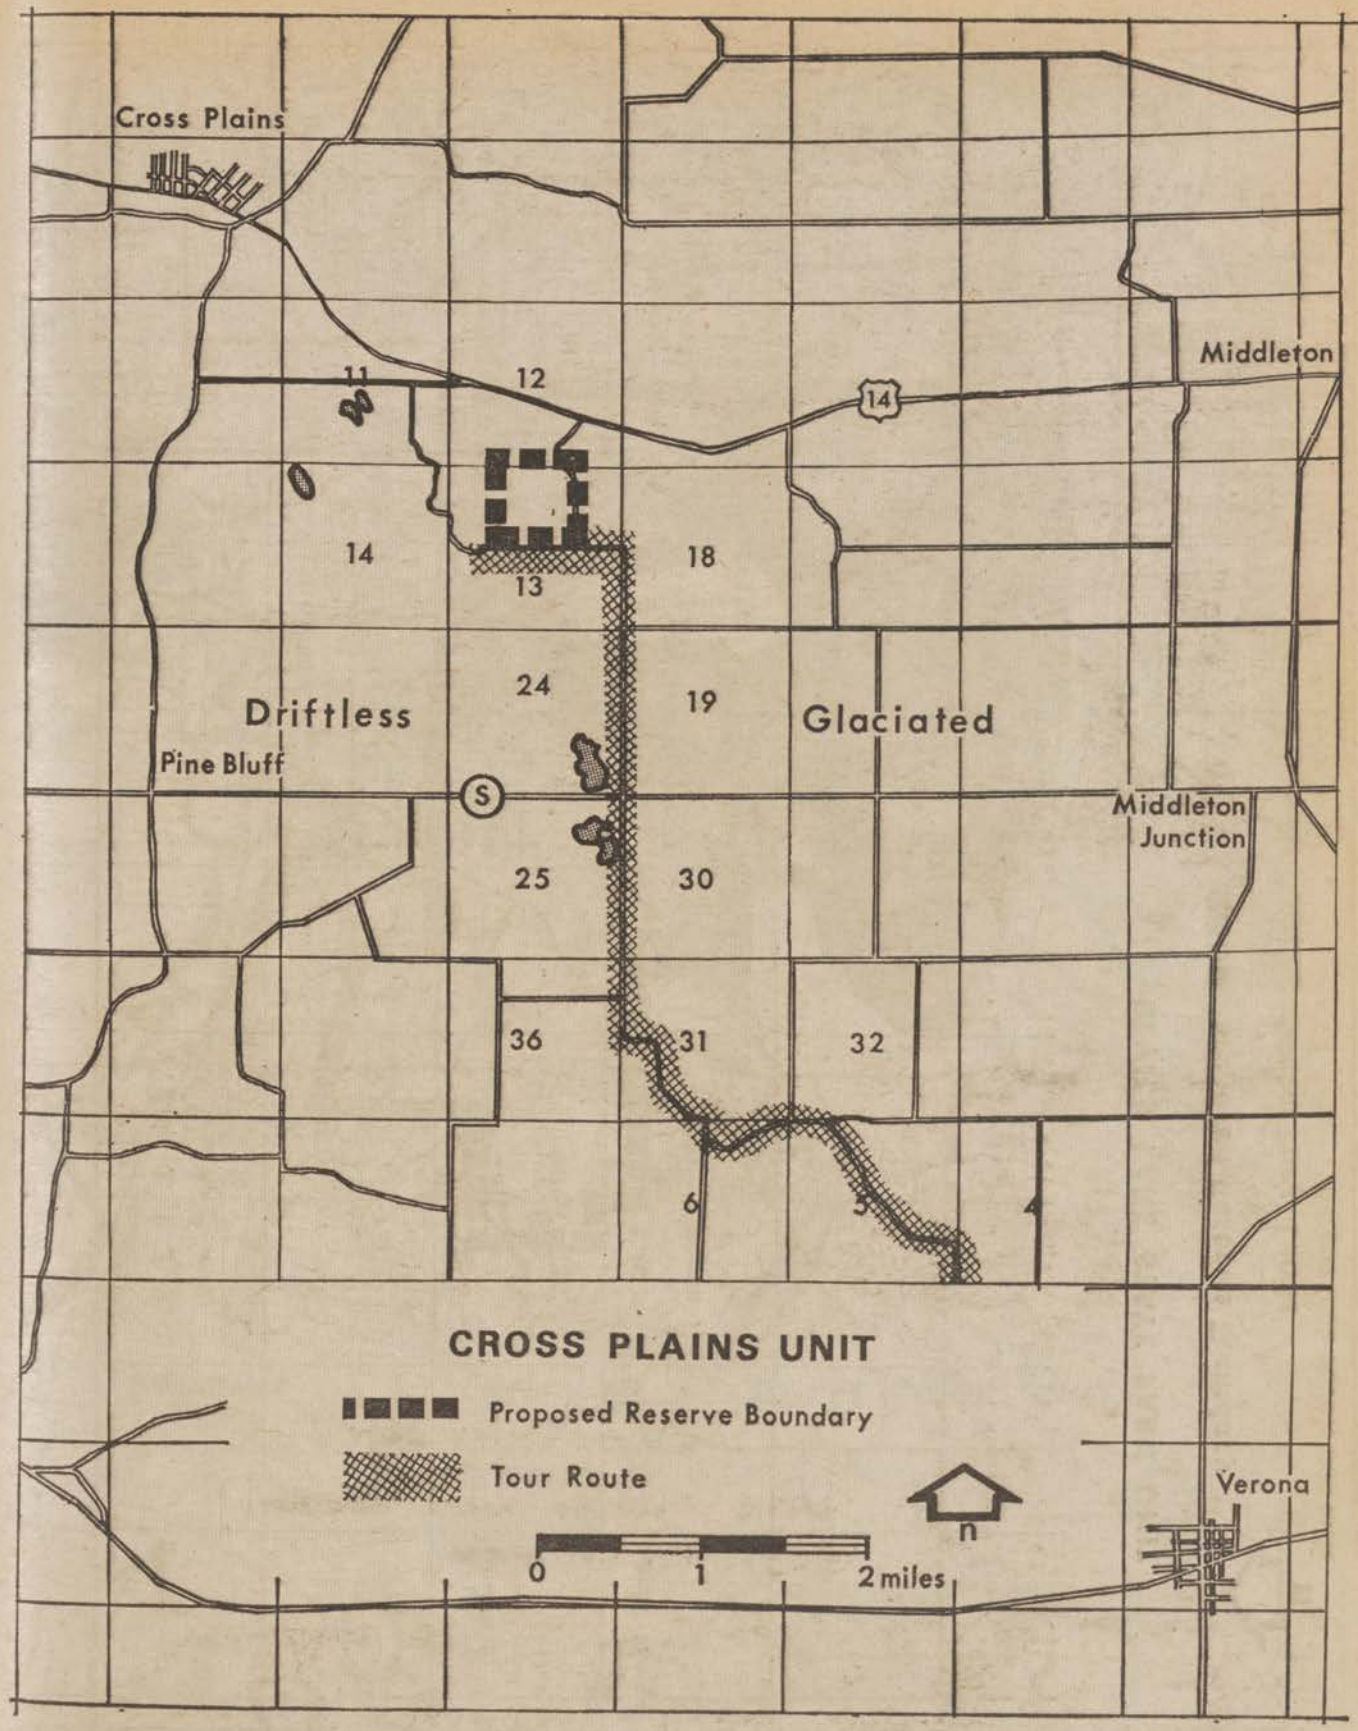
Cross Plains
Middleton
11
12
14
18
13
24
19
Driftless
Glaciated
Pine Bluff
S
Middleton
Junction
25
30
36
31
32
6
5
4
CROSS PLAINS UNIT
Proposed Reserve Boundary
Tour Route
Verona
n
0
1
2 miles

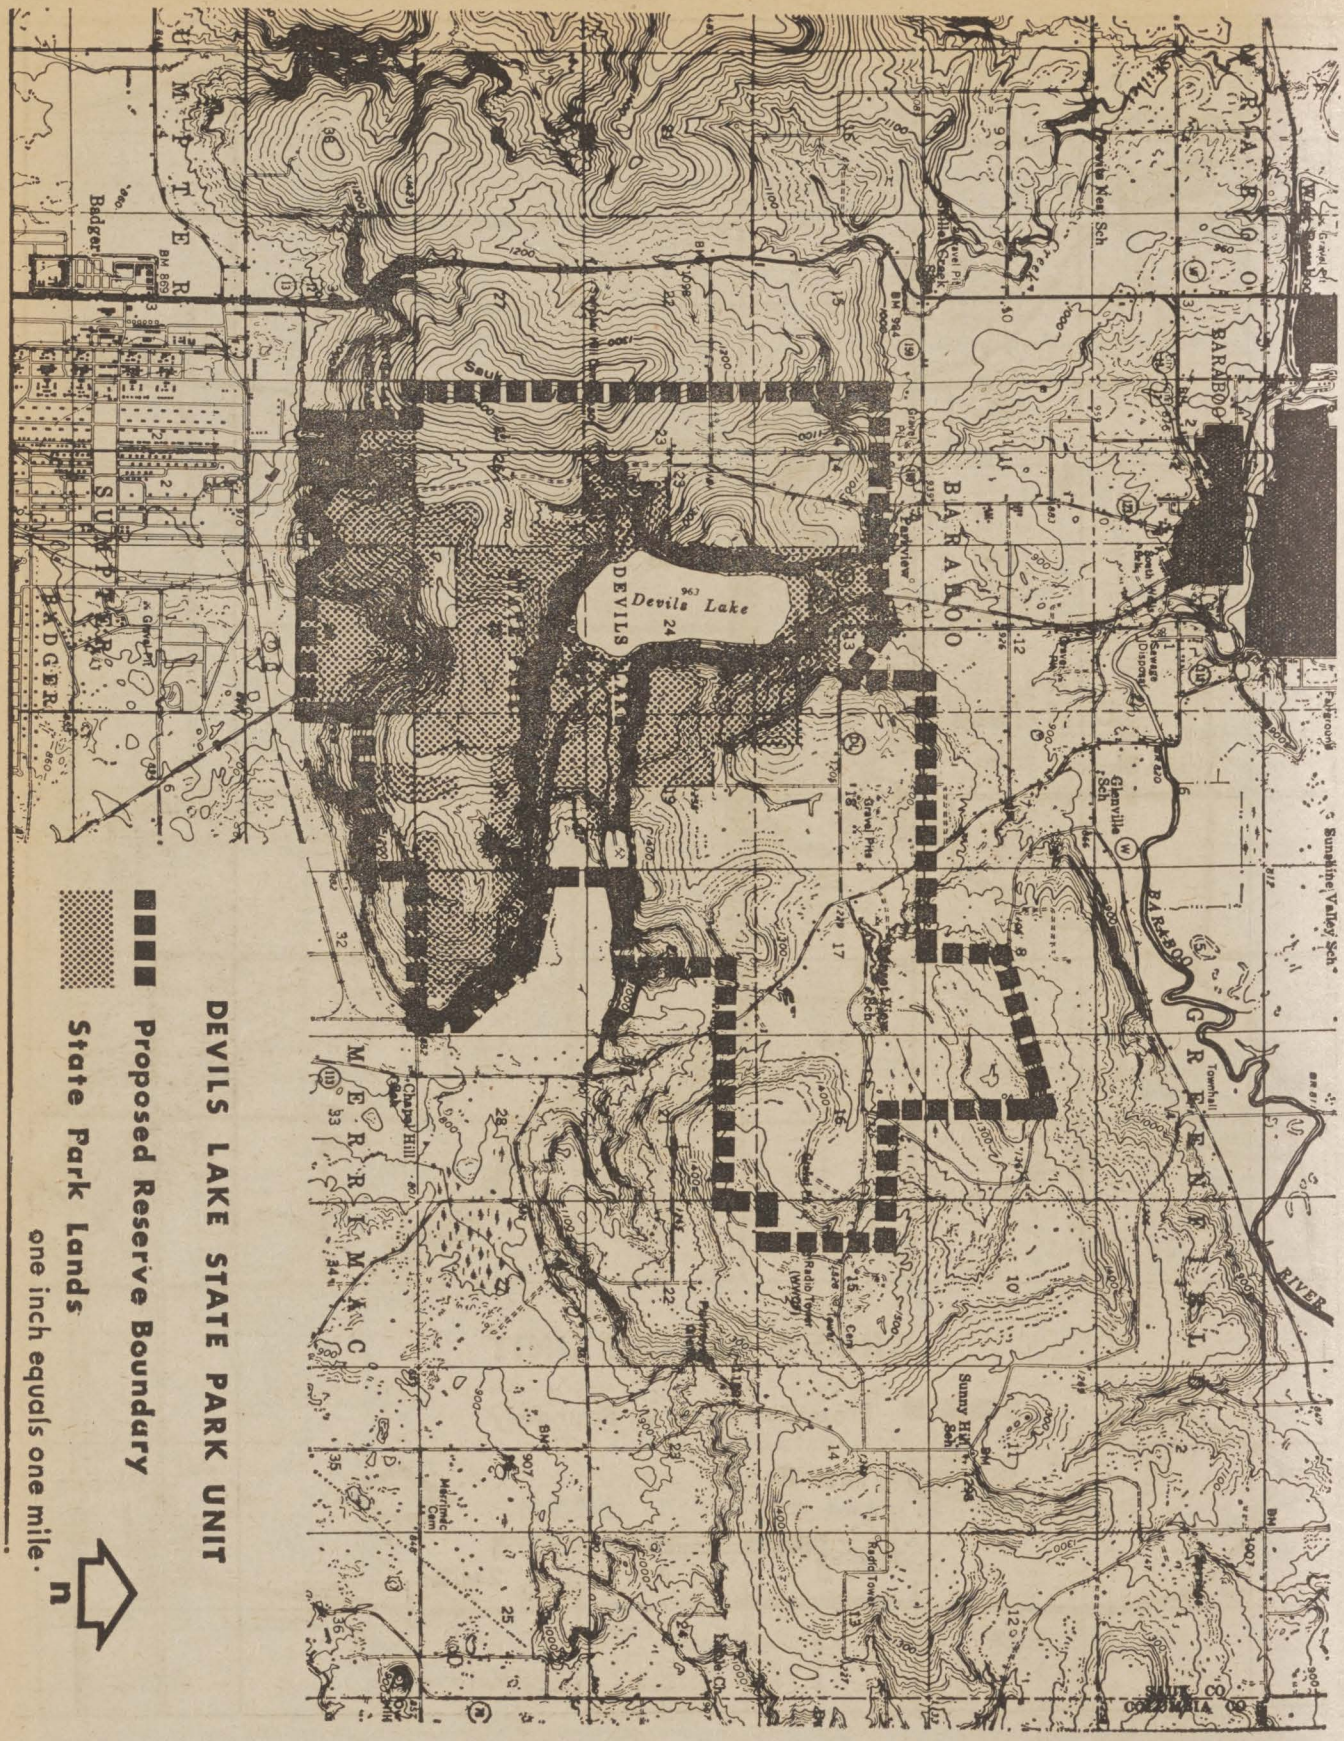
DEVILS LAKE STATE PARK UNIT
Proposed Reserve Boundary
State Park Lands
one inch equals one mile.
N
Devils Lake
963
DEVILS
24
BARBOO
SUMPTER
BADGER
MERRIMAC
Parkview
Glenville Sch
Sunshine Valley Sch
Townhall
Sunny Hill Sch
Radio Tower (WKOW)
Radio Towers
Cem
Meriinac Cem
Chapel Hill
Devils Kee Sch
Badger
RIVER

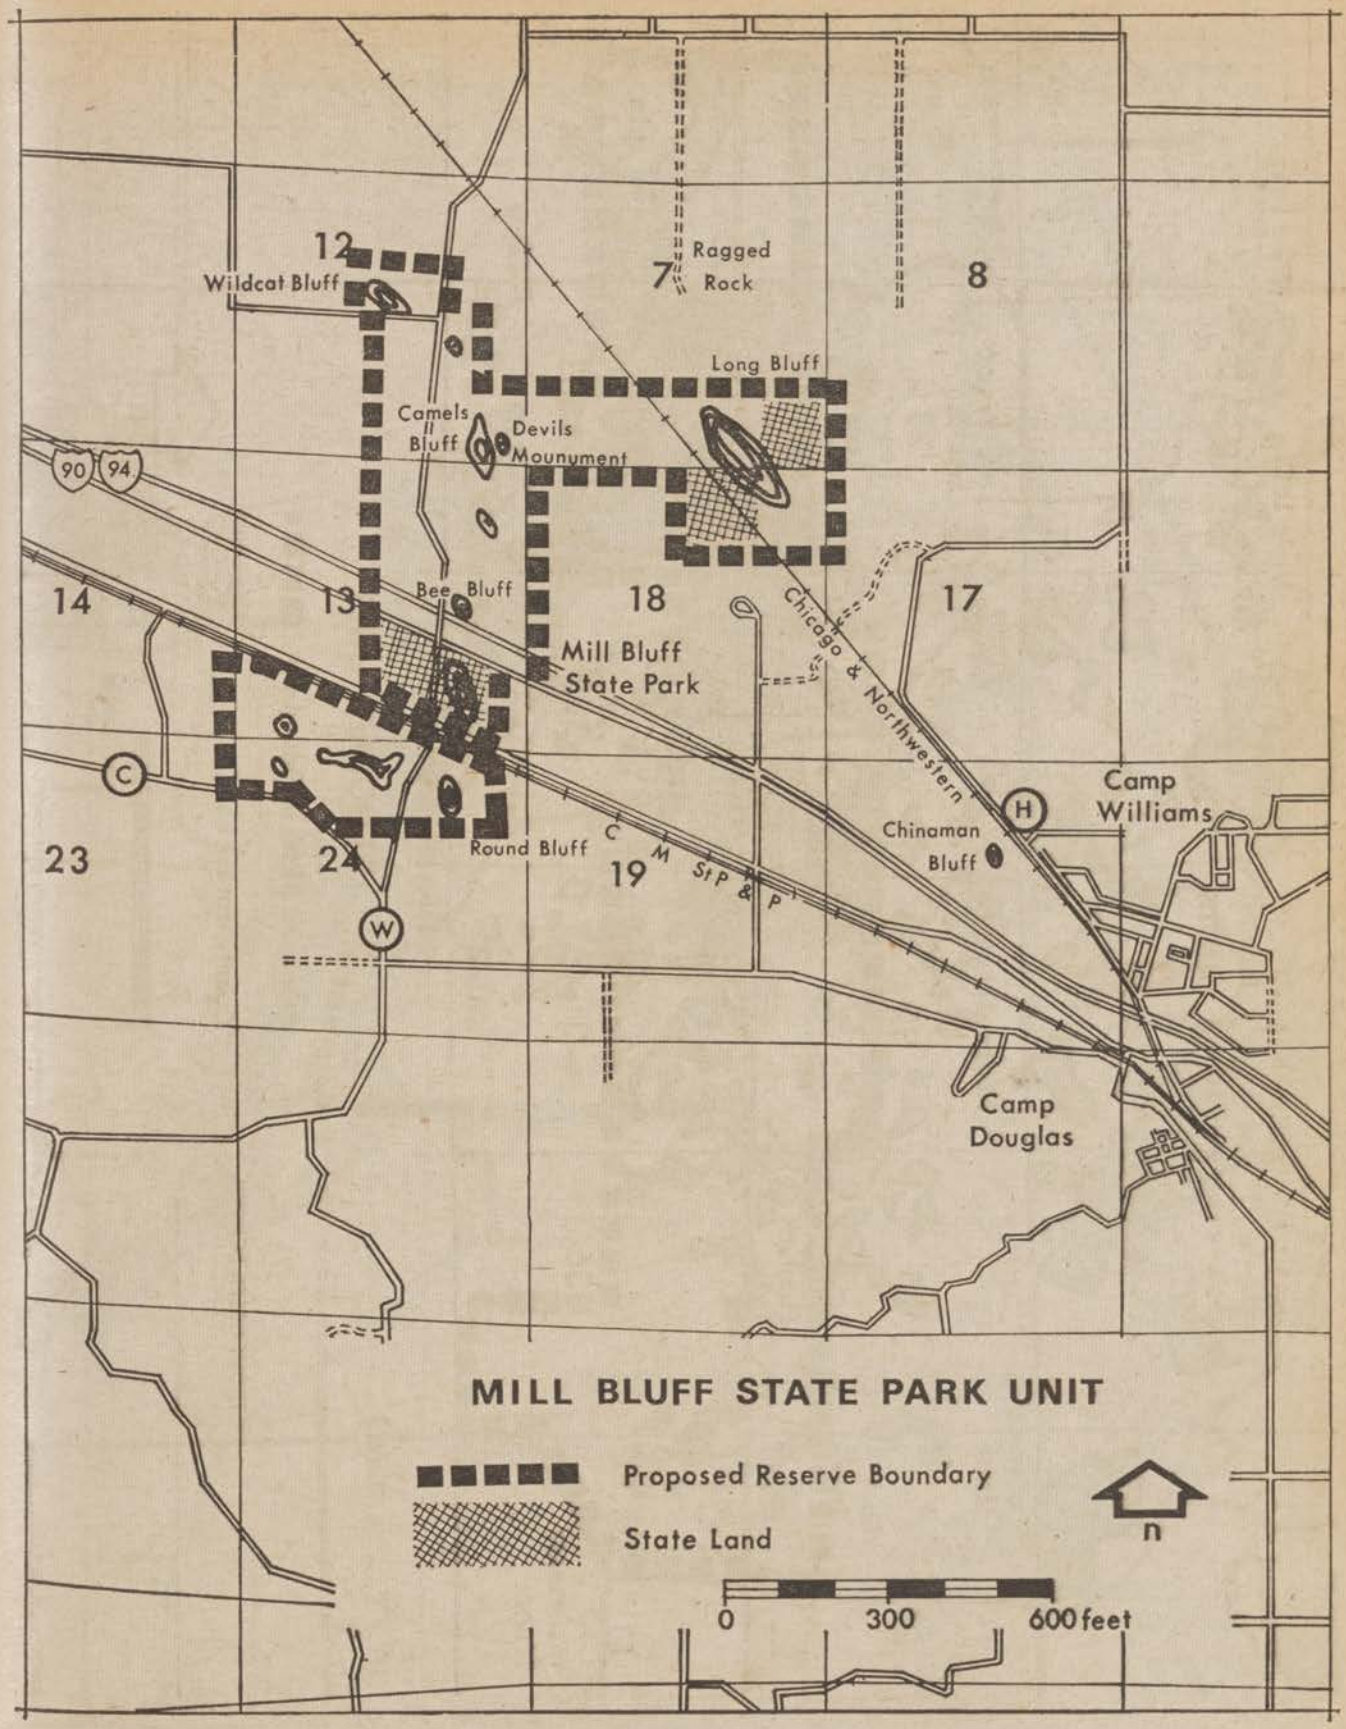
12
Wildcat Bluff
7
Ragged Rock
8
Long Bluff
Camels Bluff
Devils Mounument
90
94
14
13
Bee Bluff
18
17
Mill Bluff State Park
Chicago & Northwestern
C
H
Camp Williams
Chinaman Bluff
23
24
Round Bluff
C M St P & P
19
W
Camp Douglas
MILL BLUFF STATE PARK UNIT
Proposed Reserve Boundary
State Land
n
0
300
600 feet

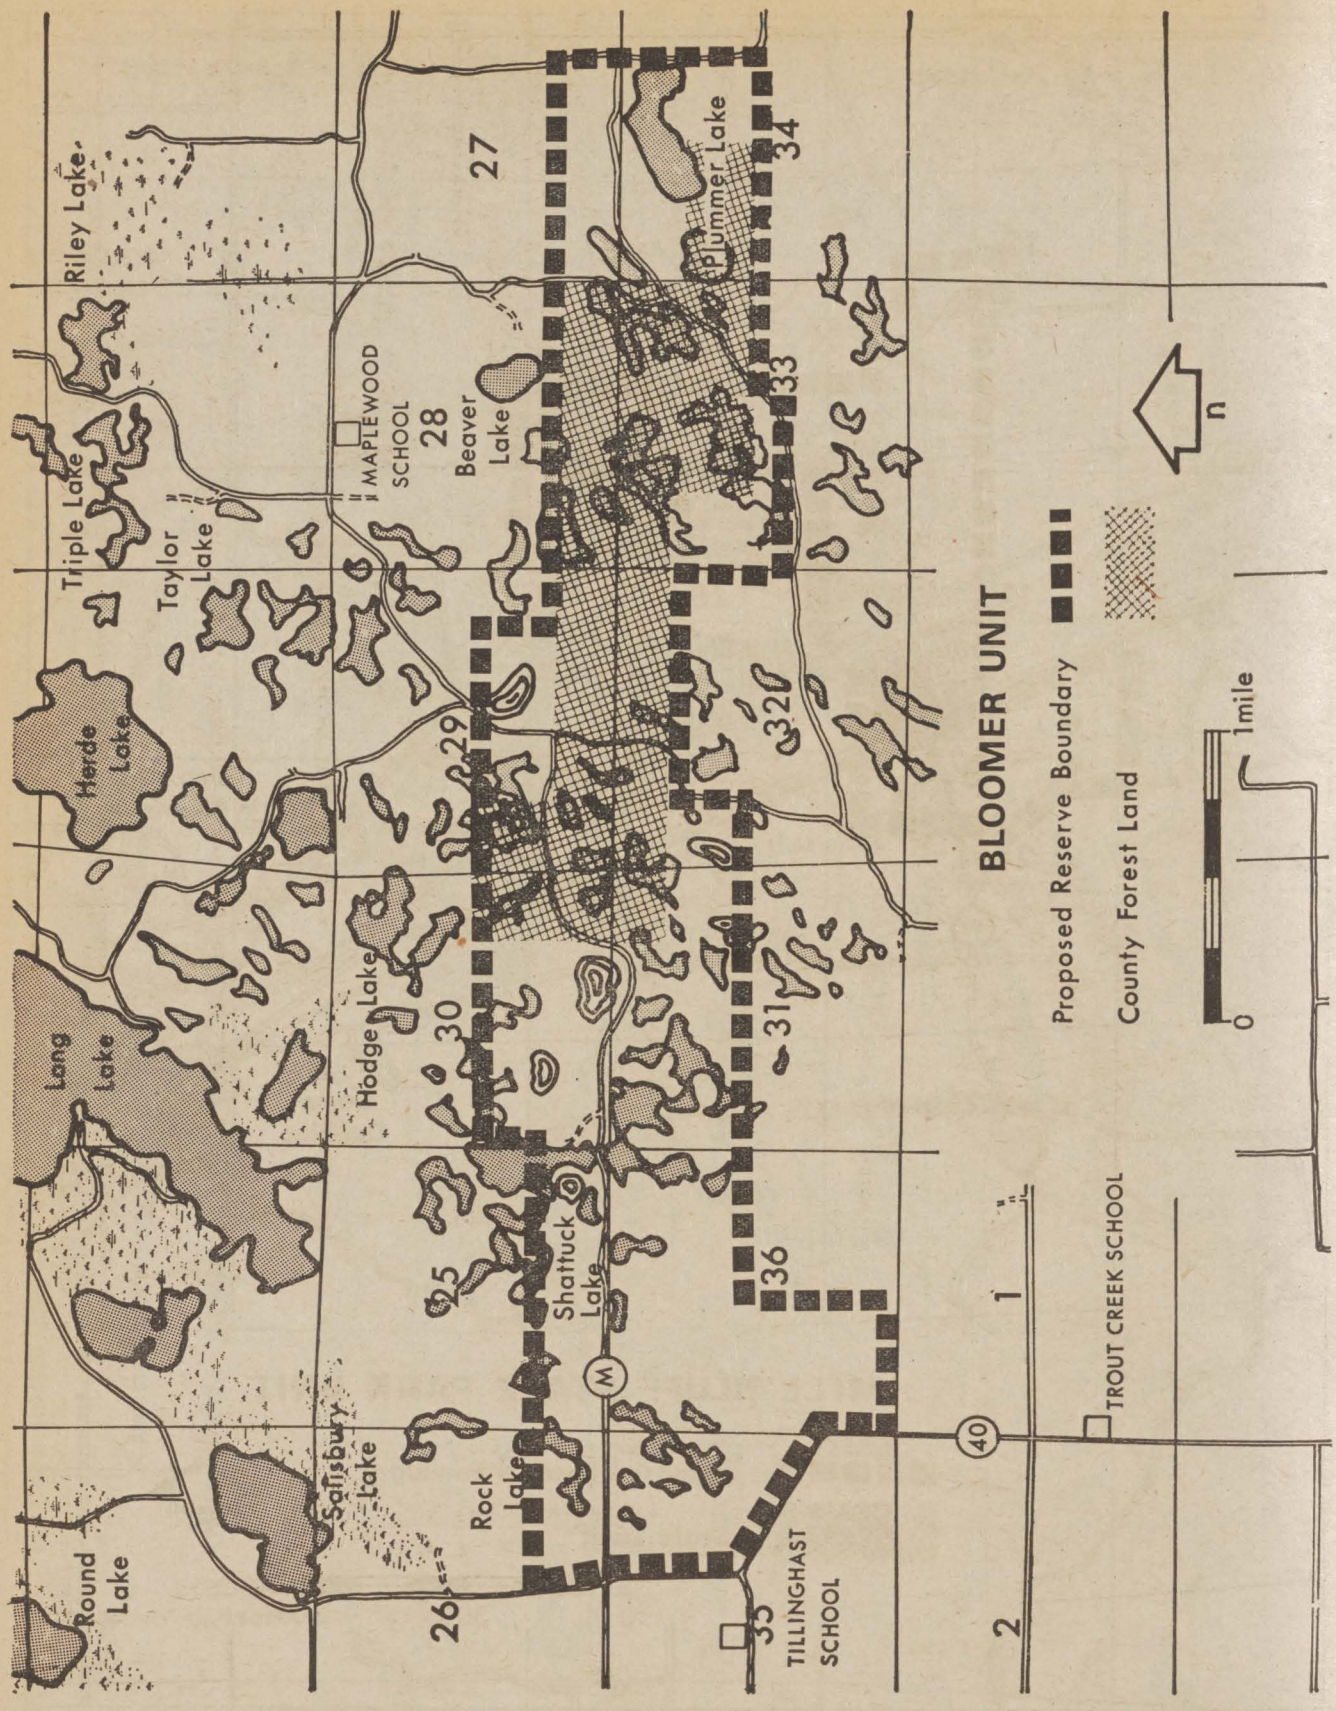
BLOOMER UNIT
Proposed Reserve Boundary
County Forest Land
0
1 mile
N
Riley Lake
Triple Lake
Taylor Lake
Herde Lake
Lang Lake
Round Lake
Salisbury Lake
Rock Lake
Hodge Lake
Shattuck Lake
Beaver Lake
Plummer Lake
MAPLEWOOD SCHOOL
TROUT CREEK SCHOOL
TILLINGHAST SCHOOL
26
27
28
29
30
31
32
33
34
35
36
1
2
M
40

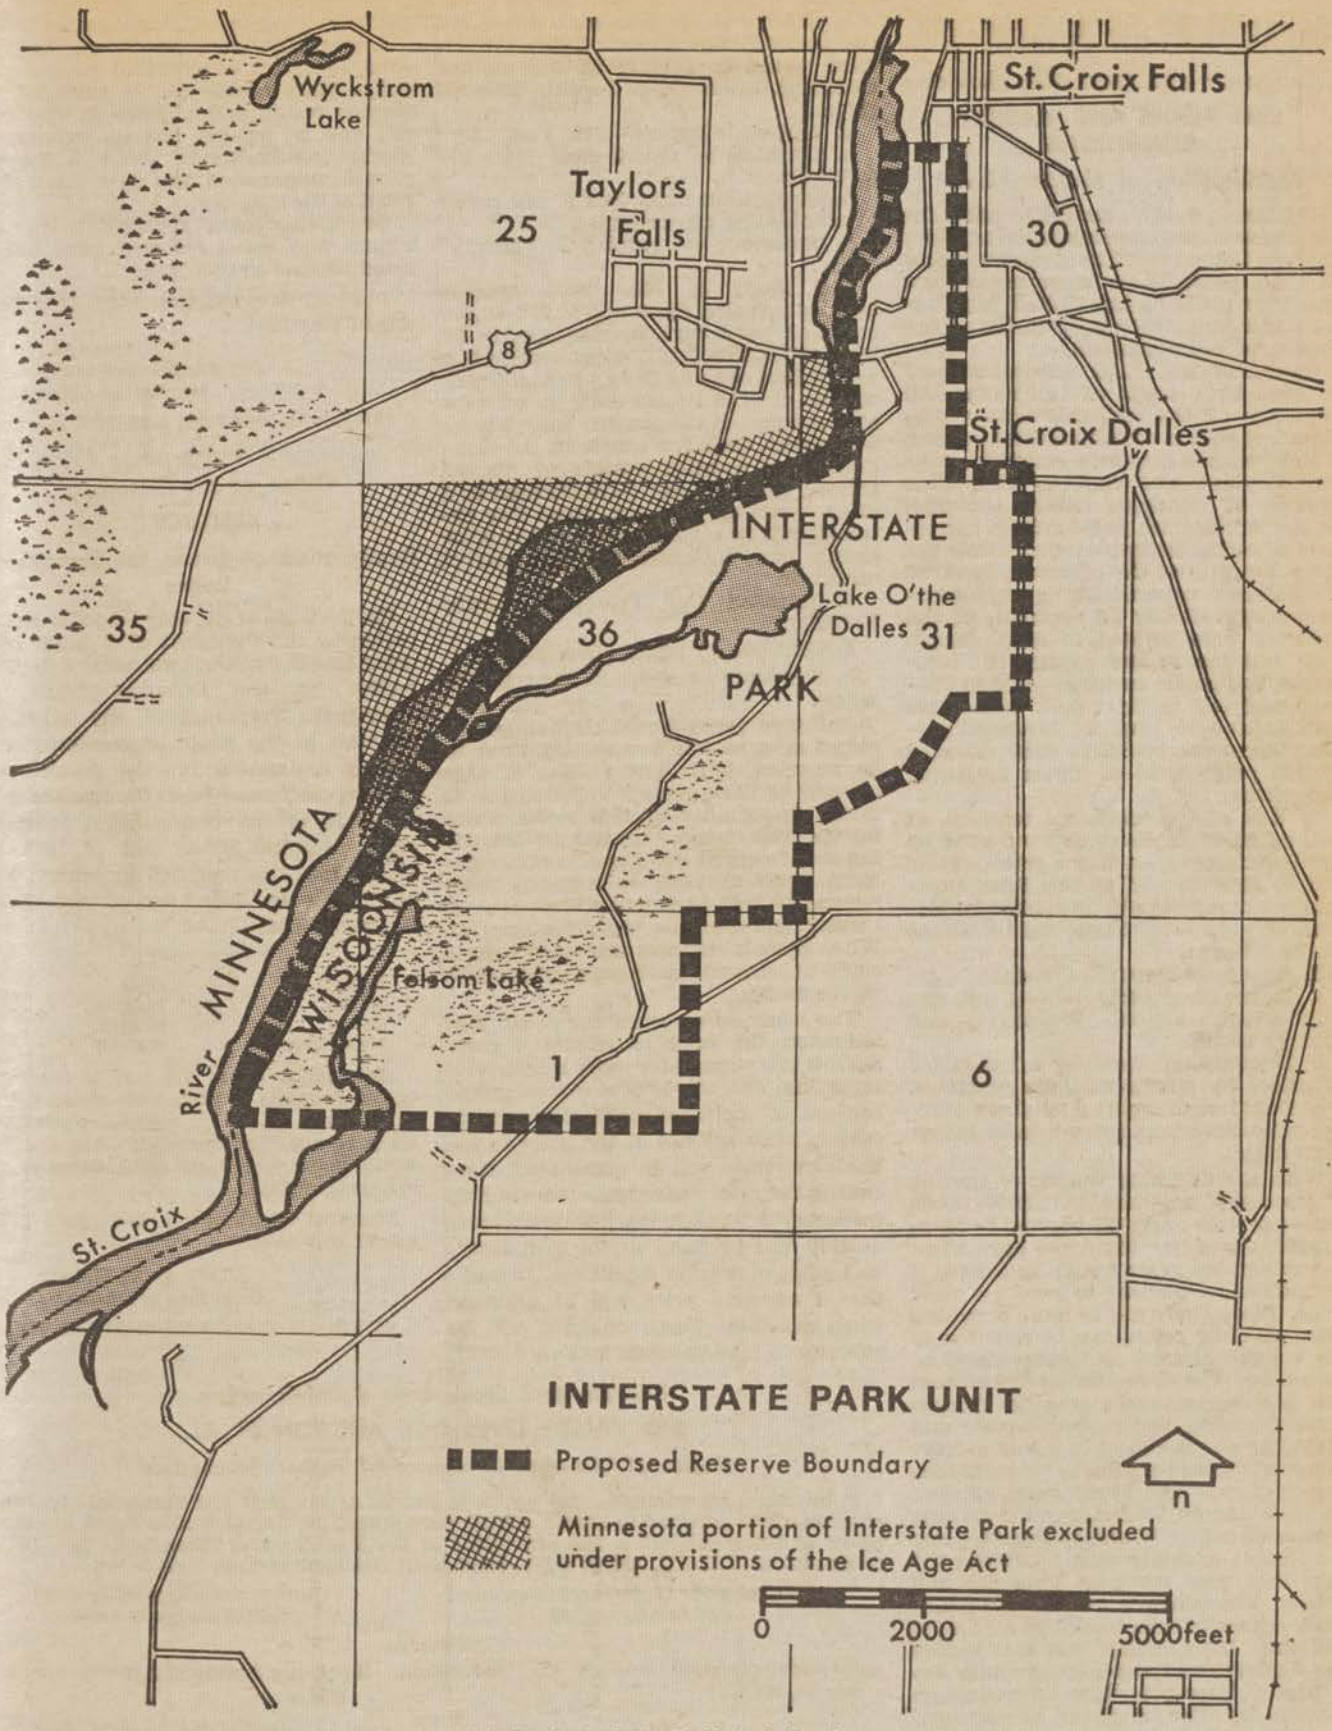

[FR Doc.71-7205 Filed 5-28-71;8:45 am]

DEPARTMENT OF AGRICULTURE

Consumer and Marketing Service

EGG PRICES AND MARKET CONDITIONS

Modification of Market News

On March 9, 1971, the USDA asked for comments on recommendations for major changes in the reporting of market prices of shell eggs. These recommendations had been made by the United Egg Producers, a nationwide cooperative of egg producers and marketers.

Approximately 1,100 comments were received as a result of the notice. All segments of the industry were represented, as well as other interested parties, such as bakers, hospitals, churches, military services, and bankers. This large number of responses reflects the high degree of interest surrounding the issue, as well as its importance. While the large majority of the responses received (75 percent) opposed UEP's recommendations, practically all segments of the industry were divided to some degree.

In addition to the request for comments, two public meetings—one in Chicago and one in New York City—were held to hear the views of interested persons. These two meetings were attended by 215 persons, 47 of whom presented statements.

In view of the comments received, as well as an in-depth study conducted by the Department, no major price reports will be discontinued at this time. However, some reports will be modified effective July 6, 1971. These modifications are as follows:

1. Wholesale Report—Chicago:

a. Discontinue daily report and initiate a twice-a-week (Wednesday and Friday) report.

b. Discontinue reporting a full range of prices by eliminating the extremes.

c. Continue to report a weighted average price but report twice-a-week rather than daily.

With the declining volume of trading of loose eggs in Chicago (10,000–12,000 cases per week presently covered by Market News reports) there are days when the volume on some grades and sizes is considered insufficient to report a valid price. There likely will be more occasions when no daily prices can be reported as the volume of trading further declines. Therefore, the Department considered two alternatives—one was to discontinue reporting the wholesale price and the other was to report in a way to have sufficient volume of sales to report meaningful prices. The study revealed that by reporting on Wednesday the trading that occurred on Monday, Tuesday, and Wednesday and reporting on Friday the sales that were made on Thursday and Friday, the prices represented a sufficient volume of eggs traded on all grades and sizes. This change will also reduce the fluctuations caused by irregular deliveries of large quantities of product on a given day. The range will be narrowed by eliminating the extreme prices where it is clearly evident that such prices are not in line with normal trading. Such sales would be carried in the market comment rather than in the table of prices.

2. Wholesale Report—New York City:

a. Continue to report daily price information.

b. Discontinue reporting a full range by eliminating the extremes.

c. Continue to report a "mostly" price.

The study of New York market activity revealed there was 40,000–50,000 cases of loose eggs covered weekly by Market News reports. Trade participation was quite broad and there was a sufficient volume of eggs traded daily to warrant continuation of the present daily wholesale report. On a few occasions the elimination of a price outside of normal trading patterns may have resulted in a more meaningful report. These few extremes will be eliminated from the price range and included in the market comment.

3. Cartoned Egg Prices—21 Major Markets:

a. Continue to report daily prices.

b. Eliminate extremes in the reported range.

Cartoned egg prices which mainly represent sales to retailers will continue to be reported daily. The volume of eggs covered by these reports is increasing as is the importance of this series. Price fluctuations in these reports are becoming less frequent but there is still sufficient price changes to warrant daily reports. The Department will keep close surveillance on these reporting services. When there is evidence that some reports could be released less frequently, changes will be made.

The study on cartoned egg prices also indicated the need to release a more narrow price range for more meaningful reporting. This was true at several points because of including small lot sales or feature sales activity in the price range. Such extremes will be eliminated. Narrowing the price range reported will help indicate the trend in market values more quickly and be more useful to industry as a guide in market conditions. In addition a monthly price will be reported when possible. These changes will be effective in most markets by July 6, 1971, but some reports will require more time.

4. Narrative statements on market conditions will continue to be released daily. More effort will be extended to employ words and phrases in common use and to depend less on expressing market conditions in terms of special phrases understood only by a small segment of the industry.

The Department appreciates the response and views received from interested persons on this issue.

Done at Washington, D.C., this 26th day of May 1971.

G. R. GRANGE,
Deputy Administrator,
Marketing Services.

[FR Doc.71-7560 Filed 5-28-71;8:48 am]

Office of the Secretary

KENTUCKY

Designation of Areas for Emergency Loans

On the basis of the May 10, 1971, declaration by the President of a major disaster and the consequent areas determination by the Director, Office of Emergency Preparedness, the following counties in the State of Kentucky are hereby designated for the purpose of making emergency loans pursuant to section 321 of the Consolidated Farmers Home Administration Act of 1961 (7 U.S.C. 1961) as modified by section 232 of the Disaster Relief Act of 1970 (Public Law 91-606):

KENTUCKY

Adair.	Ohio.
Butler.	Pulaski.
Green.	Russell.
Muhlenberg.	Warren.

Emergency loans will not be made in these counties under this designation after June 30, 1972, except subsequent loans to qualified borrowers who receive initial loans under this designation on or before that date.

Done at Washington, D.C., this 25th day of May 1971.

CLIFFORD M. HARDIN,
Secretary of Agriculture.

[FR Doc.71-7521 Filed 5-28-71;8:46 am]

Packers and Stockyards Administration

BIG VALLEY LIVESTOCK AUCTION ET AL.

Notice of Changes in Names of Posted Stockyards

It has been ascertained, and notice is hereby given, that the names of the livestock markets referred to herein, which were posted on the respective dates specified below as being subject to the provisions of the Packers and Stockyards Act, 1921, as amended (7 U.S.C. 181 et seq.), have been changed as indicated below.

Original name of stockyard, location, and date of posting	*Current name of stockyard and date of change in name*
CALIFORNIA	
Bakersfield Livestock Auction Co., Bakersfield, Nov. 25, 1967.	Big Valley Livestock Auction, Apr. 15, 1971.
IOWA	
Cow Palace, Inc., Forest City, May 16, 1959------	Jennings Brothers, Inc., Apr. 1, 1971.

Original name of stockyard, location, and date of posting	*Current name of stockyard and date of change in name*
KENTUCKY	
Logan County Livestock Company, Inc., Russellville, Dec. 11, 1959.	Logan County Livestock Market, Inc., Nov. 13, 1968.
NEBRASKA	
Wells Commission Company Stockyards, Fremont, June 7, 1941.	Wells Commission Company, Mar. 1, 1971.
WASHINGTON	
Tonasket Livestock Market, Inc., Tonasket, Oct. 9, 1959.	Okanogan Livestock Market, Inc., d.b.a. Tonasket Livestock Market, Mar. 11, 1971.

Done at Washington, D.C., this 25th day of May 1971.

G. H. HOPPER,
Chief, Registrations, Bonds, and Reports Branch, Livestock Marketing Division.

[FR Doc.71-7520 Filed 5-28-71;8:46 am]

DEPARTMENT OF COMMERCE

Maritime Administration

[Docket No. S-264]

TRINIDAD CORP.

Notice of Application

Notice is hereby given that Trinidad Corp. has filed an application for operating-differential subsidy on six (6) proposed new tankers of approximately 37,500 deadweight tons each to be operated between Caribbean ports and U.S. Gulf and Atlantic ports.

Any person, firm, or corporation having any interest in such application and desiring a hearing on issues pertinent to section 605(c) of the Merchant Marine Act, 1936, as amended, 46 U.S.C. 1175, should, by the close of business on June 15, 1971, notify the Secretary, Maritime Subsidy Board in writing in triplicate, and file petition for leave to intervene in accordance with the rules of practice and procedure of the Maritime Subsidy Board.

In the event a section 605(c) hearing is ordered to be held, the purpose thereof will be to receive evidence relevant to (1) whether the application is one with respect to vessels to be operated in an essential service, served by citizens of the United States which would be in addition to the existing service, or services, and if so, whether the service already provided by vessels of U.S. registry in such essential service is inadequate, and (2) whether in the accomplishment of the purposes and policy of the Act additional vessels should be operated thereon.

If no request for hearing and petition for leave to intervene is received within the specified time, or if the Maritime Subsidy Board determines that petitions for leave to intervene filed within the specified time do not demonstrate sufficient interest to warrant a hearing, the Maritime Subsidy Board will take such action as may be deemed appropriate.

Dated: May 26, 1971.

By order of the Maritime Subsidy Board

JAMES S. DAWSON, Jr.,
Secretary.

[FR Doc.71-7542 Filed 5-28-71;8:51 am]

[Docket No. S-265]

TRINIDAD CORP.

Notice of Application

Notice is hereby given that Trinidad Corp. has filed an application dated May 13, 1971, under the Merchant Marine Act of 1936, as amended, for operating-differential subsidy on six new 37,500 d.w.t. tankers to be employed in U.S. foreign trade. Inasmuch as Trinidad Corp. owns and operates several U.S.-flag tankers which are employed in the domestic intercoastal or coastwise service, and is affiliated with S. C. Loveland Co., Inc., a certified carrier in the domestic trade, written permission of the Maritime Administration under section 805(a) of the Merchant Marine Act, 1936, as amended, will be required for Trinidad Corp. to continue said domestic service if its application for operating-differential subsidy is granted.

Trinidad Corp. and its affiliates own and operate vessels in the following domestic services:

I. "SS Austin," "SS Fort Worth," and "SS Pasadena," all tankers, make approximately 25 voyages each per year hauling clean petroleum products for account of Shell Oil Co. primarily from Norco, La., or Pasadena, Tex., to Sewaren, N.J.; or ports on the Hudson River as far north as Albany, N.Y.; or to Bridgeport, Conn., and Port Jefferson, Long Island, N.Y. Occasional loadings are made at Las Mareas, P.R., and occasional discharge ports range from Tampa, Fla., to Portland, Maine.

II. The tanker "SS Houston" is under contract to the Shell Oil Co., and the tanker "SS Lyon's Creek" is chartered to Chevron Transport Corp. The latter is in dirty oil and trades mainly between ports in California with occasional voyages to Hawaii. Like "SS Lyon's Creek," "SS Houston" has no set pattern. Typically, she may load refined petroleum products at San Pedro, sail to Seattle for discharge and back load heating oil refined from Canadian crude for discharge at Anchorage, Alaska. After discharge, she may make a short ballast passage to Cook Inlet where she would load Alaskan crude for discharge at San Pedro where the next voyage starts.

III. S. C. Loveland Co., Inc., an affiliated company of Trinidad, is a common carrier certified by the Interstate Commerce Commission with right to operate steamships, barges, and towboats, or by towing only from Eastport, Maine, to Tampa, Fla., with coastwise and all tributaries privilege.

Interested parties may inspect this application in the Office of Subsidy Administration, Maritime Administration Room No. 4888, Department of Commerce Building, 14th and E Streets NW., Washington, DC.

Any person, firm, or corporation having any interest (within the meaning of section 805(a)) in such application and desiring to submit comments or views concerning the application must, by close of business on June 15, 1971, file same with the Maritime Subsidy Board/Maritime Administration, in writing, in triplicate, together with petition for leave to intervene which shall state clearly and concisely the grounds of interest, and the alleged facts relied on for relief.

If no petitions for leave to intervene are received within the specified time or if it is determined that petitions filed do not demonstrate sufficient interest to warrant a hearing, the Maritime Subsidy Board/Maritime Administration will take such action as may be deemed appropriate.

In the event petitions regarding the relevant section 805(a) issues are received from parties with standing to be heard, a hearing has been tentatively scheduled for _____, in Room _____, Department of Commerce Building, 14th and E Streets NW., Washington, DC. The purpose of the hearing will be to receive evidence under section 805(a) relative to whether the proposed operation (a) could result in unfair competition to any person, firm, or corporation operating exclusively in the coastwise or intercoastal service, or (b) would be prejudicial to the objects and policy of the Act relative to domestic trade operations.

Dated: May 26, 1971.

By order of the Maritime Subsidy Board/Maritime Administration.

JAMES S. DAWSON, Jr.,
Secretary.

[FR Doc.71-7543 Filed 5-28-71;8:51 am]

DEPARTMENT OF HEALTH, EDUCATION, AND WELFARE

Food and Drug Administration

COLLOIDAL PRODUCTS CORP.

Notice of Filing of Petition for Food Additives

Pursuant to provisions of the Federal Food, Drug, and Cosmetic Act (sec. 409(b)(5), 72 Stat. 1786; 21 U.S.C. 348(b)(5)), notice is given that a petition (FAP 1H2680) has been filed by Colloidal Products Corp., Post Office Box 621, Petaluma,

Calif. 94952, proposing that § 121.1225 *Adjuvants for pesticide use dilutions* (21 CFR 121.1225) be amended to provide for the safe use of 2-methyl-butanol-4 *omega* hydroxypoly (oxyethylene) mixture of dihydrogen and monohydrogen phosphate esters (the poly(oxyethylene) content averaging 4 moles) to be used as an adjuvant for pesticide use dilutions by a grower or applicator prior to application to the growing crop.

Dated: May 24, 1971.

VIRGIL O. WODICKA,
Director, Bureau of Foods.

[FR Doc.71-7530 Filed 5-28-71;8:46 am]

[Docket No. FDC-D-222; NADA No. 9-903V, etc.]

DR. MAYFIELD LABORATORIES ET AL.

Arsenic Trioxide-Vitamin Preparations; Notice of Withdrawal of Approval of New Animal Drug Applications

A notice of opportunity for hearing was published in the FEDERAL REGISTER of December 9, 1970 (35 F.R. 18689), proposing to withdraw approval of NADA's (new animal drug applications) covering drugs containing arsenic trioxide, iron oxide, potassium iodide, cobalt carbonate, manganese sulfate, magnesium carbonate, zinc phenosulfonate, and vitamins recommended for use as a vitamin trace mineral supplement for certain poultry and swine.

Dr. Mayfield Laboratories, 1209 South Main Street, Charles City, Iowa 50616, holder of NADA No. 9—903V for the drug Dr. Mayfield ML-23, requested a hearing. However, a well-organized and full-factual analysis of the clinical and other investigational data was not presented to support the request. Therefore, the Commissioner of Food and Drugs finds that there is no genuine and substantial issue of fact which precludes the withdrawal of approval of the application. The hearing request is therefore denied.

Globe Laboratories, 166 Commerce Street, Fort Worth, Tex. 76102, holder of NADA No. 318V for the drug Globe Veterinary Tonic Powder, and L. A. Mosher Inc., 268 Spring Street NW., Atlanta, Ga. 30303, holder of NADA No. 1-328V for the drug Veterinary Powder, did not respond to the December 9, 1970, notice. This is construed as an election by said firms not to avail themselves of the opportunity for a hearing. No other response to the notice of opportunity for a hearing was received.

The Commissioner finds on the basis of new information before him with respect to said drugs, evaluated together with the evidence available to him when the applications were approved, that there is a lack of substantial evidence that the drugs will have the effect they purport or are represented to have under the conditions of use prescribed, recommended, or suggested in their labeling.

Based on the grounds set forth, the Commissioner concludes that approval of said new animal drug applications should be withdrawn. Therefore, pursuant to provisions of the Federal Food, Drug, and Cosmetic Act (sec. 512(e), 82 Stat. 345-47; 21 U.S.C. 360b(e)) and under authority delegated to the Commissioner (21 CFR 2.120), approval of NADA No. 9-903V and NADA No. 318V, and NADA No. 1-328V, including all amendments and supplements thereto, is hereby withdrawn effective on the date of signature of this document.

Dated: May 6, 1971.

SAM D. FINE,
Associate Commissioner for Compliance.

[FR Doc.71-7531 Filed 5-28-71;8:47 am]

CIVIL AERONAUTICS BOARD

[Docket No. 23341; Order 71-5-97]

AIR EXEC, INC.

Order To Show Cause Regarding Establishment of Service Mail Rate

Issued under delegated authority May 20, 1971.

The Postmaster General filed a notice of intent April 28, 1971, pursuant to 14 CFR Part 298, petitioning the Board to establish for the above-captioned air taxi operator, a final service mail rate of 65.5 cents per great circle aircraft mile for the transportation of mail by aircraft between Cumberland, Md., and Charleston, W. Va., via Martinsburg, W. Va., and Baltimore, Md., based on five round trips per week.

No protest or objection was filed against the proposed services during the time for filing such objections. The Postmaster General states that the Department and the carrier agree that the above rate is a fair and reasonable rate of compensation for the proposed services. The Postmaster General believes these services will meet postal needs in the market. He states the air taxi plans to initiate mail service with Piper Navajo aircraft.

It is in the public interest to fix, determine, and establish the fair and reasonable rate of compensation to be paid by the Postmaster General for the proposed transportation of mail by aircraft, the facilities used and useful therefor, and the services connected therewith, between the aforesaid points. Upon consideration of the notice of intent and other matters officially noticed, it is proposed to issue an order [1] to include the following findings and conclusions:

The fair and reasonable final service mail rate to be paid to Air Exec, Inc., in its entirety by the Postmaster General pursuant to section 406 of the Act for the transportation of mail by aircraft, the facilities used and useful therefor, and the services connected therewith, shall be 65.5 cents per great circle aircraft mile between Cumberland, Md., and Charleston, W. Va., via Martinsburg, W. Va., and Baltimore, Md., based on five round trips per week.

Accordingly, pursuant to the Federal Aviation Act of 1958, and particularly sections 204(a) and 406 thereof, and regulations promulgated in 14 CFR Part 302, 14 CFR Part 298, and 14 CFR 385.16(f):

It is ordered, That:

1. Air Exec, Inc., the Postmaster General, Allegheny Airlines, Inc., American Airlines, Inc., Eastern Air Lines, Inc., Piedmont Aviation, Inc., United Air Lines, Inc., and all other interested persons are directed to show cause why the Board should not adopt the foregoing proposed findings and conclusions and fix, determine, and publish the final rate specified above for the transportation of mail by aircraft, the facilities used and useful therefor, and the services connected therewith as specified above as the fair and reasonable rate of compensation to be paid to Air Exec, Inc.;

2. Further procedures herein shall be in accordance with 14 CFR Part 302, and notice of any objection to the rate or to the other findings and conclusions proposed herein, shall be filed within 10 days, and if notice is filed, written answer and supporting documents shall be filed within 30 days after service of this order;

3. If notice of objection is not filed within 10 days after service of this order, or if notice is filed and answer is not filed within 30 days after service of this order, all persons shall be deemed to have waived the right to a hearing and all other procedural steps short of a final decision by the Board, and the Board may enter an order incorporating the findings and conclusions proposed herein and fix and determine the final rate specified herein;

4. If answer is filed presenting issues for hearing, the issues involved in determining the fair and reasonable final rate shall be limited to those specifically raised by the answer, except insofar as other issues are raised in accordance with Rule 307 of the rules of practice (14 CFR 302.307); and

5. This order shall be served on Air Exec, Inc., the Postmaster General, Allegheny Airlines, Inc., American Airlines, Inc., Eastern Air Lines, Inc., Piedmont Aviation, Inc., and United Air Lines, Inc.

This order will be published in the FEDERAL REGISTER.

[SEAL] HARRY J. ZINK,
Secretary.

[FR Doc.71-7547 Filed 5-28-71;8:51 am]

[Docket No. 22916]

AMERICAN-WESTERN MERGER CASE

Notice of Hearing

Notice is hereby given, pursuant to the provisions of the Federal Aviation Act of 1958, that a hearing in the above-entitled proceeding will be held on June 8, 1971,

[1] As this order to show cause is not a final action, it is not regarded as subject to the review provisions of 14 CFR Part 385. These provisions will apply to final action taken by the staff under authority delegated in § 385.16(g).

at 10 a.m., e.d.s.t., in Room 726, Universal Building, 1825 Connecticut Avenue NW., Washington, DC, before Examiner William J. Madden.

For information concerning the issues involved and other details in this proceeding, interested persons are referred to the Prehearing Conference Report and other documents which are in the docket of this proceeding on file in the Docket Section of the Civil Aeronautics Board.

Dated in Washington, D.C., May 25, 1971.

[SEAL] WILLIAM J. MADDEN,
Hearing Examiner.

[FR Doc.71-7548 Filed 5-28-71;8:51 am]

[Docket No. 21866-9]

DOMESTIC PASSENGER FARE INVESTIGATION

Notice of Hearing

Notice is hereby given, pursuant to the provisions of the Federal Aviation Act of 1958, as amended, that a public hearing in this proceeding (Phase 9—Fare Structure) is assigned to be held on June 28, 1971, at 10 a.m., e.d.s.t., in Room 911, Universal Building, 1825 Connecticut Avenue NW., Washington, DC, before the undersigned examiner.

For information concerning the issues involved and other details of this proceeding, interested persons are referred to the Prehearing Conference Report served April 20, 1970, the Supplemental Prehearing Conference Report served May 14, 1970, and other documents which are in the Docket of this proceeding on file in the Docket Section of the Civil Aeronautics Board.

Dated at Washington, D.C., May 26, 1971.

[SEAL] ROBERT M. JOHNSON,
Hearing Examiner.

[FR Doc.71-7549 Filed 5-28-71;8:51 am]

[Dockets Nos. 23380, 21866; Order 71-5-121]

TRANS WORLD AIRLINES, INC.

Order Dismissing Complaint

Adopted by the Civil Aeronautics Board at its office in Washington, D.C., on the 25th day of May 1971.

By tariff revision[1] marked to become effective May 26, 1971, Trans World Airlines, Inc. (TWA), proposes to provide for a 17-seat coach lounge in its B-747 aircraft, all seats to be withheld from sale. A similar provision has been in effect for American Airlines, Inc. (American), since March 14, 1971.

Pan American World Airways, Inc. (Pan American), filed a complaint, alleging that the use of large portions of the B-747 aircraft for a 17-seat coach lounge is inconsistent with the rationale of the Board's recent decision in Phase 6A of the Domestic Passenger-Fare Investigation; that the problem of the B-747 coach lounge has already been raised in exceptions to the Board's decision, and that the Board should not allow the proliferation of this uneconomic use of the B-747 pending final decision. TWA has answered the complaint, essentially alleging that as long as American is permitted to offer B-747 coach lounges, then its competitors must be permitted to do likewise.

Seating configurations are already under investigation in the Domestic Passenger-Fare Investigation, Docket 21866. TWA's tariff essentially matches that of American and under all the circumstances we have concluded that suspension would not be appropriate. Our action, however, should not be misconstrued as indicating a lack of concern over the possible economic consequences of the spread of this particular form of product competition. Moreover, in instituting these new seating configurations at a time when the matter already is under active investigation, the carriers should be on notice that any expenditures incurred in reconfiguring their aircraft will create no equity in their favor should the Board ultimately conclude that configuration standards calling for an added charge for lounge service should be adopted.

Accordingly, pursuant to the Federal Aviation Act of 1958, and particularly sections 204(a) and 1002 thereof:

It is ordered, That:

1. The complaint of Pan American World Airways, Inc., in Docket 23380 is hereby dismissed; and

2. A copy of this order be served upon Pan American World Airways, Inc., and Trans World Airlines, Inc.

This order shall be published in the FEDERAL REGISTER.

By the Civil Aeronautics Board.

[SEAL] HARRY J. ZINK,
Secretary.

[FR Doc.71-7501 Filed 5-28-71;8:47 am]

[1] Revision to Airline Tariff Publishers, Inc., Agent, Tariff CAB No. 65.

FEDERAL MARITIME COMMISSION

[Independent Ocean Freight Forwarder License No. 863]

AMERICAN ENTERPRISES, INC.

Order of Revocation

On May 13, 1971, the Commission received notification from Mr. Julio Enrique Amador, President, American Enterprises, Inc., 1346 Connecticut Avenue NW., Washington, DC 20036, advising that he wished to discontinue the operation of American Enterprises, Inc., effective immediately.

By virtue of authority vested in me by the Federal Maritime Commission as set forth in Manual of Orders, Commission Order No. 1 (revised) section 7.04(g) (dated Sept. 29, 1970):

It is ordered, That the Independent Ocean Freight Forwarder License of American Enterprises, Inc., be returned to the Commission for cancellation.

It is further ordered, That the Independent Ocean Freight Forwarder License No. 863 of American Enterprises, Inc., be and is hereby revoked effective May 13, 1971, without prejudice to reapplication for a license at a later date.

It is further ordered, That a copy of this order be published in the FEDERAL REGISTER and served upon American Enterprises, Inc.

AARON W. REESE,
Managing Director.

[FR Doc.71-7572 Filed 5-28-71;8:49 am]

ATLANTIC & GULF/WEST COAST OF CENTRAL AMERICA AND MEXICO CONFERENCE ET AL.

Notice of Agreement Filed

Notice is hereby given that the following agreement has been filed with the Commission for approval pursuant to section 15 of the Shipping Act, 1916, as amended (39 Stat. 733, 75 Stat. 763, 46 U.S.C. 814).

Interested parties may inspect and obtain a copy of the agreement at the Washington office of the Federal Maritime Commission, 1405 I Street NW., Room 1202; or may inspect the agreement at the Field Offices located at New York, N.Y., New Orleans, La., and San Francisco, Calif. Comments on such agreements, including requests for hearing, may be submitted to the Secretary, Federal Maritime Commission, Washington, D.C. 20573, within 20 days after publication of this notice in the FEDERAL REGISTER. Any person desiring a hearing on the proposed agreement shall provide a clear and concise statement of the matters upon which they desire to adduce evidence. An allegation of discrimination or unfairness shall be accompanied by a statement describing the discrimination or unfairness with particularity. If a violation of the Act or detriment to the commerce of the United States is alleged, the statement shall set forth with particularity the acts and circumstances said to constitute such violation or detriment to commerce.

A copy of any such statement should also be forwarded to the party filing the agreement (as indicated hereinafter) and the statement should indicate that this has been done.

Notice of agreements filed by:

John R. Mahoney, Esquire, Casey, Lane & Mittendorf, 26 Broadway, New York, NY 10004.

Conferences in the trades to, from, and between U.S. Atlantic and Gulf Ports and Ports in Central and South America and the Caribbean.

A petition filed in behalf of the conferences listed below, has been assigned the following respective agreement numbers:

Atlantic & Gulf/West Coast of Central America and Mexico Conference	8300-11
Atlantic & Gulf/West Coast of South America Conference	2744-33
East Coast Columbia Conference	7590-19

Leeward & Windward Islands & Guianas Conference	7540–22
United States Atlantic & Gulf-Haiti Conference	8120–12
United States Atlantic & Gulf-Jamaica Conference	4619–18
United States Atlantic & Gulf-Venezuela and Netherlands Antilles Conference	6190–26
United States Atlantic & Gulf-Venezuela and Netherlands Antilles Conference-Oil Companies Contract Agreement (Proprietary Cargo)	6870–14
West Coast South America Northbound Conference	7890–8

In Docket No. 69–33, served December 16, 1969, the above conferences were given authority by the Commission to include provisions in their basic agreements authorizing them to agree to and establish through intermodal arrangements with other modes of transportation for a period of 18 months, subject to the proviso that if during the first 12 months of approval no results were achieved from negotiations by the conferences, then the individual members were free to enter into their own negotiations. Agreements, modified to conform to the conditions of the above order, were filed and became effective February 12, 1970. Because of the 18-month approval period, the above modification will terminate on August 12, 1971.

The petition is for an extension of the above modifications for a period of 3 years, until August 12, 1974. The modifications retain the right of the member lines to negotiate through intermodal transportation arrangements. In addition, they are broadened to provide that each of the conferences shall agree upon and adopt the divisions, rates or charges for the inland portion or portions of the through service, the port-to-port portion, and any applicable port or other charges.

Dated: May 25, 1971.

By order of the Federal Maritime Commission.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71–7570 Filed 5–28–71;8:49 am]

COMPAGNIE FABRE, S.G.T.M. AND MEDITERRANEAN MARINE LINES

Notice of Agreement Filed

Notice is hereby given that the following agreement has been filed with the Commission for approval pursuant to section 15 of the Shipping Act, 1916, as amended (39 Stat. 733, 75 Stat. 763, 46 U.S.C. 814).

Interested parties may inspect and obtain a copy of the agreement at the Washington office of the Federal Maritime Commission, 1405 I Street NW., Room 1202; or may inspect the agreement at the Field Offices located at New York, N.Y., New Orleans, La., and San Francisco, Calif. Comments on such agreements, including requests for hearing, may be submitted to the Secretary, Federal Maritime Commission, Washington, D.C. 20573, within 20 days after publication of this notice in the FEDERAL REGISTER. Any person desiring a hearing on the proposed agreement shall provide a clear and concise statement of the matters upon which they desire to adduce evidence. An allegation of discrimination or unfairness shall be accompanied by a statement describing the discrimination or unfairness with particularity. If a violation of the Act or detriment to the commerce of the United States is alleged, the statement shall set forth with particularity the acts and circumstances said to constitute such violation or detriment to commerce.

A copy of any such statement should also be forwarded to the party filing the agreement (as indicated hereinafter) and the statement should indicate that this has been done.

Notice of agreement filed by:

Howard A. Levy, Esquire,
Kurrus & Jacobi,
2000 K Street NW.,
Washington, DC 20006.

Agreement No. 9948 provides that the above parties shall interchange containers and make container space available to each other on a uniform basis for each eastbound and each westbound sailing on their container vessels operating between the North Atlantic ports of the United States and the Mediterranean ports of Spain, France, and Italy, under terms and conditions set forth in the agreement.

Dated: May 25, 1971.

By order of the Federal Maritime Commission.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71–7569 Filed 5–28–71;8:48 am]

TRANS-PACIFIC FREIGHT CONFERENCE OF JAPAN

Notice of Agreement Filed

Notice is hereby given that the following agreement has been filed with the Commission for approval pursuant to section 15 of the Shipping Act, 1916, as amended (39 Stat. 733, 75 Stat. 763, 46 U.S.C. 814).

Interested parties may inspect and obtain a copy of the agreement at the Washington office of the Federal Maritime Commission, 1405 I Street NW., Room 1202; or may inspect the agreement at the Field Offices located at New York, N.Y., New Orleans, La., and San Francisco, Calif. Comments on such agreements, including requests for hearing, may be submitted to the Secretary, Federal Maritime Commission, Washington, D.C. 20573, within 20 days after publication of this notice in the FEDERAL REGISTER. Any person desiring a hearing on the proposed agreement shall provide a clear and concise statement of the matters upon which they desire to adduce evidence. An allegation of discrimination or unfairness shall be accompanied by a statement describing the discrimination or unfairness with particularity. If a violation of the Act or detriment to the commerce of the United States is alleged, the statement shall set forth with particularity the acts and circumstances said to constitute such violation or detriment to commerce.

A copy of any such statement should also be forwarded to the party filing the agreement (as indicated hereinafter) and the statement should indicate that this has been done.

Notice of agreement filed by:

Charles F. Warren, Esquire, 1100 Connecticut Avenue NW., Washington, DC 20036.

Agreement No. 150–50 between the member lines of the Trans-Pacific Freight Conference of Japan amends Article 7(c) of the basic agreement, as amended, to enable the Conference to regulate compensation payable to the extent fixed by resolution for services rendered at Conference ports of origin.

Dated: May 25, 1971.

By order of the Federal Maritime Commission.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71–7571 Filed 5–28–71;8:49 am]

FAIRSEA SHIPPING CORP. AND SITMAR CRUISES, INC.

Notice of Issuance of Performance Certificate

Security for the protection of the public; indemnification of passengers for nonperformance of transportation.

Notice is hereby given that the following have been issued a Certificate of Financial Responsibility for Indemnification of Passengers for Nonperformance of Transportation pursuant to the provisions of section 3, Public Law 89–777 (80 Stat. 1357, 1358) and Federal Maritime Commission General Order 20, as amended (46 CFR Part 540):

Fairsea Shipping Corp. and Sitmar Cruises, Inc., 27 Boulevard d'Italie, Monte Carlo, Monaco.

Dated: May 26, 1971.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71–7565 Filed 5–28–71;8:48 am]

FAIRSEA SHIPPING CORP. AND SITMAR CRUISES, INC.

Notice of Issuance of Casualty Certificate

Security for the protection of the public; financial responsibility to meet liability incurred for death or injury to passengers or other persons on voyages.

Notice is hereby given that the following have been issued a Certificate of Financial Responsibility to Meet Liability Incurred for Death or Injury to Passengers or Other Persons on Voyages pursuant to the provisions of section 2, Public Law 89–777 (80 Stat. 1356, 1357)

and Federal Maritime Commission General Order 20, as amended (46 CFR Part 540):

Fairsea Shipping Corp. and Sitmar Cruises, Inc., 27 Boulevard d'Italie, Monte Carlo, Monaco.

Dated: May 26, 1971.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71-7566 Filed 5-28-71;8:48 am]

FAIRWIND SHIPPING CORP. AND SITMAR CRUISES, INC.

Notice of Issuance of Performance Certificate

Security for the protection of the public; indemnification of passengers for nonperformance of transportation.

Notice is hereby given that the following have been issued a Certificate of Financial Responsibility for Indemnification of Passengers for Nonperformance of Transportation pursuant to the provisions of section 3, Public Law 89-777 (80 Stat. 1357, 1358) and Federal Maritime Commission General Order 20, as amended (46 CFR Part 540):

Fairwind Shipping Corp. and Sitmar Cruises, Inc., 27 Boulevard d'Italie, Monte Carlo, Monaco.

Dated: May 26, 1971.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71-7567 Filed 5-28-71;8:48 am]

FAIRWIND SHIPPING CORP. AND SITMAR CRUISES, INC.

Notice of Issuance of Casualty Certificate

Security for the protection of the public; financial responsibility to meet liability incurred for death or injury to passengers or other persons on voyages.

Notice is hereby given that the following have been issued a Certificate of Financial Responsibility to Meet Liability Incurred for Death or Injury to Passengers or Other Persons on Voyages pursuant to the provisions of section 2, Public Law 89-777 (80 Stat. 1356, 1357) and Federal Maritime Commission General Order 20, as amended (46 CFR Part 540):

Fairwind Shipping Corp. and Sitmar Cruises, Inc., 27 Boulevard d'Italie Monte Carlo, Monaco.

Dated: May 26, 1971.

FRANCIS C. HURNEY,
Secretary.

[FR Doc.71-7568 Filed 5-28-71;8:48 am]

FEDERAL POWER COMMISSION

[Docket No. CP71-272]

COLORADO INTERSTATE GAS CO.

Notice of Application

MAY 21, 1971.

Take notice that on May 14, 1971, Colorado Interstate Gas Co., a division of Colorado Interstate Corp. (applicant), Post Office Box 1087, Colorado Springs, CO 80901, filed in Docket No. CP71-272 an application pursuant to section 7(c) of the Natural Gas Act, as implemented by § 157.7(e) of the regulations under said Act, for a certificate of public convenience and necessity authorizing the construction, during the 12-month period beginning July 22, 1971, and operation of certain natural gas sales and transportation facilities to enable applicant to make sales of natural gas to existing customers and to make miscellaneous rearrangements of existing facilities, all as more fully set forth in the application which is on file with the Commission and open to public inspection.

The purpose of the certificate requested herein is to augment applicant's ability to supply, with the least possible delay, the natural gas requirements of its customers in existing market areas, and to make miscellaneous relocations and rearrangements of existing facilities. The total cost of the natural gas facilities proposed herein is not to exceed $300,000, which cost, applicant states will be financed with current working funds.

Any person desiring to be heard or to make any protest with reference to said application should on or before June 14, 1971, file with the Federal Power Commission, Washington, D.C. 20426, a petition to intervene or a protest in accordance with the requirements of the Commission's rules of practice and procedure (18 CFR 1.8 or 1.10) and the regulations under the Natural Gas Act (18 CFR 157.10). All protests filed with the Commission will be considered by it in determining the appropriate action to be taken but will not serve to make the protestants parties to the proceeding. Any person wishing to become a party to a proceeding or to participate as a party in any hearing therein must file a petition to intervene in accordance with the Commission's rules.

Take further notice that, pursuant to the authority contained in and subject to the jurisdiction conferred upon the Federal Power Commission by sections 7 and 15 of the Natural Gas Act and the Commission's rules of practice and procedure, a hearing will be held without further notice before the Commission on this application if no petition to intervene is filed within the time required herein, if the Commission on its own review of the matter finds that a grant of the certificate is required by the public convenience and necessity. If a petition for leave to intervene is timely filed, or if the Commission on its own motion believes that a formal hearing is required, further notice of such hearing will be duly given.

Under the procedure herein provided for, unless otherwise advised, it will be unnecessary for Applicant to appear or be represented at the hearing.

KENNETH F. PLUMB,
Acting Secretary.

[FR Doc.71-7525 Filed 5-28-71;8:46 am]

[Docket No. CP71-164]

CITY OF DE QUEEN, ARK., AND LOUISIANA-NEVADA TRANSIT CO.

Notice of Further Postponement of Hearing

MAY 24, 1971.

City of De Queen, Arkansas, applicant, v. Louisiana-Nevada Transit Co., Respondent; Docket No. CP71-164.

On May 10, 1971, the Arkansas Public Service Commission filed a request for a postponement of the hearing from June 15 to June 22, 1971, in the above-designated matter. On May 20, 1971, Counsel for the city of De Queen, Ark., filed a letter requesting, inter alia, that the hearing be postponed to June 15, 1971. The letter states that all parties are in agreement with the request.

Upon consideration, notice is hereby given that the hearing is further postponed to convene at 10 a.m., e.d.t., on June 17, 1971, in a hearing room of the Federal Power Commission, 441 G Street NW., Washington, DC 20426.

KENNETH F. PLUMB,
Acting Secretary.

[FR Doc.71-7524 Filed 5-28-71;8:46 am]

[Docket No. G-18337]

EL PASO NATURAL GAS CO.

Notice of Petition To Amend

MAY 24, 1971.

Take notice that on May 13, 1971, El Paso Natural Gas Co. (petitioner), Post Office Box 1492, El Paso, TX 79999, filed in Docket No. G-18337 a petition to amend the Commission's order heretofore issued in said docket on June 12, 1963 (29 FPC 1161), as amended on October 10, 1963 (30 FPC 989), issuing a certificate of public convenience and necessity pursuant to section 7(c) of the Natural Gas Act, by authorizing the operation of existing facilities for the transportation and delivery of natural gas to Arizona Public Service Co. (Arizona), for use in its proposed Yuma Power Plant to be located in Yuma County, Ariz., all as more fully set forth in the application which is on file with the Commission and open to public inspection.

The order of June 12, 1963, as amended, authorized, inter alia, the construction and operation of facilities for the transportation, and delivery of natural gas to Arizona for use in its Phoenix, Saguaro, and Ocotillo Power Plants, and for delivery of natural gas to Arizona for redelivery to Salt River Project Agricultural Improvement and Power District (Salt River) for use in its Kyrene, Cross Cut, and Agua Fria Power Plants. The volume of natural gas so delivered was not to exceed 47,248,879 Mcf annually.

Petitioner proposes herein the transportation and delivery of natural gas to Arizona for the fuel requirements of the proposed Yuma Power Plant. This service will not exceed 594 Mcf hourly and 5,000 Mcf daily and will be available only

during the summer period. The application states these delivery volumes will be made within the aggregate contracted quantities of natural gas which petitioner is presently authorized to transport, and deliver to Arizona for use as fuel in all of its electric generating plants. Petitioner also states that no new or additional facilities will be required to render the service proposed herein.

Any person desiring to be heard or to make any protest with reference to said petition to amend should on or before June 14, 1971, file with the Federal Power Commission, Washington, D.C. 20426, a petition to intervene or a protest in accordance with the requirements of the Commission's rules of practice and procedure (18 CFR 1.8 or 1.10) and the regulations under the Natural Gas Act (18 CFR 157.10). All protests filed with the Commission will be considered by it in determining the appropriate action to be taken but will not serve to make the protestants parties to the proceeding. Any person wishing to become a party to a proceeding or to participate as a party in any hearing therein must file a petition to intervene in accordance with the Commission's rules.

KENNETH F. PLUMB,
Acting Secretary.

[FR Doc.71-7527 Filed 5-28-71;8:46 am]

[Docket No. CP66-189]

WASHINGTON COUNTY UTILITY DISTRICT OF WASHINGTON, TENN., AND EAST TENNESSEE NATURAL GAS CO.

Notice of Extension of Time and Postponement of Hearing

MAY 24, 1971.

On May 6, 1971, Washington County Utility District of Washington, Tenn. (applicant), filed a request for an extension of time within which applicant and East Tennessee Natural Gas Co. (respondent) shall file their evidence. Applicant also requests a postponement of the hearing set for June 2, 1971, by order issued on April 30, 1971, in the above-designated proceeding. The request states that respondent, United Cities Gas Co. and the Commission Staff have no objection to the request.

Upon consideration, notice is hereby given that the time is extended to and including June 17, 1971, within which applicant and respondent shall file with the Commission and serve on all parties and the Commission Staff their evidence, pursuant to paragraph (A) of the order issued April 30, 1971. The hearing is postponed, to commence at 10 a.m., e.d.t., on June 29, 1971, in a hearing room of the Federal Power Commission, 441 G Street NW., Washington, DC.

KENNETH F. PLUMB,
Acting Secretary.

[FR Doc.71-7526 Filed 5-28-71;8:46 am]

FEDERAL RESERVE SYSTEM

BANK SHARES, INC.

Notice of Application for Approval of Acquisition of Shares of Bank

Notice is hereby given that application has been made, pursuant to section 3(a)(3) of the Bank Holding Company Act of 1956 (12 U.S.C. 1842(a)(3)), by Bank Shares, Inc., which is a bank holding company located in Minneapolis, Minn., for prior approval by the Board of Governors of the acquisition by applicant of at least 80 percent of the voting shares of Olmsted County Bank & Trust Co., Rochester, Minn.

Section 3(c) of the Act provides that the Board shall not approve:

(1) Any acquisition or merger or consolidation under section 3 which would result in a monopoly, or which would be in furtherance of any combination or conspiracy to monopolize or to attempt to monopolize the business of banking in any part of the United States, or

(2) Any other proposed acquisition or merger or consolidation under section 3 whose effect in any section of the country may be substantially to lessen competition, or to tend to create a monopoly, or which in any other manner would be in restraint of trade, unless the Board finds that the anticompetitive effects of the proposed transaction are clearly outweighed in the public interest by the probable effect of the transaction in meeting the convenience and needs of the community to be served.

Section 3(c) further provides that, in every case, the Board shall take into consideration the financial and managerial resources and future prospects of the company or companies and the banks concerned, and the convenience and needs of the community to be served.

Not later than thirty (30) days after the publication of this notice in the FEDERAL REGISTER, comments and views regarding the proposed acquisition may be filed with the Board. Communications should be addressed to the Secretary, Board of Governors of the Federal Reserve System, Washington, D.C. 20551. The application may be inspected at the office of the Board of Governors or the Federal Reserve Bank of Minneapolis.

By order of the Board of Governors, May 25, 1971.

[SEAL] KENNETH A. KENYON,
Deputy Secretary.

[FR Doc.71-7522 Filed 5-28-71;8:46 am]

GREAT LAKES HOLDING CO.

Notice of Application for Approval of Acquisition of Shares of Bank

Notice is hereby given that application has been made, pursuant to section 3(a)(1) of the Bank Holding Company Act of 1956 (12 U.S.C. 1842(a)(1)), by Great Lakes Holding Co., Kalamazoo, Mich., for prior approval by the Board of Governors of action whereby applicant would become a bank holding company through the acquisition of not less than 98 percent nor more than 92 percent of the voting shares of Industrial State Bank & Trust Co., Kalamazoo, Mich.

Section 3(c) of the Act provides that the Board shall not approve:

(1) Any acquisition or merger or consolidation under section 3 which would result in a monopoly, or which would be in furtherance of any combination or conspiracy to monopolize or to attempt to monopolize the business of banking in any part of the United States, or

(2) Any other proposed acquisition or merger or consolidation under section 3 whose effect in any section of the country may be substantially to lessen competition, or to tend to create a monopoly, or which in any other manner would be in restraint of trade, unless the Board finds that the anticompetitive effects of the proposed transaction are clearly outweighed in the public interest by the probable effect of the transaction in meeting the convenience and needs of the community to be served.

Section 3(c) further provides that, in every case, the Board shall take into consideration the financial and managerial resources and future prospects of the company or companies and the banks concerned, and the convenience and needs of the community to be served.

Not later than thirty (30) days after the publication of this notice in the FEDERAL REGISTER, comments and views regarding the proposed acquisition may be filed with the Board. Communications should be addressed to the Secretary, Board of Governors of the Federal Reserve System, Washington, D.C. 20551. The application may be inspected at the office of the Board of Governors or the Federal Reserve Bank of Chicago.

By order of the Board of Governors, May 25, 1971.

[SEAL] KENNETH A. KENYON,
Deputy Secretary.

[FR Doc.71-7523 Filed 5-28-71;8:46 am]

INTERAGENCY TEXTILE ADMINISTRATIVE COMMITTEE

CERTAIN COTTON TEXTILE PRODUCTS PRODUCED OR MANUFACTURED IN NICARAGUA

Entry or Withdrawal From Warehouse for Consumption

MAY 25, 1971.

On April 29, 1971, the U.S. Government in furtherance of the objective of, and under the terms of, the Long-Term Arrangement Regarding International Trade in Cotton Textiles, done at Geneva on February 9, 1962, and extended through September 30, 1973, requested

the Government of the Republic of Nicaragua to enter into consultations concerning exports to the United States of cotton textile products in Category 22 produced or manufactured in Nicaragua. In that request the U.S. Government stated its view that exports in this category from Nicaragua should be restrained for the 12-month period beginning April 29, 1971, and extending through April 28, 1972.

Notice is hereby given that under the provisions of Article 3 and 6(c) of the Long-Term Arrangement, if no solution is mutually agreed upon by the two governments within sixty (60) days of the date of the aforementioned note, entry and withdrawal from warehouse for consumption of cotton textiles in Category 22 produced or manufactured in Nicaragua and exported from Nicaragua on and after the date of such note may be restrained.

STANLEY NEHMER,
Chairman, Interagency Textile Administration Committee, and Deputy Assistant Secretary for Resources.

[FR Doc.71-7555 Filed 5-28-71;8:52 am]

CERTAIN COTTON TEXTILE PRODUCTS PRODUCED OR MANUFACTURED IN THAILAND

Entry or Withdrawal From Warehouse for Consumption

MAY 25, 1971.

On April 30, 1971, the U.S. Government in furtherance of the objective of, and under the terms of, the Long-Term Arrangement Regarding International Trade in Cotton Textiles, done at Geneva on February 9, 1962 and extended through September 30, 1973, requested the Government of Thailand to enter into consultations concerning exports to the United States of cotton textile products in Category 60 produced or manufactured in Thailand. In that request the U.S. Government stated its view that exports in this category from Thailand should be restrained for the 12-month period beginning April 30, 1971, and extending through April 29, 1972.

Notice is hereby given that under the provisions of Article 3 and 6(c) of the Long-Term Arrangement, if no solution is mutually agreed upon by the two governments within sixty (60) days of the date of the aforementioned note, entry and withdrawal from warehouse for consumption of cotton textiles in Category 60 produced or manufactured in Thailand and exported from Thailand on and after the date of such note may be restrained.

STANLEY NEHMER,
Chairman, Interagency Textile Administrative Committee, and Deputy Assistant Secretary for Resources.

[FR Doc.71-7554 Filed 5-28-71;8:52 am]

SECURITIES AND EXCHANGE COMMISSION

[File No. 24W-3010]

ADVERTISING AND INFORMATION DISTRIBUTION SYSTEMS, INC.

Order Temporarily Suspending Exemption, Statement of Reasons Therefor, and Notice of Opportunity for Hearing

MAY 25, 1971.

I. Advertising and Information Distribution Systems, Inc. (AIDS) incorporated in the District of Columbia on May 29, 1969, filed with the Commission on August 17, 1970 a notification on Form 1-A and an offering circular relating to an offering of 300,000 shares of its $0.01 par value common stock at $1 per share for an aggregate offering price of $300,000 for the purpose of obtaining an exemption from the registration requirements of the Securities Act of 1933, pursuant to the provisions of section 3(b) thereof and Regulation A promulgated thereunder. The underwriter named in the offering circular is Davis Securities Co., Inc.

II. The Commission on the basis of information provided by its staff, has reasonable cause to believe that:

A. The offering circular of AIDS contains untrue statements of material facts and omits to state material facts necessary in order to make the statements made in light of the circumstances under which they were made, not misleading particularly with respect to:

1. A consulting contract between AIDS and Louis Kaye;

2. Use of proceeds;

3. The failure to disclose that, 3 months prior to the date of its notification, the issuer had subleased, for the remainder of its leasehold interest, the premises which its lists as its office and warehouse space;

4. The condition and status of AID's business operation; and

5. Financial statements, which failed to disclose a liability on a consulting contract and understate accounts payable.

B. The offering, if made, would be in violation of section 17 of the Securities Act of 1933.

III. It, appearing to the Commission that it is in the public interest and for the protection of investors that the exemption of the Issuer under Regulation A be temporarily suspended.

It is ordered, Pursuant to Rule 261(a) of the general rules and regulations under the Securities Act of 1933, that the exemption under Regulation A be and hereby is temporarily suspended.

It is further ordered, Pursuant to Rule 7 of the Commission's rules of practice, that the Issuer file an answer to the allegations contained in this order within 30 days of the entry thereof.

Notice is hereby given that any person having any interest in the matter may file with the Secretary of the Commission a written request for a hearing within 30 days after the entry of this order; that within 20 days after receipt of such request the Commission will, or at any time upon its own motion may, set the matter down for hearing at a place to be designated by the Commission for the purpose of determining whether this order or suspension should be vacated or made permanent, without prejudice, however, to the consideration and presentation of additional matters at the hearing; and that notice of the time and place for said hearing will be promptly given by the Commission. If no hearing is requested and none is ordered by the Commission, the order shall become permanent on the 30th day after its entry and shall remain in effect unless it is modified or vacated by the Commission.

By the Commission.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7582 Filed 5-28-71;8:50 am]

[File No. 1-4847]

ECOLOGICAL SCIENCE CORP.

Order Suspending Trading

MAY 25, 1971.

The common stock, 2 cents par value, of Ecological Science Corp. being traded on the American Stock Exchange, the Philadelphia - Baltimore - Washington Stock Exchange and the Pacific Coast Stock Exchange, pursuant to provisions of the Securities Exchange Act of 1934 and all other securities of Ecological Science Corp. being traded otherwise than on a national securities exchange; and

It appearing to the Securities and Exchange Commission that the summary suspension of trading in such security on such exchanges and otherwise than on a national securities exchange is required in the public interest and for the protection of investors:

It is ordered, Pursuant to sections 15(c)(5) and 19(a)(4) of the Securities Exchange Act of 1934, that trading in such securities on the above-mentioned exchanges and otherwise than on a national securities exchange be summarily suspended, this order to be effective for the period May 25, 1971, 12 p.m., e.d.t., through June 3, 1971.

By the Commission.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7583 Filed 5-28-71;8:50 am]

[File No. 500-1]

INDUSTRIAL MANUFACTURING CORP.

Order Suspending Trading

MAY 25, 1971.

It appearing to the Securities and Exchange Commission that the summary suspension of trading in the common

stock of Industrial Manufacturing Corp. (F/K/A Western Lead Annex Co.) (a Nevada corporation) and all other securities of Industrial Manufacturing Corp. being traded otherwise than on a national securities exchange is required in the public interest and for the protection of investors:

It is ordered, Pursuant to section 15(c)(5) of the Securities Exchange Act of 1934, that trading in such securities otherwise than on a national securities exchange be summarily suspended, this order to be effective for the period May 25, 1971, through June 3, 1971.

By the Commission.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7584 Filed 5-28-71;8:50 am]

[70-5027]

NEW JERSEY POWER & LIGHT CO.

Notice of Proposed Issue and Sale of Short-Term Notes to Banks

MAY 25, 1971.

Notice is hereby given that New Jersey Power & Light Co. (NJP&L), Madison Avenue at Punch Bowl Road, Morristown, NJ 07960, an electric utility subsidiary company of General Public Utilities Corp. (GPU), a registered holding company, has filed a declaration and an amendment thereto with this Commission pursuant to the Public Utility Holding Company Act of 1935 (Act), designating sections 6(a) and 7 as applicable to the proposed transactions. All interested persons are referred to the declaration, which is summarized below, for a complete statement of the proposed transactions.

NJP&L proposes to issue and sell, from time to time not later than December 31, 1972, unsecured notes to banks, the aggregate principal amount of which outstanding at any one time will not exceed $12,700,000. All the notes will mature not later than 9 months from the respective dates of issue and may be prepaid at any time without premium. The interest rate on the notes will be the prime commercial rate in effect at each bank on the date of issuance. NJP&L will be required to maintain compensating balances of 10 percent of the line of credit or 20 percent of the loans outstanding, whichever is higher. NJP&L computes its effective rate of interest at 6.875 percent per annum based on the current prime rate of 5½ percent and assuming the full amount of the line of credit is borrowed. There are no commitment fees or closing costs required.

Although no commitments or agreements for such borrowings have been made, NJP&L expects that, as and to the extent that its cash needs require, borrowings will be effected, in the specified maximum amount to be outstanding at any one time, from among the following banks:

The Chase Manhattan Bank NA, New York, N.Y.	$4,000,000
Fidelity Union Trust Co., Newark, N.J.	2,300,000
American National Bank & Trust, Montclair, N.J.	1,000,000
First Merchants National Bank, Asbury Park, N.J.	600,000
First Morris Bank, Morristown, N.J.	100,000
The First National Iron Bank of New Jersey, Morristown, N.J.	1,300,000
The Hunterdon County National Bank, Lambertville, N.J.	400,000
Monmouth County National Bank, Red Bank, N.J.	500,000
The National Union Bank of Dover, N.J.	600,000
New Jersey National Bank, Asbury Park, N.J.	1,300,000
Somerset Hills & County National Bank, Bernardsville, N.J.	300,000
The Warren County National Bank, Washington, N.J.	300,000
Total	12,700,000

NJP&L proposes to utilize the proceeds of the proposed borrowings for financing its business as a public-utility company, including provisions for construction expenditures, the repayment of other short-term borrowings, and the temporary reimbursement of its treasury for construction expenditures provided therefrom.

NJP&L estimates that its expenses incident to the proposed transactions will be approximately $4,000, including counsel fees of $3,750, and it states that no State commission and no Federal commission, other than this Commission, has jurisdiction over the proposed transactions. However, it is also stated that approval by the Board of Public Utility Commissioners of the State of New Jersey will be required for the issue, renewal, extension, or replacement of any notes issued by NJP&L, if, as a result thereof, the loan evidenced thereby is not repaid within 12 months of the original date of the note or notes.

Notice is further given that any interested person may, not later than June 22, 1971, request in writing that a hearing be held in respect of such matter, stating the nature of his interest, the reasons for such request, and the issues of fact or law which he desires to controvert; or he may request that he be notified should the Commission order a hearing thereon. Any such request should be addressed: Secretary, Securities and Exchange Commission, Washington, D.C. 20549. A copy of such request should be served personally or by mail (airmail if the person being served is located more than 500 miles from the point of mailing) upon the declarant at the above-stated address, and proof of service (by affidavit or, in case of an attorney at law, by certificate) should be filed with the request. At any time after said date, the declaration, as amended or as it may be further amended, may be permitted to become effective in the manner provided by Rule 23 of the general rules and regulations promulgated under the Act, or the Commission may grant exemption from such rules as provided in Rules 20(a) and 100 thereof, or take such other action as it may deem appropriate. Persons who request a hearing or advice as to whether a hearing is ordered will receive notice of further developments in this matter, including the date of the hearing (if ordered) and any postponement thereof.

For the Commission, by the Division of Corporate Regulation, pursuant to delegated authority.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7585 Filed 5-28-71;8:50 am]

[70-4774]

POTOMAC EDISON CO.

Notice of Posteffective Amendment Regarding Issue and Sale of Notes to Banks and to Dealer in Commercial Paper

MAY 25, 1971.

Notice is hereby given that The Potomac Edison Co. (Potomac), Downsville Pike, Hagerstown, MD 21740, a registered holding company and an electric utility subsidiary company of Allegheny Power System, Inc., also a registered holding company, has filed with this Commission a posteffective amendment to its application in this proceeding pursuant to section 6(b) of the Public Utility Holding Company Act of 1935 (Act) and Rule 50(a)(5) promulgated thereunder regarding the following proposed transactions. All interested persons are referred to the amended application, which is summarized below, for a complete statement of the proposed transactions.

By orders dated August 19, 1969, and February 3, 1971 (Holding Company Act Releases Nos. 16449 and 16985), the Commission authorized Potomac to issue and sell, from time to time prior to July 31, 1971, short-term notes to banks and commercial paper to a dealer in an aggregate face amount to be outstanding at any one time up to the maximum amount allowable under Potomac's charter without preferred stockholder consent, which, as of November 30, 1970, amounted to $25,170,000. Potomac has now filed a second posteffective amendment to its application proposing to increase the maximum amount of notes to be outstanding at any one time to $27,800,000, which, as of April 30, 1971, was the maximum amount allowable under Potomac's charter without preferred stockholder consent. It is also proposed that the period of issuance of the notes be extended to July 31, 1973, with the latest maturity date being December 31, 1973. In all other respects the transactions remain the same. It is stated that construction expenditures for 1971, 1972, and 1973 are estimated at a total of $150 million.

Notice is further given that any interested person may, not later than June 17,

1971, request in writing that a hearing be held on such matter, stating the nature of his interest, the reasons for such request, and the issues of fact or law raised by said posteffective amendment to the application which he desires to controvert; or he may request that he be notified if the Commission should order a hearing thereon. Any such request should be addressed: Secretary, Securities and Exchange Commission, Washington, D.C. 20549. A copy of such request should be served personally or by mail (airmail if the person being served is located more than 500 miles from the point of mailing) upon the applicant at the above-stated address, and proof of service (by affidavit or, in case of an attorney at law, by certificate) should be filed with the request. At any time after said date, the application, as now amended or as it may be further amended, may be granted as provided in Rule 23 of the general rules and regulations promulgated under the Act, or the Commission may grant exemption from such rules as provided in Rules 20(a) and 100 thereof or take such other action as it may deem appropriate. Persons who request a hearing or advice as to whether a hearing is ordered will receive notice of further developments in this matter, including the date of the hearing (if ordered) and any postponements thereof.

For the Commission, by the Division of Corporate Regulation, pursuant to delegated authority.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7586 Filed 5-28-71;8:50 am]

[70-5025]

UTAH POWER & LIGHT CO.

Notice of Proposed Issue and Sale of Notes to Banks and to Dealer in Commercial Paper and Exception From Competitive Bidding

MAY 25, 1971.

Notice is hereby given that Utah Power & Light Co. (UP&L), 1407 West North Temple Street, Post Office Box 899, Salt Lake City, UT 84110, an electric utility company and a registered holding company, has filed a declaration and an amendment thereto with this Commission pursuant to the Public Utility Holding Company Act of 1935 (Act), designating sections 6(a) and (7) of the Act and Rule 50(a)(5) promulgated thereunder as applicable to the proposed transactions. All interested persons are referred to the declaration, which is summarized below, for a complete statement of the proposed transactions.

UP&L proposes to issue and sell, from time to time during the period ending July 31, 1972, short-term notes (including commercial paper) in an aggregate principal amount outstanding at any one time not to exceed $44 million. UP&L intends to utilize the proceeds of the sale of its notes for construction expenditures estimated at $63 million for 1971 and $60 million for 1972. Pursuant to lines of credit, UP&L proposes to issue and sell to banks an aggregate amount not to exceed $44 million of its short-term notes (and to renew such notes) from time to time until July 31, 1972. Such notes will mature not more than 9 months from the date of issue (in any event not later than July 31, 1972), with right of renewal, will bear interest at the prime rate for unsecured notes in effect at the lending bank, such interest rate to change on the effective day of any rate change, and will be prepayable at any time without penalty or premium. UP&L expects that the allocation of the commitment among the banks will be substantially as follows:

The Continental Bank & Trust Co., Salt Lake City, Utah	$500,000
First Security Bank of Utah, N.A., Salt Lake City, Utah	3,000,000
Walker Bank & Trust Co., Salt Lake City, Utah	3,000,000
Zions First National Bank, Salt Lake City, Utah	2,000,000
United Bank of Denver, Colo	2,000,000
Bank of Utah, Ogden, Utah	200,000
Carbon Emery Bank, Price, Utah	100,000
Commercial Security Bank, Ogden, Utah	1,000,000
First Security State Bank, Salt Lake City, Utah	100,000
Valley Bank & Trust Co., South Salt Lake, Utah	300,000
The Chase Manhattan Bank, N.A., New York, N.Y	9,000,000
Morgan Guaranty Trust Co. of New York, N.Y	8,500,000
Mellon National Bank & Trust Co., Pittsburgh, Pa	8,500,000
Harris Trust & Savings Bank, Chicago, Ill	3,000,000
Irving Trust Co., New York, N.Y.	2,500,000
Total	44,000,000

UP&L also proposes to issue and sell commercial paper to A. G. Becker & Co., Inc. (Becker), a commercial paper dealer, in an aggregate principal amount not to exceed $44 million at any time outstanding from time to time until July 31, 1972. Such notes will be issued in denominations of not less than $50,000 and not more than $5 million, will have varying maturities not to exceed 270 days, and will be sold by UP&L directly to Becker at a discount rate not to exceed the discount rate per annum prevailing at the date of issuance for commercial paper of comparable quality and of the particular maturity. The effective interest cost for the commercial paper will not exceed the commercial bank rate which UP&L could obtain on the date of issue on notes to banks of equal principal amounts as the proposed commercial paper, except for commercial paper of maturity not exceeding 60 days issued to refund outstanding commercial paper, if, in UP&L's judgment, it would be impractical or inadvisable to borrow from banks to refund such outstanding commercial paper. The notes will not be prepayable. No commission or fee will be payable in connection with the issuance and sale of the commercial paper. UP&L expects to retire all of the bank notes and commercial paper notes prior to July 31, 1972, with the net proceeds of the sale of long-term debt and equity securities.

Becker, as principal, will reoffer the commercial paper to institutional investors at a discount not to exceed one-eighth of 1 percent per annum less than the prevailing discount rate to UP&L. The commercial paper will be reoffered to not more than 200 identified and designated customers in a list (nonpublic) prepared in advance by Becker. No additions will be made to this list. It is anticipated that the commercial paper will be held by customers to maturity, but if such customers desire to resell prior to maturity, Becker will repurchase the commercial paper and reoffer the same to others in the group of 200 customers.

UP&L asserts that the issue and sale of its commercial paper notes should, pursuant to subparagraph (a)(5) of Rule 50, be excepted from the requirements thereof, in view of the fact that they will have a maturity of not to exceed 9 months and will be issued to a limited defined group of buyers, that the interest cost thereon will generally not exceed the effective cost of borrowing from commercial banks, and that the current rates for commercial paper for prime issuers such as UP&L are readily ascertainable by reference to daily financial publications and therefore competitive bidding is not required to determine reasonableness of rates.

Fees and expenses to be incurred by UP&L in connection with the proposed transactions are estimated at not to exceed $2,000. It is stated that the Idaho Public Utilities Commission has jurisdiction over the issue and sale of the notes. No other State commission and no Federal commission, other than this Commission, has jurisdiction over the proposed transactions.

Notice is further given that any interested person may, not later than June 14, 1971, request in writing that a hearing be held on such matter, stating the nature of his interest, the reasons for such request and the issues of fact or law raised by said declaration which he desires to controvert; or he may request that he be notified if the Commission should order a hearing thereon. Any such request should be addressed: Secretary, Securities and Exchange Commission, Washington, D.C. 20549. A copy of such request should be served personally or by mail (airmail if the person being served is located more than 500 miles from the point of mailing) upon the declarant at the above-stated address, and proof of service (by affidavit or, in case of an attorney at law, by certificate) should be filed with the request. At any time after said date, the declaration, as amended or as it may be further amended, may be permitted to become effective as provided in Rule 23 of the general rules and regulations promulgated under the Act, or the Commission may grant exemption from such rules as provided in Rules 20(a) and 100 thereof or take such other action as it may deem appropriate. Persons who request a hearing or advice as to whether a hearing is

ordered will receive notice of further developments in this matter, including the date of the hearing (if ordered) and any postponements thereof.

For the Commission, by the Division of Corporate Regulation, pursuant to delegated authority.

[SEAL] THEODORE L. HUMES,
Associate Secretary.

[FR Doc.71-7587 Filed 5-28-71;8:50 am]

SMALL BUSINESS ADMINISTRATION

MINORITY EQUITY CAPITAL CO., INC.

Notice of Issuance of License To Operate as Minority Enterprise Small Business Investment Company

On April 20, 1971, a notice was published in the FEDERAL REGISTER (36 F.R. 7489) stating that Minority Equity Capital Co., Inc., 470 Park Avenue South, New York, NY 10016, had filed an application with the Small Business Administration, pursuant to § 107.102 of the SBA rules and regulations governing small business investment companies (33 F.R. 326, 13 CFR Part 107) for a license to operate as a minority enterprise small business investment company (MESBIC).

Interested parties were given to the close of business April 30, 1971, to submit their written comments to SBA. No comments were received.

Notice is hereby given that, having considered the application and all other pertinent information, SBA has issued License No. 02/02-5288 to Minority Equity Capital Co., Inc., pursuant to section 301(c) of the Small Business Investment Act of 1958, as amended.

Dated: May 19, 1971.

A. H. SINGER,
Associate Administrator for Investment.

[FR Doc.71-7533 Filed 5-28-71;8:47 am]

TARIFF COMMISSION

[337-29]

ARTICLES COMPRISED OF PLASTIC SHEETS HAVING OPENWORK STRUCTURE

Notice of Resumption of Hearing

Notice is hereby given that on June 28, 1971, the U.S. Tariff Commission will resume its public hearing in connection with Investigation No. 337-29, regarding alleged unfair methods of competition and unfair acts in the importation and sale of certain articles comprised of plastic sheets having an openwork structure produced by means of a process embraced within the claims of U.S. Patent No. 2,761,177 owned by the complainant Ben Walters.

The complaint alleges that the effect or tendency of the unfair methods or acts is to destroy or substantially injure an industry, efficiently and economically operated, in the United States in violation of the provisions of section 337 of the Tariff Act of 1930 (19 U.S.C. 1337). Notice of institution of the investigation and hearing was published in the FEDERAL REGISTER of March 31, 1971 (36 F.R. 5945). A public hearing was held on May 18, 1971, and a recess was ordered.

The hearing will be resumed on June 28, 1971, at 10 a.m., e.d.s.t., in the Hearing Room of the Tariff Commission, Eighth and E Streets NW., Washington, DC. Requests for appearances at the hearing should be received by the Secretary of the Tariff Commission no later than June 23, 1971. Parties wishing to submit documentary evidence for the record, but not desiring to make an appearance, should send such evidence to the Secretary in time for inclusion in the record when the hearing resumes. Final briefs are due July 13, 1971.

Issued: May 26, 1971.

By order of the Commission.

[SEAL] KENNETH R. MASON,
Secretary.

[FR Doc.71-7580 Filed 5-28-71;8:50 am]

DEPARTMENT OF LABOR

Office of the Secretary

JODI SHOE CO., INC., AND GOLDBERG BROTHERS, INC.

Notice of Certification of Eligibility of Workers To Apply for Adjustment Assistance

Under date of February 8, 1971, the U.S. Tariff Commission made a report of the results of investigations (TEA-W-37 and TEA-W-41) under section 301(c)(2) of the Trade Expansion Act of 1962 (76 Stat. 884) in response to petitions for determination of eligibility to apply for adjustment assistance submitted on behalf of workers formerly employed by the Jodi Shoe Co., Inc., Derry, N.H. and Goldberg Brothers, Inc., Haverhill, Mass. In this report, the Commission being equally divided, made no finding with respect to whether articles like or directly competitive with the women's and misses' footwear produced by Jodi Shoe Co., Inc., and Goldberg Brothers, Inc., are, as a result in major part of concessions granted under trade agreements, being imported into the United States in such increased quantities as to cause, or threaten to cause, the unemployment or underemployment of a significant number or proportion of the workers at the plants concerned. The President subsequently decided, under the authority of section 330(d)(1) of the Tariff Act of 1930 as amended to consider the findings of those Commissioners who found in the affirmative as the finding of the Commission.

Upon receipt of the President's authorization, the Department, through the Acting Director of the Office of Foreign Economic Policy, Bureau of International Labor Affairs, instituted investigations. Following this, the Director made recommendations to me relating to the matter of certifications (Notice of Delegation of Authority and Notice of Investigation, 34 F.R. 18342; 36 F.R. 7625; 29 CFR Part 90). In those recommendations he noted that significant layoffs caused by imports began to occur on March 20, 1969, at the Jodi Shoe Co., Inc., which ceased production on June 13, 1969, and on January 15, 1970, at Goldberg Brothers, Inc. which ceased production on March 5, 1970. After due consideration, I make the following certifications:

All workers (hourly, piecework, and salaried), of the Jodi Shoe Co., Inc., plant located at Derry, N.H., who became unemployed or underemployed after March 20, 1969, are eligible to apply for adjustment assistance under Title III, Chapter 3, of the Trade Expansion Act of 1962.

All workers (hourly, salaried, and piecework) of the Goldberg Brothers, Inc., plant located at Haverhill, Mass., who became unemployed or underemployed after January 15, 1970, are eligible to apply for adjustment assistance under Title III, Chapter 3, of the Trade Expansion Act of 1962.

Signed at Washington, D.C., this 24th day of May 1971.

HERBERT N. BLACKMAN,
Deputy Assistant Secretary for Trade and Adjustment Policy.

[FR Doc.71-7515 Filed 5-28-71;8:45 am]

INTERSTATE COMMERCE COMMISSION

FOURTH SECTION APPLICATION FOR RELIEF

MAY 26, 1971.

Protests to the granting of an application must be prepared in accordance with Rule 1100.40 of the general rules of practice (49 CFR 1100.40) and filed within 15 days from the date of publication of this notice in the FEDERAL REGISTER.

LONG-AND-SHORT HAUL

FSA No. 42211—*Liquid caustic soda to Augusta, Ga.* Filed by O. W. South, Jr., agent (No. A6258), for interested rail carriers. Rates on sodium (soda), caustic (sodium hydroxide), in tank carloads, as described in the application, from St. Gabriel, Geismar, and Baton Rouge, La., to Augusta, Ga.

Grounds for relief—Market competition and rate relationship.

Tariff—Supplement 188 to Southern Freight Association, agent, tariff ICC S-699. Rates are published to become effective on July 1, 1971.

By the Commission.

[SEAL] ROBERT L. OSWALD,
Secretary.

[FR Doc.71-7550 Filed 5-28-71;8:51 am]

[Notice 302]

MOTOR CARRIER TEMPORARY AUTHORITY APPLICATIONS

MAY 25, 1971.

The following are notices of filing of applications for temporary authority under section 210a(a) of the Interstate Commerce Act provided for under the new rules of Ex Parte No. MC-67 (49 CFR Part 1131), published in the FEDERAL REGISTER, issue of April 27, 1965, effective July 1, 1965. These rules provide that protests to the granting of an application must be filed with the field official named in the FEDERAL REGISTER publication, within 15 calendar days after the date of notice of the filing of the publication is published in the FEDERAL REGISTER. One copy of such protests must be served on the applicant, or its authorized representative, if any, and the protests must certify that such service has been made. The protests must be specific as to the service which such protestant can and will offer, and must consist of a signed original and six copies.

A copy of the application is on file, and can be examined at the Office of the Secretary, Interstate Commerce Commission, Washington, D.C., and also in field office to which protests are to be transmitted.

MOTOR CARRIERS OF PROPERTY

No. MC 7228 (Sub-No. 38 TA), filed May 13, 1971. Applicant: COAST TRANSPORT, INC., 1906 Southeast 10th Avenue, Portland, OR 97214. Applicant's representative: Nick I. Goyak, 404 Oregon National Building, 610 Southwest Alder Street, Portland, OR 97205. Authority sought to operate as a *common carrier*, by motor vehicle over irregular routes, transporting: *Frozen foods*, from points in Umatilla County, Oreg., and Grant, Benton, Franklin, and Walla Walla Counties, Wash., to points in Oregon and Washington, for 180 days. Supporting shipper: Lamb-Weston, Inc., 6600 Southwest Hampton, Street, Post Office Box 23507, Portland, OR 97223. Send protests to: District Supervisor W. J. Huetig, Interstate Commerce Commission, Bureau of Operations, 450 Multnomah Building, 319 Southwest Pine Street, Portland, OR 97204.

No. MC 110525 (Sub-No. 1001 TA), filed May 16, 1971. Applicant: CHEMICAL LEAMAN TANK LINES, INC., 520 East Lancaster Avenue, Downingtown, PA 19335. Applicant's representative: Thomas J. O'Brien (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Plastic granules*, in bulk, from the plantsite of United States Steel Corp., at or near Haverhill (Scioto County), Ohio, to points in Alabama, Arkansas, Colorado, Connecticut, Delaware, Florida, Georgia, Illinois, Indiana, Iowa, Kansas, Kentucky, Louisiana, Maryland, Maine, Massachusetts, Michigan, Minnesota, Mississippi, Missouri, Nebraska, New Hampshire, New Jersey, New York, North Carolina, North Dakota, Oklahoma, Pennsylvania, Rhode Island, South Carolina, South Dakota, Tennessee, Texas, Vermont, Virginia, West Virginia, Wisconsin, and the District of Columbia, for 180 days. Supporting shipper: United States Steel Corp., 600 Grant Street, Pittsburgh, PA 15230. Send protests to: Peter R. Guman, District Supervisor, Interstate Commerce Commission, Bureau of Operations, 1518 Walnut Street, Room 1600, Philadelphia, PA 19102.

No. MC 112822 (Sub-No. 197 TA), filed May 13, 1971. Applicant: BRAY LINES INCORPORATED, 1401 North Little, Post Office Box 1191, Cushing, OK 74023. Applicant's representative: Joe W. Ballard (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Animal litter and pet supplies, bleachings, cleaning, laundry and scouring compounds, materials, and supplies* (except commodities in bulk), from the plantsite and distribution facilities of the Clorox Co., Atlanta, Ga., to points in Texas, Louisiana, Arkansas, Missouri, and Kansas, for 180 days. Supporting shipper: The Clorox Co., Post Office Box 24305, Oakland, CA 94623, Attention: R. W. Ernst, Division Traffic Manager. Send protests to: C. L. Phillips, District Supervisor, Interstate Commerce Commission, Bureau of Operations, Room 240, Old Post Office Building, 215 Northwest Third, Oklahoma City, OK 73102.

No. MC 112822 (Sub-No. 198 TA), filed May 13, 1971. Applicant: BRAY LINES INCORPORATED, 1401 North Little, Post Office Box 1191, Cushing, OK 74023. Applicant's representative: Joe W. Ballard (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Plumbing fixtures, fittings, and supplies*, from Delphi, Frankfort, Kokomo, and West Delphi, Ind., Gadsden and Springfield, Ala., Chattanooga, Tenn., and Bay St. Louis, Miss., to points in Alabama, Arkansas, Colorado, Illinois, Indiana, Iowa, Kansas, Kentucky, Louisiana, Minnesota, Mississippi, Missouri, Nebraska, North Dakota, Ohio, Oklahoma, South Dakota, Tennessee, Texas, and Wisconsin, for 180 days. Supporting shipper: Harvey E. Dollars, G. T. M. Gerber Fixtures Corp., 4656 West Touhy Avenue, Lincolnwood, IL. Send protests to: C. L. Phillips, District Supervisor, Interstate Commerce Commission, Bureau of Operations, Room 240, Old Post Office Building, 215 Northwest Third, Oklahoma City, OK 73102.

No. MC 113535 (Sub-No. 20 TA), filed May 12, 1971. Applicant: A & W TRUCKING CO., INC., Route 5, Box 900, Mosinee, WI 54455. Applicant's representative: John Altenburg (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Meat, meat products, meat byproducts, and articles* distributed by meat packinghouses, as described in sections A and C of appendix 1 to the report in *Descriptions of Motor Carrier Certificates*, 61 M.C.C. 209 and 766 (except commodities in bulk, in tank vehicles, and hides), from the plantsite or storage facilities of Illini Beef Packers, Inc., at or near Joslin, Ill., to points in Iowa, Minnesota, and Wisconsin. Restricted to traffic originating at the named origin and destined to the named destinations, for 180 days. Supporting shipper: Illini Beef Packers, Inc., Joslin, Ill. Send protests to: Barney L. Hardin, District Supervisor, Interstate Commerce Commission, Bureau of Operations, 139 West Wilson Street, Room 206, Madison, WI 53703.

No. MC 113678 (Sub-No. 425 TA), filed May 16, 1971. Applicant: CURTIS, INC., Post Office Box 16004, Stockyard Station, Denver, CO 80216. Applicant's representative: David L. Metzler (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Frozen meats*, from Omaha, Nebr., to Kankakee, Ill., Montecello, Decatur, New Castle, Indianapolis, Fort Wayne, and Evansville, Ind., Troy, Circleville, Galion, and Napoleon, Ohio; Marlette, St. John, Three Rivers, Sault Ste. Marie, Saginaw, Detroit, and Pontiac, Mich., for 180 days. Supporting shipper: Omaha Steaks International, 4400 South 96th Street, Omaha, NE. Send protests to: District Supervisor H. C. Ruoff, Interstate Commerce Commission, Bureau of Operations, 2022 Federal Building, Denver, Colo. 80202.

No. MC 114632 (Sub-No. 42 TA), filed May 16, 1971. Applicant: APPLE LINES, INC., Post Office Box 507, 225 South Van Eps Avenue, Madison, SD 57042. Applicant's representative: Robert Applewick (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Meat, meat products, meat byproducts and articles* distributed by meat packinghouses, as described in appendix I to the report in *Descriptions in Motor Carrier Certificates*, 61 M.C.C. 209 and 766 (except hides and commodities in bulk, in tank vehicles), from Joslin, Ill., to points in Arkansas, Colorado, Iowa, Kansas, Minnesota, Missouri, Nebraska, North Dakota, Oklahoma, and South Dakota, for 180 days. Supporting shipper: Illini Beef Packers, Inc., Joslin, Ill., G. James Bonnette, Director of Traffic. Send protests to: J. L. Hammond, District Supervisor, Interstate Commerce Commission, Bureau of Operations, Room 369, Federal Building, Pierre, S. Dak. 57501.

No. MC 116273 (Sub-No. 141 TA), filed May 13, 1971. Applicant: D & L TRANSPORT, INC., 3800 South Laramie Avenue, Cicero, IL. 60650. Applicant's representative: William R. Lavery (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Hydrogen gas*, in bulk, in tank vehicles, from Middletown, Ohio, to Countryside, Geneva and LaFox, Ill., for 150 days. Supporting shipper: American Cryogenics Division of Liquid Air, Inc., 2 Salt Creek Lane, Hinsdale, IL 60521.

Send protests to: District Supervisor Raymond E. Mauk, Interstate Commerce Commission, Bureau of Operations, 219 South Dearborn Street, Room 1086, Everett McKinley Dirksen Building, Chicago, IL 60604.

No. MC 116935 (Sub-No. 12 TA), filed May 16, 1971. Applicant: COMMERCIAL FURNITURE DISTRIBUTORS, INC., 1000 Belleville Turnpike, Kearny, NJ 07032. Applicant's representative: George A. Olsen, 69 Tonnele Avenue, Jersey City, NJ 07306. Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *New furniture*, in containers, from the facilities of Commercial Furniture Distributors, Inc., at Harrison, N.J., to New York, N.Y., and points in Nassau, Suffolk, and Westchester Counties, N.Y., and points in New Jersey, restricted to shipments having a prior movement by rail or motor carrier, for 150 days. Supporting shippers: Baumritter Corp., 205 Lexington Avenue, New York, NY, 10016; Krebs, Stengel & Co., Inc., 200 Lexington Avenue, New York, NY 10016. Send protests to: District Supervisor Robert E. Johnston, Interstate Commerce Commission, Bureau of Operations, 970 Broad Street, Newark, NJ 07102.

No. MC 123987 (Sub-No. 3 TA), filed May 16, 1971. Applicant: JEWETT SCOTT TRUCK LINE, INC., Post Office Box 267, Mangum, OK 73554. Applicant's representative: Jewett Scott, Jr. (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Gypsum wallboard and plaster, lumber, joint treatment, and roofing*, from points in Jackson County, Okla., to points in Arkansas, Louisiana, Texas, Missouri, Illinois, Nebraska, Kansas, Colorado, New Mexico, Arizona, and Tennessee, for 180 days. Supporting shipper: Joe Harris, Traffic Manager, Republic Gypsum Co., Drawer C, Duke, Okla. 73532. Send protests to: Haskell E. Ballard, District Supervisor, Bureau of Operations, Interstate Commerce Commission, 1012 Herring Plaza, 317 East Third, Amarillo, TX 79101.

No. MC 133581 (Sub-No. 7 TA), filed May 16, 1971. Applicant: HOLDT POTATO COMPANY, INC., Rural Route 2, Red Cloud, NE 68970. Applicant's representative: Frederick J. Coffman, Post Office Box 80806, Lincoln, NE 68501. Authority sought to operate as a *contract carrier*, by motor vehicle, over irregular routes, transporting: *Butter*, from the plantsite and warehouse storage facilities of Randolph Creamery at or near Randolph, Nebr., to the plantsite of Swift Dairy & Poultry Co., Oklahoma City, Okla., under continuing contract with Swift Dairy & Poultry Co., a division of Swift & Co., for 180 days. Supporting shipper: C. O. Forsythe, Plant Manager, Swift Dairy & Poultry Co., Post Office Box 26967, Oklahoma City, OK 73126. Send protests to: Max H. Johnston, District Supervisor, Bureau of Operations, Interstate Commerce Commission, 320 Federal Building and U.S. Courthouse, Lincoln, Nebr. 68508.

No. MC 134699 (Sub-No. 2 TA), filed May 16, 1971. Applicant: CAMPUS DIVISION OF P'EYLIM (American Yeshiva Student Union), Three West 16th Street, New York, NY 10011. Applicant's representative: Morton, E. Kiel, 140 Cedar Street, New York, NY 10006. Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Campers' baggage and personal effects*, between New York, N.Y., points in Nassau, Suffolk, Westchester, and Rockland Counties, N.Y., Bergan, Essex, Hudson, Union, Passaic, and Middlesex Counties, N.J., on the one hand, and, on the other, points in Hancock, Swan Lake, Monticello, and Livingston Manor, N.Y., Honesdale, Lake Como, Tannersville, Dingman's Ferry, Effort, Waymart, Indian Orchard, Winterdale, and Beach Lake, Pa., and Flatbrookville, N.J., for 180 days. Supporting shippers: There are approximately 12 statements of support attached to the application, which may be examined here at the Interstate Commerce Commission in Washington, D.C., or copies thereof which may be examined at the field office named below. Send protests to: Paul W. Assenza, District Supervisor, Bureau of Operations, Interstate Commerce Commission, 26 Federal Plaza, New York, NY 10007.

No. MC 135283 (Sub-No. 3 TA), filed May 16, 1971. Applicant: GRAND ISLAND MOVING & STORAGE CO., INC., East Highway 30, Grand Island, NE 68801. Applicant's representative: James D. Pirnie (same address as above). Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Meat, meat products, meat byproducts and articles distributed by meat packinghouses*, from the plantsite and storage facilities of Minden Beef Co., at or near Minden, Nebr., to Philadelphia, Pa., and points within the Philadelphia, Pa., commercial zone as defined by the Commission, for 150 days. Supporting shipper: Minden Beef Co., Post Office Box 70, Minden, NE 68959. Send protests to: Max H. Johnston, District Supervisor, Interstate Commerce Commission, Bureau of Operations, 320 Federal Building, and U.S. Courthouse, Lincoln, Nebr. 68508.

No. MC 135424 (Sub-No 1 TA), filed May 16, 1971. Applicant: CONNOLLY CARTAGE CORP., Post Office Box 3660, St. Paul, MN 55165. Applicant's representative: Joseph P. Summers, 630 Osborn Building, St. Paul, MN 55102. Authority sought to operate as a *contract carrier*, by motor vehicle, over irregular routes, transporting: *Paper and paper products*, from the plantsite of the International Paper Co., located at 1300 Red Fox Road, Arden Hills, MN, to points in Iowa, North Dakota, South Dakota, and Wisconsin and to *return rejected or returned shipments* to the consignor. Restriction: No transportation service shall be authorized to La Cross, Wis., for 180 days. Supporting shippers: International Paper Co., Arden Hills, Minn.; International Paper Co., New York, N.Y.; International Paper Co., Minneapolis, Minn. Send protests to: District Supervisor E. C. Sjogren, Bureau of Operations, Interstate Commerce Commission, 448 Federal Building and U.S. Courthouse, 110 South Fourth Street, Minneapolis, MN 55401.

No. MC 135592 (Sub-No. 1 TA), filed May 16, 1971. Applicant: U & R EXPRESS, INC., Post Office Box 2369, White City, OR 97501. Applicant's representative: Lawrence V. Smart, Jr., 419 Northwest 23d Avenue, Portland, OR 97210. Authority sought to operate as a *common carrier*, by motor vehicle, over irregular routes, transporting: *Wood residuals*, from points in Siskiyou County, Calif., to points in Josephine, Jackson, and Douglas Counties, Oreg., for 180 days. Supporting shippers: Timber Products Co., Post Office Box 1669, Midford, OR 97501; Forrest Industries, Ltd., Post Office Box 178, Dillard, OR 97432. Send protests to: District Supervisor A. E. Odoms, Interstate Commerce Commission, Bureau of Operations, 450 Multnomah Building, 319 Southwest Pine Street, Portland, OR 97204.

By the Commission.

[SEAL] ROBERT L. OSWALD, *Secretary*.

[FR Doc.71-7551 Filed 5-28-71;8:51 am]

[Notice 696]

MOTOR CARRIER TRANSFER PROCEEDINGS

MAY 26, 1971.

Synopses of orders entered pursuant to section 212(b) of the Interstate Commerce Act, and rules and regulations prescribed thereunder (49 CFR Part 1132), appear below:

As provided in the Commission's special rules of practice any interested person may file a petition seeking reconsideration of the following numbered proceedings within 20 days from the date of publication of this notice. Pursuant to section 17(8) of the Interstate Commerce Act, the filing of such a petition will postpone the effective date of the order in that proceeding pending its disposition. The matters relied upon by petitioners must be specified in their petitions with particularity.

No. MC-FC-72848. By order of May 24, 1971, the Motor Carrier Board approved the transfer to Great Lakes Bus Lines, Inc., North Chicago, Ill., of the operating rights in certificate No. MC-114093 issued March 13, 1970, to Lakeland Bus Lines, Inc., North Chicago, Ill., authorizing the transportation of passengers and their baggage in round-trip charter operations beginning and ending at points in Lake and McHenry Counties, Ill., and extending to points in Wisconsin and Indiana. Robert F. Munsell, 516 West Jackson Boulevard, Chicago, IL 60606, attorney for applicants.

No. MC–FC–72869. By order of May 24, 1971, the Motor Carrier Board approved the transfer to Lima-Honeoye Falls Express, Inc., Honeoye Falls, N.Y., of the operating rights set forth in certificate No. MC–56691 (Sub-No. 2), issued October 23, 1970, to Herman A. Burmister, doing business as Lima-Honeoye Falls Express, Honeoye Falls, N.Y., authorizing the transportation of general commodities with the usual exceptions between specified points in New York and certificate of registration No. MC–56691 (Sub-No. 1), issued October 14, 1964, to Herman A. Burmister, doing business as Lima-Honeoye Falls Express, Honeoye Falls, N.Y., evidencing a right to engage in transportation in interstate commerce as described in certificate No. 2454, issued January 7, 1964, by the New York Public Serivce Commission. Raymond A. Richards, 23 West Main Street, Webster, NY 14580, representative of applicants.

No. MC–FC–72872. By order of May 24, 1971, the Motor Carrier Board approved the transfer to A. T. I. Trucking Co., Inc., Florida, N.Y., of the operating rights in corrected permit No. MC–134141 (Sub-No. 2) issued September 28, 1970, to Samuel W. Groome, doing business as A. T. I. Trucking Co., Florida, N.Y., authorizing the transportation of artificial Christmas trees, wreaths, garlands, and shrubbery, from West Coxsackie, N.Y., to points in Connecticut, Delaware, Kentucky, Maine, Maryland, Massachusetts, Michigan, Illinois, New Hampshire, New Jersey, New York, Ohio, Vermont, Pennsylvania, West Virginia, Virginia, and the District of Columbia; and from Chicago, Ill., and Lexington, Ky., to West Coxsackie, N.Y. Julius Braun, 29 Nancy Drive, Troy, NY 12180, attorney for applicants.

No. MC–FC–72888. By order of May 21, 1971, the Motor Carrier Board approved the transfer to Bowie Hall Trucking, Inc., Upper Marlboro, Md., of the operating rights in certificate No. MC–133405 (Sub-No. 1) and permit No. MC–129612 issued January 13, 1970, and July 9, 1968, respectively, to I. Bowie Hall, doing business as Bowie Hall Trucking, Upper Marlboro, Md., authorizing the transportation of lumber, tunnel lagging, equipment, mats, and wood piling, from points in Prince Georges, Anne Arundel, Calvert, Charles, and St. Marys Counties, Md., to points in Ohio, Pennsylvania, New Jersey, Delaware, New York, Connecticut, Rhode Island, Massachusetts, and West Virginia, and malt beverages, from Newark, N.J., to Upper Marlboro and Leonardtown, Md. Dual operations were approved. Daniel B. Johnson, 716 Perpetual Building, 1111 E Street NW., Washington, DC 20004, attorney for applicants.

[SEAL] ROBERT L. OSWALD,
Secretary.

[FR Doc.71–7552 Filed 5–28–71;8:52 am]

CUMULATIVE LIST OF PARTS AFFECTED—MAY

The following numerical guide is a list of parts of each title of the Code of Federal Regulations affected by documents published to date during May.

3 CFR

	Page
PROCLAMATIONS:	
4049	8289
4050	8551
4051	8553
4052	8657
4053	8859
4054	9199
4055	9615
4056	9761
EXECUTIVE ORDERS:	
2295 (revoked by PLO 5052)	8807
10480 (see EO 11594)	8995
11583 (amended by EO 11595)	9763
11592	8555
11593	8921
11594	8995
11595	9763
PRESIDENTIAL DOCUMENTS OTHER THAN PROCLAMATIONS AND EXECUTIVE ORDERS:	
Memorandum of April 30, 1971	8721

5 CFR

	Page
151	9393
213	8235, 8501, 8723, 9235, 9393, 9495
307	8773
550	9393
713	9765
715	9765
771	9235
PROPOSED RULES:	
900	9469

7 CFR

	Page
19	8433
51	8502, 9061, 9125
52	8557
54	9841, 9842
55	9841
56	9765, 9841, 9842
59	9814
70	9842
319	9061
354	8235, 9437
724	8291, 8503, 9843
751	8505
811	8773
845	9061
905	9129
907	8291
908	8361, 8441, 8774, 9129, 9289, 9633
909	8671, 8997
910	8236, 8291, 8558, 8925, 9061, 9289, 9843
911	8236
916	9289, 9843
917	8671, 9495, 9765
918	8876
928	8925
929	9496
944	9236
953	9633
966	9290
980	9291, 9634
1000	9845
1001	9766, 9847
1002	9847
1004	9847
1006	9847
1007	9847
1011	9848
1012	9848
1013	9848
1015	8361, 9848
1030	9848
1032	9849
1033	9849
1036	9767, 9849, 9856
1040	9849
1043	9849
1044	9850
1046	9850
1049	9850
1050	9850
1060	9850
1061	9850
1062	9851
1063	9851
1064	9851
1065	9851
1068	9851
1069	9851
1070	9852
1071	9852
1073	9852
1075	9852
1076	9852
1078	9852
1079	9852
1090	9853
1094	9853
1096	9853
1097	9853
1098	9853
1099	9853
1101	9854
1102	9854
1103	9854
1104	9854
1106	9854
1108	9854
1120	9854
1121	9855
1124	9855
1125	9855
1126	9855
1127	9855
1128	9856
1129	9856
1130	9856
1131	9856
1132	9856
1133	9856
1134	9856
1136	9497, 9857

7 CFR—Continued

Page

PROPOSED RULES:

1137 ... 9857
1138 ... 9857
1421 ... 8291, 8362, 8559, 8930, 8997, 9001, 9236, 9634
1430 ... 8237
1475 ... 9497
1488 ... 9437–9442

PROPOSED RULES:

6 ... 9785
55 ... 9307
81 ... 9716
717 ... 9251
730 ... 8261
814 ... 9071
911 ... 8520, 9071
915 ... 8522, 9871
916 ... 9564
917 ... 8735
919 ... 9252
922 ... 9873
923 ... 9314
929 ... 8453
934 ... 9640
953 ... 8956, 9252
966 ... 8262, 8677, 9874
980 ... 8262, 8677
987 ... 9655
1030 ... 9025
1036 ... 8524, 8880, 8957
1125 ... 8678
1136 ... 8376
1207 ... 8588

8 CFR

103 ... 9001
204 ... 8294
214 ... 8660
234 ... 8294
238 ... 8294
248 ... 9001
299 ... 8295, 8505, 9002
499 ... 8505

PROPOSED RULES:

211 ... 9251
242 ... 9251

9 CFR

76 ... 8362, 8363, 8507, 8659, 8660, 8861, 8930, 8931, 9240, 9497, 9617, 9768
78 ... 9442
97 ... 8238, 8861
319 ... 9499
331 ... 9002–9004

PROPOSED RULES:

145 ... 9104
147 ... 9104

10 CFR

50 ... 8861

PROPOSED RULES:

2 ... 8379
20 ... 9468
30 ... 9468
31 ... 9468
70 ... 9786
140 ... 8454

12 CFR

1 ... 8723, 9065
201 ... 8441
222 ... 9292

12 CFR—Continued

Page

545 ... 8507, 8724, 9500, 9859
561 ... 9501
563 ... 9859
604 ... 9860
703 ... 8508

PROPOSED RULES:

10 ... 9522
11 ... 9522
12 ... 9522
16 ... 9522
18 ... 9522
545 ... 9333, 9570
555 ... 9077
747 ... 8591

13 CFR

121 ... 8660, 9618

PROPOSED RULES:

121 ... 9144

14 CFR

39 ... 8209, 8306, 8307, 8509, 8862, 9005–9007, 9241, 9768, 9860, 9861
47 ... 8661
49 ... 8661
71 ... 8209, 8210, 8307, 8308, 8363–8365, 8509, 8510, 8662, 8775, 8863, 8864, 9065–9067, 9130, 9443, 9444, 9618–9623, 9861, 9862
73 ... 8210, 8510, 9067
75 ... 8210, 8308, 9623
95 ... 8308, 9623
97 ... 9293, 9862
105 ... 8775
249 ... 8724
287 ... 8311
302 ... 8560
310 ... 8562
378 ... 8725
378a ... 8728

PROPOSED RULES:

1 ... 8383
21 ... 8383
23 ... 8383, 8398
25 ... 8383
27 ... 8383
29 ... 8383
33 ... 8383
39 ... 8695, 8696, 9026, 9785
71 ... 8263, 8316–8319, 8405, 8524, 8525, 8591, 8696, 8697, 8880, 8963, 9026, 9027, 9075, 9076, 9143, 9447, 9448, 9565, 9661–9665
73 ... 9076
75 ... 8264, 8406, 9076, 9258
93 ... 9029
103 ... 9448
121 ... 8813
139 ... 8880
239 ... 8739
241 ... 9030
288 ... 9330
302 ... 9566

15 CFR

370 ... 8367
371 ... 8367, 8932
372 ... 8368
373 ... 8369
374 ... 8370, 8776, 8932
376 ... 8370, 8932
379 ... 8371, 8776
399 ... 8776

15 CFR—Continued

Page

1000 ... 9502, 9506
1050 ... 9508

16 CFR

0 ... 9508
1 ... 9293
2 ... 9008
3 ... 9008
4 ... 9009
13 ... 8292, 8665
424 ... 8777
500 ... 9625

PROPOSED RULES:

240 ... 9260

17 CFR

201 ... 8933, 9863
230 ... 8935, 9626
231 ... 8238
240 ... 8935
241 ... 8238
249 ... 8239
270 ... 8729, 9627
271 ... 8729, 9130, 9627

PROPOSED RULES:

210 ... 9668
240 ... 9260
249 ... 9261, 9668
270 ... 8319, 9134
274 ... 8319, 8525, 9134, 9261, 9668

18 CFR

Ch. I ... 9242
101 ... 8240
104 ... 8240
141 ... 8240
201 ... 8240
204 ... 8240
260 ... 8240
601 ... 8666
602 ... 9509
615 ... 8563

PROPOSED RULES:

201 ... 9570
204 ... 9570
205 ... 9570
260 ... 9570
640 ... 8739

19 CFR

1 ... 8666
12 ... 8667
16 ... 8365
153 ... 9009, 9010
174 ... 8731

PROPOSED RULES:

10 ... 8312
22 ... 9071

20 CFR

1 ... 8936
2 ... 8936
404 ... 8366

PROPOSED RULES:

405 ... 8960
602 ... 8524

21 CFR

1 ... 9444
3 ... 8939
25 ... 9010
121 ... 9627, 9628
132 ... 8242

21 CFR—Continued

	Page
135b	9445
135c	8732
135e	8781, 9511, 9629
135g	8781, 9629
141a	9244
146a	9244, 9512, 9629
146c	9512
146d	9512
148b	8242
149y	8243
420	8243, 8441, 9630
PROPOSED RULES:	
Ch. I	8738
121	9025
144	9564
147	9446
308	9563
420	8455

22 CFR

51	9068

23 CFR

1	8243

24 CFR

1	8784
7	8942
41	8785
42	8785
Ch. II	9864
203	9768
213	8211
220	8211
221	8211
231	8212
232	8212
234	8212
235	8212
242	8212
810	8212
1000	8212
1100	8212
Ch. III	8213, 9769
1914	8233, 8565, 8877, 9246, 9631
1915	8234, 8366, 8566, 8878, 8942, 9247, 9632
PROPOSED RULES:	
1665	9667
1913	8453
1930	9315
1931	9316
1932	9318
1933	9319
1934	9325

25 CFR

41	8366
PROPOSED RULES:	
161	8520
221	8677

26 CFR

1	9010, 9018, 9393, 9512, 9770
13	9010
31	9020, 9201
170	8668
201	8568
245	8798, 9294
252	8568
301	9020

26 CFR—Continued

	Page
PROPOSED RULES:	
1	8585, 8808, 9024, 9138, 9142, 9298, 9561, 9637, 9781
13	9298

28 CFR

PROPOSED RULES:	
50	9781

29 CFR

3	9770
4	9864
5	8949
20	9771
101	9132
102	9132
615	9294
505	9865
687	9771
697	9134
1504	9771
1516	9865
1518	8311, 9423
1601	9068
1910	10466
1950	8864
PROPOSED RULES:	
727	8960
1903	8376, 8591, 8813
1904	8693

30 CFR

77	9364
PROPOSED RULES:	
75	8453

31 CFR

10	8671
223	9630
316	9866
332	9512
342	9512
500	8584

32 CFR

190	9294
242	9423
243	9423
538	9423
591	8943
592	8947
593	8947
594	8947
597	8948
598	8948
599	8948
600	8948
602	8948
606	8948
812	8258
1001	8258
1007	8259
1030	8259

32A CFR

Ch. VII:	
T–2 (amended)	8672
Ch. VIII	9136, 9297
PROPOSED RULES:	
Ch. VI	9072, 9073
Ch. –	8587, 9784, 9871

33 CFR

	Page
1	8732
3	8211
40	9135
62	9021
74	9021
204	9774
207	8866
PROPOSED RULES:	
110	8962
117	8382, 9328–9330, 9447

35 CFR

253	9021

36 CFR

7	9248
326	8442
PROPOSED RULES:	
7	8585, 9251, 9446
50	8813

37 CFR

1	8732, 9774
202	8868

38 CFR

2	9248
3	8445
13	9249
17	9249
21	9021

39 CFR

3	8673
5	8673
124	8372
PROPOSED RULES:	
Ch. I	8879, 9564

41 CFR

5A–1	8953, 9512
5A–16	8953
5A–73	8374
5B–12	8510
8–1	9513
8–3	9513
8–7	9513
8–8	9514
8–11	9514
8–16	8953
14–1	9295
14–51	9295
15–1	8447
18–8	9868
50–204	9868
101–20	8295
101–26	8295
101–27	9514
101–38	8869
101–45	8567
101–47	9021, 9775
115–1	8568
PROPOSED RULES:	
3–1	8814
3–16	9253

42 CFR

37	8869
PROPOSED RULES:	
37	9874
72	8815

43 CFR

Page

PUBLIC LAND ORDERS:
2721 (revoked in part by PLO 5050) 8450
5024 (corrected by PLO 5051) 8450
5029 (corrected by PLO 5049) 8450
5032 (corrected by PLO 5057) 8450
5049 8450
5050 8450
5051 8807
5052 8949
5053 8949
5054 8949
5055 8950
5056 8950
5057 9022
5058 9135
5059 9136
5060 9136
5061

PROPOSED RULES:
1810 8956

45 CFR

119 8950
140 8952
142 9249

PROPOSED RULES:
116 8316
132 8316
903 8816
906 8525
1201 8698, 9469

46 CFR

309 8511
390 9779
542 8259

46 CFR—Continued

Page

PROPOSED RULES:
146 9598–9601
251 9333
252 9334, 9874
278 9335
503 8460
510 8460
543 8460, 9260

47 CFR

0 8450, 8733, 8871
2 9514
31 8374
33 8374
64 8450, 8733
73 8451, 9517–9519
74 8871, 9519
87 9514
89 9250
91 9514

PROPOSED RULES:
1 8382
2 8591
15 8963, 9567
73 8382, 8455, 8456, 8591, 8699, 9259, 9333, 9569
74 8382, 8457, 8591

49 CFR

1 8733
7 8873
25 9178
173 9068, 9520
177 9068
178 9520
195 8296
230 9069

49 CFR—Continued

Page

391 8452
392 8452
397 9779
571 8296, 8298, 8734, 9069, 9869
574 9780, 9869
1033 8306, 8673, 8674, 8952, 9870
1047 9022
1104 9022
1124 8211
1202 9070
1208 9070

PROPOSED RULES:
171 9449
172 9449, 9602
173 8329, 9449, 9520, 9602
178 9520, 9602
179 8329
192 9667
571 9565, 9666
Ch. X 8599, 8889
1115 8740
1123 8327

50 CFR

17 8675
28 8734
32 8942
33 8807
250 8874
266 8675
277 8675
280 8515

PROPOSED RULES:
10 8677
80 8261
258 9074
260 8688

LIST OF FEDERAL REGISTER PAGES AND DATES—MAY

Pages	*Date*
8203–8281	May 1
8283–8354	4
8355–8426	5
8427–8494	6
8495–8543	7
8545–8649	8
8651–8716	11
8717–8765	12
8767–8851	13
8853–8914	14
8915–8988	15
8989–9054	18
9055–9119	19
9121–9191	20
9193–9281	21
9283–9385	22
9387–9488	25
9489–9607	26
9609–9754	27
9755–9834	28
9835–10714	29

federal register

SATURDAY, MAY 29, 1971
WASHINGTON, D.C.
Volume 36 ■ Number 105

PART II

DEPARTMENT OF LABOR

■

Occupational Safety and Health Administration

■

Occupational Safety and Health Standards; National Concensus Standards and Established Federal Standards

Title 29—LABOR

Chapter XVII—Occupational Safety and Health Administration, Department of Labor

PART 1910—OCCUPATIONAL SAFETY AND HEALTH STANDARDS

National Consensus Standards and Established Federal Standards

Pursuant to authority in sections 6(a) and 8(g) of the Williams-Steiger Occupational Safety and Health Act of 1970 (84 Stat. 1593, 1600; 29 U.S.C. 655, 657), Chapter XVII of Title 29 of the Code of Federal Regulations, established on April 13, 1971 (36 F.R. 7006), is hereby amended by adding thereto a new Part 1910 to read as set forth below.

The provisions of 5 U.S.C. 553 concerning notice of proposed rulemaking, public participation therein, and delay in effective date are inapplicable by virtue of the exception to 5 U.S.C. Ch. 5, provided in section 6(a) of the Act.

The new Part 1910 contains occupational safety and health standards which are either national consensus standards or established Federal standards.

The national consensus standards are occupational safety and health standards adopted and promulgated either by the American National Standards Institute (ANSI) or by the National Fire Protection Association (NFPA) under procedures whereby it can be determined that persons interested and affected by the scope or provisions of the standards have reached substantial agreement on their adoption. I have determined that those standards have been adopted and promulgated under such procedures. Accordingly, pursuant to this determination, after consultation with other appropriate Federal agencies, and in accordance with section 3(9) of the Act, I do hereby designate as national consensus standards those standards in Part 1910 which are standards adopted and promulgated by either the American National Standards Institute or the National Fire Protection Association. The national consensus standards contain only mandatory provisions of the standards promulgated by those two organizations. The standards of ANSI and NFPA may also contain advisory provisions and recommendations the adoption of which by employers is encouraged, but they are not adopted in Part 1910.

The established Federal standards are operative occupational safety and health standards in effect on April 28, 1971, and established by the Department of Labor pursuant to section 107 of the Contract Work Hours and Safety Standards Act, as amended (40 U.S.C. 333); section 41 of the Longshoremen's and Harbor Workers' Compensation Act, as amended (33 U.S.C. 941); the Walsh-Healey Public Contracts Act, as amended (41 U.S.C. 35); the Service Contract Act of 1965 (41 U.S.C. 351); or pursuant to the National Foundation on the Arts and Humanities Act (20 U.S.C. 951). In any proceeding to enforce any such standard, brought under any of such statutes or under the Williams-Steiger Occupational Safety and Health Act of 1970, the principle of collateral estoppel will be followed.

The effective date of the national consensus standards is delayed for 90 days with respect to every employer and employment subject to the Williams-Steiger Occupational Safety and Health Act of 1970. The effective date of the established Federal standards is also delayed for 90 days, but only for employers and employments not subject to any of the statutes listed in the preceding paragraph. The purpose of the delay is to insure that affected employers and employees would be informed of the existence of the standards and of their terms, and to give such employers and employees an opportunity to familiarize themselves with the requirements of the standards before their application. The delay is also intended to afford a State a full opportunity to apply for an agreement under section 18(h) of the Act permitting it to continue to enforce one or more occupational safety and health standards in the State and to submit a plan under section 18(b) of the Act for the development and enforcement of State safety and health standards. However, for established Federal standards which correspond to occupational safety and health standards (1) promulgated under any of the statutes listed in the preceding paragraph and (2) applicable to any employer and any employment by virtue of any of such statutes, no delay in effective date is provided with respect to such employer and employment. In the case of employers and employments subject to standards issued under such statutes, familiarity already exists.

An additional delay in effective date until February 15, 1972, is provided and codified in the new Part 1910 in sections within Subparts G, H, I, L, N, O, P, R, and S in situations where additional time is considered necessary to adjust to the new standards.

Effective date. The occupational safety and health standards in new Part 1910 shall become effective on August 27, 1971, except: (1) Where additional delays in effective date are specifically provided, and (2) with respect to any employment and place of employment which, on a date before August 27, 1971, is or becomes subject to any safety and health standard prescribed in 29 CFR Parts 505, 1501, 1502, 1503, 1504, 1516, or 1518, or in 41 CFR Part 50–204, any corresponding occupational safety and health standard in Subpart B of this Part 1910, or in Subpart D through S which are from 41 CFR 50–204, shall also become effective, and shall be applicable to such employment and place of employment, on such earlier date. For example, whenever a standard promulgated under the Contract Work Hours and Safety Standards Act and contained in 29 CFR Part 1518 is applicable to an employment and places of employment by virtue of the performance of a construction contract on a date before August 27, 1971, the corresponding standard prescribed by § 1910.12 of new Part 1910 shall also become effective on the same date with respect to such employment and places of employment. However, this effective date provision shall not be deemed to relieve any employer of any duty under section 5(a)(1) of the Act to furnish to each of his employees employment and a place of employment which are free from recognized hazards that are causing or likely to cause death or serious physical harm to his employees, or to relieve the Secretary of Labor of his responsibilities and authority under section 13 of the Act to initiate enforcement proceedings to counteract imminent dangers, where any employer breaches such duty under section 5(a)(1).

The new Part 1910 is set forth below.

Signed at Washington, D.C., this 27th day of April, 1971.

J. D. HODGSON,
Secretary of Labor.

PART 1910—OCCUPATIONAL SAFETY AND HEALTH STANDARDS

Subpart A—General

Sec.
1910.1 Purpose and scope.
1910.2 Definitions.
1910.3 Petitions for the issuance, amendment, or repeal of a standard.
1910.4 Amendments to this part.
1910.5 Applicability of standards.
1910.6 Incorporation by reference.

Subpart B—Adoption and Extension of Established Federal Standards

1910.11 Scope and purpose.
1910.12 Construction work.
1910.13 Ship repairing.
1910.14 Shipbuilding.
1910.15 Shipbreaking.
1910.16 Longshoring.

Subpart C—[Reserved]

Subpart D—Walking—Working Surfaces

1910.21 Definitions.
1910.22 General requirements.
1910.23 Guarding floor and wall openings and holes.
1910.24 Fixed industrial stairs.
1910.25 Portable wood ladders.
1910.26 Portable metal ladders.
1910.27 Fixed ladders.
1910.28 Safety requirements for scaffolding.
1910.29 Manually propelled mobile ladder stands and scaffolds (towers).
1910.30 Other working surfaces.
1910.31 Sources of standards.
1910.32 Standards organizations.

Subpart E—Means of Egress

1910.35 Definitions.
1910.36 General requirements.
1910.37 Means of egress, general.
1910.38 Specific means of egress requirements by occupancy.
1910.39 Sources of standards.
1910.40 Standards organizations.

Subpart F—Powered Platforms, Manlifts and Vehicle-Mounted Work Platforms

1910.66 Power platforms for exterior building maintenance.
1910.67 Vehicle-mounted elevating and rotating work platforms.
1910.68 Manlifts.
1910.69 Sources of standards.
1910.70 Standards organizations.

Subpart G—Occupational Health and Environmental Control

Sec.
1910.93 Air contaminants.
1910.94 Ventilation.
1910.95 Occupational noise exposure.
1910.96 Ionizing radiation.
1910.97 Nonionizing radiation.
1910.98 Additional delay in effective date.
1910.99 Sources of standards.
1910.100 Standards organizations.

Subpart H—Hazardous Materials

1910.101 Compressed gases—general requirements.
1910.102 Acetylene.
1910.103 Hydrogen.
1910.104 Oxygen.
1910.105 Nitrous oxide.
1910.106 Flammable and combustible liquids.
1910.107 Spray finishing using flammable and combustible materials.
1910.108 Dip tanks containing flammable or combustible liquids.
1910.109 Explosives and blasting agents.
1910.110 Storage and handling of liquified petroleum gases.
1910.111 Storage and handling of anhydrous ammonia.
1910.112 [Reserved]
1910.113 [Reserved]
1910.114 Additional delay in effective date.
1910.115 Sources of standards.
1910.116 Standards organizations.

Subpart I—Personal Protective Equipment

1910.132 General requirements.
1910.133 Eye and face protection.
1910.134 Respiratory protection.
1910.135 Occupational head protection.
1910.136 Occupational foot protection.
1910.137 Electrical protective devices.
1910.138 Additional delay in effective date.
1910.139 Sources of standards.
1910.140 Standards organizations.

Subpart J—General Environmental Controls

1910.141 Sanitation.
1910.142 Temporary labor camps.
1910.143 Nonwater carriage disposal systems.
1910.144 Safety color code for marking physical hazards.
1910.145 Specifications for accident prevention signs and tags.
1910.146 [Reserved]
1910.147 Sources of standards.
1910.148 Standards organizations.

Subpart K—Medical and First Aid

1910.151 Medical services and first aid.
1910.152 [Reserved]
1910.153 Sources of standards.

Subpart L—Fire Protection

1910.156 Definitions applicable to this subpart.

Portable Fire Suppression Equipment

1910.157 Portable fire extinguishers.
1910.158 Standpipe and hose systems.

Fixed Fire Suppression Equipment

1910.159 Automatic sprinkler systems.
1910.160 Fixed dry chemical extinguishing systems.
1910.161 Carbon dioxide extinguishing systems.
1910.162 [Reserved]

Other Fire Protection Systems

1910.163 Local fire alarm signaling systems.
1910.164 [Reserved]
1910.165 Additional delay in effective date.
1910.165a Sources of standards.
1910.165b Standards organizations.

Subpart M—Compressed Gas and Compressed Air Equipment

1910.166 Inspection of compressed gas cylinders.
1910.167 Safety relief devices for compressed gas cylinders.
1910.168 Safety relief devices for cargo and portable tanks storing compressed gases.
1910.169 Air receivers.
1910.170 Sources of standards.
1910.171 Standards organizations.

Subpart N—Materials Handling and Storage

1910.176 Handling materials—general.
1910.177 Indoor general storage.
1910.178 Powered industrial trucks.
1910.179 Overhead and gantry cranes.
1910.180 Crawler, locomotive, and truck cranes.
1910.181 Derricks.
1910.182 Additional delay in effective date.
1910.183 Sources of standards.
1910.184 Standards organizations.

Subpart O—Machinery and Machine Guarding

1910.211 Definitions.
1910.212 General requirements for all machines.
1910.213 Woodworking machinery requirements.
1910.214 Cooperage machinery.
1910.215 Abrasive wheel machinery.
1910.216 Mills and calenders in the rubber and plastics industries.
1910.217 Mechanical power presses.
1910.218 Forging machines.
1910.219 Mechanical power-transmission apparatus.
1910.220 Additional delay in effective date.
1910.221 Sources of standards.
1910.222 Standards organizations.

Subpart P—Hand and Portable Powered Tools and Other Hand-Held Equipment

1910.241 Definitions.
1910.242 Hand and portable powered tools and equipment, general.
1910.243 Guarding of portable powered tools.
1910.244 Other portable tools and equipment.
1910.245 Additional delay in effective date.
1910.246 Sources of standards.
1910.247 Standards organizations.

Subpart Q—Welding, Cutting and Brazing

1910.251 Definitions.
1910.252 Welding, cutting and brazing.
1910.253 Sources of standards
1910.254 Standards organizations.

Subpart R—Special Industries

1910.261 Pulp, paper, and paperboard mills.
1910.262 Textiles.
1910.263 Bakery equipment.
1910.264 Laundry machinery and operations.
1910.265 Sawmills.
1910.266 Pulpwood logging.
1910.267 Agricultural operations.
1910.268 Sources of standards.
1910.269 Standards organizations.

Subpart S—Electrical

1910.308 Application (NFPA 70–1968 Article 90).
1910.309 National Electrical Code NFPA 70–1968.
1910.310 General (NFPA 70–1968 Article 110).
1910.311 [Reserved]
1910.312 Overcurrent protection (NFPA 70–1968 Article 240).
1910.313 [Reserved]
1910.314 Grounding (NFPA 70–1968 Article 250).
1910.315 Outlets, switch, and junction boxes, and fittings (NFPA 70–1968 Article 370).
1910.316 Flexible cords and cables (NFPA 70–1968 Article 400).
1910.317 [Reserved]
1910.318 Transformers (NFPA 70–1968 Article 450).
1910.319 [Reserved]
1910.320 Appliances (NFPA 70–1968 Article 422).
1910.321 [Reserved]
1910.322 Hazardous locations, general (NFPA 70–1968 Article 500).
1910.323 [Reserved]
1910.324 Hazardous locations, Class I installations (NFPA 70–1968 Article 501).
1910.325 [Reserved]
1910.326 Hazardous locations, Class II installations (NFPA 70–1968 Article 502).
1910.327 [Reserved]
1910.328 Hazardous locations, Class III installations (NFPA 70–1968 Article 503).
1910.329 Additional delay in effective date.
1910.330 Sources of standards.
1910.331 Standards organizations.

AUTHORITY: The provisions of this Part 1910 issued under secs. 6(a), 8(g), 84 Stat. 1593, 1598; 29 U.S.C. 655, 657.

Subpart A—General

§ 1910.1 Purpose and scope.

(a) Section 6(a) of the Williams-Steiger Occupational Safety and Health Act of 1970 (84 Stat. 1593) provides that "without regard to chapter 5 of title 5, United States Code, or to the other subsections of this section, the Secretary shall, as soon as practicable during the period beginning with the effective date of this Act and ending 2 years after such date, by rule promulgate as an occupational safety or health standard any national consensus standard, and any established Federal standard, unless he determines that the promulgation of such a standard would not result in improved safety or health for specifically designated employees." The legislative purpose of this provision is to establish, as rapidly as possible and without regard to the rule-making provisions of the Administrative Procedure Act, standards with which industries are generally familiar, and on whose adoption interested and affected persons have already had an opportunity to express their views. Such standards are either (1) national concensus standards on whose adoption affected persons have reached substantial agreement, or (2) Federal standards already established by Federal statutes or regulations.

(b) This part carries out the directive to the Secretary of Labor under section 6(a) of the Act. It contains occupational safety and health standards which have been found to be national consensus standards or established Federal standards.

§ 1910.2 Definitions.

As used in this part, unless the context clearly requires otherwise:

(a) "Act" means the Williams-Steiger Occupational Safety and Health Act of 1970 (84 Stat. 1590).

(b) "Assistant Secretary of Labor" means the Assistant Secretary of Labor for Occupational Safety and Health;

(c) "Employer" means a person engaged in a business affecting commerce who has employees, but does not include the United States or any State or political subdivision of a State;

(d) "Employee" means an employee of an employer who is employed in a business of his employer which affects commerce;

(e) "Commerce" means trade, traffic, commerce, transportation, or communication among the several States, or between a State and any place outside thereof, or within the District of Columbia, or a possession of the United States (other than the Trust Territory of the Pacific Islands), or between points in the same State but through a point outside thereof;

(f) "Standard" means a standard which requires conditions, or the adoption or use of one or more practices, means, methods, operations, or processes, reasonably necessary or appropriate to provide safe or healthful employment and places of employment;

(g) "National consensus standard" means any standard or modification thereof which (1) has been adopted and promulgated by a nationally recognized standards-producing organization under procedures whereby it can be determined by the Secretary of Labor or by the Assistant Secretary of Labor that persons interested and affected by the scope or provisions of the standard have reached substantial agreement on its adoption, (2) was formulated in a manner which afforded an opportunity for diverse views to be considered, and (3) has been designated as such a standard by the Secretary or the Assistant Secretary, after consultation with other appropriate Federal agencies; and

(h) "Established Federal standard" means any operative standard established by any agency of the United States and in effect on April 28, 1971, or contained in any Act of Congress in force on the date of enactment of the Williams-Steiger Occupational Safety and Health Act.

§ 1910.3 Petitions for the issuance, amendment, or repeal of a standard.

(a) Any interested person may petition in writing the Assistant Secretary of Labor to promulgate, modify, or revoke a standard. The petition should set forth the terms or the substance of the rule desired, the effects thereof if promulgated, and the reasons therefor.

(b) (1) The relevant legislative history of the Act indicates congressional recognition of the American National Standards Institute and the National Fire Protection Association as the major sources of national consensus standards. National consensus standards adopted on May 29, 1971, pursuant to section 6(a) of the Act are from those two sources. However, any organization which deems itself a producer of national consensus standards, within the meaning of section 3(9) of the Act, is invited to submit in writing to the Assistant Secretary of Labor at any time prior to February 1, 1973, all relevant information which may enable the Assistant Secretary to determine whether any of its standards satisfy the requirements of the definition of "national consensus standard" in section 3(9) of the Act.

(2) Within a reasonable time after the receipt of a submission pursuant to subparagraph (1) of this paragraph, the Assistant Secretary of Labor shall publish or cause to be published in the FEDERAL REGISTER a notice of such submission, and shall afford interested persons a reasonable opportunity to present written data, views, or arguments with regard to the question whether any standards of the organization making the submission are national consensus standards.

§ 1910.4 Amendments to this part.

(a) The Assistant Secretary of Labor shall have all of the authority of the Secretary of Labor under §§ 3(9) and 6(a) of the Act.

(b) The Assistant Secretary of Labor may at any time before April 28, 1973, on his own motion or upon the written petition of any person, by rule promulgate as a standard any national consensus standard and any established Federal standard, pursuant to and in accordance with section 6(a) of the Act, and, in addition, may modify or revoke any standard in this Part 1910. In the event of conflict among any such standards, the Assistant Secretary of Labor shall take the action necessary to eliminate the conflict, including the revocation or modification of a standard in this part, so as to assure the greatest protection of the safety or health of the affected employees.

§ 1910.5 Applicability of standards.

(a) Except as provided in paragraph (b) of this section, the standards contained in this part shall apply with respect to employments performed in a workplace in a State, the District of Columbia, the Commonwealth of Puerto Rico, the Virgin Islands, American Samoa, Guam, Trust Territory of the Pacific Islands, Wake Island, Outer Continental Shelf lands defined in the Outer Continental Shelf Lands Act, Johnston Island, and the Canal Zone.

(b) None of the standards in this part shall apply to working conditions of employees with respect to which Federal agencies other than the Department of Labor, or State agencies acting under section 274 of the Atomic Energy Act of 1954, as amended (42 U.S.C. 2021), exercise statutory authority to prescribe or enforce standards or regulations affecting occupational safety or health.

(c) (1) If a particular standard is specifically applicable to a condition, practice, means, method, operation, or process, it shall prevail over any different general standard which might otherwise be applicable to the same condition, practice, means, method, operation, or process. For example, § 1501.23(c)(3) of this title prescribes personal protective equipment for certain ship repairmen working in specified areas. Such a standard shall apply, and shall not be deemed modified nor superseded by any different general standard whose provisions might otherwise be applicable, to the ship repairmen working in the areas specified in § 1501.23(c)(3).

(2) On the other hand, any standard shall apply according to its terms to any employment and place of employment in any industry, even though particular standards are also prescribed for the industry, as in Subpart B or Subpart R of this part, to the extent that none of such particular standards applies. To illustrate, the general standard regarding noise exposure in § 1910.265.

(d) In the event a standard protects on its face a class of persons larger than employees, the standard shall be applicable under this part only to employees and their employment and places of employment.

(e) Whenever the source of a standard prescribed in this Part 1910 is indicated to be an established Federal standard published in 41 CFR Part 50–204, the standard so prescribed is applicable only to plants, factories, buildings, or other places of employment where materials, supplies, articles, or equipment are manufactured or furnished. That is, the standard is intended to apply to manufacturing or supply operations which would be subject to the Walsh-Healey Public Contracts Act if there were a Federal contract (41 U.S.C. 35–45) for the procurement of the materials, supplies, articles, or equipment involved.

(f) An employer who is in compliance with any standard in this part shall be deemed to be in compliance with the requirement of section 5(a)(1) of the Act, but only to the extent of the condition, practice, means, method, operation, or process covered by the standard.

§ 1910.6 Incorporation by reference.

(a) The standards of agencies of the U.S. Government and organizations which are not agencies of the U.S. Government which are legally incorporated by reference in this part, have the same force and effect as other standards in this part.

(b) Copies of the standards which are incorporated by reference may be examined at the national office of the Occupational Safety and Health Administration, U.S. Department of Labor, Washington, D.C. 20210, or at any of its regional offices. Copies of such private standards may be obtained from the issuing organizations. Their names and addresses are listed in the pertinent subparts of this part.

(c) Any changes in the standards incorporated by reference in this part and an official historic file of such changes are available for inspection at the national office of the Occupational Safety and Health Administration, U.S. Department of Labor, Washington, D.C. 20210.

Subpart B—Adoption and Extension of Established Federal Standards

§ 1910.11 Scope and purpose.

The provisions of this Subpart B adopt, and extend the applicability of, established Federal standards in effect on

April 28, 1971, with respect to every employer, employee, and employment covered by the Act.

§ 1910.12 Construction work.

(a) *Adoption and extension of established safety and health standards for construction.* The standards prescribed by Part 1518 of this title and in effect on April 28, 1971, are adopted as occupational safety or health standards under section 6(a) of the Act and shall apply, according to the provisions thereof, to every employment and place of employment of every employee engaged in construction work. Each employer shall protect the employment and places of employment of each of his employees engaged in construction work by complying with the appropriate standards prescribed by this paragraph.

(b) *Definition.* For purposes of this section, "construction work" means work for construction, alteration, and/or repair, including painting and decorating. See discussion of these terms in § 1518.13 of this title.

§ 1910.13 Ship repairing.

(a) *Adoption and extension of established safety and health standards for ship repairing.* The standards prescribed by Part 1501 of this title and in effect on April 28, 1971, are adopted as occupational safety or health standards under section 6(a) of the Act and shall apply, according to the provisions thereof, to every employment and place of employment of every employee engaged in ship repair or a related employment. Each employer shall protect the employment and places of employment of each of his employees engaged in ship repair or a related employment, by complying with the appropriate standards prescribed by this paragraph.

(b) *Definitions.* For purposes of this section:

(1) "Ship repair means any repair of a vessel, including, but not restricted to, alterations, conversions, installations, cleaning, painting, and maintenance work;

(2) "Related employment" means any employment performed as an incident to, or in conjunction with, ship repair work, including, but not restricted to, inspection, testing, and employment as a watchman; and

(3) "Vessel" includes every description of watercraft or other artificial contrivance used, or capable of being used, as a means of transportation on water, including special purpose floating structures not primarily designed for, or used as a means of, transportation on water.

§ 1910.14 Shipbuilding.

(a) *Adoption and extension of established safety and health standards for shipbuilding.* The standards prescribed by Part 1502 of this title and in effect on April 28, 1971, are adopted as occupational safety or health standards under section 6(a) of the Act and shall apply, according to the provisions thereof, to every employment and place of employment of every employee engaged in shipbuilding or a related employment. Each employer shall protect the employment and places of employment of each of his employees engaged in shipbuilding or a related employment, by complying with the appropriate standards prescribed by this paragraph.

(b) *Definitions.* For purposes of this section:

(1) "Shipbuilding" means the construction of a vessel, including the installation of machinery and equipment;

(2) "Related employment" means any employment performed as an incident to, or in conjunction with, shipbuilding work, including, but not restricted to, inspection, testing trials, and employment as a watchman: and

(3) "Vessel" includes every description of watercraft or other artificial contrivance used, or capable of being used, as a means of transportation on water, including special purpose floating structures not primarily designed for, or used as a means of, transportation on water.

§ 1910.15 Shipbreaking.

(a) *Adoption and extension of established safety and health standards for shipbreaking.* The standards prescribed by Part 1503 of this title and in effect on April 28, 1971, are adopted as occupational safety or health standards under section 6(a) of the Act and shall apply, according to the provisions thereof, to every employment and place of employment of every employee engaged in shipbreaking or a related employment. Each employer shall protect the employment and places of employment of each of his employees engaged in shipbreaking or a related employment, by complying with the appropriate standards prescribed by this paragraph.

(b) *Definitions.* For purposes of this section:

(1) "Shipbreaking" means any breaking down of a vessel's structure for the purpose of scrapping the vessel, including the removal of gear, equipment, or any component part of a vessel;

(2) "Related employment" means any employment performed as an incident to, or in conjunction with, shipbreaking work, including, but not restricted to, inspection, survey, and employment as a watchman; and

(3) "Vessel" includes every description of watercraft or other artificial contrivance used, or capable of being used, as a means of transportation on water, including special purpose floating structures not primarily designed for, or used as a means of, transportation on water.

§ 1910.16 Longshoring.

(a) *Adoption and extension of established safety and health standards for longshoring.* The standards prescribed by Part 1504 of this title and in effect on April 28, 1971, are adopted as occupational safety or health standards under section 6(a) of the Act and shall apply, according to the provisions thereof, to every employment and place of employment of every employee engaged in longshoring operations or a related employment. Each employer shall protect the employment and places of employment of each of his employees engaged in a longshoring operation or a related employment, by complying with the appropriate standards prescribed by this paragraph.

(b) *Definitions.* For purposes of this section:

(1) "Longshoring operation" means the loading, unloading, moving, or handling of, cargo, ship's stores, gear, etc., into, in, on, or out of any vessel;

(2) "Related employment" means any employment performed as an incident to or in conjunction with, longshoring operations including, but not restricted to, securing cargo, rigging, and employment as a porter, checker, or watchman; and

(3) "Vessel" includes every description of watercraft or other artificial contrivance used, or capable of being used, as a means of transportation on water, including special purpose floating structures not primarily designed for, or used as a means of, transportation on water.

Subpart C—[Reserved]

Subpart D—Walking-Working Surfaces

§ 1910.21 Definitions.

(a) As used in § 1910.23, unless the context requires otherwise, floor and wall opening, railing and toe board terms shall have the meanings ascribed in this paragraph.

(1) *Floor hole.* An opening measuring less than 12 inches but more than 1 inch in its least dimension, in any floor, platform, pavement, or yard, through which materials but not persons may fall; such as a belt hole, pipe opening, or slot opening.

(2) *Floor opening.* An opening measuring 12 inches or more in its least dimension, in any floor, platform, pavement, or yard, through which persons may fall; such as a hatchway, stair or ladder opening, pit, or large manhole. Floor openings occupied by elevators, dumb waiters, conveyors, machinery, or containers are excluded from this subpart.

(3) *Handrail.* A single bar or pipe supported on brackets from a wall or partition, as on a stairway or ramp, to furnish persons with a handhold in case of tripping.

(4) *Platform.* A working space for persons, elevated above the surrounding floor or ground; such as a balcony or platform for the operation of machinery and equipment.

(5) *Runway.* A passageway for persons, elevated above the surrounding floor or ground level, such as a footwalk along shafting or a walkway between buildings.

(6) *Standard railing.* A vertical barrier erected along exposed edges of a floor opening, wall opening, ramp, platform, or runway to prevent falls of persons.

(7) *Standard strength and construction.* Any construction of railings, covers, or other guards that meets the requirements of § 1910.23.

(8) *Stair railing.* A vertical barrier erected along exposed sides of a stairway to prevent falls of persons.

(9) *Toeboard.* A vertical barrier at floor level erected along exposed edges of a floor opening, wall opening, platform, runway, or ramp to prevent falls of materials.

(10) *Wall hole.* An opening less than 30 inches but more than 1 inch high, of unrestricted width, in any wall or partition; such as a ventilation hole or drainage scupper.

(11) *Wall opening.* An opening at least 30 inches high and 18 inches wide, in any wall or partition, through which persons may fall; such as a yard-arm doorway or chute opening.

(b) As used in § 1910.24, unless the context requires otherwise, fixed industrial stair terms shall have the meaning ascribed in this paragraph.

(1) *Handrail.* A single bar or pipe supported on brackets from a wall or partition to provide a continuous handhold for persons using a stair.

(2) *Nose, nosing.* That portion of a tread projecting beyond the face of the riser immediately below.

(3) *Open riser.* The air space between the treads of stairways without upright members (risers).

(4) *Platform.* An extended step or landing breaking a continuous run of stairs.

(5) *Railing.* A vertical barrier erected along exposed sides of stairways and platforms to prevent falls of persons. The top member of railing usually serves as a handrail.

(6) *Rise.* The vertical distance from the top of a tread to the top of the next higher tread.

(7) *Riser.* The upright member of a step situated at the back of a lower tread and near the leading edge of the next higher tread.

(8) *Stairs, stairway.* A series of steps leading from one level or floor to another, or leading to platforms, pits, boiler rooms, crossovers, or around machinery, tanks, and other equipment that are used more or less continuously or routinely by employees, or only occasionally by specific individuals. A series of steps and landings having three or more risers constitutes stairs or stairway.

(9) *Tread.* The horizontal member of a step.

(10) *Tread run.* The horizontal distance from the leading edge of a tread to the leading edge of an adjacent tread.

(11) *Tread width.* The horizontal distance from front to back of tread including nosing when used.

(c) As used in § 1910.25, unless the context requires otherwise, portable wood ladders terms shall have the meanings ascribed in this paragraph.

(1) *Ladders.* A ladder is an appliance usually consisting of two slide rails joined at regular intervals by crosspieces called steps, rungs, or cleats, on which a person may step in ascending or descending.

(2) *Stepladder.* A stepladder is a self-supporting portable ladder, nonadjustable in length, having flat steps and a hinged back. Its size is designated by the overall length of the ladder measured along the front edge of the side rails.

(3) *Single ladder.* A single ladder is a non-self-supporting portable ladder, nonadjustable in length, consisting of but one section. Its size is designated by the overall length of the side rail.

(4) *Extension ladder.* An extension ladder is a non-self-supporting portable ladder adjustable in length. It consists of two or more sections traveling in guides or brackets so arranged as to permit length adjustment. Its size is designated by the sum of the lengths of the sections measured along the side rails.

(5) *Sectional ladder.* A sectional ladder is a non-self-supporting portable ladder, nonadjustable in length consisting of two or more sections of ladder so constructed that the sections may be combined to function as a single ladder. Its size is designated by the overall length of the assembled sections.

(6) *Trestle ladder.* A trestle ladder is a self-supporting portable ladder, nonadjustable in length, consisting of two sections hinged at the top to form equal angles with the base. The size is designated by the length of the side rails measured along the front edge.

(7) *Extension trestle ladder.* An extension trestle ladder is a self-supporting portable ladder, adjustable in length, consisting of a trestle ladder base and a vertically adjustable single ladder, with suitable means for locking the ladders together. The size is designated by the length of the trestle ladder base.

(8) *Special-purpose ladder.* A special-purpose ladder is a portable ladder which represents either a modification or a combination of design or construction features in one of the general-purpose types of ladders previously defined, in order to adapt the ladder to special or specific uses.

(9) *Trolley ladder.* A trolley ladder is a semifixed ladder, nonadjustable in length, supported by attachments to an overhead track, the plane of the ladder being at right angles to the plane of motion.

(10) *Side-rolling ladder.* A side-rolling ladder is a semifixed ladder, nonadjustable in length, supported by attachments to a guide rail, which is generally fastened to shelving, the plane of the ladder being also its plane of motion.

(11) *Wood characteristics.* Wood characteristics are distinguishing features which by their extent and number determine the quality of a piece of wood.

(12) *Wood irregularities.* Wood irregularities are natural characteristics in or on wood that may lower its durability, strength, or utility.

(13) *Cross grain.* Cross grain (slope of grain) is a deviation of the fiber direction from a line parallel to the sides of the piece.

(14) *Knot.* A knot is a branch or limb, imbedded in the tree and cut through in the process of lumber manufacture, classified according to size, quality, and occurrence. The size of the knot is determined as the average diameter on the surface of the piece.

(15) *Pitch and bark pockets.* A pitch pocket is an opening extending parallel to the annual growth rings containing, or that has contained, pitch, either solid or liquid. A bark pocket is an opening between annual growth rings that contains bark.

(16) *Shake.* A shake is a separation along the grain, most of which occurs between the rings of annual growth.

(17) *Check.* A check is a lengthwise separation of the wood, most of which occurs across the rings of annual growth.

(18) *Wane.* Wane is bark, or the lack of wood from any cause, on the corner of a piece.

(19) *Decay.* Decay is disintegration of wood substance due to action of wood-destroying fungi. It is also known as dote and rot.

(20) *Compression failure.* A compression failure is a deformation (buckling) of the fibers due to excessive compression along the grain.

(21) *Compression wood.* Compression wood is an aberrant (abnormal) and highly variable type of wood structure occurring in softwood species. The wood commonly has density somewhat higher than does normal wood, but somewhat lower stiffness and tensile strength for its weight in addition to high longitudinal shrinkage.

(22) *Low density.* Low-density wood is that which is exceptionally light in weight and usually deficient in strength properties for the species.

(d) As used in § 1910.26, unless the context requires otherwise, portable metal ladder terms shall have the meanings ascribed in this paragraph.

(1) *Ladder.* A ladder is an appliance usually consisting of two side rails joined at regular intervals by crosspieces called steps, rungs, or cleats, on which a person may step in ascending or descending.

(2) *Step ladder.* A step ladder is a self-supporting portable ladder, nonadjustable in length, having flat steps and a hinged back. Its size is designated by the overall length of the ladder measured along the front edge of the side rails.

(3) *Single ladder.* A single ladder is a non-self-supporting portable ladder, nonadjustable in length, consisting of but one section. Its size is designated by the overall length of the side rail.

(4) *Extension ladder.* An extension ladder is a non-self-supporting portable ladder adjustable in length. It consists of two or more sections traveling in guides or brackets so arranged as to permit length adjustment. Its size is designated by the sum of the lengths of the sections measured along the side rails.

(5) *Platform ladder.* A self-supporting ladder of fixed size with a platform provided at the working level. The size is determined by the distance along the front rail from the platform to the base of the ladder.

(6) *Sectional ladder.* A sectional ladder is a non-self-supporting ladder, nonadjustable in length, consisting of two or more sections so constructed that the sections may be combined to function as a single ladder. Its size is designated by the overall length of the assembled sections.

(7) *Trestle ladder.* A trestle ladder is a self-supporting portable ladder, nonadjustable in length, consisting of two sections, hinged at the top to form equal angles with the base. The size is designated by the length of the side rails measured along the front edge.

(8) *Extension trestle ladder. An* extension trestle ladder is a self-supporting portable ladder, adjustable in length, consisting of a trestle ladder base and a vertically adjustable single ladder, with suitable means for locking the ladders together. The size is designated by the length of the trestle ladder base.

(9) *Special-purpose ladder.* A special-purpose ladder is a portable ladder which represents either a modification or a combination of design or construction features in one of the general-purpose type of ladders previously defined, in order to adapt the ladder to special or specific uses.

(e) As used in § 1910.27, unless the context requires otherwise, fixed ladder terms shall have the meanings ascribed in this paragraph.

(1) *Ladder.* A ladder is an appliance usually consisting of two side rails joined at regular intervals by crosspieces called steps, rungs, or cleats, on which a person may step in ascending or descending.

(2) *Fixed ladder.* A fixed ladder is a ladder permanently attached to a structure, building, or equipment.

(3) *Individual-rung ladder.* An individual-rung ladder is a fixed ladder each rung of which is individually attached to a structure, building, or equipment.

(4) *Rail ladder.* A rail ladder is a fixed ladder consisting of side rails joined at regular intervals by rungs or cleats and fastened in full length or in sections to a building, structure, or equipment.

(5) *Railings.* A railing is any one or a combination of those railings constructed in accordance with § 1910.23. A standard railing is a vertical barrier erected along exposed edges of floor openings, wall openings, ramps, platforms, and runways to prevent falls of persons.

(6) *Pitch.* Pitch is the included angle between the horizonal and the ladder, measured on the opposite side of the ladder from the climbing side.

(7) *Fastenings.* A fastening is a device to attach a ladder to a structure, building, or equipment.

(8) *Rungs.* Rungs are ladder crosspieces of circular or oval cross-section on which a person may step in ascending or descending.

(9) *Cleats.* Cleats are ladder crosspieces of rectangular cross-section placed on edge on which a person may step in ascending or descending.

(10) *Steps.* Steps are the flat crosspieces of a ladder on which a person may step in ascending or descending.

(11) *Cage.* A cage is a guard that may be referred to as a cage or basket guard which is an enclosure that is fastened to the side rails of the fixed ladder or to the structure to encircle the climbing space of the ladder for the safety of the person who must climb the ladder.

(12) *Well.* A well is a permanent complete enclosure around a fixed ladder, which is attached to the walls of the well. Proper clearances for a well will give the person who must climb the ladder the same protection as a cage.

(13) *Ladder safety device.* A ladder safety device is any device, other than a cage or well, designed to eliminate or reduce the possibility of accidental falls and which may incorporate such features as life belts, friction brakes, and sliding attachments.

(14) *Grab bars.* Grab bars are individual handholds placed adjacent to or as an extension above ladders for the purpose of providing access beyond the limits of the ladder.

(15) *Through ladder.* A through ladder is one from which a man getting off at the top must step through the ladder in order to reach the landing.

(16) *Side-step ladder.* A side-step ladder is one from which a man getting off at the top must step sideways from the ladder in order to reach the landing.

As used in § 1910.28(f), unless the context requires otherwise, scaffolding terms shall have the meaning ascribed in this paragraph.

(1) *Bearer.* A horizontal member of a scaffold upon which the platform rests and which may be supported by ledgers.

(2) *Boatswain's chair.* A seat supported by slings attached to a suspended rope, designed to accommodate one workman in a sitting position.

(3) *Brace.* A tie that holds one scaffold member in a fixed position with respect to another member.

(4) *Bricklayers' square scaffold.* A scaffold composed of framed wood squares which support a platform limited to light and medium duty.

(5) *Carpenters' bracket scaffold.* A scaffold consisting of wood or metal brackets supporting a platform.

(6) *Coupler.* A device for locking together the component parts of a tubular metal scaffold. The material used for the couplers shall be of a structural type, such as a drop-forged steel, malleable iron, or structural grade aluminum. The use of gray cast iron is prohibited.

(7) *Crawling board or chicken ladder.* A plank with cleats spaced and secured at equal intervals, for use by a worker on roofs, not designed to carry any material.

(8) *Double pole or independent pole scaffold.* A scaffold supported from the base by a double row of uprights, independent of support from the walls and constructed of uprights, ledgers, horizontal platform bearers, and diagonal bracing.

(9) *Float or ship scaffold.* A scaffold hung from overhead supports by means of ropes and consisting of a substantial platform having diagonal bracing underneath, resting upon and securely fastened to two parallel plank bearers at right angles to the span.

(10) *Guardrail.* A rail secured to uprights and erected along the exposed sides and ends of platforms.

(11) *Heavy duty scaffold.* A scaffold designed and constructed to carry a working load not to exceed 75 pounds per square foot.

(12) *Horse scaffold.* A scaffold for light or medium duty, composed of horses supporting a work platform.

(13) *Interior hung scaffold.* A scaffold suspended from the ceiling or roof structure.

(14) *Ladder jack scaffold.* A light duty scaffold supported by brackets attached to ladders.

(15) *Ledger (stringer).* A horizontal scaffold member which extends from post to post and which supports the putlogs or bearer forming a tie between the posts.

(16) *Light duty scaffold.* A scaffold designed and constructed to carry a working load not to exceed 25 pounds per square foot.

(17) *Manually propelled mobile scaffold.* A portable rolling scaffold supported by casters.

(18) *Masons' adjustable multiple-point suspension scaffold.* A scaffold having a continuous platform supported by bearers suspended by wire rope from overhead supports, so arranged and operated as to permit the raising or lowering of the platform to desired working positions.

(19) *Maximum intended load.* The total of all loads including the working load, the weight of the scaffold, and such other loads as may be reasonably anticipated.

(20) *Medium duty scaffold.* A scaffold designed and constructed to carry a working load not to exceed 50 pounds per square foot.

(21) *Mid-rail.* A rail approximately midway between the guardrail and platform, used when required, and secured to the uprights erected along the exposed sides and ends of platforms.

(22) *Needle beam scaffold.* A light duty scaffold consisting of needle beams supporting a platform.

(23) *Outrigger scaffold.* A scaffold supported by outriggers or thrustouts projecting beyond the wall or face of the building or structure, the inboard ends of which are secured inside of such a building or structure.

(24) *Putlog.* A scaffold member upon which the platform rests.

(25) *Roofing bracket.* A bracket used in sloped roof construction, having provisions for fastening to the roof or supported by ropes fastened over the ridge and secured to some suitable object.

(26) *Runner.* The lengthwise horizontal bracing or bearing members or both.

(27) *Scaffold.* Any temporary elevated platform and its supporting structure used for supporting workmen or materials or both.

(28) *Single-point adjustable suspension scaffold.* A manually or power-operated unit designated for light duty use, supported by a single wire rope from an overhead support so arranged and

operated as to permit the raising or lowering of the platform to desired working positions.

(29) *Single pole scaffold.* Platforms resting on putlogs or crossbeams, the outside ends of which are supported on ledgers secured to a single row of posts or uprights and the inner ends of which are supported on or in a wall.

(30) *Stone setters' adjustable multiple-point suspension scaffold.* A swinging-type scaffold having a platform supported by hangers suspended at four points so as to permit the raising or lowering of the platform to the desired working position by the use of hoisting machines.

(31) *Toe board.* A barrier secured along the sides and ends of a platform, to guard against the falling of material.

(32) *Tube and coupler scaffold.* An assembly consisting of tubing which serves as posts, bearers, braces, ties, and runners, a base supporting the posts, and special couplers which serve to connect the uprights and to join the various members.

(33) *Tubular welded frame scaffold.* A sectional, panel, or frame metal scaffold substantially built up of prefabricated welded sections which consist of posts and horizontal bearer with intermediate members. Panels or frames shall be braced with diagonal or cross braces.

(34) *Two-point suspension scaffold (swinging scaffold).* A scaffold, the platform of which is supported by hangers (stirrups) at two points, suspended from overhead supports so as to permit the raising or lowering of the platform to the desired working position by tackle or hoisting machines.

(35) *Window jack scaffold.* A scaffold, the platform of which is supported by a bracket or jack which projects through a window opening.

(36) *Working load.* Load imposed by men, materials, and equipment.

(g) As used in § 1910.29, unless the context requires otherwise, manually propelled mobile ladder stand and scaffold (tower) terms shall have the meaning ascribed in this paragraph.

(1) *Bearer.* A horizontal member of a scaffold upon which the platform rests and which may be supported by ledgers.

(2) *Brace.* A tie that holds one scaffold member in a fixed position with respect to another member.

(3) *Climbing ladder.* A separate ladder with equally spaced rungs usually attached to the scaffold structure for climbing and descending.

(4) *Coupler.* A device for locking together the components of a tubular metal scaffold which shall be designed and used to safely support the maximum intended loads.

(5) *Design working load.* The maximum intended load, being the total of all loads including the weight of the men, materials, equipment, and platform.

(6) *Equivalent.* Alternative design or features, which will provide an equal degree or factor of safety.

(7) *Guardrail.* A barrier secured to uprights and erected along the exposed sides and ends of platforms to prevent falls of persons.

(8) *Handrail.* A rail connected to a ladder stand running parallel to the slope and/or top step.

(9) *Ladder stand.* A mobile fixed size self-supporting ladder consisting of a wide flat tread ladder in the form of stairs. The assembly may include handrails.

(10) *Ledger (stringer).* A horizontal scaffold member which extends from post to post and which support the bearer forming a tie between the posts.

(11) *Mobile scaffold (tower).* A light, medium, or heavy scaffold mounted on casters or wheels.

(12) *Mobile.* "Manually propelled."

(13) *Mobile work platform.* Generally a fixed work level one frame high on casters or wheels, with bracing diagonally from platform to vertical frame.

(14) *Runner.* The lengthwise horizontal bracing and/or bearing members.

(15) *Scaffold.* Any temporary elevated platform and its necessary vertical, diagonal, and horizontal members used for supporting workmen and materials. (Also known as a scaffold tower.)

(16) *Toe board.* A barrier at platform level erected along the exposed sides and ends of a scaffold platform to prevent falls of materials.

(17) *Tube and coupler scaffold.* An assembly consisting of tubing which serves as posts, bearers, braces, ties, and runners, a base supporting the posts, and uprights, and serves to join the various members, usually used in fixed locations.

(18) *Tubular welded frame scaffold.* A sectional, panel, or frame metal scaffold substantially built up of prefabricated welded sections, which consist of posts and bearers with intermediate connecting members and braced with diagonal or cross braces.

(19) *Tubular welded sectional folding scaffold.* A sectional, folding metal scaffold either of ladder frame or inside stairway design, substantially built of prefabricated welded sections, which consist of end frames, platform frame, inside inclined stairway frame and braces, or hinged connected diagonal and horizontal braces, capable of being folded into a flat package when the scaffold is not in use.

(20) *Work level.* The elevated platform, used for supporting workmen and their materials, comprising the necessary vertical, horizontal, and diagonal braces, guardrails, and ladder for access to the work platform.

§ 1910.22 General requirements.

This section applies to all permanent places of employment, except where domestic, mining, or agricultural work only is performed. Measures for the control of toxic materials are considered to be outside the scope of this section.

(a) *Housekeeping.* (1) All places of employment, passageways, storerooms, and service rooms shall be kept clean and orderly and in a sanitary condition.

(2) The floor of every workroom shall be maintained in a clean and, so far as possible, a dry condition. Where wet processes are used, drainage shall be maintained, and false floors, platforms, mats, or other dry standing places should be provided where practicable.

(3) To facilitate cleaning, every floor, working place, and passageway shall be kept free from protruding nails, splinters, holes, or loose boards.

(b) *Aisles and passageways.* (1) Where mechanical handling equipment is used, sufficient safe clearances shall be allowed for aisles, at loading docks, through doorways and wherever turns or passage must be made. Aisles and passageways shall be kept clear and in good repairs, with no obstruction across or in aisles that could create a hazard.

(2) Permanent aisles and passageways shall be appropriately marked.

(c) *Covers and guardrails.* Covers and/or guardrails shall be provided to protect personnel from the hazards of open pits, tanks, vats, ditches, etc.

(d) *Floor loading protection.* (1) In every building or other structure, or part thereof, used for mercantile, business, industrial, or storage purposes, the loads approved by the building official shall be marked on plates of approval design which shall be supplied and securely affixed by the owner of the building, or his duly authorized agent, in a conspicuous place in each space to which they relate. Such plates shall not be removed or defaced but, if lost, removed, or defaced, shall be replaced by the owner or his agent.

(2) It shall be unlawful to place, or cause, or permit to be placed, on any floor or roof of a building or other structure a load greater than that for which such floor or roof is approved by the building official.

§ 1910.23 Guarding floor and wall openings and holes.

(a) *Protection for floor openings.* (1) Every stairway floor opening shall be guarded by a standard railing constructed in accordance with paragraph (e) of this section. The railing shall be provided on all exposed sides (except at entrance to stairway). For infrequently used stairways where traffic across the opening prevents the use of fixed standard railing (as when located in aisle spaces, etc.), the guard shall consist of a hinged floor opening cover of standard strength and construction and removable standard railings on all exposed sides (except at entrance to stairway).

(2) Every ladderway floor opening or platform shall be guarded by a standard railing with standard toeboard on all exposed sides (except at entrance to opening), with the passage through the railing either provided with a swinging gate or so offset that a person cannot walk directly into the opening.

(3) Every hatchway and chute floor opening shall be guarded by one of the following:

(i) Hinged floor opening cover of standard strength and construction equipped with standard railings or permanently attached thereto so as to leave

only one exposed side. When the opening is not in use, the cover shall be closed or the exposed side shall be guarded at both top and intermediate positions by removable standard railings.

(ii) A removable railing with toeboard on not more than two sides of the opening and fixed standard railings with toeboards on all other exposed sides. The removable railings shall be kept in place when the opening is not in use and should preferably be hinged or otherwise mounted so as to be conveniently replaceable.

Where operating conditions necessitate the feeding of material into any hatchway or chute opening, protection shall be provided to prevent a person from falling through the opening.

(4) Every skylight floor opening and hole shall be guarded by a standard skylight screen or a fixed standard railing on all exposed sides.

(5) Every pit and trapdoor floor opening, infrequently used, shall be guarded by a floor opening cover of standard strength and construction which should be hinged in place. While the cover is not in place, the pit or trap opening shall be constantly attended by someone or shall be protected on all exposed sides by removable standard railings.

(6) Every manhole floor opening shall be guarded by a standard manhole cover which need not be hinged in place. While the cover is not in place, the manhole opening shall be constantly attended by someone or shall be protected by removable standard railings.

(7) Every temporary floor opening shall have standard railings, or shall be constantly attended by someone.

(8) Every floor hole into which persons can accidentally walk shall be guarded by either:

(i) A standard railing with standard toeboard on all exposed sides, or

(ii) A floor hole cover of standard strength and construction that should be hinged in place. While the cover is not in place, the floor hole shall be constantly attended by someone or shall be protected by a removable standard railing.

(9) Every floor hole into which persons cannot accidentally walk (on account of fixed machinery, equipment, or walls) shall be protected by a cover that leaves no openings more than 1 inch wide. The cover shall be securely held in place to prevent tools or materials from falling through.

(10) Where doors or gates open directly on a stairway, a platform shall be provided, and the swing of the door shall not reduce the effective width to less than 20 inches.

(b) *Protection for wall openings and holes.* (1) Every wall opening from which there is a drop of more than 4 feet shall be guarded by one of the following:

(i) Rail, roller, picket fence, half door, or equivalent barrier.

The guard may be removable but should preferably be hinged or otherwise mounted so as to be conveniently replaceable. Where there is exposure below to falling materials, a removable toe board or the equivalent shall also be provided. When the opening is not in use for handling materials, the guard shall be kept in position regardless of a door on the opening. In addition, a grab handle shall be provided on each side of the opening with its center approximately 4 feet above floor level and of standard strength and mounting.

(ii) Extension platform onto which materials can be hoisted for handling, and which shall have side rails or equivalent guards of standard specifications.

(2) Every chute wall opening from which there is a drop of more than 4 feet shall be guarded by one or more of the barriers specified in subparagraph (1) of this paragraph, or as required by the conditions.

(3) Every window wall opening at a stairway landing, floor, platform, or balcony, from which there is a drop of more than 4 feet, and where the bottom of the opening is less than 3 feet above the platform or landing, shall be guarded by standard slats, standard grill work (as specified in paragraph (e)(11) of this section), or standard railing.

Where the window opening is below the landing, or platform, a standard toe board shall be provided.

(4) Every temporary wall opening shall have adequate guards but these need not be of standard construction.

(5) Where there is a hazard of materials falling through a wall hole, and the lower edge of the near side of the hole is less than 4 inches above the floor, and the far side of the hole more than 5 feet above the next lower level, the hole shall be protected by a standard toeboard, or an enclosing screen either of solid construction, or as specified in paragraph (e)(11) of this section.

(c) *Protection of open-sided floors, platforms, and runways.* (1) Every open-sided floor or platform 4 feet or more above adjacent floor or ground level shall be guarded by a standard railing (or the equivalent as specified in paragraph (e)(3) of this section) on all open sides, except where there is entrance to a ramp, stairway, or fixed ladder. The railing shall be provided with a toeboard wherever, beneath the open sides,

(i) Persons can pass,

(ii) There is moving machinery, or

(iii) There is equipment with which falling materials could create a hazard.

(2) Every runway shall be guarded by a standard railing (or the equivalent as specified in paragraph (e)(3) of this section) on all open sides 4 feet or more above floor or ground level. Wherever tools, machine parts, or materials are likely to be used on the runway, a toeboard shall also be provided on each exposed side.

Runways used exclusively for special purposes (such as oiling, shafting, or filling tank cars) may have the railing on one side omitted where operating conditions necessitate such omission, providing the falling hazard is minimized by using a runway of not less than 18 inches wide. Where persons entering upon runways become thereby exposed to machinery, electrical equipment, or other danger not a falling hazard, additional guarding than is here specified may be essential for protection.

(3) Regardless of height, open-sided floors, walkways, platforms, or runways above or adjacent to dangerous equipment, pickling or galvanizing tanks, degreasing units, and similar hazards shall be guarded with a standard railing and toe board.

(d) *Stairway railings and guards.* (1) Every flight of stairs having four or more risers shall be equipped with standard stair railings or standard handrails as specified in subdivisions (i) through (v) of this subparagraph, the width of the stair to be measured clear of all obstructions except handrails:

(i) On stairways less than 44 inches wide having both sides enclosed, at least one handrail, preferably on the right side descending.

(ii) On stairways less than 44 inches wide having one side open, at least one stair railing on each side.

(iii) On stairways less than 44 inches wide having both sides open, one stair railing on each side.

(iv) On stairways more than 44 inches wide but less than 88 inches wide, one handrail on each enclosed side and one stair railing on each open side.

(v) On stairways 88 or more inches wide, one handrail on each enclosed side, one stair railing on each open side, and one intermediate stair railing located approximately midway of the width.

(2) Winding stairs shall be equipped with a handrail offset to prevent walking on all portions of the treads having width less than 6 inches.

(e) *Railing, toe boards, and cover specifications.* (1) A standards railing shall consist of top rail, intermediate rail, and posts, and shall have a vertical height of 42 inches nominal from upper surface of top rail to floor, platform, runway, or ramp level. The top rail shall be smooth-surfaced throughout the length of the railing. The intermediate rail shall be approximately halfway between the top rail and the floor, platform, runway, or ramp. The ends of the rails shall not overhang the terminal posts except wheres uch overhang does not constitute a projection hazard.

(2) A stair railing shall be of construction similar to a standard railing but the vertical height shall be not more than 34 inches nor less than 30 inches from upper surface of top rail to surface of tread in line with face of riser at forward edge of tread.

(3) Minimum requirements for standard railings under various types of construction are specified in the following subdivisions. Dimensions specified are based on the U.S. Department of Agriculture Wood Handbook, No. 72, 1955 (No. 1 [S4S] Southern Yellow Pine [Modulus of Rupture 7,400 p.s.i.]) for wood; ANSI G41.5–1970, American National Standard Specifications for Structural Steel, for structural steel; and ANSI B125.1–1970,

American National Standard Specifications for Welded and Steamless Steel Pipe, for pipe.

(i) For wood railing, the posts shall be of at least 2-inch by 4-inch stock spaced not to exceed 6 feet; the top and intermediate rails shall be of at least 2-inch by 4-inch stock. If top rail is made of two right-angle pieces of 1-inch by 4-inch stock, posts may be spaced on 8-foot centers, with 2-inch by 4-inch intermediate rail.

(ii) For pipe railings, posts and top and intermediate railings shall be at least 1½ inches nominal diameter with posts spaced not more than 8 feet on centers.

(iii) For structural steel railings, posts and top and intermediate rails shall be of 2-inch by 2-inch by ⅜-inch angles or other metal shapes of equivalent bending strength with posts spaced not more than 8 feet on centers.

(iv) The anchoring of posts and framing of members for railings of all types shall be of such construction that the completed structure shall be capable of withstanding a load of at least 200 pounds applied in any direction at any point on the top rail.

(v) Other types, sizes, and arrangements of railing construction are acceptable provided they meet the following conditions:

(*a*) A smooth-surfaced top rail at a height above floor, platform, runway, or ramp level of 42 inches nominal;

(*b*) A strength to withstand at least the minimum requirement of 200 pounds top rail pressure;

(*c*) Protection between top rail and floor, platform, runway, ramp, or stair treads, equivalent at least to that afforded by a standard intermediate rail;

(*d*) Elimination of overhang of rail ends unless such overhang does not constitute a hazard; such as, baluster railings, scrollwork railings, paneled railings.

(4) A standard toeboard shall be 4 inches nominal in vertical height from its top edge to the level of the floor, platform, runway, or ramp. It shall be securely fastened in place and with not more than ¼-inch clearance above floor level. It may be made of any substantial material either solid or with openings not over 1 inch in greatest dimension.

Where material is piled to such height that a standard toeboard does not provide protection, paneling from floor to intermediate rail, or to top rail shall be provided.

(5)(i) A handrail shall consist of a lengthwise member mounted directly on a wall or partition by means of brackets attached to the lower side of the handrail so as to offer no obstruction to a smooth surface along the top and both sides of the handrail. The handrail shall be of rounded or other section that will furnish an adequate handhold for anyone grasping it to avoid falling. The ends of the handrail should be turned in to the supporting wall or otherwise arranged so as not to constitute a projection hazard.

(ii) The height of handrails shall be not more than 34 inches nor less than 30 inches from upper surface of handrail to surface of tread in line with face of riser or to surface of ramp.

(iii) The size of handrails shall be: When of hardwood, at least 2 inches in diameter; when of metal pipe, at least 1½ inches in diameter. The length of brackets shall be such as will give a clearance between handrail and wall or any projection thereon of at least 3 inches. The spacing of brackets shall not exceed 8 feet.

(iv) The mounting of handrails shall be such that the completed structure is capable of withstanding a load of at least 200 pounds applied in any direction at any point on the rail.

(6) All handrails and railings shall be provided with a clearance of not less than 3 inches between the handrail or railing and any other object.

(7) Floor opening covers may be of any material that meets the following strength requirements:

(i) Trench or conduit covers and their supports, when located in plant roadways, shall be designed to carry a truck rear-axle load of at least 20,000 pounds.

(ii) Manhole covers and their supports, when located in plant roadways, shall comply with local standard highway requirements if any; otherwise, they shall be designed to carry a truck rear-axle load of at least 20,000 pounds.

(iii) The construction of floor opening covers may be of any material that meets the strength requirements. Covers projecting not more than 1 inch above the floor level may be used providing all edges are chamfered to an angle with the horizontal of not over 30 degrees. All hinges, handles, bolts, or other parts shall set flush with the floor or cover surface.

(8) Skylight screens shall be of such construction and mounting that they are capable of withstanding a load of at least 200 pounds applied perpendicularly at any one area on the screen. They shall also be of such construction and mounting that under ordinary loads or impacts, they will not deflect downward sufficiently to break the glass below them. The construction shall be of grillwork with openings not more than 4 inches long or of slatwork with openings not more than 2 inches wide with length unrestricted.

(9) Wall opening barriers (rails, rollers, picket fences, and half doors) shall be of such construction and mounting that, when in place at the opening, the barrier is capable of withstanding a load of at least 200 pounds applied in any direction (except upward) at any point on the top rail or corresponding member.

(10) Wall opening grab handles shall be not less than 12 inches in length and shall be so mounted as to give 3 inches clearance from the side framing of the wall opening. The size, material, and anchoring of the grab handle shall be such that the completed structure is capable of withstanding a load of at least 200 pounds applied in any direction at any point of the handle.

(11) Wall opening screens shall be of such construction and mounting that they are capable of withstanding a load of at least 200 pounds applied horizontally at any point on the near side of the screen. They may be of solid construction, of grillwork with openings not more than 8 inches long, or of slatwork with openings not more than 4 inches wide with length unrestricted.

§ 1910.24 Fixed industrial stairs.

(a) *Application of requirements.* The requirements of this section apply to fixed general industrial stairs. This section does not apply to stairs used for fire-exit purposes, to construction operations, to private residences, or to articulated stairs, such as may be installed on floating roof tanks or on dock facilities, the angle of which changes with the rise and fall of the base support.

(b) *Where fixed stairs are required.* Fixed stairs shall be provided for access from one structure level to another where operations necessitate regular travel between levels, and for access to operating platforms at any equipment which requires attention routinely during operations. Fixed stairs shall also be provided where access to elevations is daily or at each shift for such purposes as gauging, inspection, regular maintenance, etc., where such work may expose employees to acids, caustic, gases, or other harmful substances, or for which purposes the carrying of tools or equipment by hand is normally required. (It is not the intent of this section to preclude the use of fixed ladders for access to elevated tanks, towers, and similar structures, overhead traveling cranes, etc., where the use of fixed ladders is common practice.) Spiral stairways shall not be permitted except for special limited usage and secondary access situations where it is not practical to provide a conventional stairway. Winding stairways may be installed on tanks and similar round structures where the diameter of the structure is not less than five (5) feet.

(c) *Stair strength.* Fixed stairways shall be designed and constructed to carry a load of five times the normal live load anticipated but never of less strength than to carry safely a moving concentrated load of 1,000 pounds.

(d) *Stair width.* Fixed stairways shall have a minimum width of 22 inches.

(e) *Angle of stairway rise.* Fixed stairs shall be installed at angles to the horizontal of between 30° and 50°. Any uniform combination of rise/tread dimensions may be used that will result in a stairway at any angle to the horizontal within the permissible range. Table D–1 gives rise/tread dimensions which will produce a stairway within the permissible range, stating the angle to the horizontal produced by each combination. However, the rise/tread combinations are not limited to those given in Table D–1.

(f) *Stair treads.* Each tread and the top landing of a stairway, where risers are used, should have a nose which extends one-half inch to 1 inch beyond the

face of the lower riser. Noses should have an even leading edge. All treads shall be reasonably slip-resistant and the nosings shall be of nonslip finish. Welded bar grating treads without nosings are acceptable providing the leading edge can be readily identified by personnel descending the stairway and provided the tread is serrated or is of definite nonslip design. Rise height and tread width shall be uniform throughout any flight of stairs including any foundation structure used as one or more treads of the stairs.

TABLE D–1

Angle to horizontal	Rise (in inches)	Tread run (in inches)
30°35′	6½	11
32°08′	6¾	10¾
33°41′	7	10½
35°16′	7¼	10¼
36°52′	7½	10
38°29′	7¾	9¾
40°08′	8	9½
41°44′	8¼	9¼
43°22′	8½	9
45°00′	8¾	8¾
46°38′	9	8½
48°16′	9¼	8¼
49°54′	9½	8

(g) *Length of stairways.* Long flights of stairs, unbroken by landings or intermediate platforms, should be avoided. Consideration should be given to providing intermediate platforms where practical and where such stairways are in frequent use. Stairway platforms shall be no less than the width of a stairway and a minimum of 30 inches in length measured in the direction of travel.

(h) *Railings and handrails.* Standard railings shall be provided on the open sides of all exposed stairways and stair platforms. Handrails shall be provided on at least one side of closed stairways, preferably on the right side descending. Stair railings and handrails shall be installed in accordance with the provisions of § 1910.23.

(i) *Vertical clearance.* Vertical clearance above any stair tread to an overhead obstruction shall be at least 7 feet measured from the leading edge of the tread.

(j) *Open risers.* Stairs having treads of less than 9-inch width should have open risers.

(k) *General.* Open grating type treads are desirable for outside stairs.

§ 1910.25 Portable wood ladders.

(a) *Application of requirements.* This section is intended to prescribe rules and establish minimum requirements for the construction, care, and use of the common types of portable wood ladders, in order to insure safety under normal conditions of usage. Other types of special ladders, fruitpicker's ladders, combination step and extension ladders, stockroom step ladders, aisle-way step ladders, shelf ladders, and library ladders are not specifically covered by this section.

(b) *Materials*—(1) *Requirements applicable to all wood parts.* (i) All wood parts shall be of the species specified in Table D–5, seasoned to a moisture content of not more than 15 percent; smoothly machined and dressed on all sides; free from sharp edges and splinters; sound and free by accepted visual inspection from shake, wane, compression failures, decay, or other irregularities except as hereinafter provided. Low-density wood shall not be used.

(ii) Black streaks in western hemlock shall not be considered an irregularity, except that chambers associated with black streaks, when present in the part, shall be limited as specified for pitch and bark pockets.

(2) *Permissible irregularities in side rails and back rails.* (i) The general slope of grain in side rails of minimum dimension shall not be steeper than 1 in 12, except that for ladders under 10 feet in length and having flat steps for treads, the general slope of grain shall not be steeper than 1 in 10. The slope of grain in areas of local grain deviation shall not be steeper than 1 in 12 or 1 in 10 as specified above when occurring on the edges or in the outer one-fourth of the width of the wide face. Local areas of grain deviation within the center half of the width of the wide face may contain grain slope as steep as 1 in 8. Local deviations of grain associated with otherwise permissible irregularities are permitted.

(ii) Knots shall not appear in narrow faces of side rails. Knots, if tight and sound and less than one-half inch in diameter, are permitted on the wide face provided they are at least one-half inch back from either edge and not more frequent than 1 to any 3 feet of ladder length.

(iii) Pitch and bark pockets are permitted provided they are not more than one-eighth inch in width, or more than 2 inches in length, or more than one-half inch in depth, and then only if they are not more frequent than 1 to any 3 feet of ladder length.

(iv) Checks are permitted on side rails provided they are not more than 6 inches in length or more than one-half inch in depth.

(v) Occurrences of compression wood in relatively small amounts and positively identified by competent and conscientious visual inspection of side rails are permitted provided no single streak shall exceed one-half inch in width nor shall the aggregate of streaks exceed one-fourth of the face of the side rail. Borderline forms of compression wood not positively identified by competent and conscientious visual inspection are permitted. Ladder parts containing bow or crook which would interfere with the operation of the ladder shall not be used.

(3) *Permissible irregularities in flat steps, rungs, and cleats.* (i) The general slope of grain in flat steps of minimum dimension shall not be steeper than 1 in 12, except that for ladders under 10 feet in length the slope of grain shall not be steeper than 1 in 10. The slope of grain in areas of local deviation shall not be steeper than 1 in 12 or 1 in 10 as specified above. For all ladders, cross grain not steeper than 1 in 10 are permitted in lieu of 1 in 12, provided the size is increased to afford at least 15 percent greater calculated strength than for ladders built to minimum dimensions. Local deviations of grain associated with otherwise permissible irregularities are permitted.

(ii) The general slope of grain and that in areas of local deviations of grain shall not be steeper than 1 in 15 in rungs and cleats. For all ladders cross grain not steeper than 1 in 12 are permitted in lieu of 1 in 15, provided the size is increased to afford at least 15 percent greater calculated strength for ladders built to minimum dimensions. Local deviations of grain associated with otherwise permissible irregularities are permitted.

(iii) Knots over one-eighth inch in diameter shall not appear in rungs. Knots shall not appear in the narrow faces of flat steps and cleats. Knots appearing in the wide faces of flat steps and cleats shall not exceed a diameter of one-fourth inch.

(4) *Classification of species of wood.* Table D–5 gives a list of native woods, divided into four groups on the basis of mechanical properties considered from the standpoint of use for ladder construction.

(i) All minimum dimensions and specifications set forth hereinafter for side rails and flat steps are based on the species of wood listed in Group 3 in Table D–5 except where otherwise provided. The species of all other groups may be substituted for those of Group 3 when used in sizes that provide at least equivalent strength. (See Table D–5 for suggested methods of size adjustment.)

(ii) All minimum dimensions and specifications set forth hereinafter for rungs and cleats are based on the species of wood listed in Group 1 in Table D–5. Cleats may be made of species of any other group provided that the cross-sectional dimensions specified for Group 1 species are increasd by the factors shown in this subdivision (based on the percentages of Table D–5) for the species group of which the cleats are to be made.

FACTOR FOR INCREASE IN

Species group	Each dimension	Width only (thickness unchanged)
1	1.00	1.00
2	1.03	1.05
3	1.11	1.19
4	1.17	1.26

(5) *Metal parts.* All metal parts shall be made of aluminum, steel, wrought iron, malleable iron, or other material, adequate in strength for the purpose intended.

(c) *Construction requirements*—(1) *Basic of requirements.* (i) Dimensions specified hereinafter for wood ladders are the minimum dressed cross-sectional dimensions for the types of ladders herein designated, based on the species of woods specified in paragraph (b) (4) of this section, at a moisture content of 15 percent. The dimensions for side rails are based on a mortise or gain as specified for the various types of ladders for

step or rung attachments. Where the strength of the side rails or back legs is reduced by a greater mortise or gain than shown, or where it is desired to use a cross section for any wood part either dimension of which is less than that specified, the required dimensions may be found as indicated in subdivision (ii) of this subparagraph.

(ii) For the side rails of single extension and sectional ladders, the proposed section shall develop an actual stress per square inch not greater than 2,150 pounds for Group 1 woods, 2,000 pounds for Group 2 woods, 1,600 pounds for Group 3 woods, or 1,375 pounds for Group 4 woods when computed by the following formula applying to rectangular sections, with a maximum tolerance of 5 percent over these stresses:

$$S=\frac{3\,LD\,(P+W/16)}{2B\,(D^3-d^3)}=\frac{15\,LD\,(25+W/16)}{B\,(D^3-0.67)}$$

P = 25 pounds, which is the normal component on each rail of a load of 200 pounds at the center of the ladder, equally distributed between the rails, when the foot of the ladder is moved out of the perpendicular by one-quarter of its length.
S = Stress in extreme fiber in pounds per square inch.
W = Weight of ladder in pounds.
L = Maximum working length of ladder in inches.
B = Net thickness of each side rail in inches.
D = Depth of side rail in inches.
d = Diameter of hole board for rung (d^3 shall be taken as not less than 0.67).

(iii) Adjustment of sizes for wood parts of stepladders and other ladder types covered by this section may be made as follows:

(*a*) The dimensions specified in later sections for parts having rectangular cross sections generally represent only one of a number of possible combinations of thickness and width which could satisfy the requirements for strength and stiffness. Depending upon the material sizes available, manufacturing practices, and like factors, parts produced by a particular manufacturer may or may not agree exactly with the sizes given later. The following provisions provide means for determining equality of load-carrying capacity of parts of different sizes or of determining sizes needed to provide equality.

(*b*) Any changes in dimensions shall result in a change in the width-thickness ratio for side rails of back legs not greater than 25 percent from the ratio for a corresponding ladder as now covered in this section.

(*c*) Where both dimensions are different from those specified, the load-carrying capacity in bending of a part will be equal to or greater than that of a part of specified dimensions if the ratio P_2/P_1 is not less than 1, where

$$\frac{P_2}{P_1}=\frac{B_2D_2^2}{B_1D_1^2}$$

and

B = Dimension of the part at right angles to the direction of load (width of a step, thickness of a side rail or back leg).
D = Dimension of the part parallel to the direction of load (thickness of a step, width of a side rail or back leg).
B_1D_1 = Dimensions as specified.
B_2D_2 = Dimensions of part being considered.

(*d*) The dimensions to be used in the computations are net dimensions. For example, in the case of a stepladder side rail, the dimension B is to be taken as the gross thickness of the rail minus the depth of the gain for the steps. Where there is a rung hole at the center of depth of a rail, a somewhat more accurate comparison may be made by the use of the formula

$$\frac{P_2}{P_1}=\frac{B_2D_1\,(D_2^3-d^3)}{B_1D_2\,(D_1^3-d^3)}$$

where the symbols have the same meanings as before and d is the diameter of the hole for the rung tenon. In most instances the difference in results calculated by this and by the earlier formula will be slight.

(2) *Portable stepladders.* Stepladders longer than 20 feet shall not be supplied. Stepladders as hereinafter specified shall be of three types:

Type I—Industrial stepladder, 3 to 20 feet for heavy duty, such as utilities, contractors, and industrial use.
Type II—Commercial stepladder, 3 to 12 feet for medium duty, such as painters, offices, and light industrial use.
Type III—Household stepladder, 3 to 6 feet for light duty, such as light household use.

(i) *General requirements.* (*a*) Slope is the inclination of side rails or back legs with respect to the vertical and is expressed as a deviation from the vertical per unit length of the member. Stepladders shall be so constructed, that when in the open position, the slope of the front section shall not be less than 3½ inches and the slope of the back section not less than 2 inches, for each 12-inch length of side rail.

(*b*) A uniform step spacing shall be employed which shall be not more than 12 inches. Steps shall be parallel and level when the ladder is in position for use.

(*c*) The minimum width between side rails at the top, inside to inside, shall be not less than 11½ inches. From top to bottom, the side rails shall spread at least 1 inch for each foot of length of stepladder.

(*d*) When minimum thickness of side rails is used, steps shall be closely fitted into the grooves in the side rails one-eighth inch in depth with a tolerance of one thirty-second inch, and shall be firmly secured as hereinafter described; or they shall be closely fitted into metal brackets of an equivalent strength, which in turn shall be firmly secured to the side rails. The depth of groove herein provided may be increased in proportion to the thickness of side rails as provided in subdivisions (ii) (*a*), (iii) (*a*), and (iv) (*a*) of this subparagraph.

(*e*) All stepladders shall have a top with wood or metal brackets or fittings tightly secured to the top, side rails, and back legs, to allow free swinging of the back section without excessive play or wear at the joints.

(*f*) A metal spreader or locking device of sufficient size and strength to securely hold the front and back sections in open positions shall be a component of each stepladder. The spreader shall have all sharp points covered or removed to protect the user. For Type III ladder, the pail shelf and spreader may be combined in one unit (the so-called shelf-lock ladder).

(*g*) When measured along the front edge of the side rails, all stepladders shall measure within 3 inches of the specified length.

(*h*) Where bucket shelves are provided, they shall be constructed to support a load of 25 pounds and shall be so fastened that they can be folded up when the ladder is closed.

(*i*) All metal parts and fittings shall be securely attached by means of rivets, bolts, screws, or equivalent fasteners.

(ii) *Type I industrial stepladder.* (*a*) (*1*) The minimum dimensions of the parts of the Type I stepladder shall be as shown in Table D–2 when made of Group 2 or Group 3 woods.

(2) The minimum thickness of side rails provides for the cutting of a groove of one-eighth inch in depth with the tolerance indicated in subdivisions (i) (*d*) of this subparagraph, and shall be increased when grooves of greater depth are used.

(*b*) Steps shall be secured with at least two 6–d nails at each end, or the equivalent thereof. Each step shall be reinforced by a steel rod not less than 0.160 inch in diameter with standard commercial tolerances, which shall pass through metal washers of sufficient thickness and diameter on each end to prevent pressing—into the side rails, and a truss block which shall be fitted between the rod and the center of each step, or by a metal angle brace on each end firmly secured to the steps and side rails, or by construction of equivalent strength and safety. Where the rod reinforcement construction is used, the bottom step shall be provided further with a metal angle brace on each end which shall be securely attached to the bottom step and side rails. In addition, all steps 3⅝ inches wide and 27 inches or more in overall length and all steps 4¼ inches wide and 32 inches or more in overall length shall be provided with a metal angle brace at each end securely attached to the step and side rail.

(*c*) The back section shall be braced by one of the following methods:

(1) The back legs shall be braced with 1⅛-inch diameter rungs of Group 1 woods (see Table D–5), or material of equivalent strength, having ⅞-inch diameter tenons or oval wood rungs, or rectangular wood rungs of equivalent strength, spaced not more than 12 inches apart. The back legs shall be bored with holes either extending through the legs or to within three-sixteenths inch of the outside face of the legs, the size of the hole to be such as to insure a tight fit for the rung. The shoulder of the rung shall be forced firmly against the leg, and the tenon secured in place with a nail, or the

equivalent thereof, to prevent turning of the rungs. The back legs shall be braced by a metal angle brace on each side, securely fastened to the rung and the back legs, one rung to be braced for each 4 feet of length or fraction thereof, on ladders 4 feet or more in length, with braces required only on the bottom rung for ladders that are 4 feet or shorter. Where rungs are more than 28 inches in length between the back legs they shall be provided with center bearing consisting of a wood bar not less than ¾ by 2 inches in cross-section securely nailed to each rung passing through it and long enough to include each rung longer than 28 inches.

(2) The back leg shall be braced with horizontal wood bars of Group 1, 2, or 3 woods in Table D–5 and not less than ¾ by 2½ inches in cross-section, spaced not more than 12 inches apart. The ends of the bars shall fit into metal sockets of not less than 20-gauge (Manufacturers Standard) steel, or other material of equivalent strength, or into mortises of not less than one-eighth inch (tolerance of ±one-thirty-second inch) in depth in the back legs. A steel rod not less than 0.160 inch in diameter with standard commercial tolerance shall pass through the back legs, the bar, and at each end through metal washers of sufficient diameter and thickness to prevent passing into the back legs. The back legs shall also be braced by a metal angle brace on each side, securely fastened to the bar and to the legs, one bar to be so braced for at least each 4 feet of length or fraction thereof, with braces required only on bottom bar for ladders that are 4 feet or shorter. Metal sockets when used shall be attached to the back lags by rivets or by means of a rod running through the sock or equivalent thereof.

TABLE D–3

DIMENSIONS FOR TYPE I STEP LADDER

	Length, 12 feet and less		Length, 14 and 16 feet		Length, 18 and 20 feet	
	Thickness (inch)	Depth (inches)	Thickness (inch)	Depth (inches)	Thickness (inch)	Depth (inches)
Side rails	25/32	3¼	25/32	3⅜	1 1/16	3⅜
Back legs	25/32	2¼	25/32	2⅝	1 1/16	2¼
Steps	25/32	3⅜	25/32	4¼	25/32	4¼
Tops	25/32	5½	25/32	5½	25/32	5½

DIMENSIONS FOR TYPE II STEP LADDER

	Length, 3 to 8 feet		Length, 10 feet		Length, 12 feet	
	Thickness (inch)	Depth (inches)	Thickness (inch)	Depth (inches)	Thickness (inch)	Depth (inches)
Side rails	¾	2⅝	¾	2⅝	¾	3
Back legs	¾	1⅝	¾	1¾	¾	2
Steps	¾	3½	¾	3½	¾	3⅝
Top	¾	5	¾	5	¾	5

(*d*) The back legs shall be reinforced by a rivet through the depth of the leg above the hinge point, by metal plates or collars at the hinge point, or by other means suitable for preventing splitting of the back leg from the hinge pin to the top.

(iii) *Type II commercial stepladder.* (*a*) (*1*) The minimum dimensions of the parts of the Type II stepladder shall be as given in Table D–3 when made of Group 2 or Group 3 woods.

(2) The minimum thickness of side rails provides for the cutting of a groove of one-eighth inch in depth with the tolerance indicated in subdivision (i) (*d*) of this subparagraph, and shall be increased when grooves of greater depth are used.

(*b*) Steps shall be secured with at least two 6-d nails at each end, or the equivalent thereof. Each step shall be reinforced by by a steel rod not less than 0.160 inch in diameter with standard commercial tolerances which shall pass through metal washers of sufficient thickness and diameter on each end to prevent pressing into the side rails, and a truss block shall be fittted between the truss rod and center of each step; or by a metal angle brace on each end firmly secured to the steps and side rails; or by construction of equivalent strength and safety. Where the rod reinforcement construction is used, the bottom step shall be provided further with a metal angle brace on each end which shall be securely attached to the bottom step and side rails. In addition all steps 27 inches or more in overall length shall be provided with a metal angle brace at each end securely attached to the step and side rails.

(*c*) The back legs shall be braced by one of the three following methods:

(*1*) (*i*) With ⅞-inch diameter wood dowels of Group 1 woods (see Table D–5) or material of equivalent strength having not less than ⅝-inch tenons firmly secured in the back legs and spaced not more than 12 inches apart. The back legs shall be bored with holes either extending through the legs or to within three-sixteenths inch of the outside face of the legs, the size of the hole to be such as to insure a tight fit for the dowel. The shoulder of the dowel shall be forced firmly against the leg and the tenon secured in place with a nail, or the equivalent thereof, to prevent turning of the dowel.

(*ii*) A bar connecting two or more of the dowels shall be provided on all ladders of 6 feet or more. The cross-sectional dimensions of the bar shall be the same as the cross-sectional dimensions of the back legs, and the dowels shall pass through holes at the centerline of the bar. The bar shall be attached at the center of the length of the lower two dowels on a 6-foot ladder and shall extend upward one dowel for each 2 feet of length.

(2) With wood dowels as set forth in this subdivision (iii) (*c*) (*1*), plus an inverted V bracing of ¾- by 1½-inch material through which the dowels extend, the length of the V to extend two-thirds of the way up the back.

(*3*) With horizontal bracing of Group 1, 2, 3, or 4 woods (see Table D–5) not less than ¾ by 2 inches in cross-section, the ends of which shall fit into metal sockets of not less than 20-gauge (Manufacturing Standard), steel, or other material of equivalent strength or into mortises not less than one-eighth inch in depth in back legs. The bars shall be reinforced by steel rods not less than 0.160 inch in diameter with standard commercial tolerances which shall pass through the back legs, the bar, and, at each end, through metal washers of sufficient diameter and thickness to prevent pressing into back legs. The spacing of such braces shall not exceed 3 feet, and there shall be one brace on 3- and 4-foot ladders, two braces on 5- and 6-foot ladders, three braces on 7- and 8-foot ladders, and four braces on 10- and 12-foot ladders. The bottom bar shall not be more than 18 inches from the bottom of the ladder, and, where only one bar is used, it shall be braced by a metal angle brace on each end securely attached to the bar and the back leg.

(iv) *Type III household stepladder.* (*a*) The minimum dimensions of the parts of the Type III stepladder shall be as follows when made of Group 2 or Group 3 woods.

	Length, 3 to 6 feet	
	Thickness (inch)	Depth (inches)
Side rails	¾	2⅛
Back legs	¾	1 5/16
Steps	¾	3
Top	¾	5

The minimum thicknesses of side rails provide for the cutting of a groove one-eighth inch in depth with the tolerance indicated in subdivision (i) (*d*) of this subparagraph, and shall be increased when grooves of greater depth are used.

(*b*) Steps shall be secured with at least one 6-d nail at each end, or the equivalent thereof. Each step shall be reinforced by a steel rod not less than 0.160 inch in diameter with standard commercial tolerance which shall pass through metal washers of sufficient thickness and diameter to prevent pressing into the side rails, or by a metal brace at each end firmly secured to steps and side rails or by construction of equivalent strength and safety. Where the rod reinforcement construction is used, the bottom step shall be provided further with a metal angle brace on each end which shall be securely attached to the bottom step and side rail.

(c) Back legs shall be braced by one of the two following methods or by construction of equivalent strength and safety:

(1) By diagonal slates of groups 1, 2, 3, or 4 wood (see Table D–5) not less than $\frac{7}{8}$ by 1¼ inches securely fastened to the back legs by nails, screws, or the equivalent thereof.

(2) With horizontal bracing of Groups 1, 2, 3, or 4 wood (see Table D–5) not less than ⅝ by 1⅜ inches in cross section, the ends of which shall fit into metal sockets of not less than 20-gauge (Manufacturing Standard) steel or other material of equivalent strength or into mortises not less than one-eighth inch in depth in back legs. The bars shall be reinforced by steel rods not less than 0.160 inch in diameter with standard commercial tolerances which shall pass through the back leg, the bar, and at each end through metal washers of sufficient diameter and thickness to prevent pressing into each leg. The spacing of such bars shall not exceed 3 feet, and there shall be one brace on 3- and 4-foot ladders, two braces on 5- and 6-foot ladders. The bottom bar shall be not more than 18 inches from the bottom of the ladder.

(3) *Portable rung ladders.* Portable rung ladders as herein specified shall be of four types, as follows: single ladder; two-section extension ladder; section ladder; trestle and extension trestle ladder.

(i) *General requirements.* (a) The base or lower portion of a ladder may have either parallel sides or flared sides in accordance with commercial practice.

(b) Rungs shall be parallel, level, and uniformly spaced. The spacing shall be not more than 12 inches, except as hereinafter specified.

(c) All holes for wood rungs shall either extend through the side rails or be bored so as to give at least a thirteen-sixteenths-inch length of bearing to the rung tenon. In through-bored construction, the rungs shall extend at least flush with the outside rail surface. All holes shall be located on the center line of the wide face of the side rails and shall be of such size as to insure a tight fit for the rung. The shoulder of the rung shall be forced firmly against the side rails and the tenon secured in place with a nail or the equivalent thereof, for the sole purpose of preventing the turning of the rung and maintaining the rung position in the side rail.

(d) Round rungs shall be of Group 1 woods (see Table D–5), shall be not less than 1⅛ inches in diameter for lengths up to 36 inches between side rails and 1¼ inches in diameter for lengths over 36 up to and including 72 inches, and shall have not less than seven-eighths-inch-diameter tenons, or rungs of equivalent strength and bearing shall be provided. When rungs are 28 inches or more in length between side rails, they shall, in addition, be provided with center bearing.

(e) Oval rungs or rungs of any other cross section may be used provided they are secured by a nail at each end or the equivalent thereof, and have at least the same strength and bearing as round rungs of the same length.

(f) All metal parts and fittings shall be securely attached by means of rivets, bolts, screws, or equivalent fasteners.

(g) The construction and assembly of the movable parts shall be such that they shall operate freely and securely without binding or unnecessary play.

(h) When measured along the side rails, no rung ladder or section thereof shall be more than 4 inches shorter than the specified length.

(i) Nonslip bases shall be securely bolted, riveted, or attached by equivalent construction to the side rails.

(j) Hooks shall be securely bolted or riveted to the side rails or equivalent construction and shall be of such dimensions as to withstand the loads imposed upon them.

(ii) *Single ladder.* (a) Single ladders longer than 30 feet shall not be supplied.

(b) The minimum dimensions of the side rails of the single ladder shall be as follows when made of group 2 or group 3 woods:

Length of ladder (feet)	Thickness (inches)	Depth (inches)
Up to and including 16	1⅛	2⅛
Over 16 up to and including 22	1¼	2¾
Over 22 up to and including 30	1¼	3

(c) Smaller side rails will be acceptable in all ladders of this type when reinforced by a steel wire, rod, or strap running the length of the side rails and adequately secured thereto. Where such reinforcement is used, the reinforced rails shall be equivalent in strength to the side rails specified in this subdivision (ii) (b).

(d) The width between the side rails at the base, inside to inside, shall be at least 11½ inches for all ladders up to and including 10 feet. Such minimum widths shall be increased at least one-fourth inch for each additional 2 feet of length.

(iii) *Two-section ladder.* (a) Two-section extension ladders longer than 60 feet shall not be supplied. All ladders of this type shall consist of two sections, one to fit within the side rails of the other, and arranged in such a manner that the upper section can be raised and lowered.

(b) The minimum dimensions of the side rails of the two-section extension ladder shall be not less than specified in Table D–4 of this section.

(c) The minimum dimensions of side rails set forth in Table D–4 are based on the maximum working length, which is the size of ladder less the minimum overlap, which shall be as follows:

Size of ladder (feet):	Overlap (feet)
Up to and including 36	3
Over 36 up to and including 48	4
Over 48 up to and including 60	5

(d) Smaller side rails will be acceptable in all ladders of this type when reinforced by a steel wire, rod, or strap running the length of the side rails and adequately secured thereto. Where such reinforcement is used, the reinforced rails shall be equivalent in strength to the side rails specified in Table D–5.

(e) The minimum distance between side rails of the bottom section, inside to inside, shall be 14½ inches on ladders up to and including 28 feet; 16 inches on all ladders over 28 feet up to and including 40 feet; 18 inches on all ladders over 40 feet.

(f) All locks and guide irons shall be of metal and shall be of such construction and strength as to develop the full strength of the side rails. All locks shall be positive in their action. The guide irons shall be securely attached and so placed as to prevent the upper section from tipping or falling out while raising, lowering, or in use.

(g) (1) Ladders of this type may be equipped with a rope and pulley, which shall be securely attached to the ladder in such manner as not to weaken either the rungs or the side rails. The pulley shall be not less than 1¼ inches in diameter.

(2) The rope used with the pulley shall be not less than five-sixteenths inch in diameter having a minimum breaking strength of 560 pounds, and shall be sufficient length for the purpose intended.

(iv) *Sectional Ladder.* (a) Assembled combinations of sectional ladders longer than lengths specified in this subdivision (iv) (b) shall not be used.

(b) The minimum dimensions of side rails shall be as follows for Group 2 or Group 3 woods:

Assembled length of ladder (feet)	Thickness (inches)	Depth (inches)
Up to and including 21	1⅛	2¾
Over 21 up to and including 31	1⅛	3⅛

TABLE D–4—DIMENSIONS OF SIDE RAILS FOR TWO-SECTION LADDER

Size of ladder, overall length (feet)	Rail		
	Thickness (inches)		Depth (inches)
For group 2 woods			
16	1 1/16	×	2
20	1 1/16	×	2¼
24	1 1/16	×	2½
28	1 1/16	×	2¾
32	1⅛	×	2¾
36	1 3/16	×	2¾
40	1 3/16	×	2¾
44	1 3/16	×	3
For group 3 woods			
16	1⅛	×	2
20	1⅛	×	2¼
24	1⅛	×	2½
28	1⅛	×	2¾
32	1 3/16	×	2¾
36	1 3/16	×	3
40	1¼	×	3
44	1¼	×	3¼
48–52	1¼	×	3¼
56–60	1⅜	×	3¾

(c) Ladders of this type shall have either straight sides slightly converging toward the top of each section, or shall have flaring sides at the bottom of the first (or bottom) section, with the top section having converging side rails to a width that shall be not less than 4 inches. Except for the top section, the minimum

width between side rails shall be 11 inches.

(*1*) Adjacent sections shall be jointed by means of a groove in the bottom end of each rail of the upper of the two sections setting firmly over extensions outside the side rails, of the topmost rung of the next lower section and, at the same time, a groove in the top end of each rail of the lower of the two sections setting firmly over the bottom rung, inside the side rails, of the section next above.

(*2*) The distance between the two rungs (top-most rung of one section, bottom rung of the section next above) mentioned in this subdivision (iv) (*c*) (*1*) shall not be less than 1 foot.

(*3*) The fit between rail grooves and rungs mentioned in this subdivision (iv) (*c*) (*1*) shall be such as to provide a good fit without binding or unnecessary play.

(*4*) The grooved ends of the sections shall be reinforced with a metal plate of not less than 18-gauge (Manufacturing Standard) material properly secured thereto, and a rivet adjacent to the groove, extending through the depth of the rail, or the equivalent thereof.

(v) *Trestle and extension trestle ladder.* (*a*) Trestle ladders, or extension sections or base sections of extension trestle ladders longer than 20 feet shall not be supplied.

(*b*) The minimum dimensions of the side rails of the trestle ladder, or the base sections of the extension trestle ladder, shall be as follows for Group 2 or Group 3 woods.

Size of ladder (feet)	Thickness (inches)	Depth (inches)
Up to and including 16	1 5/16	2 3/4
Over 16 up to and including 20	1 5/16	3

The minimum dimensions of the side rails of the extension section of the extension trestle ladder, which shall have parallel sides, shall be as follows for Group 2 or Group 3 woods.

Size of ladder (feet)	Thickness (inches)	Depth (inches)
Up to and including 12	1 5/16	2 3/4
Over 12 up to and including 16	1 5/16	2 1/2
Over 16 up to and including 20	1 5/16	2 3/4

(*c*) Trestle ladders and base sections of extension trestle ladders shall be so spread that when in an open position the spread of the trestle at the bottom, inside to inside, shall be at least 5½ inches per foot of the length of the ladder.

(*d*) The width between the side rails at the base of the trestle ladder and base sections of the extension trestle ladder shall be at least 21 inches for all ladders and sections up to and including 6 feet. Longer lengths shall be increased at least 1 inch for each additional foot of length. The width between the side rails of the extension sections of the trestle ladder shall be not less than 12 inches.

(*e*) The tops of the side rails of the trestle ladder and the base section of the extension trestle ladder shall be beveled, or equivalent construction, and shall be provided further with a metal hinge to prevent spreading.

(*f*) A metal spreader or locking device to hold the front and back sections in an open position, and to hold the extension section securely in the elevated position, shall be a component of all extension trestle ladders and all trestle ladders over 12 feet in length.

(*g*) Rungs shall be parallel and level. On the trestle ladder, or on the base sections of the extension trestle ladder, rungs shall be spaced not less than 8 inches or more than 18 inches apart; on the extension section of the extension trestle ladder, rungs shall be spaced not less than 6 inches or more than 12 inches apart.

(*4*) *Special-purpose ladders.* All special-purpose ladders shall comply with the appropriate requirements of subparagraphs (1), (2), and (3) of this paragraph, except as hereinafter modified in this subparagraph.

(i) *Platform stepladder.* A platform stepladder is a modification of a portable stepladder with a working platform provided near the top.

(*a*) Platform stepladders shall be made in accordance with the requirements of type I stepladders or in accordance with the requirements for type II stepladders.

(*b*) The slope of the back section shall be such that a vertical from the back edge of the platform will strike the floor at a distance measured toward the front section of not less than 3 inches from the base of the back section.

(*c*) The minimum width between side rails at the platform shall be not less than 15 inches.

(*d*) The back legs and side rails shall extend at least 24 inches above the platform and shall be connected with a top member to form a three-sided rail, or equivalent construction shall be provided.

(*e*) Platforms shall be so constructed as to be capable of supporting a load of 200 pounds placed at any point on the platform.

(*f*) A separate spreader may be omitted from platform ladders in which the height to the platform is 6 feet or less. If the spreader is omitted, the platform shall be so designed as to function as a spreader or locking device to hold the front and back sections securely in an open position, with the connection between side rails and back legs being through the metal parts of the platform. The wood parts of a combined wood and metal platform functioning as a spreader shall not be depended upon to contribute to the spreading or locking action.

(ii) *Painter's stepladder.* (*a*) Painter's stepladders longer than 12 feet shall not be supplied.

(*b*) Painter's stepladders shall be made in accordance with the requirements of type II stepladders except for the following:

(*1*) The top may be omitted.

(*2*) A rope spreader may be substituted for the metal spreader required in subparagraph (2) (i) (f) of this paragraph. The rope shall not be less than No. 6 sash cord or its equivalent.

(iii) *Mason's ladder.* A mason's ladder is a special type of single ladder intended for use in heavy construction work.

(*a*) Mason's ladders longer than 40 feet shall not be supplied.

(*b*) The minimum dimensions of the side rails when made of Group 2 or Group 3 woods and rungs (Group 1 woods) of the mason's ladder shall be as follows:

Length of ladder (feet)	Side rails		Diameter	
	Thickness (inches)	Depth (inches)	Rung (inches)	Tenon (inches)
Up to and including 22	1 5/8	3 5/8	1 3/8	1
Over 22 up to and including 40	1 5/8	4 1/2	1 3/8	1

(*c*) The width between the side rails at the bottom rung, inside to inside, shall be not less than 12 inches for all ladders up to and including 10 feet. Such minimum widths shall be increased by at least one-fourth inch for each additional 2 feet of length.

(*d*) Rungs shall be parallel and level and shall be spaced not less than 8 inches or more than 12 inches apart.

(*5*) *Trolley and side-rolling ladders*—(i) *Length.* Trolley ladders and side-rolling ladders longer than 20 feet should not be supplied.

(ii) *Dimensions.* The dimensions of the side rails shall not be less than the following for Group 2 or Group 3 woods.

Length of side rails (feet)	Thickness (inch)	Depth (inches)
Up to and including 10	2 5/32	3
Over 10 up to and including 20	2 5/32	3 3/4

The minimum thicknesses of side rails provide for the cutting of a groove not over one-eighth inch in depth and shall be increased when grooves of greater depth are used. Flat steps shall have the following minimum dimensions for Group 2 or Group 3 woods.

Length of step (inches)	Thickness (inch)	Width (inches)
Up to and including 16	2 5/32	3
Over 16 up to and including 20	2 5/32	3 1/4
Over 20 up to and including 24	2 5/32	3 1/2
Over 24 up to and including 28	2 5/32	4

(iii) *Width.* The width between the side rails, inside to inside, shall be at least 12 inches.

(iv) *Step attachment.* Flat steps shall be inset in the side rails one-eighth inch and secured with at least two 6–d nails at each end or the equivalent thereof. They shall be reinforced with angle braces or a 3/16-inch steel rod.

(v) *Locking device.* Locking devices should be provided on all trolley ladders.

(vi) *Tracks.* (*a*) Tracks shall be wood, or metal (excluding cast iron), or a combination of these materials.

(*b*) Tracks for the top end of ladders shall be fastened securely and shall be so constructed that the wheels will not

jump the track. Tracks shall be so designed as to provide for all probable loads to which they will be subjected.

(c) The supports shall be securely fastened by lag screws, machine, hook, or toggle bolts, or their equivalent.

(d) Track for side-rolling ladders shall be supported by metal or wood brackets securely screwed or bolted to shelving or other permanent structure at not over 3 feet.

(vii) *Wheel carriages.* (a) Wheel carriages shall be so designed as to provide for all loads to which they will be subjected. Two-point suspension should be used.

(b) The wheel carriage for the top end of the ladder shall be securely fastened to the top of the ladder with metal brackets bolted either to the side rails or to the top step. When bolted to the top step, this step shall be secured to the side rails with metal braces in addition to those otherwise provided. The wheel carriage shall be so designed that a loose or broken wheel will not allow the ladder to drop or become detached from the track.

(c) The wheel carriage for the bottom end of the ladder shall be securely fastened to the bottom of the ladder.

(d) The wheels at the upper end of the ladder shall have minimum wheel base of 8 inches.

(e) When wheels are used at the bottom of the ladder, there shall be at least one wheel supporting each side rail.

(f) Running gear for bottoms of both trolley and side-rolling ladders shall be so designed and constructed as to provide for any load to which they will be subjected.

(d) *Care and use of ladders*—(1) *Care.* To insure safety and serviceability the following precautions on the care of ladders shall be observed:

(i) Ladders shall be maintained in good condition at all times, the joint between the steps and side rails shall be tight, all hardware and fittings securely attached, and the movable parts shall operate freely without binding or undue play.

(ii) Metal bearings of locks, wheels, pulleys, etc., shall be frequently lubricated.

(iv) Safety feet and other auxiliary be replaced.

(iv) Safety feet and other auxiliary equipment shall be kept in good condition to insure proper performance.

(v) Ladders should be stored in such a manner as to provide ease of access or inspection, and to prevent danger of accident when withdrawing a ladder for use.

(vi) Wood ladders, when not in use, should be stored at a location where they will not be exposed to the elements, but where there is good ventilation. They shall not be stored near radiators, stoves, steam pipes, or other places subjected to excessive heat or dampness.

(vii) Ladders stored in a horizontal position should be supported at a sufficient number of points to avoid sagging and permanent set.

(viii) Ladders carried on vehicles should be adequately supported to avoid sagging and securely fastened in position to minimize chafing and the effects of road shocks.

(ix) Ladders should be kept coated with a suitable protective material. The painting of ladders is satisfactory providing the ladders are carefully inspected prior to painting by competent and experienced inspectors acting for, and responsible to, the purchaser, and providing the ladders are not for resale.

(x) Ladders shall be inspected frequently and those which have developed defects shall be withdrawn from service for repair or destruction and tagged or marked as "Dangerous, Do Not Use."

(xi) Rungs should be kept free of grease and oil.

(2) *Use.* The following safety precautions shall be observed in connection with the use of ladders:

(i) Portable rung and cleat ladders shall, where possible, be used at such a pitch that the horizontal distance from the top support to the foot of the ladder is one-quarter of the working length of the ladder (the length along the ladder between the foot and the top support). The ladder shall be so placed as to prevent slipping, or it shall be lashed, or held in position. Ladders shall not be used in a horizontal position as platforms, runways, or scaffolds;

(ii) Ladders for which dimensions are specified should not be used by more than one man at a time nor with ladder jacks and scaffold plans where use by more than one man is anticipated. In such cases, specially designed ladders with larger dimensions of the parts should be procured;

(iii) Portable ladders shall be so placed that the side rails have a secure footing. The top rest for portable rung and cleat ladders shall be reasonably rigid and shall have ample strength to support the applied load;

(iv) Ladders shall not be placed in front of doors opening toward the ladder unless the door is blocked upon, locked, or guarded.

(v) Ladders shall not be placed on boxes, barrels, or other unstable bases to obtain additional height;

(vi) To support the top of the ladder at a window opening, a board should be attached across the back of the ladder, extending across the window and providing firm support against the building walls or window frames;

(vii) When ascending or descending, the user should face the ladder;

(viii) Ladders with broken or missing steps, rungs, or cleats, broken side rails, or other faulty equipment shall not be used; improvised repairs shall not be made.

(ix) Short ladders shall not be spliced together to provide long sections;

(x) Ladders made by fastening cleats across a single rail shall not be used;

(xi) Ladders shall not be used as guys, braces, or skids, or for other than their intended purposes ;

(xii) Tops of the ordinary types of stepladders shall not be used as steps;

(xiii) On two-section extension ladders the minimum overlap for the two sections in use shall be as follows:

Size of ladder (feet):	Overlap (feet)
Up to and including 36	3
Over 36 up to and including 48	4
Over 48 up to and including 60	5

(xiv) Portable rung ladders with reinforced rails (see paragraphs (c)(3)(ii)(c) and (d)(3) this section) shall be used only with the metal reinforcement on the under side. Ladders of this type should be used with great care near electrical conductors, since the reinforcing itself is a good conductor;

(xv) No ladder should be used to gain access to a roof unless the top of the ladder shall extend at least 3 feet above the point of support, at eave, gutter, or roof line;

(xvi) Adjustment of extension ladders should only be made by the user when standing at the base of the ladder, so that the user may observe when the locks are properly engaged. Adjustment of extension ladders from the top of the ladder (or any level over the locking device) is a dangerous practice and should not be attempted. Adjustment should not be made while the user is standing on the ladder.

(xvii) Middle and top sections of sectional or window cleaner's ladders should not be used for bottom section unless the user equips them with safety shoes.

(xviii) Extension ladders should always be erected so that the upper section is resting on the bottom section.

(xix) The user should equip all portable rung ladders with nonslip bases when there is a hazard of slipping. Nonslip bases are not intended as a substitute for care in safety placing, lashing, or holding a ladder that is being used upon oily metal, concrete, or slippery surfaces.

(xx) The bracing on the back legs of step ladders is designed solely for increasing stability and not for climbing.

(xxi) When service conditions warrant, hooks may be attached at or near the top of portable ladders to give added security.

TABLE D-5—CLASSIFICATION OF VARIOUS SPECIES OF WOOD ACCEPTABLE FOR USE IN LADDERS

The species are listed alphabetically within each group. The position of any species within a group therefore bears no relation to its strength or acceptability.

Where ladders are desired for use under conditions favorable to decay, it is recommended that the heartwood of decay-resistant species be used, or that the wood be given a treatment with a wood preservative. The species having the most durable heartwood are marked with an asterisk (*), and these should be preferred where resistance to decay is required.

GROUP 1

The allowable fiber stress in bending for the species listed herein when used for side rails shall not exceed 2,150 pounds per square inch. These species may be substituted for Group 3 woods on the following basis: The dimensions may be not more than 10 percent smaller for each cross-section dimension, or the thickness may remain unchanged, in which case the width may not be more than 15 percent smaller if used edgewise (as in a rail) or 25 percent smaller if used flatwise (as in a tread).

GROUP 1—continued

White ash	Fraxinus americana, pennsylvanica, quadrangulata
Beech	Fagus grandifolia
Birch	Betula lenta, alleghaniensis, nigra (2)
Rock elm	Ulmus themasii
Hickory	Carya ovata, laciniosa, tomentosa, glabra
Locust	Robinia pseudoacacia, Gleditsia triacanthos
Hard maple	Acer nigrum, saccharum
Red maple	Acer rubrum (3)
Red oak	Quercus velutina, marilandica, kelloggii, falcata var. pagodaefolia, laurifolia, ellipsoidalis, rubra, nuttallii, palustris, coccinea, shumardii, falcata, laevis, phellos
White oak	Quercus arizonica, douglasii, macrocarpa, lobata, prinus, muehlenbergii, emoryi, gambelii, oblonifolia, virginiana, garryana, lyrata, stellata, michauxii, bicolor, alba
Pecan	Carya illinoensis, cordiformis, myristicaeformis (4), aquatica (4)
Persimmon	Diospryros virginiana

GROUP 2

The allowable fiber stress in bending for the species listed herein when used for side rails shall not exceed 2,000 pounds per square inch. These species may be substituted for Group 3 woods on the following basis: The dimensions may be not more than 7½ percent smaller for each cross-section dimension, or the thickness may remain unchanged, in which case the width may be not more than 11 percent smaller if used edgewise (as in a rail) or 20 percent smaller if used flatwise (as in a tread).

Douglas fir (coast region)	Pseudotsuga menziesii
Western larch	Larix occidentalis
Southern yellow pine	Pinus taeda, palustris, echinata, elliotii, rigida, virginiana

GROUP 3

The allowable fiber stress in bending for the species listed herein when used for side rails shall not exceed 1,600 pounds per square inch.

Red alder	Alnus ruba, rhombifolia (2)
Oregon ash	Fraxinus latifolia
Pumpkin ash	Fraxinus profunda
Alaska cedar*	Chamaecyparis nootkatensis
Port Orford cedar*	Chamaecyparis lawsoniana
Cucumber	Magnolia acuminata
Cypress*	Taxodium distichum
Soft elm	Ulmus americana, rubra
Douglas fir (Rocky Mountain type)	Pseudotsuga menziesii var. glauca
Noble fir	Abies procera
Gum	Liquidambar styraciflua
West coast hemlock	Tsuga heterophylla
Magnolia	Magnolia grandiflora
Oregon maple	Acer macrophyllum
Norway pine	Pinus resinosa
Poplar	Liriodendron tulipifera
Redwood*	Sequoia sempervirens
Eastern spruce	Picea glauca, rubens
Sitka spruce	Picea sitchensis
Sycamore	Platanus occidentalis
Tamarack	Larix laricina
Tupelo	Nyssa aquatica, sylvatica

GROUP 4

The allowable fiber stress in bending for the species listed herein when used for side rails shall not exceed 1,375 pounds per square inch. These species may be substituted for Group 3 woods on the following basis: The dimensions shall be at least 5 percent greater for each cross-section dimension, or the thickness may remain unchanged, in which case the width shall be at least 7½ percent greater if used edgewise (as in a rail) or 15 percent greater if used flatwise (as in a tread).

Aspen	Populus tremuloides, grandidentata
Basswood	Tilia americana, heterophylla (2)
Buckeye	Aesculusoctandra, glabra (2)
Butternut	Juglanscinerea
Incense cedar*	Libocedrus decurrens
Western red cedar.*	Thuja plicata
Cottonwood	Populus balsamifera, deltoides, sargentii, heterophylla
White fir	Abies concolor, grandis, amabilis, lasiocarpa, magnifica
Hackberry	Celtis occidentalis, laevigata (2)
Eastern hemlock	Tsuga canadensis
Holly	Ilex opaca
Soft maple	Acer saccharinum
Lodgepole pine	Pinus contorta
Idaho white pine	Pinus monticola
Northern white pine.	Pinus strobus
Ponderosa pine	Pinus ponderosa, pinus jeffreyi (Jeffrey pine)
Sugar pine	Pinus lambertiana
Engelmann spruce.	Picea engelmannii

NOTE 1: The common and scientific names of species used conform to the American Lumber Standards nomenclature and in most cases to U.S. Department of Agriculture Handbook No. 41, "Check List of Native and Naturalized Trees of the United States (including Alaska)," by Elbert L. Little. These publications can be obtained from the Superintendent of Documents, Washington, D.C. 20225.

NOTE 2: This species is commonly associated with others of the same genus under American Lumber Standards nomenclature, but no strength tests have been made on it at the Forest Products Laboratory.

NOTE 3: Included under soft maple in American Lumber Standards nomenclature.

NOTE 4: This species is not included under this common name in American Lumber Standards nomenclature, but strength data are available and it is accordingly included in this classification.

§ 1910.26 Portable metal ladders.

(a) *Requirements*—(1) *General.* Specific design and construction requirements are not part of this section because of the wide variety of metals and design possibilities. However, the design shall be such as to produce a ladder without structural defects or accident hazards such as sharp edges, burrs, etc. The metal selected shall be of sufficient strength to meet the test requirements, and shall be protected against corrosion unless inherently corrosion-resistant.

(i) Because of the varied conditions, and the wide variety of ladder uses, ladders may be designed with parallel side rails, with side rails varying uniformly in separation along the length (tapered), or with side rails flaring at the base to increase stability.

(ii) The design of the side rails shall be such as to insure a product which will conform to the requirements of this section.

(iii) The spacing of rungs or steps shall be on 12-inch centers.

(iv) Rungs or steps to side rail connections should be so constructed as to insure rigidity as well as strength.

(v) Rungs and steps shall be corrugated, knurled, dimpled, coated with skid-resistant material, or otherwise treated to minimize the possibility of slipping.

(vi) Hardware shall meet strength requirements of the ladder's component parts, and shall be of a material that is protected against corrosion unless inherently corrosion-resistant. Metals shall be so selected as to avoid excessive galvanic action.

(2) *General specifications — straight and extension ladders.* (i) The minimum width between side rails of a straight ladder or any section of an extension ladder shall be 12 inches.

(ii) The length of single ladders or individual sections of ladders shall not exceed 30 feet. Two-section ladders shall not exceed 48 feet in length and over two-section ladders shall not exceed 60 feet in length.

(iii) Based on the nominal length of the ladder, each section of a multisection ladder shall overlap the adjacent section by at least the number of feet stated in the following:

Nominal length of ladder (feet):	*Overlap (feet)*
Up to and including 36	3
Over 36, up to and including 48	4
Over 48, up to 60	5

(iv) Extension ladders shall be equipped with positive stops which will insure the overlap specified in the table above.

(v) (*a*) Extension ladders may be equipped with a rope and pulley which shall be securely attached to the ladder in such a manner as not to weaken either the rungs or the side rails. The pulley shall be not less than 1¼ inches in diameter.

(*b*) The rope used with the pulley shall be not less than five-sixteenths inch in diameter, having a minimum breaking strength of 560 pounds, and shall be of sufficient length for the purpose intended.

(3) *General specifications—step ladders.* (i) Step ladders shall be designed and constructed to give a minimum slope of 3½ inches per foot of length of the front section, and a minimum slope of 2 inches per foot of length of the back section, except that special ladders designed for straight-in-wall work shall

maintain at least 1¼-inch back slope per foot of length.

(ii) The minimum width between the side rails at the top step shall be 12 inches. The width spread of the side rails shall increase a minimum of 1 inch per foot of length. The width of the step or tread shall not be less than 3 inches.

(iii) The length of a stepladder is measured by the length of the front rail. To be classified as a standard length ladder, the measured length shall be within plus or minus one-half inch of the specified length. Stepladders shall not exceed 20 feet in length.

(iv) The pail shelf shall be designed to fold completely within the ladder.

(v) The back section may be designed with either rungs or cross bracing as long as it meets the general and testing requirements.

(vi) Steps shall be corrugated, knurled, dimpled, coated with skid-resistant materials, or otherwise treated to minimize the possibility of slipping.

(vii) The bottoms of the four rails are to be supplied with insulating nonslip material for the safety of the user.

(viii) A metal spreader or locking device of sufficient size and strength to securely hold the front and back sections in the open position shall be a component of each stepladder. The spreader shall have all sharp points or edges covered or removed to protect the user.

(4) *General specifications—trestles and extension trestle ladders.* (i) Trestle ladders or extension sections or base sections of extension trestle ladders shall be not more than 20 feet in length.

(ii) The minimum distance between side rails of the trestle or extension section at the narrowest point shall not be less than 12½ inches. The width spread shall not be less than 1 inch per foot of length of side rail.

(iii) Spread of base when section is open shall not be less than 5½ inches per foot of base section side rail.

(iv) The extension locking device shall be designed to withstand all load tests.

(v) A metal spreader or locking device of sufficient size and strength to securely hold the front and back sections in the open position shall be a component of each trestle ladder. The spreader shall have all sharp points or edges covered or removed to protect the user.

(5) *General specifications—platform ladders.* (i) The length of a platform ladder shall not exceed 20 feet. The length of a platform ladder shall be measured along the front rail from the floor to the platform.

(ii) Minimum width between side rails at platform level shall be 14 inches. Width spread shall not be less than 1 inch per foot of rise.

(iii) Slope of the front rail when unit is in open position shall not be less than 3½ inches per foot of rise, and the back section shall have a minimum slope of 1 inch per foot of rise..

(iv) The platform shall be at least 20 inches from the top of the ladder, and shall have an area of not less than 200 square inches nor more than 400 square inches.

(v) The back legs and side rails of a platform ladder shall extend at least 20 inches above the platform and shall be connected with the top member to form a three-sided top guard rail, or equivalent construction shall be provided.

(vi) Spreaders shall be provided where the hinging apparatus is not designed to lock the unit open.

(b) *Testing.* (1) *General.* The following tests are intended to insure uniform testing methods for metal ladders.

(2) *Straight and extension ladders.* (i) Ladder inclined strength is measured by placing the ladder unit in a flat, horizontal position, supported 6 inches from the ends of the side rails. When testing extensions, the unit is opened to the required overlap. A load of 200 pounds is applied equally to the side rails at the center of the unit by means of a beam. The ladder must withstand this test with no permanent deformation or other visible weakening of the structure. This test is based on a 200-pound man using the ladder, set at 75½° to the ground. With the man on the center rung, the component of his 200-pound weight at right angles to the ladder will be 50 pounds. Applying the load factor of 4, the test weight becomes 200 pounds.

(ii) Test unit need only be of sufficient length for test purposes and is to consist of the base and fly sections of an extension ladder with all the hardware or fittings attached. The ladder unit is placed in a vertical position and a downward load of 775 pounds equally distributed on the ends of the side rails of the upper portion of the test unit. The unit shall withstand this test with no permanent deformation or other visible weakening of the structure.

(iii) A test unit of at least three rungs is to be used from the maximum width portion of the ladder. A load of 800 pounds shall be applied to a 3½-inch wide block resting on the center of the widest rung. A rung of 14 inches or less in length shall withstand this test with no permanent deformation or other visible weakening of the structure. A rung of more than 14 inches in length may have a permanent defection of not more than one-eighth inch provided the rung cross section is not deformed and there is no other visible weakening of the structure.

(iv) With at least a three-rung test unit set in a vertical position, a load of 800 pounds shall be applied to a 3½-inch wide block resting on the center rungs as near to the side rail as possible. On removing the load, the unit must show no indication of failure in the fasteners attaching the rungs to the side rail.

(v) The rung shall be so secured to the side rail that a torque load of 360 inch-pounds applied to the rung at a side rail shall cause no visible relative motion between the rung and the side rail.

(vi) With the ladder extended to its maximum working length, and resting horizontally on level supports located 6 inches from each end of the ladder, a weight of 50 pounds shall be suspended from one of the side rails midway between supports.

The deflection of the loaded rail, and the difference in deflection between the loaded and unloaded rails shall not exceed the values in Table D–6.

(vii) Deflections in Table D–6 are to be determined by measuring, at the midpoint between supports, the distance from the outside edges of both rails to the floor or other reference surface both before and after the test load of 50 pounds is applied to one rail of the ladder. The test is to be repeated loading the other rail of the ladder. The angle between the loaded and unloaded rails and the horizontal is to be calculated from the trigonometric equation:

$$\text{Sine } a = \frac{\text{Difference in deflection}}{\text{Ladder width}}$$

TABLE D–6—TABLE OF DEFLECTIONS

Length of ladder in feet	Maximum deflection of loaded rail in inches	Maximum difference in deflection between loaded and unloaded rails in degrees from horizontal
20	3.0	3.6
24	3.8	4.7
28	4.6	5.4
32	5.5	5.7
36	6.4	6.1
40	7.2	6.5
44	8.0	6.5
48	8.8	6.5

(3) *Step, trestle, extension trestle, and platform ladders.* (i) (*a*) Load test of the entire ladder is made with the ladder in an open position, and an 800-pound load applied to the center of the top. Resistance to side rail bending is tested by placing an 800-pound load on the center of the middle step. The strength of the step section is tested by applying an 800-pound load to a 3½-inch-wide block resting on the center of the longest or bottom step. The pail shelf shall be so constructed as to support a distributed load of 50 pounds.

(*b*) In each test case, the unit must withstand the load without failure or permanent deformation.

(ii) Set ladder in open position on a level floor. Place a 200-pound distributed load on the top step. The ladder is then subjected to a horizontal pulling load, applied at the top step, of 12-pound force to the side; 58-pound force to the front; 33-pound force to the back. In each test, all side rails must remain on the floor.

(*c*) *Care and maintenance of ladders*—(1) *General.* To get maximum serviceability, safety, and to eliminate unnecessary damage of equipment, good safe practices in the use and care of ladder equipment must be employed by the users.

The following rules and regulations are essential to the life of the equipment and the safety of the user.

(2) *Care of ladders.* (i) Ladders, like any tool, must be handled with care and not subject to unnecessary dropping,

jarring, or misuse. They are designed for a specific purpose or use; therefore, any variation from this use constitutes a mishandling of the equipment.

(ii) Ladders should be stored on racks designed to protect the ladder when not in use. The racks should have sufficient supporting points to prevent any possibility of excessive sagging.

(iii) Ladders transported on vehicles must be properly supported. Supporting points should be of a softer material, such as hardwood or rubber-covered iron pipe, to minimize the chafing and effects of road shock. Tying the ladder to each support point will greatly reduce damage due to road shock.

(iv) Ladders must be maintained in good usable condition at all times. Hardware fittings and accessories should be checked frequently and kept in good working condition.

(v) Ropes or cables should be inspected frequently and replaced if defective.

(vi) Complete ladder inspection should be periodical. If a ladder is involved in any of the following, immediate inspection is necessary:

(*a*) If ladders tip over, inspect ladder for side rails dents or bends, or excessively dented rungs; check all rung-to-side-rail connections; check hardware connections; check rivets for shear.

(*b*) If ladders are exposed to excessive heat as in the case of fire, the ladder should be inspected visually for damage and tested for deflection and strength characteristics. In doubtful cases, refer to manufacturer.

(*c*) If ladders are to be subjected to certain acids or alkali solutions, a protective coating such as asphalt and varnish should be applied to the equipment.

(*d*) If ladders are exposed to oil and grease, equipment should be cleaned of oil, grease, or slipperly materials. This can easily be done with a solvent or steam cleaning.

(vii) Ladders having defects are to be marked and taken out of service until repaired by either maintenance department or the manufacturer.

(3) *Use of ladders.* (i) Portable nonself-supporting ladders should be erected at a pitch of 75½ degrees for maximum balance and strength. A simple rule for setting up a ladder at the proper angle is to place the base a distance from the vertical wall equal to one-fourth the working length of the ladder.

(ii) Portable ladders are designed as a one-man working ladder based on a 200-pound load.

(iii) The ladder base section must be placed with a secure footing. Safety shoes of good substantial design should be installed on all ladders. Where ladders with no safety shoes or spikes are used on hard, slick surfaces, a foot-ladder board should be employed.

(iv) The top of the ladder must be placed with the two rails supported, unless equipped with a single support attachment. Such an attachment should be substantial and large enough to support the ladder under load.

(v) When ascending or descending, the climber must face the ladder.

(vi) Ladders must not be tied or fastened together to provide longer sections. They must be equipped with the hardware fittings necessary if the manufacturer endorses extended uses.

(vii) Ladders should not be used as a brace, skid, guy or gin pole, gangway, or for other uses than that for which they were intended, unless specifically recommended for use by the manufacturer.

(viii) Users are cautioned to take proper safety measures when metal ladders are used in areas containing electric circuits to prevent short circuits or electrical shock. The ordinary precautions should be employed as would be used when using any other metal tool.

§ 1910.27 Fixed ladders.

(a) *Design requirements*—(1) *Design considerations.* All ladders, appurtenances, and fastenings shall be designed to meet the following load requirements:

(i) The minimum design live load shall be a single concentrated load of 200 pounds.

(ii) The number and position of additional concentrated live-load units of 200 pounds each as determined from anticipated usage of the ladder shall be considered in the design.

(iii) The live loads imposed by persons occupying the ladder shall be considered to be concentrated at such points as will cause the maximum stress in the structural member being considered.

(iv) The weight of the ladder and attached appurtenances together with the live load shall be considered in the design of rails and fastenings.

(2) *Design stresses.* Design stresses for wood components of ladders shall not exceed those specified in § 1910.25. All wood parts of fixed ladders shall meet the requirements of § 1910.25(b).

For fixed ladders consisting of wood side rails and wood rungs or cleats, used at a pitch in the range 75 degrees to 90 degrees, and intended for use by no more than one person per section, single ladders as described in § 1910.25(c)(3)(ii) are acceptable.

(b) *Specific features*—(1) *Rungs and cleats.* (i) All rungs shall have a minimum diameter of three-fourths inch for metal ladders, except as covered in subparagraph (7)(i) of this paragraph, and a minimum diameter of 1⅛ inches for wood ladders.

(ii) The distance between rungs, cleats, and steps shall not exceed 12 inches and shall be uniform throughout the length of the ladder.

(iii) The minimum clear length of rungs or cleats shall be 16 inches.

(iv) Rungs, cleats, and steps shall be free of splinters, sharp edges, burrs, or projections which may be a hazard.

(v) The rungs of an individual-rung ladder shall be so designed that the foot cannot slide off the end. A suggested design is shown in figure D–1.

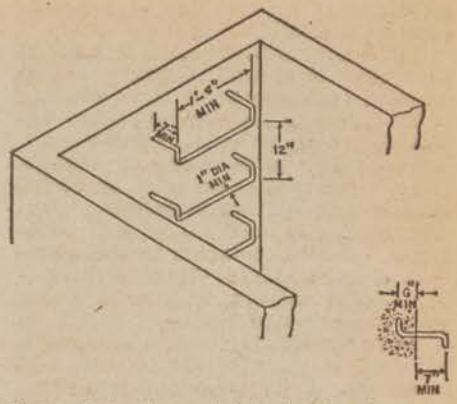

FIGURE D–1.—Suggested design for rungs on individual-rung ladders.

(2) *Side rails.* Side rails which might be used as a climbing aid shall be of such cross sections as to afford adequate gripping surface without sharp edges, splinters, or burrs.

(3) *Fastenings.* Fastenings shall be an integral part of fixed ladder design.

(4) *Splices.* All splices made by whatever means shall meet design requirements as noted in paragraph (a) of this section. All splices and connections shall have smooth transition with original members and with no sharp of extensive projections.

(5) *Electrolytic action.* Adequate means shall be employed to protect dissimilar metals from electrolytic action when such metals are joined.

(6) *Welding.* All welding shall be in accordance with the "Code for Welding in Building Construction" (AWS D1.0–1966).

(7) *Protection from deterioration.* (i) Metal ladders and appurtenances shall be painted or otherwise treated to resist corrosion and rusting when location demands. Ladders formed by individual metal rungs imbedded in concrete, which serves as access to pits and to other areas under floors, are frequently located in an atmosphere that causes corrosion and rusting. To increase rung life in such atmosphere, individual metal rungs shall have a minimum diameter of 1 inch or shall be painted or otherwise treated to resist corrosion and rusting.

(ii) Wood ladders, when used under conditions where decay may occur, shall be treated with a nonirritating preservative, and the details shall be such as to prevent or minimize the accumulation of water on wood parts.

(ii) When different types of materials are used in the construction of a ladder, the materials used shall be so treated as to have no deleterious effect one upon the other.

(c) *Clearance*—(1) *Climbing side.* On fixed ladders, the perpendicular distance from the centerline of the rungs to the nearest permanent object on the climbing side of the ladder shall be 36 inches for a pitch of 76 degrees, and 30 inches for a pitch of 90 degrees (fig. D–2 of this section), with minimum clearances for intermediate pitches varying between these two limits in proportion to the

slope, except as provided in subparagraphs (3) and (5) of this paragraph.

(2) *Ladders without cages or wells.* A clear width of at least 15 inches shall be provided each way from the centerline of the ladder in the climbing space, except when cages or wells are necessary.

(3) *Ladders with cages or baskets.* Ladders equipped with cage or basket are excepted from the provisions of subparagraphs (1) and (2) of this paragraph, but shall conform to the provisions of paragraph (d)(1)(v) of this section. Fixed ladders in smooth-walled wells are excepted from the provisions of subparagraph (1) of this paragraph, but shall conform to the provisions of paragraph (d)(1)(vi) of this section.

(4) *Clearance in back of ladder.* The distance from the centerline of rungs, cleats, or steps to the nearest permanent object in back of the ladder shall be not less than 7 inches, except that when unavoidable obstructions are encountered, minimum clearances as shown in figure D–3 shall be provided.

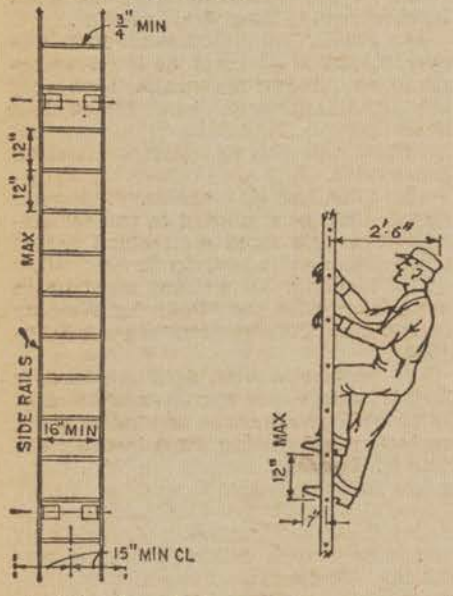

RAIL LADDER WITH BAR STEEL RAILS AND ROUND STEEL RUNGS

FIG. D-2

Minimum Ladder Clearances

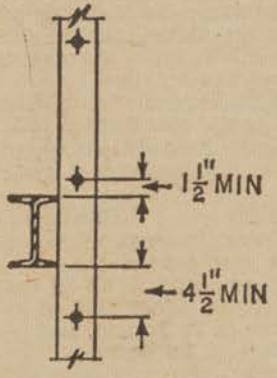

FIG. D-3

Clearance for Unavoidable Obstruction at Rear of Fixed Ladder

(5) *Clearance in back of grab bar.* The distance from the centerline of the grab bar to the nearest permanent object in back of the grab bars shall be not less than 4 inches. Grab bars shall not protrude on the climbing side beyond the rungs of the ladder which they serve.

(6) *Step-across distance.* The step-across distance from the nearest edge of ladder to the nearest edge of equipment or structure shall be not more than 12 inches, or less than 2½ inches (fig. D–4).

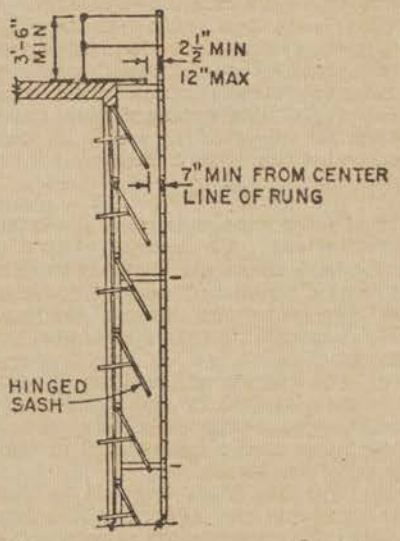

FIG. D-4

Ladder Far from Wall

(7) *Hatch cover.* Counterweighted hatch covers shall open a minimum of 60 degrees from the horizontal. The distance from the centerline of rungs or cleats to the edge of the hatch opening on the climbing side shall be not less than 24 inches for offset wells or 30 inches for straight wells. There shall be no protruding potential hazards within 24 inches of the centerline of rungs or cleats; any such hazards within 30 inches of the centerline of the rungs or cleats shall be fitted with deflector plates placed at an angle of 60 degrees from the horizontal as indicated in figure D–5. The relationship of a fixed ladder to an acceptable counterweighted hatch cover is illustrated in figure D–6.

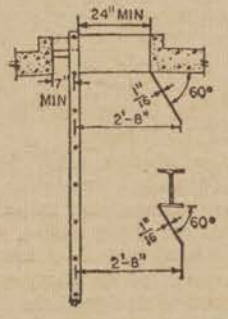

Deflector Plates for Head Hazards

FIG. D-5

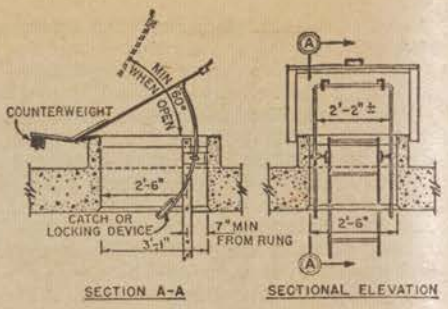

Relationship of Fixed Ladder to a Safe Access Hatch

FIG. D-6

(d) *Special requirements*—(1) *Cages or wells.* (i) Cages or wells (except on chimney ladders) shall be built, as shown on the applicable drawings, covered in detail in figures D–7, D–8, and D–9, or of equivalent construction.

(ii) Cages or wells (except as provided in subparagraph (5) of this paragraph) conforming to the dimensions shown in figures D–7, D–8, and D–9 shall be provided on ladders of more than 20 feet to a maximum unbroken length of 30 feet.

(iii) Cages shall extend a minimum of 42 inches above the top of landing, unless other acceptable protection is provided.

(iv) Cages shall extend down the ladder to a point not less than 7 feet nor more than 8 feet above the base of the ladder, with bottom flared not less than 4 inches, or portion of cage opposite ladder shall be carried to the base.

(v) Cages shall not extend less than 27 nor more than 28 inches from the centerline of the rungs of the ladder. Cage shall not be less than 27 inches in width. The inside shall be clear of projections. Vertical bars shall be located at a maximum spacing of 40 degrees around the circumference of the cage; this will give a maximum spacing of approximately 9½ inches, center to center.

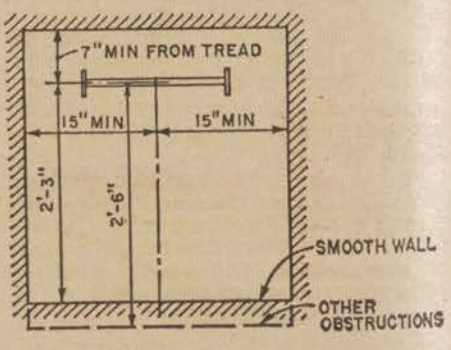

Clearance Diagram for Fixed Ladder in Well

Figure D-7

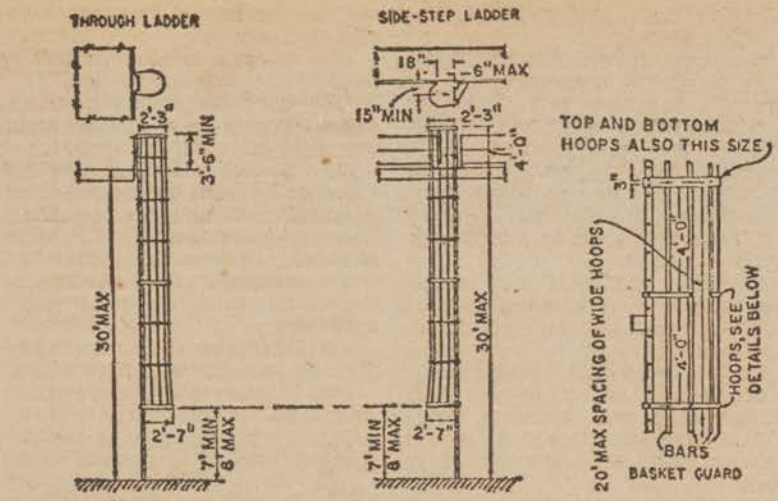

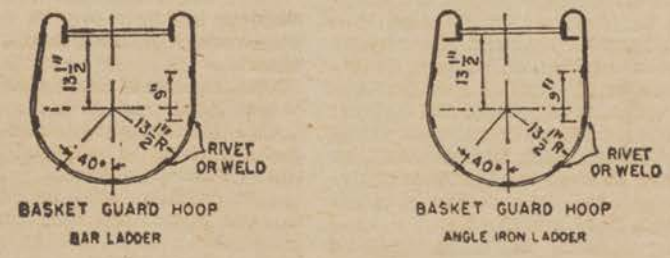

Fig. D-8

Cages for Ladders More Than 20 Feet High

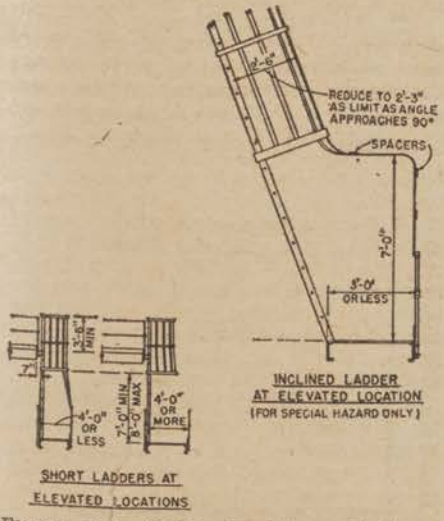

FIGURE D-9.—Cages—Special applications.

(vi) Ladder wells shall have a clear width of at least 15 inches measured each way from the centerline of the ladder. Smooth-walled wells shall be a minimum of 27 inches from the centerline of rungs to the well wall on the climbing side of the ladder. Where other obstructions on the climbing side of the ladder exist, there shall be a minimum of 30 inches from the centerline of the rungs.

(2) *Landing platforms.* When ladders are used to ascend to heights exceeding 20 feet (except on chimneys), landing platforms shall be provided for each 30 feet of height or fraction thereof, except that, where no cage, well, or ladder safety device is provided, landing platforms shall be provided for each 20 feet of height or fraction thereof. Each ladder section shall be offset from adjacent sections. Where installation conditions (even for a short, unbroken length) require that adjacent sections be offset, landing platforms shall be provided at each offset.

(i) Where a man has to step a distance greater than 12 inches from the centerline of the rung of a ladder to the nearest edge of structure or equipment, a landing platform shall be provided. The minimum step-across distance shall be 2½ inches.

(ii) All landing platforms shall be equipped with standard railings and toeboards, so arranged as to give safe access to the ladder. Platforms shall be not less than 24 inches in width and 30 inches in length.

(iii) One rung of any section of ladder shall be located at the level of the landing laterally served by the ladder. Where access to the landing is through the ladder, the same rung spacing as used on the ladder shall be used from the landing platform to the first rung below the landing.

(3) *Ladder extensions.* The side rails of through or side-step ladder extensions shall extend 3½ feet above parapets and landings. For through ladder extensions, the rungs shall be omitted from the extension and shall have not less than 18 nor more than 24 inches clearance between rails. For side-step or offset fixed ladder sections, at landings, the side rails and rungs shall be carried to the next regular rung beyond or above the 3½ feet minimum (fig. D–10).

(4) *Grab bars.* Grab bars shall be spaced by a continuation of the rung spacing when they are located in the horizontal position. Vertical grab bars shall have the same spacing as the ladder side rails. Grab-bar diameters shall be the equivalent of the round-rung diameters.

(5) *Ladder safety devices.* Ladder safety devices may be used on tower, water tank, and chimney ladders over 20 feet in unbroken length in lieu of cage protection. No landing platform is required in these cases. All ladder safety devices such as those that incorporate lifebelts, friction brakes, and sliding attachments shall meet the design requirements of the ladders which they serve.

(e) *Pitch*—(1) *Preferred pitch.* The preferred pitch of fixed ladders shall be considered to come in the range of 75 degrees and 90 degrees with the horizontal (fig. D–11).

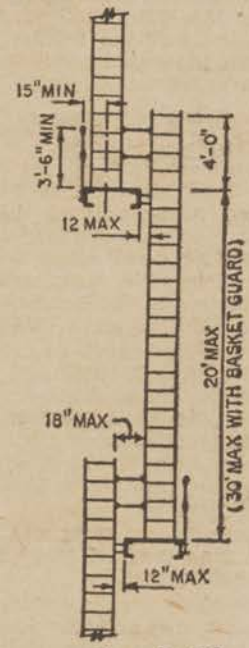

FIG. D-10

Offset Fixed Ladder Sections

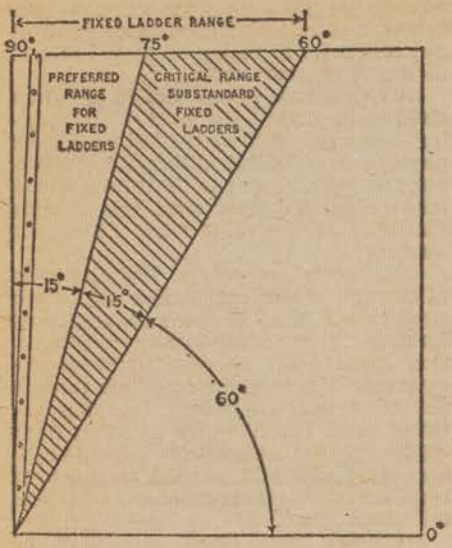

FIG. D-11

Pitch of Fixed Ladders

(2) *Substandard pitch.* Fixed ladders shall be considered as substandard if they are installed within the substandard pitch range of 60 and 75 degrees with the horizontal. Substandard fixed ladders are permitted only where it is found necessary to meet conditions of installation. This substandard pitch range shall be considered as a critical range to be avoided, if possible.

(3) *Scope of coverage in this section.* This section covers only fixed ladders within the pitch range of 60 degrees and 90 degrees with the horizontal.

(4) *Pitch greater than 90 degrees.* Ladders having a pitch in excess of 90 degrees with the horizontal are prohibited.

(f) *Maintenance.* All ladders shall be maintained in a safe condition. All ladders shall be inspected regularly, with the intervals between inspections being determined by use and exposure.

§ 1910.28 Safety requirements for scaffolding.

(a) *General requirements for all scaffolds.* (1) Scaffolds shall be furnished and erected in accordance with this standard for persons engaged in work that cannot be done safely from the ground or from solid construction, except that ladders used for such work shall conform to § 1910.25 and § 1910.26.

(2) The footing or anchorage for scaffolds shall be sound, rigid, and capable of carrying the maximum intended load without settling or displacement. Unstable objects such as barrels, boxes, loose brick, or concrete blocks shall not be used to support scaffolds or planks.

(3) Guardrails and toeboards shall be installed on all open sides and ends of platforms more than 10 feet above the ground or floor except.

(i) Scaffolding wholly within the interior of a building and covering the entire floor area of any room therein and not having any side exposed to a hoistway, elevator shaft, stairwell, or other floor opening, and

(ii) Needle-beam scaffolds and floats in use by structural iron workers.

Guardrails should all be 2 x 4 inches or the equivalent, installed no less than 36 inches or not more than 42 inches high, with a midrail, when required, of 1- x 4-inch lumber or equivalent. Supports should be at intervals not to exceed ten feet. Toeboards shall be a minimum of 4 inches in height.

(4) Scaffolds and their components shall be capable of supporting without failure at least four times the maximum intended load.

(5) Scaffolds and other devices mentioned or described in this section shall be maintained in safe condition. Scaffolds shall not be altered or moved horizontally while they are in use or occupied.

(6) Any scaffold damaged or weakened from any cause shall be immediately repaired and shall not be used until repairs have been completed.

(7) Scaffolds shall not be loaded in excess of the working load for which they are intended.

(8) All load-carrying timber members of scaffold framing shall be a minimum of 1,500 *f.* (Stress Grade) construction grade lumber. All dimensions are nominal sizes as provided in the American Lumber Standards, except that where rough sizes are noted, only rough or undressed lumber of the size specified will satisfy minimum requirements. (NOTE: Where nominal sizes of lumber are used in place of rough sizes, the nominal size lumber shall be such as to provide equivalent strength to that specified in tables D–7 through D–12 and D–16.)

(9) All planking shall be Scaffold Grade as recognized by grading rules for the species of wood used. The maximum permissible spans for 2- x 9-inch or wider planks are shown in the following table:

	Material				
	Full thickness undressed lumber			Nominal thickness lumber	
Working load (p.s.f.)	25	50	75	25	50
Permissible span (ft.)	10	8	6	8	6

The maximum permissible span for 1¼ x 9-inch or wider plank of full thickness is 4 feet with medium loading of 50 p.s.f.

(10) Nails or bolts used in the construction of scaffolds shall be of adequate size and in sufficient numbers at each connection to develop the designed strength of the scaffold. Nails shall not be subjected to a straight pull and shall be driven full length.

(11) All planking or platforms shall be overlapped (minimum 12 inches) or secured from movement.

(12) An access ladder or equivalent safe access shall be provided.

(13) Scaffold planks shall extend over their end supports not less than 6 inches nor more than 18 inches.

(14) The poles, legs, or uprights of scaffolds shall be plumb, and securely and rigidly braced to prevent swaying and displacement.

(15) Materials being hoisted onto a scaffold shall have a tag line.

(16) Overhead protection shall be provided for men on a scaffold exposed to overhead hazards.

(17) Scaffolds shall be provided with a screen between the toeboard and the guardrail, extending along the entire opening, consisting of No. 18 gauge U.S. Standard Wire one-half-inch mesh or the equivalent, where persons are required to work or pass under the scaffolds.

(18) Employees shall not work on scaffolds during storms or high winds.

(19) Employees shall not work on scaffolds which are covered with ice or snow, unless all ice or snow is removed and planking sanded to prevent slipping.

(20) Tools, materials, and debris shall not be allowed to accumulate in quantities to cause a hazard.

(21) Only treated or protected fiber rope shall be used for or near any work involving the use of corrosive substances or chemicals.

(22) Wire or fiber rope used for scaffold suspension shall be capable of supporting at least six times the intended load.

(23) When acid solutions are used for cleaning buildings over 50 feet in height, wire rope supported scaffolds shall be used.

(24) The use of shore scaffolds or lean-to scaffolds is prohibited.

(25) Lumber sizes, when used in this section, refer to nominal sizes except where otherwise stated.

(26) Scaffolds shall be secured to permanent structures, through use of anchor bolts, reveal bolts, or other equivalent means. Window cleaners' anchor bolts shall not be used.

(27) Special precautions shall be taken to protect scaffold members, including any wire or fiber ropes, when using a heat-producing process.

(b) *General requirements for wood pole scaffolds.* (1) Scaffold poles shall bear on a foundation of sufficient size and strength to spread the load from the poles over a sufficient area to prevent settlement. All poles shall be set plumb.

(2) Where wood poles are spliced, the ends shall be squared and the upper section shall rest squarely on the lower section. Wood splice plates shall be provided on at least two adjacent sides and shall not be less than 4 feet 0 inches in length, overlapping the abutted ends equally, and have the same width and not less than the cross-sectional area of the pole. Splice plates of other materials of equivalent strength may be used.

(3) Independent pole scaffolds shall be set as near to the wall of the building as practicable.

(4) All pole scaffolds shall be securely guyed or tied to the building or structure. Where the height or length exceeds 25 feet, the scaffold shall be secured at intervals not greater than 25 feet vertically and horizontally.

(5) Putlogs or bearers shall be set with their greater dimensions vertical, long

enough to project over the ledgers of the inner and outer rows of poles at least 3 inches for proper support.

(6) Every wooden putlog on single pole scaffolds shall be reinforced with a 3/16 x 2-inch steel strip or equivalent secured to its lower edge throughout its entire length.

(7) Ledgers shall be long enough to extend over two pole spaces. Ledgers shall not be spliced between the poles. Ledgers shall be reinforced by bearing blocks securely nailed to the side of the pole to form a support for the ledger.

(8) Diagonal bracing shall be provided to prevent the poles from moving in a direction parallel with the wall of the building, or from buckling.

(9) Cross bracing shall be provided between the inner and outer sets of poles in independent pole scaffolds. The free ends of pole scaffolds shall be cross braced.

(10) Full diagonal face bracing shall be erected across the entire face of pole scaffolds in both directions. The braces shall be spliced at the poles.

(11) Platform planks shall be laid with their edges close together so the platform will be tight with no spaces through which tools or fragments of material can fall.

(12) Where planking is lapped, each plank shall lap its end supports at least 12 inches. Where the ends of planks abut each other to from a flush floor, the butt joint shall be at the centerline of a pole. The abutted ends shall rest on separate bearers. Intermediate beams shall be provided where necessary to prevent dislodgment of planks due to deflection, and the ends shall be nailed or cleated to prevent their dislodgment.

(13) When a scaffold turns a corner, the platform planks shall be laid to prevent tipping. The planks that meet the corner putlog at an angle shall be laid first, extending over the diagonally placed putlog far enough to have a good safe bearing, but not far enough to involve any danger from tipping. The planking running in the opposite direction at right angles shall be laid so as to extend over and rest on the first layer of planking.

(14) When moving platforms to the next level, the old platform shall be left undisturbed until the new putlogs or bearers have been set in place, ready to receive the platform planks.

(15) Guardrails not less than 2 x 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1 x 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(16) All wood pole scaffolds 60 feet or less in height shall be constructed and erected in accordance with tables D–7 through D–12 of this section. If they are over 60 feet in height they shall be designed by a registered professional engineer and constructed and erected in accordance with such design. A copy of the typical drawings and specifications shall be made available to the employer and for inspection purposes.

(17) Wood-pole scaffolds shall not be erected beyond the reach of effective fire-fighting apparatus.

TABLE D–7—MINIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF SINGE POLE SCAFFOLDS LIGHT DUTY

	Maximum height of scaffold	
	20 feet	60 feet
Uniformly distributed load	Not to exceed 25 pounds per square foot.	
Poles or uprights	2 by 4 in	4 by 4 in.
Pole spacing (longitudinal)	6 ft. 0 in	10 ft. 0 in.
Maximum width of scaffold	5 ft. 0 in	5 ft. 0 in.
Bearers or putlogs to 30 ft. 0 in. width	2 by 4 in	2 by 4 in.
Bearers or putlogs to 5 ft. 0 in. width	2 by 6 in. or 3 by 4 in	2 by 6 in. or 3 by 4 in. (rough).
Ledgers	1 by 4 in	1¼ by 9 in.
Planking	1¼ by 9 in. (rough)	2 by 9 in.
Vertical spacing of horizontal members	7 ft. 0 in	7 ft. 0 in.
Bracing, horizontal and diagonal	1 by 4 in	1 by 4 in.
Tie-ins	1 by 4 in	1 by 4 in.
Toeboards	4 in. high (minimum)	4 in. high (minimum).
Guardrail	2 by 4 in	2 by 4 in.

All members except planking are used on edge.

TABLE D–8—MINIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF SINGLE POLE SCAFFOLDS

MEDIUM DUTY

Uniformly distributed load.	Not to exceed 50 pounds per square foot.
Maximum height of scaffold.	60 ft.
Poles or uprights	4 by 4 in.
Pole spacing (longitudinal).	8 ft. 0 in.
Maximum width of scaffold.	5 ft. 0 in.
Bearers or putlogs	2 by 9 in. or 3 by 4 in.
Spacing of bearers or putlogs.	8 ft. 0 in.
Ledgers	2 by 9 in.
Vertical spacing of horizontal members.	9 ft. 0 in.
Bracing, horizontal	1 by 6 in. or 1¼ by 4 in.
Bracing, diagonal	1 by 4 in.
Tie-ins	1 by 4 in.
Planking	2 by 9 in.
Toeboards	4 in. high (minimum).
Guardrail	2 by 4 in.

All members except planking are used on edge.

TABLE D–9—MIMIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF SINGLE POLE SCAFFOLDS

HEAVY DUTY

Uniformly distributed load.	Not to exceed 75 pounds per square foot.
Maximum height of scaffold.	60 ft.
Poles or uprights	4 by 4 in.
Pole spacing (longitudinal).	6 ft. 0 in.
Maximum width of scaffold.	5 ft. 0 in.
Bearers or putlogs	2 by 9 in. or 3 by 5 in. (rough).
Spacing of bearers or putlogs.	6 ft. 0 in.
Ledgers	2 by 9 in.
Vertical spacing of horizontal members.	6 ft. 6 in.
Bracing, horizontal and diagonal.	2 by 4 in.
Tie-ins	1 by 4 in.
Planking	2 by 9 in.
Toeboards	4 in. high (minimum).
Guardrail	2 by 4 in.

All members except planking are used on edge.

TABLE D–10—MINIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF INDEPENDENT POLE SCAFFOLDS LIGHT DUTY

	Maximum height of scaffold	
	20 feet	60 feet
Uniformly distributed load	Not to exceed 25 pounds per square foot.	
Poles or uprights	2 by 4 in	4 by 4 in.
Pole spacing (longitudinal)	6 ft. 0 in	10 ft. 0 in.
Pole spacing (transverse)	6 ft. 0 in	10 ft. 0 in.
Ledgers	1¼ by 4 in	1¼ by 9 in.
Bearers to 3 ft. 0 in. span	2 by 4 in	2 by 4 in.
Bearers to 10 ft. 0 in. span	2 by 6 in. or 3 by 4 in	2 by 9 (rough) or 3 by 8 in.
Planking	1¼ by 9 in	2 by 9 in.
Vertical spacing of horizontal members	7 ft. 0 in	7 ft. 0 in.
Bracing, horizontal and diagonal	1 by 4 in	1 by 4 in.
Tie-ins	1 by 4 in	1 by 4 in.
Toeboards	4 in. high	4 in. high (minimum).
Guardrail	2 by 4 in	2 by 4 in.

All members except planking are used on edge.

TABLE D-11—MINIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF INDEPENDENT POLE SCAFFOLDS

MEDIUM DUTY

Uniformly distributed load.	Not to exceed 50 pounds per square foot.
Maximum height of scaffold.	60 ft.
Poles or uprights	4 by 4 in.
Pole spacing (longitudinal).	8 ft. 0 in.
Pole spacing (transverse).	8 ft. 0 in.
Ledgers	2 by 9 in.
Vertical spacing of horizontal members.	6 ft. 0 in.
Spacing of bearers	8 ft. 0 in.
Bearers	2 by 9 in. (rough) or 2 by 10 in.
Bracing, horizontal	1 by 6 in. or 1¼ by 4 in.
Bracing, diagonal	1 by 4 in.
Tie-ins	1 by 4 in.
Planking	2 by 9 in.
Toeboards	4 in. high (minimum).
Guardrail	2 by 4 in.

All members except planking are used on edge.

TABLE D-12—MINIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF INDEPENDENT POLE SCAFFOLDS

HEAVY DUTY

Uniformly distributed load.	Not to exceed 75 pounds per square foot.
Maximum height of scaffold.	60 ft.
Poles or uprights	4 by 4 in.
Pole spacing (longitudinal).	6 ft. 0 in.
Pole spacing (transverse).	8 ft. 0 in.
Ledgers	2 by 9 in.
Vertical spacing of horizontal members.	4 ft. 6 in.
Bearers	2 by 9 in. (rough).
Bracing, horizontal and diagonal.	2 by 4 in.
Tie-ins	1 by 4 in.
Planking	2 by 9 in.
Toeboards	4 in. high (minimum).
Guardrail	2 by 4 in.

All members except planking are used on edge.

TABLE D-13—TUBE AND COUPLER SCAFFOLDS LIGHT DUTY

Uniformly distributed load..... Not to exceed 25 p.s.f.
Post spacing (longitudinal)..... 10 ft. 0 in.
Post spacing (transverse)..... 6 ft. 0 in.

Working levels	Additional planked levels	Maximum height
1	8	125 ft.
2	4	125 ft.
3	0	91 ft. 0 in.

TABLE D-14—TUBE AND COUPLER SCAFFOLDS MEDIUM DUTY

Uniformly distributed load..... Not to exceed 50 p.s.f.
Post spacing (longitudinal)..... 8 ft. 0 in.
Post spacing (transverse)..... 6 ft. 0 in.

Working levels	Additional planked levels	Maximum height
1	6	125 ft.
2	0	78 ft. 0 in.

TABLE D-15—TUBE AND COUPLER SCAFFOLDS HEAVY DUTY

Uniformly distributed load..... Not to exceed 75 p.s.f.
Post spacing (longitudinal)..... 6 ft. 6 in.
Post spacing (traverse)..... 6 ft. 0 in.

Working levels	Additional planked levels	Maximum height
1	6	125 ft.

(c) *Tube and coupler scaffolds.* (1) A light-duty tube and coupler scaffold shall have all posts, bearers, runners, and bracing of nominal 2-inch O.D. steel tubing. The posts shall be spaced no more than 6 feet apart by 10 feet along the length of the scaffold. Other structural metals when used must be designed to carry an equivalent load.

(2) A medium-duty tube and coupler scaffold shall have all posts, runners, and bracing of nominal 2-inch O.D. steel tubing. Posts spaced not more than 6 feet apart by 8 feet along the length of the scaffold shall have bearers of nominal 2½-inch O.D. steel tubing. Posts spaced not more than 5 feet apart by 8 feet along the length of the scaffold shall have bearers of nominal 2-inch O.D. steel tubing. Other structural metals when used must be designed to carry an equivalent load.

(3) A heavy-duty tube and coupler scaffold shall have all posts, runners, and bracing of nominal 2-inch O.D. steel tubing, with the posts spaced not more than 6 feet apart by 6 feet 6 inches along the length of the scaffold. Other structural metals when used must be designed to carry an equivalent load.

(4) Tube and coupler scaffolds shall be limited in heights and working levels to those permitted in tables D-13, 14, and 15, of this section. Drawings and specifications of all tube and coupler scaffolds above the limitations in tables D-13, 14, and 15 of this section shall be designed by a registered professional engineer and copies made available to the employer and for inspection purposes.

(5) All tube and coupler scaffolds shall be constructed and erected to support four times the maximum intended loads as set forth in tables D-13, 14, and 15 of this section, or as set forth in the specifications by a registered professional engineer, copies which shall be made available to the employer and for inspection purposes.

(6) All tube and coupler scaffolds shall be erected by competent and experienced personnel.

(7) Posts shall be accurately spaced, erected on suitable bases, and maintained plumb.

(8) Runners shall be erected along the length of the scaffold located on both the inside and the outside posts at even height. Runners shall be interlocked to form continuous lengths and coupled to each post. The bottom runners shall be located as close to the base as possible. Runners shall be placed not more than 6 feet 6 inches on centers.

(9) Bearers shall be installed transversely between posts and shall be securely coupled to the posts bearing on the runner coupler. When coupled directly to the runners, the coupler must be kept as close to the posts as possible.

(10) Bearers shall be at least 4 inches but not more than 12 inches longer than the post spacing or runner spacing. Bearers may be cantilevered for use as brackets to carry not more than two planks.

(11) Cross bracing shall be installed across the width of the scaffold at least every third set of posts horizontally and every fourth runner vertically. Such bracing shall extend diagonally from the inner and outer runners upward to the next outer and inner runners.

(12) Longitudinal diagonal bracing shall be installed at approximately a 45-degree angle from near the base of the first outer post upward to the extreme top of the scaffold. Where the longitudinal length of the scaffold permits, such bracing shall be duplicated beginning at every fifth post. In a similar manner, longitudinal diagonal bracing shall also be installed from the last post extending back and upward toward the first post. Where conditions preclude the attachment of this bracing to the posts, it may be attached to the runners.

(13) The entire scaffold shall be tied to and securely braced against the building at intervals not to exceed 30 feet horizontally and 26 feet vertically.

(14) Guardrails not less than 2×4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1×4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(d) *Tubular welded frame scaffolds.* (1) Metal tubular frame scaffolds, including accessories such as braces, brackets, trusses, screw legs, ladders, etc., shall be designed and proved to safely support four times the maximum intended load.

(2) Spacing of panels or frames shall be consistent with the loads imposed.

(3) Scaffolds shall be properly braced by cross bracing or diagonal braces, or both, for securing vertical members together laterally, and the cross braces shall be of such length as will automatically square and align vertical members so that the erected scaffold is always plumb, square, and rigid. All brace connections shall be made secure.

(4) Scaffold legs shall be set on adjustable bases or plain bases placed on mud sills or other foundations adequate to support the maximum intended load.

(5) The frames shall be placed one on top of the other with coupling or stacking pins to provide proper vertical alinement of the legs.

(6) Where uplift may occur, panels shall be locked together vertically by pins or other equivalent suitable means.

(7) Guardrails not less than 2 x 4 inches or the equivalent and not less than 36 inches or more than 42 inches high,

with a mid-rail, when required, of 1- x 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(8) All tubular metal scaffolds shall be constructed and erected to support four times the maximum intended loads.

(9) To prevent movement, the scaffold shall be secured to the building or structure at intervals not to exceed 30 feet horizontally and 26 feet vertically.

(10) Maximum permissible spans of planking shall be in conformity with paragraph (a)(9) of this section.

(11) Drawings and specifications for all frame scaffolds over 125 feet in height above the base plates shall be designed by a registered professional engineer and copies made available to the employer and for inspection purposes.

(12) All tubular welded frame scaffolds shall be erected by competent and experienced personnel.

(13) Frames and accessories for scaffolds shall be maintained in good repair and every defect, unsafe condition, or noncompliance with this section shall be immediately corrected before further use of the scaffold. Any broken, bent, excessively rusted, altered, or otherwise structurally damaged frames or accessories shall not be used.

(14) Periodic inspections shall be made of all welded frames and accessories, and any maintenance, including painting, or minor corrections authorized by the manufacturer, shall be made before further use.

(e) *Outrigger scaffolds.* (1) Outrigger beams shall extend not more than 6 feet beyond the face of the building. The inboard end of outrigger beams, measured from the fulcrum point to the extreme point of support, shall be not less than one and one-half times the outboard end in length. The beams shall rest on edge, the sides shall be plumb, and the edges shall be horizontal. The fulcrum point of the beam shall rest on a secure bearing at least 6 inches in each horizontal dimension. The beam shall be secured in place against movement and shall be securely braced at the fulcrum point against tipping.

(2) The board ends of outrigger beams shall be securely supported either by means of struts bearing against sills in contact with the overhead beams or ceiling, or by means of tension members secured to the floor joists underfoot, or by both if necessary. The inboard ends of outrigger beams shall be secured against tipping and the entire supporting structure shall be securely braced in both directions to prevent any horizontal movement.

(3) Unless outrigger scaffolds are designed by a licensed professional engineer, they shall be constructed and erected in accordance with table D-16. Outrigger scaffolds designed by a registered professional engineer shall be constructed and erected in accordance with such design. A copy of the detailed drawings and specifications showing the sizes and spacing of members shall be kept on the job.

(4) Planking shall be laid tight and shall extend to within 3 inches of the building wall. Planking shall be nailed or bolted to outriggers.

(5) Where there is danger of material falling from the scaffold, a wire mesh or other enclosure shall be provided between the guardrail and the toeboard.

(6) Where additional working levels are required to be supported by the outrigger method, the plans and specifications of the outrigger and scaffolding structure shall be designed by a registered professional engineer.

TABLE D-16—MINIMUM NOMINAL SIZE AND MAXIMUM SPACING OF MEMBERS OF OUTRIGGER SCAFFOLDS

	Light duty	Medium duty
Maximum scaffold load	25 p.s.f.	50 p.s.f.
Outrigger size	2 x 10 in.	3 x 10 in.
Maximum outrigger spacing.	10 ft 0 in.	6 ft 0 in.
Planking	2 x 9 in.	2 x 9 in.
Guardrail	2 x 4 in.	2 x 4 in.
Guardrail uprights	2 x 4 in.	2 x 4 in.
Toeboards	4 in. (minimum).	4 in. (minimum).

(f) *Masons' adjustable multiple-point suspension scaffolds.* (1) The scaffold shall be capable of sustaining a working load of 50 pounds per square foot and shall not be loaded in excess of that figure.

(2) The scaffold shall be provided with hoisting machines that meet the requirements of Underwriters' Laboratories or Factory Mutual Engineering Corp.

(3) The platform shall be supported by wire ropes in conformity with paragraph (a)(22) of this section, suspended from overhead outrigger beams.

(4) The scaffold outrigger beams shall consist of structural metal securely fastened or anchored to the frame or floor system of the building or structure.

(5) Each outrigger beam shall be equivalent in strength to at least a standard 7-inch, 15.3-pound steel I-beam, be at least 15 feet long, and shall not project more than 6 feet 6 inches beyond the bearing point.

(6) Where the overhang exceeds 6 feet 6 inches, outrigger beams shall be composed of stronger beams or multiple beams and be installed in accordance with approved designs and instructions.

(7) If channel iron outrigger beams are used in place of I-beams, they shall be securely fastened together with the flanges turned out.

(8) All outrigger beams shall be set and maintained with their webs in a vertical position.

(9) A stop bolt shall be placed at each end of every outrigger beam.

(10) The outrigger beam shall rest on suitable wood-bearing blocks.

(11) All parts of the scaffold such as bolts, nuts, fittings, clamps, wire ropes, and outrigger beams and their fastenings, shall be maintained in sound and good working condition and shall be inspected before each installation and periodically thereafter.

(12) The free end of the suspension wire ropes shall be equipped with proper size thimbles and be secured by splicing or other equivalent means. The running ends shall be securely attached to the hoisting drum and at least four turns of rope shall at all times remain on the drum.

(13) Where a single outrigger beam is used, the steel shackles or clevises with which the wire ropes are attached to the outrigger beams shall be placed directly over the hoisting drums.

(14) The scaffold platform shall be equivalent in strength to at least 2-inch planking. (For maximum planking spans see paragraph (a)(9) of this section.)

(15) Guardrails not less than 2 x 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1 x 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on the scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(16) Overhead protection shall be provided on the scaffold, not more than 9 feet above the platform, consisting of 2-inch planking or material of equivalent strength laid tight, when men are at work on the scaffold and an overhead hazard exists.

(17) Each scaffold shall be installed or relocated in accordance with designs and instructions, of a registered professional engineer, and supervised by a competent, designated person.

(g) *Two-point suspension scaffolds (swinging scaffolds).* (1) Two-point suspension scaffold platforms shall be not less than 20 inches nor more than 36 inches wide overall. The platform shall be securely fastened to the hangers by U-bolts or by other equivalent means.

(2) The hangers of two-point suspension scaffolds shall be made of wrought iron, mild steel, or other equivalent material having a cross-sectional area capable of sustaining four times the maximum intended load, and shall be designed with a support for guardrail, intermediate rail, and toeboard.

(3) When hoisting machines are used on two-point suspension scaffolds, such machines shall be of a design tested and approved by Underwriters' Laboratories or Factory Mutual Engineering Corp.

(4) The roof irons or hooks shall be of wrought iron, mild steel, or other equivalent material of proper size and design, securely installed and anchored. Tiebacks of three-fourth inch manila rope or the equivalent shall serve as a secondary means of anchorage, installed at right angles to the fact of the building whenever possible and secured to a structurally sound portion of the building.

(5) Guardrails not less than 2 x 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1- x 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a

minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a) (17) of this section.

(6) Two-point suspension scaffolds shall be suspended by wire or fiber ropes. Wire and fiber ropes shall conform to paragraph (a) (22) of this section.

(7) The blocks for fiber ropes shall be of standard 6-inch size, consisting of at least one double and one single block. The sheaves of all blocks shall fit the size of rope used.

(8) All wire ropes, fiber ropes, slings, hangers, platforms, and other supporting parts shall be inspected before every installation. Periodic inspections shall be made while the scaffold is in use.

(9) On suspension scaffolds designed for a working load of 500 pounds no more than two men shall be permitted to work at one time. On suspension scaffolds with a working load of 750 pounds, no more than three men shall be permitted to work at one time. Each workman shall be protected by a safety lifebelt attached to a lifeline. The lifeline shall be securely attached to substantial members of the structure (not scaffold), or to securely rigged lines, which will safely suspend the workman in case of a fall.

(10) Where acid solutions are used, fiber ropes are not permitted unless acid-proof.

(11) Two-point suspension scaffolds shall be securely lashed to the building or structure to prevent them from swaying. Window cleaners' anchors shall not be used for this purpose.

(12) The platform of every two-point suspension scaffold shall be one of the following types:

(i) The side stringer of ladder-type platforms shall be clear straight-grained spruce or materials of equivalent strength and durability. The rungs shall be of straight-grained oak, ash, or hickory, at least 1⅛ inch in diameter, with seven-eighth inch tenons mortised into the side stringers at least seven-eighth inch. The stringers shall be tied together with the tie rods not less than one-quarter inch in diameter, passing through the stringers and riveted up tight against washers on both ends. The flooring strips shall be spaced not more than five-eighth inch apart except at the side rails where the space may be 1 inch. Ladder-type platforms shall be constructed in accordance with table D–17.

(ii) Plank-type platforms shall be composed of not less than nominal 2- x 8-inch unspliced planks, properly cleated together on the underside starting 6 inches from each end; intervals in between shall not exceed 4 feet. The plank-type platform shall not extend beyond the hangers more than 18 inches. A bar or other effective means shall be securely fastened to the platform at each end to prevent its slipping off the hanger. The span between hangers for plank-type platforms shall not exceed 10 feet.

(iii) Beam platforms shall have side stringers of lumber not less than 2 x 6 inches set on edge. The span between hangers shall not exceed 12 feet when beam platforms are used. The flooring shall be supported on 2- and 6-inch crossbeams, laid flat and set into the upper edge of the stringers with a snug fit, at intervals of not more than 4 feet, securely nailed in place. The flooring shall be of 1- x 6-inch material properly nailed. Floorboards shall not be spaced more than one-half inch apart.

TABLE D–17—SCHEDULE FOR LADDER-TYPE PLATFORMS

	Length of platform (feet)				
	12	14 & 16	18 & 20	22 & 24	28 & 30
Side stringers, minimum cross section (finished sizes):					
At ends (in.)	1¾ x 2¾	1¾ x 2¾	1¾ x 3	1¾ x 3	1¾ x 3½
At middle (in.)	1¾ x 3¾	1¾ x 3¾	1¾ x 4	1¾ x 4¼	1¾ x 5
Reinforcing strip (minimum)	A ⅛x3¼-in. steel reinforcing strip or its equivalent shall be attached to the side or underside, full length.				
Rungs	Rungs shall be 1⅛-in. minimum diameter with at least ⅞-in. diameter tenons, and the maximum spacing shall be 12 in. center to center.				
Tie rods:					
Number (minimum)	3	4	4	5	6
Diameter (minimum)	¼ in.	¼ in.	¼ in.	¼ in.	¼ in.
Flooring, minimum finished size (in.)	½ x 2¾	½ x 2¾	½ x 2¾	½ x 2¾	½ x 2¾

(h) *Stone setters' adjustable multiple-point suspension scaffolds.* (1) The scaffold shall be capable of sustaining a working load of 25 pounds per square foot and shall not be overloaded. Scaffolds shall not be used for storage of stone or other heavy materials.

(2) The hoisting machine and its supports shall be of a type tested and listed by Underwriters' Laboratories or Factory Mutual Engineering Corp.

(3) The platform shall be securely fastened to the hangers by U-bolts or other equivalent means.

(4) The scaffold unit shall be suspended from metal outriggers, iron brackets, wire rope slings, or iron hooks which will safely support the maximum intended load.

(5) Outriggers when used shall be set with their webs in a vertical position, securely anchored to the building or structure and provided with stop bolts at each end.

(6) The scaffold shall be supported by wire rope conforming with paragraph (a) (22) of this section, suspended from overhead supports.

(7) The free ends of the suspension wire ropes shall be equipped with proper size thimbles, secured by splicing or other equivalent means. The running ends shall be securely attached to the hoisting drum and at least four turns of rope shall remain on the drum at all times.

(8) Guardrails not less than 2 by 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1- by 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a) (17) of this section.

(9) When two or more scaffolds are used on a building or structure they shall not be bridged one to the other but shall be maintained at even height with platforms butting closely.

(10) Each scaffold shall be installed or relocated in accordance with designs and instructions of a registered professional engineer, and such installation or relocation shall be supervised by a competent designated person.

(i) *Single-point adjustable suspension scaffolds.* (1) The scaffolding, including power units or manually operated winches, shall be of a type tested and listed by Underwriters' Laboratories or Factory Mutual Engineering Corp.

(2) The power units may be either electrically or air motor driven.

(3) All power-operated gears and brakes shall be enclosed.

(4) In addition to the normal operating brake, all-power driven units must have an emergency brake which engages automatically when the normal speed of descent is exceeded.

(5) Guards, mid-rails, and toeboards shall completely enclose the cage or basket. Guardrails shall be no less than 2 by 4 inches or the equivalent installed no less than 36 inches nor more than 42 inches above the platform. Mid-rails shall be 1 by 6 inches or the equivalent, installed equidistant between the guardrail and the platform. Toeboards shall be a minimum of 4 inches in height.

(6) The hoisting machines, cables, and equipment shall be regularly serviced and inspected after each installation and every 30 days thereafter.

(7) The units may be combined to form a two-point suspension scaffold. Such scaffold shall comply with paragraph (g) of this section.

(8) The supporting cable shall be straight for its entire length, and the operator shall not sway the basket and fix the cable to any intermediate points to change his original path of travel.

(9) Equipment shall be maintained and used in accordance with the manufacturers' instructions.

(10) Suspension methods shall conform to applicable provisions of paragraphs (g) and (h) of this section.

(j) *Boatswain's chairs.* (1) The chair seat shall be not less than 12 by 24 inches, and of 1-inch thickness. The seat shall be reinforced on the underside to prevent the board from splitting.

(2) The two fiber rope seat slings shall be of ⅝-inch diameter, reeved through the four seat holes so as to cross each other on the underside of the seat.

(3) Seat slings shall be of at least ⅜-inch wire rope when a workman is con-

ducting a heat producing process such as gas or arc welding.

(4) The workman shall be protected by a safety life belt attached to a lifeline. The lifeline shall be securely attached to substantial members of the structure (not scaffold), or to securely rigged lines, which will safely suspend the worker in case of a fall.

(5) The tackle shall consist of correct size ball bearing or bushed blocks and properly spliced 5/8-inch diameter first-grade manila rope.

(6) The roof irons, hooks, or the object to which the tackle is anchored shall be securely installed. Tiebacks when used shall be installed at right angles to the face of the building and securely fastened to a chimney.

(k) *Carpenters' bracket scaffolds.* (1) The brackets shall consist of a triangular wood frame not less than 2 by 3 inches in cross section, or of metal of equivalent strength. Each member shall be properly fitted and securely joined.

(2) Each bracket shall be attached to the structure by means of one of the following:

(i) A bolt no less than five-eighths inch in diameter which shall extend through the inside of the building wall.

(ii) A metal stud attachment device.

(iii) Welding to steel tanks.

(iv) Hooking over a well-secured and adequately strong supporting member.

The brackets shall be spaced no more than 10 feet apart.

(3) No more than two persons shall occupy any given 10 feet of a bracket scaffold at any one time. Tools and materials shall not exceed 75 pounds in addition to the occupancy.

(4) The platform shall consist of not less than 2- by 9-inch nominal size planks extending not more than 10 inches or less than 6 inches beyond each end support.

(5) Guardrails not less than 2 by 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1- by 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(l) *Bricklayers' square scaffolds.* (1) The squares shall not exceed 5 feet in width and 5 feet in height.

(2) Members shall be not less than those specified in Table D–18.

(3) The squares shall be reinforced on both sides of each corner with 1- by 6-inch gusset pieces. They shall also have braces 1 by 8 inches on both sides running from center to center of each member, or other means to secure equivalent strength and rigidity.

(4) The squares shall be set not more than 5 feet apart for medium duty scaffolds, and not more than 8 feet apart for light duty scaffolds. Bracing 1 x 8 inches, extending from the bottom of each square to the top of the next square, shall be provided on both front and rear sides of the scaffold.

TABLE D–18—MINIMUM DIMENSIONS FOR BRICKLAYERS' SQUARE SCAFFOLD MEMBERS

Members:	*Dimensions (inches)*
Bearers or horizontal members	2 by 6.
Legs	2 by 6.
Braces at corners	1 by 6.
Braces diagonally from center frame	1 by 8.

(5) Platform planks shall be at least 2- by 9-inch nominal size. The ends of the planks shall overlap the bearers of the squares and each plank shall be supported by not less than three squares.

(6) Bricklayers' square scaffolds shall not exceed three tiers in height and shall be so constructed and arranged that one square shall rest directly above the other. The upper tiers shall stand on a continuous row of planks laid across the next lower tier and be nailed down or otherwise secured to prevent displacement.

(7) Scaffolds shall be level and set upon a firm foundation.

(m) *Horse scaffolds.*

(1) Horse scaffolds shall not be constructed or arranged more than two tiers or 10 feet in height.

(2) The members of the horses shall be not less than those specified in Table D–19.

(3) Horses shall be spaced not more than 5 feet for medium duty and not more than 8 feet for light duty.

(4) When arranged in tiers, each horse shall be placed directly over the horse in the tier below.

(5) On all scaffolds arranged in tiers, the legs shall be nailed down to the planks to prevent displacement or thrust and each tier shall be substantially cross braced.

TABLE D–19—MINIMUM DIMENSIONS FOR HORSE SCAFFOLD MEMBERS

Members:	*Dimensions (inches)*
Horizontal members or bearers	3 by 4.
Legs	1¼ by 4½.
Longitudinal brace between legs	1 by 6.
Gusset brace at top of legs	1 by 8.
Half diagonal braces	1¼ by 4½.

(6) Horses or parts which have become weak or defective shall not be used.

(7) Guardrails not less than 2 by 4 inches or the equivalent and not less than 36 inches or more than 42 inches high with a mid-rail, when required, of 1- by 4-inch lumber or equivalent and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(n) *Needle beam scaffold.* (1) Wood needle beams shall be in accordance with paragraph (a) (5) and (9) of this section, and shall be not less than 4 by 6 inches in size, with the greater dimension placed in a vertical direction. Metal beams or the equivalent conforming to paragraph (a) (4) and (8) of this section may be used.

(2) Ropes or hangers shall be provided for supports. The span between supports on the needle beam shall not exceed 10 feet for 4- by 6-inch timbers. Rope supports shall be equivalent in strength to 1-inch diameter first-grade manila rope.

(3) The ropes shall be attached to the needle beams by a scaffold hitch or a properly made eye splice. The loose end of the rope shall be tied by a bowline knot or by a round turn and one-half hitch.

(4) The platform span between the needle beams shall not exceed 8 feet when using 2-inch scaffold plank. For spans greater than 8 feet, platforms shall be designed based on design requirements for the special span. The overhang of each end of the platform planks shall be not less than 1 foot and not more than 18 inches.

(5) When one needle beam is higher than the other or when the platform is not level the platform shall be secured against slipping.

(6) All unattached tools, bolts, and nuts used on needle beam scaffolds shall be kept in suitable containers.

(7) One end of a needle beam scaffold may be supported by a permanent structural member conforming to paragraph (a) (4) and (8) of this section.

(8) Each man working on a needle beam scaffold 20 feet or more above the ground or floor and working with both hands, shall be protected by a safety life belt attached to a lifeline. The lifeline shall be securely attached to substantial members of the structure (not scaffold), or to securely rigged lines, which will safely suspend the workman in case of a fall.

(o) *Plasterers', decorators', and large area scaffolds.* (1) Plasterers', decorators', lathers', and ceiling workers' inside scaffolds shall be constructed in accordance with the general requirements set forth for independent wood pole scaffolds.

(2) Guardrails not less than 2 by 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1- by 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(3) All platform planks shall be laid with the edges close together.

(4) When independent pole scaffold platforms are erected in sections such sections shall be provided with connecting runways equipped with substantial guardrails.

(p) *Interior hung scaffolds.* (1) An interior hung scaffold should be hung or suspended from the roof structure or substantial ceiling beams.

(2) The suspended steel wire rope shall conform to paragraph (a)(22) of this section. Wire may be used providing the strength requirements of paragraph (a)(22) of this section are met.

(3) For hanging wood scaffolds, the following minimum nominal size material is recommended:

(i) Supporting bearers 2 by 9 inches on edge.

(ii) Planking 2 by 9 inches or 2 by 10 inches, with maximum span 7 feet for heavy duty and 10 feet for light duty or medium duty.

(4) Steel tube and coupler members may be used for hanging scaffolds with both types of scaffold designed to sustain a uniform distributed working load up to heavy duty scaffold loads with a safety factor of four.

(5) When a hanging scaffold is supported by means of wire rope, such wire rope shall be wrapped at least twice around the supporting members and twice around the bearers of the scaffold, with each end of the wire rope secured by at least three standard wire-rope clips.

(6) All overhead supporting members shall be inspected and checked for strength before the scaffold is erected.

(7) Guardrails not less than 2 by 4 inches or the equivalent and not less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1- by 4-inch lumber or equivalent, and toeboards, shall be installed at all open sides on all scaffolds more than 10 feet above the ground or floor. Toeboards shall be a minimum of 4 inches in height. Wire mesh shall be installed in accordance with paragraph (a)(17) of this section.

(q) *Ladder-jack scaffolds.* (1) All ladder-jack scaffolds shall be limited to light duty and shall not exceed a height of 20 feet above the floor or ground.

(2) All ladders used in connection with ladder-jack scaffolds shall be heavy-duty ladders and shall be designed and constructed in accordance with § 1910.25 and § 1910.26.

(3) The ladder jack shall be so designed and constructed that it will bear on the side rails in addition to the ladder rungs, or if bearing on rungs only, the bearing area shall be at least 10 inches on each rung.

(4) Ladders used in conjunction with ladder jacks shall be so placed, fastened, held, or equipped with devices so as to prevent slipping.

(5) The wood platform planks shall be not less than 2 inches nominal in thickness. Both metal and wood platform planks shall overlap the bearing surface not less than 12 inches. The span between supports for wood shall not exceed 8 feet. Platform width shall be not less than 18 inches.

(6) Not more than two persons shall occupy any given 8 feet of any ladder-jack scaffold at any one time.

(r) *Window-jack scaffolds.* (1) Window-jack scaffolds shall be used only for the purpose of working at the window opening through which the jack is placed.

(2) Window jacks shall not be used to support planks placed between one window jack and another or for other elements of scaffolding.

(3) Window-jack scaffolds shall be provided with suitable guardrails unless safety belts with lifelines are attached and provided for the workman. Window-jack scaffolds shall be used by one man only.

(s) *Roofing brackets.* (1) Roofing brackets shall be constructed to fit the pitch of the roof.

(2) Brackets shall be secured in place by nailing in addition to the pointed metal projections. The nails shall be driven full length into the roof. When rope supports are used, they shall consist of first-grade manila of at least three-quarter-inch diameter, or equivalent.

(3) A substantial catch platform shall be installed below the working area of roofs more than 20 feet from the ground to eaves with a slope greater than 3 inches in 12 inches without a parapet. In width the platform shall extend 2 feet beyond the projection of the eaves and shall be provided with a safety rail, mid-rail, and toeboard. This provision shall not apply where employees engaged in work upon such roofs are protected by a safety belt attached to a lifeline.

(t) *Crawling boards or chicken ladders.* (1) Crawling boards shall be not less than 10 inches wide and 1 inch thick, having cleats 1 x 1½ inches. The cleats shall be equal in length to the width of the board and spaced at equal intervals not to exceed 24 inches. Nails shall be driven through and clinched on the underside. The crawling board shall extend from the ridge pole to the eaves when used in connection with roof construction, repair, or maintenance.

(2) A firmly fastened lifeline of at least three-quarter-inch rope shall be strung beside each crawling board for a handhold.

(3) Crawling boards shall be secured to the roof by means of adequate ridge hooks or equivalent effective means.

(u) *Float or ship scaffolds.* (1) Float or ship scaffolds shall support not more than three men and a few light tools, such as those needed for riveting, bolting, and welding. They shall be constructed in accordance with subparagraphs (2) through (6) of this paragraph, unless substitute designs and materials provide equivalent strength, stability, and safety.

(2) The platform shall be not less than 3 feet wide and 6 feet long, made of three-quarter-inch plywood, equivalent to American Plywood Association Grade B–B, Group I, Exterior.

(3) Under the platform, there shall be two supporting bearers made from 2- x 4-inch, or 1- x 10-inch rough, selected lumber, or better. They shall be free of knots or other flaws and project 6 inches beyond the platform on both sides. The ends of the platform shall extend about 6 inches beyond the outer edges of the bearers. Each bearer shall be securely fastened to the platform.

(4) An edging of wood not less than ¾ x 1½ inches, or equivalent, shall be placed around all sides of the platform to prevent tools from rolling off.

(5) Supporting ropes shall be 1-inch diameter manila rope or equivalent, free from deterioration, chemical damage, flaws, or other imperfections. Rope connections shall be such that the platform cannot shift or slip. If two ropes are used with each float, they should be arranged so as to provide four ends which are to be securely fastened to an overhead support. Each of the two supporting ropes shall be hitched around one end of a bearer and pass under the platforms to the other end of the bearer where it is hitched again, leaving sufficient rope at each end for the supporting ties.

(6) Each workman shall be protected by a safety lifebelt attached to a lifeline. The lifeline shall be securely attached to substantial members of the structure (not scaffold), or to securely rigged lines, which will safely suspend the workman in case of a fall.

§ 1910.29 Manually propelled mobile ladder stands and scaffolds (towers).

(a) *General requirements*—(1) *Application.* This section is intended to prescribe rules and requirements for the design, construction, and use of mobile work platforms (including ladder stands but not including aerial ladders) and rolling (mobile) scaffolds (towers). This standard is promulgated to aid in providing for the safety of life, limb, and property, by establishing minimum standards for structural design requirements and for the use of mobile work platforms and towers.

(2) *Working loads.* (i) Work platforms and scaffolds shall be capable of carrying the design load under varying circumstances depending upon the conditions of use. Therefore, all parts and appurtances necessary for their safe and efficient utilization must be integral parts of the design.

(ii) Specific design and construction requirements are not a part of this section because of the wide variety of materials and design possibilities. However, the design shall be such as to produce a mobile ladder stand or scaffold that will safely sustain the specified loads. The material selected shall be of sufficient strength to meet the test requirements and shall be protected against corrosion or deterioration.

(*a*) The design working load of ladder stands shall be calculated on the basis of one or more 200-pound persons together with 50 pounds of equipment each.

(*b*) The design load of all scaffolds shall be calculated on the basis of:

Light—Designed and constructed to carry a working load of 25 pounds per square foot.

Medium—Designed and constructed to carry a working load of 50 pounds per square foot.

Heavy—Designed and constructed to carry a working load of 75 pounds per square foot.

All ladder stands and scaffolds shall be capable of supporting at least four times the design working load.

(iii) The materials used in mobile ladder stands and scaffolds shall be of standard manufacture and conform to standard specifications of strength, dimensions, and weights, and shall be selected to safely support the design working load.

(iv) Nails, bolts, or other fasteners used in the construction of ladders, scaf-

folds, and towers shall be of adequate size and in sufficient numbers at each connection to develop the designed strength of the unit. Nails shall be driven full length. (All nails should be immediately withdrawn from dismantled lumber.)

(v) All exposed surfaces shall be free from sharp edges, burrs or other safety hazards.

(3) *Work levels.* (i) The maximum work level height shall not exceed four (4) times the minimum or least base dimension of any mobile ladder stand or scaffold. Where the basic mobile unit does not meet this requirement, suitable outrigger frames shall be employed to achieve this least base dimension, or provisions shall be made to guy or brace the unit against tipping.

(ii) The minimum platform width for any work level shall not be less than 20 inches for mobile scaffolds (towers). Ladder stands shall have a minimum step width of 16 inches.

(iii) The supporting structure for the work level shall be rigidly braced, using adequate cross bracing or diagonal bracing with rigid platforms at each work level.

(iv) The steps of ladder stands shall be fabricated from slip resistant treads.

(v) The work level platform of scaffolds (towers) shall be of wood, aluminum, or plywood planking, steel or expanded metal, for the full width of the scaffold, except for necessary openings. Work platforms shall be secured in place. All planking shall be 2-inch (nominal) scaffold grade minimum 1,500 *f.* (stress grade) construction grade lumber or equivalent.

(vi) All scaffold work levels 10 feet or higher above the ground or floor shall have a standard (4-inch nominal) toeboard.

(vii) All work levels 10 feet or higher above the ground or floor shall have a guardrail of 2- by 4-inch nominal or the equivalent installed no less than 36 inches or more than 42 inches high, with a mid-rail, when required, of 1- by 4-inch nominal lumber or equivalent.

(viii) A climbing ladder or stairway shall be provided for proper access and egress, and shall be affixed or built into the scaffold and so located that its use will not have a tendency to tip the scaffold. A landing platform shall be provided at intervals not to exceed 30 feet.

(4) *Wheels or casters.* (i) Wheels or casters shall be properly designed for strength and dimensions to support four (4) times the design working load.

(ii) All scaffold casters shall be provided with a positive wheel and/or swivel lock to prevent movement. Ladder stands shall have at least two (2) of the four (4) casters and shall be of the swivel type.

(iii) Where leveling of the elevated work platform is required, screw jacks or other suitable means for adjusting the height shall be provided in the base section of each mobile unit.

(b) *Mobile tubular welded frame scaffolds*—(1) *General.* Units shall be designed to comply with the requirements of paragraph (a) of this section.

(2) *Bracing.* Scaffolds shall be properly braced by cross braces and/or diagonal braces for securing vertical members together laterally. The cross braces shall be of a length that will automatically square and align vertical members so the erected scaffold is always plumb, square, and rigid.

(3) *Spacing.* Spacing of panels or frames shall be consistent with the loads imposed. The frames shall be placed one on top of the other with coupling or stacking pins to provide proper vertical alignment of the legs.

(4) *Locking.* Where uplift may occur, panels shall be locked together vertically by pins or other equivalent means.

(5) *Erection.* Only the manufacturer of a scaffold or his qualified designated agent shall be permitted to erect or supervise the erection of scaffolds exceeding 50 feet in height above the base, unless such structure is approved in writing by a registered professional engineer, or erected in accordance with instructions furnished by the manufacturer.

(c) *Mobile tubular welded sectional folding scaffolds*—(1) *General.* Units including sectional stairway and sectional ladder scaffolds shall be designed to comply with the requirements of paragraph (a) of this section.

(2) *Stairway.* An integral stairway and work platform shall be incorporated into the structure of each sectional folding stairway scaffold.

(3) *Bracing.* An integral set of pivoting and hinged folding diagonal and horizontal braces and a detachable work platform shall be incorporated into the structure of each sectional folding ladder scaffold.

(4) *Sectional folding stairway scaffolds.* Sectional folding stairway scaffolds shall be designed as medium duty scaffolds except for high clearance. These special base sections shall be designed as light duty scaffolds. When upper sectional folding stairway scaffolds are used with a special high clearance base, the load capacity of the entire scaffold shall be reduced accordingly. The width of a sectional folding stairway scaffold shall not exceed 4½ feet. The maximum length of a sectional folding stairway scaffold shall not exceed 6 feet.

(5) *Sectional folding ladder scaffolds.* Sectional folding ladder scaffolds shall be designed as light duty scaffolds including special base (open end) sections which are designed for high clearance. For certain special applications the six-foot (6′) folding ladder scaffolds, except for special high clearance base sections, shall be designed for use as medium duty scaffolds. The width of a sectional folding ladder scaffold shall not exceed 4½ feet. The maximum length of a sectional folding ladder scaffold shall not exceed 6 feet 6 inches for a six-foot (6′) long unit, 8 feet 6 inches for an eight-foot (8′) unit or 10 feet 6 inches for a ten-foot (10′) long unit.

(6) *End frames.* The end frames of sectional ladder and stairway scaffolds shall be designed so that the horizontal bearers provide supports for multiple planking levels.

(7) *Erection.* Only the manufacturer of the scaffold or his qualified designated agent shall be permitted to erect or supervise the erection of scaffolds exceeding 50 feet in height above the base, unless such structure is approved in writing by a licensed professional engineer, or erected in accordance with instructions furnished by the manufacturer.

(d) *Mobile tube and coupler scaffolds*—(1) *Design.* Units shall be designed to comply with the applicable requirements of paragraph (a) of this section.

(2) *Material.* The material used for the couplers shall be of a structural type, such as a drop-forged steel, malleable iron or structural grade aluminum. The use of gray cast iron is prohibited.

(3) *Erection.* Only the manufacturer of the scaffold or his qualified designated agent shall be permitted to erect or supervise the erection of scaffolds exceeding 50 feet in height above the base, unless such structure is approved in writing by a licensed professional engineer, or erected in accordance with instructions furnished by the manufacturer.

(e) *Mobile work platforms*—(1) *Design.* Units shall be designed for the use intended and shall comply with the requirements of paragraph (a) of this section.

(2) *Base width.* The minimum width of the base of mobile work platforms shall not be less than 20 inches.

(3) *Bracing.* Adequate rigid diagonal bracing to vertical members shall be provided.

(f) *Mobile ladder stands.*

(1) *Design.* Units shall comply with applicable requirements of paragraph (a) of this section.

(2) *Base width.* The minimum base width shall conform to paragraph (a)(3)(i) of this section. The maximum length of the base section shall be the total length of combined steps and top assembly, measured horizontally, plus five-eighths inch per step of rise.

(3) *Steps.* Steps shall be uniformly spaced, and sloped, with a rise of not less than nine (9) inches, nor more than ten (10) inches, and a depth of not less seven (7) inches. The slope of the steps section shall be a minimum of fifty-five (55) degrees and a maximum of sixty (60) degrees measured from the horizontal.

(4) *Handrails.* (i) Units having more than five (5) steps or 60 inches vertical height to the top step shall be equipped with handrails.

(ii) Handrails shall be a minimum of 29 inches high. Measurements shall be taken vertically from the center of the step.

(5) *Loading.* The load (see paragraph (a)(2)(ii)(b) of this section) shall be applied uniformly to a 3½ inches wide area front to back at the center of the width span with a safety factor of four (4).

§ 1910.30 Other working surfaces.

(a) *Dockboards (bridge plates).* (1) Portable and powered dockboards shall be strong enough to carry the load imposed on them.

(2) Portable dockboards shall be secured in position, either by being anchored or equipped with devices which will prevent their slipping.

(3) Powered dockboards shall be designed and constructed in accordance with Commercial Standard CS202–56 (1956) "Industrial Lifts and Hinged Loading Ramps published by the U.S. Department of Commerce.

(4) Handholds, or other effective means, shall be provided on portable dockboards to permit safe handling.

(5) Positive protection shall be provided to prevent railroad cars from being moved while dockboards or bridge plates are in position.

(b) *Forging machine area.* (1) Machines shall be so located as to give (i) enough clearance between machines so that the movement of one operator will not interfere with the work of another, (ii) ample room for cleaning machines and handling the work, including material and scrap. The arrangement of machines shall be such that operators will not stand in aisles.

(2) Aisles shall be provided of sufficient width to permit the free movement of employees bringing and removing material. This aisle space is to be independent of working and storage space and should be defined by marking.

(3) Wood platforms used on the floor in front of machines shall be substantially constructed.

(c) *Veneer machinery.* (1) Sides of steam vats shall extend to a height of not less than 36 inches above the floor, working platform, or ground.

(2) Large steam vats divided into sections shall be provided with substantial walkways between sections. Each walkway shall be provided with a standard handrail on each exposed side. These handrails may be removable, if necessary.

(3) Covers shall be removed only from that portion of steaming vats on which men are working and a portable railing shall be placed at this point to protect the operators.

(4) Workmen shall not ride or step on logs in steam vats.

§ 1910.31 Sources of standards.

The standards in this Subpart D are devised from the following sources:

Standard	*Source*
§ 1910.22(a)	ANSI Z4.1–1968, Requirements for Sanitation in Places of Employment.
§ 1910.22(b) and (c).	41 CFR 50–204.3.
§ 1910.22(d)	ANSI A58.1–1955, Minimum Design Loads in Building and Other Structures.
§ 1910.23	ANSI A12.1–1967, Safety Requirements for Floor and Wall Openings, Railings, and Toeboards.
§ 1910.24	ANSI A64.1–1968, Requirements for Fixed Industrial Stairs.
§ 1910.25	ANSI A14.1–1968, Safety Code for Portable Wood Ladders.
§ 1910.26	ANSI A14.2–1956, Portable Metal Ladders.
§ 1910.27	ANSI A14.3–1956, Safety Code for Fixed Ladders.
§ 1910.28	ANSI A10.8–1969, Safety Requirements for Scaffolding.
§ 1910.29	ANSI A92.1–1971, Standard for Manually Propelled Mobile Ladder Stands and Scaffolds.
§ 1910.30(a)	ANSI B56.1—1969, Safety Standard for Powered Industrial Trucks.
§ 1910.30(b)	ANSI B24.1–1963, Safety Standard for Forging.
§ 1910.30(c)	ANSI 01.1–1954, Safety Code for Woodworking Machinery.

§ 1910.32 Standards organizations.

The following organizations have been referenced in this Subpart D:

American National Standards Institute, 1430 Broadway, New York, NY 10018.
Underwriters' Laboratories, Inc., 207 East Ohio Street, Chicago, IL 60611.
Factory Mutual Engineering Corp., Post Office Box 688, Norwood, MA 02062.

Subpart E—Means of Egress

§ 1910.35 Definitions.

As used in this subpart

(a) *Means of egress.* A means of egress is a continuous and unobstructed way of exit travel from any point in a building or structure to a public way and consists of three separate and distinct parts: the way of exit access, the exit, and the way of exit discharge. A means of egress comprises the vertical and horizontal ways of travel and shall include intervening room spaces, doorways, hallways, corridors, passageways, balconies, ramps, stairs, enclosures, lobbies, escalators, horizontal exits, courts, and yards.

(b) *Exit access.* Exit access is that portion of a means of egress which leads to an entrance to an exit.

(c) *Exit.* Exit is that portion of a means of egress which is separated from all other spaces of the building or structure by construction or equipment as required in this subpart to provide a protected way of travel to the exit discharge.

(d) *Exit discharge.* Exit discharge is that portion of a means of egress between the termination of an exit and a public way.

(e) *Low hazard contents.* Low hazard contents shall be classified as those of such low combustibility that no self-propagating fire therein can occur and that consequently the only probable danger requiring the use of emergency exits will be from panic, fumes, or smoke, or fire from some external source.

(f) *High-hazard contents.* High-hazard contents shall be classified as those which are liable to burn with extreme rapidity or from which poisonous fumes or explosions are to be feared in the event of fire.

(g) *Ordinary hazard contents.* Ordinary hazard contents shall be classified as those which are liable to burn with moderate rapidity and to give off a considerable volume of smoke but from which neither poisonous fumes nor explosions are to be feared in case of fire.

(h) *Approved.* For the purposes of this subpart approved shall mean listed or approved equipment by a nationally recognized testing laboratory.

§ 1910.36 General requirements.

(a) *Application.* This subpart contains general fundamental requirements essential to providing a safe means of egress from fire and like emergencies. Nothing in this subpart shall be construed to prohibit a better type of building construction, more exits, or otherwise safer conditions than the minimum requirements specified in this subpart. Exits from vehicles, vessels, or other mobile structures are not covered by this subpart.

(b) *Fundamental requirements.* (1) Every building or structure, new or old, designed for human occupancy shall be provided with exits sufficient to permit the prompt escape of occupants in case of fire or other emergency. The design of exits and other safeguards shall be such that reliance for safety to life in case of fire or other emergency will not depend solely on any single safeguard; additional safeguards shall be provided for life safety in case any single safeguard is ineffective due to some human or mechanical failure.

(2) Every building or structure shall be so constructed, arranged, equipped, maintained, and operated as to avoid undue danger to the lives and safety of its occupants from fire, smoke, fumes, or resulting panic during the period of time reasonably necessary for escape from the building or structure in case of fire or other emergency.

(3) Every building or structure shall be provided with exits of kinds, numbers, location, and capacity appropriate to the individual building or structure, with due regard to the character of the occupancy, the number of persons exposed, the fire protection available, and the height and type of construction of the building or structure, to afford all occupants convenient facilities for escape.

(4) In every building or structure exits shall be so arranged and maintained as to provide free and unobstructed egress from all parts of the building or structure at all times when it is occupied. No lock or fastening to prevent free escape from the inside of any building shall be installed except in mental, penal, or corrective institutions where supervisory personnel is continually on duty and effective provisions are made to remove occupants in case of fire or other emergency.

(5) Every exit shall be clearly visible or the route to reach it shall be conspicuously indicated in such a manner that every occupant of every building or structure who is physically and mentally

capable will readily know the direction of escape from any point, and each point, and each path of escape, in its entirety, shall be so arranged or marked that the way to a place of safety outside is unmistakable. Any doorway or passageway not constituting an exit or way to reach an exit, but of such a character as to be subject to being mistaken for an exit, shall be so arranged or marked as to minimize its possible confusion with an exit and the resultant danger of persons endeavoring to escape from fire finding themselves trapped in a dead-end space, such as a cellar or storeroom, from which there is no other way out.

(6) In every building or structure equipped for artificial illumination, adequate and reliable illumination shall be provided for all exit facilities.

(7) In every building or structure of such size, arrangement, or occupancy that a fire may not itself provide adequate warning to occupants, fire alarm facilities shall be provided where necessary to warn occupants of the existence of fire so that they may escape, or to facilitate the orderly conduct of fire exit drills.

(8) Every building or structure, section, or area thereof of such size, occupancy, and arrangement that the reasonable safety of numbers of occupants may be endangered by the blocking of any single means of egress due to fire or smoke, shall have at least two means of egress remote from each other, so arranged as to minimize any possibility that both may be blocked by any one fire or other emergency conditions.

(9) Compliance with this subpart shall not be construed as eliminating or reducing the necessity for other provisions for safety of persons using a structure under normal occupancy conditions, nor shall any provision of the subpart be construed as requiring or permitting any condition that may be hazardous under normal occupancy conditions.

(c) *Protection of employees exposed by construction and repair operations.* (1) No building or structure under construction shall be occupied in whole or in part until all exit facilities required for the part occupied are completed and ready for use.

(2) No existing building shall be occupied during repairs or alterations unless all existing exits and any existing fire protection are continuously maintained, or in lieu thereof other measures are taken which provide equivalent safety.

(3) No flammable or explosive substances or equipment for repairs or alterations shall be introduced in a building of normally low or ordinary hazard classification while the building is occupied, unless the condition of use and safeguards provided are such as not to create any additional danger or handicap to egress beyond the normally permissible conditions in the building.

(d) *Maintenance.* (1) Every required exit, way of approach thereto, and way of travel from the exit into the street or open space, shall be continuously maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency.

(2) Every automatic sprinkler system, fire detection and alarm system, exit lighting, fire door, and other item of equipment, where provided, shall be continuously in proper operating condition.

§ 1910.37 Means of egress, general.

(a) *Permissible exit components.* An exit shall consist only of the approved components. Exit components shall be constructed as an integral part of the building or shall be permanently affixed thereto.

(b) *Protective enclosure of exits.* When an exit is protected by separation from other parts of the building the separating construction shall meet the following requirements.

(1) The separation shall have at least a 1-hour fire resistance rating when the exit connects three stories or less. This applies whether the stories connected are above or below the story at which exit discharge begins.

(2) The separation shall have at least a 2-hour fire resistance rating when the exit connects four or more stories, whether above or below the floor of discharge. It shall be constructed of noncombustible materials, and shall be supported by construction having at least a 2-hour fire resistance rating.

(3) Any opening therein shall be protected by an approved self-closing fire door.

(4) Openings in exit enclosures shall be confined to those necessary for access to the enclosure from normally occupied spaces and for egress from the enclosure.

(c) *Width and capacity of means of egress.* (1) The capacity in number of persons per unit of exit width for approved components of means of egress shall be as follows:

(i) Level Egress Components (including Class A Ramps) 100 persons.

(ii) Inclined Egress Components (including Class B Ramps) 60 persons.

(2) Means of egress shall be measured in units of exit width of 22 inches. Fractions of a unit shall not be counted, except that 12 inches added to one or more full units shall be counted as one-half a unit of exit width.

(3) Units of exit width shall be measured in the clear at the narrowest point of the means of egress except that a handrail may project inside the measured width on each side not more than 3½ inches and a stringer may project inside the measured width not more than 1½ inches. An exit or exit access door swinging into an aisle or passageway shall not restrict the effective width thereof at any point during its swing to less than the minimum widths hereafter specified.

(d) *Egress capacity and occupant load.* (1) The capacity of means of egress for any floor, balcony, tier, or other occupied space shall be sufficient for the occupant load thereof. The occupant load shall be the maximum number of persons that may be in the space at any time.

(2) Where exits serve more than one floor, only the occupant load of each floor considered individually need be used in computing the capacity of the exits at that floor, provided that exit capacity shall not be decreased in the direction of exit travel.

(e) *Arrangement of exits.* When more than one exit is required from a story, at least two of the exits shall be remote from each other and so arranged as to minimize any possibility that both may be blocked by any one fire or other emergency condition.

(f) *Access to exits.* (1) Exits shall be so located and exit accesss shall be so arranged that exits are readily accessible at all times. Where exits are not immediately accessible from an open floor area, safe and continuous passageways, aisles, or corridors leading directly to every exit and so arranged as to provide convenient access for each occupant to at least two exits by separate ways of travel, except as a single exit or limited dead ends are permitted by other provisions of this subpart shall be maintained.

(2) A door from a room to an exit or to a way of exit access shall be of the side-hinged, swinging type. It shall swing with exit travel when the room is occupied by more than 50 persons or used for a high hazard occupancy.

(3) In no case shall access to an exit be through a bathroom, or other room subject to locking, except where the exit is required to serve only the room subject to locking.

(4) Ways of exit access and the doors to exits to which they lead shall be so designed and arranged as to be clearly recognizable as such. Hangings or draperies shall not be placed over exit doors or otherwise so located as to conceal or obscure any exit. Mirrors shall not be placed on exit doors. Mirrors shall not be placed in or adjacent to any exit in such a manner as to confuse the direction of exit.

(5) Exit access shall be so arranged that it will not be necessary to travel toward any area of high hazard occupancy in order to reach the nearest exit, unless the path of travel is effectively shielded from the high hazard location by suitable partitions or other physical barriers.

(6) The minimum width of any way of exit access shall in no case be less than 28 inches. Where a single way of exit access leads to an exit, its capacity in terms of width shall be at least equal to the required capacity of the exit to which it leads. Where more than one way of exit access leads to an exit, each shall have a width adequate for the number of persons it must accommodate.

(g) *Exterior ways of exit access.* (1) Access to an exit may be by means of any exterior balcony, porch, gallery, or roof that conforms to the requirements of this section.

(2) Exterior ways of exit access shall have smooth, solid floors, substantially level, and shall have guards on the unenclosed sides.

(3) Where accumulation of snow or ice is likely because of the climate, the exterior way of exit access shall be protected by a roof, unless it serves as the sole normal means of access to the rooms or spaces served, in which case it may

be assumed that snow and ice will be regularly removed in the course of normal occupancy.

(4) A permanent, reasonably straight path of travel shall be maintained over the required exterior way of exit access. There shall be no obstruction by railings, barriers, or gates that divide the open space into sections appurtenant to individual rooms, apartments, or other uses. Where the Assistant Secretary of Labor or his duly authorized representative finds the required path of travel to be obstructed by furniture or other movable objects, he may require that they be fastened out of the way or he may require that railings or other permanent barriers be installed to protect the path of travel against encroachment.

(5) An exterior way of exit access shall be so arranged that there are no dead ends in excess of 20 feet. Any unenclosed exit served by an exterior way of exit access shall be so located that no part of the exit extends past a vertical plane 20 feet and one-half the required width of the exit from the end of and at right angles to the way of exit access.

(6) Any gallery, balcony, bridge, porch or other exterior exit access that projects beyond the outside wall of the building shall comply with the requirements of this section as to width and arrangement.

(h) *Discharge from exits.* (1) All exits shall discharge directly to the street, or to a yard, court, or other open space that gives safe access to a public way. The streets to which the exits discharge shall be of width adequate to accommodate all persons leaving the building. Yards, courts, or other open spaces to which exits discharge shall also be of adequate width and size to provide all persons leaving the building with ready access to the street.

(2) Stairs and other exits shall be so arranged as to make clear the direction of egress to the street. Exit stairs that continue beyond the floor of discharge shall be interrupted at the floor of discharge by partitions, doors, or other effective means.

(i) *Headroom.* Means of egress shall be so designed and maintained as to provide adequate headroom, but in no case shall the ceiling height be less than 7 feet 6 inches nor any projection from the ceiling be less than 6 feet 8 inches from the floor.

(j) *Changes in elevation.* Where a means of egress is not substantially level, such differences in elevation shall be negotiated by stairs or ramps.

(k) *Maintenance and workmanship* (1) Doors, stairs, ramps, passages, signs, and all other components of means of egress shall be of substantial, reliable construction and shall be built or installed in a workmanlike manner.

(2) Means of egress shall be continuously maintained free of all obstructions or impediments to full instant use in the case of fire or other emergency.

(3) Any device or alarm installed to restrict the improper use of an exit shall be so designed and installed that it cannot, even in cases of failure, impede or prevent emergency use of such exit.

(l) *Furnishings and decorations.* (1) No furnishings, decorations, or other objects shall be so placed as to obstruct exits, access thereto, egress therefrom, or visibility thereof.

(2) No furnishings or decorations of an explosive or highly flammable character shall be used in any occupancy.

(m) *Automatic sprinkler systems.* All automatic sprinkler systems shall be continuously maintained in reliable operating condition at all times, and such periodic inspections and tests shall be made as are necessary to assure proper maintenance.

(n) *Alarm and fire detection systems.* (1) Systems shall be under the supervision of a responsible person who shall cause proper tests to be made at specified intervals and have general charge of all alterations and additions.

(2) Fire alarm signaling equipment shall be restored to service as promptly as possible after each test or alarm, and shall be kept in normal condition for operation. Equipment requiring rewinding or replenishing shall be rewound or replenished as promptly as possible after each test or alarm.

(o) *Fire retardant paints.* Fire retardant paints or solutions shall be renewed at such intervals as necessary to maintain the necessary flame retardant properties.

(p) *Recognition of means of egress.* Hangings or draperies shall not be placed over exit doors or otherwise located as to conceal or obscure any exit. Mirrors shall not be placed on exit doors. Mirrors shall not be placed in or adjacent to any exit in such a manner as to confuse the direction of exit.

(q) *Exit marking.* (1) Exits shall be marked by a readily visible sign. Access to exits shall be marked by readily visible signs in all cases where the exit or way to reach it is not immediately visible to the occupants.

(2) Any door, passage, or stairway which is neither an exit nor a way of exit access, and which is so located or arranged as to be likely to be mistaken for an exit, shall be identified by a sign reading "Not an Exit" or similar designation, or shall be identified by a sign indicating its actual character, such as "To Basement," "Storeroom," "Linen Closet," or the like.

(3) Every required sign designating an exit or way of exit access shall be so located and of such size, color, and design as to be readily visible. No decorations, furnishings, or equipment which impair visibility of an exit sign shall be permitted, nor shall there be any brightly illuminated sign (for other than exit purposes), display, or object in or near the line of vision to the required exit sign of such a character as to so detract attention from the exit sign that it may not be noticed.

(4) Every exit sign shall be distinctive in color and shall provide contrast with decorations, interior finish, or other signs.

(5) A sign reading "Exit", or similar designation, with an arrow indicating the direction, shall be placed in every location where the direction of travel to reach the nearest exit is not immediately apparent.

(6) Every exit sign shall be suitably illuminated by a reliable light source giving a value of not less than 5-foot candles on the illuminated surface. Artificial lights giving illumination to exit signs other than the internally illuminated types shall have screens, discs, or lenses of not less than 25 square inches area made of translucent material to show red or other specified designating color on the side of the approach.

(7) Each internally illuminated exit sign shall be provided in all occupancies where reduction of normal illumination is permitted.

(8) Every exit sign shall have the word "Exit" in plainly legible letters not less than 6 inches high, with the principal strokes of letters not less than three-fourths-inch wide.

§ 1910.38 Specific means of egress requirements by occupancy. [Reserved]

§ 1910.39 Sources of standards.

The entire subpart is promulgated from NFPA 101–1970, Life Safety Code.

§ 1910.40 Standards organizations.

Specific standards of the following organization have been referenced in this subpart. Copies of the standards may be obtained from the issuing organization:

National Fire Protection Association, 60 Batterymarch Street, Boston, MA 02110.

Subpart F—Powered Platforms, Manlifts, and Vehicle-Mounted Work Platforms

§ 1910.66 Power platforms for exterior building maintenance.

(a) *Definitions applicable to this section*—(1) *Angulated roping.* A system of platform suspension in which the upper wire rope sheaves or suspension points are closer to the plane of the building face than the corresponding attachment points on the platform, thus causing the platform to press against the face of the building during its vertical travel.

(2) *ANSI.* American National Standards Institute.

(3) *Babbitted fastenings.* The method of providing wire rope attachments in which the ends of the wire strands are bent back and are held in a tapered socket by means of poured molten babbitt metal.

(4) *Brake—disc type.* A brake in which the holding effect is obtained by frictional resistance between one or more faces of discs keyed to the rotating member to be held and fixed discs keyed to the stationary or housing member (pressure between the discs being applied axially).

(5) *Brake—self-energizing band type.* An essentially unidirectional brake in which the holding effect is obtained by the snubbing action of a flexible band wrapped about a cylindrical wheel or drum affixed to the rotating member to be held, the connections and linkages being so arranged that the motion of the brake

wheel or drum will act to increase the tension or holding force of the band.

(6) *Brake—shoe type.* A brake in which the holding effect is obtained by applying the direct pressure of two or more segmental friction elements held to a stationary member against a cylindrical wheel or drum affixed to the rotating member to be held.

(7) *Building face rollers.* A specialized form of guide roller designed to contact a portion of the outer face or wall structure of the building, and to assist in stabilizing the operators' platform during vertical travel.

(8) *Continuous pressure.* Operation by means of buttons or switches, any one of which may be used to control the movement of the working platform or roof car, only as long as the button or switch is manually maintained in the actuating position.

(9) *Control.* A system governing starting, stopping, direction, acceleration, speed, and retardation of moving members.

(10) *Controller.* A device or group of devices, usually contained in a single enclosure, which serves to control in some predetermined manner the apparatus to which it is connected.

(11) *Electrical ground.* A conducting connection between an electrical circuit or equipment and the earth, or some conducting body which serves in place of the earth.

(12) *Guide roller.* A rotating, bearing-mounted, generally cylindrical member, operating separately or as part of a guide shoe assembly, attached to the platform, and providing rolling contact with building guideways, or other building contact members.

(13) *Guide shoe.* An assembly of rollers, slide members, or the equivalent, attached as a unit to the operators' platform, and designed to engage with the building members provided for the vertical guidance of the operators' platform.

(14) *Interlock.* A device actuated by the operation of some other device with which it is directly associated, to govern succeeding operations of the same or allied devices.

(15) *Operating* device. A pushbutton, lever, or other manual device used to actuate a control.

(16) *Power platform.* Equipment to provide access to the exterior of a building for maintenance, consisting of a suspended power-operated working platform, a roof car, or other suspension means, and the requisite operating and control devices.

(17) *Rated load.* The combined weight of employees, tools, equivalent, and other material which the working platform is designed and installed to lift.

(18) *Relay, direction.* An electrically energized contactor responsive to an initiating control circuit, which in turn causes a moving member to travel in a particular direction.

(19) *Relay, potential for vertical travel.* An electrically energized contactor responsive to initiating control circuit, which in turn controls the operation of a moving member in both directions. This relay usually operates in conjunction with direction relays, as covered under the definition, "relay direction."

(20) *Roof car.* A structure for the suspension of a working platform, providing for its horizontal movement to working positions.

(21) *Roof-powered platform.* A powered platform having the raising and lowering mechanism located on a roof car.

(22) *Self-powered platform.* A powered platform having the raising and lowering mechanism located on the working platform.

(2) *Traveling cable.* A cable made up of electrical or communication conductors or both, and providing electrical connection between the working platform and the roof car or other fixed point.

(24) *Weatherproof.* Equipment so constructed or protected that exposure to the weather will not interfere with its proper operation.

(25) *Working platform.* The suspended structure arranged for vertical travel which provides access to the exterior of the building or structure.

(26) *Yield point.* The stress at which the material exhibits a permanent set of 0.2 percent.

(27) *Zinced fastenings.* The method of providing wire rope attachments in which the splayed or fanned wire ends are held in a tapered socked by means of poured molten zinc.

(b) *General requirements*—(1) *Application.* (i) This section establishes safety requirements for the design, construction, installation, operation, maintenance, inspection, and use of power-operated platforms for exterior building maintenance. The requirements of this section do not apply to temporary equipment used for construction work; or to devices which are raised and lowered manually.

(ii) The purpose of this standard is to provide for the safety of life and limb of users of exterior powered platforms, as well as of others who may be exposed. The equipment described in this section is intended for use by one or more workmen who are engaged in exterior work, such as window cleaning, caulking, metal-polishing, and general exterior building maintenance or repairs.

(2) *Existing and new equipment.* This section applies to all powered platforms installed subsequent to the effective date of these regulations with the exception of powered platforms installed for emergency purposes.

(3) *Design requirements.* All new powered platforms for exterior building maintenance purchased and used after the effective date of these regulations shall meet all of the design, construction, installation, and maintenance requirements of Part II and III of the "American National Standard Safety Requirements for Powered Platforms for Exterior Building Maintenance ANSI A120.1–1970" and of this section. Reference shall be made to appropriate parts of ANSI A120.1–1970 for detail specifications for equipment and special installations.

(4) *Limitation.* The requirements of this section apply only to electric powered platforms. It is not the intent of this section to prohibit the use of other types of power. Installation of powered platforms using other types of power is permitted, provided such platforms have adequate protective devices for the type of power used, and otherwise provide for reasonable safety of life and limb to users of equipment and to others who may be exposed.

(5) *Types of powered platforms.* (i) For the purpose of applying this standard, powered platforms are divided into two basic types, Type F and Type T.

(ii) Powered platforms designated as Type F shall meet all of the requirements of subparagraph (3) of this paragraph. A basic requirement of Type F equipment is that the working platform is suspended by at least four wire ropes and designed so that failure of any one wire rope will not substantially alter the normal position of the working platform. Another basic requirement of Type F equipment is that only one layer of hoisting rope is permitted on winding drums. Type F powered platforms may be either roof-powered or self-powered.

(iii) Powered platforms designated as Type T shall meet all the requirements of subparagraph (3) of this paragraph. A basic requirement of Type T equipment is that the working platform is suspended by at least two wire ropes. Failure of one wire rope would not permit the working platform to fall to the ground, but would upset its normal position. The employer shall require employees working on Type T equipment to wear safety belts, which are attached by lifelines to either the working platform or the building structure. Type T powered platform may be either roof-powered or self-powered.

(iv) The requirements of this section apply to powered platforms with winding drum type hoisting machines. It is not the intent of this section to prohibit powered platforms using other types of hoisting machines such as, but not limited to, traction drum hoisting machines, air powered machines, hydraulic powered machines, and internal combustion machines. Installation of powered platforms with other types of hoisting machines is permitted, provided adequate protective devices are used, and provided reasonable safety of life and limb to users of the equipment and to others who may be exposed is assured.

(c) *Type F powered platforms*—(1) *Roof car, general.* (i) A roof car shall be provided whenever it is necessary to move the working platform horizontally to working or storage positions.

(ii) The maximum rated speed at which a power traversed roof car may be moved in a horizontal direction shall be 50 feet per minute.

(2) *Movement and positioning of roof car.* (i) Restriction of movement is required. Provision shall be made to protect against having the roof car leave the roof or enter roof areas not designed for travel.

(ii) The horizontal motion of the roof cars shall be positively controlled so as to insure proper movement and positioning of the roof car.

(iii) Roof car positioning devices shall be provided to insure that the working platform is placed and retained in proper position for vertical travel and during storage.

(iv) Mechanical stops shall be provided to prevent the traversing of the roof car beyond its normal limits of travel. Such stops shall be capable of withstanding a force equal to 100 percent of the inertial effect of the roof car in motion with traversing power applied.

(v) (*a*) The operating device of a power-operated roof car for traversing shall be located on the roof car, the working platform, or both, and shall be of the continuous pressure weatherproof electric type. If more than one operating device is provided, they shall be so arranged that traversing is possible only from one operating device at a time.

(*b*) The operating device shall be so connected that it is not operable until:

(*1*) The working platform is located at its uppermost position of travel and is not in contact with the building face or fixed vertical guides in the face of the building; and

(*2*) All protective devices and interlocks are in a position for traversing.

(3) *Roof car stability.* Roof car stability shall be determined by either subdivision (i) or (ii) of this subparagraph whichever is greater.

(i) The roof car shall be continuously stable, considering overturning moment as determined by 125 percent rated load, plus maximum dead load and the prescribed wind loading.

(ii) The roof car and its anchorages shall be capable of resisting accidental over-tensioning of the wire ropes suspending the working platform and this calculated value shall include the effect of one and one-half times the value. For this calculation, the simultaneous effect of one-half wind load shall be included, and the design stresses shall not exceed those referred to in paragraph (b) (3) of this section.

(iii) If the load on the motors is at any time in excess of three times that required for lifting the working platform with its rated load, the motor shall stall.

(4) *Access to the roof car.* Safe access to the roof car and from the roof car to the working platform shall be provided. If the access to the roof car at any point of its travel is not over the roof area or where otherwise necessary for safety, self-closing, self-locking gates shall be provided. Applicable provisions of the American National Standard Safety Requirements for Floor and Wall Openings, Railings and Toeboard, A12.1–1967, shall apply.

(5) *Means for maintenance, repair, and storage.* Means shall be provided to run the roof car away from the roof perimeter, where necessary, and to provide a safe area for maintenance, repairs, and storage. Provisions shall be made to secure the machine in the stored position. For stored machines subject to wind forces, see special design and anchorage requirements for "wind forces" in Part II, section 10.5 of ANSI A120.1–1970.

(6) *General requirements for working platforms.* The working platform shall be of girder or truss construction and shall be adequate to support its rated load under any position of loading, and comply with the provisions set forth in paragraph (b) (3) of this section.

(7) *Load rating plate.* Each working platform shall bear a manufacturer's load rating plate, conspicuously posted; stating the maximum permissible rated load. Load rating plates shall be made of noncorrosive material and shall have letters and figures stamped, etched, or cast on the surface. The minimum height of the letters and figures shall be one-fourth inch.

(8) *Minimum size.* The working platform shall have a minimum net width of 24 inches.

(9) *Guard rails.* Working platforms shall be furnished with permanent guard rails not less than 36 inches high, and not more than 42 inches high at the front (building side). At the rear, and on the sides, the rail shall not be less than 42 inches high. An intermediate guardrail shall be provided around the entire platform between the top guardrail and the toeboard.

(10) *Toeboards.* A 4-inch toeboard shall be provided along all sides of the working platform.

(11) *Open spaces between guardrails and toeboards.* The spaces between the intermediate guardrail and platform toeboard on the building side of the working platform, and between the top guardrail and the toeboard on other sides of the platform, shall be filled with metallic mesh or similar material that will reject a ball 1 inch in diameter. The installed mesh shall be capable of withstanding a load of 100 pounds applied horizontally over any area of 12 square inches. If the space between the platform and the building face does not exceed 8 inches, and the platform is restrained by guides, the mesh may be omitted on the front side.

(12) *Flooring.* The platform flooring shall be of the nonskid type, and if of open construction, shall reject a $\frac{9}{16}$-inch diameter ball, or be provided with a screen below the floor to reject a $\frac{9}{16}$-inch diameter ball.

(13) *Access gates.* Where access gates are provided, they shall be self-closing and self-locking.

(14) *Operating device for vertical movement of the working platform.* (i) The normal operating device for the working platform shall be located on the working platform and shall be of the continuous pressure weatherproof electric type.

(ii) The operating device shall be operable only when all electrical protective devices and interlocks on the working platform are in position for normal service, and the roof car, if provided, is at an established operating point.

(15) *Emergency electric operative device.* (i) In addition, on roof-powered platforms, an emergency electric operating device shall be provided near the hoisting machine for use in the event of failure of the normal operating device for the working platform, or failure of the traveling cable system. The emergency operating device shall be mounted in a locked compartment and shall have a legend mounted thereon reading: "For Emergency Operation Only. Establish Communication With Personnel on Working Platform Before Use."

(ii) A key for unlocking the compartment housing the emergency operating device shall be mounted in a break-glass receptacle located near the emergency operating device.

(16) *Manual cranking for emergency operation.* Emergency operation of the main drive machine may be provided to allow manual cranking. This provision for manual operation shall be designed so that not more than two persons will be required to perform this operation. The access to this provision shall include a means to automatically make the machine inoperative electrically while under the emergency manual operation. The design shall be such that the emergency brake is operative at or below governor tripping speed during manual operation.

(17) *Arrangement and guarding of hoisting equipment.* (i) Hoisting equipment shall consist of a power-driven drum or drum contained in the roof car (roof-powered platforms) or contained on the working platform (self-powered platform).

(ii) The hoisting equipment shall be power-operated in both up and down directions.

(iii) Guard or other protective devices shall be installed wherever rotating shafts or other mechanisms or gears may expose personnel to a hazard.

(iv) Friction devices or clutches shall not be used for connecting the main driving mechanism to the drum or drums. Belt- or chain-driven machines are prohibited.

(18) *Hoisting motors.* (i) Hoisting motors shall be electric and of weatherproof construction.

(ii) Hoisting motors shall be in conformance with applicable provisions of subparagraph (22) of this paragraph, Electrical wiring and equipment.

(iii) Hoisting motors shall be directly connected to the hoisting machinery. Motor couplings, if used, shall be of steel construction.

(19) *Brakes.* The hoisting machine(s) shall have two independent braking means, each designed to stop and hold the working platform with 125 percent of rated load.

(20) *Hoisting ropes and rope connections.* (i) Working platforms shall be suspended by wire ropes of either 6 x 19 or 6 x 37 classification, preformed or nonpreformed.

(ii) The minimum grade of the wire rope shall be improved plow steel. Ropes shall be fabricated of drawn galvanized or bright wire. Drawn galvanized wire rope shall be fabricated of individual wires on which the zinc coating has been applied at an intermediate size, and

the wire then drawn to finished size and to the same tolerances and with the same mechanical properties as for uncoated wire of equal grade.

(iii) The minimum factor of safety shall be ten, and shall be calculated by the following formula:

$$F = \frac{S \times N}{W}$$

where

S=Manufacturer's rated breaking strength of one rope.
N=Number of ropes under load.
W=Maximum static load on all ropes with the platform and its rated load at any point of its travel.

(iv) Hoisting ropes shall be sized to conform with the required factor of safety, but in no case shall the size be less than five-sixteenths-inch diameter.

(v) Winding drums shall have at least three turns of rope remaining when the platform has landed at the lowest possible point of its travel.

(vi) The lengthening or repairing of wire rope by the joining of two or more lengths is prohibited.

(vii) The nondrum ends of the hoisting ropes shall be provided with individual shackle rods which will permit individual adjustment of rope lengths, if required.

(viii) Reverse bends in rope arrangement should be avoided. More than two reverse bends in each rope is prohibited.

(21) *Rope tag data.* (i) A metal data tag shall be securely attached to one of the wire rope fastenings. This data tag shall bear the following wire rope data:

(*a*) The diameter in inches.

(*b*) Construction classification.

(*c*) Whether nonpreformed or preformed.

(*d*) The grade of material used.

(*e*) The manufacturer's rated breaking strength.

(*f*) Name of the manufacturer of the rope.

(*g*) The month and year the ropes were installed.

(*h*) Name of the person or firm who installed ropes.

(ii) Noncorrosive metal data tags shall be used. The minimum height of the letters, stamped or etched, shall be one-sixteenth inch.

(iii) A new tag shall be installed at each rope renewal. When ropes are refastened, the original tag shall be retained and a supplemental tag showing the date of refastening and the name of the person or firm who refastened the ropes shall be provided.

(22) *Electrical wiring and equipment.* (i) All electrical equipment and wiring shall conform to the requirements of the American National Standard National Electrical Code, C1–1968, except as modified by ANSI A120.1–1970 "American National Standard Safety Requirements for Powered Platforms for Exterior Building Maintenance." For detail design specifications for electrical equipment, see Part 2, ANSI 120.1–1970.

(ii) All motors and operation and control equipment shall be supplied from a single power source.

(iii) The power supply for the powered platform shall be an independent circuit supplied through a fused disconnect switch.

(iv) Electrical conductor parts of the power supply system shall be protected against accidental contact.

(v) Electrical grounding shall be provided.

(*a*) Provision for electrical grounding shall be included with the power-supply system.

(*b*) Controller cabinets, motor frames, hoisting machines, the working platform, roof car and roof car track system, and noncurrent carrying parts of electrical equipment, where provided, shall be grounded.

(*c*) The controller, where used, shall be so designed and installed that a single ground or short circuit will not prevent both the normal and final stopping device from stopping the working platform.

(*d*) Means shall be provided on the roof car and working platform for grounding portable electric tools.

(*e*) The working platform shall be grounded through a grounding connection in a traveling cable. Electrically powered tools utilized on the working platform shall be grounded.

(vi) Electrical receptacles located on the roof or other exterior location shall be of a weatherproof type and shall be located so as not to be subject to contact with water or accumulated snow. The receptacles shall be grounded and the electric cable shall include a grounding conductor. The receptacle and plug shall be a type designed to avoid hazard to persons inserting or withdrawing the plug. Provision shall be made to prevent application of cable strain directly to the plug and receptacle.

(vii) Electric runway conductor systems shall be of the type designed for use in exterior locations and shall be located so as not to be subject to contact with water or accumulated snow. The conductors, collectors, and disconnecting means shall conform to the same requirements as those for cranes and hoists in Article 610 of American National Standard National Electrical Code C1–1968. A grounded conductor shall parallel the power conductors and be so connected that it cannot be opened by the disconnecting means. The system shall be designed to avoid hazard to persons in the area.

(viii) Electrical protective devices and interlocks of the weatherproof type shall be provided.

(ix) Where the installation includes a roof car, electric contact(s) shall be provided and so connected that the operating devices for the working platform shall be operative only when the roof car is located and mechanically retained at an established operating point.

(x) Where the powered platform includes a power-operated roof car, the operating device for the roof car shall be inoperative when the roof car is mechanically retained at an established operating point.

(xi) An electric contact shall be provided and so connected that it will cause the down direction relay for vertical travel to open if the tension in the traveling cable exceeds safe limits.

(xii) An automatic overload device shall be provided to cut off the electrical power to the circuit in all hoisting motors for travel in the up direction, should the load applied to the hoisting ropes at either end of the working platform exceed 125 percent of its normal tension with rated load, as shown on the manufacturer's data plate on the working platform.

(xiii) An automatic device shall be provided for each hoisting rope which will cut off the electrical power to the hoisting motor or motors in the down direction and apply the brakes if any hoisting rope becomes slack.

(xiv) Upper and lower directional limit devices shall be provided to prevent the travel of the working platform beyond the normal upper and lower limits of travel.

(xv) Operation of a directional limit device shall prevent further motion in the appropriate direction, if the normal limit of travel has been reached.

(xvi) Directional limit devices, if driven from the hoisting machine by chains, tapes, or cables, shall incorporate a device to disconnect the electric power from the hoisting machine and apply both the primary and secondary brakes in the event of failure of the driving means.

(xvii) Final Terminal Stopping Devices of the Working Platform:

(*a*) Final terminal stopping devices for the working platform shall be provided as a secondary means of preventing the working platform from overtraveling at the terminals.

(*b*) The device shall be set to function as close to each terminal landing as practical, but in such a way that under normal operating conditions it will not function when the working platform is stopped by the normal terminal stopping device.

(*c*) Operation of the final terminal stopping device shall open the potential relay for vertical travel, thereby disconnecting the electric power from the hoisting machine, and applying both the primary and secondary brakes.

(*d*) The final terminal stopping device for the upper limit of travel shall be mounted so that it is operated directly by the motion of the working platform itself.

(xviii) Emergency stop switches shall be provided in or adjacent to each operating device.

(xix) Emergency stop switches shall:

(*a*) Have red operating buttons or handles.

(*b*) Be conspicuously and permanently marked "Stop".

(*c*) Be the manually opened and manually closed type.

(*d*) Be positively opened with the opening not solely dependent on springs.

(xx) The manual operation of an emergency stop switch associated with an operating device for the working plat-

form shall open the potential relay for vertical travel, thereby disconnecting the electric power from the hoisting machine and applying both the primary and secondary brakes.

(xxi) The manual operation of the emergency stop switch associated with the operating device for a power-driven roof car shall cause the electrical power to the traverse machine to be interrupted, and the traverse machine brake to apply.

(23) *Requirements for emergency communications.* (i) Communication equipment shall be provided for each powered platform for use in an emergency.

(ii) Two-way communication shall be established between personnel on the roof and personnel on the stalled working platform before any emergency operation of the working platform is undertaken by personnel on the roof.

(iii) The equipment shall permit two-way voice communication between the working platform and

(*a*) Designated personnel continuously available while the powered platform is in use; and

(*b*) Designated personnel on roof-powered platforms, undertaking emergency operation of the working platform by means of the emergency operating device located near the hoisting machine.

(iv) The emergency communication equipment shall be one of the following types:

(*a*) Telephone connected to the central telephone exchange system; or

(*b*) Telephones on a limited system or an approved two-way radio system, provided designated personnel are available to receive a message during the time the powered platform is in use.

(d) *Type T powered platforms*—(1) *Roof car.* The requirements of paragraphs (c)(1) through (c)(5) of this section shall apply to Type T powered platforms.

(2) *Working platform.* The requirements of paragraphs (c)(6) through (c)(16) of this section apply to Type T powered platforms.

(i) The working platform shall be suspended by at least two wire ropes.

(ii) The maximum rated speed at which the working platform of self-powered platforms may be moved in a vertical direction shall not exceed 35 feet per minute.

(3) *Hoisting equipment.* The requirements of paragraphs (c) (17) and (18) of this section shall apply to Type T powered platforms.

(4) *Brakes.* Brakes requirements of paragraph (c)(19) of this section shall apply.

(5) *Hoisting ropes and rope connections.* (i) Paragraph (c)(20) (i) through (vi) and (viii) of this section shall apply to type T powered platforms.

(ii) Adjustable shackle rods in subparagraph (c)(20)(vii) of this section shall apply to type T powered platforms if the working platform is suspended by more than two wire ropes.

(6) *Electrical wiring and equipment.* (i) The requirements of paragraph (c)(22) (i) through (vi) of this section shall apply to type T powered platforms. "Circuit protection limitation," "powered platform electrical service system," all operating services and control equipment shall comply with the specifications contained in Part 2, section 26, of ANSI A120.1–1970.

(ii) For electrical protective devices the requirements of paragraph (c)(22) (i) through (viii) of this section shall apply to type T powered platforms. Requirements for the "circuit potential limitation" shall be in accordance with the specifications contained in Part 2, section 26, of ANSI A120.1–1970.

(7) *Emergency communications.* All the requirements of paragraph (c)(23) of this section shall apply to type T powered platforms.

(8) *Safety belts and lifelines.* (i) Each employee on the working platform of type T powered platforms shall be provided with a safety belt with means for attachment to a lifeline on the roof or to the working platform. It is recommended that safety belts, lines and other components, including fastening means and anchorages to the working platform, building, or structure, be capable of withstanding a static load of 4,000 pounds without damage or permanent deformation of any part.

(ii) Fastening devices should be of the self-closing type, equipped with a locking device to prevent accidental opening of the fastening device.

(iii) Harness-type belts are recommended. If body-type belts are used, it is recommended that the portion of the belt bearing on the front of the wearer's body have a minimum width of 3 inches.

(iv) It is recommended that the line used to connect the belt to the platform, or to a lifeline attached to the building, have a maximum length of 5 feet.

(e) *Inspections and tests*—(1) *Inspections and tests of new installations and alterations.* All powered platform installations shall, on their completion, and before being placed in service, be subjected to an acceptance test in the field to determine that all parts of the installation conform to applicable requirements of this standard, and that all safety and operating equipment functions as required. A similar inspection and test shall be made following a major alteration to an existing installation.

(2) *Periodic inspections and tests.* Each installation shall undergo a periodic inspection and test at least every 12 months. All parts of the equipment shall be inspected, and where necessary, tested to determine that they are in safe operating condition.

(3) *Maintenance inspections and tests.* Each installation shall undergo a maintenance inspection and test every 30 days, except where the cleaning cycle is less than 30 days, such inspection and test shall be made prior to each cleaning cycle. The results of these inspections and tests shall be recorded in a log which is available for review by the Assistant Secretary of Labor or his designated representative. Each log entry shall include the date of the inspection or test and shall be signed by the person making the inspection or test.

(4) *Special inspection of governors and secondary brakes.* (i) Special inspections and tests of the governor and secondary braking system shall be made at intervals not exceeding 1 year.

(ii) The inspection and test shall include a verification that the initiating device for the secondary breaking operates at the proper overspeed.

(iii) If adequate tests cannot be performed in the field, the initiating device may be removed from the powered platform and sent to a shop equipped to make such a test.

(iv) The inspection shall include a verification of the proper functioning of the secondary brake. If an adequate test cannot be performed in the field, the hoisting machine may be removed from the building and sent to a shop equipped to make such a test.

(v) If any hoisting machine or initiating device for the secondary brake system is removed from the building for testing, all reinstalled and directly related components shall be reinspected prior to returning the powered platform installation to service.

(5) *Adverse weather.* The operation of powered platforms during severe adverse weather conditions is prohibited.

(6) *Maintenance.* (i) Required maintenance. All parts of equipment on which safe operation depends shall be maintained in proper working order so that they perform the function for which they are intended.

(ii) Broken or worn parts, worn switch contacts, brushes, and short flexible conductors of electrical devices, which may interfere with safe operation, shall be replaced promptly. Electrical receptacles and plugs shall be replaced promptly when worn or damaged. All electrical connections shall be kept tight.

(iii) Components of the electrical service system and traveling cables shall be replaced when damaged or substantially abraded.

(iv) Gears, shafts, bearings, brakes, and hoisting drums shall be maintained in proper alinement. Gears shall be replaced promptly when there is evidence of appreciable wear.

(7) *Cleaning.* (i) Controller contactors and relays shall be kept clean and free from dirt.

(ii) All other parts shall be kept clean, if their proper functioning would be affected by the presence of dirt or other contaminants.

(8) *Periodic reshackling of hoisting ropes.* The ropes shall be reshackled at the nondrum ends at intervals not exceeding 24 months. In reshackling the ropes, a sufficient length shall be cut from the end of the rope to remove damaged or fatigued portions.

(9) *Making safety devices inoperative.* No person shall at any time make any required safety device or electrical protective device inoperative, except when necessary during tests, inspections, and maintenance. Immediately upon completion of such test, inspections, and main-

tenance, the devices shall be restored to their normal operating condition.

(10) *Damaged rope.* Wire ropes shall be replaced whenever there are six or more broken wires in any one lay of the wire rope, or whenever the ropes are damaged or in a deteriorated condition.

(11) *Roof track system.* Roof track systems tiedowns, or similar equipment, if provided, shall be maintained in proper working order so that they perform the function for which they are intended.

(12) *Building face guiding members.* T-rails, indented mullions, or equivalent guides located in the face of the building, if provided, shall be maintained in proper working order so that they perform the function for which they are intended. Brackets for cable stabilizers, if provided, shall similarly be maintained in proper working order.

§ 1910.67 Vehicle-mounted elevating and rotating work platforms.

(a) *Definitions applicable to this section*—(1) *Aerial device.* Any vehicle-mounted scoping or articulating or both, which is used to position personnel.

(2) *Aerial ladder.* An aerial device consisting of a single- or multiple-section extensible ladder.

(3) *Articulating boom platform.* An aerial device with two or more hinged boom sections.

(4) *Extensible boom platform.* An aerial device (except ladders) with a telescopic or extensible boom. Telescopic derricks with personnel platform attachments shall be considered to be extensible boom platforms when used with a personnel platform.

(5) *Insulated aerial device.* An aerial device designed for work on energized lines and apparatus.

(6) *Mobile unit.* A combination of an aerial device, its vehicle, and related equipment.

(7) *Platform.* Any personnel-carrying device (basket or bucket) which is a component of an aerial device.

(8) *Vehicle.* Any carrier that is not manually propelled.

(9) *Vertical tower.* An aerial device designed to elevate a platform in a substantially vertical axis.

(b) *General requirements*—(1) *Application.* (i) This section relates to the following types of vehicle-mounted aerial devices used to elevate personnel to job sites above ground:

(*a*) Extensible boom platforms.
(*b*) Aerial ladders.
(*c*) Articulating boom platforms.
(*d*) Vertical towers.
(*e*) A combination of any of the above.

These devices are made of metal, wood, fiberglass reinforced plastic (FRP), or other material and are powered or manually operated, whether or not they are capable of rotating about a substantially vertical axis.

(ii) The requirements of this section do not include any matter relating to firefighting equipment or any matter relating to the vehicles upon which aerial devices are mounted, except in respect to a vehicle being a stable support for the aerial device.

(2) *Design requirements.* All new vehicle-mounted elevating and rotating work platforms after the effective date of these regulations shall meet the design, construction, and test specifications of the "American National Standard for Vehicle-Mounted Elevating and Rotating Work Platforms ANSI A92.2–1969."

§ 1910.68 Manlifts.

(a) *Definitions applicable to this section*—(1) *Handhold (Handgrip).* A handhold is a device attached to the belt which can be grasped by the passenger to provide a means of maintaining balance.

(2) *Open type.* One which has a handgrip surface fully exposed and capable of being encircled by the passenger's fingers.

(3) *Closed type.* A cup-shaped device, open at the top in the direction of travel of the step for which it is to be used, and closed at the bottom, into which the passenger may place his fingers.

(4) *Limit switch.* A device, the purpose of which is to cut off the power to the motor and apply the brakes to stop the carrier in the event that a loaded step passes the terminal landing.

(5) *Manlift.* A device consisting of a power-driven endless belt moving in one direction only, and provided with steps or platforms and handholds attached to it for the transportation of personnel from floor to floor.

(6) *Rated speed.* Rated speed is the speed for which the device is designed and installed.

(7) *Split-rail switch.* An electric limit switch operated mechanically by the rollers on the manlift steps. It consists of an additional hinged or "split" rail, mounted on the regular guiderail, over which the step rollers pass. It is spring-loaded in the "split" position. If the step supports no load, the rollers will "bump" over the switch; if a loaded step should pass over the section, the split rail will be forced straight, tripping the switch and opening the electrical circuit.

(8) *Step (platform).* A step is a passenger carrying unit.

(9) *Travel.* The travel is the distance between the centers of the top and bottom pulleys.

(b) *General requirements*—(1) *Application.* This section applies to the construction, maintenance, inspection, and operation of manlifts in relation to accidental hazards. Manlifts covered by this section consist of platforms or brackets and accompanying handholds mounted on, or attached to an endless belt, operating vertically in one direction only and being supported by, and driven through pulleys, at the top and bottom. These manlifts are intended for conveyance of persons only. It is not intended that this section cover moving stairways, elevators with enclosed platforms ("Paternoster" elevators), gravity lifts, nor conveyors used only for conveying material. This section aplies to manlifts used to carry only personnel trained and authorized by the employer in their use.

(2) *Exceptions for new and existing equipment.* The purpose of this section is to provide reasonable safety for life and limb.

(3) *Design requirements.* All new manlift installations and equipment installed after the effective date of these regulations shall meet the design requirements of the "American National Safety Standard for Manlifts ANSI A90.1–1969", and the requirements of this section.

(4) *Reference to other codes and subparts.* The following codes, and subparts of this part, are applicable to this section. Safety Code for Mechanical Power-Transmission Apparatus, ANSI B15.1–1953 (R 1958) and subpart O; National Electrical Code, ANSI C1–1968 and subpart S; Safety Code for Fixed Ladders, ANSI A14.3–1956 and Safety Requirements for Floor and Wall Openings, Railings and Toeboards, ANSI A12.1–1967 and subpart D.

(5) *Floor openings*—(i) *Allowable size.* Floor openings for both the "up" and "down" runs shall be not less than 28 inches nor more than 36 inches in width for a 12-inch belt not less than 34 inches nor more than 38 inches for a 14-inch belt; and not less than 36 inches nor more than 40 inches for a 16-inch belt and shall extend not less than 24 inches, nor more than 28 inches from the face of the belt.

(ii) *Uniformity.* All floor openings for a given manlift shall be uniform in size and shall be approximately circular, and each shall be located vertically above the opening below it.

(6) *Landing*—(i) *Vertical clearance.* The clearance between the floor or mounting platform and the lower edge for the conical guard above it required by subparagraph (7) of this paragraph shall not be less than 7 feet 6 inches. Where this clearance cannot be obtained no access to the manlift shall be provided and the manlift runway shall be enclosed where it passes through such floor.

(ii) *Clear landing space.* The landing space adjacent to the floor openings shall be free from obstruction and kept clear at all times. This landing space shall be at least 2 feet in width from the edge of the floor opening used for mounting and dismounting.

(iii) *Lighting and landing.* Adequate lighting not less than 5-foot candles, shall be provided at each floor landing at all times when the lift is in operation.

(iv) *Landing surface.* The landing surfaces at the entrances and exits to the manlift shall be constructed and maintained as to provide safe footing at all times.

(v) *Emergency landings.* Where there is a travel of 50 feet or more between floor landings, one or more emergency landings shall be provided so that there will be a landing (either floor or emergency) for every 25 feet or less of manlift travel.

(*a*) Emergency landings shall be accessible from both the "up" and "down" rungs of the manlift and shall give access to the ladder required in subparagraph (12) of this paragraph.

(b) Emergency landings shall be completely enclosed with a standard railing and toeboard.

(c) Platforms constructed to give access to bucket elevators or other equipment for the purpose of inspection, lubrication, and repair may also serve as emergency landings under this rule. All such platforms will then be considered part of the emergency landing and shall be provided with standard railings and toeboards.

(7) *Guards on underside of floor openings*—(i) *Fixed type.* On the ascending side of the manlift floor openings shall be provided with a bevel guard or cone meeting the following requirements:

(a) The cone shall make an angle of not less than 45° with the horizontal. An angle of 60° or greater shall be used where ceiling heights permit.

(b) The lower edge of this guard shall extend at least 42 inches outward from any handhold on the belt. It shall not extend beyond the upper surface of the floor above.

(c) The cone shall be made of not less than No. 18 U.S. gauge sheet steel or material of equivalent strength or stiffness. The lower edge shall be rolled to a minimum diameter of one-half inch and the interior shall be smooth with no rivets, bolts or screws protruding.

(ii) *Floating type.* In lieu of the fixed guards specified in subdivision (i) of this subparagraph a floating type safety cone may be used, such floating cones to be mounted on hinges at least 6 inches below the underside of the floor and so constructed as to actuate a limit switch should a force of 2 pounds be applied on the edge of the cone closest to the hinge. The depth of this floating cone need not exceed 12 inches.

(8) *Protection of entrances and exits*—(i) *Guardrail requirement.* The entrances and exits at all floor landings affording access to the manlift shall be guarded by a maze (staggered railing) or a handrail equipped with self-closing gates.

(ii) *Construction.* The rails shall be standard guardrails with toeboards meeting the provisions of the Safety Requirements for Floor and Wall Openings, Railings and Toeboards, ANSI A12.1–1967 and section 1910.23.

(iii) *Gates.* Gates, if used, shall open outward and shall be self-closing. Corners of gates shall be rounded.

(iv) *Maze.* Maze or staggered openings shall offer no direct passage between enclosure and outer floor space.

(v) Except where building layout prevents, entrances at all landings shall be in the same relative position.

(vi) If located in buildings to which the public has access, such manlift or manlifts shall be located in an enclosure protected by self-closing spring-locked doors. Keys to such doors shall be limited to authorized personnel.

(9) *Guards for openings*—(i) *Construction.* The floor openings at each landing shall be guarded on sides not used for entrance or exit by a wall, a railing and toeboard or by panels of wire mesh of suitable strength.

(ii) *Height and location.* Such rails or guards shall be at least 42 inches in height on the up-running side and 66 inches on the down-running side.

(10) *Bottom arrangement*—(i) *Bottom landing.* At the bottom landing the clear area shall be not smaller than the area enclosed by the guardrails on the floors above, and any wall in front of the down-running side of the belt shall be not less than 48 inches from the face of the belt. This space shall not be encroached upon by stairs or ladders.

(ii) *Location of lower pulley.* The lower (boot) pulley shall be installed so that it is supported by the lowest landing served. The sides of the pulley support shall be guarded to prevent contact with the pulley or the steps.

(iii) *Mounting platform.* A mounting platform shall be provided in front or to one side of the uprun at the lowest landing, unless the floor level is such that the following requirement can be met: The floor or platform shall be at or above the point at which the upper surface of the ascending step completes its turn and assumes a horizontal position.

(iv) *Guardrails.* To guard against persons walking under a descending step, the area on the downside of the manlift shall be guarded in accordance with subparagraph (8) of this paragraph. To guard against a person getting between the mounting platform and an ascending step, the area between the belt and the platform shall be protected by a guardrail.

(11) *Top arrangements*—(i) *Clearance from floor.* A top clearance shall be provided of at least 11 feet above the top terminal landing. This clearance shall be maintained from a plane through each face of the belt to a vertical cylindrical plane having a diameter 2 feet greater than the diameter of the floor opening, extending upward from the top floor to the ceiling on the up-running side of the belt. No encroachment of structural or machine supporting members within this space will be permitted.

(ii) *Pulley clearance.* (a) There shall be a clearance of at least 5 feet between the center of the head pulley shaft and any ceiling obstruction.

(b) The center of the head pulley shaft shall be not less than 6 feet above the top terminal landing.

(iii) *Emergency grab rail.* An emergency grab bar or rail and platform shall be provided at the head pulley when the distance to the head pulley is over 6 feet above the top landing, otherwise only a grab bar or rail is to be provided to permit the rider to swing free should the emergency stops become inoperative.

(12) *Emergency exit ladder.* A fixed metal ladder accessible from both the "up" and "down" run of the manlift shall be provided for the entire travel of the manlift. Such ladder shall be in accordance with the existing ANSI A14.3–1956. Safety Code for Fixed Ladders and section 1910.27.

(13) *Superstructure bracing.* Manlift rails shall be secured in such a manner as to avoid spreading, vibration, and misalinement.

(14) *Illumination*—(i) *General.* Both runs of the manlift shall be illuminated at all times when the lift is in operation. An intensity of not less than 1-foot candle shall be maintained at all points. (However, see subparagraph (6) (iii) of this paragraph for illumination requirements at landings.)

(ii) *Control of illumination.* Lighting of manlift runways shall be by means of circuits permanently tied in to the building circuits (no switches), or shall be controlled by switches at each landing. Where separate switches are provided at each landing, any switch shall turn on all lights necessary to illuminate the entire runway.

(15) *Weather protection.* The entire manlift and its driving mechanism shall be protected from the weather at all times.

(c) *Mechanical requirements*—(1) *Machines, general.* (i) *Brake.* A mechanically applied, electrically released brake shall be applied to the motor shaft for direct-connected units or to the input shaft for belt-driven units. The brake shall be capable of stopping and holding the manlift when the descending side is loaded with 250 pounds on each step.

(ii) *Belt.* (a) The belts shall be of hard-woven canvas, rubber-coated canvas, leather, or other material meeting the strength requirements of subdivision (c) of this subdivision and having a coefficient of friction such that when used in conjunction with an adequate tension device it will meet the brake test specified in subdivision (i) of this subparagraph.

(b) The width of the belt shall be not less than 12 inches for a travel not exceeding 100 feet, not less than 14 inches for a travel greater than 100 feet but not exceeding 150 feet and 16 inches for a travel exceeding 150 feet.

(c) A belt that has become torn while in use on a manlift shall not be spliced and put back in service.

(2) *Speed*—(i) *Maximum speed.* No manlift designed for a speed in excess of 80 feet per minute shall be installed.

(3) *Platforms or steps*—(i) *Minimum depth.* Steps or platforms shall be not less than 12 inches nor more than 14 inches deep, measured from the belt to the edge of the step or platform.

(ii) *Width.* The width of the step or platform shall be not less than the width of the belt to which it is attached.

(iii) *Distance between steps.* The distance between steps shall be equally spaced and not less than 16 feet measured from the upper surface of one step to the upper surface of the next step above it.

(iv) *Angle of step.* The surface of the step shall make approximately a right angle with the "up" and "down" run of the belt, and shall travel in the approximate horizontal position with the "up" and "down" run of the belt.

(v) *Surfaces.* The upper or working surfaces of the step shall be of a material having inherent nonslip characteristics (coefficient of friction not less than 0.5) or shall be covered completely by a nonslip tread securely fastened to it.

(vi) *Strength of step supports.* When subjected to a load of 400 pounds applied at the approximate center of the step, step frames, or supports and their guides shall be of adequate strength to:

(*a*) Prevent the disengagement of any step roller.

(*b*) Prevent any appreciable misalinement.

(*c*) Prevent any visible deformation of the steps or its support.

(vii) *Prohibition of steps without handholds.* No steps shall be provided unless there is a corresponding handhold above or below it meeting the requirements of subparagraph (4) of this paragraph. If a step is removed for repairs or permanently, the handholds immediately above and below it shall be removed before the lift is again placed in service.

(4) *Handholds*—(i) *Location.* Handholds attached to the belt shall be provided and installed so that they are not less than 4 feet nor more than 4 feet 8 inches above the step tread. These shall be so located as to be available on the both "up" and "down" run of the belt.

(ii) *Size.* The grab surface of the handhold shall be not less than 4½ inches in width, not less than 3 inches in depth, and shall provide 2 inches of clearance from the belt. Fastenings for handholds shall be located not less than 1 inch from the edge of the belt.

(iii) *Strength.* The handhold shall be capable of withstanding, without damage, a load of 300 pounds applied parallel to the run of the belt.

(iv) *Prohibition of handhold without steps.* No handhold shall be provided without a corresponding step. If a handhold is removed permanently or temporarily, the corresponding step and handhold for the opposite direction of travel shall also be removed before the lift is again placed in service.

(v) *Type.* All handholds shall be of the closed type.

(5) *Up limit stops*—(i) *Requirements.* Two separate automatic stop devices shall be provided to cut off the power and apply the brake when a loaded step passes the upper terminal landing. One of these shall consist of a split-rail switch mechanically operated by the step roller and located not more than 6 inches above the top terminal landing. The second automatic stop device may consist of any of the following:

(*a*) Any split-rail switch placed 6 inches above and on the side opposite the first limit switch.

(*b*) An electronic device.

(*c*) A switch actuated by a lever, rod, or plate, the latter to be placed on the "up" side of the head pulley so as to just clear a passing step.

(ii) *Manual reset location.* After the manlift has been stopped by a stop device it shall be necessary to reset the automatic stop manually. The device shall be so located that a person resetting it shall have a clear view of both the "up" and "down" runs of the manlift. It shall not be possible to reset the device from any step or platform.

(iii) *Cut-off point.* The initial limit stop device shall function so that the manlift will be stopped before the loaded step has reached a point 24 inches above the top terminal landing.

(iv) *Electrical requirements.* (*a*) Where such switches open the main motor circuit directly they shall be of the multipole type.

(*b*) Where electronic devices are used they shall be so designed and installed that failure will result in shutting off the power to the driving motor.

(*c*) Where flammable vapors or dusts may be present all electrical installations shall be in accordance with NFPA No. 70–1968 National Electric Code, requirements for such locations.

(*d*) Unless of the oil-immersed type controller contacts carrying the main motor current shall be copper to carbon or equal, except where the circuit is broken at two or more points simultaneously.

(6) *Emergency Stop*—(i) *General.* An emergency stop means shall be provided.

(ii) *Location.* This stop means shall be within easy reach of the ascending and descending runs of the belt.

(iii) *Operation.* This stop means shall be so connected with the control lever or operating mechanism that it will cut off the power and apply the brake when pulled in the direction of travel.

(iv) *Rope.* If rope is used, it shall be not less than three-eighths inch in diameter. Wire rope, unless marlin-covered, shall not be used.

(7) *Instruction and warning signs*—(i) *Instruction signs at landings or belts.* Signs of conspicuous and easily read style giving instructions for the use of the manlift shall be posted at each landing or stenciled on the belt.

(*a*) Such signs shall be of letters not less than 1 inch in height and of a color having high contrast with the surface on which it is stenciled or painted (white or yellow on black or black on white or gray).

(*b*) The instructions shall read approximately as follows:

Face the Belt.
Use the Handholds.
To Stop—Pull Rope.

(ii) *Top floor warning sign and light.* (*a*) At the top floor an illuminated sign shall be displayed bearing the following wording:

"TOP FLOOR—GET OFF"

Signs shall be in block letters not less than 2 inches in height. This sign shall be located within easy view of an ascending passenger and not more than 2 feet above the top terminal landing.

(*b*) In addition to the sign required by subdivision (*a*) of this subdivision, a red warning light of not less than 40-watt rating shall be provided immediately below the upper landing terminal and so located as to shine in the passenger's face.

(iii) *Visitor Warning.* A conspicuous sign having the following legend—AUTHORIZED PERSONNEL ONLY—shall be displayed at each landing. The sign shall be of block letters not less than 2 inches in height and shall be of a color offering high contrast with the background color.

(d) *Operating rules*—(1) *Proper use of manlifts.* No freight, packaged goods, pipe, lumber, or construction materials of any kind shall be handled on any manlift.

(e) *Periodic inspection*—(1) *Frequency.* All manlifts shall be inspected by a competent designated person at intervals of not more than 30 days. Limit switches shall be checked weekly. Manlifts found to be unsafe shall not be operated until properly repaired.

(2) *Items covered.* This periodic inspection shall cover but is not limited to the following items:

Steps.
Step Fastenings.
Rails.
Rail Supports and Fastenings.
Rollers and Slides.
Belt and Belt Tension.
Handholders and Fastenings.
Floor Landings.
Guardrails.
Lubrication.
Limit Switches.
Warning Signs and Lights.
Illumination.
Drive Pulley.
Bottom (boot) Pulley and Clearance.
Pulley Supports.
Motor.
Driving Mechanism.
Brake.
Electrical Switches.
Vibration and Misalignment.
"Skip" on up or down run when mounting step (indicating worn gears).

(3) *Inspection log.* A written record shall be kept of findings at each inspection. Records of inspection shall be made available to the Assistant Secretary of Labor or his duly authorized representative.

(SOURCE: ANSI A90.1–1969 Safety Code for Manlifts.)

§ 1910.69 Sources of standards.

Sec.	*Source*
1910.66	ANSI A120.1–1970 Safety Code for Powered Platforms for Exterior Building Maintenance.
1910.67	ANSI A92.2–1969. American National Standard for Vehicle-Mounted Elevating and Rotating Work Platforms.
1910.68	ANSI A90.1–1969 Safety Code for Manlifts.

§ 1910.70 Standards organizations.

Specific standards of the following organizations have been referenced in this subpart. Copies of the standards may be obtained from the issuing organization.

American National Standards Institute, 1430 Broadway, New York, NY 10018.

Subpart G—Occupational Health and Environmental Control

§ 1910.93 Air contaminants. (Gases, vapors, fumes, dust, and mists.)

(a) Exposures by inhalation, ingestion, skin absorption, or contact to any material or substance (1) at a concentration above those specified in the "Threshold Limit Values of Airborne Contaminants for 1970" of the American Conference of Governmental Industrial Hygienists, listed in Table G–1, except for the American National Standards listed in Table G–2 of this section and

except for values of mineral dusts listed in Table G–3 of this section, and (2) concentrations above those specified in Table G–1, G–2, and G–3 of this section, shall be avoided, or protective equipment shall be provided and used.

(b) To achieve compliance with paragraph (a) of this section, feasible administrative or engineering controls must first be determined and implemented in all cases. In cases where protective equipment, or protective equipment in addition to other measures is used as the method of protecting the employee, such protection must be approved for each specific application by a competent industrial hygienist or other technically qualified source.

TABLE G–I

Substance	p.p.m.[a]	mg./M³ [b]
Abate		15
Acetaldehyde	200	360
Acetic acid	10	25
Acetic anhydride	5	20
Acetone	1,000	2,400
Acetonitrile	40	70
Acetylene dichloride, see 1, 2-Dichloroethylene		
Acetylene tetrabromide	1	14
Acrolein	0.1	0.25
Acrylamide—Skin		0.3
Acrylonitrile—Skin	20	45
Aldrin—Skin		0.25
Allyl alchol—Skin	2	5
Allyl chloride	1	3
**C Allyl glycidyl ether (AGE)	10	45
Allyl propyl disulfide	2	12
2-Aminoethanol, see Ethanolamine		
2-Aminopyridine	0.5	2
**Ammonia	50	35
Ammonium sulfamate (Ammate)		15
n-Amyl acetate	100	525
sec-Amyl acetate	125	650
Aniline—Skin	5	19
Anisidine (o, p-isomers)—Skin		0.5
Antimony and compounds (as Sb)		0.5
ANTU (alpha naphthyl thiourea)		0.3
Arsenic and compounds (as As)		0.5
Arsine	0.05	0.2
Azinphos-methyl—Skin		0.2
Barium (soluble compounds)		0.5
p-Benzoquinone, see Quinone		
Benzoyl peroxide		5
Benzyl chloride	1	5
Biphenyl, see Diphenyl		
Bisphenol A, see Diglycidyl ether		
Boron oxide		15
Boron tribromide	1	10
C Boron trifluoride	1	3
Bromine	0.1	0.7
*Bromine pentafluoride	0.1	0.7
Bromoform—Skin	0.5	5
Butadiene (1, 3-butadiene)	1,000	2,200
Butanethiol, see Butyl mercaptan		
2-Butanone	200	590
2-Butoxy ethanol (Butyl Cellosolve)—Skin	50	240
Butyl acetate (n-butyl acetate)	150	710
sec-Butyl acetate	200	950
tert-Butyl acetate	200	950
Butyl alcohol	100	300
sec-Butyl alcohol	150	450
tert-Butyl alcohol	100	300
C Butylamine—Skin	5	15
C tert-Butyl chromate (as CrO_3)—Skin		0.1
n-Butyl glycidyl ether (BGE)	50	270
*Butyl mercaptan	0.5	1.5
p-tert-Butyltoluene	10	60
Calcium arsenate		1
Calcium oxide		5
**Camphor (Synthetic)	2	
Carbaryl (Sevin ®)		5
Carbon black		3.5
Carbon dioxide	5,000	9,000
Carbon monoxide	50	55
Chlordane—Skin		0.5
Chlorinated camphene—Skin		0.5
Chlorinated diphenyl oxide		0.5
*Chlorine	1	3
Chlorine dioxide	0.1	0.3
C Chlorine trifluoride	0.1	0.4
C Chloroacetaldehyde	1	3
α-Chloroacetophenone (phenacylchloride)	0.05	0.3
Chlorobenzene (monochlorobenzene)	75	350
o-Chlorobenzylidene malononitrile (OCBM)	0.05	0.4
Chlorobromomethane	200	1,050
2-Chloro-1,3-butadiene, see Chloroprene		
Chlorodiphenyl (42 percent Chlorine)—Skin		1
Chlorodiphenyl (54 percent Chlorine)—Skin		0.5
1-Chloro,2,3-epoxypropane, see Epichlorhydrin		
2-Chloroethanol, see Ethylene chlorohydrin		
Chloroethylene, see Vinyl choride		
C Chloroform (trichloromethane)	50	240
1-Chloro-1-nitropropane	20	100
Chloropicrin	0.1	0.7
Chloroprene (2-chloro-1,3-butadiene)—Skin	25	90
Chromium, sol. chromic, chromous salts as Cr		0.5
Metal and insol. salts		1
Coal tar pitch volatiles (benzene soluble fraction) anthracene, BaP, phenanthrene, acridine, chrysene, pyrene		0.2
Cobalt, metal fume and dust		0.1
Copper fume		0.1
Dusts and Mists		1
Cotton dust (raw)		1
Crag® herbicide		15
Cresol (all isomers)—Skin	5	22
Crotonaldehyde	2	6
Cumene—Skin	50	245
Cyanide (as CN)—Skin		5
*Cyanogen	100	
Cyclohexane	300	1,050
Cyclohexanol	50	200
Cyclohexanone	50	200
Cyclohexene	300	1,015
Cyclopentadiene	75	200
2, 4-D		10
DDT—Skin		1
DDVP, see Dichlorvos		
Decaborane—Skin	0.05	0.3
Demeton®—Skin		0.1
Diacetone alcohol (4-hydroxy-4-methyl-2-pentanone)	50	240
1,2-diaminoethane, see Ethylenediamine		
Diazomethane	0.2	0.4
Diborane	0.1	0.1
Dibutyl phosphate	1	5
Dibutylphthalate		5
*C Dichloroacetylene	0.1	0.4
C o-Dichlorobenzene	50	300
p-Dichlorobenzene	75	450
Dichlorodifluoromethane	1,000	4,950
1,3-Dichloro-5,5-dimethyl hydantoin		0.2
1,1-Dichloroethane	100	400
1,2-Dichloroethylene	200	790
C Dichloroethyl ether—Skin	15	90
Dichloromethane, see Methylenechloride		
Dichloromonofluoromethane	1,000	4,200
C 1,1-Dichloro-1-nitroethane	10	60
1,2-Dichloropropane, see Propylenedichloride		
Dichlorotetrafluoroethane	1,000	7,000
Dichlorvos (DDVP)—Skin		1
Dieldrin—Skin		0.25
Diethylamine	25	75
Diethylamino ethanol—Skin	10	50
**C Diethylene triamine—Skin	10	42
Diethylether, see Ethyl ether		
Difluorodibromomethane	100	860
C Diglycidyl ether (DGE)	0.5	2.8
Dihydroxybenzene, see Hydroquinone		
Diisobutyl ketone	50	290
Diisopropylamine—Skin	5	20
Dimethoxymethane, see Methylal		
Dimethyl acetamide—Skin	10	35
Dimethylamine	10	18
Dimethylaminobenzene, see Xylidene		
Dimethylaniline(N-dimethyl-aniline)—Skin	5	25
Dimethylbenzene, see Xylene		
Dimethyl 1,2-dibromo-2,2-dichloroethyl phosphate, (Dibrom)		3
Dimethylformamide—Skin	10	30
2,6-Dimethylheptanone, see Diisobutyl ketone		
1,1-Dimethylhydrazine—Skin	0.5	1
Dimethylphthalate		5
Dimethylsulfate—Skin	1	5
Dinitrobenzene (all isomers)—Skin		1
Dinitro-o-cresol—Skin		0.2
Dinitrotoluene—Skin		1.5
Dioxane (Diethylene dioxide)—Skin	100	360
Diphenyl	0.2	1
Diphenyl amine		10
Diphenylmethane diisocyanate (see Methylene bisphenyl isocyanate (MDI)		
Dipropylene glycol methyl ether—Skin	100	600
Di-sec, octyl phthalate (Di-2-ethylhexylphthalate)		5
*Endosulfan (Thiodan ®)—Skin		0.1
Endrin—Skin		0.1
Epichlorhydrin—Skin	5	19
EPN—Skin		0.5
1,2-Epoxypropane, see Propyleneoxide		
2,3-Epoxy-1-propanol, see Glycidol		
Ethanethiol, see Ethylmercaptan		
Ethanolamine	3	6
2-Ethoxyethanol—Skin	200	740
2-Ethoxyethylacetate (Cellosolve acetate)—Skin	100	540
Ethyl acetate	400	1,400
Ethyl acrylate—Skin	25	100
Ethyl alcohol (ethanol)	1,000	1,900
Ethylamine	10	18
Ethyl sec-amyl ketone (5-methyl-3-heptanone)	25	130
Ethyl benzene	100	435
Ethyl bromide	200	890
Ethyl butyl ketone (3-Heptanone)	50	230
Ethyl chloride	1,000	2,600
Ethyl ether	400	1,200
Ethyl formate	100	300
Ethyl mercaptan	0.5	1
Ethyl silicate	100	850
Ethylene chlorohydrin—Skin	5	16
Ethylenediamine	10	25
Ethylene dibromide, see 1,2-Dibromoethane		
Ethylene dichloride, see 1,2-Dichloroethane		
C Ethylene glycol dinitrate and/or Nitroglycerin—Skin	[d] 0.2	
Ethylene glycol monomethyl ether acetate, see Methyl cellosolve acetate		
Ethylene imine—Skin	0.5	1
Ethylene oxide	50	90
Ethylidine chloride, see 1,1-Dichloroethane		
N-Ethylmorpholine—Skin	20	94
Ferbam		15
Ferrovanadium dust		1
Fluoride (as F)		2.5
Fluorine	0.1	0.2
Fluorotrichloromethane	1,000	5,600
Formic acid	5	9
Furfural—Skin	5	20
Furfuryl alcohol	50	200
Glycidol (2,3-Epoxy-1-propanol)	50	150
Glycol monoethyl ether, see 2-Ethoxyethanol		
Guthion, ® see Azinphos-methyl		
Hafnium		0.5
Heptachlor—Skin		0.5
Heptane (n-heptane)	500	2,000
Hexachloroethane—Skin	1	10
Hexachloronaphthalene—Skin		0.2
Hexane (n-hexane)	500	1,800
2-Hexanone	100	410
Hexone (Methyl isobutyl ketone)	100	410
sec-Hexyl acetate	50	300
Hydrazine—Skin	1	1.3
Hydrogen bromide	3	10
C Hydrogen chloride	5	7
Hydrogen cyanide—Skin	10	11
Hydrogen peroxide	1	1.4
Hydrogen selenide	0.05	0.2
Hydroquinone		2
*Indene	10	45
Indium and compounds, as In		0.1
C Iodine	0.1	1
Iron oxide fume		10
Iron salts, soluble, as Fe		1
Isoamyl acetate	100	525
Isoamyl alcohol	100	360
Isobutyl acetate	150	700
Isobutyl alcohol	100	300
Isophorone	25	140
Isopropyl acetate	250	950
Isopropyl alcohol	400	980
Isopropylamine	5	12

See footnotes at end of table.

TABLE G-I—Con.

Substance	p.p.m.[a]	mg./M³ [b]
Isopropylether	500	2,100
Isopropyl glycidyl ether (IGE)	50	240
Ketene	0.5	0.9
Lead arsenate		0.15
Lindane—Skin		0.5
Lithium hydride		0.025
L.P.G. (liquified petroleum gas)	1,000	1,800
Magnesium oxide fume		15
Malathion—Skin		15
Maleic anhydride	0.25	1
C Manganese and compounds, as Mn		5
Mesityl oxide	25	100
Methanethiol, see Methyl mercaptan		
Methoxychlor		15
2-Methoxyethanol, see Methyl cellosolve		
Methyl acetate	200	610
Methyl acetylene (propyne)	1,000	1,650
Methyl acetylene-propadiene mixture (MAPP)	1,000	1,800
Methyl acrylate—Skin	10	35
Methylal (dimethoxymethane)	1,000	3,100
Methyl alcohol (methanol)	200	260
Methylamine	10	12
Methyl amyl alcohol, see Methyl isobutyl carbinol		
*Methyl isoamyl ketone	100	475
Methyl (n-amyl) ketone (2-Heptanone)	100	465
C Methyl bromide—Skin	20	80
Methyl butyl ketone, see 2-Hexanone		
Methyl cellosolve—Skin	25	80
Methyl cellosolve acetate—Skin	25	120
Methyl chloroform	350	1,900
Methylcyclohexane	500	2,000
Methylcyclohexanol	100	470
o-Methylcyclohexanone—Skin	100	460
Methyl ethyl ketone (MEK), see 2-Butanone		
Methyl formate	100	250
Methyl iodide—Skin	5	28
Methyl isobutyl carbinol—Skin	25	100
Methyl isobutyl ketone, see Hexone		
Methyl isocyanate—Skin	0.02	0.05
*Methyl mercaptan	0.5	1
Methyl methacrylate	100	410
Methyl propyl ketone, see 2-Pentanone		
C Methyl silicate	5	30
C α Methyl styrene	100	480
C Methylene bisphenyl isocyanate (MDI)	0.02	0.2
Molybdenum:		
Soluble compounds		5
Insoluble compounds		15
Monomethyl aniline—Skin	2	9
C Monomethyl hydrazine—Skin	0.2	0.35
Morpholine—Skin	20	70
Naphtha (coaltar)	100	400
Naphthalene	10	50
Nickel carbonyl	0.001	0.007
Nickel, metal and soluble cmpds, as Ni		1
Nicotine—Skin		0.5
Nitric acid	2	5
Nitric oxide	25	30
p-Nitroaniline—Skin	1	6
Nitrobenzene—Skin	1	5
p-Nitrochlorobenzene—Skin		1
Nitroethane	100	310
Nitrogen dioxide	5	9
Nitrogen trifluoride	10	29
Nitroglycerin—Skin	0.2	2
Nitromethane	100	250
1-Nitropropane	25	90
2-Nitropropane	25	90
Nitrotoluene—Skin	5	30
Nitrotrichloromethane, see Chloropicrin		
Octachloronaphthalene—Skin		0.1
*Octane	400	1,900
*Oil mist, particulate		*5
Osmium tetroxide		0.002
Oxalic acid		1
Oxygen difluoride	0.05	0.1
Ozone	0.1	0.2
Paraquat—Skin		0.5
Silver, metal and soluble compounds		0.01
Sodium fluoroacetate (1080)—Skin		0.05
Sodium hydroxide		2
Stibine	0.1	0.5
*Stoddard solvent	200	1,150
Strychnine		0.15
Sulfur dioxide	5	13
Sulfur hexafluoride	1,000	6,000

See footnotes at end of table.

TABLE G-I—Con.

Substance	p.p.m.[a]	mg./M³ [b]
Sulfuric acid		1
Sulfur monochloride	1	6
Sulfur pentafluoride	0.025	0.25
Sulfuryl fluoride	5	20
Systox, see Demeton ®		
2,4,5T		10
Tantalum		5
TEDP—Skin		0.2
Tellurium		0.1
Tellurium hexafluoride	0.02	0.2
TEPP—Skin		0.05
C Terphenyls	1	9
1,1,1,2-Tetrachloro-2,2-difluoroethane	500	4,170
1,1,2,2-Tetrachloro-1,2-difluoroethane	500	4,170
1,1,2,2-Tetrachloroethane—Skin	5	35
Tetrachloroethylene, see Perchloroethylene		
Tetrachloromethane, see Carbon tetrachloride		
Tetrachloronaphthalene—Skin		2
Tetraethyl lead (as Pb)—Skin		/0.100
Tetrahydrofuran	200	590
Tetramethyl lead (as Pb)—Skin		/0.150
Tetramethyl succinonitrile—Skin	0.5	3
Tetranitromethane	1	8
Tetryl (2,4,6-trinitrophenylmethylnitramine)—Skin		1.5
Thallium (soluble compounds)—Skin as Tl		0.1
Thiram		5
Tin (inorganic cmpds, except SnH_4 and SnO_2)		2
Tin (organic cmpds)		0.1
C Toluene-2,4-diisocyanate	0.02	0.14
o-Toluidine—Skin	5	22
Toxaphene, see Chlorinated camphene		
Tributyl phosphate		5
1,1,1-Trichloroethane see Methyl chloroform		
1,1,2-Trichloroethane—Skin	10	45
Parathion—Skin		0.1
Pentaborane	0.005	0.01
Pentachloronaphthalene—Skin		0.5
Pentachlorophenol—Skin		0.5
*Pentane	500	1,500
2-Pentanone	200	700
Perchloromethyl mercaptan	0.1	0.8
Perchloryl fluoride	3	13.5
Phenol—Skin	5	19
p-Phenylene diamine—Skin		0.1
Phenyl ether (vapor)	1	7
Phenyl ether-biphenyl mixture (vapor)	1	7
Phenylethylene, see Styrene		
Phenyl glycidyl ether (PGE)	10	60
Phenylhydrazine—Skin	5	22
Phosdrin (Mevinphos ®)—Skin		0.1
Phosgene (carbonyl chloride)	0.1	0.4
Phosphine	0.3	0.4
Phosphoric acid		1
Phosphorus (yellow)		0.1
Phosphorus pentachloride		1
Phosphorus pentasulfide		1
Phosphorus trichloride	0.5	3
Phthalic anhydride	2	12
Picric acid—Skin		0.1
Pival ® (2-Pivalyl-1,3-indandione)		0.1
Platinum (Soluble Salts) as Pt		0.002
Propargyl alcohol—Skin	1	
n-Propyl acetate	200	840
Propyl alcohol	200	500
n-Propyl nitrate	25	110
Propylene dichloride	75	350
Propylene imine—Skin	2	5
Propylene oxide	100	240
Propyne, see Methylacetylene		
Pyrethrum		5
Pyridine	5	15
Quinone	0.1	0.4
RDX—Skin		1.5
Rhodium, Metal fume and dusts, as Rh		0.1
Soluble salts		0.001
Ronnel		10
Rotenone (commercial)		5
Selenium compounds (as Se)		0.2
Selenium hexafluoride	0.05	0.4
Trichloromethane, see Chloroform		
Trichloronaphthalene—Skin		5
1,2,3-Trichloropropane	50	300
1,1,2-Trichloro 1,2,2-trifluoroethane	1,000	7,600
Triethylamine	25	100
Trifluoromonobromomethane	1,000	6,100

TABLE G-I—Con.

Substance	p.p.m.[a]	mg./M³ [b]
*Trimethyl benzene	25	120
2,4,6-Trinitrophenol, see Picric acid		
2,4,6-Trinitrophenylmethylnitramine, see Tetryl		
Trinitrotoluene—Skin		1.5
Triorthocresyl phosphate		0.1
Triphenyl phosphate		3
Tungsten and compounds, as W:		
Soluble		1
Insoluble		5
Turpentine	100	560
Uranium (natural) sol. and insol. compounds as U		0.2
C Vanadium:		
V_2O_3 dust		0.5
V_2O_5 fume		0.1
Vinyl benzene, see Styrene		
**C Vinyl chloride	500	1,300
Vinylcyanide, see Acrylonitrile		
Vinyl toluene	100	480
Warfarin		0.1
Xylene (xylol)	100	435
Xylidine—Skin	5	25
Yttrium		1
Zinc chloride fume		1
Zinc oxide fume		5
Zirconium compounds (as Zr)		5

*1970 Addition.

[a] Parts of vapor or gas per million parts of contaminated air by volume at 25° C. and 760 mm. Hg pressure.

[b] Approximate milligrams of particulate per cubic meter of air.

(No footnote "c" is used to avoid confusion with ceiling value notations.)

[d] An atmospheric concentration of not more than 0.02 p.p.m., or personal protection may be necessary to avoid headache.

[e] As sampled method that does not collect vapor.

[f] For control of general room air, biologic monitoring is essential for personnel control.

TABLE G-2

	8-hour time weighted average
Benzene (Z37.4–1969)	10 p.p.m.
Beryllium and beryllium compounds (Z37.29–1970)	0.002 mg./M³.
Cadmium dust (as Cd) (Z37.5–1970)	0.2 mg./M³.
Cadmium fume (as Cd) (Z37.5–1970)	0.1 mg./M³.
Carbon disulfide (Z37.3–1968)	20 p.p.m.
Carbon tetrachloride (Z37.17–1967)	10 p.p.m.
Ethylene dibromide (Z37.31–1970)	20 p.p.m.
Ethylene dichloride (Z37.21–1969)	50 p.p.m.
Formaldehyde (Z37.16–1967)	3 p.p.m.
Hydrogen fluoride (Z37.28–1969)	3 p.p.m.
Fluoride as dust (Z37.28–1966)	2.5 mg./M³.
Lead and its inorganic compounds (Z37.11–1969)	0.2 mg./M³.
Methyl chloride (Z37.18–1969)	100 p.p.m.
Methylene chloride (Z37.23–1969)	500 p.p.m.
Organo (alkyl) mercury (Z37.30–1969)	0.01 mg./M³.
Styrene (Z37.12–1969)	100 p.p.m.
Tetrachloroethylene (Z37.22–1967)	100 p.p.m.
Toluene (Z37.12–1967)	200 p.p.m.
	Acceptable ceiling concentration
Hydrogen sulfide (Z37.2–1966)	20 p.p.m.
Chromic acid and chromates (Z37.3–1971)	1 mg./10M³.
Mercury (Z37.8–1971)	1 mg./10M³.

237.15

TABLE G-3—MINERAL DUSTS

Substance	Mppcf [a]	Mg/M³ [b]
Silica:		
Crystalline:		
Quartz (respirable)	250 [c]	10mg/M³ [m]
	%SiO₂+5	%SiO₂+2
Quartz (total dust)		30mg/M³
		%SiO₂+2
Cristobalite: Use ½ the value calculated from the count or mass formulae for quartz.		
Tridymite: Use ½ the value calculated from the formulae for quartz.		
Amorphous, including natural diatomaceous earth	20	80mg/M³
		%SiO₂
Tremolite	5	20mg/M³
		%SiO₂
Silicates (less than 1% crystalline silica):		
Asbestos—12 fibers per milliliter greater than 5 microns in length [d] or	2	
Mica	20	
Soapstone	20	
Talc	20	
Portland cement	50	
Graphite (natural)	15	
Coal dust (respirable fraction less than 5% SiO_2)		2.4mg/M³
		or
For more than 5% SiO_2		10mg/M³
		%SiO₂+2
Inert or Nuisance Dust:		
Respirable fraction	15	5mg/M³
Total dust	50	15mg/M³

NOTE: Conversion factors—
mppcf×35.3=million particles per cubic meter
=particles per c.c.

[a] Millions of particles per cubic foot of air, based on impinger samples counted by light-field technics.

[c] The percentage of crystalline silica in the formula is the amount determined from air-borne samples, except in those instances in which other methods have been shown to be applicable.

[d] As determined by the membrane filter method at 430 × phase contrast magnification.

[m] Both concentration and percent quartz for the application of this limit are to be determined from the fraction passing a size-selector with the following characteristics:

Aerodynamic diameter (unit density sphere)	Percent passing selector
2	90
2.5	75
3.5	50
5.0	25
10	0

The measurements under this note refer to the use of an AEC instrument. If the respirable fraction of coal dust is determined with a MRE the figure corresponding to that of 2.4 Mg/M³ in the table for coal dust is 4.5 Mg/M³

§ 1910.94 Ventilation.

(a) *Abrasive blasting*—(1) *Definitions applicable to this paragraph.*—(i) *Abrasive.* A solid substance used in an abrasive blasting operation.

(ii) *Abrasive-blasting respirator.* A continuous flow air-line respirator constructed so that it will cover the wearer's head, neck, and shoulders to protect him from rebounding abrasive.

(iii) *Blast cleaning barrel.* A complete enclosure which rotates on an axis, or which has an internal moving tread to tumble the parts, in order to expose various surfaces of the parts of the action of an automatic blast spray.

(iv) *Blast cleaning room.* A complete enclosure in which blasting operations are performed and where the operator works inside of the room to operate the blasting nozzle and direct the flow of the abrasive material.

(v) *Blasting cabinet.* An enclosure where the operator stands outside and operates the blasting nozzle through an opening or openings in the enclosure.

(vi) *Clean air.* Air of such purity that it will not cause harm or discomfort to an individual if it is inhaled for extended periods of time.

(vii) *Dust collector.* A device or combination of devices for separating dust from the air handled by an exhaust ventilation system.

(viii) *Exhaust ventilation system.* A system for removing contaminated air from a space, comprising two or more of the following elements (*a*) enclosure or hood, (*b*) duct work, (*c*) dust collecting equipment, (*d*) exhauster, and (*e*) discharge stack.

(ix) *Particulate-filter respirator.* An air purifying respirator, commonly referred to as a dust or a fume respirator, which removes most of the dust or fume from the air passing through the device.

(x) *Respirable dust.* Airborne dust in sizes capable of passing through the upper respiratory system to reach the lower lung passages.

(xi) *Rotary blast cleaning table.* An enclosure where the pieces to be cleaned are positioned on a rotating table and are passed automatically through a series of blast sprays.

(xii) *Abrasive blasting.* The forcible application of an abrasive to a surface by pneumatic pressure, hydraulic pressure, or centrifugal force.

(2) *Dust hazards from abrasive blasting.* (i) Abrasives and the surface coatings on the materials blasted are shattered and pulverized during blasting operations and the dust formed will contain particles of respirable size. The composition and toxicity of the dust from these sources shall be considered in making an evaluation of the potential health hazards.

(ii) The concentration of respirable dust or fume in the breathing zone of the abrasive-blasting operator or any other worker shall be kept below the levels specified in § 1910.93.

(iii) Organic abrasives which are combustible shall be used only in automatic systems. Where flammable or explosive dust mixtures may be present, the construction of the equipment, including the exhaust system and all electric wiring shall conform to the requirements of American National Standard Installation of Blower and Exhaust Systems for Dust, Stock, and Vapor Removal or Conveying, Z33.1–1961 (NFPA 91–1961), and American National Standard National Electrical Code, C1–1968 (NFPA 70–1968). The blast nozzle shall be bonded and grounded to prevent the buildup of static charges. Where flammable or explosive dust mixtures may be present, the abrasive blasting enclosure, the ducts, and the dust collector shall be constructed with loose panels or explosion venting areas, located on sides away from any occupied area, to provide for pressure relief in case of explosion, following the principles set forth in the National Fire Protection Association Explosion Venting Guide, NFPA 68–1954.

(3) *Blast-cleaning enclosures.* (i) Blast-cleaning enclosures shall be exhaust ventilated in such a way that a continuous inward flow of air will be maintained at all openings in the enclosure, during the blasting operation.

(*a*) All air inlets and access openings shall be baffled or so arranged that by the combination of inward air flow and baffling the escape of abrasive or dust particules into an adjacent work area will be minimized and visible spurts of dust will not be observed.

(*b*) The rate of exhaust shall be sufficient to provide prompt clearance of the dust-laden air within the enclosure after the cessation of blasting.

(*c*) Before the enclosure is opened, the blast shall be turned off and the exhaust system shall be run for a sufficient period of time to remove the dusty air within the enclosure.

(*d*) Safety glass protected by screening shall be used in observation windows, where hard deep-cutting abrasives are used.

(*e*) Slit abrasive-resistant baffles shall be installed in multiple sets at all small access openings where dust might escape, and shall be inspected regularly and replaced when needed.

(*f*) Doors shall be flanged and tight when closed.

(2) Doors on blast-cleaning rooms shall be operable from both inside and outside, except that where there is a small operator access door, the large work access door may be closed or opened from the outside only.

(4) *Exhaust ventilation systems.* (i) The construction, installation, inspection, and maintenance of exhaust systems shall conform to the principles and requirements set forth in American National Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960, and ANSI Z33.1–1961.

(*a*) When dust leaks are noted, repairs shall be made as soon as possible.

(*b*) The static pressure drop at the exhaust ducts leading from the equipment shall be checked when the installation is completed and periodically thereafter to assure continued satisfactory operation. Whenever an appreciable change in the pressure drop indicates a partial blockage, the system shall be cleaned and returned to normal operating condition.

(ii) In installations where the abrasive is recirculated, the exhaust ventilation system for the blasting enclosure shall not be relied upon for the removal of fines from the spent abrasive instead of an abrasive separator. An abrasive separator shall be provided for the purpose.

(iii) The air exhausted from blast-cleaning equipment shall be discharged through dust collecting equipment. Dust collectors shall be set up so that the accumulated dust can be emptied and removed without contaminating other working areas.

(5) *Personal protective equipment.* (i) Only respiratory protective equipment

approved by the Bureau of Mines, U.S. Department of the Interior (see 30 CFR Part 11) shall be used for protection of personnel against dust produced during abrasive-blasting operations.

(ii) Abrasive-blasting respirators shall be worn by all abrasive-blasting operators.

(*a*) When working inside of blast-cleaning rooms, or

(*b*) When using silica sand in manual blasting operations where the nozzle and blast are not physically separated from the operator in an exhaust ventilated enclosure, or

(*c*) Where concentrations of toxic dust dispersed by the abrasive blasting may exceed the limits set in § 1910.93 and the nozzle and blast are not physically separated from the operator in an exhaust-ventilated enclosure.

(iii) Particulate filter respirators, commonly referred to as dust-filter respirators, properly fitted, may be used for short, intermittent, or occasional dust exposures such as cleanup, dumping of dust collectors, or unloading shipments of sand at a receiving point, when it is not feasible to control the dust by enclosure, exhaust ventilation, or other means. Respirators used shall be approved (see 30 CFR Part 11) for protection against the specific type of dust encountered.

(a) Dust-filter respirators may be used to protect the operator of outside abrasive-blasting operations where nonsilica abrasives are used on materials having low toxicities.

(b) Dust-filter respirators shall not be used for continuous protection where silica sand is used as the blasting abrasive, or toxic materials are blasted.

(iv) A respiratory protection program as defined and described in § 1910.134 (a) and (b), shall be established whereever it is necessary to use respiratory protective equipment.

(v) Operators shall be equipped with heavy canvas or leather gloves and aprons or equivalent protection to protect them from the impact of abrasives. Safety shoes shall be worn to protect against foot injury where heavy pieces of work are handled.

(*a*) Safety shoes shall conform to the requirements of American National Standard for Men's Safety-Toe Footwear, Z41.1–1967.

(*b*) Equipment for protection of the eyes and face shall be supplied to the operator when the respirator design does not provide such protection and to any other personnel working in the vicinity of abrasive blasting operations. This equipment shall conform to the requirements of § 1910.133.

(6) *Air supply and air compressors.* The air for abrasive-blasting respirators shall be free of harmful quantities of dusts, mists, or noxious gases, and shall meet the requirements for air purity set forth in ANSI Z9.2–1960. The air from the regular compressed air line of the plant may be used for the abrasive-blasting respirator if (i) a trap and carbon filter are installed and regularly maintained, to remove oil, water, scale, and odor, (ii) a pressure reducing diaphragm or valve is installed to reduce the pressure down to requirements of the particular type of abrasive-blasting respirator, and (iii) an automatic control is provided to either sound an alarm or shut down the compressor in case of overheating.

(7) *Operational procedures and general safety.* Dust shall not be permitted to accumulate on the floor or on ledges outside of an abrasive-blasting enclosure, and dust spills shall be cleaned up promptly. Aisles and walkways shall be kept clear of steel shot or similar abrasive which may create a slipping hazard.

(b) *Grinding, polishing, and buffing operations*—(1) *Definitions applicable to this paragraph*—(i) *Abrasive cutting-off wheels.* Organic-bonded wheels, the thickness of which is not more than one forty-eighth of their diameter for those up to, and including, 20 inches in diameter, and not more than one-sixtieth of their diameter for those larger than 20 inches in diameter, used for a multitude of operations variously known as cutting, cutting off, grooving, slotting, coping, and jointing, and the like. The wheels may be "solid" consisting of organic-bonded abrasive material throughout, "steel centered" consisting of a steel disc with a rim of organic-bonded material moulded around the periphery, or of the "inserted tooth" type consisting of a steel disc with organic-bonded abrasive teeth or inserts mechanically secured around the periphery.

(ii) *Belts.* All power-driven, flexible, coated bands used for grinding, polishing, or buffing purposes.

(iii) *Branch pipe.* The part of an exhaust system piping that is connected directly to the hood or enclosure.

(iv) *Cradle.* A movable fixture, upon which the part to be ground or polished is placed.

(v) *Disc wheels.* All power-driven rotatable discs faces with abrasive materials, artificial or natural, and used for grinding or polishing on the side of the assembled disc.

(v) *Disc wheels.* All power-driven sure caused by air flowing into a duct or hood. It is usually expressed in inches of water gauge.

(vii) *Exhaust system.* A system consisting of branch pipes connected to hoods of enclosures, one or more header pipes, an exhaust fan, means for separating solid contaminants from the air flowing in the system, and a discharge stack to outside.

(viii) *Grinding wheels.* All power-driven rotatable grinding or abrasive wheels, except disc wheels as defined in this standard, consisting of abrasive particles held together by artificial or natural bonds and used for peripheral grinding.

(ix) *Header pipe (main pipe).* A pipe into which one or more branch pipes enter and which connects such branch pipes to the remainder of the exhaust system.

(x) *Hoods and enclosures.* The partial or complete enclosure around the wheel or disc through which air enters an exhaust system during operation.

(xi) *Horizontal double-spindle disc grinder.* A grinding machine carrying two power-driven, rotatable, coaxial, horizontal spindles upon the inside ends of which are mounted abrasive disc wheels for grinding two surfaces simultaneously.

(xii) *Horizontal single-spindle disc grinder.* A grinding machine carrying an abrasive disc wheel upon one or both ends of a power-driven, rotatable single horizontal spindle.

(xiii) *Polishing and buffing wheels.* All power-driven rotatable wheels composed all or in part of textile fabrics, wood, felt, leather, paper, and may be coated with abrasives on the periphery of the wheel for purposes of polishing, buffing, and light grinding.

(xiv) *Portable grinder.* Any power-driven rotatable grinding, polishing, or buffing wheel mounted in such manner that it may be manually manipulated.

(xv) *Scratch brush wheels.* All power-driven rotatable wheels made from wire or bristles, and used for scratch cleaning and brushing purposes.

(xvi) *Swing-frame grinder.* Any power-driven rotatable grinding, polishing, or buffing wheel mounted in such a manner that the wheel with its supporting framework can be manipulated over stationary objects.

(xvii) *Velocity pressure (vp).* The kinetic pressure in the direction of flow necessary to cause a fluid at rest to flow at a given velocity. It is usually expressed in inches of water gage.

(xviii) *Vertical spindle disc grinder.* A grinding machine having a vertical, rotatable power-driven spindle carrying a horizontal abrasive disc wheel.

(2) *Application.* (i) Every establishment performing dry grinding, dry polishing, or buffing shall provide suitable hood or enclosures that are connected to exhaust systems.

(ii) Such exhaust systems shall be operated continuously whenever such operations are carried on, and be capable of preventing contaminants from entering the breathing zone.

(3) *Hood and branch pipe requirements.* (i) Hoods connected to exhaust systems shall be used, and such hoods shall be designed, located, and placed so that the dust or dirt particles shall fall or be projected into the hoods in the direction of the air flow. No wheels, discs, straps, or belts shall be operated in such manner and in such direction as to cause the dust and dirt particles to be thrown into the operator's breathing zone.

(ii) Grinding wheels on floor stands, pedestals, benches, and special-purpose grinding machines and abrasive cutting-off wheels shall have not less than the minimum exhaust volumes shown in Table G–4 with a recommended minimum duct velocity of 4,500 feet per minute in the branch and 3,500 feet per minute in the main. The entry losses from all hoods except the vertical-spindle disc grinder hood, shall equal 0.65 velocity pressure for a straight takeoff and 0.45 velocity pressure for a tapered

takeoff. The entry loss for the vertical-spindle disc grinder hood is shown in figure G–1 (following § 1910.94(b)).

TABLE G–4—GRINDING AND ABRASIVE CUTTING-OFF WHEELS

Wheel diameter (inches)	Wheel width (inches)	Minimum exhaust volume (feet³/min.)
To 9	1½	220
Over 9 to 16	2	390
Over 16 to 19	3	500
Over 19 to 24	4	610
Over 24 to 30	5	880
Over 30 to 36	6	1,200

For any wheel wider than wheel diameters shown in Table G–4, increase the exhaust volume by the ratio of the new width to the width shown.

Example:

If wheel width = 4½ inches, then

$$\frac{4.5}{4} \times 610 = 686 \text{ (rounded to 690)}.$$

(iii) Scratch-brush wheels and all buffing and polishing wheels mounted on floor stands, pedestals, benches, or special-purpose machines shall have not less than the minimum exhaust volume shown in Table G–5.

TABLE G–5—BUFFING AND POLISHING WHEELS

Wheel diameter (inches)	Wheel width (inches)	Minimum exhaust volume (feet³/min.)
To 9	2	300
Over 9 to 16	3	500
Over 16 to 19	4	610
Over 19 to 24	5	740
Over 24 to 30	6	1,040
Over 30 to 36	6	1,200

(iv) Grinding wheels or discs for horizontal single-spindle disc grinders shall be hooded to collect the dust or dirt generated by the grinding operation and the hoods shall be connected to branch pipes having exhaust volumes as shown in Table G–6.

TABLE G–6—HORIZONTAL SINGLE-SPINDLE DISC GRINDER

Disc diameter (inches):	*Exhaust volume (ft. 3/min.)*
Up to 12	220
Over 12 to 19	390
Over 19 to 30	610
Over 30 to 36	880

(v) Grinding wheels or discs for horizontal double-spindle disc grinders shall have a hood enclosing the grinding chamber and the hood shall be connected to one or more branch pipes having exhaust volumes as shown in Table G–7.

TABLE G–7—HORIZONTAL DOUBLE-SPINDLE DISC GRINDER

Disc diameter (inches):	*Exhaust volume (ft. 3/min.)*
Up to 19	610
Over 19 to 25	880
Over 25 to 30	1,200
Over 30 to 53	1,770
Over 53 to 72	6,280

(vi) Grinding wheels or discs for vertical single-spindle disc grinders shall be encircled with hoods to remove the dust generated in the operation. The hoods shall be connected to one or more branch pipes having exhaust volumes as shown in Table G–8.

TABLE G–8—VERTICAL SPINDLE DISC GRINDER

Disc diameter (inches)	One-half or more of disc covered		Disc not covered	
	Number[1]	Exhaust foot³/min.	Number[1]	Exhaust foot³/min.
Up to 20	1	500	2	780
Over 20 to 30	2	780	2	1,480
Over 30 to 53	2	1,770	4	3,530
Over 53 to 72	2	3,140	5	6,010

[1] Number of exhaust outlets around periphery of hood, or equal distribution provided by other means.

(vii) Grinding and polishing belts shall be provided with hoods to remove dust and dirt generated in the operations and the hoods shall be connected to branch pipes having exhaust volumes as shown in Table G–9.

TABLE G–9—GRINDING AND POLISHING BELTS

Belts width (inches):	*Exhaust volume (ft.³/min.)*
Up to 3	220
Over 3 to 5	300
Over 5 to 7	390
Over 7 to 9	500
Over 9 to 11	610
Over 11 to 13	740

(viii) Cradles and swing-frame grinders. Where cradles are used for handling the parts to be ground, polished, or buffed, requiring large partial enclosures to house the complete operation, a minimum average air velocity of 150 feet per minutes shall be maintained over the entire opening of the enclosure. Swing-frame grinders shall also be exhausted in the same manner as provided for cradles. (See fig. G–2)

(ix) Where the work is outside the hood, air volumes must be increased as shown in American Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960 (section 4, exhaust hoods).

(4) *Exhaust systems.* (i) Exhaust systems for grinding, polishing, and buffing operations should be designed in accordance with American Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960.

(ii) Exhaust systems for grinding, polishing, and buffing operations shall be tested in the manner described in American Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960.

(iii) All exhaust systems shall be provided with suitable dust collectors.

(5) *Hood and enclosure design.* (i) (*a*) It is the dual function of grinding and abrasive cutting-off wheel hoods to protect the operator from the hazards of bursting wheels as well as to provide a means for the removal of dust and dirt generated. All hoods shall be not less in structural strength than specified in the American National Standard Code for the Use, Care, and Protection of Abrasive Wheels, B7.1–1970.

(*b*) Due to the variety of work and types of grinding machines employed, it is necessary to develop hoods adaptable to the particular machine in question, and such hoods shall be located as close as possible to the operation.

(ii) Exhaust hoods for floor stands, pedestals, and bench grinders shall be designed in accordance with figure G–2. The adjustable tongue shown in the figure shall be kept in working order and shall be adjusted within one-fourth inch of the wheel periphery at all times.

(iii) Swing-frame grinders shall be provided with exhaust booths as indicated in figure G–3.

(iv) Portable grinding operations, whenever the nature of the work permits, shall be conducted within a partial enclosure. The opening in the enclosure shall be no larger than is actually required in the operation and an average face air velocity of not less than 200 feet per minute shall be maintained.

(v) Hoods for polishing and buffing and scratch-brush wheels shall be constructed to conform as closely to figure G–4 as the nature of the work will permit.

(vi) Cradle grinding and polishing operations shall be performed within a partial enclosure similar to figure G–5. The operator shall be positioned outside the working face of the opening of the enclosure. The face opening of the enclosure should not be any greater in area than that actually required for the performance of the operation and the average air velocity into the working face of the enclosure shall not be less than 150 feet per minute.

(vii) Hoods for horizontal single-spindle disc grinders shall be constructed to conform as closely as possible to the hood shown in figure G–6. It is essential that there be a space between the back of the wheel and the hood, and a space around the periphery of the wheel of at least 1 inch in order to permit the suction to act around the wheel periphery. The opening on the side of the disc shall be no larger than is required for the grinding operation, but must never be less than twice the area of the branch outlet.

(viii) Horizontal double-spindle disc grinders shall have a hood encircling the wheels and grinding chamber similar to that illustrated in figure G–7. The openings for passing the work into the grinding chamber should be kept as small as possible, but must never be less than twice the area of the branch outlets.

(ix) Vertical-spindle disc grinders shall be encircled with a hood so constructed that the heavy dust is drawn off a surface of the disc and the lighter dust exhausted through a continuous slot at the top of the hood as shown in figure G–1.

(x) Grinding and polishing belt hoods shall be constructed as close to the operation as possible. The hood should extend almost to the belt, and 1-inch wide openings should be provided on either side. Figure G–8 shows a typical hood for a belt operation.

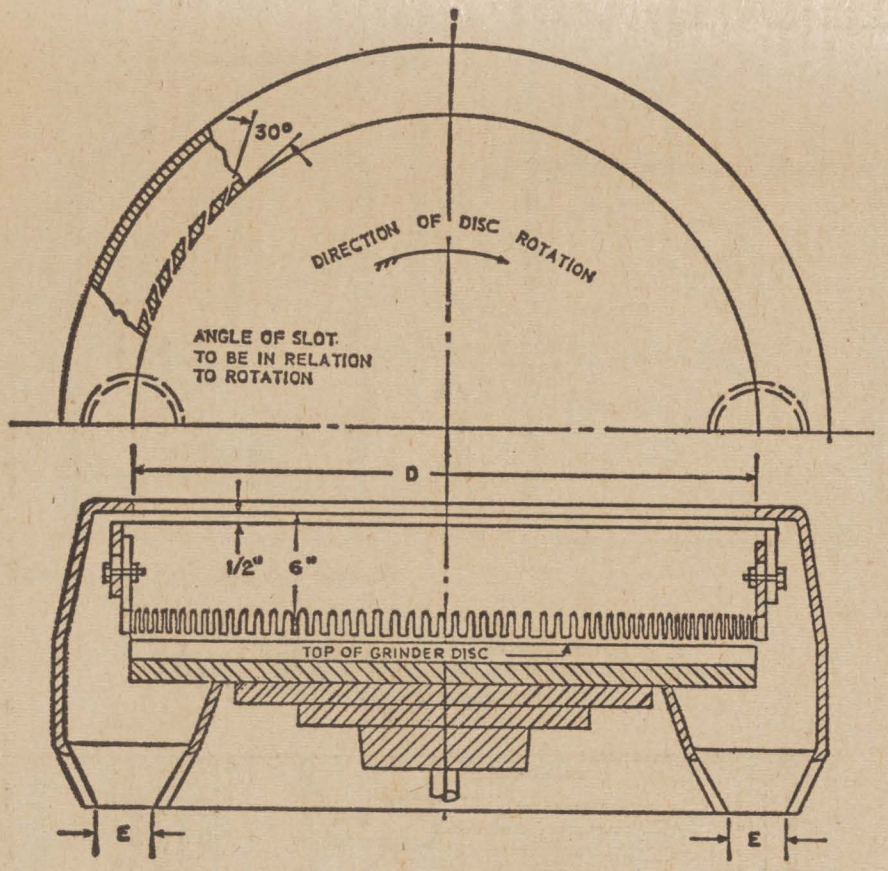

Fig. G-1
Vertical Spindle Disc Grinder Exhaust Hood and Branch Pipe Connections

Dia *D*, Inches		Exhaust *E*		Volume Exhausted at 4,500 ft/min ft³/min	Note
Min	Max	No. Pipes	Dia		
	20	1	4½	500	When one-half or more of the disc can be hooded, use exhaust ducts as shown at the left.
Over 20	30	2	4	780	
Over 30	72	2	6	1.770	
Over 53	72	2	8	3.140	
	20	2	4	780	When no hood can be used over disc, use exhaust ducts as shown at left.
Over 20	30	2	5½	1.480	
Over 30	53	4	6	3.530	
Over 53	72	5	7	6.010	

Entry loss = 1.0 slot velocity pressure + 0.5 branch velocity pressure
Minimum slot velocity = 2,000 ft/min – ½-inch slot width

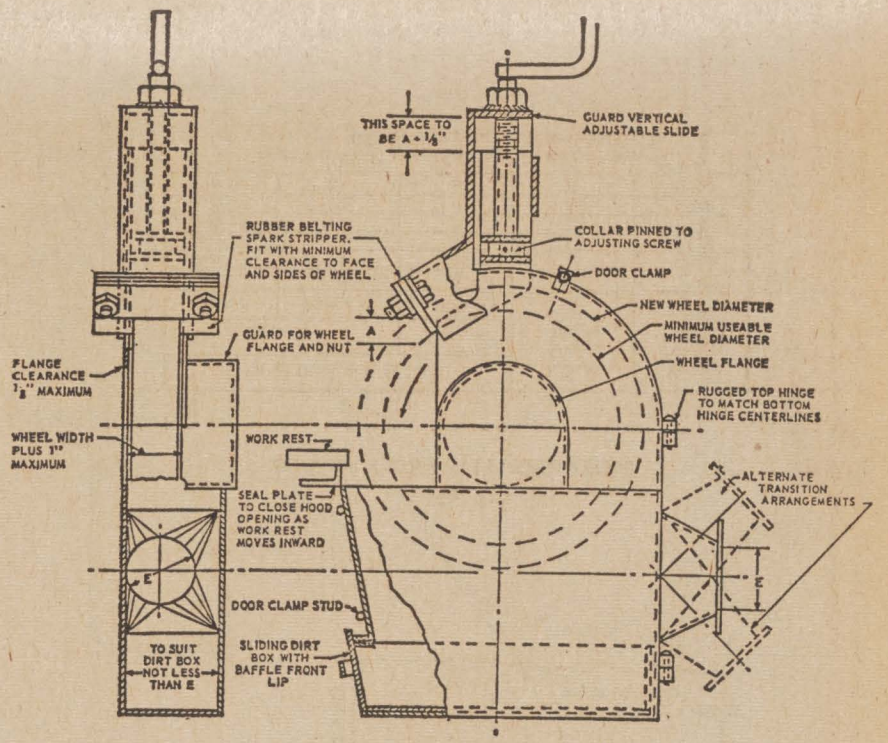

Fig. G-2
Standard Grinder Hood

Wheel Dimension			Exhaust Outlet, Inches	Volume of Air at 4,500 ft/min
Diameter, Inches		Width, Inches		
Min = *d*	Max = *D*	Max	*E*	
	9	1½	3	220
Over 9	16	2	4	390
Over 16	19	3	4½	500
Over 19	24	4	5	610
Over 24	30	5	6	880
Over 30	36	6	7	1,200

Entry loss = 0.45 velocity pressure for tapered takeoff
0.65 velocity pressure for straight takeoff

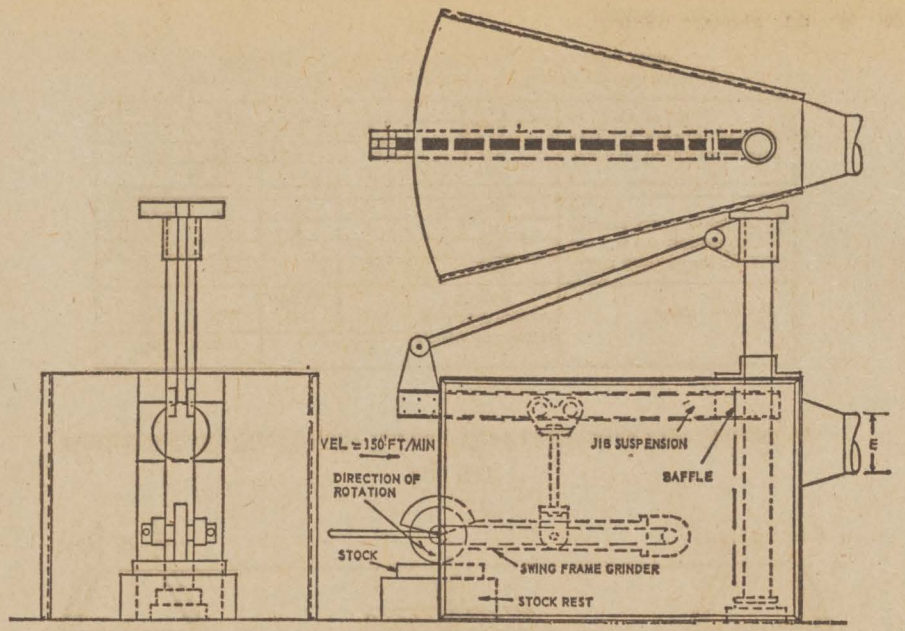

Fig. G-3

A Method of Applying an Exhaust Enclosure to Swing-Frame Grinders

NOTE: Baffle to reduce front opening as much as possible

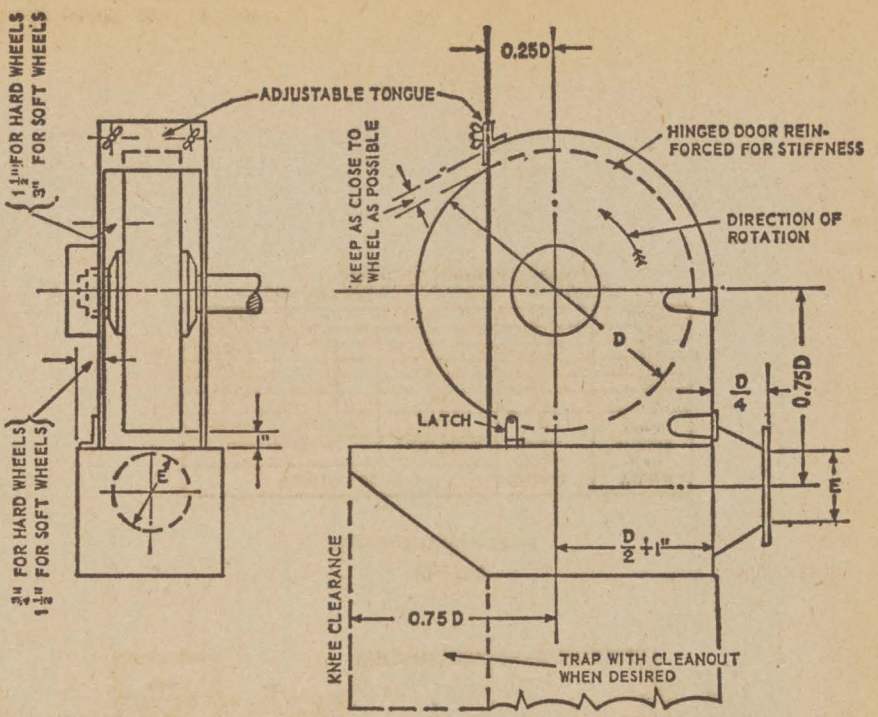

Fig. G-4

Standard Buffing and Polishing Hood

Wheel Dimension, Inches			Exhaust Outlet, Inches	Volume of Air at 4,500 ft/min
Diameter		Width		
Min = *d*	Max = *D*	Max	*E*	
	9	2	3½	300
Over 9	16	3	4	500
Over 16	19	4	5	610
Over 19	24	5	5½	740
Over 24	30	6	6½	1,040
Over 30	36	6	7	1,200

Entry loss = 0.15 velocity pressure for tapered takeoff
0.65 velocity pressure for straight takeoff

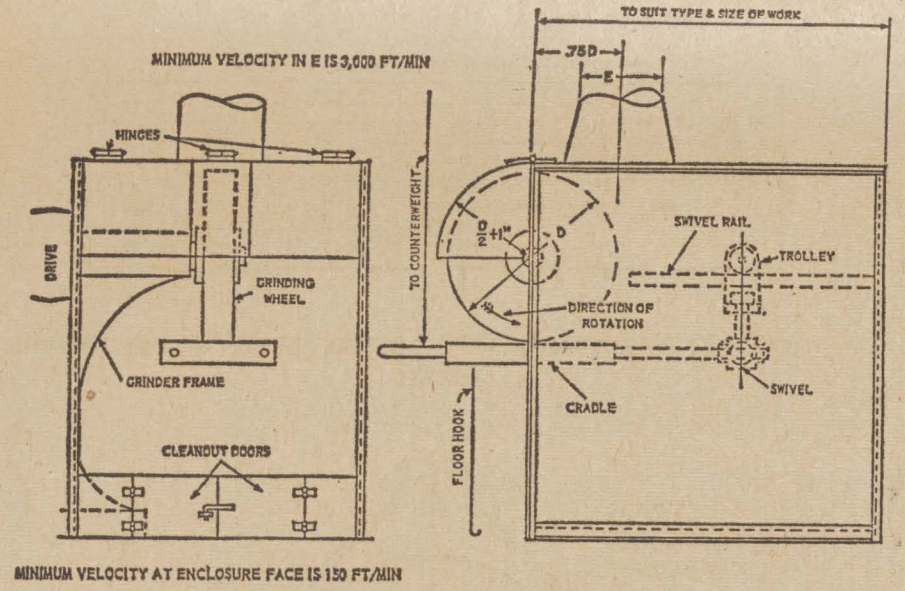

Fig. G-5

Cradle Polishing or Grinding Enclosure

Entry loss = 0.45 velocity pressure for tapered takeoff

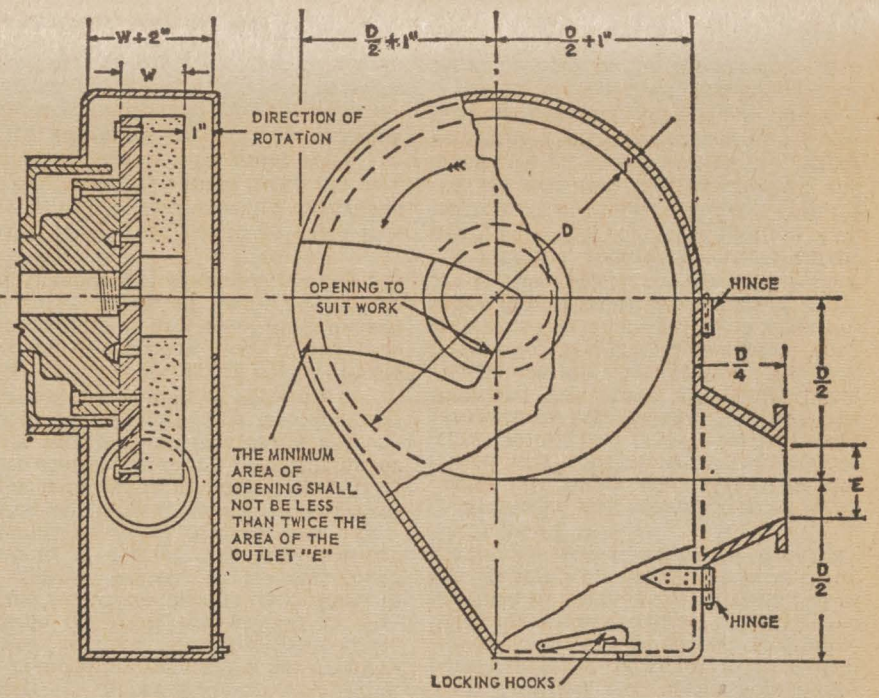

Fig. G-6

Horizontal Single-Spindle Disc Grinder Exhaust Hood and Branch Pipe Connections

Dia *D*, Inches		Exhaust *E*	Volume Exhausted at 4,500 ft/min
Min	Max	Dia. Inches	ft³/min
	12	3	220
Over 12	19	4	390
Over 19	30	5	610
Over 30	36	6	880

NOTE: If grinding wheels are used for disc grinding purposes, hoods must conform to structural strength and materials as described in 9.1.

Entry loss = 0.45 velocity pressure for tapered takeoff

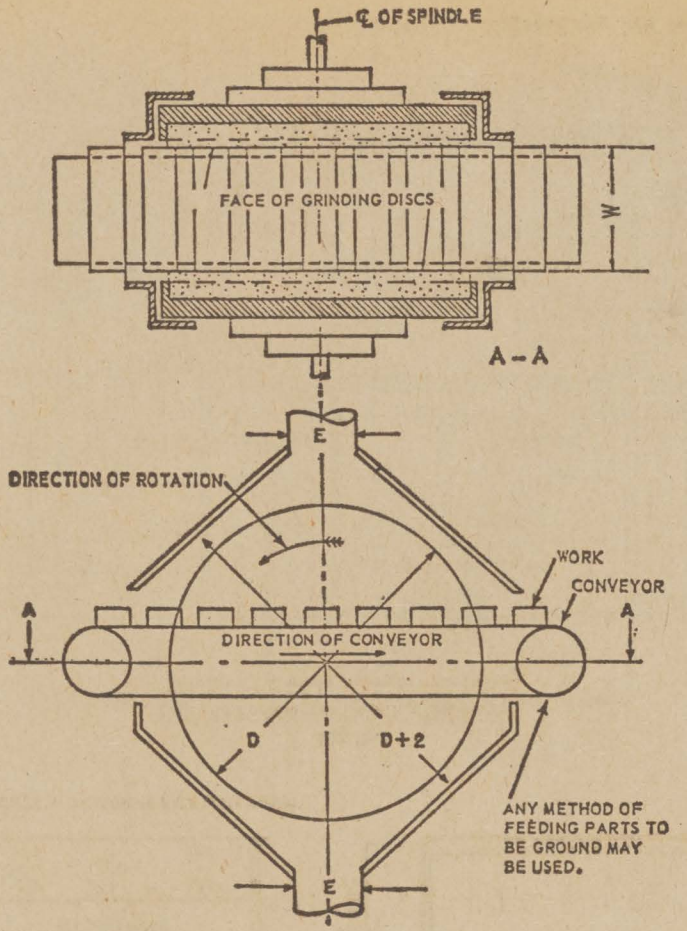

Fig. G-7

Horizontal Double-Spindle Disc Grinder Exhaust Hood and Branch Pipe Connections

Disc Dia, Inches		Exhaust *E*		Volume Exhausted at 4,500 ft/min ft³/min	Note
Min	Max	No. Pipes	Dia		
	19	1	5	610	When width "W" permits, exhaust ducts should be as near heaviest grinding as possible.
Over 19	25	1	6	880	
Over 25	30	1	7	1,200	
Over 30	53	2	6	1,770	
Over 53	72	4	8	6,280	

Entry loss = 0.45 velocity pressure for tapered takeoff

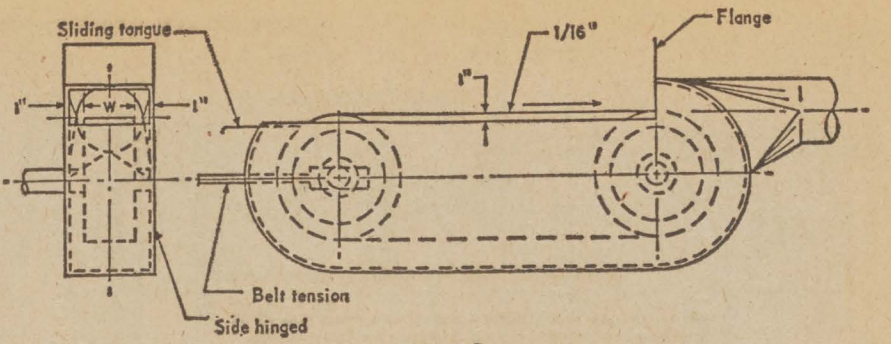

Fig. G-8

A Typical Hood for a Belt Operation

Belt Width *W*, Inches	Exhaust Volume, ft³/min
up to 3	220
3 to 5	300
5 to 7	390
7 to 9	500
9 to 11	610
11 to 13	740

Minimum duct velocity = 4,500 ft/min branch, 3,500 ft/min main
Entry loss = 0.45 velocity pressure for tapered takeoff
0.65 velocity pressure for straight takeoff

(c) *Spray-finishing operations*—(1) *Definitions applicable to this paragraph*—(i) *Spray-finishing operations.* Spray-finishing operations are employment of methods wherein organic or inorganic materials are utilized in dispersed form from deposit on surfaces to be coated, treated, or cleaned. Such methods of deposit may involve either automatic, manual, or electrostatic deposition but do not include metal spraying or metallizing, dipping, flow coating, roller coating, tumbling, centrifuging, or spray washing and degreasing as conducted in self-contained washing and degreasing machines or systems.

(ii) *Spray booth.* Spray booths are defined and described in § 1910.107(a). (See sections 103, 104, and 105 of the Standard for Spray Finishing Using Flammable and Combustible Materials, NFPA No. 33–1969).

(iii) *Spray room.* A spray room is a room in which spray-finishing operations not conducted in a spray booth are performed separately from other areas.

(iv) *Minimum maintained velocity.* Minimum maintained velocity is the velocity of air movement which must be maintained in order to meet minimum specified requirements for health and safety.

(2) *Location and application.* Spray booths or spray rooms are to be used to enclose or confine all operations. Spray-finishing operations shall be located as provided in sections 201 through 206 of the Standard for Spray Finishing Using Flammable and Combustible Materials, NFPA No. 33–1969.

(3) *Design and construction of spray booths.* (i) Spray booths shall be designed and constructed in accordance with § 1910.107(b) (1)–(4) and (6)–(10) (see sections 301–304 and 306–310 of the Standard for Spray Finishing Using Flammable and Combustible Materials, NFPA No. 33–1969), for general construction specifications. For a more detailed discussion of fundamentals relating to this subject, see ANSI A9.2–1960.

(*a*) Lights, motors, electrical equipment, and other sources of ignition shall conform to the requirements of § 1910.107 (b) (10) and (c). (See section 310 and chapter 4 of the Standard for Spray Finishing Using Flammable and Combustible Materials, NFPA No. 33–1969.)

(*b*) In no case shall combustible material be used in the construction of a

spray booth and supply or exhaust duct connected to it.

(ii) Unobstructed walkways shall not be less than 6½ feet high and shall be maintained clear of obstruction from any work location in the booth to a booth exit or open booth front. In booths where the open front is the only exit, such exits shall be not less than 3 feet wide. In booths having multiple exits, such exits shall not be less than 2 feet wide, provided that the maximum distance from the work location to the exit is 25 feet or less. Where booth exits are provided with doors, such doors shall open outward from the booth.

(iii) Baffles, distribution plates, and dry-type overspray collectors shall conform to the requirements of § 1910.107 (b) (4) and (5). (See sections 304 and 305 of the Standard for Spray Finishing Using Flammable and Combustible Materials, NFPA No. 33–1969.)

(*a*) Overspray filters shall be installed and maintained in accordance with the requirements of § 1910.107(b)(5), (see section 305 of the Standard for Spray Finishing Using Flammable and Combustible Materials, NFPA No. 33–1969), and shall only be in a location easily accessible for inspection, cleaning, or replacement.

(*b*) Where effective means, independent of the overspray filters are installed which will result in design air distribution across the booth cross section, it is permissible to operate the booth without the filters in place.

(iv)(*a*) For wet or water-wash spray booths, the water-chamber enclosure, within which intimate contact of contaminated air and cleaning water or other cleaning medium is maintained, if made of steel, shall be 18 gage or heavier and adequately protected against corrosion.

(*b*) Chambers may include scrubber spray nozzles, headers, troughs, or other devices. Chambers shall be provided with adequate means for creating and maintaining scrubbing action for removal of particulate matter from the exhaust air stream.

(v) Collecting tanks shall be of welded steel construction or other suitable noncombustible material. If pits are used as collecting tanks, they shall be concrete, masonry, or other material having similar properties.

(*a*) Tanks shall be provided with weirs, skimmer plates, or screens to prevent sludge and floating paint from entering the pump suction box. Means for automatically maintaining the proper water level shall also be provided. Fresh water inlets shall not be submerged. They shall terminate at least one pipe diameter above the safety overflow level of the tank.

(*b*) Tanks shall be so constructed as to discourage accumulation of hazardous deposits.

(vi) Pump manifolds, risers, and headers shall be adequately sized to insure sufficient water flow to provide efficient operation of the water chamber.

(4) *Design and construction of spray rooms.* (i) Spray rooms, including floors, shall be constructed of masonry, concrete, or other noncombustible material.

(ii) Spray rooms shall have noncombustible fire doors and shutters.

(iii) Spray rooms shall be adequately ventilated so that the atmosphere in the breathing zone of the operator shall be maintained in accordance with the requirements of subparagraph (6)(ii) of this paragraph.

(iv) Spray rooms used for production spray-finishing operations shall conform to the requirements for spray booths.

(5) *Ventilation.* (i) Ventilation shall be provided in accordance with provisions of § 1910.107(d) (see chapter 5 of the Standard for Spray Finishing Using Flammable or Combustible Materials, NFPA No. 33–1969), and in accordance with the following:

(*a*) Where a fan plenum is used to equalize or control the distribution of exhaust air movement through the booth, it shall be of sufficient strength or rigidity to withstand the differential air pressure or other superficially imposed loads for which the equipment is designed and also to facilitate cleaning. Construction specifications shall be at least equivalent to those of subdivision (iii) of this subparagraph.

(*b*) All fan ratings shall be in accordance with Air Moving and Conditioning Association Standard Test Code for Testing Air Moving Devices, Bulletin 210, April 1962.

(ii) Inlet or supply ductwork used to transport makeup air to spray booths or surrounding areas shall be constructed of noncombustible materials.

(*a*) If negative pressure exists within inlet ductwork, all seams and joints shall be sealed if there is a possibility of infiltration of harmful quantities of noxious gases, fumes, or mists from areas through which ductwork passes.

(*b*) Inlet ductwork shall be sized in accordance with volume flow requirements and provide design air requirements at the spray booth.

(*c*) Inlet ductwork shall be adequately supported throughout its length to sustain at least its own weight plus any negative pressure which is exerted upon it under normal operating conditions.

(iii) Exhaust shall be so constructed as to provide structural strength and stability at least equivalent to sheet steel of not less than the following thickness:

Diameter or Greater Dimension	(U.S. gauge)
Up to 8 inches inclusive	No. 24
Over 8 inches to 18 inches inclusive	No. 22
Over 18 inches to 30 inches inclusive	No. 20
Over 30 inches	No. 18

(*a*) Exhaust ductwork shall be adequately supported throughout its length to sustain its weight plus any normal accumulation in interior during normal operating conditions and any negative pressure exerted upon it.

(*b*) Exhaust ductwork shall be sized in accordance with good design practice which shall include consideration of fan capacity, length of duct, number of turns and elbows, variation in size, volume, and character of materials being exhausted. See American National Standard Z9.2–1960 for further details and explanation concerning elements of design.

(*c*) Longitudinal joints in sheet steel ductwork shall be either lock-seamed, riveted, or welded. For other than steel construction, equivalent securing of joints shall be provided.

(*d*) Circumferential joints in ductwork shall be substantially fastened together and lapped in the direction of airflow. At least every fourth joint shall be provided with connecting flanges, bolted together or of equivalent fastening security.

(*e*) Inspection or clean-out doors shall be provided for every 9 to 12 feet of running length for ducts up to 12 inches in diameter, but the distance between clean-out doors may be greater for larger pipes. (See 8.3.21 of American National Standard Z9.1–1960.) A clean-out door or doors shall be provided for servicing the fan, and where necessary, a drain shall be provided.

(*f*) Where ductwork passes through a combustible roof or wall, the roof or wall shall be protected at the point of penetration by open space or fire-resistive material between the duct and the roof or wall. When ducts pass through firewalls, they shall be provided with automatic fire dampers on both sides of the wall, except that three-eighth-inch steel plates may be used in lieu of automatic fire dampers for ducts not exceeding 18 inches in diameter.

(*g*) Ductwork used for ventilating any process covered in this standard shall not be connected to ducts ventilating any other process or any chimney or flue used for conveying any products of combustion.

(6) *Velocity and air flow requirements.* (i) Except where a spray booth has an adequate air replacement system, the velocity of air into all openings of a spray booth shall be not less than that specified in Table G–10 for the operating conditions specified. An adequate air replacement system is one which introduces replacement air upstream or above the object being sprayed and is so designed that the velocity of air in the booth cross section is not less than that specified in Table G–10 when measured upstream or above the object being sprayed.

TABLE G-10—MINIMUM MAINTAINED VELOCITIES INTO SPRAY BOOTHS

Operating conditions for objects completely inside booth	Crossdraft, f.p.m.	Airflow velocities, f.p.m.	
		Design	Range
Electrostatic and automatic airless operation contained in booth without operator.	Negligible	50 large booth	50- 75
		100 small booth	75-125
Air-operated guns, manual or automatic	Up to 50	100 large booth	75-125
		150 small booth	125-175
Air-operated guns, manual or automatic	Up to 100	150 large booth	125-175
		200 small booth	150-250

NOTES:
(1) Attention is invited to the fact that the effectiveness of the spray booth is dependent upon the relationship of the depth of the booth to its height and width.
(2) Crossdrafts can be eliminated through proper design and such design should be sought. Crossdrafts in excess of 100 fpm (feet per minute) should not be permitted.
(3) Excessive air pressures result in loss of both efficiency and material waste in addition to creating a backlash that may carry overspray and fumes into adjacent work areas.
(4) Booths should be designed with velocities shown in the column headed "Design." However, booths operating with velocities shown in the column headed "Range" are in compliance with this standard.

(ii) In addition to the requirements in subdivision (i) of this subparagraph the total air volume exhausted through a spray booth shall be such as to dilute solvent vapor to at least 25 percent of the lower explosive limit of the solvent being sprayed. An example of the method of calculating this volume is given below.

Example: To determine the lower explosive limits of the most common solvents used in spray finishing, see Table G-11. Column 1 gives the number of cubic feet of vapor per gallon of solvent and column 2 gives the lower explosive limit (LEL) in percentage by volume of air. Note that the quantity of solvent will be diminished by the quantity of solids and nonflammables contained in the finish.

To determine the volume of air in cubic feet necessary to dilute the vapor from 1 gallon of solvent to 25 percent of the lower explosive limit, apply the following formula:

$$\text{Dilution volume required per gallon of solvent} = \frac{4\,(100-\text{LEL})\,(\text{cubic feet of vapor per gallon})}{\text{LEL}}$$

Using toluene as the solvent.

(1) LEL of toluene from Table G-11, column 2, is 1.4 percent.

(2) Cubic feet of vapor per gallon from Table G-11, column 1, is 30.4 cubic feet per gallon.

(3) Dilution volume required =

$$\frac{4\,(100-1.4)\,30.4}{1.4} = 8{,}564 \text{ cubic feet.}$$

(4) To convert to cubic feet per minute of required ventilation, multiply the dilution volume required per gallon of solvent by the number of gallons of solvent evaporated per minute.

TABLE G-11—LOWER EXPLOSIVE LIMIT OF SOME COMMONLY USED SOLVENTS

Solvent	Cubic feet of vapor per gallon of liquid at 70° F	Lower explosive limit in percent by volume of air at 70° F
	Column 1	*Column 2*
Acetone	44.0	2.6
Amyl Acetate (iso)	21.6	[1] 1.0
Amyl Alcohol (n)	29.6	1.2
Amyl Alcohol (iso)	29.6	1.2
Benzene	36.8	[1] 1.4
Butyl Acetate (n)	24.8	1.7
Butyl Alcohol (n)	35.2	1.4
Butyl Cellosolve	24.8	1.1
Cellosolve	33.6	1.8
Cellosolve Acetate	23.2	1.7
Cyclohexanone	31.2	[1] 1.1
1,1 Dichloroethylene	42.4	5.6
1,2 Dichloroethylene	42.4	9.7
Ethyl Acetate	32.8	2.5
Ethyl Alcohol	55.2	4.3
Ethyl Lactate	28.0	[1] 1.5
Methyl Acetate	40.0	3.1
Methyl Alcohol	80.8	7.3
Methyl Cellosolve	40.8	2.5
Methyl Ethyl Ketone	36.0	1.8
Methyl n-Propyl Ketone	30.4	1.5
Naphtha (VM&P) (76° Naphtha)	22.4	0.9
Naphtha (100° Flash) Safety Solvent—Stoddard Solvent	23.2	1.1
Propyl Acetate (n)	27.2	2.0
Propyl Acetate (iso)	28.0	1.8
Propyl Alcohol (n)	44.8	2.1
Propyl Alcohol (iso)	44.0	2.0
Toluene	30.4	1.4
Turpentine	20.8	0.8
Xylene (o)	26.4	1.0

[1] At 212° F.

(iii) (*a*) When an operator must position himself in a booth downstream of the object being sprayed, an air supplied respirator or other type of respirator approved by the Bureau of Mines, U.S. Department of the Interior (see 30 CFR Part 11) or specified in ANSI Z88.2-1969 for the material being sprayed should be used by the operator.

(*b*) Where downdraft booths are provided with doors, such doors shall be closed when spray painting.

(7) *Make-up air.* (i) Clean fresh air, free of contamination from adjacent industrial exhaust systems, chimneys, stacks, or vents, shall be supplied to a spray booth or room in quantities equal to the volume of air exhausted through the spray booth.

(ii) Where a spray booth or room receives make-up air through self-closing doors, dampers, or louvers, they shall be fully open at all times when the booth or room is in use for spraying. The velocity of air through such doors, dampers, or louvers shall not exceed 200 feet per minute. If the fan characteristics are such that the required air flow through the booth will be provided, higher velocities through the doors, dampers, or louvers may be used.

(iii) (*a*) Where the air supply to a spray booth or room is filtered, the fan static pressure shall be calculated on the assumption that the filters are dirty to the extent that they require cleaning or replacement.

(*b*) The rating of filters shall be governed by test data supplied by the manufacturer of the filter. A pressure gage shall be installed to show the pressure drop across the filters. This gage shall be marked to show the pressure drop at which the filters require cleaning or replacement. Filters shall be replaced or cleaned whenever the pressure drop across them becomes excessive or whenever the air flow through the face of the booth falls below that specified in Table G-10.

(iv) (*a*) Means of heating make-up air to any spray booth or room, before or at the time spraying is normally performed, shall be provided in all places where the outdoor temperature may be expected to remain below 55° F. for appreciable periods of time during the operation of the booth except where adequate and safe means of radiant heating for all operating personnel affected is provided. The replacement air during the heating seasons shall be maintained at not less than 65° F. at the point of entry into the spray booth or spray room. When otherwise unheated make-up air would be at a temperature of more than 10° F. below room temperature, its temperature shall be regulated as provided in section 3.6 of ANSI Z9.2-1960.

(*b*) As an alternative to an air replacement system complying with the preceding section, general heating of the building in which the spray room or booth is located may be employed provided that all occupied parts of the building are maintained at not less than 65° F. when the exhaust system is in operation or the general heating system supplemented by other sources of heat may be employed to meet this requirement.

(*c*) No means of heating make-up air shall be located in a spray booth.

(*d*) Where make-up air is heated by coal or oil, the products of combustion shall not be allowed to mix with the make-up air, and the products of combustion shall be conducted outside the building through a flue terminating at a point remote from all points where make-up air enters the building.

(*e*) Where make-up air is heated by gas, and the products of combustion are not mixed with the make-up air but are conducted through an independent flue to a point outside the building remote from all points where make-up air enters the building, it is not necessary to comply with (*f*) of this subdivision.

(*f*) Where make-up air to any manually operated spray booth or room is heated by gas and the products of combustion are allowed to mix with the supply air, the following precautions must be taken:

(*1*) The gas must have a distinctive and strong enough odor to warn workment in a spray booth or room of its presence if in an unburned state in the make-up air.

(*2*) The maximum rate of gas supply to the make-up air heater burners must not exceed that which would yield in excess of 200 p.p.m. (parts per million) of carbon monoxide or 2,000 p.p.m. of total combustible gases in the mixture if the unburned gas upon the occurrence of flame failure were mixed with all of the make-up air supplied.

(*3*) A fan must be provided to deliver the mixture of heated air and products

of combustion from the plenum chamber housing the gas burners to the spray booth or room.

(d) *Open surface tanks*—(1) *General.* (i) This section applies to all operations involving the immersion of materials in liquids, or in the vapors of such liquids, for the purpose of cleaning or altering the surface or adding to or imparting a finish thereto or changing the character of the materials, and their subsequent removal from the liquid or vapor, draining, and drying. These operations include washing, electroplating, anodizing, pickling, quenching, dying, dipping, tanning, dressing, bleaching, degreasing, alkaline cleaning, stripping, rinsing, digesting, and other similar operations.

(ii) Except where specific construction specifications are prescribed in this section, hoods, ducts, elbows, fans, blowers, and all other exhaust system parts, components, and supports thereof shall be so constructed as to meet conditions of service and to facilitate maintenance and shall conform in construction to the specifications contained in American National Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960.

(2) *Classification of open-surface tank operations.* (i) Open-surface tank operations shall be classified into 16 classes, numbered A–1 to D–4, inclusive.

(ii) *Determination of class.* Class is determined by two factors, hazard potential designated by a letter from A to D, inclusive, and rate of gas, vapor, or mist evolution designated by a number from 1 to 4, inclusive (for example, B.3).

(iii) Hazard potential is an index, on a scale of from A to D, inclusive, of the severity of the hazard associated with the substance contained in the tank because of the toxic, flammable, or explosive nature of the vapor, gas, or mist produced therefrom. The toxic hazard is determined from the concentration, measured in parts by volume of a gas or vapor, per million parts by volume of contaminated air (p.p.m.), or in milligrams of mist per cubic meter of air (mg./m.^{3}), below which ill effects are unlikely to occur to the exposed worker. The concentrations shall be those in § 1910.93.

(iv) The relative fire or explosion hazard is measured in degrees Fahrenheit in terms of the closed-cup flash point of the substance in the tank. Detailed information on the prevention of fire hazards in dip tanks may be found in Dip Tanks Containing Flammable or Combustible Liquids, NFPA No. 34–1966, National Fire Protection Association. Where the tank contains a mixture of liquids, other than organic solvents, whose effects are additive, the hygienic standard of the most toxic component (for example, the one having the lowest p.p.m. or mg./m.^{3}) shall be used, except where such substance constitutes an insignificantly small fraction of the mixture. For mixtures of organic solvents, their combined effect, rather than that of either individually, shall determine the hazard potential. In the absence of information to the contrary, the effects shall be considered as additive. If the sum of the ratios of the airborne concentration of each contaminant to the toxic concentration of that contaminant exceeds unity, the toxic concentration shall be considered to have been exceeded. (See Note A to subdivision (v) of this subparagraph.)

(v) Hazard potential shall be determined from Table G–12, with the value indicating greater hazard being used. When the hazardous material may be either a vapor with a threshhold limit value (*TLV*) in p.p.m. or a mist with a *TLV* in mg./m.^{3}, the *TLV* indicating the greater hazard shall be used (for example, A takes precedence over B or C; B over C; C over D).

NOTE A:

$$\frac{c_1}{TLV_1}+\frac{c_2}{TLV_2}+\frac{c_3}{TLV_3}+\ldots\frac{c_N}{TLV_N}>1$$

where:

c = Concentration measured at the operation in p.p.m.

TABLE G–12—DETERMINATION OF HAZARD POTENTIAL

Hazard potential	Toxicity Group		
	Gas or vapor (p.p.m.)	Mist (mg./m^3)	Flash point (in degrees F.)
A	0–10	0–0.1	
B	11–100	0.11–1.0	Under 100
C	101–500	1.1–10	100–200
D	Over 500	Over 10	Over 200

(vi) Rate of gas, vapor, or mist evolution is a numerical index, on a scale of from 1 to 4, inclusive, both of the relative capacity of the tank to produce gas, vapor, or mist and of the relative energy with which it is projected or carried upwards from the tank. Rate is evaluated in terms of

(*a*) The temperature of the liquid in the tank in degrees Fahrenheit;

(*b*) The number of degrees Fahrenheit that this temperature is below the boiling point of the liquid in degrees Fahrenheit;

(*c*) The relative evaporation of the liquid in still air at room temperature in an arbitrary scale—fast, medium, slow, or nil; and

(*d*) The extent that the tank gases or produces mist in an arbitrary scale—high, medium, low, and nil. (See Table G–13, Note 2.) Gasing depends upon electrochemical or mechanical processes, the effects of which have to be individually evaluated for each installation (see Table G–13, Note 3).

(vii) Rate of evolution shall be determined from Table G–13. When evaporation and gassing yield different rates, the lowest numerical value shall be used.

TABLE G–13—DETERMINATION OF RATE OF GAS, VAPOR, OR MIST EVOLUTION[1]

Rate	Liquid temperature,° F.	Degrees below boiling point	Relative evaporation[2]	Gassing[3]
1	Over 200	0–20	Fast	High.
2	150–200	21–50	Medium	Medium.
3	94–149	51–100	Slow	Low.
4	Under 94	Over 100	Nil	Nil.

NOTE 1. In certain classes of equipment, specifically vapor degreasers, an internal condenser or vapor level thermostat is used to prevent the vapor from leaving the tank during normal operations. In such cases, rate of vapor evolution from the tank into the workroom is not dependent upon the factors listed in the table, but rather upon abnormalities of operating procedure, such as carryout of vapors from excessively fast action, dragout of liquid by entrainment in parts, contamination of solvent by water and other materials, or improper heat balance. When operating procedure is excellent, effective rate of evolution may be taken as 4. When operating procedure is average, the effective rate of evolution may be taken as 3. When operation is poor, a rate of 2 or 1 is indicated, depending upon observed conditions.

NOTE 2. Relative evaporation rate is determined according to the methods described by A. K. Doolittle in Industrial and Engineering Chemistry, vol. 27, p. 1169, (3) where time for 100-percent evaporation is as follows: Fast: 0–3 hours; Medium: 3–12 hours; Slow: 12–50 hours; Nil: more than 50 hours.

NOTE 3. Gassing means the formation by chemical or electrochemical action of minute bubbles of gas under the surface of the liquid in the tank and is generally limited to aqueous solutions.

(3) *Ventilation.* Where ventilation is used to control potential exposures to workers as defined in subparagraph (2) (ii) of this paragraph, it shall be adequate to reduce the concentration of the air contaminant to the degree that a hazard to the worker does not exist. Methods of ventilation are discussed in American National Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960.

(4) *Control requirements.* (i) Control velocities shall conform to Table G–14 in all cases where the flow of air past the breathing or working zone of the operator and into the hoods is undisturbed by local environmental conditions, such as open windows, wall fans, unit heaters, or moving machinery.

(ii) All tanks exhausted by means of hoods which

(*a*) Project over the entire tank;

(*b*) Are fixed in position in such a location that the head of the workman, in all his normal operating positions while working at the tank, is in front of all hood openings; and

(*c*) Are completely enclosed on at least two sides, shall be considered to be exhausted through an enclosing hood.

(*d*) The quantity of air in cubic feet per minute necessary to be exhausted through an enclosing hood shall be not less than the product of the control velocity times the net area of all openings in the enclosure through which air can flow into the hood.

TABLE G-14—CONTROL VELOCITIES IN FEET PER MINUTE (F.P.M.) FOR UNDISTURBED LOCATIONS

Class (See Subparagraph (2) and Tables G-12 and G-13)	Enclosing hood (See Subparagraph (4)(ii))		Lateral exhaust [1] (See Subparagraph (4)(iii))	Canopy hood [2] (See Subparagraph (4)(iv))	
	One open side	Two open sides		Three open sides	Four open sides
A-1 and A-2	100	150	150	Do not use	Do not use
A-3 (Note 2), B-1, B-2, and C-1	75	100	100	125	175
B-3, C-2, and D-1 (Note 3)	65	90	75	100	150
A-4 (Note 2), C-3, and D-2 (Note 3)	50	75	50	75	125
B-4, C-4, D-3 (Note 3), and D-4	General room ventilation required.				

[1] See Table G-15 for computation of ventilation rate.
[2] Do not use canopy hood for Hazard Potential A processes.
[3] Where complete control of hot water is desired, design as next highest class.

(iii) All tanks exhausted by means of hoods which do not project over the entire tank, and in which the direction of air movement into the hood or hoods is substantially horizontal, shall be considered to be laterally exhausted. The quantity of air in cubic feet per minute necessary to be laterally exhausted per square foot of tank area in order to maintain the required control velocity shall be determined from Table G-15 for all variations in ratio of tank width (W) to tank length (L). The total quantity of air in cubic feet per minute required to be exhausted per tank shall be not less than the product of the area of tank surface times the cubic feet per minute per square foot of tank area, determined from Table G-15.

(a) For lateral exhaust hoods over 42 inches wide, or where it is desirable to reduce the amount of air removed from the workroom, air supply slots or orifices shall be provided along the side or the center of the tank opposite from the exhaust slots. The design of such systems shall meet the following criteria:

(1) The supply air volume plus the entrained air shall not exceed 50 percent of the exhaust volume.

(2) The velocity of the supply airstream as it reaches the effective control area of the exhaust slot shall be less than the effective velocity over the exhaust slot area.

(3) The vertical height of the receiving exhaust hood, including any baffle, shall not be less than one-quarter the width of the tank.

(4) The supply airstream shall not be allowed to impinge on obstructions between it and the exhaust slot in such a manner as to significantly interfere with the performance of the exhaust hood.

TABLE G-15—MINIMUM VENTILATION RATE IN CUBIC FEET OF AIR PER MINUTE PER SQUARE FOOT OF TANK AREA FOR LATERAL EXHAUST

Required minimum control velocity, f.p.m. (from Table G-14)	C.f.m per sq. ft. to maintain required minimum velocities at following ratios (tank width (W) /tank length (L)) [1] [2]				
	0.0-0.09	0.1-0.24	0.25-0.49	0.5-0.99	1.0-2.0
Hood along one side or two parallel sides of tank when one hood is against a wall or baffle.[2] Also for a manifold along tank centerline.[3]					
50	50	60	75	90	100
75	75	90	110	130	150
100	100	125	150	175	200
150	150	190	225	260	300
Hood along one side or two parallel sides of free standing tank not against wall or baffle.					
50	75	90	100	110	125
75	110	130	150	170	190
100	150	175	200	225	250
150	225	260	300	340	375

[1] It is not practicable to ventilate across the long dimension of a tank whose ratio $\frac{W}{L}$ exceeds 2.0.

It is understandable to do so when $\frac{W}{L}$ exceeds 1.0. For circular tanks with lateral exhaust along up to the circumference, use $W/L=1.0$; for over one-half the circumference use $W/L=0.5$.

[2] Baffle is a vertical plate the same length as the tank, and with the top of the plate as high as the tank is wide. If the exhaust hood is on the side of a tank against a building wall or close to it, it is perfectly baffled.

[3] Use $\frac{W}{2}$ as tank width in computing when manifold is along centerline, or when hoods are used on two parallel sides of a tank.

Tank Width (W) means the effective width over which the hood must pull air to operate (for example, where the hood face is set back from the edge of the tank, this set back must be added in measuring tank width). The surface area of tanks can frequently be reduced and better control obtained (particularly on conveyorized systems) by using covers extending from the upper edges of the slots toward the center of the tank.

(5) Since most failure of push-pull systems result from excessive supply air volumes and pressures, methods of measuring and adjusting the supply air shall be provided. When satisfactory control has been achieved, the adjustable features of the hood shall be fixed so that they will not be altered.

(iv) All tanks exhausted by means of hoods which project over the entire tank, and which do not conform to the definition of enclosing hoods, shall be considered to be overhead canopy hoods. The quantity of air in cubic feet per minute necessary to be exhausted through a canopy hood shall be not less than the product of the control velocity times the net area of all openings between the bottom edges of the hood and the top edges of the tank.

(v) The rate of vapor evolution (including steam or products of combustion) from the process shall be estimated. If the rate of vapor evolution is equal to or greater than 10 percent of the calculated exhaust volume required, the exhaust volume shall be increased in equal amount.

(5) *Spray cleaning and degreasing.* Wherever spraying or other mechanical means are used to disperse a liquid above an open-surface tank, control must be provided for the airborne spray. Such operations shall be enclosed as completely as possible. The inward air velocity into the enclosure shall be sufficient to prevent the discharge of spray into the workroom. Mechanical baffles may be used to help prevent the discharge of spray. Spray painting operations are covered by paragraph (c) of this section.

(6) *Control means other than ventilation.* Tank covers, foams, beads, chips, or other materials floating on the tank surface so as to confine gases, mists, or vapors to the area under the cover or to the foam, bead, or chip layer; or surface tension depressive agents added to the liquid in the tank to minimize mist formation, or any combination thereof, may all be used as gas, mist, or vapor control means for open-surface tank operations, provided that they effectively reduce the concentrations of hazardous materials in the vicinity of the worker below the limits set in accordance with subparagraph (2) of this paragraph.

(7) *System design.* (i) The equipment for exhausting air shall have sufficient capacity to produce the flow of air required in each of the hoods and openings of the system.

(ii) The capacity required in subdivision (i) of this subparagraph shall be obtained when the airflow producing equipment is operating against the following pressure losses, the sum of which is the static pressure:

(a) Entrance losses into the hood.

(b) Resistance to airflow in branch pipe including bends and transformations.

(c) Entrance loss into the main pipe.

(d) Resistance to airflow in main pipe including bends and transformations.

(e) Resistance of mechanical equipment; that is, filters, washers, condensers, absorbers, etc., plus their entrance and exit losses.

(f) Resistance in outlet duct and discharge stack.

(iii) Two or more operations shall not be connected to the same exhaust system where either one or the combination of the substances removed may constitute a fire, explosion, or chemical reaction hazard in the duct system. Traps or other devices shall be provided to insure that condensate in ducts does not drain back into any tank.

(iv) The exhaust system, consisting of hoods, ducts, air mover, and discharge outlet shall be designed in accordance with American National Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2-1960, or the manual, Industrial Ventilation, published by the American Conference of Governmental Industrial Hygienists. Airflow and pressure loss data provided by the manufacturer of any air cleaning device shall be included in the design calculations.

(8) *Operation.* (i) The required airflow shall be maintained at all times during which gas, mist, or vapor is emitted from the tank, and at all times the tank, the draining, or the drying area is in operation or use. When the system is first installed, the airflow from each hood shall be measured by means of a pitot traverse in the exhaust duct and corrective action taken if the flow is less than that required. When the proper flow is obtained, the hood static pressure shall be measured and recorded. At intervals of not more than 3 months operation, or after a prolonged shutdown period, the hoods and duct system shall be inspected for evidence of corrosion or damage. In any case where the airflow is found to be less than required, it shall be increased to the required value. (Information on airflow and static pressure measurement and calculations may be found in American National Standard Fundamental Governing the Design and Operation of Local Exhaust Systems, Z9.2–1960, or in the manual, Industrial Ventilation, published by the American Conference of Governmental Industrial Hygienists.)

(ii) The exhaust system shall discharge to the outer air in such a manner that the possibility of its effluent entering any building is at a minimum. Recirculation shall only be through a device for contaminant removal which will prevent the creation of a health hazard in the room or area to which the air is recirculated.

(iii) A volume of outside air in the range of 90 percent to 110 percent of the exhaust volume shall be provided to each room having exhaust hoods. The outside air supply shall enter the workroom in such a manner as not to be detrimental to any exhaust hood. The airflow of the makeup air system shall be measured on installation. Periodically, thereafter, the airflow should be remeasured, and corrective action shall be taken when the airflow is below that required. The makeup air shall be uncontaminated.

(9) *Personal protection.* (i) All employees working in and around open-surface tank operations must be instructed as to the hazards of their respective jobs, and in the personal protection and first aid procedures applicable to these hazards.

(ii) All persons required to work in such a manner that their feet may become wet shall be provided with rubber or other impervious boots or shoes, rubbers, or wooden-soled shoes sufficient to keep feet dry.

(iii) All persons required to handle work wet with a liquid other than water shall be provided with gloves impervious to such a liquid and of a length sufficient to prevent entrance of liquid into the tops of the gloves. The interior of gloves shall be kept free from corrosive or irritating contaminants.

(iv) All persons required to work in such a manner that their clothing may become wet shall be provided with such aprons, coats, jackets, sleeves, or other garments made of rubber, or of other materials impervious to liquids other than water, as are required to keep their clothing dry. Aprons shall extend well below the top of boots to prevent liquid splashing into the boots. Provision of dry, clean, cotton clothing along with rubber shoes or short boots and an apron impervious to liquids other than water shall be considered a satisfactory substitute where small parts are cleaned, plated, or acid dipped in open tanks and rapid work is required.

(v) Whenever there is a danger of splashing, for example, when additions are made manually to the tanks, or when acids and chemicals are removed from the tanks, the employees so engaged shall be required to wear either tight-fitting chemical goggles or an effective face shield. See § 1910.133 (b)(6) and (c)(3).

(vi) When, during emergencies as described in subparagraph (11)(v) of this paragraph, workers must be in areas where concentrations of air contaminants are greater than the limit set by subparagraph (2)(ii) of this paragraph, or oxygen concentrations are less than 19.5 percent, they shall be required to wear respirators adequate to reduce their exposure to a level below these limits, or to provide adequate oxygen. Such respirators shall also be provided in marked, quickly accessible storage compartments built for the purpose, when there exists the possibility of accidental release of hazardous concentrations of air contaminants. Respirators shall be approved by the U.S. Bureau of Mines, U.S. Department of the Interior (see 30 CFR Part 11) and shall be selected by a competent industrial hygienist or other technically qualified source. Respirators shall be used in accordance with § 1910.134 (a), (b), and (c), and persons who may require them shall be trained in their use.

(vii) Near each tank containing a liquid which may burn, irritate, or otherwise be harmful to the skin if splashed upon the worker's body, there shall be a supply of clean cold water. The water pipe (carrying a pressure not exceeding 25 pounds) shall be provided with a quick opening valve and at least 48 inches of hose not smaller than three-fourths inch, so that no time may be lost in washing off liquids from the skin or clothing. Alternatively, deluge showers and eye flushes shall be provided in cases where harmful chemicals may be splashed on parts of the body.

(viii) Operators with sores, burns, or other skin lesions requiring medical treatment shall not be allowed to work at their regular operations until so authorized by a physician. Any small skin abrasions, cuts, rash, or open sores which are found or reported shall be treated by a properly designated person so that chances of exposures to the chemicals are removed. Workers exposed to chromic acids shall have a periodic examination made of the nostrils and other parts of the body, to detect incipient ulceration.

(ix) Sufficient washing facilities, including soap, individual towels, and hot water, shall be provided for all persons required to use or handle any liquids which may burn, irritate, or otherwise be harmful to the skin, on the basis of at least one basin (or its equivalent) with a hot water faucet for every 10 employees. See § 1910.141(d).

(x) Locker space or equivalent clothing storage facilities shall be provided to prevent contamination of street clothing.

(xi) First aid facilities specific to the hazards of the operations conducted shall be readily available.

(10) *Special precautions for cyanide.* Dikes or other arrangements shall be provided to prevent the possibility of intermixing of cyanide and acid in the event of tank rupture.

(11) *Inspection, maintenance, and installation.*

(i) Floors and platforms around tanks shall be prevented from becoming slippery both by original type of construction and by frequent flushing. They shall be firm, sound, and of the design and construction to minimize the possibility of tripping.

(ii) Before cleaning the interior of any tank, the contents shall be drained off, and the cleanout doors shall be opened where provided. All pockets in tanks or pits, where it is possible for hazardous vapors to collect, shall be ventilated and cleared of such vapors.

(iii) Tanks which have been drained to permit employees to enter for the purposes of cleaning, inspection, or maintenance may contain atmospheres which are hazardous to life or health, through the presence of flammable or toxic air contaminants, or through the absence of sufficient oxygen. Before employees shall be permitted to enter any such tank, appropriate tests of the atmosphere shall be made to determine if the limits set by subparagraph (2)(ii) of this paragraph are exceeded, or if the oxygen concentration is less than 19.5 percent.

(iv) If the tests made in accordance with subdivision (iii) of this subparagraph indicate that the atmosphere in the tank is unsafe, before any employee is permitted to enter the tank, the tank shall be ventilated until the hazardous atmosphere is removed, and ventilation shall be continued so as to prevent the occurrence of a hazardous atmosphere as long as an employee is in the tank.

(v) If, in emergencies, such as rescue work, it is necessary to enter a tank which may contain a hazardous atmosphere, suitable respirators, such as self-contained breathing apparatus; hose mask with blower, if there is a possibility of oxygen deficiency; or a gas mask, selected and operated in accordance with subparagraph (9)(vi) of this paragraph, shall be used. If a contaminant in the tank can cause dermatitis, or be absorbed through the skin, the employee entering the tank shall also wear protective clothing. At least one trained standby employee, with suitable respirator, shall be present in the nearest uncontaminated area. The standby employee must be able to communicate with the employee in the tank and be well able to haul him out of the tank with a lifeline if necessary.

(vi) Maintenance work requiring welding or open flame, where toxic metal fumes such as cadmium, chromium, or lead may be evolved, shall be done only with sufficient local exhaust ventilation to prevent the creation of a health haz-

ard, or be done with respirators selected and used in accordance with subparagraph (9)(vi) of this paragraph. Welding, or the use of open flames near any solvent cleaning equipment shall be permitted only after such equipment has first been thoroughly cleared of solvents and vapors.

(12) *Vapor degreasing tanks.* (i) In any vapor degreasing tank equipped with a condenser or vapor level thermostat, the condenser or thermostat shall keep the level of vapors below the top edge of the tank by a distance at least equal to one-half the tank width, or at least 36 inches, whichever is shorter.

(ii) Where gas is used as a fuel for heating vapor degreasing tanks, the combustion chamber shall be of tight construction, except for such openings as the exhaust flue, and those that are necessary for supplying air for combustion. Flues shall be of corrosion-resistant construction and shall extend to the outer air. If mechanical exhaust is used on this flue, a draft diverter shall be used. Special precautions must be taken to prevent solvent fumes from entering the combustion air of this or any other heater when chlorinated or fluorinated hydrocarbon solvents (for example, trichloroethylene; Freon) are used.

(iii) Heating elements shall be so designed and maintained that their surface temperature will not cause the solvent or mixture to decompose, break down, or be converted into an excessive quantity of vapor.

(iv) Tanks or machines of more than 4 square feet of vapor area, used for solvent cleaning or vapor degreasing, shall be equipped with suitable cleanout or sludge doors located near the bottom of each tank or still. These doors shall be so designed and gasketed that there will be no leakage of solvent when they are closed.

§ 1910.95 Occupational noise exposure.

(a) Protection against the effects of noise exposure shall be provided when the sound levels exceed those shown in Table G–16 when measured on the A scale of a standard sound level meter at slow response. When noise levels are determined by octave band analysis, the equivalent A-weighted sound level may be determined as follows:

Figure G-9

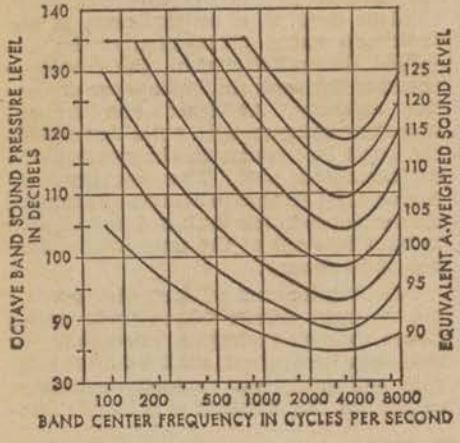

Equivalent sound level contours. Octave band sound pressure levels may be converted to the equivalent A-weighted sound level by plotting them on this graph and noting the A-weighted sound level corresponding to the point of highest penetration into the sound level contours. This equivalent A-weighted sound level, which may differ from the actual A-weighted sound level of the noise, is used to determine exposure limits from Table I.G–16.

(b)(1) When employees are subjected to sound exceeding those listed in Table G–16, feasible administrative or engineering controls shall be utilized. If such controls fail to reduce sound levels within the levels of Table G–16, personal protective equipment shall be provided and used to reduce sound levels within the levels of the table.

(2) If the variations in noise level involve maxima at intervals of 1 second or less, it is to be considered continuous.

(3) In all cases where the sound levels exceed the values shown herein, a continuing, effective hearing conservation program shall be administered.

TABLE G–16—PERMISSIBLE NOISE EXPOSURES [1]

Duration per day, hours	Sound level dBA slow response
8	90
6	92
4	95
3	97
2	100
1½	102
1	105
½	110
¼ or less	115

[1] When the daily noise exposure is composed of two or more periods of noise exposure of different levels, their combined effect should be considered, rather than the individual effect of each. If the sum of the following fractions: $C1/T1+C2/T2$ Cn/Tn exceeds unity, then, the mixed exposure should be considered to exceed the limit value. Cn indicates the total time of exposure at a specified noise level, and Tn indicates the total time of exposure permitted at that level.

Exposure to impulsive or impact noise should not exceed 140 dB peak sound pressure level.

§ 1910.96 Ionizing radiation.

(a) *Definitions applicable to this section.* (1) "Radiation" includes alpha rays, beta rays, gamma rays, X-rays, neutrons, high-speed electrons, high-speed protons, and other atomic particles but such term does not include sound or radio waves, or visible light, or infrared or ultraviolet light.

(2) "Radioactive material" means any material which emits, by spontaneous nuclear disintegration, corpuscular or electromagnetic emanations.

(3) "Restricted area" means any area access to which is controlled by the employer for purposes of protection of individuals from exposure to radiation or radioactive materials.

(4) "Unrestricted area" means any area access to which is not controlled by the employer for purposes of protection of individuals from exposure to radiation or radioactive materials.

(5) "Dose" means the quantity of ionizing radiation absorbed, per unit of mass, by the body or by any portion of the body. When the provisions in this section specify a dose during a period of time, the dose is the total quantity of radiation absorbed, per unit of mass, by the body or by any portion of the body during such period of time. Several different units of dose are in current use. Definitions of units used in this section are set forth in subparagraphs (6) and (7) of this paragraph.

(6) "Rad" means a measure of the dose of any ionizing radiation to body tissues in terms of the energy absorbed per unit of mass of the tissue. One rad is the dose corresponding to the absorption of 100 ergs per gram of tissue (1 millirad (mrad) = 0.001 rad).

(7) "Rem" means a measure of the dose of any ionizing radiation to body tissue in terms of its estimated biological effect relative to a dose of 1 roentgen (r) of X-rays (1 millirem (mrem) = 0.001 rem). The relation of the rem to other dose units depends upon the biological effect under consideration and upon the conditions for irradiation. Each of the following is considered to be equivalent to a dose of 1 rem:

(i) A dose of 1 rad due to X- or gamma radiation;

(ii) A dose of 1 rad due to X-, gamma, or beta radiation;

(iii) A dose of 0.1 rad due to neutrons or high energy protons;

(iv) A dose of 0.05 rad due to particles heavier than protons and with sufficient energy to reach the lens of the eye;

(v) If it is more convenient to measure the neutron flux, or equivalent, than to determine the neutron dose in rads, as provided in subdivision (iii) of this subparagraph, 1 rem of neutron radiation may, for purposes of the provisions in this section be assumed to be equivalent to 14 million neutrons per square centimeter incident upon the body; or, if there is sufficient information to estimate with reasonable accuracy the approximate distribution in energy of the neutrons, the incident number of neutrons per square centimeter equivalent to 1 rem may be estimated from Table G–17:

TABLE G–17—NEUTRON FLUX DOSE EQUIVALENTS

Neutron energy (million electron volts (Mev))	Number of neutrons per square centimeter equivalent to a dose of 1 rem (neutrons/cm²)	Average flux to deliver 100 millirem in 40 hours (neutrons/cm² per sec.)
Thermal	970×10^6	670
0.0001	720×10^6	500
0.005	820×10^6	570
0.02	400×10^6	280
0.1	120×10^6	80
0.5	43×10^6	30
1.0	26×10^6	18
2.5	29×10^6	20
5.0	26×10^6	18
7.5	24×10^6	17
10	24×10^6	17
10 to 30	14×10^6	10

(8) For determining exposures to X- or gamma rays up to 3 Mev., the dose limits specified in this section may be assumed to be equivalent to the "air dose". For the purpose of this section "air dose" means that the dose is measured by a properly calibrated appropriate instrument in air at or near the body sur-

face in the region of the highest dosage rate.

(b) *Exposure of individuals to radiation in restricted areas.* (1) Except as provided in subparagraph (2) of this paragraph, no employer shall possess, use, or transfer sources of ionizing radiation in such a manner as to cause any individual in a restricted area to receive in any period of one calendar quarter from sources in the employer's possession or control a dose in excess of the limits specified in Table G–18:

TABLE G–18

	Rems per calendar quarter
Whole body: Head and trunk; active blood-forming organs; lens of eyes; or gonads	1¼
Hands and forearms; feet and ankles	18¾
Skin of whole body	7½

(2) An employer may permit an individual in a restricted area to receive doses to the whole body greater than those permitted under subparagraph (1) of this paragraph, so long as:

(i) During any calendar quarter the dose to the whole body shall not exceed 3 rems; and

(ii) The dose to the whole body, when added to the accumulated occupational dose to the whole body, shall not exceed 5 (N–18) rems, where "N" equals the individual's age in years at his last birthday; and

(iii) The employer maintains adequate past and current exposure records which show that the addition of such a dose will not cause the individual to exceed the amount authorized in this subparagraph. As used in this subparagraph, "Dose to the whole body" shall be deemed to include any dose to the whole body, gonad, active bloodforming organs, head and trunk, or lens of the eye.

(3) No employer shall permit any employee who is under 18 years of age to receive in any period of one calendar quarter a dose in excess of 10 percent of the limits specified in Table G–18.

(4) "Calendar quarter" means any 3-month period determined as follows:

(i) The first period of any year may begin on any date in January: *Provided*, That the second, third, and fourth periods accordingly begin on the same date in April, July, and October, respectively, and that the fourth period extends into January of the succeeding year, if necessary to complete a 3-month quarter. During the first year of use of this method of determination, the first period for that year shall also include any additional days in January preceding the starting date for the first period; or

(ii) The first period in a calendar year of 13 complete, consecutive calendar weeks; the second period in a calendar year of 13 complete consecutive weeks; the third period in a calendar year of 13 complete, consecutive calendar weeks; the fourth period in a calendar year of 13 complete, consecutive calendar weeks. If at the end of a calendar year there are any days not falling within a complete calendar week of that year, such days shall be included within the last complete calendar week of that year. If at the beginning of any calendar year there are days not falling within a complete calendar week of that year, such days shall be included within the last complete calendar week of the previous year; or

(iii) The four periods in a calendar year may consist of the first 14 complete, consecutive calendar weeks; the next 12 complete, consecutive calendar weeks, the next 14 complete, consecutive calendar weeks, and the last 12 complete, consecutive calendar weeks. If at the end of a calendar year there are any days not falling within a complete calendar week of that year, such days shall be included (for purposes of this section) within the last complete calendar week of the year. If at the beginning of any calendar year there are days not falling within a complete calendar week of that year, such days shall be included (for purposes of this section) within the last complete week of the previous year.

(5) No employer shall change the method used by him to determine calendar quarters except at the beginning of a calendar year.

(c) *Exposure to airborne radioactive material.* (1) No employer shall possess, use or transport radioactive material in such a manner as to cause any employee, within a restricted area, to be exposed to airborne radioactive material in an average concentration in excess of the limits specified in Table 1 of Appendix B to 10 CFR Part 20. The limits given in Table 1 are for exposure to the concentrations specified for 40 hours in any workweek of 7 consecutive days. In any such period where the number of hours of exposure is less than 40, the limits specified in the table may be increased proportionately. In any such period where the number of hours of exposure is greater than 40, the limits specified in the table shall be decreased proportionately.

(2) No employer shall possess, use, or transfer radioactive material in such a manner as to cause any individual within a restricted area, who is under 18 years of age, to be exposed to airborne radioactive material in an average concentration in excess of the limit specified in Table II of Appendix B to 10 CFR Part 20. For purposes of this subparagraph, concentrations may be averaged over periods not greater than 1 week.

(3) "Exposed" as used in this paragraph means that the individual is present in an airborne concentration. No allowance shall be made for the use of protective clothing or equipment, or particle size.

(d) *Precautionary procedures and personal monitoring.* (1) Every employer shall make such surveys as may be necessary for him to comply with the provisions in this section. "Survey" means an evaluation of the radiation hazards incident to the production, use, release, disposal, or presence of radioactive materials or other sources of radiation under a specific set of conditions. When appropriate, such evaluation includes a physical survey of the location of materials and equipment, and measurements of levels of radiation or concentrations of radioactive material present.

(2) Every employer shall supply appropriate personnel monitoring equipment, such as film badges, pocket chambers, pocket dosimeters, or film rings, to, and shall require the use of such equipment by:

(i) Each employee who enters a restricted area under such circumstances that he receives, or is likely to receive, a dose in any calendar quarter in excess of 25 percent of the applicable value specified in paragraph (a)(1) of this section; and

(ii) Each employee under 18 years of age who enters a restricted area under such circumstances that he receives, or is likely to receive, a dose in any calendar quarter in excess of 5 percent of the applicable value specified in paragraph (a)(1) of this section; and

(iii) Each employee who enters a high radiation area.

(3) As used in this section:

(i) "Personnel monitoring equipment" means devices designed to be worn or carried by an individual for the purpose of measuring the dose received (e.g., film badges, pocket chambers, pocket dosimeters, film rings, etc.);

(ii) "Radiation area" means any area, accessible to personnel, in which there exists radiation at such levels that a major portion of the body could receive in any 1 hour a dose in excess of 5 millirem, or in any 5 consecutive days a dose in excess of 100 millirem; and

(iii) "High radiation area" means any area, accessible to personnel, in which there exists radiation at such levels that a major portion of the body could receive in any one hour a dose in excess of 100 millirem.

(e) *Caution signs, labels, and signals*—(1) *General.* (i) Symbols prescribed by this paragraph shall use the conventional radiation caution colors (magenta or purple on yellow background). The symbol prescribed by this paragraph is the conventional three-bladed design:

RADIATION SYMBOL

1. Cross-hatched area is to be magenta or purple.
2. Background is to be yellow.

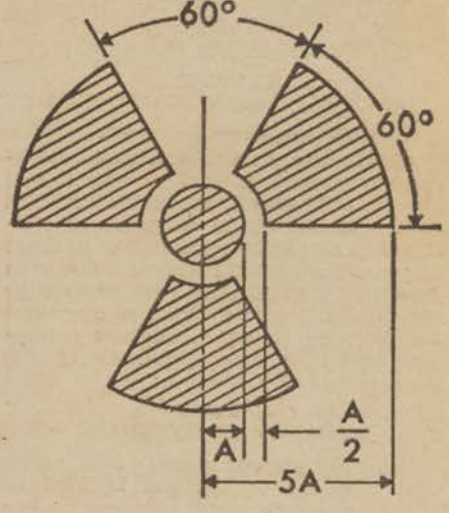

(ii) In addition to the contents of signs and labels prescribed in this paragraph, employers may provide on or near such signs and labels any additional information which may be appropriate in aiding individuals to minimize exposure to radiation or to radioactive material.

(2) *Radiation area.* Each radiation area shall be conspicuously posted with a sign or signs bearing the radiation caution symbol described in subparagraph (1) of this paragraph and the words:

CAUTION
RADIATION AREA

(3) *High radiation area.* (i) Each high radiation area shall be conspicuously posted with a sign or signs bearing the radiation caution symbol and the words:

CAUTION
HIGH RADIATION AREA

(ii) Each high radiation area shall be equipped with a control device which shall either cause the level of radiation to be reduced below that at which an individual might receive a dose of 100 millirems in 1 hour upon entry into the area or shall energize a conspicuous visible or audible alarm signal in such a manner that the individual entering and the employer or a supervisor of the activity are made aware of the entry. In the case of a high radiation area established for a period of 30 days or less, such control device is not required.

(4) *Airborne radioactivity area.* (i) As used in the provisions of this section, "airborne radioactivity area" means:

(*a*) Any room, enclosure, or operating area in which airborne radioactive materials, composed wholly or partly of radioactive material, exist in concentrations in excess of the amounts specified in column 1 of Table 1 of Appendix B to 10 CFR Part 20 or

(*b*) Any room, enclosure, or operating area in which airborne radioactive materials exist in concentrations which, averaged over the number of hours in any week during which individuals are in the area, exceed 25 percent of the amounts specified in column 1 of Table 1 of Appendix B to 10 CFR Part 20.

(ii) Each airborne radioactivity area shall be conspicuously posted with a sign or signs bearing the radiation caution symbol described in subparagraph (1) of this paragraph and the words:

CAUTION
AIRBORNE RADIOACTIVITY AREA

(5) *Additional requirements.*

(i) Each area or room in which radioactive material is used or stored and which contains any radioactive material (other than natural uranium or thorium) in any amount exceeding 10 times the quantity of such material specified in Appendix C to 10 CFR Part 20 shall be conspicuously posted with a sign or signs bearing the radiation caution symbol described in subparagraph (1) of this paragraph and the words:

CAUTION
RADIOACTIVE MATERIALS

(ii) Each area or room in which natural uranium or thorium is used or stored in an amount exceeding 100 times the quantity of such material specified in 10 CFR Part 20 shall be conspicuously posted with a sign or signs bearing the radiation caution symbol described in subparagraph (1) of this paragraph and the words:

CAUTION
RADIOACTIVE MATERIALS

(6) *Containers.* (i) Each container in which is transported, stored, or used a quantity of any radioactive material (other than natural uranium or thorium) greater than the quantity of such material specified in Appendix C of 10 CFR Part 20 shall bear a durable, clearly visible label bearing the radiation caution symbol described in subparagraph (1) of the paragraph and the words:

CAUTION
RADIOACTIVE MATERIALS

(ii) Each container in which natural uranium or thorium is transported, stored, or used in a quantity greater than 10 times the quantity specified in Appendix C to 10 CFR Part 20 shall bear a durable, clearly visible label bearing the radiation caution symbol described in subparagraph (1) of this paragraph and the words:

CAUTION
RADIOACTIVE MATERIALS

(iii) Notwithstanding the provisions of subdivisions (i) and (ii) of this subparagraph a label shall not be required:

(*a*) If the concentration of the material in the container does not exceed that specified in column 2 of Table 1 of Appendix B to 10 CFR Part 20, or

(*b*) For laboratory containers, such as beakers, flasks, and test tubes, used transiently in laboratory procedures, when the user is present.

(iv) Where containers are used for storage, the labels required in this subparagraph shall state also the quantities and kinds of radioactive materials in the containers and the date of measurement of the quantities.

(f) *Immediate evacuation warning signal*—(1) *Signal characteristics.* (i) The signal shall be a midfrequency complex sound wave amplitude modulated at a subsonic frequency. The complex sound wave in free space shall have a fundamental frequency (f_1) between 450 and 500 hertz (Hz) modulated at a subsonic rate between 4 and 5 hertz.

(ii) The signal generator shall not be less than 75 decibels at every location where an individual may be present whose immediate, rapid, and complete evacuation is essential.

(iii) A sufficient number of signal units shall be installed such that the requirements of subdivision (ii) of this subparagraph are met at every location where an individual may be present whose immediate, rapid, and complete evacuation is essential.

(iv) The signal shall be unique in the plant or facility in which it is installed.

(v) The minimum duration of the signal shall be sufficient to insure that all affected persons hear the signal.

(vi) The signal-generating system shall respond automatically to an initiating event without requiring any human action to sound the signal.

(2) *Design objectives.* (i) The signal-generating system shall be designed to incorporate components which enable the system to produce the desired signal each time it is activated within one-half second of activation.

(ii) The signal-generating system shall be provided with an automatically activated secondary power supply which is adequate to simultaneously power all emergency equipment to which it is connected, if operation during power failure is necessary, except in those systems using batteries as the primary source of power.

(iii) All components of the signal-generating system shall be located to provide maximum practicable protection against damage in case of fire, explosion, corrosive atmosphere, or other environmental extremes consistent with adequate system performance.

(iv) The signal-generating system shall be designed with the minimum number of components necessary to make it function as intended, and should utilize components which do not require frequent servicing such as lubrication or cleaning.

(v) Where several activating devices feed activating information to a central signal generator, failure of any activating device shall not render the signal-generator system inoperable to activating information from the remaining devices.

(vi) The signal-generating system shall be designed to enhance the probability that alarm occurs only when immediate evacuation is warranted. The number of false alarms shall not be so great that the signal will come to be disregarded and shall be low enough to minimize personal injuries or excessive property damage that might result from such evacuation.

(3) *Testing.* (i) Initial tests, inspections, and checks of the signal-generating system shall be made to verify that the fabrication and installation were made in accordance with design plans and specifications and to develop a thorough knowledge of the performance of the system and all components under normal and hostile conditions.

(ii) Once the system has been placed in service, periodic tests, inspections, and checks shall be made to minimize the possibility of malfunction.

(iii) Following significant alterations or revisions to the system, tests and checks similar to the initial installation tests shall be made.

(iv) Tests shall be designed to minimize hazards while conducting the tests.

(v) Prior to normal operation the signal-generating system shall be checked physically and functionally to assure reliability and to demonstrate accuracy and performance. Specific tests shall include:

(*a*) All power sources.

(*b*) Calibration and calibration stability.

(*c*) Trip levels and stability.

(*d*) Continuity of function with loss and return of required services such as AC or DC power, air pressure, etc.

(e) All indicators.

(f) Trouble indicator circuits and signals, where used.

(g) Air pressure (if used).

(h) Determine that sound level of the signal is within the limit of subparagraph (1)(i) of this paragraph at all points that require immediate evacuation.

(vi) In addition to the initial startup and operating tests, periodic scheduled performance tests and status checks must be made to insure that the system is at all times operating within design limits and capable of the required response. Specific periodic tests or checks or both shall include:

(a) Adequacy of signal activation devices.

(b) All power sources.

(c) Function of all alarm circuits and trouble indicator circuits including trip levels.

(d) Air pressure (if used).

(e) Function of entire system including operation without power where required.

(f) Complete operational tests including sounding of the signal and determination that sound levels are adequate.

(vii) Periodic tests shall be scheduled on the basis of need, experience, difficulty, and disruption of operations. The entire system should be operationally tested at least quarterly.

(viii) All employees whose work may necessitate their presence in an area covered by the signal shall be made familiar with the actual sound of the signal—preferably as it sounds at their work location. Before placing the system into operation, all employees normally working in the area shall be made acquainted with the signal by actual demonstration at their work locations.

(g) *Exceptions from posting requirements.* Notwithstanding the provisions of paragraph (e) of this section:

(1) A room or area is not required to be posted with a caution sign because of the presence of a sealed source, provided the radiation level 12 inches from the surface of the source container or housing does not exceed 5 millirem per hour.

(2) Rooms or other areas in onsite medical facilities are not required to be posted with caution signs because of the presence of patients containing radioactive material, provided that there are personnel in attendance who shall take the precautions necessary to prevent the exposure of any individual to radiation or radioactive material in excess of the limits established in the provisions of this section.

(3) Caution signs are not required to be posted at areas or rooms containing radioactive materials for periods of less than 8 hours: *Provided*, That

(i) The materials are constantly attended during such periods by an individual who shall take the precautions necessary to prevent the exposure of any individual to radiation or radioactive materials in excess of the limits established in the provisions of this section; and

(ii) Such area or room is subject to the employer's control.

(h) *Exemptions for radioactive materials packaged for shipment.* Radioactive materials packaged and labeled in accordance with regulations of the Department of Transportation published in 49 CFR Chapter I, are exempt from the labeling and posting requirements of this subpart during shipment, provided that the inside containers are labeled in accordance with the provisions of paragraph (e) of this section.

(i) *Instruction of personnel posting.* (1) Employers regulated by the Atomic Energy Commission shall be governed by 10 CFR Part 20 standards. Employers in a State named in paragraph (p)(3) of this section shall be governed by the requirements of the laws and regulations of that State. All other employers shall be regulated by the following:

(2) All individuals working in or frequenting any portion of a radiation area shall be informed of the occurrence of radioactive materials or of radiation in such portions of the radiation area; shall be instructed in the safety problems associated with exposure to such materials or radiation and in precautions or devices to minimize exposure; shall be instructed in the applicable provisions of this section for the protection of employees from exposure to radiation or radioactive materials; and shall be advised of reports of radiation exposure which employees may request pursuant to the regulations in this section.

(3) Each employer to whom this section applies shall post a current copy of its provisions and a copy of the operating procedures applicable to the work conspicuously in such locations as to insure that employees working in or frequenting radiation areas will observe these documents on the way to and from their place of employment, or shall keep such documents available for examination of employees upon request.

(j) *Storage of radioactive materials.* Radioactive materials stored in a nonradiation area shall be secured against unauthorized removal from the place of storage.

(k) *Waste disposal.* No employer shall dispose of radioactive material except by transfer to an authorized recipient, or in a manner approved by the Atomic Energy Commission or a State named in paragraph (p)(3) of this section.

(l) *Notification of incidents*—(1) *Immediate notification.* Each employer shall immediately notify the Assistant Secretary of Labor or his duly authorized representative, for employees not protected by the Atomic Energy Commission by means of 10 CFR Part 20; paragraph (p)(2) of this section, or the requirements of the laws and regulations of States named in paragraph (p)(3) of this section, by telephone or telegraph of any incident involving radiation which may have caused or threatens to cause:

(i) Exposure of the whole body of any individual to 25 rems or more of radiation; exposure of the skin of the whole body of any individual to 150 rems or more of radiation; or exposure of the feet, ankles, hands, or forearms of any individual to 375 rems or more of radiation; or

(ii) The release of radioactive material in concentrations which, if averaged over a period of 24 hours, would exceed 5,000 times the limit specified for such materials in Table II of Appendix B to 10 CFR Part 20.

(iii) A loss of 1 working week or more of the operation of any facilities affected; or

(iv) Damage to property in excess of $100,000.

(2) *Twenty-four hour notification.* Each employer shall within 24 hours following its occurrence notify the Assistant Secretary of Labor or his duly authorized representative for employees not protected by the Atomic Energy Commission by means of 10 CFR Part 20; paragraph (p)(2) of this section, or the requirements of the laws and applicable regulations of States named in paragraph (p)(3) of this section, by telephone or telegraph of any incident involving radiation which may have caused or threatens to cause:

(i) Exposure of the whole body of any individual to 5 rems or more of radiation; exposure of the skin of the whole body of any individual to 30 rems or more of radiation; or exposure of the feet, ankles, hands, or forearms to 75 rems or more of radiation; or

(ii) A loss of 1 day or more of the operation of any facilities; or

(iii) Damage to property in excess of $10,000.

(m) *Reports of overexposure and excessive levels and concentrations.* (1) In addition to any notification required by paragraph (l) of this section each employer shall make a report in writing within 30 days to the Assistant Secretary of Labor or his duly authorized representative, for employees not protected by the Atomic Energy Commission by means of 10 CFR Part 20; or under paragraph (p)(2) of this section, or the requirements of the laws and regulations of States named in paragraph (p)(3) of this section, of each exposure of an individual to radiation or concentrations of radioactive material in excess of any applicable limit in this section. Each report required under this subparagraph shall describe the extent of exposure of persons to radiation or to radioactive material; levels of radiation and concentration, of radioactive material involved, the cause of the exposure levels of concentrations; and corrective steps taken or planned to assure against a recurrence.

(2) In any case where an employer is required pursuant to the provisions of this paragraph to report to the U.S. Department of Labor any exposure of an individual to radiation or to concentrations of radioactive material, the employer shall also notify such individual of the nature and extent of exposure. Such notice shall be in writing and shall contain the following statement: "You should preserve this report for future reference."

(n) *Records.* (1) Every employer shall maintain records of the radiation exposure of all employees for whom per-

sonnel monitoring is required under paragraph (d) of this section and advise each of his employees of his individual exposure on at least an annual basis.

(2) Every employer shall maintain records in the same units used in tables in paragraph (b) of this section and Appendix B to 10 CFR Part 20.

(o) *Disclosure to former employee of individual employee's record.* (1) At the request of a former employee an employer shall furnish to the employee a report of the employee's exposure to radiation as shown in records maintained by the employer pursuant to paragraph (n)(1) of this section. Such report shall be furnished within 30 days from the time the request is made, and shall cover each calendar quarter of the individual's employment involving exposure to radiation or such lesser period as may be requested by the employee. The report shall also include the results of any calculations and analysis of radioactive material deposited in the body of the employee. The report shall be in writing and contain the following statement: "You should preserve this report for future reference."

(2) The former employee's request should include appropriate identifying data, such as social security number and dates and locations of employment.

(p) *Atomic Energy Commission licensees—AEC contractors operating AEC plants and facilities—AEC Agreement State licensees or registrants.* (1) Any employer who possesses or uses source material, byproduct material, or special nuclear material, as defined in the Atomic Energy Act of 1954, as amended, under a license issued by the Atomic Energy Commission and in accordance with the requirements of 10 CFR Part 20 shall be deemed to be in compliance with the requirements of this section with respect to such possession and use.

(2) AEC contractors operating AEC plants and facilities: Any employer who possesses or uses source material, byproduct material, special nuclear material, or other radiation sources under a contract with the Atomic Energy Commission for the operation of AEC plants and facilities and in accordance with the standards, procedures, and other requirements for radiation protection established by the Commission for such contract pursuant to the Atomic Energy Act of 1954 as amended (42 U.S.C. 2011 et seq.), shall be deemed to be in compliance with the requirements of this section with respect to such possession and use.

(3) AEC-agreement State licensees or registrants:

(i) *Atomic Energy Act sources.* Any employer who possesses or uses source material, byproduct material, or special nuclear material, as defined in the Atomic Energy Act of 1954, as amended (42 U.S.C. 2011 et seq.), and has either registered such sources with, or is operating under a license issued by, a State which has an agreement in effect with the Atomic Energy Commission pursuant to section 274(b) (42 U.S.C. 2021(b)) of the Atomic Energy Act of 1954, as amended, and in accordance with the requirements of that State's laws and regulations shall be deemed to be in compliance with the radiation requirements of this section, insofar as his possession and use of such material is concerned, unless the Secretary of Labor, after conference with the Atomic Energy Commission, shall determine that the State's program for control of these radiation sources is incompatible with the requirements of this section. Such agreements currently are in effect only in the States of Alabama, Arkansas, California, Kansas, Kentucky, Florida, Mississippi, New Hampshire, New York, North Carolina, Texas, Tennessee, Oregon, Idaho, Arizona, Colorado, Louisiana, Nebraska, Washington, Maryland, North Dakota, South Carolina, and Georgia.

(ii) *Other sources.* Any employer who possesses or uses radiation sources other than source material, byproduct material, or special nuclear material, as defined in the Atomic Energy Act of 1954, as amended (42 U.S.C. 2011 et seq.), and has either registered such sources with, or is operating under a license issued by a State which has an agreement in effect with the Atomic Energy Commission pursuant to section 274(b) (42 U.S.C. 2021(b)) of the Atomic Energy Act of 1954, as amended, and in accordance with the requirements of that State's laws and regulations shall be deemed to be in compliance with the radiation requirements of this section, insofar as his possession and use of such material is concerned, provided the State's program for control of these radiation sources is the subject of a currently effective determination by the Assistant Secretary of Labor that such program is compatible with the requirements of this section. Such determinations currently are in effect only in the States of Alabama, Arkansas, California, Kansas, Kentucky, Florida, Mississippi, New Hampshire, New York, North Carolina, Texas, Tennessee, Oregon, Idaho, Arizona, Colorado, Louisiana, Nebraska, Washington, Maryland, North Dakota, South Carolina, and Georgia.

(q) [Reserved]

(r) *Radiation standards for mining.* (1) For the purpose of this paragraph, a "working level" is defined as any combination of radon daughters in 1 liter of air which will result in the ultimate emission of 1.3×10^5 million electron volts of potential alpha energy. The numerical value of the "working level" is derived from the alpha energy released by the total decay of short-lived radon daughter products in equilibrium with 100 picocuries of radon 222 per liter of air. A working level month is defined as the exposure received by a worker breathing air at one working level concentration for 4⅓ weeks of 40 hours each.

(2) Occupational exposure to radon daughters in mines shall be controlled so that no individual will receive an exposure of more than 2 working level months in any calendar quarter and no more than 4 working level months in any calendar year. Actual exposures shall be kept as far below these values as practicable.

(3)(i) For uranium mines, records of environmental concentrations in the occupied parts of the mine, and of the time spent in each area by each person involved in an underground work shall be established and maintained. These records shall be in sufficient detail to permit calculations of the exposures, in units of working level months, of the individuals and shall be available for inspection by the Secretary of Labor or his authorized agents.

(ii) For other than uranium mines and for surface workers in all mines, subdivision (i) of this subparagraph will be applicable: *Provided, however,* That if no environmental sample shows a concentration greater than 0.33 working level in any occupied part of the mine, the maintenance of individual occupancy records and the calculation of individual exposures will not be required.

(4)(i) At the request of an employee (or former employee) a report of the employee's exposure to radiation as shown in records maintained by the employer pursuant to subparagraph (3) of this paragraph, shall be furnished to him. The report shall be in writing and contain the following statement:

> This report is furnished to you under the provisions of the U.S. Department of Labor, Ionizing Radiation Safety and Health Standards (29 CFR 1910.96(q)). You should preserve this report for future reference.

(ii) The former employee's request should include appropriate identifying data, such as social security number and dates and locations of employment.

§ 1910.97 Nonionizing radiation.

(a) *Electromagnetic radiation—(1) Definitions applicable to this paragraph.* (i) The term "electromagnetic radiation" is restricted to that portion of the spectrum commonly defined as the radio frequency region, which for the purpose of this specification shall include the microwave frequency region.

(ii) *Partial body irradiation.* Pertains to the case in which part of the body is exposed to the incident electromagnetic energy.

(iii) *Radiation protection guide.* Radiation level which should not be exceeded without careful consideration of the reasons for doing so.

(iv) The word "symbol" as used in this specification refers to the overall design, shape, and coloring of the rf radiation sign shown in figure G–11.

(v) *Whole body irradiation.* Pertains to the case in which the entire body is exposed to the incident electromagnetic energy or in which the cross section of the body is smaller than the cross section of the incident radiation beam.

(2) *Radiation protection guide.* (i) For normal environmental conditions and for incident electromagnetic energy of frequencies from 10 MHz to 100 GHz, the

radiation protection guide is 10 mW/cm.² (milliwatt per square centimeter) as averaged over any possible 0.1-hour period. This means the following:

Power density: 10 mW./cm.² for periods of 0.1-hour or more.
Energy density: 1 mW.-hr./cm.² (milliwatt hour per square centimeter) during any 0.1-hour period.

This guide applies whether the radiation is continuous or intermittent.

(ii) These formulated recommendations pertain to both whole body irradiation and partial body irradiation. Partial body irradiation must be included since it has been shown that some parts of the human body (e.g., eyes, testicles) may be harmed if exposed to incident radiation levels significantly in excess of the recommended levels.

(3) *Warning symbol.* (i) The warning symbol for radio frequency radiation hazards shall consist of a red isosceles triangle above an inverted black isosceles triangle, separated and outlined by an aluminum color border. The words "Warning—Radio-Frequency Radiation Hazard" shall appear in the upper triangle. See figure G–11.

(ii) American National Standard Safety Color Code for Marking Physical Hazards and the Identification of Certain Equipment, Z53.1–1953, shall be used for color specification. All lettering and the border shall be of aluminum color.

(iii) The inclusion and choice of warning information or precautionary instructions is at the discretion of the user. If such information is included it shall appear in the lower triangle of the warning symbol.

1. Place handling and mounting instructions on reverse side.
2. D = Scaling unit.
3. Lettering: Ratio of letter height to thickness of letter lines.

Upper triangle :	5 to 1	Large
	6 to 1	Medium
Lower triangle	4 to 1	Small
	6 to 1	Medium

4. Symbol is square, triangles are right-angle isosceles.

Fig. G-11
Radio-Frequency Radiation Hazard Warning Symbol

§ 1910.98 Additional delay in effective date.

The requirements of this Subpart G shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart upon the commencement of the Walsh-Healey requirement.

§ 1910.99 Sources of standards.

Section	Source
1910.93	41 CFR 50–204.50, except for Table G–2, the source of which is American National Standards Institute, Z37 series.
1910.94(a)	ANSI N2.3–1967, Immediate and Safe Practices, of Abrasive Blasting Operations.
1910.94(b)	ANSI Z43.1–966, Ventilation Control of Grinding, Polishing, and Buffing Operations.
1910.94(c)	ANSI Z9.3–1970, Safety Code for the Design, Construction and Ventilation of Spray Finishing Operations.
1910.94(d)	ANSI Z9.1–1969, Safety Code for Ventilation and Operation of Open-Surface Tanks.
1910.95	41 CFR 50–204.10.
1910.96 (a) through (e) and (g) through (r).	41 CFR 50–204.20.
1910.96(f)	ANSI N2.3–1967, Immediate Evacuation Signal for Use in Industrial Installations Where Radiation Exposure May Occur.
1910.97	ANSI C95.1–1966, Safety Level of Electromagnetic Radiation with Respect to Personnel and American National Standards Institute C95.2–1966, Radio Frequency Radiation Hazard and Warning Signal.

§ 1910.100 Standards organizations.

Specific standards of the following organizations have been referenced in this subpart. Copies of the standards may be obtained from the issuing organization.

American Conference of Governmental Industrial Hygienists, 1014 Broadway, Cincinnati, OH 45202.
American National Standards Institute, 1430 Broadway, New York, NY 10018.
National Fire Protection Association, 60 Batterymarch Street, Boston, MA 02110.

Subpart H—Hazardous Materials

§ 1910.101 Compressed gases (general requirements).

(a) *Inspection of compressed gas cylinders.* Each employer shall determine that compressed gas cylinders under his control are in a safe condition to the extent that this can be determined by visual inspection. Visual and other inspections shall be conducted as pre-

scribed in the Hazardous Materials Regulations of the Department of Transportation (49 CFR Parts 171–179 and 14 CFR Part 103). Where those regulations are not applicable, visual and other inspections shall be conducted in accordance with Compressed Gas Association Pamphlets C–6–1968 and C–8–1962.

(b) *Compressed gases.* The in-plant handling, storage, and utilization of all compressed gases in cylinders, portable tanks, rail tankcars, or motor vehicle cargo tanks shall be in accordance with Compressed Gas Association Pamphlet P–1–1965.

(c) *Safety relief devices for compressed gas containers.* Compressed gas cylinders, portable tanks, and cargo tanks shall have pressure relief devices installed and maintained in accordance with Compressed Gas Association Pamphlets S–1.1–1963 and 1965 addenda and S–1.2–1963.

§ 1910.102 Acetylene.

(a) *Cylinders.* The in-plant transfer, handling, storage, and utilization of acetylene in cylinders shall be in accordance with Compressed Gas Association Pamphlet G–1–1966.

(b) *Piped systems.* The piped systems for the inplant transfer and distribution of acetylene shall be designed, installed, maintained, and operated in accordance with Compressed Gas Association Pamphlet G–1.3–1959.

(c) *Generators and filling cylinders.* Plants for the generation of acetylene and the charging (filling) of acetylene cylinders shall be designed, constructed, and tested in accordance with the standards prescribed in Compressed Gas Association Pamphlet G–1.4–1966.

§ 1910.103 Hydrogen.

(a) *General*—(1) *Definitions.* As used in this section (i) Gaseous hydrogen system is one in which the hydrogen is delivered, stored and discharged in the gaseous form to consumer's piping. The system includes stationary or movable containers, pressure regulators, safety relief devices, manifolds, interconnecting piping and controls. The system terminates at the point where hydrogen at service pressure first enters the consumer's distribution piping.

(ii) Approved—Means unless otherwise indicated listed or approved by the following nationally recognized testing laboratories: Underwriters Laboratories, Inc., and Factory Mutual Engineering Corp.

(iii) Listed—See "approved".

(iv) ASME—American Society of Mechanical Engineers.

(v) DOT Specifications—Regulations of the Department of Transportation published in 49 CFR Chapter I.

(vi) DOT regulations—See § 1910.103 (a)(1)(v).

(2) *Application.* The in-plant transfer, handling, storage, and utilization of hydrogen shall be in accordance with Compressed Gas Association Pamphlets G–5.1–1961 and G–5.2–1966.

(b) *Gaseous hydrogen systems*—(1) *Design.*

(i) *Containers.* (*a*) Hydrogen containers shall comply with one of the following:

(*1*) Designed, constructed, and tested in accordance with appropriate requirements of ASME Boiler and Pressure Vessel Code, Section VIII—Unfired Pressure Vessels—1968.

(*2*) Designed, construction, tested and maintained in accordance with U.S. Department of Transportation Specifications and Regulations.

(*b*) Permanently installed containers shall be provided with substantial noncombustible supports on firm noncombustible foundations.

(*c*) Each portable container shall be legibly marked with the name "Hydrogen" in accordance with "Marking Portable Compressed Gas Containers to Identify the Material Contained" ANSI Z48.1—1954. Each manifolded hydrogen supply unit shall be legibly marked with the name Hydrogen or a legend such as "This unit contains hydrogen."

(ii) *Safety relief devices.* (*a*) Hydrogen containers shall be equipped with safety relief devices as required by the ASME Boiler and Pressure Vessel Code, Section VIII Unfired Pressure Vessels, 1968 or the DOT Specification and Regulations under which the container is fabricated.

(*b*) Safety relief devices shall be arranged to discharge upward and unobstructed to the open air in such a manner as to prevent any impingement of escaping gas upon the container, adjacent structure of personnel. This requirement does not apply to DOT Specification containers having an internal volume of 2 cubic feet or less.

(*c*) Safety relief devices or vent piping shall be designed or located so that moisture cannot collect and freeze in a manner which would interfere with proper operation of the device.

(iii) *Piping, tubing, and fittings.*—(*a*) Piping, tubing, and fittings shall be suitable for hydrogen service and for the pressures and temperatures involved. Cast iron pipe and fittings shall not be used.

(*b*) Piping and tubing shall conform to Section 2—"Industrial Gas and Air Piping"—Code for Pressure Piping, ANSI B31.1–1967 with addenda B31.1–1969.

(*c*) Joints in piping and tubing may be made by welding or brazing or by use of flanged, threaded, socket, or compression fittings. Gaskets and thread sealants shall be suitable for hydrogen service.

(iv) *Equipment assembly.* (*a*) Valves, gauges, regulators, and other accessories shall be suitable for hydrogen service.

(*b*) Installation of hydrogen systems shall be supervised by personnel familiar with proper practices with reference to their construction and use.

(*c*) Storage containers, piping, valves, regulating equipment, and other accessories shall be readily accessible, and shall be protected against physical damage and against tampering.

(*d*) Cabinets or housings containing hydrogen control or operating equipment shall be adequately ventilated.

(*e*) Each mobile hydrogen supply unit used as part of a hydrogen system shall be adequately secured to prevent movement.

(*f*) Mobile hydrogen supply units shall be electrically bonded to the system before discharging hydrogen.

(v) *Marking.* The hydrogen storage location shall be permanently placarded as follows: "HYDROGEN—FLAMMABLE GAS—NO SMOKING—NO OPEN FLAMES," or equivalent.

(vi) *Testing.* After installations, all piping, tubing, and fittings shall be tested and proved hydrogen gas tight at maximum operating pressure.

(2) *Location*—(i) *General.* (*a*) The system shall be located so that it is readily accessible to delivery equipment and to authorized personnel.

(*b*) Systems shall be located above ground.

(*c*) Systems shall not be located beneath electric power lines.

(*d*) Systems shall not be located close to flammable liquid piping or piping of other flammable gases.

(*e*) Systems near aboveground flammable liquid storage shall be located on ground higher than the flammable liquid storage except when dikes, diversion curbs, grading, or separating solid walls are used to prevent accumulation of flammable liquids under the system.

(ii) *Specific requirements.* (*a*) The location of a system, as determined by the maximum total contained volume of hydrogen, shall be in the order of preference as indicated by Roman numerals in Table H–1.

TABLE H–1

Nature of location	Size of hydrogen system		
	Less than 3,000 CF	3,000 CF to 15,000 CF	In excess of 15,000 CF
Outdoors	I	I	I.
In a separate building	II	II	II.
In a special room	III	III	Not permitted.
Inside buildings not in a special room and exposed to other occupancies.	IV	Not permitted.	Not permitted.

(*b*) The minimum distance in feet from a hydrogen system of indicated capacity located outdoors, in separate buildings or in special rooms to any specified outdoor exposure shall be in accordance with Table H–2.

(*c*) The distances in Table H–2 Items 1, 14, and 3 to 10 inclusive do not apply where protective structures such as adequate fire walls are located between the system and the exposure.

TABLE H-2

	Type of outdoor exposure	Size of hydrogen system: Less than 3,000 CF	3,000 CF to 15,000 CF	In excess of 15,000 CF
1. Building or structure	Wood frame construction*	10	25	50
	Heavy timber, noncombustible or ordinary construction*	0	10	**25
	Fire-resistive construction*	0	0	0
2. Wall openings	Not above any part of a system	10	10	10
	Above any part of a system	25	25	25
3. Flammable liquids above ground.	0 to 1,000 gallons	10	25	25
	In excess of 1,000 gallons	25	50	50
4. Flammable liquids below ground—0 to 1,000 gallons.	Tank	10	10	10
	Vent or fill opening of tank	25	25	25
5. Flammable liquids below ground—in excess of 1,000 gallons.	Tank	20	20	20
	Vent or fill opening of tank	25	25	25
6. Flammable gas storage, either high pressure or low pressure.	0 to 15,000 CF capacity	10	25	25
	In excess of 15,000 CF capacity	25	50	50
7. Oxygen storage	12,000 CF or less	Refer to NFPA No. 51, gas systems for welding and cutting (1969).		
	More than 12,000 CF	Refer to NFPA No. 566, bulk oxygen systems at consumer sites (1969).		
8. Fast burning solids such as ordinary lumber, excelsior or paper		50	50	25
9. Slow burning solids such as heavy timber or coal		25	25	25
10. Open flames and other sources of ignition		25	25	50
11. Air compressor intakes or inlets to ventilating or air-conditioning equipment		50	50	50
12. Concentration of people***		25	50	50
13. Public sidewalks		15	15	15
14. Line of adjoining property which may be built upon		5	5	5

*Refer to NFPA No. 220 standard types of building construction for definitions of various types of construction. (1969 Ed.)
**But not less than one-half the height of adjacent side wall of the structure.
***In congested areas such as offices, lunchrooms, locker rooms, time-clock areas, and places of public assembly.

(*d*) Hydrogen systems of less than 3,000 CF when located inside buildings and exposed to other occupancies shall be situated in the building so that the system will be as follows:

(*1*) In an adequately ventilated area as in subparagraph (3) (ii) (*b*) of this paragraph.

(2) Twenty feet from stored flammable materials or oxidizing gases.

(3) Twenty-five feet from open flames, ordinary electrical equipment or other sources of ignition.

(*4*) Twenty-five feet from concentrations of people.

(5) Fifty feet from intakes of ventilation or air-conditioning equipment and air compressors.

(*6*) Fifty feet from other flammable gas storage.

(7) Protected against damage or injury due to falling objects or working activity in the area.

(*8*) More than one system of 3,000 CF or less may be installed in the same room, provided the systems are separated by at least 50 feet. Each such system shall meet all of the requirements of this paragraph.

(3) *Design consideration at specific locations*—(i) *Outdoor locations.* (*a*) Where protective walls or roofs are provided, they shall be constructed of noncombustible materials.

(*b*) Where the enclosing sides adjoin each other, the area shall be properly ventilated.

(*c*) Electrical equipment within 15 feet shall be in accordance with subpart S of this part.

(ii) *Separate buildings.* (*a*) Separate buildings shall be built of at least noncombustible construction. Windows and doors shall be located so as to be readily accessible in case of emergency. Windows shall be of glass or plastic in metal frames.

(*b*) Adequate ventilation to the outdoors shall be provided. Inlet openings shall be located near the floor in exterior walls only. Outlet openings shall be located at the high point of the room in exterior walls or roof. Inlet and outlet openings shall each have minimum total area of one (1) square foot per 1,000 cubic feet of room volume. Discharge from outlet openings shall be directed or conducted to a safe location.

(*c*) Explosion venting shall be provided in exterior walls or roof only. The venting area shall be equal to not less than 1 square foot per 30 cubic feet of room volume and may consist of any one or any combination of the following: walls of light noncombustible material, preferably single thickness, single strength glass; lightly fastened hatch covers; lightly fastened swinging doors in exterior walls opening outward; lightly fastened walls or roof designed to relieve at a maximum pressure of 25 pounds per square foot.

(*d*) There shall be no sources of ignition from open flames, electrical equipment, or heating equipment.

(*e*) Electrical equipment shall be in accordance with subpart S of this part for Class I, Division 2 locations.

(*f*) Heating, if provided, shall be by steam, hot water, or other indirect means.

(iii) *Special rooms.* (*a*) Floor, walls, and ceiling shall have a fire-resistance rating of at least 2 hours. Walls or partitions shall be continuous from floor to ceiling and shall be securely anchored. At least one wall shall be an exterior wall. Openings to other parts of the building shall not be permitted. Windows and doors shall be in exterior walls and shall be located so as to be readily accessible in case of emergency. Windows shall be of glass or plastic in metal frames.

(*b*) Ventilation shall be as provided in subdivision (ii) (*b*) of this subparagraph.

(*c*) Explosion venting shall be as provided in subdivision (ii) (*c*) of this subparagraph.

(*d*) There shall be no sources of ignition from open flames, electrical equipment, or heating equipment.

(*e*) Electrical equipment shall be in accordance with Article 501 of the National Electrical Code, NFPA 70–1968, for Class I Division 2 locations.

(*f*) Heating, if provided, shall be by steam, hot water, or indirect means.

(4) *Operating instructions.* For installations which require any operation of equipment by the user, legible instructions shall be maintaind at operating locations.

(5) *Maintenance*—(i) *Inspection.* Each hydrogen system installed on consumer premises shall be periodically inspected and maintained by a qualified representative of the hydrogen supplier.

(ii) *Clear zone.* The area within 15 feet of any hydrogen container shall be kept free of dry vegetation and combustible material.

(c) *Liquefied hydrogen systems*—(1) *Design*—(i) *Containers.* (*a*) Hydrogen containers shall comply with the following: Storage containers shall be designed, constructed, and tested in accordance with appropriate requirements of the ASME Boiler and Pressure Vessel Code, Section VIII—Unfired Pressure Vessels (1968) or applicable provisions of API Standard 620, Recommended Rules for Design and Construction of Large, Welded, Low-Pressure Storage Tanks, Second Edition (June 1963) and Appendix R (April 1965).

(*b*) Portable containers shall be designed, constructed and tested in accordance with DOT Specifications and Regulations.

(ii) *Supports.* Permanently installed containers shall be provided with substantial noncombustible supports securely anchored on firm noncombustible foundations. Steel supports in excess of 18 inches in height shall be protected with a protective coating having a 2-hour fire-resistance rating.

(iii) *Marking.* Each container shall be legibly marked to indicate "LIQUEFIED HYDROGEN—FLAMMABLE GAS."

(iv) *Safety relief devices.* (*a*) (*1*) Stationary liquefied hydrogen containers shall be equipped with safety relief devices sized in accordance with CGA Pamphlet S–1, Part 3, Safety Relief Device Standards for Compressed Gas Storage Containers.

(2) Portable liquefied hydrogen containers complying with the U.S. Department of Transportation Regulations shall be equipped with safety relief devices as required in the U.S. Department of Transportation Specifications and Regulations. Safety relief devices shall

be sized in accordance with the requirements of CGA Pamphlet S–1, Safety Relief Device Standards, Part 1, Compressed Gas Cylinders and Part 2, Cargo and Portable Tank Containers.

(b) Safety relief devices shall be arranged to discharge unobstructed to the outdoors and in such a manner as to prevent impingement of escaping liquid or gas upon the container, adjacent structures or personnel. See subparagraph (2)(i)(f) of this paragraph for venting of safety relief devices in special locations.

(c) Safety relief devices or vent piping shall be designed or located so that moisture cannot collect and freeze in a manner which would interfere with proper operation of the device.

(d) Safety relief devices shall be provided in piping wherever liquefied hydrogen could be trapped between closures.

(v) *Piping, tubing, and fittings.* (a) Piping, tubing, and fittings and gasket and thread sealants shall be suitable for hydrogen service at the pressures and temperatures involved. Consideration shall be given to the thermal expansion and contraction of piping systems when exposed to temperature fluctuations of ambient to liquefied hydrogen temperatures.

(b) Gaseous hydrogen piping and tubing (above −20° F.) shall conform to the applicable sections of Pressure Piping Section 2—Industrial Gas and Air Piping, ANSI B31.1–1967 with addenda B31.1–1969. Design of liquefied hydrogen or cold (−20° F. or below) gas piping shall use Petroleum Refinery Piping ANSI B31.3–1966 or Refrigeration Piping ANSI B31.5–1966 with addenda B31.5a–1968 as a guide.

(c) Joints in piping and tubing shall preferably be made by welding or brazing; flanged, threaded, socket, or suitable compression fittings may be used.

(d) Means shall be provided to minimize exposure of personnel to piping operating at low temperatures and to prevent air condensate from contacting piping, structural members, and surfaces not suitable for cryogenic temperatures. Only those insulating materials which are rated nonburning in accordance with ASTM Procedures D1692–68 may be used. Other protective means may be used to protect personnel. The insulation shall be designed to have a vapor-tight seal in the outer covering to prevent the condensation of air and subsequent oxygen enrichment within the insulation. The insulation material and outside shield shall also be of adequate design to prevent attrition of the insulation due to normal operating conditions.

(e) Uninsulated piping and equipment which operate at liquefied-hydrogen temperature shall not be installed above asphalt surfaces or other combustible materials in order to prevent contact of liquid air with such materials. Drip pans may be installed under uninsulated piping and equipment to retain and vaporize condensed liquid air.

(vi) *Equipment assembly.* (a) Valves, gauges, regulators, and other accessories shall be suitable for liquefied hydrogen service and for the pressures and temperatures involved.

(b) Installation of liquefied hydrogen systems shall be supervised by personnel familiar with proper practices and with reference to their construction and use.

(c) Storage containers, piping, valves, regulating equipment, and other accessories shall be readily accessible and shall be protected against physical damage and against tampering. A shutoff valve shall be located in liquid product withdrawal lines as close to the container as practical. On containers of over 2,000 gallons capacity, this shutoff valve shall be of the remote control type with no connections, flanges, or other appurtenances (other than a welded manual shutoff valve) allowed in the piping between the shutoff valve and its connection to the inner container.

(d) Cabinets or housings containing hydrogen control equipment shall be ventilated to prevent any accumulation of hydrogen gas.

(vii) *Testing.* (a) After installation, all field-erected piping shall be tested and proved hydrogen gas-tight at operating pressure and temperature.

(b) Containers if out of service in excess of 1 year shall be inspected and tested as outlined in (a) of this subdivision. The safety relief devices shall be checked to determine if they are operable and properly set.

(viii) *Liquefied hydrogen vaporizers.* (a) The vaporizer shall be anchored and its connecting piping shall be sufficiently flexible to provide for the effect of expansion and contraction due to temperature changes.

(b) The vaporizer and its piping shall be adequately protected on the hydrogen and heating media sections with safety relief devices.

(c) Heat used in a liquefied hydrogen vaporizer shall be indirectly supplied utilizing media such as air, steam, water, or water solutions.

(d) A low temperature shutoff switch shall be provided in the vaporizer discharge piping to prevent flow of liquefied hydrogen in the event of the loss of the heat source.

(ix) *Electrical systems.* (a) Electrical wiring and equipment located within 3 feet of a point where connections are regularly made and disconnected, shall be in accordance with subpart S of this part, for class I, group B, division 1 locations.

(b) Except as provided in (a) of this subdivision, electrical wiring, and equipment located within 25 feet of a point where connections are regularly made and disconnected or within 25 feet of a liquid hydrogen storage container, shall be in accordance with subpart S of this part, for class I, group B, division 2 locations. When equipment approved for class I, group B atmospheres is not commercially available, the equipment may be—

(1) Purged or ventilated in accordance with NFPA No. 496–1967, Standard for Purged Enclosures for Electrical Equipment in Hazardous Locations,

(2) Intrinsically safe, or

(3) Approved for class I, group C atmospheres. This requirement does not apply to electrical equipment which is installed on mobile supply trucks or tank cars from which the storage container is filled.

(x) *Bonding and grounding.* The liquefied hydrogen container and associated piping shall be electrically bonded and grounded.

(2) *Location of liquefied hydrogen storage*—(i) *General requirements.* (a) The storage containers shall be located so that they are readily accessible to mobile supply equipment at ground level and to authorized personnel.

(b) The containers shall not be exposed by electric power lines, flammable liquid lines, flammable gas lines, or lines carrying oxidizing materials.

(c) When locating liquified hydrogen storage containers near above-ground flammable liquid storage or liquid oxygen storage, it is advisable to locate the liquefied hydrogen container on ground higher than flammable liquid storage or liquid oxygen storage.

(d) Where it is necessary to locate the liquefied hydrogen container on ground that is level with or lower than adjacent flammable liquid storage or liquid oxygen storage, suitable protective means shall be taken (such as by diking, diversion, curbs, grading), with respect to the adjacent flammable liquid storage or liquid oxygen storage, to prevent accumulation of liquids within 50 feet of the liquefied hydrogen container.

(e) Storage sites shall be fenced and posted to prevent entrance by unauthorized personnel. Sites shall also be placarded as follows: "Liquefied Hydrogen—Flammable Gas—No Smoking—No Open Flames."

(f) If liquified hydrogen is located in (as specified in Table H–3) a separate building, in a special room, or inside buildings when not in a special room and exposed to other occupancies, containers shall have the safety relief devices vented unobstructed to the outdoors at a minimum elevation of 25 feet above grade to a safe location as required in subparagraph (1)(iv)(b) of this paragraph.

(ii) *Specific requirements.* (a) The location of liquefied hydrogen storage, as determined by the maximum total quantity of liquified hydrogen, shall be in the order of preference as indicated by Roman numerals in the following Table H–3.

TABLE H-3—MAXIMUM TOTAL QUANTITY OF LIQUEFIED HYDROGEN STORAGE PERMITTED

Nature of location	Size of hydrogen storage (capacity in gallons)			
	39.63 (150 liters) to 50	51 to 300	301 to 600	In excess of 600
Outdoors	I	I	I	I.
In a separate building	II	II	II	Not permitted.
In a special room	III	III	Not permitted	Not permitted.
Inside buildings not in a special room and exposed to other occupancies.	IV	Not permitted	Not permitted	Not permitted.

NOTE: This table does not apply to the storage in dewars of the type generally used in laboratories for experimental purposes.

(*b*) The minimum distance in feet from liquefied hydrogen systems of indicated storage capacity located outdoors, in a separate building, or in a special room to any specified exposure shall be in accordance with Table H-4.

TABLE H-4—MINIMUM DISTANCE (FEET) FROM LIQUEFIED HYDROGEN SYSTEMS TO EXPOSURE

Type of exposure	Liquefied hydrogen storage (capacity in gallons)		
	39.63 (150 liters) to 3,500	3,501 to 15,000	15,001 to 30,000
1. Fire-resistive building and fire walls*	5	5	5
2. Noncombustible building*	25	50	75
3. Other buildings*	50	75	100
4. Wall openings, air-compressor intakes, inlets for air-conditioning or ventilating equipment	75	75	75
5. Flammable liquids (above ground and vent or fill openings if below ground) (see 513 and 514)	50	75	100
6. Between stationary liquefied hydrogen containers	5	5	5
7. Flammable gas storage	50	75	100
8. Liquid oxygen storage and other oxidizers (see 513 and 514)	100	100	100
9. Combustible solids	50	75	100
10. Open flames, smoking, and welding	50	50	50
11. Concentrations of people†	75	75	75
12. Public ways, railroads, and property lines	25	50	75

*Refer to standard types of building construction, NFPA No. 220-1969 for definitions of various types of construction.

†In congested areas such as offices, lunchrooms, locker rooms, time-clock areas, and places of public assembly.

NOTE 1: The distance in Nos. 2, 3, 5, 7, 9, and 12 in Table H-4 may be reduced where protective structures, such as firewalls equal to height of top of the container, to safeguard the liquefied hydrogen storage system, are located between the liquefied hydrogen storage installation and the exposure.

NOTE 2: Where protective structures are provided, ventilation and confinement of product should be considered. The 5-foot distance in Nos. 1 and 6 facilitates maintenance and enhances ventilation.

(iii) *Handling of liquefied hydrogen inside buildings other than separate buildings and special rooms.* Portable liquefied hydrogen containers of 50 gallons or less capacity as permitted in Table H-3 and in compliance with subdivision (i) (*f*) of this subparagraph when housed inside buildings not located in a special room and exposed to other occupancies shall comply with the following minimum requirements:

(*a*) Be located 20 feet from flammable liquids and readily combustible materials such as excelsior or paper.

(*b*) Be located 25 feet from ordinary electrical equipment and other sources of ignition including process or analytical equipment.

(*c*) Be located 25 feet from concentrations of people.

(*d*) Be located 50 feet from intakes of ventilation and air-conditioning equipment or intakes of compressors.

(*e*) Be located 50 feet from storage of other flammable-gases or storage of oxidizing gases.

(*f*) Containers shall be protected against damage or injury due to falling objects or work activity in the area.

(*g*) Containers shall be firmly secured and stored in an upright position.

(*h*) Welding or cutting operations, and smoking shall be prohibited while hydrogen is in the room.

(*i*) The area shall be adequately ventilated. Safety relief devices on the containers shall be vented directly outdoors or to a suitable hood. See subparagraph (1) (iv) (*b*) of this paragraph and subdivision (i) (*f*) of this subparagraph.

(3) *Design considerations at specific locations*—(i) *Outdoor locations.* (*a*) Outdoor location shall mean outside of any building or structure, and includes locations under a weather shelter or canopy provided such locations are not enclosed by more than two walls set at right angles and are provided with ventspace between the walls and vented roof or canopy.

(*b*) Roadways and yard surfaces located below liquefied hydrogen piping, from which liquid air may drip, shall be constructed of noncombustible materials.

(*c*) If protective walls are provided, they shall be constructed of noncombustible materials and in accordance with the provisions of subdivision (*a*) of this subdivision as applicable.

(*d*) Electrical wiring and equipment shall comply with subparagraph (1) (ix) (*a*) and (*b*) of this paragraph.

(*e*) Adequate lighting shall be provided for nighttime transfer operation.

(ii) *Separate buildings.* (*a*) Separate buildings shall be of light noncombustible construction on a substantial frame. Walls and roofs shall be lightly fastened and designed to relieve at a maximum internal pressure of 25 pounds per square foot. Windows shall be of shatterproof glass or plastic in metal frames. Doors shall be located in such a manner that they will be readily accessible to personnel in an emergency.

(*b*) Adequate ventilation to the outdoors shall be provided. Inlet openings shall be located near the floor level in exterior walls only. Outlet openings shall be located at the high point of the room in exterior walls or roof. Both the inlet and outlet vent openings shall have a minimum total area of 1 square foot per 1,000 cubic feet of room volume. Discharge from outlet openings shall be directed or conducted to a safe location.

(*c*) There shall be no sources of ignition.

(*d*) Electrical wiring and equipment shall comply with subparagraph (1) (ix) (*a*) and (*b*) of this paragraph except that the provisions of subparagraph (i) (ix) (*b*) of this paragraph shall apply to all electrical wiring and equipment in the separate building.

(*e*) Heating, if provided, shall be by steam, hot water, or other indirect means.

(iii) *Special rooms.* (*a*) Floors, walls, and ceilings shall have a fire resistance rating of at least 2 hours. Walls or partitions shall be continuous from floor to ceiling and shall be securely anchored. At least one wall shall be an exterior wall. Openings to other parts of the building shall not be permitted. Windows and doors shall be in exterior walls and doors shall be located in such a manner that they will be accessible in an emergency. Windows shall be of shatterproof glass or plastic in metal frames.

(*b*) Ventilation shall be as provided in subdivision (ii) (*b*) of this subparagraph.

(*c*) Explosion venting shall be provided in exterior walls or roof only. The venting area shall be equal to not less than 1 square foot per 30 cubic feet of room volume and may consist of any one or any combination of the following: walls of light noncombustible material; lightly fastened hatch covers; lightly fastened swinging doors opening outward in exterior walls; lightly fastened walls or roofs designed to relieve at a maximum pressure of 25 pounds per square foot.

(*d*) There shall be no sources of ignition.

(*e*) Electrical wiring and equipment shall comply with subparagraph (1) (ix) (*a*) and (*b*) of this paragraph except that the provision of subparagraph (1) (ix) (*b*) of this paragraph shall apply to all electrical wiring and equipment in the special room.

(*f*) Heating, if provided, shall be steam, hot water, or by other indirect means.

(4) *Operating instructions*—(i) *Written instructions.* For installation which require any operation of equipment by the user, legible instructions shall be maintained at operating locations.

(ii) *Attendant.* A qualified person shall be in attendance at all times while the mobile hydrogen supply unit is being unloaded.

(iii) *Security.* Each mobile liquefied hydrogen supply unit used as part of a hydrogen system shall be adequately secured to prevent movement.

(iy) *Grounding.* The mobile liquefied hydrogen supply unit shall be grounded for static electricity.

(5) *Maintenance*—(i) Inspection. Each liquefied hydrogen system installed on consumer premises shall be periodically inspected and maintained by a qualified representative of the equipment owner.

(ii) *Clear Zone.* Weeds or similar combustibles shall not be permitted within 25 feet of any liquefied hydrogen equipment.

SOURCE: NFPA 50B–1968

§ 1910.104 Oxygen.

(a) *General.* The in-plant transfer, handling, storage, and utilization of oxygen as a liquid or a compressed gas shall be in accordance with Compressed Gas Association Pamphlet G–4–1962. (Source: 41 CFR 50–204.67.)

(b) *Bulk oxygen systems.*—(1) *Definition.* As used in this section: A bulk oxygen system is an assembly of equipment, such as oxygen storage containers, pressure regulators, safety devices, vaporizers, manifolds, and interconnecting piping, which has storage capacity of more than 13,000 cubic feet of oxygen, Normal Temperature and Pressure (NTP), connected in service or ready for service, or more than 25,000 cubic feet of oxygen (NTP) including unconnected reserves on hand at the site. The bulk oxygen system terminates at the point where oxygen at service pressure first enters the supply line. The oxygen containers may be stationary or movable, and the oxygen may be stored as gas or liquid.

(2) *Location*—(i) *General.* Bulk oxygen storage systems shall be located above ground out of doors, or shall be installed in a building of noncombustible construction, adequately vented, and used for that purpose exclusively. The location selected shall be such that containers and associated equipment shall not be exposed by electric power lines, flammable or combustible liquid lines, or flammable gas lines.

(ii) *Accessibility.* The system shall be located so that it is readily accessible to mobile supply equipment at ground level and to authorized personnel.

(iii) *Leakage.* Where oxygen is stored as a liquid, noncombustible surfacing shall be provided in an area in which any leakage of liquid oxygen might fall during operation of the system and filling of a storage container. For purposes of this paragraph, asphaltic or bituminous paving is considered to be combustible.

(iv) *Elevation.* When locating bulk oxygen systems near above-ground flammable or combustible liquid storage which may be either indoors or outdoors, it is advisable to locate the system on ground higher than the flammable or combustible liquid storage.

(v) *Dikes.* Where it is necessary to locate a bulk oxygen system on ground lower than adjacent flammable or combustible liquid storage suitable means shall be taken (such as by diking, diversion curbs, or grading) with respect to the adjacent flammable or combustible liquid storage to prevent accumulation of liquids under the bulk oxygen system.

(3) *Distance between systems and exposures*—(i) *General.* The minimum distance from any bulk oxygen storage container to exposures, measured in the most direct line except as indicated in subdivisions (vi) and (vii) of this subparagraph, shall be as indicated in subdivisions (ii) to (xix) of this subparagraph inclusive.

(ii) *Combustible structures.* Fifty feet from any combustible structures.

(iii) *Fire resistive structures.* Twenty-five feet from any structures with fire-resistive exterior walls or sprinklered buildings or other construction, but not less than one-half the height of adjacent side wall of the structure.

(iv) *Openings.* At least 10 feet from any opening in adjacent walls of fire resistive structures. Spacing from such structures shall be adequate to permit maintenance, but shall not be less than 1 foot.

(v) *Flammable liquid storage aboveground.*

Distance (feet)	*Capacity (gallons)*
50	0–1000
90	1001 or more

(vi) *Flammable liquid storage belowground.*

Distance measured horizontally from oxygen storage container to flammable liquid tank (feet)	Distance from oxygen storage container to filling and vent connections or openings to flammable liquid tank (feet)	Capacity gallons
15	50	0–1000.
30	50	1001 or more.

(vii) *Combustible liquid storage aboveground.*

Distance (feet)	*Capacity (gallons)*
25	0–1000
50	1001 or more

(viii) *Combustible liquid storage belowground.*

Distance measured horizontally from oxygen storage container to combustible liquid tank (feet)	*Distance from oxygen storage container to filling and vent connections or openings to combustible liquid tank (feet)*
15	40

(ix) *Flammable gas storage.* (Such as compressed flammable gases, liquefied flammable gases and flammable gases in low pressure gas holders):

Distance (feet)	*Capacity (cu. ft. NTP)*
50	Less than 5000
90	5000 or more

(x) *Highly combustible materials.* Fifty feet from solid materials which burn rapidly, such as excelsior or paper.

(xi) *Slow-burning materials.* Twenty-five feet from solid materials which burn slowly, such as coal and heavy timber.

(xii) *Ventilation.* Seventy-five feet in one direction and 35 feet in approximately 90° direction from confining walls (not including firewalls less than 20 feet high) to provide adequate ventilation in courtyards and similar confining areas.

(xiii) *Congested areas.* Twenty-five feet from congested areas such as offices, lunchrooms, locker rooms, time clock areas, and similar locations where people may congregate.

(xiv) *Public areas.* Fifty feet from places of public assembly.

(xv) *Patients.* Fifty feet from areas occupied by nonambulatory patients.

(xvi) *Sidewalks.* Ten feet from any public sidewalk.

(xvii) *Adjacent property.* Five feet from any line of adjoining property.

(xviii) *Exceptions.* The distances in subdivisions (ii), (iii), (v) to (xi) inclusive, (xvi), and (xvii) of this subparagraph do not apply where protective structures such as firewalls of adequate height to safeguard the oxygen storage systems are located between the bulk oxygen storage installation and the exposure. In such cases, the bulk oxygen storage installation may be a minimum distance of 1 foot from the firewall.

(4) *Storage containers*—(i) *Foundations and supports.* Permanently installed containers shall be provided with substantial noncombustible supports on firm noncombustible foundations.

(ii) *Construction—liquid.* Liquid oxygen storage containers shall be fabricated from materials meeting the impact test requirements of paragraph UG–84 of ASME Boiler and Pressure Vessel Code, Section VIII—Unfired Pressure Vessels—1968. Containers operating at pressures above 15 pounds per square inch gage (p.s.i.g.) shall be designed, constructed, and tested in accordance with appropriate requirements of ASME Boiler and Pressure Vessel Code, Section VII—Unfired Pressure Vessels—1968. Insulation surrounding the liquid oxygen container shall be noncombustible.

(iii) *Construction—gaseous.* High-pressure gaseous oxygen containers shall comply with one of the following:

(*a*) Designed, constructed, and tested in accordance with appropriate requirements of ASME Boiler and Pressure Vessel Code, Section VIII—Unfired Pressure Vessels—1968.

(*b*) Designed, constructed, tested, and maintained in accordance with DOT Specifications and Regulations.

(5) *Piping, tubing, and fittings*—(i) *Selection.* Piping, tubing, and fittings shall be suitable for oxygen service and for the pressures and temperatures involved.

(ii) *Specification.* Piping and tubing shall conform to Section 2—Gas and Air Piping Systems of Code for Pressure Piping, ANSI, B31.1–1967 with addenda B31.10a–1969.

(iii) *Fabrication.* Piping or tubing for operating temperatures below −20° F. shall be fabricated from materials meeting the impact test requirements of paragraph UG–84 of ASME Boiler and Pressure Vessel Code, Section VIII—Unfired Pressure Vessels—1968, when tested at the minimum operating temperature to which the piping may be subjected in service.

(6) *Safety relief devices*—(i) *General.* Bulk oxygen storage containers, regardless of design pressure shall be equipped with safety relief devices as re-

quired by the ASME code or the DOT specifications and regulations.

(ii) *DOT containers.* Bulk oxygen storage containers designed and constructed in accordance with DOT specification shall be equipped with safety relief devices as required thereby.

(iii) *ASME containers.* Bulk oxygen storage containers designed and construction in accordance with the ASME Boiler and Pressure Vessel Code, Section VIII—Unfired Pressure Vessel—1968 shall be equipped with safety relief devices meeting the provisions of the Compressed Gas Association Pamphlet "Safety Relief Device Standards for Compressed Gas Storage Containers," S–1, Part 3.

(iv) *Insulation.* Insulation casings on liquid oxygen containers shall be equipped with suitable safety relief devices.

(v) *Reliability.* All safety relief devices shall be so designed or located that moisture cannot collect and freeze in a manner which would interfere with proper operation of the device.

(7) *Liquid oxygen vaporizers*—(i) *Mounts and couplings.* The vaporizer shall be anchored and its connecting piping be sufficiently flexible to provide for the effect of expansion and contraction due to temperature changes.

(ii) *Relief devices.* The vaporizer and its piping shall be adequately protected on the oxygen and heating medium sections with safety relief devices.

(iii) *Heating.* Heat used in an oxygen vaporizer shall be indirectly supplied only through media such as steam, air, water, or water solutions which do not react with oxygen.

(iv) *Grounding.* If electric heaters are used to provide the primary source of heat, the vaporizing system shall be electrically grounded.

(8) *Equipment assembly and installation*—(i) *Cleaning.* Equipment making up a bulk oxygen system shall be cleaned in order to remove oil, grease or other readily oxidizable materials before placing the system in service.

(ii) *Joints.* Joints in piping and tubing may be made by welding or by use of flanged, threaded, slip, or compression fittings. Gaskets or threat sealants shall be suitable for oxygen service.

(iii) *Accessories.* Valves, gages, regulators, and other accessories shall be suitable for oxygen service.

(iv) *Installation.* Installation of bulk oxygen systems shall be supervised by personnel familiar with proper practices with reference to their construction and use.

(v) *Testing.* After installation all field erected piping shall be tested and proved gas tight at maximum operating pressure. Any medium used for testing shall be oil free and nonflammable.

(vi) *Security.* Storage containers, piping, valves, regulating equipment, and other accessories shall be protected against physical damage and against tampering.

(vii) *Venting.* Any enclosure containing oxygen control or operating equipment shall be adequately vented.

(viii) *Placarding.* The bulk oxygen storage location shall be permanently placarded to indicate: "OXYGEN—NO SMOKING—NO OPEN FLAMES", or an equivalent warning.

(ix) *Electrical wiring.* Bulk oxygen installations are not hazardous locations as defined and covered in subpart S of this part. Therefore, general purpose or weatherproof types of electrical wiring and equipment are acceptable depending upon whether the installation is indoors or outdoors. Such equipment shall be installed in accordance with the applicable provisions of subpart S of this part.

(9) *Operating instructions.* For installations which require any operation of equipment by the user, legible instructions shall be maintained at operating locations.

(10) *Maintenance* — (i) *Inspection.* Each bulk oxygen system installed on consumer premises shall be periodically inspected and maintained by a qualified representative of the oxygen supplier.

(ii) *Clear zone.* Weeds and long dry grass shall be cut back within 15 feet of any bulk oxygen storage container.

§ 1910.105 Nitrous oxide.

The piped systems for the in-plant transfer and distribution of nitrous oxide shall be designed, installed, maintained, and operated in accordance with Compressed Gas Association Pamphlet G–8–1964.

§ 1910.106 Flammable and combustible liquids.

(a) *Definitions.* As used in this section:

(1) Aerosol shall mean a material which is dispensed from its container as a mist, spray, or foam by a propellant under pressure.

(2) Atmospheric tank shall mean a storage tank which has been designed to operate at pressures from atmospheric through 0.5 p.s.i.g.

(3) Automotive service station shall mean that portion of property where flammable or combustible liquids used as motor fuels are stored and dispensed from fixed equipment into the fuel tanks of motor vehicles and shall include any facilities available for the sale and service of tires, batteries, and accessories, and for minor automotive maintenance work. Major automotive repairs, painting, body and fender work are excluded.

(4) Basement shall mean a story of a building or structure having one-half or more of its height below ground level and to which access for fire fighting purposes is unduly restricted.

(5) Boiling point shall mean the boiling point of a liquid at a pressure of 14.7 pounds per square inch absolute (p.s.i.a.) (760 mm.). Where an accurate boiling point is unavailable for the material in question, or for mixtures which do not have a constant boiling point, for purposes of this section the 10 percent point of a distillation performed in accordance with the Standard Method of Test for Distillation of Petroleum Products, ASTM D–86–62, may be used as the boiling point of the liquid.

(6) Boilover shall mean the expulsion of crude oil (or certain other liquids) from a burning tank. The light fractions of the crude oil burnoff producing a heat wave in the residue, which on reaching a water strata may result in the expulsion of a portion of the contents of the tank in the form of froth.

(7) Bulk plant shall mean that portion of a property where flammable or combustible liquids are received by tank vessel, pipelines, tank car, or tank vehicle, and are stored or blended in bulk for the purpose of distributing such liquids by tank vessel, pipeline, tank car, tank vehicle, or container.

(8) Chemical plant shall mean a large integrated plant or that portion of such a plant other than a refinery or distillery where flammable or combustible liquids are produced by chemical reactions or used in chemical reactions.

(9) Closed container shall mean a container as herein defined, so sealed by means of a lid or other device that neither liquid nor vapor will escape from it at ordinary temperatures.

(10) Crude petroleum shall mean hydrocarbon mixtures that have a flash point below 150° F. and which have not been processed in a refinery.

(11) Distillery shall mean a plant or that portion of a plant where flammable or combustible liquids produced by fermentation are concentrated, and where the concentrated products may also be mixed, stored, or packaged.

(12) Fire area shall mean an area of a building separated from the remainder of the building by construction having a fire resistance of at least 1 hour and having all communicating openings properly protected by an assembly having a fire resistance rating of at least 1 hour.

(13) Flammable aerosol shall mean an aerosol which is required to be labeled "Flammable" under the Federal Hazardous Substances Labeling Act (15 U.S.C. 1261). For the purposes of paragraph (d) of this section, such aerosols are considered Class IA liquids.

(14) Flashpoint of the liquid shall mean the temperature at which it gives off vapor sufficient to form an ignitable mixture with the air near the surface of the liquid or within the vessel used as determined by appropriate test procedure and apparatus as specified below.

(i) The flashpoint of liquids having a viscosity less than 45 SUS at 100° F. (37.8° C.) and a flashpoint below 175° F. (79.4° C.) shall be determined in accordance with the Standard Method of Test for Flashpoint by the Tag Closed Tester, ASTM D–56–69.

(ii) The flashpoint of liquids having a viscosity of 45 SUS or more at 100° F. (37.8° C.) or a flashpoint of 157° F. (79.4° C.) or higher shall be determined in accordance with the Standard Method of Test for Flashpoint by the Pensky Martens Closed Tester, ASTM D–93–69.

(15) Hotel shall mean buildings or groups of buildings under the same management in which there are sleeping accommodations for hire, primarily used by transients who are lodged with or

without meals including but not limited to inns, clubs, motels, and apartment hotels.

(16) Institutional occupancy shall mean the occupancy or use of a building or structure or any portion thereof by persons harbored or detained to receive medical, charitable or other care or treatment, or by persons involuntarily detained.

(17) Liquid shall mean, for the purpose of this section, any material which has a fluidity greater than that of 300 penetration asphalt when tested in accordance with ASTM Test for Penetration for Bituminous Materials, D–5–65. When not otherwise identified, the term liquid shall include both flammable and combustible liquids.

(18) Combustible liquids shall mean any liquid having a flashpoint at or above 140° F. (60° C.), and shall be known as Class III liquids. Class IIIA shall include those having flashpoints at or above 140° F. (60° C.) and below 200° F. (93.4° C.). Class IIIB shall include those having flashpoints at or above 200° F. (93.4° C.).

This section does not cover Class IIIB liquids. Where the term combustible liquids or Class III liquids is used in this section, it shall mean only Class IIIA liquids.

NOTE: The upper limit of 200° F. is given because the application of this section does not extend to liquids having flashpoints above 200° F. and should not be construed as indicating that liquids with higher flashpoints are noncombustible.

(19) Flammable liquids shall mean any liquid having a flashpoint below 140° F. and having a vapor pressure not exceeding 40 pounds per square inch (absolute) at 100° F.

(i) Flammable liquids shall be divided into two classes of liquids as follows:

(ii) Class I liquids shall include those having flashpoints below 100° F. and may be subdivided as follows:

(*a*) Class IA shall include those having flashpoints below 73° F. and having a boiling point below 100° F.

(*b*) Class IB shall include those having flashpoints below 73° F. and having a boiling point at or above 100° F.

(*c*) Class IC shall include those having flashpoints at or above 73° F. and below 100° F.

(iii) Class II liquids shall include those having flashpoints at or above 100° F. and below 140° F.

NOTE: The volatility of liquids is increased when artificially heated to temperatures equal to or higher than their flashpoints. When so heated Class II and III liquids shall be subject to the applicable requirements for Class I or II liquids. This section may also be applied to high flashpoint liquids when so heated even though these same liquids when not heated are outside of its scope.

(20) Unstable (reactive) liquid shall mean a liquid which in the pure state or as commercially produced or transported will vigorously polymerize, decompose, condense, or will become self-reactive under conditions of shocks, pressure, or temperature.

(21) Low-pressure tank shall mean a storage tank which has been designed to operate at pressures above 0.5 p.s.i.g. but not more than 15 p.s.i.g.

(22) Marine service station shall mean that portion of a property where flammable or combustible liquids used as fuels are stored and dispensed from fixed equipment on shore, piers, wharves, or floating docks into the fuel tanks of self-propelled craft, and shall include all facilities used in connection therewith.

(23) Mercantile occupancy shall mean the occupancy or use of a building or structure or any portion thereof for the displaying, selling, or buying of goods, wares, or merchandise.

(24) Office occupancy shall mean the occupancy or use of a building or structure or any portion thereof for the transaction of business, or the rendering or receiving of professional services.

(25) Portable tank shall mean a closed container having a liquid capacity over 60 U.S. gallons and not intended for fixed installation.

(26) Pressure vessel shall mean a storage tank or vessel which has been designed to operate at pressures above 15 p.s.i.g.

(27) Protection for exposure shall mean fire protection for structures on property adjacent to tanks. When acceptable to the authority having jurisdiction, such structures located (i) within the jurisdiction of any public fire department or (ii) within or adjacent to plants having private fire brigades shall be considered as having adequate protection for exposures.

(28) Refinery shall mean a plant in which flammable or combustible liquids are produced on a commercial scale from crude petroleum, natural gasoline, or other hydrocarbon sources.

(29) Safety can shall mean an approved container, of not more than 5 gallons capacity, having a spring-closing lid and spout cover and so designed that it will safely relieve internal pressure when subjected to fire explosure.

(30) Vapor pressure shall mean the pressure, measured in pounds per square inch (absolute) exerted by a volatile liquid as determined by the "Standard Method of Test for Vapor Pressure of Petroleum Products (Reid Method)," American Society for Testing and Materials ASTM D323–68.

(31) Ventilation as specified in this section is for the prevention of fire and explosion. It is considered adequate if it is sufficient to prevent accumulation of significant quantities of vapor-air mixtures in concentration over one-fourth of the lower flammable limit.

(32) Storage: Flammable or combustible liquids shall be stored in a tank or in a container that complies with paragraph (d)(2) of this section.

(33) Barrel shall mean a volume of 42 U.S. gallons.

(34) Container shall mean any can, barrel, or drum.

(35) Approved unless otherwise indicated, approved, or listed by at least one of the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

(36) Listed see "approved" in § 1910.106(a)(35).

(b) *Tank storage*—(1) *Design and construction of tanks*—(i) *Materials.* (*a*) Tanks shall be built of steel except as provided in (*b*) through (*e*) of this subdivision.

(*b*) Tanks may be built of materials other than steel for installation underground or if required by the properties of the liquid stored. Tanks located above ground or inside buildings shall be of noncombustible construction.

(*c*) Tanks built of materials other than steel shall be designed to specifications embodying principles recognized as good engineering design for the material used.

(*d*) Unlined concrete tanks may be used for storing flammable or combustible liquids having a gravity of 40° API or heavier. Concrete tanks with special lining may be used for other services provided the design is in accordance with sound engineering practice.

(*e*) Tanks may have combustible or noncombustible linings.

(*f*) Special engineering consideration shall be required if the specific gravity of the liquid to be stored exceeds that of water or if the tanks are designed to contain flammable or combustible liquids at a liquid temperature below 0° F.

(ii) *Fabrication.* (*a*) Tanks may be of any shape or type consistent with sound engineering design.

(*b*) Metal tanks shall be welded, riveted, and caulked, brazed, or bolted, or constructed by use of a combination of these methods. Filler metal used in brazing shall be nonferrous metal or an alloy having a melting point above 1000° F. and below that of the metal joined.

(iii) *Atmospheric tanks.* (*a*) Atmospheric tanks shall be built in accordance with acceptable good standards of design. Atmospheric tanks may be built in accordance with:

(*1*) Underwriters' Laboratories, Inc., Subjects No. 142, Standard for Steel Aboveground Tanks for Flammable and Combustible Liquids, 1968; No. 58, Standard for Steel Underground Tanks for Flammable and Combustible Liquids, Fifth Edition, December 1961; or No. 80, Standard for Steel Inside Tanks for Oil-Burner Fuel, September 1963.

(*2*) American Petroleum Institute Standards No. 12A, Specification for Oil Storage Tanks with Riveted Shells, Seventh Edition, September 1951, or No. 650, Welded Steel Tanks for Oil Storage, Third Edition, 1966.

(*3*) American Petroleum Institute Standards No. 12B, Specification for Bolted Production Tanks, Eleventh Edition, May 1958, and Supplement 1, March 1962; No. 12D, Specification for Large Welded Production Tanks, Seventh Edition, August 1957; or No. 12F, Specification for Small Welded Production Tanks, Fifth Edition, March 1961. Tanks built in accordance with these standards shall be used only as production tanks for storage of crude petroleum in oil-producing areas.

(b) Tanks designed for underground service not exceeding 2,500 gallons capacity may be used aboveground.

(c) Low-pressure tanks and pressure vessels may be used as atmospheric tanks.

(d) Atmospheric tanks shall not be used for the storage of a flammable or combustible liquid at a temperature at or above its boiling point.

(iv) *Low pressure tanks.* (a) The normal operating pressure of the tank shall not exceed the design pressure of the tank.

(b) Low-pressure tanks shall be built in accordance with acceptable standards of design. Low-pressure tanks may be built in accordance with:

(1) American Petroleum Institute Standard No. 620, Recommended Rules for the Design and Construction of Large, Welded, Low-Pressure Storage Tanks, Third Edition, 1966.

(2) The principles of the Code for Unfired Pressure Vessels, Section VIII of the ASME Boiler and Pressure Vessels Code, 1968.

(c) Atmospheric tanks built according to Underwriters' Laboratories, Inc., requirements in subdivision (iii)(a) of this subparagraph may be used for operating pressures not exceeding 1 p.s.i.g. and shall be limited to 2.5 p.s.i.g. under emergency venting conditions. Pressure vessels may be used as low-pressure tanks.

(v) *Pressure vessels.* (a) The normal operating pressure of the vessel shall not exceed the design pressure of the vessel.

(b) Pressure vessels shall be built in accordance with the Code for Unfired Pressure Vessels, Section VIII of the ASME Boiler and Pressure Vessel Code, 1968.

(vi) *Provisions for internal corrosion.* When tanks are not designed in accordance with the American Petroleum Institute, American Society of Mechanical Engineers, or the Underwriters' Laboratories, Inc.'s, standards, or if corrosion is anticipated beyond that provided for in the design formulas used, anticipated metal thickness or suitable protective coatings or linings shall be provided to compensate for the corrosion loss expected during the design life of the tank.

(2) *Installation of outside aboveground tanks.*—(i) *Location with respect to property lines and public ways.* (a) Every aboveground tank for the storage of flammable or combustible liquids, except those liquids with boil-over characteristics and unstable liquids, operating at pressures not in excess of 2.5 p.s.i.g. and equipped with emergency venting which will not permit pressures to exceed 2.5 p.s.i.g. shall be located in accordance with Table H–5.

(b) Every aboveground tank for the storage of flammable or combustible liquids, except those liquids with boil-over characteristics and unstable flammable or combustible liquids, operating at pressures exceeding 2.5 p.s.i.g. or equipped with emergency venting which will permit pressures to exceed 2.5 p.s.i.g. shall be located in accordance with Table H–6.

TABLE H–5

Type of tank	Protection	Minimum distance in feet from property line which may be built upon, including the opposite side of a public way	Minimum distance in feet from nearest side of any public way or from nearest important building and shall be not less than 5 feet
Floating roof	Protection for exposures.	½ times diameter of tank but need not exceed 90 ft.	⅙ times diameter of tank but need not exceed 30 ft.
	None	Diameter of tank but need not exceed 175 ft.	⅙ times diameter of tank but need not exceed 30 ft.
Vertical with weak roof to shell seam.	Approved foam or inerting system on the tank.	⅓ times diameter of tank but need not exceed 90 ft. and shall not be less than 5 ft.	⅙ times diameter of tank but need not exceed 30 ft.
	Protection for exposures.	Diameter of tank but, need not exceed 175 ft.	⅓ times diameter of tank but need not exceed 60 ft.
	None	2 times diameter of tank but need not exceed 350 ft.	⅔ times diameter of tank but need not exceed 60 ft.
Horizontal and vertical, with emergency relief venting to limit pressures to 2.5 p.s.i.g.	Approved inerting system on the tank or approved foam system on vertical tanks.	½ times Table H–9 but shall not be less than 5 ft.	½ times Table H–9.
	Protection for exposures.	Table H–9	Table H–9.
	None	2 times Table H–9	Table H–9.

TABLE H–6

Type of tank	Protection	Minimum distance in feet from property line which may be built upon, including the opposite side of a public way	Minimum distance in feet from nearest side of any public way or from nearest important building
Any type	Protection for exposures.	1½ times Table H–9 but shall not be less than 25 ft.	1½ times Table H–9 but shall not be less than 25 ft.
	None	3 times Table H–9 but shall not be less than 50 ft.	1½ times Table H–9 but shall not be less than 25 ft.

(c) Every aboveground tank for the storage of flammable or combustible liquids with boil-over characteristics shall be located in accordance with Table H–7.

TABLE H–7

Type of tank	Protection	Minimum distance in feet from property line which may be built upon, including the opposite side of a public way	Minimum distance in feet from nearest side of any public way or from nearest important building
Floating roof	Protection for exposures.	Diameter of tank but need not exceed 175 ft.	¼ times diameter of tank but need not exceed 60 ft.
	None	2 times diameter of tank but need not exceed 350 ft.	½ times diameter of tank but need not exceed 60 ft.
Fixed roof	Approved foam or inerting system.	Diameter of tank but need not exceed 175 ft.	⅓ times diameter of tank but need not exceed 60 ft.
	Protection for exposures.	2 times diameter of tank but need not exceed 350 ft.	⅔ times diameter of tank but need not exceed 120 ft.
	None	4 times diameter of tank but need not exceed 350 ft.	⅔ times diameter of tank but need not exceed 120 ft.

(d) Every aboveground tank for the storage of unstable liquids shall be located in accordance with Table H–8.

TABLE H–8

Type of tank	Protection	Minimum distance in feet from property line which may be built upon, including the opposite side of a public way	Minimum distance in feet from nearest side of any public way or from nearest important building
Horizontal and vertical tanks with emergency relief venting to permit pressure not in excess of 2.5 p.s.i.g.	Tank protected with any one of the following: Approved water spray, approved inerting, approved insulation and refrigeration, approved barricade.	See table H–9, but the distance may be not less than 25 ft.	Not less than 25 ft.
	Protection for exposures	2½ times Table H–9 but not less than 50 ft.	Not less than 50 ft.
	None	5 times table H–9 but not less than 100 ft.	Not less than 100 ft.
Horizontal and vertical tanks with emergency relief venting to permit pressure over 2.5 p.s.i.g.	Tank protected with any one of the following: Approved water spray, approved inerting, approved insulation and refrigeration, approved barricade.	2 times table H–9 but not less than 50 ft.	Not less than 50 ft.
	Protection for exposures	4 times table H–9 but not less than 100 ft.	Not less than 100 ft.
	None	8 times table H–9 but not less than 150 ft.	Not less than 150 ft.

(e) Reference minimum distances for use in Tables H–5 to H–8, inclusive.

TABLE H–9

Capacity tank gallons	Minimum distance in feet from property line which may be built upon, including the opposite side of a public way	Minimum distance in feet from nearest side of any public way or from nearest important building
275 or less	5	5
276 to 750	10	5
751 to 12,000	15	5
12,001 to 30,000	20	5
30,001 to 50,000	30	10
50,001 to 100,000	50	15
100,001 to 500,000	80	25
500,001 to 1,000,000	100	35
1,000,001 to 2,000,000	135	45
2,000,001 to 3,000,000	165	55
3,000,001 or more	175	60

(f) Where end failure or horizontal pressure tanks and vessels may expose property, the tank shall be placed with the longitudinal axis parallel to the nearest important exposure.

(ii) *Spacing (shell-to-shell) between aboveground tanks.* (a) The distance between any two flammable or combustible liquid storage tanks shall not be less than 3 feet.

(b) Except as provided in subdivision (c) of this subdivision, the distance between any two adjacent tanks shall not be less than one-sixth the sum of their diameters. When the diameter of one tank is less than one-half the diameter of the adjacent tank, the distance between the two tanks shall not be less than one-half the diameter of the smaller tank.

(c) Where crude petroleum in conjunction with production facilities are located in noncongested areas and have capacities not exceeding 126,000 gallons (3,000 barrels), the distance between such tanks shall not be less than 3 feet.

(d) Where unstable flammable or combustible liquids are stored, the distance between such tanks shall not be less than one-half the sum of their diameters.

(e) When tanks are compacted in three or more rows or in an irregular pattern, greater spacing or other means shall be provided so that inside tanks are accessible for firefighting purposes.

(f) The minimum separation between a liquefied petroleum gas container and a flammable or combustible liquid storage tank shall be 20 feet, except in the case of flammable or combustible liquid tanks operating at pressures exceeding 2.5 p.s.i.g. or equipped with emergency venting which will permit pressures to exceed 2.5 p.s.i.g. in which case the provisions of subdivisions (a) and (b) of this subdivision shall apply. Suitable means shall be taken to prevent the accumulation of flammable or combustible liquids under adjacent liquefied petroleum gas containers such as by diversion curbs or grading. When flammable or combustible liquid storage tanks are within a diked area, the liquefied petroleum gas containers shall be outside the diked area and at least 10 feet away from the centerline of the wall of the diked area. The foregoing provisions shall not apply when liquefied petroleum gas containers of 125 gallons or less capacity are installed adjacent to fuel oil supply tanks of 550 gallons or less capacity.

(iii) *Location of outside aboveground tanks with respect to important buildings on same property.* Every outside aboveground tank shall be separated from important buildings on the same property by distances not less than those specified in subdivisions (i) (a), (b), (c), and (d) of this subparagraph, whichever is applicable. The appropriate distance column in Tables H–5, H–6, H–7, H–8, or H–9, that shall be used shall be the one reading: "Minimum Distance in Feet from Nearest Side of Any Public Way or From Nearest Important Building."

(iv) *Normal venting for aboveground tanks.* (a) Atmospheric storage tanks shall be adequately vented to prevent the development of vacuum or pressure sufficient to distort the roof of a cone roof tank or exceeding the design pressure in the case of other atmospheric tanks, as a result of filling or emptying, and atmospheric temperature changes.

(b) Normal vents shall be sized either in accordance with: (1) the American Petroleum Institute Standard 2000 (1968), Venting Atmospheric and Low-Pressure Storage Tanks; or (2) other accepted standard; or (3) shall be at least as large as the filling or withdrawal connection, whichever is larger but in no case less than 1¼ inch nominal inside diameter.

(c) Low-pressure tanks and pressure vessels shall be adequately vented to prevent development of pressure or vacuum, as a result of filling or emptying and atmospheric temperature changes, from exceeding the design pressure of the tank or vessel. Protection shall also be provided to prevent overpressure from any pump discharging into the tank or vessel when the pump discharge pressure can exceed the design pressure of the tank or vessel.

(d) If any tank or pressure vessel has more than one fill or withdrawal connection and simultaneous filling or withdrawal can be made, the vent size shall be based on the maximum anticipated simultaneous flow.

(e) Unless the vent is designed to limit the internal pressure 2.5 p.s.i. or less, the outlet of vents and vent drains shall be arranged to discharge in such a manner as to prevent localized overheating of any part of the tank in the event vapors from such vents are ignited.

(f) Tanks and pressure vessels storing Class IA liquids shall be equipped with venting devices which shall be normally closed except when venting to pressure or vacuum conditions. Tanks and pressure storing Class IB and IC liquids shall be equipped with venting devices which shall be normally closed except when venting under pressure or vacuum conditions, or with approved flame arresters.

Exemption: Tanks of 3,000 bbls. capacity or less containing crude petroleum in crude-producing areas; and, outside aboveground atmospheric tanks under 1,000 gallons capacity containing other than Class IA flammable liquids may have open vents. (See subdivision (vi) (b) of this subparagraph.)

(g) Flame arresters or venting devices required in subdivision (f) of this subdivision may be omitted for Class IB and IC liquids where conditions are such that their use may, in case of obstruction, result in tank damage.

(v) *Emergency relief venting for fire exposure for aboveground tanks.* (a) Every aboveground storage tank shall have some form of construction or device that will relieve excessive internal pressure caused by exposure fires.

(b) In a vertical tank the construction referred to in subdivision (a) of this subdivision may take the form of a floating roof, lifter roof, a weak roof-to-shell seam, or other approved pressure relieving construction. The weak roof-to-shell seam shall be constructed to fail preferential to any other seam.

(c) Where entire dependence for emergency relief is placed upon pressure relieving devices, the total venting capacity of both normal and emergency vents shall be enough to prevent rupture of the shell or bottom of the tank if vertical, or if the shell or heads if horizontal. If unstable liquids are stored, the effects of heat or gas resulting from polymerization, decomposition, condensation, or self-reactivity shall be taken into account. The total capacity of both normal and emergency venting devices shall be not less than that derived from Table H–10 except as provided in subdivision (e) or (f) of this subdivision. Such device may be a self-closing manhole cover, or one using long bolts that permit the cover to lift under internal pressure, or an additional or larger relief valve or valves. The wetted area of the tank shall be calculated on the basis of 55 percent of the total exposed area of a sphere or spheroid, 75 percent of the total exposed area of a horizontal tank and the first 30 feet above grade of the exposed shell area of a vertical tank.

TABLE H-10—WETTED AREA VERSUS CUBIC FEET FREE AIR PER HOUR

(14.7 psia and 60° F.)

Square feet	CFH	Square feet	CFH	Square feet	CFH
20	21,100	200	211,000	1,000	524,000
30	31,600	250	239,000	1,200	557,000
40	42,100	300	265,000	1,400	587,000
50	52,700	350	288,000	1,600	614,000
60	63,200	400	312,000	1,800	639,000
70	73,700	500	354,000	2,000	662,000
80	84,200	600	392,000	2,400	704,000
90	94,800	700	428,000	2,800	742,000
100	105,000	800	462,000	and over	
120	126,000	900	493,000		
140	147,000	1,000	524,000		
160	168,000				
180	190,000				
200	211,000				

(*d*) For tanks and storage vessels designed for pressure over 1 p.s.i.g., the total rate of venting shall be determined in accordance with Table H-10, except that when the exposed wetted area of the surface is greater than 2,800 square feet, the total rate of venting shall be calculated by the following formula:

$$CFH = 1{,}107A^{0.82}$$

Where:

CFH = Venting requirement, in cubic feet of free air per hour.

A = Exposed wetted surface, in square feet.

NOTE: The foregoing formula is based on $Q = 21{,}000A^{0.82}$.

(*e*) The total emergency relief venting capacity for any specific stable liquid may be determined by the following formula:

$$\text{Cubic feet of free air per hour} = V\frac{1337}{L\sqrt{M}}$$

V = Cubic feet of free air per hour from Table II-6.

L = Latent heat of vaporization of specific liquid in B.t.u. per pound.

M = Molecular weight of specific liquids.

(*f*) The required airflow rate of subdivision (*c*) or (*e*) of this subdivision may be multiplied by the appropriate factor listed in the following schedule when protection is provided as indicated. Only one factor may be used for any one tank.

0.5 for drainage in accordance with subdivision (vii) (*b*) of this subparagraph for tanks over 200 square feet of wetted area.

0.3 for approved water spray.

0.3 for approved insulation.

0.15 for approved water spray with approved insulation.

(*g*) The outlet of all vents and vent drains on tanks equipped with emergency venting to permit pressures exceeding 2.5 p.s.i.g. shall be arranged to discharge in such a way as to prevent localized overheating of any part of the tank, in the event vapors from such vents are ignited.

(*h*) Each commercial tank venting device shall have stamped on it the opening pressure, the pressure at which the valve reaches the full open position, and the flow capacity at the latter pressure, expressed in cubic feet per hour of air at 60° F. and at a pressure of 14.7 p.s.i.a.

(*i*) The flow capacity of tank venting devices 12 inches and smaller in nominal pipe size shall be determined by actual test of each type and size of vent. These flow tests may be conducted by the manufacturer if certified by a qualified impartial observer, or may be conducted by an outside agency. The flow capacity of tank venting devices larger than 12 inches nominal pipe size, including manhole covers with long bolts or equivalent, may be calculated provided that the opening pressure is actually measured, the rating pressure and corresponding free orifice area are stated, the word "calculated" appears on the nameplate, and the computation is based on a flow coefficient of 0.5 applied to the rated orifice area.

(vi) *Vent piping for aboveground tanks.* (*a*) Vent piping shall be constructed in accordance with paragraph (c) of this section.

(*b*) Where vent pipe outlets for tanks storing Class I liquids are adjacent to buildings or public ways, they shall be located so that the vapors are released at a safe point outside of buildings and not less than 12 feet above the adjacent ground level. In order to aid their dispersion, vapors shall be discharged upward or horizontally away from closely adjacent walls. Vent outlets shall be located so that flammable vapors will not be trapped by eaves or other obstructions and shall be at least five feet from building openings.

(*c*) When tank vent piping is manifolded, pipe sizes shall be such as to discharge, within the pressure limitations of the system, the vapors they may be required to handle when manifolded tanks are subject to the same fire exposure.

(vii) *Drainage, dikes, and walls for aboveground tanks—(a) Drainage and diked areas.* The area surrounding a tank or a group of tanks shall be provided with drainage as in subdivision (*b*) of this subdivision, or shall be diked as provided in subdivision (*c*) of this subdivision, to prevent accidental discharge of liquid from endangering adjoining property or reaching waterways.

(*b*) *Drainage.* Where protection of adjoining property or waterways is by means of a natural or manmade drainage system, such systems shall comply with the following:

(*1*) A slope of not less than 1 percent away from the tank toward the drainage system shall be provided.

(*2*) The drainage system shall terminate in vacant land or other area or in an impounding basin having a capacity not smaller than that of the largest tank served. This termination area and the route of the drainage system shall be so located that, if the flammable or combustible liquids in the drainage system are ignited, the fire will not seriously expose tanks or adjoining property.

(*3*) The drainage system, including automatic drainage pumps, shall not discharge to adjoining property, natural water courses, public sewers, or public drains unless the discharge of flammable or combustible liquids would not constitute a hazard, or the system is so designed that it will not permit flammable or combustible liquids to be released.

(*c*) *Diked areas.* Where protection of adjoining property or waterways is accomplished by retaining the liquid around the tank by means of a dike, the volume of the diked area shall comply with the following requirements:

(*1*) Except as provided in subdivision (*2*) of this subdivision, the volumetric capacity of the diked area shall not be less than the greatest amount of liquid that can be released from the largest tank within the diked area, assuming a full tank. The capacity of the diked area enclosing more than one tank shall be calculated by deducting the volume of the tanks other than the largest tank below the height of the dike.

(*2*) For a tank or group of tanks with fixed roofs containing crude petroleum with boilover characteristics, the volumetric capacity of the diked area shall be not less than the capacity of the largest tank served by the enclosure, assuming a full tank. The capacity of the diked enclosure shall be calculated by deducting the volume below the height of the dike of all tanks within the enclosure.

(*3*) Walls of the diked area shall be of earth, steel, concrete or solid masonry designed to be liquidated and to withstand a full hydrostatic head. Earthen walls 3 feet or more in height shall have a flat section at the top not less than 2 feet wide. The slope of an earthen wall shall be consistent with the angle of repose of the material of which the wall is constructed.

(*4*) The walls of the diked area shall be restricted to an average height of 6 feet above interior grade.

(*5*) Where provision is made for draining water from diked areas, drainage shall be provided at a uniform slope of not less than 1 percent away from tanks toward a sump, drainbox, or other safe means of disposal located at the greatest practical distance from the tank. Such drains shall normally be controlled in a manner so as to prevent flammable or combustible liquids from entering natural water courses, public sewers, or public drains, if their presence would constitute a hazard. Control of drainage shall be accessible under fire conditions.

(*6*) No loose combustible material, empty or full drum or barrel, shall be permitted within the diked area.

(*7*) Each diked area containing two or more tanks shall be subdivided preferably by drainage channels or at least by intermediate curbs in order to prevent spills from endangering adjacent tanks within the diked area as follows:

(*i*) When storing normally stable liquids in vertical cone roof tanks constructed with weak roof-to-shell seam or approved floating roof tanks or when storing crude petroleum in producing areas in any type of tank, one subdivision for each tank in excess of 10,000 bbls. and one subdivision for each group of tanks (no tank exceeding 10,000 bbls. capacity) having an aggregate capacity not exceeding 15,000 bbls.

(*ii*) When storing normally stable flammable or combustible liquids in tanks not covered in subdivision (*i*) of this subdivision, one subdivision for each tank in excess of 100,000 gallons (2,500 bbls.) and one subdivision for each group of tanks (no tank exceeding

100,000 gallons capacity) having an aggregate capacity not exceeding 150,000 gallons (3,570 bbls.).

(*iii*) When storing unstable liquids in any type of tank, one subdivision for each tank except that tanks installed in accordance with the drainage requirements of NFPA 15–1969, Standard for Water Spray Fixed Systems for Fire Protection shall require no additional subdivision.

(*iv*) The drainage channels or intermediate curbs shall be located between tanks so as to take full advantage of the available space with due regard for the individual tank capacities. Intermediate curbs, where used, shall be not less than 18 inches in height.

(ix) *Tank openings other than vents for aboveground tanks.* (*a*) Connections for all tank openings shall be vaportight and liquidtight. Vents are covered in subdivisions (iv) through (vi) of this subparagraph.

(*b*) Each connection to an aboveground tank through which liquid can normally flow shall be provided with an internal or an external valve located as close as practical to the shell of the tank. Such valves, when external, and their connections to the tank shall be of steel except when the chemical characteristics of the liquid stored are incompatible with steel. When materials other than steel are necessary, they shall be suitable for the pressures, structural stresses, and temperatures involved, including fire exposures.

(*c*) Each connection below the liquid level through which liquid does not normally flow shall be provided with a liquidtight closure. This may be a valve, plug, or blind, or a combination of these.

(*d*) Openings for gaging shall be provided with a vaportight cap or cover.

(*e*) For Class IB and Class IC liquids other than crude oils, gasolines, and asphalts, the fill pipe shall be so designed and installed as to minimize the possibility of generating static electricity. A fill pipe entering the top of a tank shall terminate within 6 inches of the bottom of the tank and shall be installed to avoid excessive vibration.

(*f*) Filling and emptying connections which are made and broken shall be located outside of buildings at a location free from any source of ignition and not less than 5 feet away from any building opening. Such connection shall be closed and liquidtight when not in use. The connection shall be properly identified.

(3) *Installation of underground tanks*—(i) *Location.* Excavation for underground storage tanks shall be made with due care to avoid undermining of foundations of existing structures. Underground tanks or tanks under buildings shall be so located with respect to existing building foundations and supports that the loads carried by the latter cannot be transmitted to the tank. The distance from any part of a tank storing class I liquids to the nearest wall of any basement or pit shall be not less than 1 foot, and to any property line that may be built upon, not less than 3 feet. The distance from any part of a tank storing class II or class III liquids to the nearest wall of any basement, pit or property line shall be not less than 1 foot.

(ii) *Depth and cover.* Underground tanks shall be set on firm foundations and surrounded with at least 6 inches of noncorrosive, inert materials such as clean sand, earth, or gravel well tamped in place. The tank shall be placed in the hole with care since dropping or rolling the tank into the hole can break a weld, puncture or damage the tank, or scrape off the protective coating of coated tanks. Tanks shall be covered with a minimum of 2 feet of earth, or shall be covered with not less than 1 foot of earth, on top of which shall be placed a slab of reinforced concrete not less than 4 inches thick. When underground tanks are, or are likely to be, subject to traffic, they shall be protected against damage from vehicles passing over them by at least 3 feet of earth cover, or 18 inches of well-tamped earth, plus 6 inches of reinforced concrete or 8 inches of asphaltic concrete. When asphaltic or reinforced concrete paving is used as part of the protection, it shall extend at least 1 foot horizontally beyond the outline of the tank in all directions.

(iii) *Corrosion protection.* Corrosion protection for the tank and its piping shall be provided by one or more of the following methods:

(*a*) Use of protective coatings or wrappings;

(*b*) Cathodic protection; or,

(*c*) Corrosion resistant materials of construction.

(iv) *Vents.* (*a*) Location and arrangement of vents for class I liquids. Vent pipes from tanks storing class I liquids shall be so located that the discharge point is outside of buildings, higher than the full pipe opening, and not less than 12 feet above the adjacent ground level. Vent pipes shall discharge only upward in order to disperse vapors. Vent pipes 2 inches or less in nominal inside diameter shall not be obstructed by devices that will cause excessive back pressure. Vent pipe outlets shall be so located that flammable vapors will not enter building openings, or be trapped under eaves or other obstructions. If the vent pipe is less than 10 feet in length, or greater than 2 inches in nominal inside diameter, the outlet shall be provided with a vacuum and pressure relief device or there shall be an approved flame arrester located in the vent line at the outlet or within the approved distance from the outlet.

(*b*) Size of vents. Each tank shall be vented through piping adequate in size to prevent blow-back of vapor or liquid at the fill opening while the tank is being filled. Vent pipes shall be not less than 1¼ inch nominal inside diameter.

TABLE H–II—VENT LINE DIAMETERS

Maximum flow GPM	Pipe length*		
	50 feet	100 feet	200 feet
	Inches	*Inches*	*Inches*
100	1¼	1¼	1¼
200	1¼	1¼	1½
300	1¼	1¼	1½
400	1¼	1½	2
500	1½	1½	2
600	1½	2	2
700	2	2	2
800	2	2	3
900	2	2	3
1,000	2	2	3

*Vent lines of 50 ft., 100 ft., and 200 ft. of pipe plus 7 ells.

(*c*) Location and arrangement of vents for class II or class III liquids. Vent pipes from tanks storing class II or class III flammable liquids shall terminate outside of the building and higher than the fill pipe opening. Vent outlets shall be above normal snow level. They may be fitted with return bends, coarse screens or other devices to minimize ingress of foreign material.

(*d*) Vent piping shall be constructed in accordance with paragraph (*c*) of this section. Vent pipes shall be so laid as to drain toward the tank without sags or traps in which liquid can collect. They shall be located so that they will not be subjected to physical damage. The tank end of the vent pipe shall enter the tank through the top.

(*e*) When tank vent piping is manifolded, pipe sizes shall be such as to discharge, within the pressure limitations of the system, the vapors they may be required to handle when manifolded tanks are filled simultaneously.

(v) *Tank openings other than vents.* (*a*) Connections for all tank openings shall be vapor or liquid tight.

(*b*) Openings for manual gaging, if independent of the fill pipe, shall be provided with a liquid-tight cap or cover. If inside a building, each such opening shall be protected against liquid overflow and possible vapor release by means of a spring loaded check valve or other approved device.

(*c*) Fill and discharge lines shall enter tanks only through the top. Fill lines shall be sloped toward the tank.

(*d*) For class IB and class IC liquids other than crude oils, gasolines, and asphalts, the fill pipe shall be so designed and installed as to minimize the possibility of generating static electricity by terminating within 6 inches of the bottom of the tank.

(*e*) Filling and emptying connections which are made and broken shall be located outside of buildings at a location free from any source of ignition and not less than 5 feet away from any building opening. Such connection shall be closed and liquidtight when not in use. The connection shall be properly identified.

(4) *Installation of tanks inside of buildings*—(i) *Location.* Tanks shall not be permitted inside of buildings except

as provided in paragraphs (e), (g), (h), or (i) of this section.

(ii) *Vents.* Vents for tanks inside of buildings shall be as provided in subparagraphs (2) (iv), (v), (vi)(*b*), and (3)(iv) of this paragraph, except that emergency venting by the use of weak roof seams on tanks shall not be permitted. Vents shall discharge vapors outside the buildings.

(iii) *Vent piping.* Vent piping shall be constructed in accordance with paragraph (c) of this section.

(iv) *Tank openings other than vents.* (*a*) Connections for all tank openings shall be vapor or liquidtight. Vents are covered in subdivision (ii) of this subparagraph.

(*b*) Each connection to a tank inside of buildings through which liquid can normally flow shall be provided with an internal or an external valve located as close as practical to the shell of the tank. Such valves, when external, and their connections to the tank shall be of steel except when the chemical characteristics of the liquid stored are incompatible with steel. When materials other than steel are necessary, they shall be suitable for the pressures, structural stresses, and temperatures involved, including fire exposures.

(*c*) Flammable or combustible liquid tanks located inside of buildings, except in one-story buildings designed and protected for flammable or combustible liquid storage, shall be provided with an automatic-closing heat-actuated valve on each withdrawal connection below the liquid level, except for connections used for emergency disposal, to prevent continued flow in the event of fire in the vicinity of the tank. This function may be incorporated in the valve required in (*b*) of this subdivision, and if a separate valve, shall be located adjacent to the valve required in (*b*) of this subdivision.

(*d*) Openings for manual gaging, if independent of the fill pipe (see (*f*) of this subdivision), shall be provided with a vaportight cap or cover. Each such opening shall be protected against liquid overflow and possible vapor release by means of a spring loaded check valve or other approved device.

(*e*) For Class IB and Class IC liquids other than crude oils, gasolines, and asphalts, the fill pipe shall be so designed and installed as to minimize the possibility of generating static electricity by terminating within 6 inches of the bottom of the tank.

(*f*) The fill pipe inside of the tank shall be installed to avoid excessive vibration of the pipe.

(*g*) The inlet of the fill pipe shall be located outside of buildings at a location free from any source of ignition and not less than 5 feet away from any building opening. The inlet of the fill pipe shall be closed and liquidtight when not in use. The fill connection shall be properly identified.

(*h*) Tanks inside buildings shall be equipped with a device, or other means shall be provided, to prevent overflow into the building.

(5) *Supports, foundations, and anchorage for all tank locations*—(i) *General.* Tank supports shall be installed on firm foundations. Tank supports shall be of concrete, masonry, or protected steel. Single wood timber supports (not cribbing) laid horizontally may be used for outside aboveground tanks if not more than 12 inches high at their lowest point.

(ii) *Fire resistance.* Steel supports or exposed piling shall be protected by materials having a fire resistance rating of not less than 2 hours, except that steel saddles need not be protected if less than 12 inches high at their lowest point. Water spray protection or its equivalent may be used in lieu of fire-resistive materials to protect supports.

(iii) *Spheres.* The design of the supporting structure for tanks such as spheres shall receive special engineering consideration.

(iv) *Load distribution.* Every tank shall be so supported as to prevent the excessive concentration of loads on the supporting portion of the shell.

(v) *Foundations.* Tanks shall rest on the ground or on foundations made of concrete, masonry, piling, or steel. Tank foundations shall be designed to minimize the possibility of uneven settling of the tank and to minimize corrosion in any part of the tank resting on the foundation.

(vi) *Flood areas.* Where a tank is located in an area that may be subjected to flooding, the applicable precautions outlined in this subdivision shall be observed.

(*a*) No aboveground vertical storage tank containing a flammable or combustible liquid shall be located so that the allowable liquid level within the tank is below the established maximum flood stage, unless the tank is provided with a guiding structure such as described in (*n*), (*o*), and (*p*) of this subdivision.

(*b*) Independent water supply facilities shall be provided at locations where there is no ample and dependable public water supply available for loading partially empty tanks with water.

(*c*) In addition to the preceding requirements, each tank so located that more than 70 percent, but less than 100 percent, of its allowable liquid storage capacity will be submerged at the established maximum flood stage, shall be safeguarded by one of the following methods: Tank shall be raised, or its height shall be increased, until its top extends above the maximum flood stage a distance equivalent to 30 percent or more of its allowable liquid storage capacity: *Provided, however,* That the submerged part of the tank shall not exceed two and one-half times the diameter. Or, as an alternative to the foregoing, adequate noncombustible structural guides, designed to permit the tank to float vertically without loss of product, shall be provided.

(*d*) Each horizontal tank so located that more than 70 percent of its storage capacity will be submerged at the established flood stage, shall be anchored, attached to a foundation of concrete or of steel and concrete, of sufficient weight to provide adequate load for the tank when filled with flammable or combustible liquid and submerged by flood waters to the established flood stage, or adequately secured by other means.

(*e*) Spherical and spheroidal tanks shall be protected by applicable methods as specified for either vertical or horizontal tanks.

(*f*) At locations where there is no ample and dependable water supply, or where filling of underground tanks with liquids is impracticable because of the character of their contents, their use, or for other reasons, each tank shall be safeguarded against movement when empty and submerged by high ground water or flood waters by anchoring, weighting with concrete or other approved solid loading material, or securing by other means. Each such tank shall be so constructed and installed that it will safely resist external pressures due to high ground water or flood waters.

(*g*) At locations where there is an ample and dependable water supply available, underground tanks containing flammable or combustible liquids, so installed that more than 70 percent of their storage capacity will be submerged at the maximum flood stage, shall be so anchored, weighted, or secured by other means, as to prevent movement of such tanks when filled with flammable or combustible liquids, and submerged by flood waters to the established flood stage.

(*h*) Pipe connections below the allowable liquid level in a tank shall be provided with valves or cocks located as closely as practicable to the tank shell. Such valves and their connections to tanks shall be of steel or other material suitable for use with the liquid being stored. Cast iron shall not be permitted.

(*i*) At locations where an independent water supply is required, it shall be entirely independent of public power and water supply. Independent source of water shall be available when flood waters reach a level not less than 10 feet below the bottom of the lowest tank on a property.

(*j*) The self-contained power and pumping unit shall be so located or so designed that pumping into tanks may be carried on continuously throughout the rise in flood waters from a level 10 feet below the lowest tank to the level of the potential flood stage.

(*k*) Capacity of the pumping unit shall be such that the rate of rise of water in all tanks shall be equivalent to the established potential average rate of rise of flood waters at any stage.

(*l*) Each independent pumping unit shall be tested periodically to insure that it is in satisfactory operating condition.

(*m*) Structural guides for holding floating tanks above their foundations shall be so designed that there will be no resistance to the free rise of a tank, and shall be constructed of noncombustible material.

(*n*) The strength of the structure shall be adequate to resist lateral movement of a tank subject to a horizontal force in any direction equivalent to not

less than 25 pounds per square foot acting on the projected vertical cross-sectional area of the tank.

(o) Where tanks are situated on exposed points or bends in a shoreline where swift currents in flood waters will be present, the structures shall be designed to withstand a unit force of not less than 50 pounds per square foot.

(p) The filling of a tank to be protected by water loading shall be started as soon as flood waters reach a dangerous flood stage. The rate of filling shall be at least equal to the rate of rise of the floodwaters (or the established average potential rate of rise).

(q) Sufficient fuel to operate the water pumps shall be available at all times to insure adequate power to fill all tankage with water.

(r) All valves on connecting pipelines shall be closed and locked in closed position when water loading has been completed.

(s) Where structural guides are provided for the protection of floating tanks, all rigid connections between tanks and pipelines shall be disconnected and blanked off or blinded before the floodwaters reach the bottom of the tank, unless control valves and their connections to the tank are of a type designed to prevent breakage between the valve and the tank shell.

(t) All valves attached to tanks other than those used in connection with water loading operations shall be closed and locked.

(u) If a tank is equipped with a swing line, the swing pipe shall be raised to and secured at its highest position.

(v) Inspections. The Assistant Secretary or his designated representative shall make periodic inspections of all plants where the storage of flammable or combustible liquids is such as to require compliance with the foregoing requirements, in order to assure the following:

(1) That all flammable or combustible liquid storage tanks are in compliance with these requirements and so maintained.

(2) That detailed printed instructions of what to do in flood emergencies are properly posted.

(3) That station operators and other employees depended upon to carry out such instructions are thoroughly informed as to the location and operation of such valves and other equipment necessary to effect these requirements.

(vii) *Earthquake areas.* In areas subject to earthquakes, the tank supports and connections shall be designed to resist damage as a result of such shocks.

(6) *Sources of ignition.* In locations where flammable vapors may be present, precautions shall be taken to prevent ignition by eliminating or controlling sources of ignition. Sources of ignition may include open flames, lightning, smoking, cutting and welding, hot surfaces, frictional heat, sparks (static, electrical, and mechanical), spontaneous ignition, chemical and physical-chemical reactions, and radiant heat.

(7) *Testing*—(i) *General.* All tanks, whether shop built or field erected, shall be strength tested before they are placed in service in accordance with the applicable paragraphs of the code under which they were built. The American Society of Mechanical Engineers (ASME) code stamp, American Petroleum Institute (API) monogram, or the label of the Underwriters' Laboratories, Inc., on a tank shall be evidence of compliance with this strength test. Tanks not marked in accordance with the above codes shall be strength tested before they are placed in service in accordance with good engineering principles and reference shall be made to the sections on testing in the codes listed in subparagraphs (1) (iii) (*a*), (iv) (*b*), or (v) (*b*) of this paragraph.

(ii) *Strength.* When the vertical length of the fill and vent pipes is such that when filled with liquid the static head imposed upon the bottom of the tank exceeds 10 pounds per square inch, the tank and related piping shall be tested hydrostatically to a pressure equal to the static head thus imposed.

(iii) *Tightness.* In addition to the strength test called for in subdivisions (i) and (ii) of this subparagraph, all tanks and connections shall be tested for tightness. Except for underground tanks, this tightness test shall be made at operating pressure with air, inert gas, or water prior to placing the tank in service. In the case of field-erected tanks the strength test may be considered to be the test for tank tightness. Underground tanks and piping, before being covered, enclosed, or placed in use, shall be tested for tightness hydrostatically, or with air pressure at not less than 3 pounds per square inch and not more than 5 pounds per square inch.

(iv) *Repairs.* All leaks or deformations shall be corrected in an acceptable manner before the tank is placed in service. Mechanical caulking is not permitted for correcting leaks in welded tanks except pinhole leaks in the roof.

(v) *Derated operations.* Tanks to be operated at pressures below their design pressure may be tested by the applicable provisions of subdivisions (i) or (ii) of this subparagraph, based upon the pressure developed under full emergency venting of the tank.

(c) *Piping, valves, and fittings*—(1) *General*—(i) *Design.* The design (including selection of materials) fabrication, assembly, test, and inspection of piping systems containing flammable or combustible liquids shall be suitable for the expected working pressures and structural stresses. Conformity with the applicable provisions of Pressure Piping, ANSI B31 series and the provisions of this paragraph, shall be considered prima facie evidence of compliance with the foregoing provisions.

(ii) *Exceptions.* This paragraph does not apply to any of the following:

(*a*) Tubing or casing on any oil or gas wells and any piping connected directly thereto.

(*b*) Motor vehicle, aircraft, boat, or portable or stationary engines.

(*c*) Piping within the scope of any applicable boiler and pressures vessel code.

(iii) *Definitions.* As used in this paragraph, piping systems consist of pipe, tubing flanges, bolting, gaskets, valves, fittings, the pressure containing parts of other components such as expansion joints and strainers, and devices which serve such purposes as mixing, separating, snubbing, distributing, metering, or controlling flow.

(2) *Materials for piping, valves, and fittings*—(i) *Required materials.* Materials for piping, valves, or fittings shall be steel or modular iron except as provided in subdivisions (ii), (iii), and (iv) of this subparagraph.

(ii) *Exceptions.* Materials other than steel or nodular iron may be used underground or if required by the properties of the flammable or combustible liquid handled. Material other than steel or nodular iron shall be designed to specifications embodying principles recognized as good engineering design for the material used.

(iii) *Linings.* Piping, valves, and fittings may have combustible or noncombustible linings.

(iv) *Low-melting materials.* When low-melting point materials such as aluminum and brass or materials that soften on fire exposure such as plastics, or nonductile materials such as cast iron, are necessary, special consideration shall be given to their behavior on fire exposure. If such materials are used in aboveground piping systems or inside buildings, they shall be suitably protected against fire exposure or so located that any spill resulting from the failure of these materials could not unduly expose persons, important buildings or structures or can be readily controlled by remote valves.

(3) *Pipe joints.* Joints shall be made liquid tight. Welded or screwed joints or approved connectors shall be used. Threaded joints and connections shall be made up tight with a suitable lubricant or piping compound. Pipe joints dependent upon the friction characteristics of combustible materials for mechanical continuity of piping shall not be used inside buildings. They may be used outside of buildings above or below ground. If used aboveground, the piping shall either be secured to prevent disengagement at the fitting or the piping system shall be so designed that any spill resulting from such disengagement could not unduly expose persons, important buildings or structures, and could be readily controlled by remote valves.

(4) *Supports.* Piping systems shall be substantially supported and protected against physical damage and excessive stresses arising from settlement, vibration, expansion, or contraction.

(5) *Protection against corrosion.* All piping for flammable or combustible liquids, both aboveground and underground, where subject to external corrosion, shall be painted or otherwise protected.

(6) *Valves.* Piping systems shall contain a sufficient number of valves to operate the system properly and to protect the plant. Piping systems in connection with bumps shall contain a sufficient number of valves to control properly the

flow of liquid in normal operation and in the event of physical damage. Each connection to pipelines, by which equipments such as tankcars or tank vehicles discharge liquids by means of pumps into storage tanks, shall be provided with a check valve for automatic protection against backflow if the piping arrangement is such that backflow from the system is possible.

(7) *Testing.* All piping before being covered, enclosed, or placed in use shall be hydrostatically tested to 150 percent of the maximum anticipated pressure of the system, or pneumatically tested to 110 percent of the maximum anticipated pressure of the system, but not less than 5 pounds per square inch gage at the highest point of the system. This test shall be maintained for a sufficient time to complete visual inspection of all joints and connections, but for at least 10 minutes.

(d) *Container and portable tank storage.*—(1) *Scope.*—(i) *General.* This paragraph shall apply only to the storage of flammable or combustible liquids in drums or other containers (including flammable aerosols) not exceeding 60 gallons individual capacity and those portable tanks not exceeding 660 gallons individual capacity.

(ii) *Exceptions.* This paragraph shall not apply to the following:

(*a*) Storage of containers in bulk plants, service stations, refineries, chemical plants, and distilleries;

(*b*) Flammable liquids in the fuel tanks of a motor vehicle, aircraft, boat, or portable or stationary engine;

(*c*) Flammable or combustible paints, oils, varnishes, and similar mixtures used for painting or maintenance when not kept for a period in excess of 30 days.

(*d*) Beverages when packaged in individual containers not exceeding 1 gallon in size.

(2) *Design, construction, and capacity of containers*—(i) *General.* Only approved containers and portable tanks shall be used. Metal containers and portable tanks meeting the requirements of and containing products authorized by Chapter I, Title 49 of the Code of Federal Regulations (regulations issued by the Hazardous Materials Regulations Board, Department of Transportation), shall be deemed to be acceptable.

(ii) *Emergency venting.* Each portable tank shall be provided with one or more devices installed in the top with sufficient emergency venting capacity to limit internal pressure under fire exposure conditions to 10 p.s.i.g., or 30 percent of the bursting pressure of the tank, whichever is greater. The total venting capacity shall be not less than that specified in paragraphs (b)(2)(v) (*c*) or (*e*) of this section. At least one pressure-actuated vent having a minimum capacity of 6,000 cubic feet of free air (14.7 p.s.i.a. and 60° F.) shall be used. It shall be set to open at not less than 5 p.s.i.g. If fusible vents are used, they shall be actuated by elements that operate at a temperature not exceeding 300° F.

TABLE H-12—MAXIMUM ALLOWABLE SIZE OF CONTAINERS AND PORTABLE TANKS

Container type	Flammable liquids				Combustible liquids, Class III
	Class IA	Class IB	Class IC	Class II	
Glass or approved plastic	1 pt.	1 qt.	1 gal.	1 gal.	1 gal.
Metal (other than DOT drums)	1 gal.	5 gal.	5 gal.	5 gal.	5 gal.
Safety cans	2 gal.	5 gal.	5 gal.	5 gal.	5 gal.
Metal drums (DOT spec.)	60 gal.	60 gal.	60 gal.	60 gal.	60 gal.
Approved portable tanks	660 gal.	660 gal.	660 gal.	660 gal.	660 gal.

Container exemptions: (a) Medicines, beverages, foodstuffs, cosmetics, and other common consumer items, when packaged according to commonly accepted practices, shall be exempt from the requirements of subdivisions (i) and (ii) of this subparagraph.

(iii) *Size.* Flammable and combustible liquids packaged for sale or use shall conform to Table H-12.

(3) *Design, construction, and capacity of storage cabinets*—(i) *Maximum capacity.* Not more than 60 gallons of flammable or 120 gallons of combustible liquids may be stored in a storage cabinet.

(ii) *Fire resistance.* Storage cabinets shall be designed and constructed to limit the internal temperature to not more than 325° F. when subjected to a 10-minute fire test using the standard time-temperature curve as set forth in Standard Methods of Fire Tests of Building Construction and Materials, NFPA 251–1969. All joints and seams shall remain tight and the door shall remain securely closed during the fire test. Cabinets shall be labeled in conspicuous lettering, "Flammable—Keep Fire Away."

(*a*) Metal cabinets constructed in the following manner shall be deemed to be in compliance. The bottom, top, door, and sides of cabinet shall be at least No. 18 gage sheet iron and double walled with 1½-inch air space. Joints shall be riveted, welded or made tight by some equally effective means. The door shall be provided with a three-point lock, and the door sill shall be raised at least 2 inches above the bottom of the cabinet.

(*b*) Wooden cabinets constructed in the following manner shall be deemed in compliance. The bottom, sides, and top shall be constructed of an approved grade of plywood at least 1 inch in thickness, which shall not break down or delaminate under fire conditions. All joints shall be rabbetted and shall be fastened in two directions with flathead woodscrews. When more than one door is used, there shall be a rabbetted overlap of not less than 1 inch. Hinges shall be mounted in such a manner as not to lose their holding capacity due to loosening or burning out of the screws when subjected to the fire test.

(4) *Design and construction of inside storage rooms*—(i) *Construction.* Inside storage rooms shall be constructed to meet the required fire-resistive rating for their use. Such construction shall comply with the test specifications set forth in Standard Methods of Fire Tests of Building Construction and Materials, NFPA 251–1969. Where an automatic sprinkler system is provided, the system shall be designed and installed in an acceptable manner. Openings to other rooms or buildings shall be provided with noncombustible liquid-tight raised sills or ramps at least 4 inches in height, or the floor in the storage area shall be at least 4 inches below the surrounding floor. Openings shall be provided with approved self-closing fire doors. The room shall be liquid tight where the walls join the floor. A permissible alternate to the sill or ramp is an open-grated trench inside of the room which drains to a safe location. Where other portions of the building or other properties are exposed, windows shall be protected as set forth in the Standard for Fire Doors and Windows, NFPA No. 80–1969, for class E or F openings. Wood at least 1 inch nominal thickness may be used for shelving, racks, dunnage, scuffboards, floor overlay, and similar installations.

(ii) *Rating and capacity.* Storage in inside storage rooms shall comply with Table H-13.

TABLE H-13—STORAGE IN INSIDE ROOMS

Fire protection* provided	Fire resistance	Maximum size	Total allowable quantities (gals./sq. ft./floor area)
Yes	2 hours	500 sq. ft.	10
No	2 hours	500 sq. ft.	4
Yes	1 hour	150 sq. ft.	5
No	1 hour	150 sq. ft.	2

*Fire protection system shall be sprinkler, water spray, carbon dioxide, or other system.

(iii) *Wiring.* Electrical wiring and equipment located in inside storage rooms used for class I liquids shall be approved under subpart S of this part for Class I, Division 2, Hazardous Locations; for class II and class III liquids, shall be approved for general use.

(iv) *Ventilation.* Every inside storage room shall be provided with either a gravity or a mechanical exhaust ventilation system. Such system shall be designed to provide for a complete change of air within the room at least six times per hour. If a mechanical exhaust system is used, it shall be controlled by a switch located outside of the door. The ventilating equipment and any lighting fixtures shall be operated by the same switch. A pilot light shall be installed adjacent to the switch if class I flammable liquids are dispensed within the room. Where gravity ventilation is provided, the fresh air intake, as well as the exhaust outlet from the room, shall be on the exterior of the building in which the room is located.

(v) *Storage in inside storage rooms.* In every inside storage room there shall

be maintained one clear aisle at least 3 feet wide. Containers over 30 gallons capacity shall not be stacked one upon the other. Dispensing shall be by approved pump or self-closing faucet only.

(5) *Storage inside building*—(i) *Egress.* Flammable or combustible liquids, including stock for sale, shall not be stored so as to limit use of exits, stairways, or areas normally used for the safe egress of people.

(ii) *Containers.* The storage of flammable or combustible liquids in containers or portable tanks shall comply with subdivisions (iii) through (v) of this subparagraph.

(iii) *Office occupancies.* Storage shall be prohibited except that which is required for maintenance and operation of building and operation of equipment. Such storage shall be kept in closed metal containers stored in a storage cabinet or in safety cans or in an inside storage room not having a door that opens into that portion of the building used by the public.

(iv) *Mercantile occupancies and other retail stores.*

(*a*) In rooms or areas accessible to the public, storage shall be limited to quantities needed for display and normal merchandising purposes but shall not exceed 2 gallons per square foot of gross floor area. The gross floor area used for computing the maximum quantity permitted shall be considered as that portion of the storage area actually being used for merchandising flammable and combustible liquids.

(*b*) Where the aggregate quantity of additional stock exceeds 60 gallons of class IA, 120 gallons of class IB, 180 gallons of class IC, 240 gallons of class II, or 500 gallons of combustible liquids, or any combination of flammable liquids exceeding 240 gallons, it shall be stored in a room or portion of the building that complies with the construction provisions for an inside storage room as prescribed in subparagraph (4) of this paragraph. For water miscible liquids, these quantities may be doubled.

(*c*) Containers in a display area shall not be stacked more than 3 feet or two containers high, whichever is the greater, unless the stacking is done on fixed shelving or is otherwise satisfactorily secured.

(*d*) Shelving shall be of stable construction, of sufficient depth and arrangement such that containers displayed thereon shal not be easily displaced.

(*e*) Leaking containers shall be removed to a storage room or taken to a safe location outside the building and the contents transferred to an undamaged container.

(v) *General purpose public warehouses.* Storage shall be in accordance with Table H–14 or H–15 and in buildings or in portions of such buildings cut off by standard firewalls. Material creating no fire exposure hazard to the flammable or combustible liquids may be stored in the same area.

TABLE H–14—INDOOR CONTAINER STORAGE

Class liquid	Storage level	Protected storage maximum per pile		Unprotected storage maximum per pile	
		Gallons	Height	Gallons	Height
IA	Ground and upper floors	2,750	3 ft.	660	3 ft.
		(50)	(1)	(12)	(1)
	Basement	Not permitted		Not permitted	
IB	Ground and upper floors	5,500	6 ft.	1,375	3 ft.
		(100)	(2)	(25)	(1)
	Basement	Not permitted		Not permitted	
IC	Ground and upper floors	16,500	6 ft.	4,125	3 ft.
		(300)	(2)	(75)	(1)
	Basement	Not permitted		Not permitted	
II	Ground and upper floors	16,500	9 ft.	4,125	9 ft.
		(300)	(3)	(75)	(3)
	Basement	5,500	9 ft.	Not permitted	
		(100)	(3)		
Combustible	Ground and upper floors	55,000	15 ft.	13,750	12 ft.
		(1,000)	(5)	(250)	(4)
	Basement	8,250	9 ft.	Not permitted	
		(450)	(3)		

NOTE 1: When 2 or more classes of materials are stored in a single pile, the maximum gallonage permitted in that pile shall be the smallest of the 2 or more separate maximum gallonages.

NOTE 2: Aisles shall be provided so that no container is more than 12 ft. from an aisle. Main aisles shall be at least 8 ft. wide and side aisles at least 4 ft. wide.

(Numbers in parentheses indicate corresponding number of 55-gal. drums.)

TABLE H–15—INDOOR PORTABLE TANK STORAGE

Class liquid	Storage level	Protected storage maximum per pile		Unprotected storage maximum per pile	
		Gallons	Height	Gallons	Height
IA	Ground and upper floors	Not permitted		Not permitted	
	Basement	Not permitted		Not permitted	
IB	Ground and upper floors	20,000	7 ft.	2,000	7 ft.
	Basement	Not permitted		Not permitted	
IC	Ground and upper floors	40,000	14 ft.	5,500	7 ft.
	Basement	Not permitted		Not permitted	
II	Ground and upper floors	40,000	14 ft.	5,500	7 ft.
	Basement	20,000	7 ft.	Not permitted	
Combustible	Ground and upper floors	60,000	14 ft.	22,000	7 ft.
	Basement	20,000	7 ft.	Not permitted	

NOTE 1: When 2 or more classes of materials are stored in a single pile, the maximum gallonage permitted in that pile shall be the smallest of the 2 or more separate maximum gallonages.

NOTE 2: Aisles shall be provided so that no portable tank is more than 12 ft. from an aisle. Main aisles shall be at least 8 ft. wide and side aisles at least 4 ft. wide.

(vi) *Flammable and combustible liquid warehouses or storage buildings.* (*a*) If the storage building is located 50 feet or less from a building or line of adjoining property that may be built upon, the exposing wall shall be a blank wall having a fire-resistance rating of at least 2 hours.

(*b*) The total quantity of liquids within a building shall not be restricted, but the arrangement of storage shall comply with Table H–14 or H–15.

(*c*) Containers in piles shall be separated by pallets or dunnage where necessary to provide stability and to prevent excessive stress on container walls.

(*d*) Portable tanks stored over one tier high shall be designed to nest securely, without dunnage, and adequate materials handling equipment shall be available to handle tanks safely at the upper tier level.

(*e*) No pile shall be closer than 3 feet to the nearest beam, chord, girder, or other obstruction, and shall be 3 feet below sprinkler deflectors or discharge orifices of water spray, or other overhead fire protection systems.

(*f*) Aisles of at least 3 feet wide shall be provided where necessary for reasons of access to doors, windows or standpipe connections.

(6) *Storage outside buildings*—(i) *General.* Storage outside buildings shall be in accordance with Table H–16 or H–17, and subdivisions (ii) and (iv) of this subparagraph.

TABLE H–16—OUTDOOR CONTAINER STORAGE

1	2	3	4	5
Class	Maximum per pile gallons (see note 1)	Distance between piles (see note 2)	Distance to property line that can be built upon (see notes 3 and 4)	Distance to street, alley, public way (see note 4)
		ft.	*ft.*	*ft.*
IA	1,100	5	20	10
IB	2,200	5	20	10
IC	4,400	5	20	10
II	8,800	5	10	5
Combustible	22,000	5	10	5

NOTE 1: When 2 or more classes of materials are stored in a single pile, the maximum gallonage in that pile shal be the smallest of the 2 or more separate gallonages.

NOTE 2: Within 200 ft. of each container, there shall be a 12-ft. wide access way to permit approach of fire control apparatus.

NOTE 3: The distances listed apply to properties that have protection for exposures as defined. If there are exposures, and such protection for exposures does not exist, the distances in column 4 shall be doubled.

NOTE 4: When total quantity stored does not exceed 50 percent of maximum per pile, the distances in columns 4 and 5 may be reduced 50 percent, but not less than 3 ft.

(ii) *Maximum storage.* A maximum of 1,100 gallons of flammable or combustible liquids may be located adjacent to buildings located on the same premises and under the same management provided the provisions of subdivisions (*a*) and (*b*) of this subdivision are complied with.

(*a*) The building shall be a one-story building devoted principally to the handling and storing of flammable or combustible liquids or the building shall have 2-hour fire-resistive exterior walls having no opening within 10 feet of such storage.

(*b*) Where quantity stored exceeds 1,100 gallons, or provisions of subdivision (*a*) of this subdivision cannot be met, a minimum distance of 10 feet between buildings and nearest container of flammable or combustible liquid shall be maintained.

TABLE H-17—OUTDOOR PORTABLE TANK STORAGE

1 Class	2 Maximum per pile gallons	3 Distance between piles	4 Distance to property line that can be built upon	5 Distance to street, alley public way
		ft.	*ft.*	*ft.*
IA	2,200	5	20	10
IB	4,400	5	20	10
IC	8,800	5	20	10
II	17,600	5	10	5
Combustible	44,000	5	10	5

NOTE 1: When 2 or more classes of materials are stored in a single pile, the maximum gallonage in that pile shall be the the smallest of the 2 or more separate gallonages.

NOTE 2: Within 200 ft. of each portable tank, there shall be a 12-ft. wide access way to permit approach of fire control apparatus.

NOTE 3: The distances listed apply to properties that have protection for exposures as defined. If there are exposures, and such protection for exposures does not exist, the distances in column 4 shall be doubled.

NOTE 4: When total quantity stored does not exceed 50 percent of maximum per pile, the distances in columns 4 and 5 may be reduced 50 percent, but not less than 3 ft.

(iii) *Spill containment.* The storage area shall be graded in a manner to divert possible spills away from buildings or other exposures or shall be surrounded by a curb at least 6 inches high. When curbs are used, provisions shall be made for draining of accumulations of ground or rain water or spills of flammable or combustible liquids. Drains shall terminate at a safe location and shall be accessible to operation under fire conditions.

(iv) *Security.* The storage area shall be protected against tampering or trespassers where necessary and shall be kept free of weeds, debris and other combustible material not necessary to the storage.

(7) *Fire control*—(i) *Extinguishers.* Suitable fire control devices, such as small hose or portable fire extinguishers, shall be available at locations where flammable or combustible liquids are stored.

(*a*) At least one portable fire extinguishers having a rating of not less than 12–B units shall be located outside of, but not more than 10 feet from, the door opening into any room used for storage.

(*b*) At least one portable fire extinguisher having a rating of not less than 12–B units shall be located not less than 10 feet, nor more than 25 feet, from any flammable liquid storage area located outside of a storage room but inside a building.

(*1*) When sprinklers are provided, they shall be installed in an approved manner.

(2) Open flames and smoking shall not be permitted in flammable or combustible liquid storage areas.

(3) Materials which will react with water shall not be stored in the same room with flammable or combustible liquids.

(e) *Industrial plants*—(1) Scope—(i) *Application.* This paragraph shall apply to those industrial plants where

(*a*) The use of flammable or combustible liquids is incidental to the principal business, or

(*b*) Where flammable or combustible liquids are handled or used only in unit physical operations such as mixing, drying, evaporating, filtering, distillation, and similar operations which do not involve chemical reaction. This paragraph shall not apply to chemical plants, refineries or distilleries.

(ii) *Exceptions.* Where portions of such plants involve chemical reactions such as oxidation, reduction, halogenation, hydrogenation, alkylation, polymerization, and other chemical processes, those portions of the plant shall be in accordance with paragraph (h) of this section.

(2) *Incidental storage or use of flammable and combustible liquids*—(i) *Application.* This subparagraph shall be applicable to those portions of an industrial plant where the use and handling of flammable or combustible liquids is only incidental to the principal business, such as automobile assembly, construction of electronic equipment, furniture manufacturing, or other similar activities.

(ii) *Containers.* Flammable or combustible liquids shall be stored in tanks or closed containers.

(*a*) Except as provided in subdivisions (*b*) and (*c*) of this subdivision, all storage shall comply with paragraph (d) (3) or (4) of this section.

(*b*) The quantity of liquid that may be located outside of an inside storage room or storage cabinet in a building or in any one fire area of a building shall not exceed:

(*1*) 25 gallons of Class IA liquids in containers

(2) 120 gallons of Class IB, IC, II, or III liquids in containers

(3) 660 gallons of Class IB, IC, II, or III liquids in a single portable tank.

(*c*) Where large quantities of flammable or combustible liquids are necessary, storage may be in tanks which shall comply with the applicable requirements of paragraph (b) of this section.

(iii) *Separation and protection.* Areas in which flammable or combustible liquids are transferred from one tank or container to another container shall be separated from other operations in the building by adequate distance or by construction having adequate fire resistance. Drainage or other means shall be provided to control spills. Adequate natural or mechanical ventilation shall be provided.

(iv) *Handling liquids at point of final use.* (*a*) Flammable liquids shall be kept in covered containers when not actually in use.

(*b*) Where flammable or combustible liquids are used or handled, except in closed containers, means shall be provided to dispose promptly and safely of leakage or spills.

(*c*) Class I liquids may be used only where there are no open flames or other sources of ignition within the possible path of vapor travel.

(*d*) Flammable or combustible liquids shall be drawn from or transferred into vessels, containers, or portable tanks within a building only through a closed piping system, from safety cans, by means of a device drawing through the top, or from a container or portable tanks by gravity through an approved self-closing valve. Transferring by means of air pressure on the container or portable tanks shall be prohibited.

(3) *Unit physical operations*—(i) *Application.* This subparagraph shall be applicable in those portions of industrial plants where flammable or combustible liquids are handled or used in unit physical operations such as mixing, drying, evaporating, filtering, distillation, and similar operations which do not involve chemical change. Examples are plants compounding cosmetics, pharmaceuticals, solvents, cleaning fluids, insecticides, and similar types of activities.

(ii) *Location.* Industrial plants shall be located so that each building or unit of equipment is accessible from at least one side for firefighting and fire control purposes. Buildings shall be located with respect to lines of adjoining property which may be built upon as set forth in paragraph (h) (2) (i) and (ii) of this section except that the blank wall referred to in paragraph (h) (2) (ii) of this section shall have a fire resistance rating of at least 2 hours.

(iii) *Chemical processes.* Areas where unstable liquids are handled or small scale unit chemical processes are carried on shall be separated from the remainder of the plant by a fire wall of 2-hour minimum fire resistance rating.

(iv) *Drainage.* (*a*) Emergency drainage systems shall be provided to direct flammable or combustible liquid leak-

age and fire protection water to a safe location. This may require curbs, scuppers, or special drainage systems to control the spread of fire; see paragraph (b)(2)(vii)(*b*) of this section.

(*b*) Emergency drainage systems, if connected to public sewers or discharged into public waterways, shall be equipped with traps or separators.

(*c*) The industrial plant shall be designed and operated to prevent the normal discharge of flammable or combustible liquids into public waterways, public sewers, or adjoining property.

(v) *Ventilation.* (*a*) Areas as defined in subdivision (i) of this subparagraph using Class I liquids shall be ventilated at a rate of not less than 1 cubic foot per minute per square foot of solid floor area. This shall be accomplished by natural or mechanical ventilation with discharge or exhaust to a safe location outside of the building. Provision shall be made for introduction of makeup air in such a manner as not to short circuit the ventilation. Ventilation shall be arranged to include all floor areas or pits where flammable vapors may collect.

(*b*) Equipment used in a building and the ventilation of the building shall be designed so as to limit flammable vapor-air mixtures under normal operating conditions to the interior of equipment, and to not more than 5 feet from equipment which exposes Class I liquids to the air. Examples of such equipment are dispensing stations, open centrifuges, plate and frame filters, open vacuum filters, and surfaces of open equipment.

(vi) *Storage and handling.* The storage, transfer, and handling of liquid shall comply with paragraph (h)(4) of this section.

(4) *Tank vehicle and tank car loading and unloading.* (i) Tank vehicle and tank car loading or unloading facilities shall be separated from aboveground tanks, warehouses, other plant buildings or nearest line of adjoining property which may be built upon by a distance of 25 feet for Class I liquids and 15 feet for Class II and Class III liquids measured from the nearest position of any fill stem. Buildings for pumps or shelters for personnel may be a part of the facility. Operations of the facility shall comply with the appropriate portions of paragraph (f)(3) of this section.

(5) *Fire control*—(i) *Portable and special equipment.* Portable fire extinguishment and control equipment shall be provided in such quantities and types as are needed for the special hazards of operation and storage.

(ii) *Water supply.* Water shall be available in volume and at adequate pressure to supply water hose streams, foam-producing equipment, automatic sprinklers, or water spray systems as the need is indicated by the special hazards of operation, dispensing and storage.

(iii) *Special extinguishers.* Special extinguishing equipment such as that utilizing foam, inert gas, or dry chemical shall be provided as the need is indicated by the special hazards of operation dispensing and storage.

(iv) *Special hazards.* Where the need is indicated by special hazards of operation, flammable or combustible liquid processing equipment, major piping, and supporting steel shall be protected by approved water spray systems, deluge systems, approved fire-resistant coatings, insulation, or any combination of these.

(v) *Maintenance.* All plant fire protection facilities shall be adequately maintained and periodically inspected and tested to make sure they are always in satisfactory operating condition, and they will serve their purpose in time of emergency.

(6) *Sources of ignition*—(i) *General.* Adequate precautions shall be taken to prevent the ignition of flammable vapors. Sources of ignition include but are not limited to open flames; lightning; smoking; cutting and welding; hot surfaces; frictional heat; static, electrical, and mechanical sparks; spontaneous ignition, including heat-producing chemical reactions; and radiant heat.

(ii) *Grounding.* Class I liquids shall not be dispensed into containers unless the nozzle and container are electrically interconnected. Where the metallic floorplate on which the container stands while filling is electrically connected to the fill stem or where the fill stem is bonded to the container during filling operations by means of a bond wire, the provisions of this section shall be deemed to have been complied with.

(7) *Electrical*—(i) *Equipment.* (*a*) All electrical wiring and equipment shall be installed according to the requirements of Subpart S of this part.

(*b*) Locations where flammable vapor-air mixtures may exist under normal operations shall be classified Class I, Division 1 according to the requirements of Subpart S of this part. For those pieces of equipment installed in accordance with subparagraph (3)(v)(*b*) of this paragraph, the Division 1 area shall extend 5 feet in all directions from all points of vapor liberation. All areas within pits shall be classified Division 1 if any part of the pit is within a Division 1 or 2 classified area, unless the pit is provided with mechanical ventilation.

(*c*) Locations where flammable vapor-air mixtures may exist under abnormal conditions and for a distance beyond Division 1 locations shall be classified Division 2 according to the requirements of Subpart S of this part. These locations include an area within 20 feet horizontally, 3 feet vertically beyond a Division 1 area, and up to 3 feet above floor or grade level within 25 feet, if indoors, or 10 feet if outdoors, from any pump, bleeder, withdrawal fitting, meter, or similar device handling Class I liquids. Pits provided with adequate mechanical ventilation within a Division 1 or 2 area shall be classified Division 2. If Class II or Class III liquids only are handled, then ordinary electrical equipment is satisfactory though care shall be used in locating electrical apparatus to prevent hot metal from falling into open equipment.

(*d*) Where the provisions of subdivisions (*a*), (*b*), and (*c*), of this subdivision require the installation of electrical equipment suitable for Class I, Division 1 or Division 2 locations, ordinary electrical equipment including switchgear may be used if installed in a room or enclosure which is maintained under positive pressure with respect to the hazardous area. Ventilation makeup air shall be uncontaminated by flammable vapors.

(8) *Repairs to equipment.* Hot work, such as welding or cutting operations, use of spark-producing power tools, and chipping operations shall be permitted only under supervision of an individual in responsible charge. The individual in responsible charge shall make an inspection of the area to be sure that it is safe for the work to be done and that safe procedures will be followed for the work specified.

(9) *Housekeeping*—(i) *General.* Maintenance and operating practices shall be in accordance with established procedures which will tend to control leakage and prevent the accidental escape of flammable or combustible liquids. Spills shall be cleaned up promptly.

(ii) *Access.* Adequate aisles shall be maintained for unobstructed movement of personnel and so that fire protection equipment can be brought to bear on any part of flammable or combustible liquid storage, use, or any unit physical operation.

(iii) *Waste and residue.* Combustible waste material and residues in a building or unit operating area shall be kept to a minimum, stored in covered metal receptacles and disposed of daily.

(iv) *Clear zone.* Ground area around buildings and unit operating areas shall be kept free of weeds, trash, or other unnecessary combustible materials.

(f) *Bulk plants*—(1) *Storage*—(i) *Class I liquids.* Class I liquids shall be stored in closed containers, or in storage tanks above ground outside of buildings, or underground in accordance with paragraph (b) of this section.

(ii) *Class II and III liquids.* Class II and Class III liquids shall be stored in containers, or in tanks within buildings or above ground outside of buildings, or underground in accordance with paragraph (b) of this section.

(iii) *Piling containers.* Containers of flammable or combustible liquids when piled one upon the other shall be separated by dunnage sufficient to provide stability and to prevent excessive stress on container walls. The height of the pile shall be consistent with the stability and strength of containers.

(2) *Buildings*—(i) *Exits.* Rooms in which flammable or combustible liquids are stored or handled by pumps shall have exit facilities arranged to prevent occupants from being trapped in the event of fire.

(ii) *Heating.* Rooms in which Class I liquids are stored or handled shall be heated only by means not constituting a source of ignition, such as steam or hot water. Rooms containing heating appliances involving sources of ignition shall be located and arranged to prevent entry of flammable vapors.

(iii) *Ventilation.* (*a*) Ventilation shall be provided for all rooms, buildings, or enclosures in which Class I liquids are pumped or dispensed. Design of ventilation systems shall take into account the relatively high specific gravity of the vapors. Ventilation may be provided by adequate openings in outside walls at floor level unobstructed except by louvers or coarse screens. Where natural ventilation is inadequate, mechanical ventilation shall be provided.

(*b*) Class I liquids shall not be stored or handled within a building having a basement or pit into which flammable vapors may travel, unless such area is provided with ventilation designed to prevent the accumulation of flammable vapors therein.

(*c*) Containers of Class I liquids shall not be drawn from or filled within buildings unless provision is made to prevent the accumulation of flammable vapors in hazardous concentrations. Where mechanical ventilation is required, it shall be kept in operation while flammable liquids are being handled.

(3) *Loading and unloading facilities*—(i) *Separation.* Tank vehicle and tank car loading or unloading facilities shall be separated from aboveground tanks, warehouses, other plant buildings or nearest line of adjoining property that may be built upon by a distance of 25 feet for Class I liquids and 15 feet for Class II and Class III liquids measured from the nearest position of any fill spout. Buildings for pumps or shelters for personnel may be a part of the facility.

(ii) *Class restriction.* Equipment such as piping, pumps, and meters used for the transfer of Class I liquids between storage tanks and the fill stem of the loading rack shall not be used for the transfer of Class II or Class III liquids.

(iii) *Valves.* Valves used for the final control for filling tank vehicles shall be of the self-closing type and manually held open except where automatic means are provided for shutting off the flow when the vehicle is full or after filling of a preset amount.

(iv) *Static protection.* (*a*) Bonding facilities for protection against static sparks during the loading of tank vehicles through open domes shall be provided:

(*1*) Where Class I liquids are loaded, or

(2) Where Class II or Class III liquids are loaded into vehicles which may contain vapors from previous cargoes of Class I liquids.

(*b*) Protection as required in (*a*) of this subdivision (iv) shall consist of a metallic bond wire permanently electrically connected to the fill stem or to some part of the rack structure in electrical contact with the fill stem. The free end of such wire shall be provided with a clamp or equivalent device for convenient attachment to some metallic part in electrical contact with the cargo tank of the tank vehicle.

(*c*) Such bonding connection shall be made fast to the vehicle or tank before dome covers are raised and shall remain in place until filling is completed and all dome covers have been closed and secured.

(*d*) Bonding as specified in (*a*), (*b*), and (*c*) of this subdivision is not required:

(*1*) Where vehicles are loaded exclusively with products not having a static accumulating tendency, such as asphalt, most crude oils, residual oils, and water soluble liquids;

(2) Where no Class I liquids are handled at the loading facility and the tank vehicles loaded are used exclusively for Class II and Class III liquids; and

(3) Where vehicles are loaded or unloaded through closed bottom or top connections.

(*e*) Filling through open domes into the tanks of tank vehicles or tank cars, that contain vapor-air mixtures within the flammable range or where the liquid being filled can form such a mixture, shall be by means of a downspout which extends near the bottom of the tank. This precaution is not required when loading liquids which are nonaccumulators of static charges.

(v) *Stray currents.* Tank car loading facilities where Class I liquids are loaded through open domes shall be protected against stray currents by bonding the pipe to at least one rail and to the rack structure if of metal. Multiple lines entering the rack area shall be electrically bonded together. In addition, in areas where excessive stray currents are known to exist, all pipe entering the rack area shall be provided with insulating sections to electrically isolate the rack piping from the pipelines. No bonding between the tank car and the rack or piping is required during either loading or unloading of Class II or III liquids.

(vi) *Container filling facilities.* Class I liquids shall not be dispensed into containers unless the nozzle and container are electrically interconnected. Where the metallic floorplate on which the container stands while filling is electrically connected to the fill stem or where the fill stem is bonded to the container during filling operations by means of a bond wire, the provisions of this section shall be deemed to have been complied with.

(4) *Wharves*—(i) *Definition, application.* The term wharf shall mean any wharf, pier, bulkhead, or other structure over or contiguous to navigable water used in conjunction with a bulk plant, the primary function of which is the transfer of flammable or combustible liquid cargo in bulk between the bulk plant and any tank vessel, ship, barge, lighter boat, or other mobile floating craft; and this subparagraph shall apply to all such installations except Marine Service Stations as covered in paragraph (g) of this section.

(ii) *Package cargo.* Package cargo of flammable and combustible liquids, including full and empty drums, bulk fuel, and stores may be handled over a wharf and at such times and places as may be agreed upon by the wharf superintendent and the senior deck officer on duty.

(iii) *Location.* Wharves at which flammable or combustible liquid cargoes are to be transferred in bulk quantities to or from tank vessels shall be at least 100 feet from any bridge over a navigable waterway, or from an entrance to or superstructure of any vehicular or railroad tunnel under a waterway. The termination of the wharf loading or unloading fixed piping shall be at least 200 feet from a bridge or from an entrance to or superstructure of a tunnel.

(iv) *Design and construction.* Substructure and deck shall be substantially designed for the use intended. Deck may employ any material which will afford the desired combination of flexibility, resistance to shock, durability, strength, and fire resistance. Heavy timber construction is acceptable.

(v) *Tanks.* Tanks used exclusively for ballast water or Class II or Class III liquids may be installed on suitably designed wharves.

(vi) *Pumps.* Loading pumps capable of building up pressures in excess of the safe working pressure of cargo hose or loading arms shall be provided with bypasses, relief valves, or other arrangement to protect the loading facilities against excessive pressure. Relief devices shall be tested at not more than yearly intervals to determine that they function satisfactorily at the pressure at which they are set.

(vii) *Hoses and couplings.* All pressure hoses and couplings shall be inspected at intervals appropriate to the service. The hose and couplings shall be tested with the hose extended and using the "inservice maximum operating pressures." Any hose showing material deteriorations, signs of leakage, or weakness in its carcass or at the couplings shall be withdrawn from service and repaired or discarded.

(viii) *Piping and fittings.* Piping, valves, and fittings shall be in accordance with paragraph (c) of this section, with the following exceptions and additions:

(*a*) Flexibility of piping shall be assured by appropriate layout and arrangement of piping supports so that motion of the wharf structure resulting from wave action, currents, tides, or the mooring of vessels will not subject the pipe to repeated strain beyond the elastic limit.

(*b*) Pipe joints depending upon the friction characteristics of combustible materials or grooving of pipe ends for mechanical continuity of piping shall not be used.

(*c*) Swivel joints may be used in piping to which hoses are connected, and for articulated swivel-joint transfer systems, provided that the design is such that the mechanical strength of joint will not be impaired if the packing material should fail, as by exposure to fire.

(*d*) Piping systems shall contain a sufficient number of valves to operate the system properly and to control the flow of liquid in normal operation and in the event of physical damage.

(*e*) In addition to the requirements of subdivision (*d*) of this subdivision, each line conveying flammable liquids leading to a wharf shall be provided with a readily accessible block valve located on shore near the approach to the wharf and outside of any diked area. Where more

than one line is involved, the valves shall be grouped in one location.

(*f*) Means of easy access shall be provided for cargo line valves located below the wharf deck.

(*g*) Pipelines on flammable or combustible liquids wharves shall be adequately bonded and grounded. If excessive stray currents are encountered, insulting points shall be installed. Bonding and grounding connections on all pipelines shall be located on wharf-side of hose-riser insulating flanges, if used, and shall be accessible for inspection.

(*h*) Hose or articulated swivel-joint pipe connections used for cargo transfer shall be capable of accommodating the combined effects of change in draft and maximum tidal range, and mooring lines shall be kept adjusted to prevent the surge of the vessel from placing stress on the cargo transfer system.

(*i*) Hose shall be supported so as to avoid kinking and damage from chafing.

(vi) *Fire protection.* Suitable portable fire extinguishers with a rating of not less than 12–BC shall be located within 75 feet of those portions of the facility where fires are likely to occur, such as hose connections, pumps, and separator tanks.

(*a*) Where piped water is available, ready-connected fire hose in size appropriate for the water supply shall be provided so that manifolds where connections are made and broken can be reached by at least one hose stream.

(*b*) Material shall not be placed on wharves in such a manner as to obstruct access to firefighting equipment, or important pipeline control valves.

(*c*) Where the wharf is accessible to vehicle traffic, an unobstructed roadway to the shore end of the wharf shall be maintained for access of firefighting apparatus.

(vii) *Operations control.* Loading or discharging shall not commence until the wharf superintendent and officer in charge of the tank vessel agree that the tank vessel is properly moored and all connections are properly made. Mechanical work shall not be performed on the wharf during cargo transfer; except under special authorization based on a review of the area involved, methods to be employed, and precautions necessary.

(5) *Electrical equipment*—(i) *Application.* This subparagraph shall apply to areas where class I liquids are stored or handled. For areas where class II or class III liquids only are stored or handled, the electrical equipment may be installed in accordance with the provisions of subpart S of this part, for ordinary locations.

(ii) *Conformance.* All electrical equipment and wiring shall be of a type specified by and shall be installed in accordance with subpart S of this part.

(iii) *Classification.* So far as it applies Table H–18 shall be used to delineate and classify hazardous areas for the purpose of installation of electrical equipment under normal circumstances. In Table H–18 a classified area shall not extend beyond an unpierced wall, roof, or other solid partition. The area classifications listed shall be based on the premise that the installation meets the applicable requirements of this section in all respects.

(6) *Sources of ignition.* Class I liquids shall not be handled, drawn, or dispensed where flammable vapors may reach a source of ignition. Smoking shall be prohibited except in designated localities. "No Smoking" signs shall be conspicuously posted where hazard from flammable liquid vapors is normally present.

(7) *Drainage and waste disposal.* Provision shall be made to prevent flammable or combustible liquids which may be spilled at loading or unloading points from entering public sewers and drainage systems, or natural waterways. Connection to such sewers, drains, or waterways by which flammable or combustible liquids might enter shall be provided with separator boxes or other approved means whereby such entry is precluded. Crankcase drainings and flammable or combustible liquids shall not be dumped into sewers, but shall be stored in tanks or tight drums outside of any building until removed from the premises.

(8) *Fire control.* Suitable fire-control devices, such as small hose or portable fire extinguishers, shall be available to locations where fires are likely to occur. Additional fire-control equipment may be required where a tank of more than 50,000 gallons individual capacity contains class I liquids and where an unusual exposure hazard exists from surrounding property. Such additional fire-control equipment shall be sufficient to extinguish a fire in the largest tank. The design and amount of such equipment shall be in accordance with approved engineering standards.

TABLE H–18—ELECTRICAL EQUIPMENT HAZARDOUS AREAS—BULK PLANTS

Location	NEC Class I Group D division	Extent of classified area
Tank vehicle and tank car:[1]		
Loading through open dome	1	Within 3 feet of edge of dome, extending in all directions.
	2	Area between 3 feet and 5 feet from edge of dome, extending in all directions.
Loading through bottom connections with atmospheric venting.	1	Within 3 feet of point of venting to atmosphere extending in all directions.
	2	Area between 3 feet and 5 feet from point of venting to atmosphere, extending in all directions. Also up to 18 inches above grade within a horizontal radius of 10 feet from point of loading connection.
Loading through closed dome with atmospheric venting.	1	Within 3 feet of open end of vent, extending in all directions.
	2	Area between 3 feet and 5 feet from open end of vent, extending in all directions. Also within 3 feet of edge of dome, extending in all directions.
Loading through closed dome with vapor recovery.	2	Within 3 feet of point of connection of both fill and vapor lines, extending in all directions.
Bottom loading with vapor recovery or any bottom unloading.	2	Within 3 feet of point of connections extending in all directions. Also up to 18 inches above grade within a horizontal radius of 10 feet from point of connection.
Drum and container filling:		
Outdoors, or indoors with adequate ventilation.	1	Within 3 feet of vent and fill opening, extending in all directions.
	2	Area between 3 feet and 5 feet from vent or fill opening, extending in all directions. Also up to 18 inches above floor or grade level within a horizontal radius of 10 feet from vent or fill opening.
Outdoors, or indoors with adequate ventilation.	1	Within 3 feet of vent and fill opening, extending in all directions.
	2	Area between 3 feet and 5 feet from vent or fill opening, extending in all directions. Also up to 18 inches above floor or grade level within a horizontal radius of 10 feet from vent or fill opening.
Tank—Aboveground:		
Shell, ends, or roof and dike area	2	Within 10 feet from shell, ends, or roof of tank, Area inside dikes to level of top of dike.
Vent	1	Within 5 feet of open end of vent, extending in all directions.
	2	Area between 5 feet and 10 feet from open end of vent, extending in all directions.
Floating roof	1	Area above the roof and within the shell.
Pits:		
Without mechanical ventilation	1	Entire area within pit if any part is within a Division 1 or 2 classified area.
With mechanical ventilation	2	Entire area within pit if any part is within a Division 1 or 2 classified area.
Containing valves, fittings or piping, and not within a division 1 or 2 classified area.	2	Entire pit.
Pumps, bleeders, withdrawal fittings, meters and similar devices:		
Indoors	2	Within 5 feet of any edge of such devices, extending in all directions. Also up to 3 feet above floor or grade level within 25 feet horizontally from any edge of such devices.
Outdoors	2	Within 3 feet of any edge of such devices, extending in all directions. Also up to 18 inches above grade level within 10 feet horizontally from any edge of such devices.
Storage and repair garage for tank vehicles	1	All pits or spaces below floor level.
	2	Area up to 18 inches above floor or grade level for entire storage or repair garage.
Drainage ditches, separators, impounding basins.	2	Area up to 18 inches above ditch, separator or basin. Also up to 18 inches above grade within 15 feet horizontally from any edge.
Garages for other than tank vehicles	Ordinary	If there is any opening to these rooms within the extent of an outdoor classified area, the entire room shall be classified the same as the area classification at the point of the opening.
Outdoor drum storage	Ordinary	
Indoor warehousing where there is no flammable liquid transfer.	Ordinary	If there is any opening to these rooms within the extent of an indoor classified area, the room shall be classified the same as if the wall, curb or partition did not exist.
Office and rest rooms	Ordinary	

[1] When classifying the extent of the area, consideration shall be given to the fact that tank cars or tank vehicles may be spotted at varying points. Therefore, the extremities of the loading or unloading positions shall be used.

(g) *Service stations*—(1) *Storage and handling*—(i) *General provisions.* (*a*) Liquids shall be stored in approved closed containers not exceeding 60 gallons capacity, in tanks located underground, in tanks in special enclosures as described in subdivision (ii) of this subparagraph, or in aboveground tanks as provided for in subparagraphs (4)(ii) (*a*), (*b*), and (*c*) of this paragraph.

(*b*) Aboveground tanks, located in an adjoining bulk plant, may be connected by piping to service station underground tanks if, in addition to valves at aboveground tanks, a valve is also installed within control of service station personnel.

(*c*) Apparatus dispensing class I liquids into the fuel tanks of motor vehicles of the public shall not be located at a bulk plant unless separated by a fence or similar barrier from the area in which bulk operations are conducted.

(*d*) The provisions of (*a*) of this subdivision shall not prohibit the temporary use of movable tanks in conjunction with the dispensing of flammable or combustible liquids into the fuel tanks of motor vehicles or other motorized equipment on premises not normally accessible to the public. Such installations shall only be made under permit from the enforcing authority. The permit shall include a definite time limit.

(*e*) The provisions of (*a*) of this subdivision shall not prohibit the dispensing of flammable liquids in the open from a tank vehicle to a motor vehicle. Such dispensing shall be permitted provided:

(*1*) The tank vehicle complies with the requirements covered in the Standard on Tank Vehicles for Flammable Liquids, NFPA 385–1966.

(2) The dispensing is done on premises not open to the public.

(3) The motor vehicles are owned or operated by a commercial, industrial, or governmental agency.

(4) The dispensing hose does not exceed 50 feet in length.

(5) The dispensing nozzle is a listed automatic-closing type without a latch-open device.

(*f*) Class I liquids shall not be stored or handled within a building having a basement or pit into which flammable vapors may travel, unless such area is provided with ventilation designed to prevent the accumulation of flammable vapors therein.

(*g*) Accurate inventory records shall be maintained and reconciled on all class I liquid storage tanks for possible indication of leakage from tanks or piping.

(ii) *Special enclosures.* (*a*) When installation of tanks in accordance with paragraph (b)(3) of this section is impractical because of property or building limitations, tanks for flammable or combustible liquids may be installed in buildings if properly enclosed.

(*b*) The enclosure shall be substantially liquid and vaportight without backfill. Sides, top, and bottom of the enclosure shall be of reinforced concrete at least 6 inches thick, with openings for inspection through the top only. Tank connections shall be so piped or closed that neither vapors nor liquid can escape into the enclosed space. Means shall be provided whereby portable equipment may be employed to discharge to the outside any liquid or vapors which might accumulate should leakage occur.

(*c*) At automotive service stations provided in connection with tenant or customer parking facilities at or below grade level in large buildings of commercial, mercantile, or residential occupancy, tanks containing class I liquids, installed of necessity in accordance with (*b*) of this subdivision, shall not exceed 6,000 gallons individual or 18,000 gallons aggregate capacity.

(iii) *Inside buildings.* (*a*) Except where stored in tanks as provided in subdivision (ii) of this subparagraph, no class I liquids shall be stored within any service station building except in closed containers of aggregate capacity not exceeding 60 gallons. One container not exceeding 60 gallons capacity equipped with an approved pump is permitted.

(*b*) Class I liquids may be transferred from one container to another in lubrication or service rooms of a service station building provided the electrical installation complies with Table H–19 and provided that any heating equipment complies with subparagraph (6) of this paragraph.

(*c*) Class II and class III liquids may be stored and dispensed inside service station buildings from tanks of not more than 120 gallons capacity each.

(iv) *Labeling.* No sale or purchase of any class I, II, or III liquids shall be made in containers unless such containers are clearly marked with the name of the product contained therein.

(v) *Dispensing into portable containers.* No delivery of any class I liquids shall be made into portable containers unless the container is constructed of metal, has a tight closure with screwed or spring cover, and is fitted with a spout or so designed that the contents can be poured without spilling.

(2) *Private stations.* Service stations not accessible to or open to the public do not require an attendant or supervisor. Such stations may be used by commercial, industrial, governmental, or manufacturing establishments.

(3) *Dispensing systems*—(i) *Location.* Dispensing devices at automotive service stations shall be so located that all parts of the vehicle being served will be on the premises of the service station.

(ii) *Inside location.* Approved dispensing units may be located inside of buildings. The dispensing area shall be separated from other areas in an approved manner. The dispensing unit and its piping shall be mounted either on a concrete island or protected against collision damage by suitable means and shall be located in a position where it cannot be struck by a vehicle descending a ramp or other slope out of control. The dispensing area shall be provided with an approved mechanical or gravity ventilation system. When dispensing units are located below grade, only approved mechanical ventilation shall be used and the entire dispensing area shall be protected by an approved automatic sprinkler system. Ventilating systems shall be electrically interlocked with gasoline dispensing units so that the dispensing units cannot be operated unless the ventilating fan motors are energized.

(iii) *Emergency power cutoff.* A clearly identified and easily accessible switch(es) or a circuit breaker(s) shall be provided at a location remote from dispensing devices, including remote pumping systems, to shut off the power to all dispensing devices in the event of an emergency.

(iv) *Dispensing units.* (a) Class I liquids shall be transferred from tanks by means of fixed pumps so designed and equipped as to allow control of the flow and to prevent leakage or accidential discharge.

(*b*) Dispensing devices for class I liquids shall be of approved type.

(*c*) Class I liquids shall not be dispensed by pressure from drums, barrels, and similar containers. Approved pumps taking suction through the top of the container or approved self-closing faucets shall be used.

(*d*) The dispensing units, except those attached to containers, shall be mounted either on a concrete island or protected against collision damage by suitable means.

(v) *Remote Pumping systems.*

(*a*) This subdivision shall apply to systems for dispensing class I liquids where such liquids are transferred from storage to individual or multiple dispensing units by pumps located elsewhere than at the dispensing units.

(*b*) Pumps shall be designed or equipped so that no part of the system will be subjected to pressures above its allowable working pressure. Pumps installed above grade, outside of buildings, shall be located not less than 10 feet from lines of adjoining property which may be built upon, and not less than 5 feet from any building opening. When an outside pump location is impractical, pumps may be installed inside of buildings, as provided for dispensers in subdivision (ii) of this subparagraph, or in pits as provided in subdivision (*c*) of this subdivision. Pumps shall be substantially anchored and protected against physical damage by vehicles.

(*c*) Pits for subsurface pumps or piping manifolds of submersible pumps shall withstand the external forces to which they may be subjected without damage to the pump, tank, or piping. The pit shall be no larger than necessary for inspection and maintenance and shall be provided with a fitted cover.

(*d*) A control shall be provided that will permit the pump to operate only when a dispensing nozzle is removed from its bracket on the dispensing unit and the switch on this dispensing unit is manually actuated. This control shall also stop the pump when all nozzles have been returned to their brackets.

(*e*) An approved impact valve, incorporating a fusible link, designed to close automatically in the event of severe impact or fire exposure shall be properly installed in the dispensing supply line at

the base of each individual dispensing device.

(*f*) Testing. After the completion of the installation, including any paving, that section of the pressure piping system between the pump discharge and the connection for the dispensing facility shall be tested for at least 30 minutes at the maximum operating pressure of the system. Such tests shall be repeated at 5-year intervals thereafter.

(vi) *Delivery nozzles.* (*a*) Hose-nozzle valves of either the manual or automatic-closing type for dispensing class I liquids into a fuel tank or into a container shall be manually held open during the dispensing operation except as provided in subdivision (*b*) of this subdivision.

(*b*) On any service station dispenser accessible to the public a listed automatic type nozzle with hold-open latch is permitted only when all dispensing of class I liquids is to be done by the service station attendant.

(*c*) If the dispensing of class I liquids at a service station available and open to the public is to be done by a person other than the service station attendant, the nozzle shall be a listed automatic-closing type without a hold-open latch.

(vii) *Special type dispensers.* (*a*) Approved special dispensing devices such as, but not limited to, coin-operated, and remote preset types are permitted at service stations, provided there is at least one qualified attendant on duty while the station is open to the public.

(*b*) Emergency controls shall be installed at an acceptable location, but controls shall not be more than 100 feet from dispensers.

(*c*) Instructions for the operation of dispensers shall be conspicuously posted.

(4) *Marine service stations*—(i) *Dispensing.* (*a*) The dispensing area shall be located away from other structures so as to provide room for safe ingress and egress of craft to be fueled. Dispensing units shall in all cases be at least 20 feet from any activity involving fixed sources of ignition.

(*b*) Dispensing shall be by approved dispensing units with or without integral pumps and may be located on open piers, wharves, or floating docks or on shore or on piers of the solid fill type.

(*c*) Dispensing nozzles shall be automatic-closing without a hold-open latch.

(ii) *Tanks and pumps.* (*a*) Tanks, and pumps not integral with the dispensing unit, shall be on shore or on a pier of the solid fill type, except as provided in subdivisions (*b*) and (*c*) of this subdivision.

(*b*) Where shore location would require excessively long supply lines to dispensers, tanks may be installed on a pier provided that applicable portions of paragraph (b) of this section relative to spacing, diking, and piping are complied with and the quantity so stored does not exceed 1,100 gallons aggregate capacity.

(*c*) Shore tanks supplying marine service stations may be located above ground, where rock ledges or high water table make underground tanks impractical.

(*d*) Where tanks are at an elevation which would produce gravity head on the dispensing unit, the tank outlet shall be equipped with a pressure control valve positioned adjacent to and outside the tank block valve specified in paragraph (b) (2) (ix) (*b*) of this section, so adjusted that liquid cannot flow by gravity from the tank in case of piping or hose failure.

(iii) *Piping.* (*a*) Piping between shore tanks and dispensing units shall be as described in paragraph (*c*) of this section, except that, where dispensing is from a floating structure, suitable lengths of oil-resistant flexible hose may be employed between the shore piping and the piping on the floating structure as made necessary by change in water level or shoreline.

(*b*) A readily accessible valve to shut off the supply from shore shall be provided in each pipeline at or near the approach to the pier and at the shore end of each pipeline adjacent to the point where flexible hose is attached.

(*c*) Piping shall be located so as to be protected from physical damage.

(*d*) Piping handling Class I liquids shall be grounded to control stray currents.

(5) *Electrical equipment*—(i) *Application.* This subparagraph shall apply to areas where Class I liquids are stored or handled. For areas where Class II or Class III liquids are stored or handled the electrical equipment may be installed in accordance with the provisions of Subpart S of this part, for ordinary locations. All electrical equipment and wiring shall be of a type specified by and shall be installed in accordance with Subpart S of this part. So far as it applies, Table H–19 shall be used to delineate and classify hazardous areas for the purpose of installation of electrical equipment under normal circumstances. A classified area shall not extend beyond an unpierced wall, roof, or other solid partition. The area classifications listed shall be based on the assumption that the installation meets the applicable requirements of this section in all respects.

TABLE H–19—ELECTRICAL EQUIPMENT HAZARDOUS AREAS—SERVICE STATIONS

Location	NEC Class I, Group D division	Extent of classified area
Underground tank:		
Fill opening	1	Any pit, box or space below grade level, any part of which is within the Division 1 or 2 classified area.
	2	Up to 18 inches above grade level within a horizontal radius of 10 feet from a loose fill connection and within a horizontal radius of 5 feet from a tight fill connection.
Vent—Discharging upward	1	Within 3 feet of open end of vent, extending in all directions.
	2	Area between 3 feet and 5 feet of open end of vent, extending in all directions.
Dispenser:		
Pits	1	Any pit, box or space below grade level, any part of which is within the Division 1 or 2 classified area.
Dispenser enclosure	1	The area 4 feet vertically above base within the enclosure and 18 inches horizontally in all directions.
Outdoor	2	Up to 18 inches above grade level within 20 feet horizontally of any edge of enclosure.
Indoor:		
With mechanical ventilation	2	Up to 18 inches above grade or floor level within 20 feet horizontally of any edge of enclosure.
With gravity ventilation	2	Up to 18 inches above grade or floor level within 25 feet horizontally of any edge of enclosure.
Remote pump—Outdoor	1	Any pit, box or space below grade level if any part is within a horizontal distance of 10 feet from any edge of pump.
	2	Within 3 feet of any edge of pump, extending in all directions. Also up to 18 inches above grade level within 10 feet horizontally from any edge of pump.
Remote pump—Indoor	1	Entire area within any pit.
	2	Within 5 feet of any edge of pump, extending in all directions. Also up to 3 feet above floor or grade level within 25 feet horizontally from any edge of pump.
Lubrication or service room	1	Entire area within any pit.
	2	Area up to 18 inches above floor or grade level within entire lubrication room.
Dispenser for Class I Liquids	2	Within 3 feet of any fill or dispensin point, extending in all directions.
Special enclosure inside building per section 6020.	1	Entire enclosure.
Sales, storage and rest rooms	Ordinary	If there is any opening to these rooms within the extent of a Division 1 area, the entire room shall be classified as Division 1.

(6) *Heating equipment*—(i) *Conformance.* Heating equipment shall be installed as provided in subdivisions (ii) through (v) of this subparagraph.

(ii) *Application.* Heating equipment may be installed in the conventional manner in an area except as provided in subdivisions (iii), (iv), or (v) of this subparagraph.

(iii) *Special room.* Heating equipment may be installed in a special room separated from an area classified by Table H–19 by walls having a fire resistance rating of at least 1 hour and without any openings in the walls within 8 feet of the floor into an area classified in Table H–19. This room shall not be used for combustible storage and all air for combustion purposes shall come from outside the building.

(iv) *Work areas.* Heating equipment using gas or oil fuel may be installed in the lubrication, sales, or service room where there is no dispensing or transferring of Class I liquids provided the bottom of the combustion chamber is at least 18 inches above the floor and the heating equipment is protected from physical damage by vehicles. Heating equipment using gas or oil fuel listed for use in garages may be installed in the lubrication or service room where

Class I liquids are dispensed provided the equipment is installed at least 8 feet above the floor.

(v) *Electric heat.* Electrical heating equipment shall conform to subparagraph (5) of this paragraph.

(7) *Drainage and waste disposal.* Provision shall be made in the area where Class I liquids are dispensed to prevent spilled liquids from flowing into the interior of service station buildings. Such provision may be by grading driveways, raising door sills, or other equally effective means. Crankcase drainings and flammable or combustible liquids shall not be dumped into sewers but shall be stored in tanks or drums outside of any building until removed from the premises.

(8) *Sources of ignition.* In addition to the previous restrictions of this paragraph, the following shall apply: There shall be no smoking or open flames in the areas used for fueling, servicing fuel systems for internal combustion engines, receiving or dispensing of flammable or combustible liquids. Conspicuous and legible signs prohibiting smoking shall be posted within sight of the customer being served. The motors of all equipment being fueled shall be shut off during the fueling operation.

(9) *Fire control.* Each service station shall be provided with at least one fire extinguisher having a minimum approved classification of 6 B, C located so that an extinguisher will be within 75 feet of each pump, dispenser, underground fill pipe opening, and lubrication or service room.

(h) *Processing plants*—(1) *Scope.* This paragraph shall apply to those plants or buildings which contain chemical operations such as oxidation, reduction, halogenation, hydrogenation, alkylation, polymerization, and other chemical processes but shall not apply to chemical plants, refineries or distilleries.

(2) *Location*—(i) *Classification.* The location of each processing vessel shall be based upon its flammable or combustible liquid capacity. Processing vessels shall be located, with respect to distances to lines of adjoining property which may be built upon, in accordance with Table H–20, except when the processing plant is designed in accordance with subdivision (ii) of this subparagraph.

TABLE H–20

Processing vessels with emergency relief venting to permit pressure	Stable liquids	Unstable liquids
Not in excess of 2.5 p.s.i.g.	Table H–9	2½ times Table H–9.
Over 2.5 p.s.i.g	1½ times Table H–9.	4 times Table H–9.

(ii) *Exception.* The distances required in subdivision (i) of this subparagraph may be waived when the vessels are housed within a building and the exterior wall facing the line of adjoining property which may be built upon is a blank wall having a fire-resistance rating of not less than 4 hours. When Class IA or unstable liquids are handled, the blank wall shall have explosion resistance in accordance with good engineering practice, see subparagraph (3) (iv) of this paragraph.

(3) *Processing building*—(i) *Construction.* (*a*) Processing buildings shall be of fire-resistance or noncombustible construction, except heavy timber construction with load-bearing walls may be permitted for plants utilizing only stable Class II or Class III liquids. Except as provided in subparagraph (2) (ii) of this paragraph or in the case of explosion resistant walls used in conjunction with explosion relieving facilities, see subparagraph (3) (iv) of this paragraph, load-bearing walls are prohibited. Buildings shall be without basements or covered pits.

(*b*) Areas shall have adequate exit facilities arranged to prevent occupants from being trapped in the event of fire. Exits shall not be exposed by the drainage facilities described in subdivision (ii) of this subparagraph.

(ii) *Drainage.* (*a*) Emergency drainage systems shall be provided to direct flammable or combustible liquid leakage and fire protection water to a safe location. This may require curbs, scuppers, or special drainage systems to control the spread of fire, see paragraph (b) (2) (vii) (*b*) of this section.

(*b*) Emergency drainage systems, if connected to public sewers or discharged into public waterways, shall be equipped with traps or separators.

(*c*) The processing plant shall be designed and operated to prevent the normal discharge of flammable or combustible liquids to public waterways, public sewers, or adjoining property.

(iii) *Ventilation.* (*a*) Enclosed processing buildings shall be ventilated at a rate of not less than 1 cubic foot per minute per square foot of solid floor area. This shall be accomplished by natural or mechanical ventilation with discharge or exhaust to a safe location outside of the building. Provision shall be made for introduction of makeup air in such a manner as not to short circuit the ventilation. Ventilation shall be arranged to include all floor areas or pits where flammable vapors may collect.

(*b*) Equipment used in a building and the ventilation of the building shall be designed so as to limit flammable vapor-air mixtures under normal operating conditions to the interior of equipment, and to not more than 5 feet from equipment which exposes Class I liquids to the air. Examples of such equipment are dispensing stations, open centrifuges, plate and frame filters, open vacuum filters, and surfaces of open equipment.

(iv) *Explosion relief.* Areas where Class IA or unstable liquids are processed shall have explosion venting through one or more of the following methods:

(*a*) Open air construction.

(*b*) Lightweight walls and roof.

(*c*) Lightweight wall panels and roof hatches.

(*d*) Windows of explosion venting type.

(4) *Liquid handling*—(i) *Storage.* (*a*) The storage of flammable or combustible liquids in tanks shall be in accordance with the applicable provisions of paragraph (b) of this section.

(*b*) If the storage of flammable or combustible liquids in outside aboveground or underground tanks is not practical because of temperature or production considerations, tanks may be permitted inside of buildings or structures in accordance with the applicable provisions of paragraph (b) of this section.

(*c*) Storage tanks inside of buildings shall be permitted only in areas at or above grade which have adequate drainage and are separated from the processing area by construction having a fire resistance rating of at least 2 hours.

(*d*) The storage of flammable or combustible liquids in containers shall be in accordance with the applicable provisions of paragraph (d) of this section.

(ii) *Piping, valves, and fittings.* (*a*) Piping, valves, and fittings shall be in accordance with paragraph (c) of this section.

(*b*) Approved flexible connectors may be used where vibration exists or where frequent movement is necessary. Approved hose may be used at transfer stations.

(*c*) Piping containing flammable or combustible liquids shall be identified.

(iii) *Transfer.* (*a*) The transfer of large quantities of flammable or combustible liquids shall be through piping by means of pumps or water displacement. Except as required in process equipment, gravity flow shall not be used. The use of compressed air as a transferring medium is prohibited.

(*b*) Positive displacement pumps shall be provided with pressure relief discharging back to the tank or to pump suction.

(iv) *Equipment.* (*a*) Equipment shall be designed and arranged to prevent the unintentional escape of liquids and vapors and to minimize the quantity escaping in the event of accidental release.

(*b*) Where the vapor space of equipment is usually within the flammable range, the probability of explosion damage to the equipment can be limited by inerting, by providing an explosion suppression system, or by designing the equipment to contain the peak explosion pressure which may be modified by explosion relief. Where the special hazards of operation, sources of ignition, or exposures indicate a need, consideration shall be given to providing protection by one or more of the above means.

(5) *Tank vehicle and tank car loading and unloading.* Tank vehicle and tank car loading or unloading facilities shall be separated from aboveground tanks, warehouses, other plant buildings, or nearest line of adjoining property which may be built upon by a distance of 25 feet for class I liquids and 15 feet for class II and class III liquids measured from the nearest position of any fill stem. Buildings for pumps or shelters for personnel may be a part of the facility. Operations of the facility shall comply

with the appropriate portions of paragraph (f)(3) of this section.

(6) *Fire control*—(i) *Portable extinguishers.* Approved portable fire extinguishers of appropriate size, type, and number shall be provided.

(ii) *Other controls.* Where the special hazards of operation or exposure indicate a need, the following fire control provision shall be provided.

(*a*) A reliable water supply shall be available in pressure and quantity adequate to meet the probable fire demands.

(*b*) Hydrants shall be provided in accordance with accepted good practice.

(*c*) Hose connected to a source of water shall be installed so that all vessels, pumps, and other equipment containing flammable or combustible liquids can be reached with at least one hose stream. Nozzles that are capable of discharging a water spray shall be provided.

(*d*) Processing plants shall be protected by an approved automatic sprinkler system or equivalent extinguishing system. If special extinguishing systems including but not limited to those employing foam, carbon dioxide, or dry chemical are provided, approved equipment shall be used and installed in an approved manner.

(iii) *Alarm systems.* An approved means for prompt notification of fire to those within the plant and any public fire department available shall be provided. It may be advisable to connect the plant system with the public system where public fire alarm system is available.

(iv) *Maintenance.* All plant fire protection facilities shall be adequately maintained and periodically inspected and tested to make sure they are always in satisfactory operating condition and that they will serve their purpose in time of emergency.

(7) *Sources of ignition*—(i) *General.* (*a*) Precautions shall be taken to prevent the ignition of flammable vapors. Sources of ignition include but are not limited to open flames; lightning; smoking; cutting and welding; hot surfaces; frictional heat; static, electrical, and mechanical sparks; spontaneous ignition, including heat-producing chemical reactions; and radiant heat.

(*b*) Class I liquids shall not be dispensed into containers unless the nozzle and container are electrically interconnected. Where the metallic floorplate on which the container stands while filling is electrically connected to the fill stem or where the fill stem is bonded to the container during filling operations by means of a bond wire, the provisions of this section shall be deemed to have been complied with.

(ii) *Maintenance and repair.* (*a*) When necessary to do maintenance work in a flammable or combustible liquid processing area, the work shall be authorized by a responsible representative of the employer.

(*b*) Hot work, such as welding or cutting operations, use of spark-producing power tools, and chipping operations shall be permitted only under supervision of an individual in responsible charge who shall make an inspection of the area to be sure that it is safe for the work to be done and that safe procedures will be followed for the work specified.

(iii) *Electrical.* (*a*) All electrical wiring and equipment within storage or processing areas shall be installed in accordance with nationally recognized good practice.

(*b*) Locations where flammable vapor-air mixtures may exist under normal operations shall be classified Class I, Division 1 according to the requirements of Subpart S of this part. For those pieces of equipment installed in accordance with subparagraph (3)(iii)(*b*) of this paragraph, the Division 1 area shall extend 5 feet in all directions from all points of vapor liberation. All areas within pits shall be classified Division 1 if any part of the pit is within a Division 1 or 2 classified area, unless the pit is provided with mechanical ventilation.

(*c*) Locations where flammable vapor-air mixtures may exist under abnormal conditions and for a distance beyond Division 1 locations shall be classified Division 2 according to the requirements of Subpart S of this Part. These locations include an area within 20 feet horizontally, 3 feet vertically beyond a Division 1 area, and up to 3 feet above floor or grade level within 25 feet, if indoors, or 10 feet if outdoors, from any pump, bleeder, withdrawal fitting, meter, or similar device handling Class I liquids. Pits provided with adequate mechanical ventilation within a Division 1 or 2 area shall be classified Division 2. If Class II or Class III liquids only are handled, then ordinary electrical equipment is satisfactory though care shall be used in locating electrical apparatus to prevent hot metal from falling into open equipment.

(*d*) Where the provisions of (*a*), (*b*), and (*c*), of this subdivision (iii) require the installation of explosion-proof equipment, ordinary electrical equipment including switchgear may be used if installed in a room or enclosure which is maintained under positive pressure with respect to the hazardous area. Ventilation makeup air shall be uncontaminated by flammable vapors.

(8) *Housekeeping*—(i) *General.* Maintenance and operating practices shall be in accordance with established procedures which will tend to control leakage and prevent the accidental escape of flammable or combustible liquids. Spills shall be cleaned up promptly.

(ii) *Access.* Adequate aisles shall be maintained for unobstructed movement of personnel and so that fire protection equipment can be brought to bear on any part of the processing equipment.

(iii) *Waste and residues.* Combustible waste material and residues in a building or operating area shall be kept to a minimum, stored in closed metal waste cans, and disposed of daily.

(iv) *Clear zone.* Ground area around buildings and operating areas shall be kept free of tall grass, weeds, trash, or other combustible materials.

(i) *Refineries, chemical plants, and distilleries*—(1) *Storage tanks.* Flammable or combustile liquids shall be stored in tanks, in containers, or in portable tanks. Tanks shall be installed in accordance with paragraph (b) of this section. Tanks for the storage of flammable or combustile liquids in tank farms and in locations other than process areas shall be located in accordance with paragraph (b)(2) (i) and (ii) of this section.

(2) *Wharves.* Wharves handling flammable or combustible liquids shall be in accordance with paragraph (f)(4) of this section.

(3) *Fired and unfired pressure vessels.*—(i) *Fired vessels.* Fired pressure vessels shall be constructed in accordance with the Code for Fired Pressure Vessels, section I of the ASME Boiler and Pressure Vessel Code—1968.

(ii) Unfired vessels shall be constructed in accordance with the Code for Unfired Pressure Vessels, section VIII of the ASME Boiler and Pressure Vessel Code—1968.

(4) *Location of process units.* Process units shall be located so that they are accessible from at least one side for the purpose of fire control. Where topographical conditions are such that flammable or combustible liquids may flow from a processing area so as to constitute a fire hazard to property of others, provision shall be made to divert or impound the flow by curbs, drains, or other suitable means.

(5) *Fire control*—(i) *Portable equipment.* Portable fire extinguishment and control equipment shall be provided in such quantities and types as are needed for the special hazards of operation and storage.

(ii) *Water supply.* Water shall be available in volume and at adequate pressure to supply water hose streams, foam producing equipment, automatic sprinklers, or water spray systems as the need is indicated by the special hazards of operation and storage.

(iii) *Special equipment.* Special extinguishing equipment such as that utilizing foam, inert gas, or dry chemical shall be provided as the need is indicated by the special hazards of operation and storage.

§ 1910.107 Spray finishing using flammable and combustible materials.

(a) *Definitions applicable to this section*—(1) *Aerated solid powders.* Aerated powders shall mean any powdered material used as a coating material which shall be fluidized within a container by passing air uniformly from below. It is common practice to fluidize such materials to form a fluidized powder bed and then dip the part to be coated into the bed in a manner similar to that used in liquid dipping. Such beds are also used as sources for powder spray operations.

(2) *Spraying area.* Any area in which dangerous quantities of flammable vapors or mists, or combustible residues, dusts, or deposits are present due to the operation of spraying processes.

(3) *Spray booth.* A power-ventilated structure provided to enclose or accommodate a spraying operation to confine and limit the escape of spray, vapor, and residue, and to safely conduct or direct them to an exhaust system.

(4) *Waterwash spray booth.* A spray booth equipped with a water washing system designed to minimize dusts or residues entering exhaust ducts and to permit the recovery of overspray finishing material.

(5) *Dry spray booth.* A spray booth not equipped with a water washing system as described in subparagraph (3) of this paragraph. A dry spray booth may be equipped with (i) distribution or baffle plates to promote an even flow of air through the booth or cause the deposit of overspray before it enters the exhaust duct; or (ii) overspray dry filters to minimize dusts; or (iii) overspray dry filters to minimize dusts or residues entering exhaust ducts; or (iv) overspray dry filter rolls designed to minimize dusts or residues entering exhaust ducts; or (v) where dry powders are being sprayed, with powder collection systems so arranged in the exhaust to capture oversprayed material.

(6) *Fluidized bed.* A container holding powder coating material which is aerated from below so as to form an air-supported expanded cloud of such material through which the preheated object to be coated is immersed and transported.

(7) *Electrostatic fluidized bed.* A container holding powder coating material which is aerated from below so as to form an air-supported expanded cloud of such material which is electrically charged with a charge opposite to the charge of the object to be coated; such object is transported through the container immediately above the charged and aerated materials in order to be coated.

(8) *Approved.* Shall mean approved and listed by the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

(9) *Listed.* See "approved" in § 1910.107 (a)(8).

(b) *Spray booths*—(1) *Construction.* Spray booths shall be substantially constructed of steel not thinner than No. 18 U.S. gauge, securely and rigidly supported, or of concrete or masonry, except that aluminum or other substantial noncombustible material may be used for intermittent or low volume spraying. Spray booths shall be designed to sweep air currents toward the exhaust outlet.

(2) *Interiors.* The interior surfaces of spray booths shall be smooth and continuous without edges and otherwise designed to prevent pocketing of residues and facilitate cleaning and washing without injury.

(3) *Floors.* The floor surface of a spray booth and operator's working area, if combustible, shall be covered with noncombustible material of such character as to facilitate the safe cleaning and removal of residues.

(4) *Distribution or baffle plates.* Distribution or baffle plates, if installed to promote an even flow of air through the booth or cause the deposit of overspray before it enters the exhaust duct, shall be of noncombustible material and readily removable or accessible on both sides for cleaning. Such plates shall not be located in exhaust ducts.

(5) *Dry type overspray collectors — (exhaust air filters).* In conventional dry type spray booths, overspray dry filters or filter rolls, if installed, shall conform to the following:

(i) The spraying operations except electrostatic spraying operations shall be so designed, installed and maintained that the average air velocity over the open face of the booth (or booth cross section during spraying operations) shall be not less than 100 linear feet per minute. Electrostatic spraying operations may be conducted with an air velocity over the open face of the booth of not less than 60 linear feet per minute, or more, depending on the volume of the finishing material being applied and its flammability and explosion characteristics. Visible gauges or audible alarm or pressure activated devices shall be installed to indicate or insure that the required air velocity is maintained. Dry spray booths equipped with a filter roll which is automatically advanced when the air velocity is reduced to that specified in this subdivision should be arranged to cause shutdown of spraying operations if the filter roll fails to advance automatically. Maintenance procedures should be established to assure replacing filter pads before excessive restriction to airflow occurs. Filter pads should be inspected after each period of use and clogged filter pads discarded and replaced. Filter rolls shall be inspected to insure proper replacement of filter media.

(ii) All discarded filter pads and filter rolls shall be immediately removed to a safe, well-detached location or placed in a water-filled metal container and disposed of at the close of the day's operation unless maintained completely in water.

(iii) The location of filters in a spray booth shall be so as to not reduce the effective booth enclosure of the articles being sprayed.

(iv) Space within the spray booth on the downstream and upstream sides of filters shall be protected with approved automatic sprinklers.

(v) Filters or filter rolls shall not be used when applying a spray material know to be highly susceptible to spontaneous heating and ignition.

(vi) Clean filters or filter rolls shall be noncombustible or of a type having a combustibility not in excess of class 2 filters as listed by Underwriters' Laboratories, Inc. Filters and filter rolls shall not be alternately used for different types of coating materials, where the combination of materials may be conducive to spontaneous ignition. See also paragraph (e)(6) of this section.

(6) *Frontal area.* Each spray booth having a frontal area larger than 9 square feet shall have a metal deflector or curtain not less than 2½ inches deep installed at the upper outer edge of the booth over the opening.

(7) *Conveyors.* Where conveyors are arranged to carry work into or out of spray booths, the openings therefor shall be as small as practical.

(8) *Separation of operations.* Each spray booth shall be separated from other operations by not less than 3 feet, or by a greater distance, or by such partition or wall as to reduce the danger from juxtaposition of hazardous operations. See also paragraph (c)(1) of this section.

(9) *Cleaning.* Spray booths shall be so installed that all portions are readily accessible for cleaning. A clear space of not less than 3 feet on all sides shall be kept free from storage or combustible construction.

(10) *Illumination.* When spraying areas are illuminated through glass panels or other transparent materials, only fixed lighting units shall be used as a source of illumination. Panels shall effectively isolate the spraying area from the area in which the lighting unit is located, and shall be of a noncombustible material of such a nature or so protected that breakage will be unlikely. Panels shall be so arranged that normal accumulations of residue on the exposed surface of the panel will not be raised to a dangerous temperature by radiation or conduction from the source of illumination.

(c) *Electrical and other sources of ignition*—(1) *Conformance.* All electrical equipment, open flames and other sources of ignition shall conform to the requirements of this paragraph, except as follows:

(i) Electrostatic apparatus shall conform to the requirements of paragraphs (h) and (i) of this section;

(ii) Drying, curing, and fusion apparatus shall conform to the requirements of paragraph (j) of this section;

(iii) Automobile undercoating spray operations in garages shall conform to the requirements of paragraph (k) of this section.

(iv) Powder coating equipment shall conform to the requirements of paragraph (1) of this section.

(2) *Minimum separation.* There shall be no open flame or spark producing equipment in any spraying area nor within 20 feet thereof, unless separated by a partition.

(3) *Hot surfaces.* Space-heating appliances, steampipes, or hot surfaces shall not be located in a spraying area where deposits of combustible residues may readily accumulate.

(4) *Wiring conformance.* Electrical wiring and equipment shall conform to the provisions of this paragraph and shall otherwise be in accordance with subpart S of this part.

(5) *Combustible residues, areas.* Unless specifically approved for locations containing both deposits of readily ignitable residue and explosive vapors, there shall be no electrical equipment in any spraying area, whereon deposits of combustible residues may readily accumulate, except wiring in rigid conduit or in boxes or fittings containing no taps, splices, or terminal connections.

(6) *Wiring type approved.* Electrical wiring and equipment not subject to deposits of combustible residues but located in a spraying area as herein defined shall

be of explosion-proof type approved for class I, group D locations and shall otherwise conform to the provisions of subpart S of this part, for Class I, Division 1, Hazardous Locations. Electrical wiring, motors, and other equipment outside of but within twenty (20) feet of any spraying area, and not separated therefrom by partitions, shall not produce sparks under normal operating conditions and shall otherwise conform to the provisions of subpart S of this part for Class I, Division 2 Hazardous Locations.

(7) *Lamps.* Electric lamps outside of, but within twenty (20) feet of any spraying area, and not separated therefrom by a partition, shall be totally enclosed to prevent the falling of hot particles and shall be protected from mechanical injury by suitable guards or by location.

(8) *Portable lamps.* Portable electric lamps shall not be used in any spraying area during spraying operations. Portable electric lamps, if used during cleaning or repairing operations, shall be of the type approved for hazardous class I locations.

(9) *Grounding.* (i) All metal parts of spray booths, exhaust ducts, and piping systems conveying flammable or combustible liquids or aerated solids shall be properly electrically grounded in an effective and permanent manner.

(ii) "Airless" high-fluid pressure spray guns and any conductive object being sprayed should be properly electrically grounded.

(d) *Ventilation*—(1) *Conformance.* Ventilating and exhaust systems shall be in accordance with the Standard for Blower and Exhaust Systems for Vapor Removal, NFPA No. 91–1961, where applicable and shall also conform to the provisions of this section.

(2) *General.* All spraying areas shall be provided with mechanical ventilation adequate to remove flammable vapors, mists, or powders to a safe location and to confine and control combustible residues so that life or property is not endangered. Mechanical ventilation shall be kept in operation at all times while spraying operations are being conducted and for a sufficient time thereafter to allow vapors from drying coated articles and drying finishing material residue to be exhausted.

(3) *Independent exhaust.* Each spray booth shall have an independent exhaust duct system discharging to the exterior of the building, except that multiple cabinet spray booths in which identical spray finishing material is used with a combined frontal area of not more than 18 square feet may have a common exhaust. If more than one fan serves one booth, all fans shall be so interconnected that one fan cannot operate without all fans being operated.

(4) *Fan-rotating element.* The nonrotating element shall be nonferrous or nonsparking or the casing shall consist of or be lined with such material. There shall be ample clearance between the fan-rotating element and the fan casing to avoid a fire by friction, necessary allowance being made for ordinary expansion and loading to prevent contact between moving parts and the duct or fan housing. Fan blades shall be mounted on a shaft sufficiently heavy to maintain perfect alignment even when the blades of the fan are heavily loaded, the shaft preferably to have bearings outside the duct and booth. All bearings shall be of the self-lubricating type, or lubricated from the outside duct.

(5) *Electric motors.* Electric motors driving exhaust fans shall not be placed inside booths or ducts. See also paragraph (c) of this section.

(6) *Belts.* Belts shall not enter the duct or booth unless the belt and pulley within the duct or booth are thoroughly enclosed.

(7) *Exhaust ducts.* Exhaust ducts shall be constructed of steel and shall be substantially supported. Exhaust ducts without dampers are preferred; however, if dampers are installed, they shall be maintained so that they will be in a full open position at all times the ventilating system is in operation.

(i) Exhaust ducts shall be protected against mechanical damage and have a clearance from unprotected combustible construction or other combustible material of not less than 18 inches.

(ii) If combustible construction is provided with the following protection applied to all surfaces within 18 inches, clearances may be reduced to the distances indicated:

(*a*) 28-gage sheet metal on ¼-inch asbestos mill board.	12 inches.
(*b*) 28-gage sheet metal on ⅛-inch asbestos mill board spaced out 1 inch on noncombustible spacers.	9 inches.
(*c*) 22-gage sheet metal on 1-inch rockwool batts reinforced with wire mesh or the equivalent.	3 inches.
(*d*) Where ducts are protected with an approved automatic sprinkler system, properly maintained, the clearance required in subdivision (i) of this subparagraph may be reduced to	6 inches.

(8) *Discharge clearance.* Unless the spray booth exhaust duct terminal is from a water-wash spray booth, the terminal discharge point shall be not less than 6 feet from any combustible exterior wall or roof nor discharge in the direction of any combustible construction or unprotected opening in any noncombustible exterior wall within 25 feet.

(9) *Air exhaust.* Air exhaust from spray operations shall not be directed so that it will contaminate makeup air being introduced into the spraying area or other ventilating intakes, nor directed so as to create a nuisance. Air exhausted from spray operations shall not be recirculated.

(10) *Access doors.* When necessary to facilitate cleaning, exhaust ducts shall be provided with an ample number of access doors.

(11) *Room intakes.* Air intake openings to rooms containing spray finishing operations shall be adequate for the efficient operation of exhaust fans and shall be so located as to minimize the creation of dead air pockets.

(12) *Drying spaces.* Freshly sprayed articles shall be dried only in spaces provided with adequate ventilation to prevent the formation of explosive vapors. In the event adequate and reliable ventilation is not provided such drying spaces shall be considered a spraying area. See also paragraph (j) of this section.

(e) *Flammable and combustible liquids—storage and handling*—(1) *Conformance.* The storage of flammable or combustible liquids in connection with spraying operations shall conform to the requirements of § 1910.106, where applicable.

(2) *Quantity.* The quantity of flammable or combustible liquids kept in the vicinity of spraying operations shall be the minimum required for operations and should ordinarily not exceed a supply for 1 day or one shift. Bulk storage of portable containers of flammable or combustible liquids shall be in a separate, constructed building detached from other important buildings or cut off in a standard manner.

(3) *Containers.* Original closed containers, approved portable tanks, approved safety cans or a properly arranged system of piping shall be used for bringing flammable or combustible liquids into spray finishing room. Open or glass containers shall not be used.

(4) *Transferring liquids.* Except as provided in subparagraph (5) of this paragraph the withdrawal of flammable and combustible liquids from containers having a capacity of greater than 60 gallons shall be by approved pumps. The withdrawal of flammable or combustible liquids from containers and the filling of containers, including portable mixing tanks, shall be done only in a suitable mixing room or in a spraying area when the ventilating system is in operation. Adequate precautions shall be taken to protect against liquid spillage and sources of ignition.

(5) *Spraying containers.* Containers supplying spray nozzles shall be of closed type or provided with metal covers kept closed. Containers not resting on floors shall be on metal supports or suspended by wire cables. Containers supplying spray nozzles by gravity flow shall not exceed 10 gallons capacity. Original shipping containers shall not be subject to air pressure for supplying spray nozzles. Containers under air pressure supplying spray nozzles shall be of limited capacity, not exceeding that necessary for 1 day's operation; shall be designed and approved for such use; shall be provided with a visible pressure gage; and shall be provided with a relief valve set to operate in conformance with the requirements of the Code for Unfired Pressure Vessels, Section VIII of the ASME Boiler and Pressure Vessel Code—1968. Containers under air pressure supplying spray nozzles, air-storage tanks and coolers shall conform to the standards of the Code for Unfired Pressure Vessels, Section VIII of the ASME Boiler and Pressure Vessel Code—1968 for construction, tests, and maintenance.

(6) *Pipes and hoses.* (i) All containers or piping to which is attached a hose or

flexible connection shall be provided with a shutoff valve at the connection. Such valves shall be kept shut when spraying operations are not being conducted.

(ii) When a pump is used to deliver products, automatic means shall be provided to prevent pressure in excess of the design working pressure of accessories, piping, and hose.

(iii) All pressure hose and couplings shall be inspected at regular intervals appropriate to this service. The hose and couplings shall be tested with the hose extended, and using the "inservice maximum operating pressures." Any hose showing material deteriorations, signs of leakage, or weakness in its carcass or at the couplings, shall be withdrawn from service and repaired or discarded.

(iv) Piping systems conveying flammable or combustible liquids shall be of steel or other material having comparable properties of resistance to heat and physical damage. Piping systems shall be properly bonded and grounded.

(7) *Spray liquid heaters.* Electrically powered spray liquid heaters shall be approved and listed for the specific location in which used (see paragraph (c) of this section). Heaters shall not be located in spray booths nor other locations subject to the accumulation of deposits or combustible residue. Agitators, if used, should preferably be driven by compressed air, water, or low-pressure steam. If an electric motor is used, see paragraph (c) of this section.

(8) *Pump relief.* If flammable or combustible liquids are supplied to spray nozzles by positive displacement pumps, the pump discharge line shall be provided with an approved relief valve discharging to a pump suction or a safe detached location, or a device provided to stop the prime mover if the discharge pressure exceeds the safe operating pressure of the system.

(9) *Grounding.* Whenever flammable or combustible liquids are transferred from one container to another, both containers shall be effectively bonded and grounded to prevent discharge sparks of static electricity.

(f) *Protection*—(1) *Conformance.* In sprinklered buildings, the automatic sprinkler system in rooms containing spray finishing operations shall conform to the Standard for the Installation of Sprinkler Systems. NFPA 13–1969, provisions for Extra Hazard Occupancy, and in unsprinklered buildings where sprinklers are installed only to protect spraying areas, the installation shall conform to such standards insofar as they may be applicable. Sprinkler installations shall also conform to the provisions of this paragraph. Sprinkler heads shall be located to effect water distribution throughout the entire booth.

(2) *Valve access.* Automatic sprinklers protecting each spray booth (together with its connecting exhaust) shall be under an accessibly located separate outside stem and yoke (OS&Y) subcontral valve.

(3) *Cleaning of heads.* Sprinklers protecting spraying areas shall be kept as free from deposits as practical by cleaning daily if necessary. (See also paragraph (g) of this section.)

(4) *Portable extinguishers.* An adequate supply of suitable portable fire extinguishers shall be installed near all spraying areas.

(g) *Operations and maintenance.*—(1) *Spraying.* Spraying shall not be conducted outside of predetermined spraying areas.

(2) *Cleaning.* All spraying areas shall be kept as free from the accumulation of deposits of combustible residues as practical, with cleaning conducted daily if necessary. Scrapers, spuds, or other such tools used for cleaning purposes shall be of nonsparking material.

(3) *Residue disposal.* Residue scrapings and debris contaminated with residue shall be immediately removed from the premises and properly disposed of. Approved metal waste cans shall be provided wherever rags or waste are impregnated with finishing material and all such rags or waste deposited therein immediately after use. The contents of waste cans shall be properly disposed of at least once daily or at the end of each shift.

(4) *Clothing storage.* Spray finishing employees' clothing shall not be left on the premises overnight unless kept in metal lockers.

(5) *Cleaning solvents.* The use of solvents for cleaning operations shall be restricted to those having flashpoints not less than 100° F.; however, for cleaning spray nozzles and auxiliary equipment, solvents having flashpoints not less than those normally used in spray operations may be used. Such cleaning shall be conducted inside spray booths and ventilating equipment operating during cleaning.

(6) *Hazardous materials combinations.* Spray booths shall not be alternately used for different types of coating materials, where the combination of the materials may be conducive to spontaneous ignition, unless all deposits of the first used material are removed from the booth and exhaust ducts prior to spraying with the second used material.

(7) *"No Smoking" signs.* "No smoking" signs in large letters on contrasting color background shall be conspicuously posted at all spraying areas and paint storage rooms.

(h) *Fixed electrostatic apparatus*—(1) *Conformance.* Where installation and use of electrostatic spraying equipment is used, such installation and use shall conform to all other paragraphs of this section, and shall also conform to the requirements of this paragraph.

(2) *Type approval.* Electrostatic apparatus and devices used in connection with coating operations shall be of approved types.

(3) *Location.* Transformers, power packs, control apparatus, and all other electrical portions of the equipment, with the exception of high-voltage grids, electrodes, and electrostatic atomizing heads and their connections, shall be located outside of the spraying area, or shall otherwise conform to the requirements of paragraph (c) of this section.

(4) *Support.* Electrodes and electrostatic atomizing heads shall be adequately supported in permanent locations and shall be effectively insulated from the ground. Electrodes and electrostatic atomizing heads which are permanently attached to their bases, supports, or reciprocators, shall be deemed to comply with this section. Insulators shall be nonporous and noncombustible.

(5) *Insulators, grounding.* High-voltage leads to electrodes shall be properly insulated and protected from mechanical injury or exposure to destructive chemicals. Electrostatic atomizing heads shall be effectively and permanently supported on suitable insulators and shall be effectively guarded against accidental contact or grounding. An automatic means shall be provided for grounding the electrode system when it is electrically deenergized for any reason. All insulators shall be kept clean and dry.

(6) *Safe distance.* A safe distance shall be maintained between goods being painted and electrodes or electrostatic atomizing heads or conductors of at least twice the sparking distance. A suitable sign indicating this safe distance shall be conspicuously posted near the assembly.

(7) *Conveyors required.* Goods being painted using this process are to be supported on conveyors. The conveyors shall be so arranged as to maintain safe distances between the goods and the electrodes or electrostatic atomizing heads at all times. Any irregularly shaped or other goods subject to possible swinging or movement shall be rigidly supported to prevent such swinging or movement which would reduce the clearance to less than that specified in subparagraph (6) of this paragraph.

(8) *Prohibition.* This process is not acceptable where goods being coated are manipulated by hand. When finishing materials are applied by electrostatic equipment which is manipulated by hand, see paragraph (i) of this section for applicable requirements.

(9) *Fail-safe controls.* Electrostatic apparatus shall be equipped with automatic controls which will operate without time delay to disconnect the power supply to the high voltage transformer and to signal the operator under any of the following conditions:

(i) Stoppage of ventilating fans or failure of ventilating equipment from any cause.

(ii) Stoppage of the conveyor carrying goods through the high voltage field.

(iii) Occurrence of a ground or of an imminent ground at any point on the high voltage system.

(iv) Reduction of clearance below that specified in subparagraph (6) of this paragraph.

(10) *Guarding.* Adequate booths, fencing, railings, or guards shall be so placed about the equipment that they, either by their location or character or both, assure that a safe isolation of the process is maintained from plant storage or personnel. Such railings, fencing, and guards shall be of conducting material, adequately grounded.

(11) *Ventilation.* Where electrostatic atomization is used the spraying area shall be so ventilated as to insure safe conditions from a fire and health standpoint.

(12) *Fire protection.* All areas used for spraying, including the interior of the booth, shall be protected by automatic sprinklers where this protection is available. Where this protection is not available, other approved automatic extinguishing equipment shall be provided.

(i) *Electrostatic hand spraying equipment*—(1) *Application.* This paragraph shall apply to any equipment using electrostatically charged elements for the atomization and/or, precipitation of materials for coatings on articles, or for other similar purposes in which the atomizing device is hand held and manipulated during the spraying operation.

(2) *Conformance.* Electrostatic hand spraying equipment shall conform with the other provisions of this section.

(3) *Equipment approval and specifications.* Electrostatic hand spray apparatus and devices used in connection with coating operations shall be of approved types. The equipment should be so designed that the maximum surface temperature of the equipment in the spraying area shall not exceed 150° F. under any condition. The high voltage circuits shall be designed so as to not produce a spark of sufficient intensity to ignite any vapor-air mixtures nor result in appreciable shock hazard upon coming in contact with a grounded object under all normal operating conditions. The electrostatically charged exposed elements of the handgun shall be capable of being energized only by a switch which also controls the coating material supply.

(4) *Electrical support equipment.* Transformers, powerpacks, control apparatus, and all other electrical portions of the equipment, with the exception of the handgun itself and its connections to the powder supply shall be located outside of the spraying area or shall otherwise conform to the requirements of paragraph (c) of this section.

(5) *Spray gun ground.* The handle of the spraying gun shall be electrically connected to ground by a metallic connection and to be so constructed that the operator in normal operating position is in intimate electrical contact with the grounded handle.

(6) *Grounding—general.* All electrically conductive objects in the spraying area shall be adequately grounded. This requirement shall apply to paint containers, wash cans, and any other objects or devices in the area. The equipment shall carry a prominent permanently installed warning regarding the necessity for this grounding feature.

(7) *Maintenance of grounds.* Objects being painted or coated shall be maintained in metallic contact with the conveyor or other grounded support. Hooks shall be regularly cleaned to insure this contact and areas of contact shall be sharp points or knife edges where possible. Points of support of the object shall be concealed from random spray where feasible and where the objects being sprayer are supported from a conveyor, the point of attachment to the conveyor shall be so located as to not collect spray material during normal operation.

(8) *Interlocks.* The electrical equipment shall be so interlocked with the ventilation of the spraying area that the equipment cannot be operated unless the ventilation fans are in operation.

(9) *Ventilation.* The spraying operation shall take place within a spray area which is adequately ventilated to remove solvent vapors released from the operation.

(j) *Drying, curing, or fusion apparatus*—(1) *Conformance.* Drying, curing, or fusion apparatus in connection with spray application of flammable and combustible finishes shall conform to the Standard for Ovens and Furnaces, NFPA 86A-1969, where applicable and shall also conform with the following requirements of this subparagraph.

(2) *Alternate use prohibited.* Spray booths, rooms, or other enclosures used for spraying operations shall not alternately be used for the purpose of drying by any arrangement which will cause a material increase in the surface temperature of the spray booth, room, or enclosure.

(3) *Adjacent system interlocked.* Except as specifically provided in subparagraph (4) of this paragraph, drying, curing, or fusion units utilizing a heating system having open flames or which may produce sparks shall not be installed in a spraying area, but may be installed adjacent thereto when equipped with an interlocked ventilating system arranged to:

(i) Thoroughly ventilate the drying space before the heating system can be started;

(ii) Maintain a safe atmosphere at any source of ignition;

(iii) Automatically shut down the heating system in the event of failure of the ventilating system.

(4) *Alternate use permitted.* Automobile refinishing spray booths or enclosures, otherwise installed and maintained in full conformity with this section, may alternately be used for drying with portable electrical infrared drying apparatus when conforming with the following:

(i) Interior (especially floors) of spray enclosures shall be kept free of overspray deposits.

(ii) During spray operations, the drying apparatus and electrical connections and wiring thereto shall not be located within spray enclosure nor in any other location where spray residues may be deposited thereon.

(iii) The spraying apparatus, the drying apparatus, and the ventilating system of the spray enclosure shall be equipped with suitable interlocks so arranged that:

(*a*) The spraying apparatus cannot be operated while the drying apparatus is inside the spray enclosure.

(*b*) The spray enclosure will be purged of spray vapors for a period of not less than 3 minutes before the drying apparatus can be energized.

(*c*) The ventilating system will maintain a safe atmosphere within the enclosure during the drying process and the drying appartus will automatically shut off in the event of failure of the ventilating system.

(iv) All electrical wiring and equipment of the drying apparatus shall conform with the applicable sections of Subpart S of this Part. Only equipment of a type approved for Class I, Division 2 hazardous locations shall be located within 18 inches of floor level. All metallic parts of the drying apparatus shall be properly electrically bonded and grounded.

(v) The drying apparatus shall contain a prominently located, permanently attached warning sign indicating that ventilation should be maintained during the drying period and that spraying should not be conducted in the vicinity that spray will deposit on apparatus.

(k) *Automobile undercoating in garages.* Automobile undercoating spray operations in garages, conducted in areas having adequate natural or mechanical ventilation, are exempt from the requirements pertaining to spray finishing operations, when using undercoating materials not more hazardous than kerosene (as listed by Underwriters' Laboratories in respect to fire hazard rating 30–40) or undercoating materials using only solvents listed as having a flash point in excess of 100° F. Undercoating spray operations not conforming to these provisions are subject to all requirements of this section pertaining to spray finishing operations.

(l) *Powder coating*—(1) *Electrical and other sources of ignition.* Electrical equipment and other sources of ignition shall conform to the requirements of paragraph (c)(1) (i)–(iv), (8) and (9) (i) of this section and Subpart S of this Part.

(2) *Ventilation.* (i) In addition to the provisions of paragraph (d) of this section, where applicable, exhaust ventilation shall be sufficient to maintain the atmosphere below the lowest explosive limits for the materials being applied. All nondeposited air-suspended powders shall be safely removed via exhaust ducts to the powder recovery cyclone or receptacle. Each installation shall be designed and operated to meet the foregoing performance specification.

(ii) Powders shall not be released to the outside atmosphere.

(3) *Drying, curing, or fusion equipment.* The provisions of the Standard for ovens and furnaces, NFPA No. 86A–1969 shall apply where applicable.

(4) *Operation and maintenance.* (i) All areas shall be kept free of the accumulation of powder coating dusts, particularly such horizontal surfaces as ledges, beams, pipes, hoods, booths, and floors.

(ii) Surfaces shall be cleaned in such manner as to avoid scattering dust to other places or creating dust clouds.

(iii) "No Smoking" signs in large letters on contrasting color background shall be conspicuously posted at all powder coating areas and powder storage rooms.

(5) *Fixed electrostatic spraying equipment.* The provisions of paragraph (h) of this section and other subparagraphs of this paragraph shall apply to fixed electrostatic equipment, except that electrical equipment not covered therein shall conform to subparagraph (1) of this paragraph.

(6) *Electrostatic hand spraying equipment.* The provisions of paragraph (i) of this section and other subparagraphs of this paragraph, shall apply to electrostatic handguns when used in powder coating, except that electrical equipment not covered therein shall conform to subparagraph (1) of this paragraph.

(7) *Electrostatic fluidized beds.* (i) Electrostatic fluidized beds and associated equipment shall be of approved types. The maximum surface temperature of this equipment in the coating area shall not exceed 150° F. The high voltage circuits shall be so designed as to not produce a spark of sufficient intensity to ignite any powder-air mixtures nor result in appreciable shock hazard upon coming in contact with a grounded object under normal operating conditions.

(ii) Transformers, powerpacks, control apparatus, and all other electrical portions of the equipment, with the exception of the charging electrodes and their connections to the power supply shall be located outside of the powder coating area or shall otherwise conform to the requirements of subparagraph (1) of this paragraph.

(iii) All electrically conductive objects within the charging influence of the electrodes shall be adequately grounded. The powder coating equipment shall carry a prominent, permanently installed warning regarding the necessity for grounding these objects.

(iv) Objects being coated shall be maintained in contact with the conveyor or other support in order to insure proper grounding. Hangers shall be regularly cleaned to insure effective contact and areas of contact shall be sharp points or knife edges where possible.

(v) The electrical equipment shall be so interlocked with the ventilation system that the equipment cannot be operated unless the ventilation fans are in operation.

(m) *Organic peroxides and dual component coatings*—(1) *Conformance.* All spraying operations involving the use of organic peroxides and other dual component coatings shall be conducted in approved sprinklered spray booths meeting the requirements of this section.

(2) *Smoking.* Smoking shall be prohibited and "No Smoking" signs shall be prominently displayed and only nonsparking tools shall be used in any area where organic peroxides are stored, mixed or applied.

§ 1910.108 Dip tanks containing flammable or combustible liquids.

(a) *Definitions applicable to this section*—(1) *Dip tank.* Shall mean a tank, vat, or container of flammable or combustible liquid in which articles or materials are immersed for the purpose of coating, finishing, testing, or similar processes.

(2) *Vapor area.* Shall mean any area containing dangerous quantities of flammable vapors in the vicinity of dip tanks, their drainboards or associated drying, conveying, or other equipment, during operation or shutdown periods.

(3) *Approved.* Unless otherwise indicated, approval or listing by at least one of the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

(4) *Listed.* See "approved" in § 1910.108 (a)(3).

(b) *Ventilation*—(1) *Vapor area ventilation.* Vapor areas as defined in paragraph (a) of this section shall be limited to the smallest practical space by maintaining a properly designed system of mechanical ventilation arranged to move air from all directions towards the vapor area origin and thence to a safe outside location. Ventilating systems shall conform to the Standards for Blower and Exhaust Systems (NFPA Pamphlet No. 91–1969). Required ventilating systems shall be so arranged that the failure of any ventilating fan shall automatically stop any dipping conveyor system. See also paragraph (c)(6) of this section.

(2) *Ventilation combined with drying.* When a required ventilating system serves associated drying operations utilizing a heating system which may be a source of ignition, means shall be provided for preventilation before the heating system can be started; the failure of any ventilating fan shall automatically shut down the heating system; and the installation shall otherwise conform to the Standard for Ovens and Furnaces (NFPA No. 86A–1969).

(c) *Construction of dip tanks*—(1) *General.* Dip tanks, including drainboards if provided, shall be constructed of substantial noncombustible material, and their supports shall be of heavy metal, reinforced concrete, or masonry. Where dip tanks extend through a floor to the story below or where the weakening of the tank supports by fire may result in the tank collapse, supports should be of material having not less than 1-hour fire resistance.

(2) *Overflow pipes.* (i) Dip tanks of over 150 gallons in capacity or 10 square feet in liquid surface area shall be equipped with a properly trapped overflow pipe leading to a safe location outside buildings. Smaller dip tanks should also be so equipped, where practical. The discharge of the overflow pipe should be so located and arranged that if the entire combustible contents of the dip tank is overflowed through overflow pipe by the application of water during fire fighting, property will not be endangered. The size of the overflow pipe should be sufficient to conduct the maximum rate of flow of water expected to be applied to the liquid surface of the dip tank from automatic sprinklers or from other sources in the event of fire.

(ii) Overflow pipes shall be of sufficient capacity to overflow the maximum delivery of dip tank liquid fill pipes but shall not be less than 3 inches in diameter and shall be increased in size depending upon the area of the liquid surface and the length and pitch of pipe.

(iii) Piping connections on drains and overflow lines shall be designed so as to permit ready access for inspection and cleaning of the interior.

(iv) The bottom of the overflow connection shall be not less than 6 inches below the top of the tank. See also subparagraph (6) of this paragraph and paragraph (g)(3)(ii) of this section.

(3) *Bottom drains.* (i) Dip tanks over 500 gallons in liquid capacity shall be equipped with bottom drains automatically and manually arranged to quickly drain the tank in the event of fire, unless the viscosity of the liquid at normal atmospheric temperature makes this impractical. Manual operation shall be from a safely accessible location. Where gravity flow is not practicable, automatic pumps shall be required.

(ii) Such drain shall be trapped and discharge to a closed properly vented salvage tank or to a safe location outside which will not endanger property.

(iii) According to tank capacity the diameter of bottom drainpipe shall be not less than the following:

Gallons:	*Inches*
500 to 750	3
750 to 1,000	4
1,000 to 2,500	5
2,500 to 4,000	6
Over 4,000	8

(4) *Salvage tanks.* The capacity of the salvage tank shall be greater than the capacity of the dip tank or tanks to which they are connected.

(5) *Automatic extinguishing facilities.* Except as noted in paragraph (h)(1)(v) of this section (applying to hardening and tempering tanks), all dip tanks exceeding 150 gallons liquid capacity or having a liquid surface area exceeding 4 square feet shall be protected with at least one of the automatic extinguishing facilities conforming to paragraph (g)(2), (3), (4), (5), or (6) of this section.

(6) *Conveyor systems.* Dip tanks utilizing a conveyor system shall be so arranged that in the event of fire, the conveyor system shall automatically cease motion and required bottom drains shall open. Conveyor systems shall automatically cease motion unless required ventilation is in full operation. See also paragraph (b)(1) of this section.

(7) *Heating dip tank liquids.* When dip tank liquids are artificially heated, either by the dipping of heated articles, or by other application of heat to the liquid, provision shall be made to prevent a temperature rise greater than 50° F. below the flashpoint of the liquid. See also paragraph (h)(1) of this section.

(d) *Liquids used in dip tanks, storage and handling.* The storage of flammable and combustible liquids in connection with dipping operation shall conform to the requirements of section 1910.106, where applicable. Where portable containers are used for the replenishment of flammable and combustible liquids, provision shall be made so that both the container and tank shall be positively

grounded and electrically bonded to prevent static electric sparks.

(e) *Electrical and other sources of ignition*—(1) *Vapor areas.* (i) There shall be no open flames, spark producing devices, or heated surfaces having a temperature sufficient to ignite vapors in any vapor area. Except as specifically permitted in paragraph (h)(3) of this section, relating to electrostatic apparatus, electrical wiring and equipment in any vapor area (as defined in paragraph (a)(2) of this section) shall be explosion proof type according to the requirements of Subpart S of this part for Class I, Group D locations and shall otherwise conform to Subpart S of this part.

(ii) Unless specifically approved for locations containing both deposits of readily ignitable residues and explosive vapors, there shall be no electrical equipment in the vicinity of dip tanks or associated drainboards or drying operations which are subject to splashing or dripping of dip tank liquids, except wiring in rigid conduit or in threaded boxes or fittings containing no taps, splices, or terminal connections, and except as specifically permitted in paragraph (h)(3) of this section.

(2) *Adjacent areas.* In any floorspace outside a vapor area but within 20 feet therefrom, and not separated by tight partitions, there shall be no open flames or spark producing devices except as specifically permitted in NFPA Standard No. 86A–1969, Ovens and Furnaces, paragraph 200–7, and electrical wiring and equipment shall conform to the provisions of Subpart S of this part.

(f) *Operations and maintenance*—(1) *General.* Areas in the vicinity of dip tanks shall be kept as clear of combustible stock as practical and shall be kept entirely free of combustible debris.

(2) *Waste cans.* When waste or rags are used in connection with dipping operations, approved metal waste cans shall be provided and all impregnated rags or waste deposited therein immediately after use. The contents of waste cans shall be properly disposed of at least once daily at the end of each shift.

(3) *Inspection.* Periodic inspection or tests of all dip tank facilities shall be made, including covers, overflow pipe inlets and discharge, bottom drains and valves, electrical wiring and equipment and grounding connections, ventilating facilities, and all extinguishing equipment. Any defects found shall be promptly corrected.

(4) *Warning signs.* "No Smoking" signs in large letters on contrasting color background shall be conspicuously posted in the vicinity of dip tanks.

(g) *Extinguishment*—(1) *Extinguishers.* Areas in the vicinity of dip tanks shall be provided with manual fire extinguishers suitable for flammable and combustible liquid fires, conforming to Standard for Portable Fire Extinguishers NFPA No. 10–1970.

(2) *Automatic water spray extinguishing systems.* Such systems shall conform to NFPA Standard for Water Spray Systems for Fire Protection NFPA No. 15–1969 and shall be arranged to protect tanks, drainboards, and stock over drainboards.

(3) *Automatic foam extinguishing systems.* Automatic foam extinguishing systems shall conform to NFPA Standard for Foam Extinguishing Systems, NFPA No. 11–1970 and;

(i) Foam producing material selected shall be suitable for intended use, taking into account characteristics of the dip tank liquid;

(ii) Overflow pipe shall be arranged to prevent the floating away of foam and clogging overflow pipe. This may be accomplished by either of the following:

(*a*) Overflow pipe may be extended through tank wall and terminated in an ell pointing downward. The bottom of the overflow pipe at the point it pierces tank wall should not be over 2 inches above the opening or face of the ell.

(*b*) Overflow pipe inlet may be provided with a removable screen of ¼-inch mesh having an area at least twice the cross-sectional area of overflow pipe. Screens which may be clogged by dip tank ingredients shall be inspected and cleaned periodically.

(4) *Automatic carbon dioxide systems.* Automatic carbon dioxide systems shall conform to NFPA Standard for Carbon Dioxide Extinguishing Systems, NFPA No. 12–1968, and shall be arranged to protect both dip tanks and drainboards and unless stock over drainboards is otherwise protected with automatic extinguishing facilities, shall also be arranged to protect such stock.

(5) *Dry chemical extinguishing systems.* Dry chemical extinguishing systems shall conform to NFPA Standard for Dry Chemical Extinguishing Systems NFPA No. 17–1969 and shall be arranged to protect both dip tanks and drainboards, and unless stock over drainboards is otherwise protected with automatic extinguishing facilities, shall also be arranged to protect such stock.

(6) *Dip tank covers.* (i) Covers arranged to close automatically in the event of fire shall be actuated by approved automatic devices and shall also be arranged for manual operation.

(ii) Covers shall be of substantial noncombustible material or of tin-clad type with enclosing metal applied with locked joints.

(iii) Chains or wire rope shall be used for cover support or operating mechanism where the burning of a cord would interfere with the action of a device.

(iv) Covers shall be kept closed when tanks are not in use.

(h) *Special dip tank applications*—(1) *Hardening and tempering tanks.* (i) Tanks shall be located as far as practicable from furnaces and shall not be located on or near combustible floors.

(ii) Tanks shall be provided with a noncombustible hood and vent or other equally effective means of venting to the outside of the building to serve as a vent in case of fire. All such vent ducts shall be treated as flues and be kept well away from combustible roofs or materials.

(iii) Tanks shall be so designed that the maximum workload is incapable of raising the temperature of the cooling medium to within 50° below its flashpoint, or such tanks shall be equipped with circulating cooling systems which will accomplish the same result.

(iv) Tanks shall be equipped with a high temperature limit switch arranged to sound an alarm when the temperature of the quenching medium reaches within 50° F. below the flashpoint. If practical from an operating standpoint, such limit switches shall also shut down conveying equipment supplying work to the tank.

(v) The provisions of paragraph (c)(5) of this section shall apply to tanks having a liquid surface area of 25 square feet or more or a capacity of 500 gallons or more.

(vi) Air under pressure shall not be used to fill or to agitate oil tanks.

(vii) Drain facilities from the bottom of the tank may be combined with the oil circulating system or arranged independently to drain the oil to a safe location. The drain valve shall be operated automatically with approved heat actuated devices or manually, and if the latter, the valve shall be operated from a safe distance.

(2) *Flow coat; general.* (i) Except as modified in this paragraph, all of the preceding standards for dip tanks apply.

(ii) All piping shall be strongly erected and rigidly supported.

(iii) Paint shall be supplied by direct low-pressure pumping arranged to automatically shut down by means of approved heat actuated devices, in the case of fire, or paint may be supplied by a gravity tank not exceeding 10 gallons in capacity.

(iv) The area of the sump and any areas on which paint flows should be considered the area of dip tank.

(3) *Electrostatic apparatus; general.* (i) Installation and use of electrostatic detearing equipment shall conform to paragraphs (a) through (g) of this section.

(ii) Electrostatic apparatus and devices used in connection with paint detearing operations shall be of approved types.

(iii) Transformers, powerpacks, control appartus, and all other electrical portions of the equipment, with the exception of high voltage grids and their connections, shall be located outside the vapor area or shall conform to the requirements of paragraph (*e*) of this section.

(iv) Electrodes shall be of substantial construction, shall be rigidly supported in permanent locations and shall be effectively insulated from ground. Insulators shall be nonporous and noncombustible.

(v) High voltage leads to electrodes shall be effectively and permanently supported on suitable insulators, and shall be effectively guarded against accidental contact or grounding. An automatic means shall be provided for grounding and discharging any accumulated residual charge on the electrode assembly or the secondary circuit of the high voltage transformer when the transformer primary is disconnected from the source of supply.

(vi) A space shall be maintained between goods being deteared and electrodes or conductors of at least twice the sparking distance. A suitable sign stating the sparking distance shall be conspicuously posted near the assembly.

(vii) Goods being deteared using this electrostatic process are to be supported on conveyors. The conveyors shall be so arranged as to maintain safe distances between the goods and the electrodes at all times. All goods shall be so supported as to prevent any swinging or movement which would reduce the clearance to less than specified in subdivision (vi) of this subparagraph.

(viii) This electrostatic process is not approved where goods being deteared are manipulated by hand.

(ix) Electrostatic apparatus shall be equipped with automatic controls which will operate without time delay to disconnect the power supply to the high voltage transformer and to signal the operator under any of the following conditions:

(*a*) Stoppage of ventilating fans or failure of ventilating equipment from any cause.

(*b*) Stoppage of the conveyor carrying goods past the high voltage grid.

(*c*) Occurrence of a ground or of an imminent ground at any point on the high voltage system.

(*d*) Reduction of clearance below that specified in subdivision (vi) of this subparagraph.

(x) Adequate fencing, railings, or guards shall be so placed about the equipment that they, either by their location or character or both, assure that a safe isolation of the process is maintained from plant storage or personnel. Such railings, fencing and guards shall be of conducting material, adequately grounded, and should be at least 5 feet from processing equipment.

(xi) Electrode insulators shall be kept clean and dry.

(xii) The detearing area shall be ventilated by exhausting adequate air from the area as specified in paragraph (b) of this section.

(xiii) All areas for detearing shall be protected by automatic sprinklers where this protection is available. Where this protection is not available, other approved automatic extinguishing equipment shall be provided.

(xiv) Drip plates and screens subject to paint deposits shall be removable and shall be taken to a safe place for cleaning.

(4) *Roll coating.* (i) The processes of roll coating, spreading, and impregnating, in which fabrics, paper, or other material are passed directly through a tank or trough containing flammable or combustible liquids, or over the surface of a roller that revolves partially submerged in a flammable liquid, shall conform to the applicable requirements of paragraphs (a) through (g) of this section and in addition shall conform to subdivision (ii) of this subparagraph.

(ii) Adequate arrangements shall be made to prevent sparks from static electricity by electrically bonding and grounding all metallic rotating and other parts of machinery and equipment and by the installation of static collectors or maintaining a conductive atmosphere such as a high relative humidity.

§ 1910.109 Explosives and blasting agents.

(a) *Definitions applicable to this section.*—(1) *Blasting agent.* Blasting agent—any material or mixture, consisting of a fuel and oxidizer, intended for blasting, not otherwise classified as an explosive and in which none of the ingredients are classified as an explosive, provided that the finished product, as mixed and packaged for use or shipment, cannot be detonated by means of a No. 8 test blasting cap when unconfined.

(2) *Explosive-actuated power devices.* Explosive-actuated power device—any tool or special mechanized device which is actuated by explosives, but not including propellant-actuated power devices. Examples of explosive-actuated power devices are jet tappers and jet perforators.

(3) *Explosive.* Explosive—any chemical compound, mixture, or device, the primary or common purpose of which is to function by explosion, i.e., with substantially instantaneous release of gas and heat, unless such compound, mixture, or device is otherwise specifically classified by the U.S. Department of Transportation; see 49 CFR Chapter I. The term "explosives" shall include all material which is classified as Class A, Class B, and Class C explosives by the U.S. Department of Transportation, and includes, but is not limited to dynamite, black powder, pellet powders, initiating explosives, blasting caps, electric blasting caps, safety fuse, fuse lighters, fuse igniters, squibs, cordeau detonant fuse, instantaneous fuse, igniter cord, igniters, small arms ammunition, small arms ammunition primers, smokeless propellant, cartridges for propellant-actuated power devices, and cartridges for industrial guns. Commercial explosives are those explosives which are intended to be used in commercial or industrial operations.

NOTE 1: Classification of explosives is described by the U.S. Department of Transportation as follows (see 49 CFR Chapter I):

(i) *Class A explosives.* Possessing, detonating, or otherwise maximum hazard; such as dynamite, nitroglycerin, picric acid, lead azide, fulminate of mercury, black powder, blasting caps, and detonating primers.

(ii) *Class B explosives.* Possessing flammable hazard, such as propellant explosives (including some smokeless propellants), photographic flash powders, and some special fireworks.

(iii) *Class C explosives.* Includes certain types of manufactured articles which contain Class A or Class B explosives, or both, as components but in restricted quantities.

(iv) *Forbidden or not acceptable explosives.* Explosives which are forbidden or not acceptable for transportation by common carriers by rail freight, rail express, highway, or water in accordance with the regulations of the U.S. Department of Transportation, 49 CFR Chapter I.

(4) *Highway.* Highway—any public street, public alley, or public road.

(5) *Inhabited building.* Inhabited building—a building or structure regularly used in whole or part as a place of human habitation. The term "inhabited building" shall also mean any church, school, store, railway passenger station, airport terminal for passengers, and any other building or structure where people are accustomed to congregate or assemble but excluding any building or structure occupied in connection with the manufacture, transportation, storage, and use of explosives.

(6) *Magazine.* Magazine—any building or structure, other than an explosives manufacturing building, for the storage of explosives.

(7) *Motor vehicle.* Motor vehicle—any self-propelled vehicle, truck, tractor, semitrailer, or truck-full trailers used for the transportation of freight over public highways.

(8) *Propellant-actuated power devices.* Propellant-actuated power devices—any tool or special mechanized device or gas generator system which is actuated by a smokeless propellant or which releases and directs work through a smokeless propellant charge.

(9) *Public conveyance.* Public conveyance—any railroad car, streetcar, ferry, cab, bus, airplane, or other vehicle which is carrying passengers for hire.

(10) *Pyrotechnics.* Pyrotechnics—and include any combustible or explosive compositions or manufactured articles designed and prepared for the purpose of producing audible or visible effects which are commonly referred to as fireworks.

(11) *Railway.* Railway—any steam, electric, diesel electric, or other railroad or railway which carries passengers for hire on the particular line or branch in the vicinity where explosives are stored or where explosives manufacturing buildings are situated.

(12) *Semiconductive hose.* Semiconductive hose—a hose with an electrical resistance high enough to limit flow of stray electric currents to safe levels, yet not so high as to prevent drainage of static electric charges to ground; hose of not more than 2 megohms resistance over its entire length and of not less than 5,000 ohms per foot meets the requirement.

(13) *Small arms ammunition.* Small arms ammunition—any shotgun, rifle, pistol, or revolver cartridge, and cartridges for propellant-actuated power devices and industrial guns. Military-type ammunition containing explosive-bursting charges, incendiary, tracer, spotting, or pyrotechnic projectiles is excluded from this definition.

(14) *Small arms ammunition primers.* Small arms ammunition primers—small percussion-sensitive explosive charges, encased in a cup, used to ignite propellant powder.

(15) *Smokeless propellants.* Smokeless propellants—solid propellants, commonly called smokeless powders in the trade, used in small arms ammunition, cannon,

rockets, propellant-actuated power devices, etc.

(16) *Special industrial explosives devices.* Special industrial explosives devices—explosive-actuated power devices and propellant-actuated power devices.

(17) *Special industrial explosives materials.* Special industrial explosives materials—shaped materials and sheet forms and various other extrusions, pellets, and packages of high explosives, which include dynamite, trinitrotolvene (TNT), pentaerythritol tetranitrate (PETN), hexahydro-1,3,5-trinitro-s-triazine (RDX), and other similar compounds used for high-energy-rate forming, expanding, and shaping in metal fabrication, and for dismemberment and quick reduction of scrap metal.

(18) *Water gels or slurry explosives.* These comprise a wide variety of materials used for blasting. They all contain substantial proportions of water and high proportions of ammonium nitrate, some of which is in solution in the water. Two broad classes of water gels are (i) those which are sensitized by a material classed as an explosive, such as TNT or smokeless powder, (ii) those which contain no ingredient classified as an explosive; these are sensitized with metals such as aluminum or with other fuels. Water gels may be premixed at an explosives plant or mixed at the site immediately before delivery into the borehole.

(19) *DOT specifications.* Regulations of the Department of Transportation published in 49 CFR Chapter I.

(20) *DOT regulations.* See § 1910.109 (a) (19).

(21) *DOT requirements.* See § 1910.109 (a) (19).

(b) *Miscellaneous provisions* — (1) *General hazard.* No person shall store, handle, or transport explosives or blasting agents when such storage, handling, and transportation of explosives or blasting agents constitutes an undue hazard to life and property.

(2) *Unauthorized recipients.* No person shall sell or give away any explosive or blasting agent to any unauthorized person.

(3) *Display.* No person shall sell, display, or expose for sale any explosive or blasting agent on any highway, street, sidewalk, public way, or public place.

(c) *Storage of explosives*—(1) *General provisions.* (i) All class A, class B, class C explosives, and special industrial explosives, and any newly developed and unclassified explosives, shall be kept in magazines which meet the requirements of this paragraph.

(ii) Blasting caps, electric blasting caps, detonating primers, and primed cartridges shall not be stored in the same magazine with other explosives.

(iii) Ground around magazines shall slope away for drainage. The land surrounding magazines shall be kept clear of brush, dried grass, leaves, and other materials for a distance of at least 25 feet.

(iv) Magazines as required by this chapter shall be of two classes; namely, class I magazines, and class II magazines.

(v) Class I magazines shall be required where the quantity of explosives stored is more than 50 pounds. Class II magazines may be used where the quantity of explosives stored is 50 pounds or less.

(vi) Class I magazines shall be located away from inhabited buildings, passenger railways, and public highways and from other magazines in conformity with Table H–21.

TABLE H–21—AMERICAN TABLE OF DISTANCES FOR STORAGE OF EXPLOSIVES

As revised and approved by the Institute of Makers of Explosives, June 5, 1964

Explosives		Distances in feet when storage is barricaded			
Pounds over	Pounds not over	Inhabited buildings	Passenger railways	Public highways	Separation of magazines
2	5	70	30	30	6
5	10	90	35	35	8
10	20	110	45	45	10
20	30	125	50	50	11
30	40	140	55	55	12
40	50	150	60	60	14
50	75	170	70	70	15
75	100	190	75	75	16
100	125	200	80	80	18
125	150	215	85	85	19
150	200	235	95	95	21
200	250	255	105	105	23
250	300	270	110	110	24
300	400	295	120	120	27
400	500	320	130	130	29
500	600	340	135	135	31
600	700	355	145	145	32
700	800	375	150	150	33
800	900	390	155	155	35
900	1,000	400	160	160	36
1,000	1,200	425	170	165	39
1,200	1,400	450	180	170	41
1,400	1,600	470	190	175	43
1,600	1,800	490	195	180	44
1,800	2,000	505	205	185	45
2,000	2,500	545	220	190	49
2,500	3,000	580	235	195	52
3,000	4,000	635	255	210	58
4,000	5,000	685	275	225	61
5,000	6,000	730	295	235	65
6,000	7,000	770	310	245	68
7,000	8,000	800	320	250	72
8,000	9,000	835	335	255	75
9,000	10,000	865	345	260	78
10,000	12,000	875	370	270	82
12,000	14,000	885	390	275	87
14,000	16,000	900	405	280	90
16,000	18,000	940	420	285	94
18,000	20,000	975	435	290	93
20,000	25,000	1,055	470	315	105
25,000	30,000	1,130	500	340	112
30,000	35,000	1,205	525	360	119
35,000	40,000	1,275	550	380	124
40,000	45,000	1,340	570	400	129
45,000	50,000	1,400	580	420	135
50,000	55,000	1,460	610	440	140
55,000	60,000	1,515	630	455	145
60,000	65,000	1,565	645	470	150
65,000	70,000	1,610	660	485	155
70,000	75,000	1,655	675	500	160
75,000	80,000	1,695	690	510	165
80,000	85,000	1,730	705	520	170
85,000	90,000	1,760	720	530	175
90,000	95,000	1,790	730	540	180
95,000	100,000	1,815	745	545	185
100,000	110,000	1,835	770	550	195
110,000	120,000	1,855	790	555	205
120,000	130,000	1,875	810	560	215
130,000	140,000	1,890	835	565	225
140,000	150,000	1,900	850	570	235
150,000	160,000	1,935	870	580	245
160,000	170,000	1,965	890	590	255
170,000	180,000	1,990	905	600	265
180,000	190,000	2,010	920	605	275
190,000	200,000	2,030	935	610	285
200,000	210,000	2,055	955	620	295
210,000	230,000	2,100	980	635	315
230,000	250,000	2,155	1,010	650	335
250,000	275,000	2,215	1,040	670	360
275,000	300,000	2,275	1,075	690	385

NOTE 1. "Natural barricade" means natural features of the ground, such as hills, or timber of sufficient density that the surrounding exposures which require protection cannot be seen from the magazine when the trees are bare of leaves.

NOTE 2. "Artificial barricade" means an artificial mound or revetted wall of earth of a minimum thickness of three feet.

NOTE 3. "Barricaded" means that a building containing explosives is effectually screened from a magazine, building, railway, or highway, either by a natural barricade, or by an artificial barricade of such height that a straight line from the top of any sidewall of the building containing explosives to the eave line of any magazine, or building, or to a point 12 feet above the center of a railway or highway, will pass through such intervening natural or artificial barricade.

NOTE 4. When two or more storage magazines are located on the same property, each magazine must comply with the minimum distances specified from inhabited buildings, railways, and highways, and in addition, they should be separated from each other by not less than the distances shown for "Separation of Magazines," except that the quantity of explosives contained in cap magazines shall govern in regard to the spacing of said cap magazines from magazines containing other explosives. If any two or more magazines are separated from each other by less than the specified "Separation of Magazines" distances, then such two or more magazines, as a group, must be considered as one magazine, and the total quantity of explosives stored in such group must be treated as if stored in a single magazine located on the site of any magazine of the group, and must comply with the minimum of distances specified from other magazines, inhabited buildings, railways, and highways.

NOTE 5. This table applies only to the manufacture and permanent storage of commercial explosives. It is not applicable to transportation of explosives, or any handling or temporary storage necessary or incident thereto. It is not intended to apply to bombs, projectiles, or other heavily encased explosives.

(vii) Except as provided in subdivision (viii) of this subparagraph, class II magazines shall be located in conformity with Table H–21, but may be permitted in warehouses and in wholesale and retail establishments when located on a floor which has an entrance at outside grade level and the magazine is located not more than 10 feet from such an entrance. Two class II magazines may be located in the same building when one is used only for blasting caps in quantities not in excess of 5,000 caps and a distance of 10 feet is maintained between magazines.

(viii) When used for temporary storage at a site for blasting operations, class II magazines shall be located away from neighboring inhabited buildings, railways, highways, and other magazines. A distance of at least one hundred and fifty (150) feet shall be maintained between class II magazines and the work in progress when the quantity of explosives kept therein is in excess of 25 pounds, and at least 50 feet when the quantity of explosives is 25 pounds, or less.

(2) *Construction of magazines—general.* (i) Magazines shall be constructed in conformity with the provisions of this paragraph.

(ii) Magazines for the storage of explosives, other than black powder, class B and class C explosives shall be bullet resistant, weather resistant, fire resistant, and ventilated sufficiently to protect the explosive in the specific locality. Magazines used only for storage of black powder, class B and class C explosives shall be weather resistant, fire-resistant,

and have ventilation. Magazines for storage of blasting and electric blasting caps shall be weather resistant, fire-resistant, and ventilated.

(iii) Property upon which class I magazines are located and property where class II magazines are located outside of buildings shall be posted with signs reading "Explosives—Keep Off." Such signs shall be located so as to minimize the possibility of a bullet traveling in the direction of the magazine if anyone shoots at the sign.

(iv) Magazines requiring heat shall be heated by either hot-water radiant heating with the magazine building; or air directed into the magazine building over either hot water or low pressure steam (15 p.s.i.g.) coils located outside the magazine building.

(v) The magazine heating systems shall meet the following requirements:

(*a*) The radiant heating coils within the building shall be installed in such a manner that the explosives or explosives containers cannot contact the coils and air is free to circulate between the coils and the explosives or explosives containers.

(*b*) The heating ducts shall be installed in such a manner that the hot-air discharge from the duct is not directed against the explosives or explosives containers.

(*c*) The heating device used in connection with a magazine shall have controls which prevent the ambient building temperature from exceeding 130° F.

(*d*) The electric fan or pump used in the heating system for a magazine shall be mounted outside and separate from the wall of the magazine and shall be grounded.

(*e*) The electric fan motor and the controls for electrical heating devices used in heating water or steam shall have overloads and disconnects, which comply with subpart S of this part. All electrical switch gear shall be located a minimum distance of 25 feet from the magazine.

(*f*) The heating source for water or steam shall be separated from the magazine by a distance of not less than 25 feet when electrical and 50 feet when fuel fired. The area between the heating unit and the magazine shall be cleared of all combustible materials.

(*g*) The storage of explosives and explosives containers in the magazine shall allow uniform air circulation so product temperature uniformity can be maintained.

(vi) When lights are necessary inside the magazine, electric safety flashlight, or electric safety lanterns shall be used.

(3) *Construction of class I magazines.* (i) Class I magazines shall be of masonry construction or of wood or of metal construction, or a combination of these types. Thickness of masonry units shall not be less than 8 inches. Hollow masonry units used in construction required to be bullet resistant shall have all hollow spaces filled with weak cement or well-tamped sand. Wood constructed walls, required to be bullet resistant, shall have at least a 6-inch space between interior and exterior sheathing and the space between sheathing shall be filled with well-tamped sand. Metal wall construction, when required to be bullet resistant, shall be lined with brick at least 4 inches in thickness or shall have at least a 6-inch sandfill between interior and exterior walls.

(ii) Floors and roofs of masonry magazines may be of wood construction. Wood floors shall be tongue and grooved lumber having a nominal thickness of 1 inch.

(iii) Roofs required to be bullet resistant shall be protected by a sand tray located at the lines of eaves and covering the entire area except that necessary for ventilation. Sand in the sand tray shall be maintained at a depth of not less than 4 inches.

(iv) All wood at the exterior of magazines, including eaves, shall be protected by being covered with black or galvanized steel or aluminum metal of thickness of not less than No. 26 gage. All nails exposed to the interior of magazines shall be well countersunk.

(v) Foundations for magazines shall be of substantial construction and arranged to provide good cross ventilation.

(vi) Magazines shall be ventilated sufficiently to prevent dampness and heating of stored explosives. Ventilating openings shall be screened to prevent the entrance of sparks.

(vii) Openings to magazines shall be restricted to that necessary for the placement and removal of stocks of explosives. Doors for openings in magazines for class A explosives shall be bullet resistant. Doors for magazines not required to be bullet resistant shall be designed to prevent unauthorized entrance to the magazine.

(viii) Magazines shall be provided with substantial means for locking; locks shall be provided and magazine doors shall be kept locked, except during the time of placement and removal of stocks of explosives.

(ix) Provisions shall be made to prevent the piling of stocks of explosives directly against masonry walls, brick-lined or sand-filled metal walls and single-thickness metal walls; such protection, however, shall not interfere with proper ventilation at the interior of side and end walls.

(4) *Construction of class II magazines.* (i) Class II magazines shall be of wood or metal construction, or a combination thereof.

(ii) Wood magazines of this class shall have sides, bottom, and cover constructed of 2-inch hardwood boards well braced at corners and protected by being entirely covered with sheet metal of not less than No. 20 gage. All nails exposed to the interior of the magazine shall be well countersunk. All metal magazines of this class shall have sides, bottom, and cover constructed of sheet metal, and shall be lined with three-eighths-inch plywood or equivalent. Edges of metal covers shall overlap sides at least 1 inch.

(iii) Covers for both wood- and metal-constructed magazines of this class shall be provided with substantial strap hinges and shall be provided with substantial means for locking. Covers shall be kept locked except during the placement or removal of explosives.

(iv) Magazines of this class shall be painted red and shall bear lettering in white, on all sides and top, at least 3 inches high, "Explosives—Keep Fire Away." Class II magazines when located in warehouses, and in wholesale and retail establishments shall be provided with substantial wheels or casters to facilitate easy removal in the case of fire. Where necessary due to climatic conditions, class II magazines shall be ventilated.

(5) *Storage within magazines.* (i) Packages of explosives shall be laid flat with top side up. Black powder when stored in magazines with other explosives shall be stored separately. Black powder stored in kegs shall be stored on ends, bungs down, or on side, seams down. Corresponding grades and brands shall be stored together in such a manner that brands and grade marks show. All stocks shall be stored so as to be easily counted and checked. Packages of explosives shall be piled in a stable manner. When any kind of explosive is removed from a magazine for use, the oldest explosive of that particular kind shall always be taken first.

(ii) Packages of explosives shall not be unpacked or repacked in a magazine nor within 50 feet of a magazine or in close proximity to other explosives. Tools used for opening packages of explosives shall be constructed of nonsparking materials, except that metal slitters may be used for opening fiberboard boxes. A wood wedge and a fiber, rubber, or wood mallet shall be used for opening or closing wood packages of explosives. Opened packages of explosives shall be securely closed before being returned to a magazine.

(iii) Magazines shall not be used for the storage of any metal tools nor any commodity except explosives, but this restriction shall not apply to the storage of blasting agents and blasting supplies.

(iv) Magazine floors shall be regularly swept, kept clean, dry, free of grit, paper, empty used packages, and rubbish. Brooms and other cleaning utensils shall not have any spark-producing metal parts. Sweepings from floors of magazines shall be properly disposed of. Magazine floors stained with nitroglycerin shall be cleaned according to instructions by the manufacturer.

(v) When any explosive has deteriorated to an extent that it is in an unstable or dangerous condition, or if nitroglycerin leaks from any explosives, then the person in possession of such explosive shall immediately proceed to destroy such explosive in accordance with the instructions of the manufacturer. Only experienced persons shall be allowed to do the work of destroying explosives.

(vi) When magazines need inside repairs, all explosives shall be removed therefrom and the floors cleaned. In making outside repairs, if there is a possibility of causing sparks or fire the explosives shall be removed from the magazine. Explosives removed from a magazine under repair shall either be

placed in another magazine or placed a safe distance from the magazine where they shall be properly guarded and protected until repairs have been completed, when they shall be returned to the magazine.

(vii) Smoking, matches, open flames, spark-producing devices, and firearms (except firearms carried by guards) shall not be permitted inside of or within 50 feet of magazines. The land surrounding a magazine shall be kept clear of all combustible materials for a distance of at least 25 feet. Combustible materials shall not be stored within 50 feet of magazines.

(viii) Magazines shall be in the charge of a competent person at all times who shall be at least 21 years of age, and who shall be held responsible for the enforcement of all safety precautions.

(ix) Explosives recovered from blasting misfires shall be placed in a separate magazine until competent personnel has determined from the manufacturer the method of disposal. Caps recovered from blasting misfires shall not be reused. Such explosives and caps shall then be disposed of in the manner recommended by the manufacturer.

(d) *Transportation of explosives*—(1) *General provisions.* (i) No employee shall be allowed to smoke, carry matches or any other flame-producing device, or carry any firearms or loaded cartridges while in or near a motor vehicle transporting explosives; or drive, load, or unload such vehicle in a careless or reckless manner.

(ii) Explosives shall not be carried or transported in or upon a public conveyance or vehicle carrying passengers for hire.

(iii) Explosives shall not be transferred from one vehicle to another within the confines of any jurisdiction (city, county, State, or other area) without informing the fire and police departments thereof. In the event of breakdown or collision the local fire and police departments shall be promptly notified to help safeguard such emergencies. Explosives shall be transferred from the disabled vehicle to another only, when proper and qualified supervision is provided.

(iv) Blasting caps or electric blasting caps shall not be transported over the highways on the same vehicles with other explosives.

(2) *Transportation vehicles.* (i) Vehicles used for transporting explosives shall be strong enough to carry the load without difficulty and be in good mechanical condition. If vehicles do not have a closed body, the body shall be covered with a flameproof and moisture-proof tarpaulin or other effective protection against moisture and sparks. All vehicles used for the transportation of explosives shall have tight floors and any exposed spark-producing metal on the inside of the body shall be covered with wood or other nonsparking materials to prevent contact with packages of explosives. Packages of explosives shall not be loaded above the sides of an open-body vehicle.

(ii) Every vehicle used for transporting explosives and oxidizing materials listed in (*a*) of this subdivision shall be marked as follows:

(*a*) Exterior markings or placards required on applicable vehicles shall be as follows for the various classes of commodities:

Commodity	*Type of marking or placard*
Explosives, Class A, any quantity or a combination of Class A and Class B explosives.	Explosives A (Red letters on white background).
Explosives, Class B, any quantity.	Explosives B (Red letters on white background).
Oxidizing material (blasting agents, ammonium nitrate, etc.), 1,000 pounds or more gross weight.	Oxidizers (Yellow letters on black background).

(*b*) Each marking or placard shall consist of letters not less than 4 inches high, in the color specified, using approximately a $\frac{5}{8}$-inch stroke. The placard must be larger than the lettering required thereon by at least 1 inch at the top and bottom sides. Such marking or placard described in subdivision (*a*) shall be contained in an area on the vehicle which has no other marking, lettering, or graphic display, for at least 3 inches in each direction.

(*c*) Such markings or placards shall be displayed at the front, rear, and on each side of the motor vehicle or trailer, or other cargo carrying body while it contains explosives or other dangerous articles of such type and in such quantity as specified in (*a*) of this subdivision. The front marking or placard may be displayed on the front of either the truck, truck body, truck tractor or the trailer.

(*d*) Any motor vehicle, trailer, or other cargo-carrying body containing more than one kind of explosive as well as an oxidizing material requiring a placard under the provisions of subdivision (*a*), the aggregate gross weight of which totals 1,000 pounds or more, shall be marked or placarded "Dangerous" as well as "Explosive A" or "Explosive B" as appropriate. If explosives Class A and explosives Class B are loaded on the same vehicle, the "Explosives B" marking need not be displayed.

(*e*) In any combination of two or more vehicles containing explosives or other dangerous articles each vehicle shall be marked or placarded as to its contents and in accordance with (*a*) and (*c*) of this subdivision.

(iii) Each motor vehicle used for transporting explosives shall be equipped with a minimum of two extinguishers, each having a rating of at least 10–BC.

(*a*) Only extinguishers listed or approved by Underwriters Laboratories, Inc., or the Factory Mutual Engineering Corp. shall be deemed suitable for use on explosives-carrying vehicles.

(*b*) Extinguishers shall be filled and ready for immediate use and located near the driver's seat. Extinguishers shall be examined periodically by a competent person.

(iv) A motor vehicle used for transporting explosives shall be given the following inspection to determine that it is in proper condition for safe transportation of explosives:

(*a*) Fire extinguishers shall be filled and in working order.

(*b*) All electrical wiring shall be completely protected and securely fastened to prevent short-circuiting.

(*c*) Chassis, motor, pan, and underside of body shall be reasonably clean and free of excess oil and grease.

(*d*) Fuel tank and feedline shall be secure and have no leaks.

(*e*) Brakes, lights, horn, windshield wipers, and steering apparatus shall function properly.

(*f*) Tires shall be checked for proper inflation and defects.

(*g*) The vehicle shall be in proper condition in every other respect and acceptable for handling explosives.

(3) *Operation of transportation vehicles.* (i) Vehicles transporting explosives shall only be driven by and be in the charge of a driver who is physically fit, careful, capable, reliable, able to read and write the English language, and not addicted to the use, or under the influence of intoxicants, narcotics, or other dangerous drugs; and not less than 21 years of age. He shall be familiar with the traffic regulations, State laws, and the provisions of this section.

(ii) Except under emergency conditions, no vehicle transporting explosives shall be parked before reaching its destination, even though attended, on any public street adjacent to or in proximity to any bridge, tunnel, dwelling, building, or place where people work, congregate, or assemble.

(iii) Every motor vehicle transporting any quantity of Class A or Class B explosives shall, at all times, be attended by a driver or other attendant of the motor carrier. This attendant shall have been made aware of the class of the explosive material in the vehicle and of its inherent dangers, and shall have been instructed in the measures and procedures to be followed in order to protect the public from those dangers. He shall have been made familiar with the vehicle he is assigned, and shall be trained, supplied with the necessary means, and authorized to move the vehicle when required.

(*a*) For the purpose of this subdivision, a motor vehicle shall be deemed "attended" only when the driver or other attendant is physically on or in the vehicle, or has the vehicle within his field of vision and can reach it quickly and without any kind of interference; "attended" also means that the driver or attendant is awake, alert, and not engaged in other duties or activities which may divert his attention from the vehicle, except for necessary communication with public officers, or representatives of the carrier, shipper, or consignee, or except for necessary absence from the vehicle to obtain food or to provide for his physical comfort.

(*b*) However, an explosive-laden vehicle may be left unattended if parked within a securely fenced or walled area with all gates or entrances locked where parking of such vehicle is otherwise permissible, or at a magazine site established solely for the purpose of storing explosives.

(iv) No spark-producing metal, spark-producing metal tools, oils, matches, firearms, electric storage batteries, flammable substances, acids, oxidizing materials, or corrosive compounds shall be carried in the body of any motor truck and/or vehicle transporting explosives, unless the loading of such dangerous articles and the explosives comply with U.S. Department of Transportation regulations.

(v) Vehicles transporting explosives shall avoid congested areas and heavy traffic. Where routes through congested areas have been designated by local authorities such routes shall be followed.

(vi) Delivery shall only be made to authorized persons and into authorized magazines or authorized temporary storage or handling areas.

(e) *Use of explosives and blasting agents*—(1) *General provisions.* (i) While explosives are being handled or used, smoking shall not be permitted and no one near the explosives shall possess matches, open light or other fire or flame. No person shall be allowed to handle explosives while under the influence of intoxicating liquors, narcotics, or other dangerous drugs.

(ii) Original containers or Class II magazines shall be used for taking detonators and other explosives from storage magazines to the blasting area.

(iii) When blasting is done in congested areas or in close proximity to a structure, railway, or highway or any other installation that may be damaged, the blast shall be covered before firing with a mat constructed so that it is capable of preventing fragments from being thrown.

(iv) Persons authorized to prepare explosive charges or conduct blasting operations shall use every reasonable precaution, including but not limited to warning signals, flags, barricades, or woven wire mats to insure the safety of the general public and workmen.

(v) Blasting operations shall be conducted during daylight hours.

(vi) Whenever blasting is being conducted in the vicinity of gas, electric, water, fire alarm, telephone, telegraph, and steam utilities, the blaster shall notify the appropriate representatives of such utilities at least 24 hours in advance of blasting, specifying the location and intended time of such blasting. Verbal notice shall be confirmed with written notice.

(vii) Due precautions shall be taken to prevent accidental discharge of electric blasting caps from current induced by radar, radio transmitters, lightning, adjacent powerlines, dust storms, or other sources of extraneous electricity. These precautions shall include:

(*a*) The suspension of all blasting operations and removal of persons from the blasting area during the approach and progress of an electric storm.

(*b*) The posting of signs warning against the use of mobile radio transmitters on all roads within 350 feet of the blasting operations.

(2) *Storage at use sites.* (i) Empty boxes and paper and fiber packing materials which have previously contained high explosives shall not be used again for any purpose, but shall be destroyed by burning at an approved isolated location out of doors, and no person shall be nearer than 100 feet after the burning has started.

(ii) Containers of explosives shall not be opened in any magazine or within 50 feet of any magazine. In opening kegs or wooden cases, no sparking metal tools shall be used; wooden wedges and either wood, fiber or rubber mallets shall be used. Nonsparking metallic slitters may be used for opening fiberboard cases.

(iii) Explosives or blasting equipment that are obviously deteriorated or damaged shall not be used.

(iv) No explosives shall be abandoned.

(3) *Loading of explosives in blast holes.* (i) All drill holes shall be sufficiently large to admit freely the insertion of the cartridges of explosives.

(ii) Tamping shall be done only with wood rods without exposed metal parts, but nonsparking metal connectors may be used for jointed poles. Violent tamping shall be avoided. Primed cartridges shall not be tamped.

(iii) When loading blasting agents pneumatically over electric blasting caps, semiconductive delivery hose shall be used and the equipment shall be bonded and grounded.

(iv) No holes shall be loaded except those to be fired in the next round of blasting. After loading, all remaining explosives shall be immediately returned to an authorized magazine.

(v) Drilling shall not be started until all remaining butts of old holes are examined with a wooden stick for unexploded charges, and if any are found, they shall be refired before work proceeds.

(vi) No person shall be allowed to deepen drill holes which have contained explosives.

(vii) After loading for a blast is completed, all excess blasting caps or electric blasting caps and other explosives shall immediately be returned to their separate storage magazines.

(4) *Initiation of explosive charges.* (i) Only electric blasting caps shall be used for blasting operations in congested districts, or on highways, or adjacent to highways open to traffic, except where sources of extraneous electricity make such use dangerous.

(ii) When fuse is used, the blasting cap shall be securely attached to the safety fuse with a standard-ring type cap crimper. All primers shall be assembled at least 50 feet from any magazine.

(iii) Primers shall be made up only as required for each round of blasting.

(iv) No blasting cap shall be inserted in the explosives without first making a hole in the cartridge for the cap with a wooden punch of proper size or standard cap crimper.

(v) Explosives shall not be extracted from a hole that has once been charged or has misfired unless it is impossible to detonate the unexploded charge by insertion of a fresh additional primer.

(vi) If there are any misfires while using cap and fuse, all persons shall be required to remain away from the charge for at least 1 hour. If electric blasting caps are used and a misfire occurs, this waiting period may be reduced to 30 minutes. Misfires shall be handled under the direction of the person in charge of the blasting and all wires shall be carefully traced and search made for unexploded charges.

(vii) Blasters, when testing circuits to charged holes, shall use only blasting galvanometers designed for this purpose.

(viii) Only the employee making leading wire connections in electrical firing shall be allowed to fire the shot. Leading wires shall remain shorted and not be connected to the blasting machine or other source of current until the charge is to be fired.

(5) *Warning required.* Before a blast is fired, the employer shall require that a loud warning signal be given by the person in charge, who has made certain that all surplus explosives are in a safe place, all persons and vehicles are at a safe distance or under sufficient cover, and that an adequate warning has been given.

(f) *Explosives at piers, railway stations, and cars or vessels not otherwise specified in this standard*—(1) *Railway cars.* Except in an emergency and with permission of the local authority, no person shall have or keep explosives in a railway car unless said car and contents and methods of loading are in accordance with the U.S. Department of Transportation Regulations for the Transportation of Explosives, 49 CFR Chapter I.

(2) *Packing and marking.* No person shall deliver any explosive to any carrier unless such explosive conforms in all respects, including marking and packing, to the U.S. Department of Transportation Regulations for the Transportation of Explosives.

(3) *Marking cars.* Every railway car containing explosives which has reached its designation, or is stopped in transit so as no longer to be in interstate commerce, shall have attached to both sides and ends of the car, cards with the words "Explosives — Handle Carefully — Keep Fire Away" in red letters at least 1½ inches high on a white background.

(4) *Storage.* Any explosives at a railway facility, truck terminal, pier, wharf, harbor facility, or airport terminal, whether for delivery to a consignee, or forwarded to some other destination, shall be kept in a safe place, isolated as far as practicable and in such manner that they can be easily and quickly removed.

(5) *Hours of transfer.* Explosives shall not be delivered to or received from any railway station, truck terminal, pier, wharf, harbor facility, or airport terminal between the hours of sunset and sunrise.

(g) *Blasting agents*—(1) *General.* Unless otherwise set forth in this paragraph, blasting agents, excluding water

gels, shall be transported, stored, and used in the same manner as explosives. Water gels are covered in paragraph (h) of this section.

(2) *Fixed location mixing.* (i) Buildings or other facilities used for mixing blasting agents shall be located, with respect to inhabited buildings, passenger railroads, and public highways, in accordance with Table H–21. In determining the distance separating highways, railroads, and inhabited buildings from potential explosions (as prescribed in Table H–21), the sum of all masses which may propagate (i.e., lie at distances less than prescribed in Table H–22) from either individual or combined donor masses are included. However, when the ammonium nitrate must be included, only 50 percent of its weight shall be used because of its reduced blast effects.

(ii) Buildings used for the mixing of blasting agents shall conform to the requirements of this section.

(*a*) Buildings shall be of noncombustible construction or sheet metal on wood studs.

(*b*) Floors in a mixing plant shall be of concrete or of other nonabsorbent materials.

(*c*) All fuel oil storage facilities shall be separated from the mixing plant and located in such a manner that in case of tank rupture, the oil will drain away from the mixing plant building.

(*d*) The building shall be well ventilated.

(*e*) Heating units which do not depend on combustion processes, when properly designed and located, may be used in the building. All direct sources of heat shall be provided exclusively from units located outside the mixing building.

(*f*) All internal-combustion engines used for electric power generation shall be located outside the mixing plant building, or shall be properly ventilated and isolated by a firewall. The exhaust systems on all such engines shall be located so any spark emission cannot be a hazard to any materials in or adjacent to the plant.

(iii) Equipment used for mixing blasting agents shall conform to the requirements of this subdivision.

(*a*) The design of the mixer shall minimize the possibility of frictional heating, compaction, and especially confinement. All bearings and drive assemblies shall be mounted outside the mixer and protected against the accumulation of dust. All surfaces shall be accessible for cleaning.

(*b*) Mixing and packaging equipment shall be constructed of materials compatible with the fuel-ammonium nitrate composition.

(*c*) Suitable means shall be provided to prevent the flow of fuel oil to the mixer in case of fire. In graviety flow systems an automatic spring-loaded shutoff valve with fusible link shall be installed.

(iv) The provisions of this subdivision shall be considered when determining blasting agent compositions.

(*a*) The sensitivity of the blasting agent shall be determined by means of a No. 9 test blasting cap at regular intervals and after every change in formulation.

(*b*) Oxidizers of small particle size, such as crushed ammonium nitrate prills or fines, may be more sensitive than coarser products and shall, therefore, be handled with greater care.

(*c*) No hydrocarbon liquid fuel with flashpoint lower than that of No. 2 diesel fuel oil 125° F. minimum shall be used.

(*d*) Crude oil and crankcase oil shall not be used.

(*e*) Metal powders such as aluminum shall be kept dry and shall be stored in containers or bins which are moisture-resistant or weathertight. Solid fuels shall be used in such manner as to minimize dust explosion hazards.

(*f*) Peroxides and chlorates shall not be used.

(v) All electrical switches, controls, motors, and lights located in the mixing room shall conform to the requirements in subpart S of this part for class II, division 2 locations; otherwise they shall be located outside the mixing room. The frame of the mixer and all other equipment that may be used shall be electrically bonded and be provided with a continuous path to the ground.

(vi) Safety precautions at mixing plants shall include the requirements of this subdivision.

(*a*) Floors shall be constructed so as to eliminate floor drains and piping into which molten materials could flow and be confined in case of fire.

(*b*) The floors and equipment of the mixing and packaging room shall be cleaned regularly and thoroughly to prevent accumulation of oxidizers or fuels and other sensitizers.

(*c*) The entire mixing and packaging plant shall be cleaned regularly and thoroughly to prevent excessive accumulation of dust.

(*d*) Smoking, matches, open flames, spark-producing devices, and firearms (except firearms carried by guards) shall not be permitted inside of or within 50 feet of any building or facility used for the mixing of blasting agents.

(*e*) The land surrounding the mixing plant shall be kept clear of brush, dried grass, leaves, and other materials for a distance of at least 25 feet.

(*f*) Empty ammonium nitrate bags shall be disposed of daily in a safe manner.

(*g*) No welding shall be permitted or open flames used in or around the mixing or storage area of the plant unless the equipment or area has been completely washed down and all oxidizer material removed.

(*h*) Before welding or repairs to hollow shafts, all oxidizer material shall be removed from the outside and inside of the shaft and the shaft vented with a minimum one-half inch diameter opening.

(*i*) Explosives shall not be permitted inside of or within 50 feet of any building or facility used for the mixing of blasting agents.

(3) *Bulk delivery and mixing vehicles.* (i) The provisions of this subparagraph shall apply to off-highway private operations as well as to all public highway movements.

(ii) A bulk vehicle body for delivering and mixing blasting agents shall conform with the requirements of this subdivision (ii).

(*a*) The body shall be constructed of noncombustible materials.

(*b*) Vehicles used to transport bulk premixed blasting agents on public highways shall have closed bodies.

(*c*) All moving parts of the mixing system shall be designed as to prevent a heat buildup. Shafts or axles which contact the product shall have outboard bearings with 1-inch minimum clearance between the bearings and the outside of the product container. Particular attention shall be given to the clearances on all moving parts.

(*d*) A bulk delivery vehicle shall be strong enough to carry the load without difficulty and be in good mechanical condition.

(iii) Operation of bulk delivery vehicles shall conform to the requirements of this subdivision. These include the placarding requirements as specified by Department of Transportation.

(*a*) The operator shall be trained in the safe operation of the vehicle together with its mixing, conveying, and related equipment. The employer shall assure that the operator is familiar with the commodities being delivered and the general procedure for handling emergency situations.

(*b*) The hauling of either blasting caps or other explosives but not both, shall be permitted on bulk trucks provided that a special wood or nonferrous-lined container is installed for the explosives. Such blasting caps or other explosives shall be in DOT-specified shipping containers: see 49 CFR Chapter I.

(*c*) No person shall smoke, carry matches or any flame-producing device, or carry any firearms while in or about bulk vehicles effecting the mixing transfer or down-the-hole loading of blasting agents at or near the blasting site.

(*d*) Caution shall be exercised in the movement of the vehicle in the blasting area to avoid driving the vehicle over or dragging hoses over firing lines, cap wires, or explosive materials. The employer shall assure that the driver, in moving the vehicle, has assistance of a second person to guide his movements.

(*e*) No intransit mixing of materials shall be performed.

(iv) Pneumatic loading from bulk delivery vehicles into blastholes primed with electric blasting caps or other static-sensitive systems shall conform to the requirements of this subdivision.

(*a*) A positive grounding device shall be used to prevent the accumulation of static electricity.

(*b*) A discharge hose shall be used that has a resistance range that will prevent conducting stray currents, but that is conductive enough to bleed off static buildup.

(*c*) A qualified person shall evaluate all systems to determine if they will adequately dissipate static under potential field conditions.

(v) Repairs to bulk delivery vehicles shall conform to the requirements of this section.

(a) No welding or open flames shall be used on or around any part of the delivery equipment unless it has been completely washed down and all oxidizer material removed.

(b) Before welding or making repairs to hollow shafts, the shaft shall be thoroughly cleaned inside and out and vented with a minimum one-half-inch diameter opening.

(4) *Bulk storage bins.* (i) The bin, including supports, shall be constructed of compatible materials, waterproof, and adequately supported and braced to withstand the combination of all loads including impact forces arising from product movement within the bin and accidental vehicle contact with the support legs.

(ii) The bin discharge gate shall be designed to provide a closure tight enough to prevent leakage of the stored product. Provision shall also be made so that the gate can be locked.

(iii) Bin loading manways or access hatches shall be hinged or otherwise attached to the bin and be designed to permit locking.

(iv) Any electrically driven conveyors for loading or unloading bins shall conform to the requirements of Subpart S of this Part. They shall be designed to minimize damage from corrosion.

(v) Bins containing blasting agent shall be located, with respect to inhabited buildings, passenger railroads, and public highways, in accordance with Table H–21 and separation from other blasting agent storage and explosives storage shall be in conformity with Table H–22.

(vi) Bins containing ammonium nitrate shall be separated from blasting agent storage and explosives storage in conformity with Table H–22.

TABLE H–22—TABLE OF RECOMMENDED SEPARATION DISTANCES OF AMMONIUM NITRATE AND BLASTING AGENTS FROM EXPLOSIVES OR BLASTING AGENTS [1, 6]

Donor weight		Minimum separation distance of receptor when barricaded [2] (ft.)		Minimum thickness of artificial barricades [5] (in.)
Pounds over	Pounds not over	Ammonium nitrate [3]	Blasting agent [4]	
	100	3	11	12
100	300	4	14	12
300	600	5	18	12
600	1,000	6	22	12
1,000	1,600	7	25	12
1,600	2,000	8	29	12
2,000	3,000	9	32	15
3,000	4,000	10	36	15
4,000	6,000	11	40	15
6,000	8,000	12	43	20
8,000	10,000	13	47	20
10,000	12,000	14	50	20
12,000	16,000	15	54	25
16,000	20,000	16	58	25
20,000	25,000	18	65	25
25,000	30,000	19	68	30
30,000	35,000	20	72	30
35,000	40,000	21	76	30
40,000	45,000	22	79	35
45,000	50,000	23	83	35
50,000	55,000	24	86	35
55,000	60,000	25	90	35
60,000	70,000	26	94	40
70,000	80,000	28	101	40
80,000	90,000	30	108	40
90,000	100,000	32	115	40
100,000	120,000	34	122	50
120,000	140,000	37	133	50
140,000	160,000	40	144	50
160,000	180,000	44	158	50
180,000	200,000	48	173	50
200,000	220,000	52	187	60
220,000	250,000	56	202	60
250,000	275,000	60	216	60
275,000	300,000	64	230	60

Notes to Table of Recommended Separation Distances of Ammonium Nitrate and Blasting Agents from Explosives or Blasting Agents:

NOTE 1. These distances apply to the separation of stores only. Table H–21 shall be used in determining separation distances from inhabited buildings, passenger railways, and public highways.

NOTE 2. When the ammonium nitrate and/or blasting agent is not barricaded, the distances shown in the table shall be multiplied by six. These distances allow for the possibility of high velocity metal fragments from mixers, hoppers, truck bodies, sheet metal structures, metal containers, and the like which may enclose the "donor". Where storage is in bullet-resistant magazines recommended for explosives or where the storage is protected by a bullet-resistant wall, distances, and barricade thicknesses in excess of those prescribed in Table H–21 are not required.

NOTE 3. The distances in the table apply to ammonium nitrate that passes the insensitivity test prescribed in the definition of ammonium nitrate fertilizer promulgated by the National Plant Food Institute*; and ammonium nitrate failing to pass said test shall be stored at separation distances determined by competent persons. (*Definition and Test Procedures for Ammonium Nitrate Fertilizer, National Plant Food Institute, November 1964.)

NOTE 4. These distances apply to nitrocarbo-nitrates and blasting agents which pass the insensitivity test prescribed in the U.S. Department of Transportation (DOT) regulations.

NOTE 5. Earth, or sand dikes, or enclosures filled with the prescribed minimum thickness of earth or sand are acceptable artificial barricades. Natural barricades, such as hills or timber of sufficient density that the surrounding exposures which require protection cannot be seen from the "donor" when the trees are bare of leaves, are also acceptable.

NOTE 6. When the ammonium nitrate must be counted in determining the distances to be maintained from inhabited buildings, passenger railways and public highways, it may be counted at one-half its actual weight because its blast effect is lower.

NOTE 7. Guide to use of table of recommended separation distances of ammonium nitrate and blasting agents from explosives or blasting agents.

(a) Sketch location of all potential donor and acceptor materials together with the maximum mass of material to be allowed in that vicinity. (Potential donors are high explosives, blasting agents, and combination of masses of detonating materials. Potential acceptors are high explosives, blasting agents, and ammonium nitrate.)

(b) Consider separately each donor mass in combination with each acceptor mass. If the masses are closer than table allowance (distances measured between nearest edges), the combination of masses becomes a new potential donor of weight equal to the total mass. When individual masses are considered as donors, distances to potential acceptors shall be measured between edges. When combined masses within propagating distance of each other are considered as a donor, the appropriate distance to the edge of potential acceptors shall be computed as a weighted distance from the combined masses.

Calculation of weighted distance from combined masses:

Let M_2, M_3 . . . M_n be donor masses to be combined.

M_1 is a potential acceptor mass.

D_{12} is distance from M_1 to M_2 (edge to edge).

D_{13} is distance from M_1 to M_3 (edge to edge), etc.

To find weighted distance $[D_{1(2,3}\ldots_{n)}]$ from combined masses to M_1, add the products of the individual masses and distances and divide the total by the sum of the masses thus:

$$D_{1(2,3}\ldots_{n)} = \frac{M_2 \times D_{12} + M_3 \times D_{13} \ldots + M_n \times D_{1n}}{M_2 + M_3 \ldots + M_n}$$

Propagation is possible if either an individual donor mass is less than the tabulated distance from an acceptor or a combined mass is less than the weighted distance from an acceptor.

(c) In determining the distances separating highways, railroads, and inhabited buildings from potential explosions (as prescribed in Table H–21), the sum of all masses which may propagate (i.e., lie at distances less than prescribed in the Table) from *either* individual *or* combined donor masses are included. However, when the ammonium nitrate must be included, only 50 percent of its weight shall be used because of its reduced blast effects. In applying Table H–21 to distances from highways, railroads, and inhabited buildings, distances are measured from the nearest edge of potentially explodable material as prescribed in Table H–21, Note 5.

(d) When all or part of a potential acceptor comprises Explosives Class A as defined in DOT regulations, storage in bullet-resistant magazines is required. Safe distances to stores in bullet-resistant magazines may be obtained from the intermagazine distances prescribed in Table H–21.

(e) Barricades must not have line-of-sight openings between potential donors and acceptors which permit blast or missiles to move directly between masses.

(f) Good housekeeping practices shall be maintained around any bin containing ammonium nitrate or blasting agent. This includes keeping weeds and other combustible materials cleared within 25 feet of such bin. Accumulation of spilled product on the ground shall be prevented.

(5) *Storage of blasting agents and supplies.* (i) Blasting agents and oxidizers used for mixing of blasting agents shall be stored in the manner set forth in this subdivision.

(a) Blasting agents or ammonium nitrate, when stored in conjunction with explosives, shall be stored in the manner set forth in paragraph (c) of this section for explosives. The mass of blasting agents and one-half the mass of ammonium nitrate shall be included when computing the total quantity of explosives for determining distance requirements.

(b) Blasting agents, when stored entirely separate from explosives, may be stored in the manner set forth in paragraph (c) of this section or in one-story warehouses (without basements) which shall be:

(1) Noncombustible or fire resistive;

(2) Constructed so as to eliminate open floor drains and piping into which

molten materials could flow and be confined in case of fire;

(3) Weather resistant;

(4) Well ventilated; and

(5) Equipped with a strong door kept securely locked except when open for business.

(c) Semitrailer or full-trailer vans used for highway or onsite transportation of the blasting agents are satisfactory for temporarily storing these materials, provided they are located in accordance with Table H–21 with respect to inhabited buildings, passenger railways, and public highways and according to Table H–22 with respect to one another. Trailers shall be provided with substantial means for locking, and the trailer doors shall be kept locked, except during the time of placement and removal of stocks of blasting agents.

(ii) Warehouses used for the storage of blasting agents separate from explosives shall be located as set forth in this subdivision.

(a) Warehouses used for the storage of blasting agents shall be located in accordance with the provisions of Table H–21 with respect to inhabited buildings, passenger railways, and public highways, and according to Table H–22 with respect to one another.

(b) If both blasting agents and ammonium nitrate are handled or stored within the distance limitations prescribed through subparagraph (2) of this paragraph, one-half the mass of the ammonium nitrate shall be added to the mass of the blasting agent when computing the total quality of explosives for determining the proper distance for compliance with Table H–21.

(iii) Smoking, matches, open flames, spark producing devices, and firearms are prohibited inside of or within 50 feet of any warehouse used for the storage of blasting agents. Combustible materials shall not be stored within 50 feet of warehouses used for the storage of blasting agents.

(iv) The interior of warehouses used for the storage of blasting agents shall be kept clean and free from debris and empty containers. Spilled materials shall be cleaned up promptly and safely removed. Combustible materials, flammable liquids, corrosive acids, chlorates, or nitrates shall not be stored in any warehouse used for blasting agents unless separated therefrom by a fire resistive separation of not less than 1 hour resistance. The provisions of this subdivision shall not prohibit the storage of blasting agents together with nonexplosive blasting supplies.

(v) Piles of ammonium nitrate and warehouses containing ammonium nitrate shall be adequately separated from readily combustible fuels.

(vi) Caked oxidizers, either in bags or in bulk, shall not be loosened by blasting.

(vii) Every warehouse used for the storage of blasting agents shall be under the supervision of a competent person who shall be not less than 21 years of age.

(6) *Transportation of packaged blasting agents.* (i) When blasting agents are transported in the same vehicle with explosives, all of the requirements of paragraph (d) of this section shall be complied with.

(ii) Vehicles transporting blasting agents shall only be driven by and be in charge of a driver at least twenty-one (21) years of age who is capable, careful, reliable, and in possession of a valid motor vehicle operator's license. Such a person shall also be familiar with the States vehicle and traffic laws.

(iii) No matches, firearms, acids, or other corrosive liquids shall be carried in the bed or body of any vehicle containing blasting agents.

(iv) No person shall be permitted to ride upon, drive, load, or unload a vehicle containing blasting agents while smoking or under the influence of intoxicants, narcotics, or other dangerous drugs.

(v) It is prohibited for any person to transport or carry any blasting agents upon any public vehicle carrying passengers for hire.

(vi) Vehicles transporting blasting agents shall be in safe operating condition at all times.

(vii) When offering blasting agents for transportation on public highways the packaging, marking, and labeling of containers of blasting agents shall comply with the requirements of DOT.

(viii) Vehicles used for transporting blasting agents on public highways shall be placarded in accordance with DOT regulations.

(7) *Use of blasting agents.* Persons using blasting agents shall comply with all of the applicable provisions of paragraph (e) of this section.

(h) *Water gel (Slurry) explosives and blasting agents*—(1) *General provisions.* Unless otherwise set forth in this paragraph, water gels shall be transported, stored and used in the same manner as explosives or blasting agents in accordance with the classification of the product.

(2) *Types and classifications.* (i) Water gels containing a substance in itself classified as an explosive shall be classified as an explosive and manufactured, transported, stored, and used as specified for "explosives" in this section, except as noted in subdivision (iv) of this subparagraph.

(ii) Water gels containing no substance in itself classified as an explosive and which are cap-sensitive as defined in paragraph (a) of this section under Blasting Agent shall be classified as an explosive and manufactured, transported, stored and used as specified for "explosives" in this section.

(iii) Water gels containing no substance in itself classified as an explosive and which are not cap-sensitive as defined in paragraph (a) of this section under Blasting Agent shall be classified as blasting agents and manufactured, transported, stored, and used as specified for "blasting agents" in this section.

(iv) When tests on specific formulations of water gels result in Department of Transportation classification as a Class B explosive, bullet-resistant magazines are not required, see paragraph (c)(2)(ii) of this section.

(3) *Fixed location mixing.* (i)(a) Buildings or other facilities used for mixing water gels shall be located with respect to inhabited buildings, passenger railroads and public highways, in accordance with Table H–21.

(b) In determining the distances separating highways, railroads, and inhabited buildings from potential explosions (as prescribed in Table H–21), the sum of all masses that may propagate (i.e., lie at distances less than prescribed in Table H–22) from either individual or combined donor masses are included. However, when the ammonium nitrate must be included, only 50 percent of its weight shall be used because of its reduced blast effects.

(ii) Buildings used for the mixing of water gels shall conform to the requirements of this subdivision.

(a) Buildings shall be of noncombustible construction or sheet metal on wood studs.

(b) Floors in a mixing plant shall be of concrete or of other nonabsorbent materials.

(c) Where fuel oil is used all fuel oil storage facilities shall be separated from the mixing plant and located in such a manner that in case of tank rupture, the oil will drain away from the mixing plant building.

(d) The building shall be well ventilated. Heating units that do not depend on combustion processes, when properly designed and located, may be used in the building. All direct sources of heat shall be provided exclusively from units located outside of the mixing building.

(e) All internal-combustion engines used for electric power generation shall be located outside the mixing plant building, or shall be properly ventilated and isolated by a firewall. The exhaust systems on all such engines shall be located so any spark emission cannot be a hazard to any materials in or adjacent to the plant.

(iii) Ingredients of water gels shall conform to the requirements of this subdivision.

(a) Ingredients in themselves classified as Class A or Class B explosives shall be stored in conformity with paragraph (c) of this section.

(b) Nitrate-water solutions may be stored in tank cars, tank trucks, or fixed tanks without quantity or distance limitations. Spills or leaks which may contaminate combustible materials shall be cleaned up immediately.

(c) Metal powders such as aluminum shall be kept dry and shall be stored in containers or bins which are moisture-resistant or weathertight. Solid fuels shall be used in such manner as to minimize dust explosion hazards.

(d) Ingredients shall not be stored with imcompatible materials.

(e) Peroxides and chlorates shall not be used.

(iv) Mixing equipment shall comply with the requirements of this subdivision.

(a) The design of the processing equipment, including mixing and conveying equipment, shall be compatible with the relative sensitivity of the materials being handled. Equipment shall be designed to minimize the possibility of frictional heating, compaction, overloading, and confinement.

(b) Both equipment and handling procedures shall be designed to prevent the introduction of foreign objects or materials.

(c) Mixers, pumps, valves, and related equipment shall be designed to permit regular and periodic flushing, cleaning, dismantling, and inspection.

(d) All electrical equipment including wiring, switches, controls, motors, and lights, shall conform to the requirements of Subpart S of this part.

(e) All electric motors and generators shall be provided with suitable overload protection devices. Electrical generators, motors, proportioning devices, and all other electrical enclosures shall be electrically bonded. The grounding conductor to all such electrical equipment shall be effectively bonded to the service-entrance ground connection and to all equipment ground connections in a manner so as to provide a continuous path to ground.

(v) Mixing facilities shall comply with the fire prevention requirements of this subdivision.

(a) The mixing, loading, and ingredient transfer areas where residues or spilled materials may accumulate shall be cleaned periodically. A cleaning and collection system for dangerous residues shall be provided.

(b) A daily visual inspection shall be made of the mixing, convening, and electrical equipment to establish that such equipment is in good operating condition. A program of systematic maintenance shall be conducted on regular schedule.

(c) Heaters which are not dependent on the combustion process within the heating unit may be used within the confines of processing buildings, or compartments, if provided with temperature and safety controls and located away from combustible materials and the finished product.

(4) *Bulk delivery and mixing vehicles.* (i) The design of vehicles shall comply with the requirements of this subdivision.

(a) Vehicles used over public highways for the bulk transportation of water gels or of ingredients classified as dangerous commodities, shall meet the requirements of th Department of Transportation and shall meet the requirements of paragraphs (d) and (g)(6) of this section.

(b) When electric power is supplied by a self-contained motor generator located on the vehicle the generator shall be at a point separate from where the water gel is discharged.

(c) The design of processing equipment and general requirements shall conform to subparagraphs (3) (iii) and (iv) of this paragraph.

(d) A positive action parking brake which will set the wheel brakes on at least one axle shall be provided on vehicles when equipped with air brakes and shall be used during bulk delivery operations. Wheel chocks shall supplement parking brakes whenever conditions may require.

(ii) Operation of bulk delivery and mixing vehicles shall comply with the requirements of this subdivision.

(a) The placarding requirements contained in DOT regulations apply to vehicles carrying water gel explosives or blasting agents.

(b) The operator shall be trained in the safe operation of the vehicle together with its mixing, conveying, and related equipment. He shall be familiar with the commodities being delivered and the general procedure for handling emergency situations.

(c) The hauling of either blasting caps or other explosives, but not both, shall be permitted on bulk trucks provided that a special wood or nonferrous-lined container is installed for the explosives. Such blasting caps or other explosives shall be in DOT-specified shipping containers; see 49 CFR Chapter I.

(d) No person shall be allowed to smoke, carry matches or any flame-producing device, or carry any firearms while in or about bulk vehicles effecting the mixing, transfer, or down-the-hole loading of water gels at or near the blasting site.

(e) Caution shall be exercised in the movement of the vehicle in the blasting area to avoid driving the vehicle over or dragging hoses over firing lines, cap wires, or explosive materials. The employer shall furnish the driver the assistance of a second person to guide the driver's movements.

(f) No intransit mixing of materials shall be performed.

(g) The location chosen for water gel or ingredient transfer from a support vehicle into the borehold loading vehicle shall be away from the blasthole site when the boreholes are loaded or in the process of being loaded.

(i) *Storage of ammonium nitrate*—(1) *Scope and definitions.* (i) (a) Except as provided in subdivision (d) of this subdivision this paragraph applies to the storage of ammonium nitrate in the form of crystals, flakes, grains, or prills including fertilizer grade, dynamite grade, nitrous oxide grade, technical grade, and other mixtures containing 60 percent or more ammonium nitrate by weight but does not apply to blasting.

(b) This paragraph does not apply to the transportation of ammonium nitrate.

(c) This paragraph does not apply to storage under the jurisdiction of and in compliance with the regulations of the U.S. Coast Guard (see 46 CFR Parts 146–149).

(d) The storage of ammonium nitrate and ammonium nitrate mixtures that are more sensitive than allowed by the "Definition of Test Procedures for Ammonium Nitrate Fertilizer" is prohibited.

(e) Nothing in this paragraph shall apply to the production of ammonium nitrate or to the storage of ammonium nitrate on the premises of the producing plant, provided that no distinct undue hazard to the public is created.

(ii) (a) The definition and test procedures for ammonium nitrate fertilizer are those found in the bulletin, "Definition and Test Procedures for Ammonium Nitrate Fertilizer", available from the National Plant Food Institute, 1700 K Street NW., Washington, DC 20006. This definition limits the contents of organic materials, metals, sulfur, etc., in a product that may be classified ammonium nitrate fertilizer.

(b) The standards for ammonium nitrate (nitrous oxide grade) are those found in the "Specifications, Properties, and Recommendations for Packaging, Transportation, Storage, and Use of Ammonium Nitrate", available from the Compressed Gas Association, Inc., 500 Fifth Avenue, New York, NY 10036.

(2) *General provisions.* (i) This paragraph applies to all persons storing, having, or keeping ammonium nitrate, and to the owner or lessee of any building, premises, or structure in which ammonium nitrate is stored in quantities of 1,000 pounds or more.

(ii) Approval of large quantity storage shall be subject to due consideration of the fire and explosion hazards, including exposure to toxic vapors from burning or decomposing ammonium nitrate.

(iii) (a) Storage buildings shall not have basements unless the basements are open on at least one side. Storage buildings shall not be over one story in height.

(b) Storage buildings shall have adequate ventilation or be of a construction that will be self-ventilating in the event of fire.

(c) The wall on the exposed side of a storage building within 50 feet of a combustible building, forest, piles of combustible materials and similar exposure hazards shall be of fire-resistive construction. In lieu of the fire-resistive wall, other suitable means of exposure protection such as a free standing wall may be used. The roof coverings shall be class C or better, as defined in Roof Coverings, NFPA 203–1970.

(d) All flooring in storage and handling areas, shall be of noncombustible material or protected against impregnation by ammonium nitrate and shall be

without open drains, taps, tunnels, pits, or pockets into which any molten ammonium nitrate could flow and be confined in the event of fire.

(e) The continued use of an existing storage building or structure not in strict conformity with this paragraph may be approved in cases where such continued use will not constitute a hazard to life or adjoining property.

(f) Buildings and structures shall be dry and free from water seepage through the roof, walls, and floors.

(3) *Storage of ammonium nitrate in bags, drums, or other containers.* (i) (a) Bags and containers used for ammonium nitrate must comply with specifications and standards required for use in interstate commerce (see 49 CFR Chapter I).

(b) Containers used on the premises in the actual manufacturing or processing need not comply with provisions of subdivision (a) of this subdivision.

(ii) (a) Containers of ammonium nitrate shall not be accepted for storage when the temperature of the ammonium nitrate exceeds 130° F.

(b) Bags of ammonium nitrate shall not be stored within 30 inches of the storage building walls and partitions.

(c) The height of piles shall not exceed 20 feet. The width of piles shall not exceed 20 feet and the length 50 feet except that where the building is of noncombustible construction or is protected by automatic sprinklers the length of piles shall not be limited. In no case shall the ammonium nitrate be stacked closer than 36 inches below the roof or supporting and spreader beams overhead.

(d) Aisles shall be provided to separate piles by a clear space of not less than 3 feet in width. At least one service or main aisle in the storage area shall be not less than 4 feet in width.

(4) *Storage of bulk ammonium nitrate.* (i) (a) Warehouses shall have adequate ventilation or be capable of adequate ventilation in case of fire.

(b) Unless constructed of noncombustible material or unless adequate facilities for fighting a roof fire are available, bulk storage structures shall not exceed a height of 40 feet.

(ii) (a) Bins shall be clean and free of materials which may contaminate ammonium nitrate.

(b) Due to the corrosive and reactive properties of ammonium nitrate, and to avoid contamination, galvanized iron, copper, lead, and zinc shall not be used in a bin construction unless suitably protected. Aluminum bins and wooden bins protected against impregnation by ammonium nitrate are permissible. The partitions dividing the ammonium nitrate storage from other products which would contaminate the ammonium nitrate shall be of tight construction.

(c) The ammonium nitrate storage bins or piles shall be clearly identified by signs reading "Ammonium Nitrate" with letters at least 2 inches high.

(iii) (a) Piles or bins shall be so sized and arranged that all material in the pile is moved out periodically in order to minimize possible caking of the stored ammonium nitrate.

(b) Height or depth of piles shall be limited by the pressure-setting tendency of the product. However, in no case shall the ammonium nitrate be piled higher at any point than 36 inches below the roof or supporting and spreader beams overhead.

(c) Ammonium nitrate shall not be accepted for storage when the temperature of the product exceeds 130° F.

(d) Dynamite, other explosives, and blasting agents shall not be used to break up or loosen caked ammonium nitrate.

(5) *Contaminants.* (i) (a) Ammonium nitrate shall be in a separate building or shall be separated by approved type firewalls of not less than 1 hour fire-resistance rating from storage or organic chemicals, acids, or other corrosive materials, materials that may require blasting during processing or handling, compressed flammable gases, flammable and combustible materials or other contaminating substances, including but not limited to animal fats, baled cotton, baled rags, baled scrap paper, bleaching powder, burlap or cotton bags, caustic soda, coal, coke, charcoal, cork, camphor, excelsior, fibers of any kind, fish oils, fish meal, foam rubber, hay, lubricating oil, linsed oil, or other oxidizable or drying oils, naphthalene, oakum, oiled clothing, oiled paper, oiled textiles, paint, straw, sawdust, wood shavings, or vegetable oils. Walls referred to in this subdivision need extend only to the underside of the roof.

(b) In lieu of separation walls, ammonium nitrate may be separated from the materials referred to in subdivision (a) of this subdivision by a space of at least 30 feet.

(c) Flammable liquids such as gasoline, kerosene, solvents, and light fuel oils shall not be stored on the premises except when such storage conforms to § 1910.106, and when walls and sills or curbs are provided in accordance with subdivisions (a) or (b) of this subdivision.

(d) LP-Gas shall not be stored on the premises except when such storage conforms to § 1910.110.

(ii) (a) Sulfur and finely divided metals shall not be stored in the same building with ammonium nitrate except when such storage conforms to paragraphs (a) through (h) of this section.

(b) Explosives and blasting agents shall not be stored in the same building with ammonium nitrate except on the premises of makers, distributors, and user-compounders of explosives or blasting agents.

(c) Where explosives or blasting agents are stored in separate buildings, other than on the premises of makers, distributors, and user-compounders of explosives or blasting agents, they shall be separated from the ammonium nitrate by the distances and/or barricades specified in Table H–22 of this subpart, but by not less than 50 feet.

(d) Storage and/or operations on the premises of makers, distributors, and user-compounders of explosives or blasting agents shall be in conformity with paragraphs (a) through (h) of this section.

(6) *General precautions.* (i) (a) Electrical installations shall conform to the requirements of subpart S of this part, for ordinary locations. They shall be designed to minimize damage from corrosion.

(vi) In areas where lightning storms are prevalent, lightning protection shall be provided. (See the Lightning Protection Code, NFPA 78–1968.)

(vii) Provisions shall be made to prevent unauthorized personnel from entering the ammonium nitrate storage area.

(7) *Fire protection.* (i) Not more than 2,500 tons of bagged ammonium nitrate shall be stored in a building or structure not equipped with an automatic sprinkler system. Sprinkler systems shall be of approved type and installed in accordance with the Standard for the Installation of Sprinkler Systems, NFPA 13–1969.

(ii) (a) Suitable fire control devices such as small hose or portable extinguishers shall be provided throughout the warehouse and in the loading and unloading areas. See the Standard for the Installation of Portable Fire Extinguishers, NFPA 10–1970, and the Standard for the Installation of Standpipe and Hose Systems, NFPA 14–1970.

(b) Water supplies and fire hydrants shall be available in accordance with recognized good practices.

§ 1910.110 Storage and handling of liquefied petroleum gases.

(a) *Definitions applicable to this section.* As used in this section:

(1) API–ASME container—A container constructed in accordance with the requirements of paragraph (b)(3)(iii) of this section.

(2) ASME container—A container constructed in accordance with the requirements of paragraph (b)(3)(iii) of this section.

(3) Container assembly—An assembly consisting essentially of the container and fittings for all container openings, including shutoff valves, excess flow valves, liquid-level gaging devices, safety relief devices, and protective housing.

(4) Containers—All vessels, such as tanks, cylinders, or drums, used for transportation or storing liquefied petroleum gases.

(5) DOT—Department of Transportation.

(6) DOT container—A container constructed in accordance with the applicable requirements of 49 CFR Chapter I.

(7) "Liquefied petroleum gases"—"LPG" and "LP-Gas"—Any material which is composed predominantly of any of the following hydrocarbons, or mixtures of them; propane, propylene, butanes (normal butane or iso-butane), and butylenes.

(8) Movable fuel storage tenders or farm carts—Containers not in excess of 1,200 gallons water capacity, equipped with wheels not to be towed from one

Printing error = error See 29 CFR 1910.110 in (29 CFR Part 900-End revised as of 1 Jan. 1972)
(iii) [illegible] and (3) (i), (ii), and (iii),

location of usage to another. They are basically nonhighway vehicles, but may occasionally be moved over public roads or highways. They are used as a fuel supply for farm tractors, construction machinery and similar equipment.

(9) P.S.I.G.—pounds per square inch gauge.

(10) P.S.I.A.—pounds per square inch absolute.

(11) Systems—an assembly of equipment consisting essentially of the container or containers, major devices such as vaporizers, safety relief valves, excess flow valves, regulators, and piping connecting such parts.

(12) Vaporizer-burner—an integral vaporizer-burner unit, dependent upon the heat generated by the burner as the source of heat to vaporize the liquid used for dehydrators or dryers.

(13) Ventilation, adequate—when specified for the prevention of fire during normal operation, ventilation shall be considered adequate when the concentration of the gas in a gas-air mixture does not exceed 25 percent of the lower flammable limit.

(14) Approved—unless otherwise indicated, listing or approval by the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factual Mutual Engineering Corp.

(15) Listed—see "approved" in § 1910.110(14).

(16) DOT Specifications—regulations of the Department of Transportation published in 49 CFR Chapter I.

(17) DOT regulations—see § 1910.110(a)(16).

(18) DOT requirements—see § 1910.110(a)(16).

(19) DOT cylinders—cylinders meeting the requirements of 49 CFR Chapter I.

(b) *Basic rules.*—(1) *Odorizing gases.* (i) All liquefied petroleum gases shall be effectively odorized by an approved agent of such character as to indicate positively, by distinct odor, the presence of gas down to concentration in air of not over one-fifth the lower limit of flammability. Odorization, however, is not required if harmful in the use of further processing of the liquefied petroleum gas, or if odorization will serve no useful purpose as a warning agent in such use or further processing.

(ii) The odorization requirement of subdivision (i) of this subparagraph shall be considered to be met by the use of 1.0 pounds of ethyl mercaptan, 1.0 pounds of thiophane or 1.4 pounds of amyl mercaptan per 10,000 gallons of LP-Gas. However, this listing of odorants and quantities shall not exclude the use of other odorants that meet the odorization requirements of subdivision (i) of this subparagraph.

(2) *Approval of equipment and systems.* (i) Each system utilizing DOT containers in accordance with 49 CFR Part 178 shall have its container valves, connectors, manifold valve assemblies, and regulators approved.

(ii) Each system for domestic or commercial use utilizing containers of 2,000 gallons or less water capacity, other than those constructed in accordance with 49 CFR Part 178, shall consist of a container assembly and one or more regulators, and may include other parts. The system as a unit or the container assembly as a unit, and the regulator or regulators, shall be individually listed.

(iv) The provisions of subdivision (i) of this subparagraph shall not be construed as prohibiting the continued use or reinstallation of containers constructed and maintained in accordance with the standard for the Storage and Handling of Liquefied Petroleum Gases NFPA No. 58 in effect at the time of fabrication.

(v) Containers used with systems embodied in paragraph (b), (d)(3)(iii), and (f) of this section, shall be constructed, tested, and stamped in accordance with DOT specifications effective at the date of their manufacture.

(4) *Welding of containers.* (i) Welding to the shell, head, or any other part of the container subject to internal pressure, shall be done in compliance with the code under which the tank was fabricated. Other welding is permitted only on saddle plates, lugs, or brackets attached to the container by the tank manufacturer.

(ii) Where repair or modification involving welding of DOT containers is required, the container shall be returned to a qualified manufacturer making containers of the same type, and the repair or modification made in compliance with DOT regulations.

(5) *Markings on containers.* (i) Each container covered in subparagraph (3)(i) of this paragraph, except as provided in subparagraph (3)(iv) of this paragraph shall be marked as specified in the following:

(*a*) With a marking identifying compliance with, and other markings required by, the rules of the reference under which the container is constructed; or with the stamp and other markings required by the National Board of Boiler and Pressure Vessel Inspectors.

(iii) In systems utilizing containers of over 2,000 gallons water capacity, each regulator, container valve, excess flow valve, gaging device, and relief valve installed on or at the container, shall have its correctness as to design, construction, and performance determined by listing by Underwriters Laboratories, Inc., or Factory Mutual Engineering Corp.

(3) *Requirements for construction and original test of containers.* (i) Containers used with systems embodied in paragraphs (d), (e), (g), and (h) of this section, except as provided in paragraphs (e)(3)(iii) and (g)(2)(i) of this section, shall be designed, constructed, and tested in accordance with the Rules for Construction of Unfired Pressure Vessels, section VIII, Division 1, American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code, 1968 edition.

(ii) Containers constructed according to the 1949 and earlier editions of the ASME Code do not have to comply with paragraphs U–2 through U–10 and U–19 thereof. Containers constructed according to paragraph U–70 in the 1949 and earlier editions are not authorized.

(iii) Containers designed, constructed, and tested prior to July 1, 1961, according to the Code for Unfired Pressure Vessels for Petroleum Liquids and Gases, 1951 edition with 1954 Addenda, of the American Petroleum Institute and the American Society of Mechanical Engineers shall be considered in conformance. Containers constructed according to API–ASME Code do not have to comply with section I or with appendix to section I. Paragraphs W–601 to W–606 inclusive in the 1943 and earlier editions do not apply.

(*b*) With notation as to whether the container is designed for underground or aboveground installation or both. If intended for both and different style hoods are provided, the marking shall indicate the proper hood for each type of installation.

(*c*) With the name and address of the supplier of the container, or with the trade name of the container.

(*d*) With the water capacity of the container in pounds or gallons, U.S. Standard.

(*e*) With the pressure in p.s.i.g., for which the container is designed.

(*f*) With the wording "This container shall not contain a product having a vapor pressure in excess of — p.s.i.g. at 100° F.," see subparagraph (14)(viii) of this paragraph.

(*g*) With the tare weight in pounds or other identified unit of weight for containers with a water capacity of 300 pounds or less.

(*h*) With marking indicating the maximum level to which the container may be filled with liquid at temperatures between 20° F. and 130° F., except on containers provided with fixed maximum level indicators or which are filled by weighing. Markings shall be increments of not more than 20° F. This marking may be located on the liquid level gaging device.

(*i*) With the outside surface area in square feet.

(ii) Markings specified shall be on a metal nameplate attached to the container and located in such a manner as to remain visible after the container is installed.

(iii) When LP-Gas and one or more other gases are stored or used in the same area, the containers shall be marked to identify their content. Marking shall be in compliance with American National Standard Z48.1–1954, "Method of Marking Portable Compressed Gas Containers To Identify the Material Contained."

(6) *Location of containers and regulating equipment.* (i) Containers, and first stage regulating equipment if used, shall be located outside of buildings, except under one or more of the following:

(*a*) In buildings used exclusively for container charging, vaporization pressure reduction, gas mixing, gas manufacturing, or distribution.

(*b*) When portable use is necessary and in accordance with paragraph (c)(5) of this section.

(c) LP-Gas fueled stationary or portable engines in accordance with paragraph (e) (11) or (12) of this section.

(d) LP-Gas fueled industrial trucks used in accordance with paragraph (e) (13) of this section.

(e) LP-Gas fueled vehicles garaged in accordance with paragraph (e) (14) of this section.

(f) Containers awaiting use or resale when stored in accordance with paragraph (f) of this section.

(ii) Each individual container shall be located with respect to the nearest important building or group of buildings or line of adjoining property which may be built on in accordance with Table H–23.

TABLE H–23

Water capacity per container	Minimum distances: Containers: Underground	Minimum distances: Containers: Aboveground	Minimum distances: Between aboveground containers
Less than 125 gals [1]	10 feet	None	None.
125 to 250 gallons	10 feet	10 feet	None.
251 to 500 gallons	10 feet	10 feet	3 feet.
501 to 2,000 gallons	25 feet [2]	25 feet [2]	3 feet.
2,001 to 30,000 gallons	50 feet	50 feet	5 feet.
30,001 to 70,000 gallons	50 feet	75 feet	¼ of sum of diameters of adjacent containers.
70,001 to 90,000 gallons	50 feet	100 feet	¼ of sum of diameters of adjacent containers.

[1] If the aggregate water capacity of a multi-container installation at a consumer site is 501 gallons or greater, the minimum distance shall comply with the appropriate portion of this table, applying the aggregate capacity rather than the capacity per container. If more than one installation is made, each installation shall be separated from another installation by at least 25 feet. Do not apply the MINIMUM DISTANCES BETWEEN ABOVEGROUND CONTAINERS to such installations.

[2] NOTE: The above distance requirements may be reduced to not less than 10 feet for a single container of 1,200 gallons water capacity or less, providing such a container is at least 25 feet from any other LP-Gas container of more than 125 gallons water capacity.

(iii) Containers installed for use shall not be stacked one above the other.

(iv) In industrial installations involving containers of 180,000 gallons aggregate water capacity or more, where serious mutual exposures between the container and adjacent properties prevail, firewalls or other means of special protection designed and constructed in accordance with good engineering practices are required.

(v) In the case of buildings devoted exclusively to gas manufacturing and distributing operations, the distances required by Table H–23 may be reduced provided that in no case shall containers of water capacity exceeding 500 gallons be located closer than 10 feet to such gas manufacturing and distributing buildings.

(vi) Readily ignitible material such as weeds and long dry grass shall be removed within 10 feet of any container.

(vii) The minimum separation between liquefied petroleum gas containers and flammable liquid tanks shall be 20 feet, and the minimum separation between a container and the centerline of the dike shall be 10 feet. The foregoing provision shall not apply when LP-Gas containers of 125 gallons or less capacity are installed adjacent to Class III flammable liquid tanks of 275 gallons or less capacity.

(viii) Suitable means shall be taken to prevent the accumulation of flammable liquids under adjacent liquefied petroleum gas containers, such as by diking, diversion curbs, or grading.

(ix) When dikes are used with flammable liquid tanks, no liquefied petroleum gas containers shall be located within the diked area.

(7) *Container valves and container accessories.* (i) Valves, fittings, and accessories connected directly to the container including primary shutoff valves, shall have a rated working pressure of at least 250 p.s.i.g. and shall be of material and design suitable for LP-Gas service. Cast iron shall not be used for container valves, fittings, and accessories. This does not prohibit the use of container valves made of malleable or nodular iron.

(ii) Connections to containers, except safety relief connections, liquid level gaging devices, and plugged openings, shall have shutoff valves located as close to the container as practicable.

(iii) Excess flow valves, where required shall close automatically at the rated flows of vapor or liquid as specified by the manufacturer. The connections or line including valves, fittings, etc., being protected by an excess flow valve shall have a greater capacity than the rated flow of the excess flow valve.

(iv) Liquid level gaging devices which are so constructed that outward flow of container contents shall not exceed that passed by a No. 54 drill size opening, need not be equipped with excess flow valves.

(v) Openings from container or through fittings attached directly on container to which pressure gage connection is made, need not be equipped with shutoff or excess flow valves if such openings are restricted to not larger than No. 54 drill size opening.

(vi) Except as provided in paragraph (c) (5) (i) (b) of this section, excess flow and back pressure check valves where required by this section shall be located inside of the container or at a point outside where the line enters the container; in the latter case, installation shall be made in such manner that any undue strain beyond the excess flow or back pressure check valve will not cause breakage between the container and such valve.

(vii) Excess flow valves shall be designed with a bypass, not to exceed a No. 60 drill size opening to allow equalization of pressures.

(viii) Containers of more than 30 gallons water capacity and less than 2,000 gallons water capacity, filled on a volumetric basis, and manufactured after December 1, 1963, shall be equipped for filling into the vapor space.

(8) *Piping—including pipe, tubing, and fittings.* (i) Pipe, except as provided in paragraphs (e) (6) (i) and (g) (10) (iii), of this section shall be wrought iron or steel (black or galvanized), brass, copper, or aluminum alloy. Aluminum alloy pipe shall be at least Schedule 40 in accordance with the specifications for Aluminum Alloy Pipe, American National Standards Institute (ANSI) H38.-7–1969 (AST, B241–69), except that the use of alloy 5456 is prohibited and shall be suitably marked at each end of each length indicating compliance with American National Standard Institute Specifications. Aluminum Alloy pipe shall be protected against external corrosion when it is in contact with dissimilar metals other than galvanized steel, or its location is subject to repeated wetting by such liquids as water (except rain water), detergents, sewage, or leaking from other piping, or it passes through flooring, plaster, masonry, or insulation. Galvanized sheet steel or pipe, galvanized inside and out, may be considered suitable protection. The maximum nominal pipe size for aluminum pipe shall be three-fourths inch and shall not be used for pressures exceeding 20 p.s.i.g. Aluminum alloy pipe shall not be installed within 6 inches of the ground.

(a) Vapor piping with operating pressures not exceeding 125 p.s.i.g. shall be suitable for a working pressure of at least 125 p.s.i.g. Pipe shall be at least Schedule 40 ASTM A–53–69, Grade B Electric Resistance Welded and Electric Flash Welded Pipe or equal.

(b) Vapor piping with operating pressures over 125 p.s.i.g. and all liquid piping shall be suitable for a working pressure of at least 250 p.s.i.g. Pipe shall be at least Schedule 80 if joints are threaded or threaded and back welded. At least Schedule 40 (ASTM A–53–69 Grade B Electric Resistance Welded and Electric Flash Welded Pipe or equal) shall be used if joints are welded, or welded and flanged.

(ii) Tubing shall be seamless and of copper, brass, steel, or aluminum alloy. Copper tubing shall be of type K or L or equivalent as covered in the Specification for Seamless Copper Water Tube, ANSI H23.1–1970 (ASTM B88–69). Aluminum alloy tubing shall be of Type A or B or equivalent as covered in Specification ASTM B210–68 and shall be suitably marked every 18 inches indicating compliance with ASTM Specifications. The minimum nominal wall thickness of copper tubing and aluminum alloy tubing shall be as specified in Table H–24 and Table H–25.

TABLE H–24—WALL THICKNESS OF COPPER TUBING [1]

NOTE: The standard size by which tube is designated is ⅛-inch smaller than its nominal outside diameter.

Standard size (inches)	Nominal O.D. (inches)	Nominal wall thickness (inches): Type K	Nominal wall thickness (inches): Type L
¼	0.375	0.035	0.030
⅜	0.500	0.049	0.035
½	0.625	0.049	0.040
⅝	0.750	0.049	0.042
¾	0.875	0.065	0.045
1	1.125	0.065	0.050
1¼	1.375	0.065	0.055
1½	1.625	0.072	0.060
2	2.125	0.083	0.070

[1] Based on data in Specification for Seamless Copper Water Tube, ANSI H23.1–1970 (ASTM B–88–69).

TABLE H-25—WALL THICKNESS OF ALUMINUM ALLOY TUBING [1]

Outside diameter (inches)	Nominal wall thickness (inches)	
	Type A	Type B
⅜	0.035	0.049
½	0.035	0.049
⅝	0.042	0.049
¾	0.049	0.058

[1] Based on data in Standard Specification for Aluminum-Alloy Drawn Seamless Coiled Tubes for Special Purpose Applications, ASTM B210-68.

Aluminum alloy tubing shall be protected against external corrosion when it is in contact with dissimilar metals other than galvanized steel, or its location is subject to repeated wetting by liquids such as water (except rainwater), detergents, sewage, or leakage from other piping, or it passes through flooring, plaster, masonry, or insulation. Galvanized sheet steel or pipe, galvanized inside and out, may be considered suitable protection. The maximum outside diameter for aluminum alloy tubing shall be three-fourths inch and shall not be used for pressures exceeding 20 p.s.i.g. Aluminum alloy tubing shall not be installed within 6 inches of the ground.

(iii) In systems where the gas in liquid form without pressure reduction enters the building, only heavy walled seamless brass or copper tubing with an internal diameter not greater than three thirty-seconds inch, and a wall thickness of not less than three sixty-fourths inch shall be used. This requirement shall not apply to research and experimental laboratories, buildings, or separate fire divisions of buildings used exclusively for housing internal combustion engines, and to commercial gas plants or bulk stations where containers are charged, nor to industrial vaporizer buildings, nor to buildings, structures, or equipment under construction or undergoing major renovation.

(iv) Pipe joints may be screwed, flanged, welded, soldered, or brazed with a material having a melting point exceeding 1,000° F. Joints on seamless copper, brass, steel, or aluminum alloy gas tubing shall be made by means of approved gas tubing fittings, or soldered or brazed with a material having a melting point exceeding 1,000° F.

(v) For operating pressures of 125 p.s.i.g. or less, fittings shall be designed for a pressure of at least 125 p.s.i.g. For operating pressures above 125 p.s.i.g., fittings shall be designed for a minimum of 250 p.s.i.g.

(vi) The use of threaded cast iron pipe fittings such as ells, tees, crosses, couplings, and unions is prohibited. Aluminum alloy fittings shall be used with aluminum alloy pipe and tubing. Insulated fittings shall be used where aluminum alloy pipe or tubing connects with a dissimilar metal.

(vii) Strainers, regulators, meters, compressors, pumps, etc., are not to be considered as pipe fittings. This does not prohibit the use of malleable, nodular, or higher strength gray iron for such equipment.

(viii) All materials such as valve seats, packing, gaskets, diaphragms, etc., shall be of such quality as to be resistant to the action of liquified petroleum gas under the service conditions to which they are subjected.

(ix) All piping, tubing, or hose shall be tested after assembly and proved free from leaks at not less than normal operating pressures. After installation, piping and tubing of all domestic and commercial systems shall be tested and proved free of leaks using a manometer or equivalent device that will indicate a drop in pressure. Test shall not be made with a flame.

(x) Provision shall be made to compensate for expansion, contraction, jarring, and vibration, and for settling. This may be accomplished by flexible connections.

(xi) Piping outside buildings may be buried, above ground, or both, but shall be well supported and protected against physical damage. Where soil conditions warrant, all piping shall be protected against corrosion. Where condensation may occur, the piping shall be pitched back to the container, or suitable means shall be provided for revaporization of the condensate.

(9) *Hose specifications.* (i) Hose shall be fabricated of materials that are resistant to the action of LP-Gas in the liquid and vapor phases. If wire braid is used for reinforcing the hose, it shall be of corrosion-resistant material such as stainless steel.

(ii) Hose subject to container pressure shall be marked "LP-Gas" or "LPG" at not greater than 10-foot intervals.

(iii) Hose subject to container pressure shall be designed for a bursting pressure of not less than 1,250 p.s.i.g.

(iv) Hose subject to container pressure shall have its correctness as to design construction and performance determined by being listed (see § 1910.110 (a)(15)).

(v) Hose connections subject to container pressure shall be capable of withstanding, without leakage, a test pressure of not less than 500 p.s.i.g.

(vi) Hose and hose connections on the low-pressure side of the regulator or reducing valve shall be designed for a bursting pressure of not less than 125 p.s.i.g or five times the set pressure of the relief devices protecting that portion of the system, whichever is higher.

(vii) Hose may be used on the low-pressure side of regulators to connect to other than domestic and commercial gas appliances under the following conditions:

(*a*) The appliances connected with hose shall be portable and need a flexible connection.

(*b*) For use inside buildings the hose shall be of minimum practical length, but shall not exceed 6 feet except as provided in paragraph (c)(5)(i)(*f*) of this section and shall not extend from one room to another, nor pass through any walls, partitions, ceilings, or floors. Such hose shall not be concealed from view or used in a concealed location. For use outside of buildings, the hose may exceed this length but shall be kept as short as practical.

(*c*) The hose shall be approved and shall not be used where it is likely to be subjected to temperatures above 125° F. The hose shall be securely connected to the appliance and the use of rubber slip ends shall not be permitted.

(*d*) The shutoff valve for an appliance connected by hose shall be in the metal pipe or tubing and not at the appliance end of the hose. When shutoff valves are installed close to each other, precautions shall be taken to prevent operation of the wrong valve.

(*e*) Hose used for connecting to wall outlets shall be protected from physical damage.

(10) *Safety devices.* (i) Every container except those constructed in accordance with DOT specifications and every vaporizer (except motor fuel vaporizers and except vaporizers described in subparagraph (11)(ii)(*c*) of this paragraph and paragraph (d)(4)(v)(*a*) of this section) whether heated by artificial means or not, shall be provided with one or more safety relief valves of spring-loaded or equivalent type. These valves shall be arranged to afford free vent to the outer air with discharge not less than 5 feet horizontally away from any opening into the building which is below such discharge. The rate of discharge shall be in accordance with the requirements of subdivision (ii) of this subparagraph or subdivision (iii) of this subparagraph in the case of vaporizers.

(ii) Minimum required rate of discharge in cubic feet per minute of air at 120 percent of the maximum permitted start to discharge pressure for safety relief valves to be used on containers other than those constructed in accordance with DOT specification shall be as follows:

Surface area (sq. ft.)	*Flow rate CFM air*
20 or less	626
25	751
30	872
35	990
40	1,100
45	1,220
50	1,330
55	1,430
60	1,540
65	1,640
70	1,750
75	1,850
80	1,950
85	2,050
90	2,150
95	2,240
100	2,340
105	2,440
110	2,530
115	2,630
120	2,720
125	2,810
130	2,900
135	2,990
140	3,080
145	3,170
150	3,260
155	3,350
160	3,440

Surface area (sq. ft.)	Flow rate CFM air
165	3,530
170	3,620
175	3,700
180	3,790
185	3,880
190	3,960
195	4,050
200	4,130
210	4,300
220	4,470
230	4,630
240	4,800
250	4,960
260	5,130
270	5,290
280	5,450
290	5,610
300	5,760
310	5,920
320	6,080
330	6,230
340	6,390
350	6,540
360	6,690
370	6,840
380	7,000
390	7,150
400	7,300
450	8,040
500	8,760
550	9,470
600	10,170
650	10,860
700	11,550
750	12,220
800	12,880
850	13,540
900	14,190
950	14,830
1,000	15,470
1,050	16,100
1,100	16,720
1,150	17,350
1,200	17,960
1,250	18,570
1,300	19,180
1,350	19,780
1,400	20,380
1,450	20,980
1,500	21,570
1,550	22,160
1,600	22,740
1,650	23,320
1,700	23,900
1,750	24,470
1,800	25,050
1,850	25,620
1,900	26,180
1,950	26,750
2,000	27,310

Surface area=total outside surface area of container in square feet.

When the surface area is not stamped on the nameplate or when the marking is not legible, the area can be calculated by using one of the following formulas:

(1) Cylindrical container with hemispherical heads:

Area=Overall length×outside diameter×3.1416.

(2) Cylindrical container with other than hemispherical heads:

Area=(Overall length+0.3 outside diameter)×outside diameter×3.1416.

NOTE: This formula is not exact, but will give results within the limits of practical accuracy for the sole purpose of sizing relief valves.

(3) Spherical container:

Area=Outside diameter squared×3.1416.

Flow Rate-CFM Air=Required flow capacity in cubic feet per minute of air at standard conditions, 60 F. and atmospheric pressure (14.7 p.s.i.a.).

The rate of discharge may be interpolated for intermediate values of surface area. For containers with total outside surface area greater than 2,000 square feet, the required flow rate can be calculated using the formula, Flow Rate-CFM Air=53.632 $A^{0.82}$.

A=total outside surface area of the container in square feet.

Valves not marked "Air" have flow rate marking in cubic feet per minute of liquefied petroleum gas. These can be converted to ratings in cubic feet per minute of air by multiplying the liquefied petroleum gas ratings by factors listed below. Air flow ratings can be converted to ratings in cubic feet per minute of liquefied petroleum gas by dividing the air ratings by the factors listed below.

AIR CONVERSION FACTORS

Container type	100	125	150	175	200
Air conversion factor	1.162	1.142	1.113	1.078	1.010

(iii) Minimum Required Rate of Discharge for Safety Relief Valves for Liquefied Petroleum Gas Vaporizers (Steam Heated, Water Heated, and Direct Fired).

The minimum required rate of discharge for safety relief valves shall be determined as follows:

(*a*) Obtain the total surface area by adding the surface area of vaporizer shell in square feet directly in contact with LP-Gas and the heat exchanged surface area in square feet directly in contact with LP-Gas.

(*b*) Obtain the minimum required rate of discharge in cubic feet of air per minute, at 60° F. and 14.7 p.s.i.a. from subdivision (ii) of this subparagraph, for this total surface area.

(iv) Container and vaporizer safety relief valves shall be set to start-to-discharge, with relation to the design pressure of the container, in accordance with Table H–26.

TABLE H–26

Containers	Minimum (percent)	Maximum (percent)
ASME Code; Par. U–68, U–69—1949 and earlier editions	110	[1] 125
ASME Code; Par. U–200, U–201—1949 edition	88	[1] 100
ASME Code—1950, 1952, 1956, 1959, 1962, 1965 and 1968 (Division I) editions	88	[1] 100
API—ASME Code—all editions	88	[1] 100
DOT—As prescribed in 49 CFR Chapter I		

[1] Manufacturers of safety relief valves are allowed a plus tolerance not exceeding 10 percent of the set pressure marked on the valve.

(v) Safety relief devices used with systems employing containers other than those constructed according to DOT specifications shall be so constructed as to discharge at not less than the rates shown in subdivision (ii) of this subparagraph, before the pressure is in excess of 120 percent of the maximum (not including the 10 percent referred to in subdivision (iv) of this subparagraph) permitted start to discharge pressure setting of the device.

(vi) In certain locations sufficiently sustained high temperatures prevail which require the use of a lower vapor pressure product to be stored or the use of a higher designed pressure vessel in order to prevent the safety valves opening as the result of these temperatures. As an alternative the tanks may be protected by cooling devices such as by spraying, by shading, or other effective means.

(vii) Safety relief valves shall be arranged so that the possibility of tampering will be minimized. If pressure setting or adjustment is external, the relief valves shall be provided with approved means for sealing adjustment.

(viii) Shutoff valves shall not be installed between the safety relief devices and the container, or the equipment or piping to which the safety relief device is connected except that a shutoff valve may be used where the arrangement of this valve is such that full required capacity flow through the safety relief device is always afforded.

(ix) Safety relief valves shall have direct communication with the vapor space of the container at all times.

(x) Each container safety relief valve used with systems covered by paragraphs (d), (e), (g), and (h) of this section, except as provided in paragraph (e)(3)(iii) of this section shall be plainly and permanently marked with the following: "Container Type" of the pressure vessel on which the valve is designed to be installed; the pressure in p.s.i.g. at which the valve is set to discharge; the actual rate of discharge of the valve in cubic feet per minute of air at 60° F. and 14.7 p.s.i.a.; and the manufacturer's name and catalog number, for example: T200–250–4050 AIR—indicating that the valve is suitable for use on a Type 200 container, that it is set to start to discharge at 250 p.s.i.g.; and that its rate of discharge is 4,050 cubic feet per minute of air as determined in subdivision (ii) of this subparagraph.

(xi) Safety relief valve assemblies, including their connections, shall be of sufficient size so as to provide the rate of flow required for the container on which they are installed.

(xii) A hydrostatic relief valve shall be installed between each pair of shutoff valves on liquefied petroleum gas liquid piping so as to relieve into a safe atmosphere. The start-to-discharge pressure setting of such relief valves shall not be in excess of 500 p.s.i.g. The minimum setting on relief valves installed in piping connected to other than DOT containers shall not be lower than 140 percent of the container relief valve setting and in piping connected to DOT containers not lower than 400 p.s.i.g. Such a relief valve should not be installed in the pump discharge if the same protection can be provided by installing the relief valve in the suction piping. The start-to-discharge pressure setting of such a relief valve, if installed on the discharge side of a pump, shall be greater than the maximum pressure permitted by the recirculation device in the system.

(xiii) The discharge from any safety relief device shall not terminate in or beneath any building, except relief devices covered by subparagraphs (6) (i) (*a*)–(*f*) of this paragraph, or paragraphs (c) (4) (i) or (5) of this section.

(xiv) Container safety relief devices and regulator relief vents shall be located not less than five (5) feet in any direction from air openings into sealed combustion system appliances or mechanical ventilation air intakes.

(11) *Vaporizer and housing.* (i) Indirect fired vaporizers utilizing steam, water, or other heating medium shall be constructed and installed as follows:

(*a*) Vaporizers shall be constructed in accordance with the requirements of subparagraph (3) (i)–(iii) of this paragraph and shall be permanently marked as follows:

(*1*) With the code marking signifying the specifications to which the vaporizer is constructed.

(2) With the allowable working pressure and temperature for which the vaporizer is designed.

(3) With the sum of the outside surface area and the inside heat exchange surface area expressed in square feet.

(*4*) With the name or symbol of the manufacturer.

(*b*) Vaporizers having an inside diameter of 6 inches or less exempted by the ASME Unfired Pressure Vessel Code, Section VIII of the ASME Boiler and Pressure Vessel Code—1968 shall have a design pressure not less than 250 p.s.i.g. and need not be permanently marked.

(*c*) Heating or cooling coils shall not be installed inside a storage container.

(*d*) Vaporizers may be installed in buildings, rooms, sheds, or lean-tos used exclusively for gas manufacturing or distribution, or in other structures of light, noncombustible construction or equivalent, well ventilated near the floor line and roof.

When vaporizing and/or mixing equipment is located in a structure or building not used exclusively for gas manufacturing or distribution, either attached to or within such a building, such structure or room shall be separated from the remainder of the building by a wall designed to withstand a static pressure of at least 100 pounds per square foot. This wall shall have no openings or pipe or conduit passing through it. Such structure or room shall be provided with adequate ventilation and shall have a roof or at least one exterior wall of lightweight construction.

(*e*) Vaporizers shall have, at or near the discharge, a safety relief valve providing an effective rate of discharge in accordance with subparagraph (10(iii) of this paragraph, except as provided in paragraph (d) (4) (v) (*a*), of this section.

(*f*) The heating medium lines into and leaving the vaporizer shall be provided with suitable means for preventing the flow of gas into the heat systems in the event of tube rupture in the vaporizer. Vaporizers shall be provided with suitable automatic means to prevent liquid passing through the vaporizers to the gas discharging pipe.

(*g*) The device that supplies the necessary heat for producing steam, hot water, or other heating medium may be installed in a building, compartment, room, or lean-to which shall be ventilated near the floorline and roof to the outside. The device location shall be separated from all compartments or rooms containing liquefied petroleum gas vaporizers, pumps, and central gas mixing devices by a well designed to withstand a static pressure of at least 100 pounds per square foot. This wall shall have no openings or pipes or conduit passing through it. This requirement does not apply to the domestic water heaters which may supply heat for a vaporizer in a domestic system.

(*h*) Gas-fired heating systems supplying heat exclusively for vaporization purposes shall be equipped with automatic safety devices to shut off the flow of gas to main burners, if the pilot light should fail.

(*i*) Vaporizers may be an integral part of a fuel storage container directly connected to the liquid section or gas section or both.

(*j*) Vaporizers shall not be equipped with fusible plugs.

(*k*) Vaporizer houses shall not have unprotected drains to sewers or sump pits.

(ii) Atmospheric vaporizers employing heat from the ground or surrounding air shall be installed as follows:

(*a*) Buried underground, or

(*b*) Located inside the building close to a point at which pipe enters the building provided the capacity of the unit does not exceed 1 quart.

(*c*) Vaporizers of less than 1 quart capacity heated by the ground or surrounding air, need not be equipped with safety relief valves provided that adequate tests demonstrate that the assembly is safe without safety relief valves.

(iii) Direct gas-fired vaporizers shall be constructed, marked, and installed as follows:

(*a*) (*1*) In accordance with the requirements of the American Society of Mechanical Engineers Boiler and Pressure Vessel Code—1968 that are applicable to the maximum working conditions for which the vaporizer is designed.

(2) With the name of the manufacturer; rated BTU input to the burner; the area of the heat exchange surface in square feet; the outside surface of the vaporizer in square feet; and the maximum vaporizing capacity in gallons per hour.

(*b*) (*1*) Vaporizers may be connected to the liquid section or the gas section of the storage container, or both; but in any case there shall be at the container a manually operated valve in each connection to permit completely shutting off when desired, of all flow of gas or liquid from container to vaporizer.

(2) Vaporizers with capacity not exceeding 35 gallons per hour shall be located at least 5 feet from container shutoff valves. Vaporizers having capacity of more than 35 gallons but not exceeding 100 gallons per hour shall be located at least 10 feet from the container shutoff valves. Vaporizers having a capacity greater than 100 gallons per hour shall be located at least 15 feet from container shutoff valves.

(*c*) Vaporizers may be installed in buildings, rooms, housings, sheds, or lean-tos used exclusively for vaporizing or mixing of liquefied petroleum gas. Vaporizing housing structures shall be of noncombustible construction, well ventilated near the floorline and the highest point of the roof. When vaporizer and/or mixing equipment is located in a structure or room attached to or within a building, such structure or room shall be separated from the remainder of the building by a wall designed to withstand a static pressure of at least 100 pounds per square foot. This wall shall have no openings or pipes or conduit passing through it. Such structure or room shall be provided with adequate ventilation, and shall have a roof or at least one exterior wall of lightweight construction in accordance with DOT specifications.

(*d*) Vaporizers shall have at or near the discharge, a safety relief valve providing an effective rate of discharge in accordance with subparagraph (10) (iii) of this paragraph. The relief valve shall be so located as not to be subjected to temperatures in excess of 140° F.

(*e*) Vaporizers shall be provided with suitable automatic means to prevent liquid passing from the vaporizer to the gas discharge piping of the vaporizer.

(*f*) Vaporizers shall be provided with means for manually turning off the gas to the main burner and pilot.

(*g*) Vaporizers shall be equipped with automatic safety devices to shut off the flow of gas to main burners if the pilot light should fail. When the flow through the pilot exceeds 2,000 B.t.u. per hour, the pilot also shall be equipped with an automatic safety device to shut off the flow of gas to the pilot should the pilot flame be extinguished.

(*h*) Pressure regulating and pressure reducing equipment if located within 10 feet of a direct fired vaporizer shall be separated from the open flame by a substantially airtight noncombustible partition or partitions.

(*i*) Except as provided in (c) of this subdivision, the following minimum distances shall be maintained between direct fired vaporizers and the nearest important building or group of buildings or line of adjoining property which may be built upon:

Ten feet for vaporizers having a capacity of 15 gallons per hour or less vaporizing capacity.

Twenty-five feet for vaporizers having a vaporizing capacity of 16 to 100 gallons per hour.

Fifty feet for vaporizers having a vaporizing capacity exceeding 100 gallons per hour.

(*j*) Direct fired vaporizers shall not raise the product pressure above the design pressure of the vaporizer equipment nor shall they raise the product pressure within the storage container above the pressure shown in the second column of Table 30–H.

(*k*) Vaporizers shall not be provided with fusible plugs.

(*l*) Vaporizers shall not have unprotected drains to sewers or sump pits.

(iv) Direct gas-fired tank heaters shall be constructed and installed as follows:

(*a*) Direct gas-fired tank heaters, and tanks to which they are applied, shall only be installed above ground.

(*b*) Tank heaters shall be permanently marked with the name of the manufacturer, the rated B.t.u. input to the burner, and the maximum vaporizing capacity in gallons per hour.

(*c*) Tank heaters may be an integral part of a fuel storage container directly connected to the container liquid section, or vapor section, or both.

(*d*) Tank heaters shall be provided with a means for manually turning off the gas to the main burner and pilot.

(*e*) Tank heaters shall be equipped with an automatic safety device to shut off the flow of gas to main burners, if the pilot light should fail. When flow through pilot exceeds 2,000 B.t.u. per hour, the pilot also shall be equipped with an automatic safety device to shut off the flow of gas to the pilot should the pilot flame be extinguished.

(*f*) Pressure regulating and pressure reducing equipment if located within 10 feet of a direct fired tank heater shall be separated from the open flame by a substantially airtight noncombustible partition.

(*g*) The following minimum distances shall be maintained between a storage tank heated by a direct fired tank heater and the nearest important building or group of buildings or line of adjoining property which may be built upon:

Ten feet for storage containers of less than 500 gallons water capacity.

Twenty-five feet for storage containers of 500 to 1,200 gallons water capacity.

Fifty feet for storage containers of over 1,200 gallons water capacity.

(*h*) No direct fired tank heater shall raise the product pressure within the storage container over 75 percent of the pressure set out in the second column of Table H–30.

(v) The vaporizer section of vaporizer-burners used for dehydrators or dryers shall be located outside of buildings; they shall be constructed and installed as follows:

(*a*) Vaporizer-burners shall have a minimum design pressure of 250 p.s.i.g. with a factor of safety of five.

(*b*) Manually operated positive shutoff valves shall be located at the containers to shut off all flow to the vaporizer-burners.

(*c*) Minimum distances between storage containers and vaporizer-burners shall be as follows:

Water capacity per container (gallons)	*Minimum distances (feet)*
Less than 501	10
501 to 2,000	25
Over 2,000	50

(*d*) The vaporizer section of vaporizer-burners shall be protected by a hydrostatic relief valve. The relief valve shall be located so as not to be subjected to temperatures in excess of 140° F. The start-to-discharge pressure setting shall be such as to protect the components involved, but not less than 250 p.s.i.g. The discharge shall be directed upward and away from component parts of the equipment and away from operating personnel.

(*e*) Vaporizer-burners shall be provided with means for manually turning off the gas to the main burner and pilot.

(*f*) Vaporizer-burners shall be equipped with automatic safety devices to shut off the flow of gas to the main burner and pilot in the event the pilot is extinguished.

(*g*) Pressure regulating and control equipment shall be located or protected so that the temperatures surrounding this equipment shall not exceed 140° F. except that equipment components may be used at higher temperatures if designed to withstand such temperatures.

(*h*) Pressure regulating and control equipment when located downstream of the vaporizer shall be designed to withstand the maximum discharge temperature of the vapor.

(*i*) The vaporizer section of vaporizer-burners shall not be provided with fusible plugs.

(*j*) Vaporizer coils or jackets shall be made of ferrous metal or high temperature alloys.

(*k*) Equipment utilizing vaporizer-burners shall be equipped with automatic shutoff devices upstream and downstream of the vaporizer section connected so as to operate in the event of excessive temperature, flame failure, and, if applicable, insufficient airflow.

(12) *Filling densities.* (i) The "filling density" is defined as the percent ratio of the weight of the gas in a container to the weight of water the container will hold at 60° F. All containers shall be filled according to the filling densities shown in Table H–27.

TABLE H-27—MAXIMUM PERMITTED FILLING DENSITY

Specific gravity at 60° F. (15.6° C.)	Aboveground containers		Underground containers, all capacities
	0 to 1,200 U.S. gals. (1,000 imp. gal., 4,550 liters) total water cap.	Over 1,200 U.S. gals. (1,000 imp. gal., 4,550 liters) total water cap.	
	Percent	*Percent*	*Percent*
0.496–0.503	41	44	45
.504–.510	42	45	46
.511–.519	43	46	47
.520–.527	44	47	48
.528–.536	45	48	49
.537–.544	46	49	50
.545–.552	47	50	51
.553–.560	48	51	52
.561–.568	49	52	53
.569–.576	50	53	54
.577–.584	51	54	55
.585–.592	52	55	56
.593–.600	53	56	57

(ii) Except as provided in subdivision (iii) of this subparagraph, any container including mobile cargo tanks and portable tank containers regardless of size or construction, shipped under DOT jurisdiction or constructed in accordance with 49 CFR Chapter I Specifications shall be charged according to 49 CFR Chapter I requirements.

(iii) Portable containers not subject to DOT jurisdiction (such as, but not limited to, motor fuel containers on industrial and lift trucks, and farm tractors covered in paragraph (e) of this section, or containers recharged at the installation) may be filled either by weight, or by volume using a fixed length dip tube gaging device.

(13) *LP-Gas in buildings.* (i) Vapor shall be piped into buildings at pressures in excess of 20 p.s.i.g. only if the buildings or separate areas thereof, (*a*) are constructed in accordance with this section; (*b*) are used excusively to house equipment for vaporization, pressure reduction, gas mixing, gas manufacturing, or distribution, or to house internal combustion engines, industrial processes, research and experimental laboratories, or equipment and processes using such gas and having similar hazard; (*c*) buildings, structures, or equipment under construction or undergoing major renovation.

(ii) Liquid may be permitted in buildings as follows:

(*a*) Buildings, or separate areas of buildings, used exclusively to house equipment for vaporization, pressure reduction, gas mixing, gas manufacturing, or distribution, or to house internal combustion engines, industrial processes, research and experimental laboratories, or equipment and processes using such gas and having similar hazard; and when such buildings, or separate areas thereof are constructed in accordance with this section.

(*b*) Buildings, structures, or equipment under construction or undergoing major renovation provided the temporary piping meets the following conditions:

(*1*) Liquid piping inside the building shall conform to the requirements of subparagraph (8) of this paragraph, and shall not exceed three-fourths iron pipe size. Copper tubing with an outside diameter of three-fourths inch or less may be used provided it conforms to Type K of Specifications for Seamless Water Tube, ANSI H23.1–1970 (ASTM B88–69) (see Table H–24). All such piping shall be protected against construction hazards. Liquid piping inside buildings shall be kept to a minimum. Such piping shall be securely fastened to walls or other surfaces so as to provide adequate protection from breakage and so located as to subject the liquid line to lowest ambient temperatures.

(*2*) A shutoff valve shall be installed in each intermediate branch line where it takes off the main line and shall be readily accessible. A shutoff valve shall also be placed at the appliance end of the intermediate branch line. Such shutoff valve shall be upstream of any flexible connector used with the appliance.

(*3*) Suitable excess flow valves shall be installed in the container outlet line supplying liquid LP-Gas to the building. A suitable excess flow valve shall be installed immediately downstream of each shutoff valve. Suitable excess flow valves shall be installed where piping size is reduced and shall be sized for the reduced size piping.

(4) Hydrostatic relief valves shall be installed in accordance with subparagraph (10)(xii) of this paragraph.

(5) The use of hose to carry liquid between the container and the building or at any point in the liquid line, except at the appliance connector, shall be prohibited.

(6) Where flexible connectors are necessary for appliance installation, such connectors shall be as short as practicable and shall comply with subparagraph (8)(ii) or (9) of this paragraph.

(7) Release of fuel when any section of piping or appliances is disconnected shall be minimized by either of the following methods:

(i) Using an approved automatic quick-closing coupling (a type closing in both directions when coupled in the fuel line), or

(ii) Closing the valve nearest to the appliance and allowing the appliance to operate until the fuel in the line is consumed.

(iii) Portable containers shall not be taken into buildings except as provided in subparagraph (6)(i) of this paragraph.

(14) *Transfer of liquids.* The employer shall assure that (i) at least one attendant shall remain close to the transfer connection from the time the connections are first made until they are finally disconnected, during the transfer of the product.

(ii) Containers shall be filled or used only upon authorization of the owner.

(iii) Containers manufactured in accordance with specifications of 49 CFR Part 178 and authorized by 49 CFR Chapter 1 as a "single trip" or "nonrefillable container" shall not be refilled or reused in LP-Gas service.

(iv) Gas or liquid shall not be vented to the atmosphere to assist in transferring contents of one container to another, except as provided in paragraph (e)(5)(iv) of this section and except that this shall not preclude the use of listed pump utilizing LP-Gas in the vapor phase as a source of energy and venting such gas to the atmosphere at a rate not to exceed that from a No. 31 drill size opening and provided that such venting and liquid transfer shall be located not less than 50 feet from the nearest important building.

(v) Filling of fuel containers for industrial trucks or motor vehicles from industrial bulk storage containers shall be performed not less than 10 feet from the nearest important masonry-walled building or not less than 25 feet from the nearest important building or other construction and, in any event, not less than 25 feet from any building opening.

(vi) Filling of portable containers, containers mounted on skids, fuel containers on farm tractors, or similar applications, from storage containers used in domestic or commercial service, shall be performed not less than 50 feet from the nearest important building.

(vii) The filling connection and the vent from the liquid level gages in containers, filled at point of installation, shall not be less than 10 feet in any direction from air openings into sealed combustion system appliances or mechanical ventilation air intakes.

(viii) Fuel supply containers shall be gaged and charged only in the open air or in buildings especially provided for that purpose.

(ix) The maximum vapor pressure of the product at 100° F. which may be transferred into a container shall be in accordance with paragraphs (d)(2) and (e)(3) of this section. (For DOT containers use DOT requirements.)

(x) Marketers and users shall exercise precaution to assure that only those gases for which the system is designed, examined, and listed, are employed in its operation, particularly with regard to pressures.

(xi) Pumps or compressors shall be designed for use with LP-Gas. When compressors are used they shall normally take suction from the vapor space of the container being filled and discharge to the vapor space of the container being emptied.

(xii) Pumping systems, when equipped with a positive displacement pump, shall include a recirculating device which shall limit the differential pressure on the pump under normal operating conditions to the maximum differential pressure rating of the pump. The discharge of the pumping system shall be protected so that pressure does not exceed 350 p.s.i.g. If a recirculation system discharges into the supply tank and contains a manual shutoff valve, an adequate secondary safety recirculation system shall be incorporated which shall have no means of rendering it inoperative. Manual shutoff valves in recirculation systems shall be kept open except during an emergency or when repairs are being made to the system.

(xiii) When necessary, unloading piping or hoses shall be provided with suitable bleeder valves for relieving pressure before disconnection.

(xvi) Agricultural air moving equipment, including crop dryers, shall be shut down when supply containers are being filled unless the air intakes and sources of ignition on the equipment are located 50 feet or more from the container.

(xv) Agricultural equipment employing open flames or equipment with integral containers, such as flame cultivators, weed burners, and, in addition, tractors, shall be shut down during refueling.

(15) *Tank car or transport truck loading or unloading points and operations.* (i) The track of tank car siding shall be relatively level.

(ii) A "Tank Car Connected" sign, as covered by DOT rules, shall be installed at the active end or ends of the siding while the tank car is connected.

(iii) While cars are on sidetrack for loading or unloading, the wheels at both ends shall be blocked on the rails.

(iv) The employer shall insure that an employee is in attendance at all times while the tank car, cars, or trucks are being loaded or unloaded.

(v) A backflow check valve, excess-flow valve, or a shutoff valve with means of remote closing, to protect against uncontrolled discharge of LP-Gas from storage tank piping shall be installed close to the point where the liquid piping and hose or swing joint pipe is connected.

(vi) Except as provided in subdivision (vii) of this subparagraph, when the size (diameter) of the loading or unloading hoses and/or piping is reduced below the size of the tank car or transport truck loading or unloading connections, the adaptors to which lines are attached shall be equipped with either a backflow check valve, a properly sized excess flow valve, or shutoff valve with means of remote closing, to protect against uncontrolled discharge from the tank car or transport truck.

(vii) The requirement of subdivision (vi) of this subparagraph shall not apply if the tank car or transport is equipped with a quick-closing internal valve that can be remotely closed.

(viii) The tank car or transport truck loading or unloading point shall be located with due consideration to the following:

(*a*) Proximity to railroads and highway traffic.

(*b*) The distance of such unloading or loading point from adjacent property.

(*c*) With respect to buildings on installer's property.

(*d*) Nature of occupancy.

(*e*) Topography.

(*f*) Type of construction of buildings.

(*g*) Number of tank cars or transport trucks that may be safely loaded or unloaded at one time.

(*h*) Frequency of loading or unloading.

(ix) Where practical, the distance of the unloading or loading point shall conform to the distances in subparagraph (6)(ii) of this paragraph.

(16) *Instructions.* Personnel performing installation, removal, operation, and maintenance work shall be properly trained in such function.

(17) *Electrical equipment and other sources of ignition.* (i) Electrical equipment and wiring shall be of a type specified by and shall be installed in accordance with Subpart S of this part, for ordinary locations except that fixed electrical equipment in classified areas shall comply with subparagraph (18) of this paragraph.

(ii) Open flames or other sources of ignition shall not be permitted in vaporizer rooms (except those housing direct-fired vaporizers), pumphouses, container charging rooms or other similar locations. Direct-fired vaporizers shall not be permitted in pumphouses or container charging rooms.

(iii) Liquefied petroleum gas storage containers do not require lightning protection.

(iv) Since liquefied petroleum gas is contained in a closed system of piping and equipment, the system need not be bonded for protection against static electrically conductive or electrically electricity.

(v) Open flames (except as provided for in subparagraph (ii) of this paragraph), cutting or welding, portable electric tools, and extension lights capable of igniting LP-Gas, shall not be permitted within classified areas specified in Table H–28 unless the LP-Gas facilities have been freed of all liquid and vapor, or special precautions observed under carefully controlled conditions.

TABLE H–28

Part	Location	Extent of classified area [1]	Equipment shall be suitable for National Electrical Code, Class 1, Group D [2]
A	Storage containers other than DOT cylinders.	Within 15 feet in all directions from connections, except connections otherwise covered in Table H–28.	Division 2.
B	Tank vehicle and tank car loading and unloading. [3]	Within 5 feet in all directions from connections regularly made or disconnected for product transfer.	Division 1.
		Beyond 5 feet but within 15 feet in all directions from a point where connections are regularly made or disconnected and within the cylindrical volume between the horizontal equator of the sphere and grade. (See Figure H–1).	Division 2.
C	Gage vent openings other than those on DOT cylinders.	Within 5 feet in all directions from point of discharge.	Division 1.
		Beyond 5 feet but within 15 feet in all directions from point of discharge.	Division 2.
D	Relief valve discharge other than those on DOT cylinders.	Within direct path of discharge.	Divison 1. *Note*—Fixed electrical equipment should preferably not be installed.
		Within 5 feet in all directions from point of discharge.	Division 1.
		Beyond 5 feet but within 15 feet in all directions from point of discharge except within the direct path of discharge.	Division 2.
E	Pumps, compressors, gas-air mixers and vaporizers other than direct fired.	----------	
	Indoors without ventilation.	Entire room and any adjacent room not separated by a gaslight partition.	Division 1.
		Within 15 feet of the exterior side of any exterior wall or roof that is not vaportight or within 15 feet of any exterior opening.	Division 2.
	Indoors with adequate ventilation. [4]	Entire room and any adjacent room not separated by a gastight partition.	Division 2.
	Outdoors in open air at or abovegrade.	Within 15 feet in all directions from this equipment and within the cylindrical volume between the horizontal equator of the sphere and grade. See Figure H–1.	Division 2.
F	Service Station Dispensing Units.	Entire space within dispenser enclosure, and 18 inches horizontally from enclosure exterior up to an elevation 4 ft. above dispenser base. Entire pit or open space beneath dispenser.	Division 1.
		Up to 18 inches abovegrade within 20 ft. horizontally from any edge of enclosure. Note: For pits within this area, see Part F of this table.	Division 2.
G	Pits or trenches containing or located beneath LP-Gas valves, pumps, compressors, regulators, and similar equipment.	----------	
	Without mechanical ventilation.	Entire pit or trench	Division 1.
		Entire room and any adjacent room not separated by a gastight partition.	Division 2.
		Within 15 feet in all directions from pit or trench when located outdoors.	Division 2.
	With adequate mechanical ventilation.	Entire pit or trench	Division 2.
		Entire room and any adjacent room not separated by a gastight partition.	Division 2.
		Within 15 feet in all directions from pit or trench when located outdoors.	Division 2.
H	Special buildings or rooms for storage of portable containers.	Entire room	Division 2.
I	Pipelines and connections containing operational bleeds, drips, vents or drains.	Within 5 ft. in all directions from point of discharge	Division 1.
		Beyond 5 ft. from point of discharge, same as Part E of this table.	
J	Container filling:		
	Indoors without ventilation.	Entire room	Division 1.
	Indoors with adequate ventilation. [4]	Within 5 feet in all directions from connections regularly made or disconnected for product transfer.	Division 1.
		Beyond 5 feet and entire room	Division 2.
	Outdoors in open air	Within 5 feet in all directions from connections regularly made or disconnected for product transfer.	Division 1.
		Beyond 5 feet but within 15 feet in all directions from a point where connections are regularly made or disconnected and within the cylindrical volume between the horizontal equator of the sphere and grade. (See Figure H–1)	Division 2.

[1] The classified area shall not extend beyond an unpierced wall, roof, or solid vaportight partition.
[2] See Subpart S of this part.
[3] When classifying extent of hazardous area, consideration shall be given to possible variations in the spotting of tank cars and tank vehicles at the unloading points and the effect these variations of actual spotting point may have on the point of connection.
[4] Ventilation, either natural or mechanical, is considered adequate when the concentration of the gas in a gas-air mixture does not exceed 25 percent of the lower flammable limit under normal operating conditions.

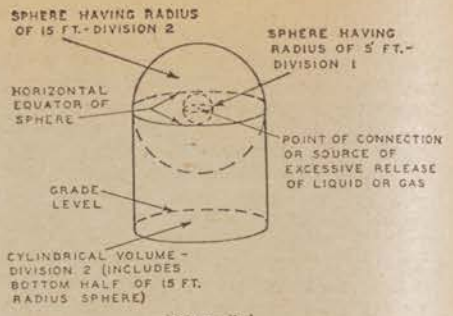

Figure H-1

(18) *Fixed electrical equipment in classified areas.* Fixed electrical equipment and wiring installed within classified areas specified in Table H–28 shall comply with Table H–28 and shall be installed in accordance with Subpart S of this part. This provision does not apply to fixed electrical equipment at residential or commercial installations of LP-Gas systems or to systems covered by paragraph (e) or (g) of this section.

(19) *Liquid-level gaging device.* (i) Each container manufactured after December 31, 1965, and filled on a volumetric basis shall be equipped with a fixed liquid-level gage to indicate the maximum permitted filling level as provided in subdivision (v) of this subparagraph. Each container manufactured after December 31, 1969, shall have permanently attached to the container adjacent to the fixed level gage a marking showing the percentage full that will be shown by that gage. When a variable liquid-level gage is also provided, the fixed liquid-level gage will also serve as a means for checking the variable gage. These gages shall be used in charging containers as required in subparagraph (12) of this paragraph.

(ii) All variable gaging devices shall be arranged so that the maximum liquid level for butane, for a 50–50 mixture of butane and propane, and for propane, to which the container may be charged is readily determinable. The markings indicating the various liquid levels from empty to full shall be on the system nameplate or gaging device or part may be on the system nameplate and part on the gaging device. Dials of magnetic or rotary gages shall show whether they are for cylindrical or spherical containers and whether for aboveground or underground service. The dials of gages intended for use only on aboveground containers of over 1,200 gallons water capacity shall be so marked.

(iii) Gaging devices that require bleeding of the product to the atmosphere, such as the rotary tube, fixed tube, and slip tube, shall be designed so that the bleed valve maximum opening is not larger than a No. 54 drill size, unless provided with excess flow valve.

(iv) Gaging devices shall have a design working pressure of at least 250 p.s.i.g.

(v) Length of tube or position of fixed liquid-level gage shall be designed to indicate the maximum level to which the container may be filled for the product

contained. This level shall be based on the volume of the product at 40° F. at its maximum permitted filling density for aboveground containers and at 50° F. for underground containers. The employer shall calculate the filling point for which the fixed liquid level gage shall be designed according to the method in this subdivision.

(a) It is impossible to set out in a table the length of a fixed dip tube for various capacity tanks because of the varying tank diameters and lengths and because the tank may be installed either in a vertical or horizontal position. Knowing the maximum permitted filling volume in gallons, however, the length of the fixed tube can be determined by the use of a strapping table obtained from the container manufacturer. The length of the fixed tube should be such that when its lower end touches the surface of the liquid in the container, the contents of the container will be the maximum permitted volume as determined by the following formula:

$$\frac{\text{Water capacity (gals.) of container}^{*} \times \text{filling density}^{**}}{\text{Specific gravity of LP-Gas}^{*} \times \text{volume correction factor}^{\dagger} \times 100} = \text{Maximum volume of LP-Gas}$$

*Measured at 60° F.

**From subparagraph (12) of this paragraph "Filling Densities."

†For aboveground containers the liquid temperature is assumed to be 40° F. and for underground containers the liquid temperature is assumed to be 50° F. To correct the liquid volumes at these temperatures to 60° F. the following factors shall be used.

(b) Formula for determining maximum volume of liquefied petroleum gas for which a fixed length of dip tube shall be set:

TABLE H-29—VOLUME CORRECTION FACTORS

Specific gravity	Aboveground	Underground
0.500	1.033	1.017
.510	1.031	1.016
.520	1.029	1.015
.530	1.028	1.014
.540	1.026	1.013
.550	1.025	1.013
.560	1.024	1.012
.570	1.023	1.011
.580	1.021	1.011
.590	1.020	1.010

(c) The maximum volume of LP-Gas which can be placed in a container when determining the length of the dip tube expressed as a percentage of total water content of the container is calculated by the following formula.

(d) The maximum weight of LP-Gas which may be placed in a container *for determining the length of a fixed dip tube* is determined by multiplying the maximum volume of liquefied petroleum gas obtained by the formula in (b) of this subdivision by the pounds of liquefied petroleum gas in a gallon at 40° F. for aboveground and at 50° F. for underground containers. For example, typical pounds per gallon are specified below:

Example: Assume a 100-gallon total water capacity tank for aboveground storage of propane having a specific gravity of 0.510 of 60° F.

$$\frac{100\ (\text{gals.}) \times 42\ (\text{filling density from subparagraph (12) of this paragraph})}{0.510 \times 1.031\ (\text{correction factor from Table H-29}) \times 100} = \frac{4200}{52.6}$$

$\frac{4200}{52.6}$ = 79.8 gallons propane, the maximum amount permitted to be placed in a 100-gallon total water capacity aboveground container equipped with a fixed dip tube.

$$\frac{\text{Maximum volume of LP-Gas (from formula in subdivision (b) of this subdivision)} \times 100}{\text{Total water content of container in gallons}} = \text{Maximum percent of LP-Gas}$$

	Aboveground, pounds per gallon	Underground, pounds per gallon
Propane	4.37	4.31
N Butane	4.97	4.92

(vi) Fixed liquid-level gages used on containers other than DOT containers shall be stamped on the exterior of the gage with the letters "DT" followed by the vertical distance (expressed in inches and carried out to one decimal place) from the top of container to the end of the dip tube or to the centerline of the gage when it is located at the maximum permitted filling level. For portable containers that may be filled in the horizontal and/or vertical position the letters "DT" shall be followed by "V" with the vertical distance from the top of the container to the end of the dip tube for vertical filling and with "H" followed by the proper distance for horizontal filling. For DOT containers the stamping shall be placed both on the exterior of the gage and on the container. On aboveground or cargo containers where the gages are positioned at specific levels, the marking may be specified in percent of total tank contents and the marking shall be stamped on the container.

(vii) Gage glasses of the columnar type shall be restricted to charging plants where the fuel is withdrawn in the liquid phase only. They shall be equipped with valves having metallic handwheels, with excess flow valves, and with extra-heavy glass adequately protected with a metal housing applied by the gage manufacturer. They shall be shielded against the direct rays of the sun. Gage glasses of the columnar type are prohibited on tank trucks, and on motor fuel tanks, and on containers used in domestic, commercial, and industrial installations.

(viii) Gaging devices of the float, or equivalent type which do not require flow for their operation and having connections extending to a point outside the container do not have to be equipped with excess flow valves provided the piping and fittings are adequately designed to withstand the container pressure and are properly protected against physical damage and breakage.

(20) *Requirements for appliances.* (i) Except as provided in subdivision (ii) of this subparagraph, new commercial and industrial gas consuming appliances shall be approved.

(ii) Any appliance that was originally manufactured for operation with a gaseous fuel other than LP-Gas and is in good condition may be used with LP-Gas only after it is properly converted, adapted, and tested for performance with LP-Gas before the appliance is placed in use.

(iii) Unattended heaters used inside buildings for the purpose of animal or poultry production or care shall be equipped with an approved automatic device designed to shut off the flow of gas to the main burners, and pilot if used, in the event of flame extinguishment.

(iv) All commercial, industrial, and agricultural appliances or equipment shall be installed in accordance with the requirements of this section and in accordance with the following:

(a) Domestic and commercial appliances—NFPA 54–1969, Standard for the Installation of Gas Appliances and Gas Piping.

(b) Industrial appliances—NFPA 54A–1969, Standard for the Installation of Gas Piping and Gas Equipment on Industrial Premises and Certain Other Premises.

(c) Standard for the Installation and Use of Stationary Combustion Engines and Gas Turbines—NFPA 37–1970.

(d) Standard for the Installation of Equipment for the Removal of Smoke and Grease-Laden Vapors from Commercial Cooking Equipment, NFPA 96–1970.

(c) *Cylinder systems*—(1) *Application.* This paragraph applies specifically to systems utilizing containers constructed in accordance with DOT Specifications. All requirements of paragraph (b) of this section apply to this paragraph unless otherwise noted in paragraph (b) of this section.

(2) *Marking of containers.* (i) Containers shall be marked in accordance with DOT regulations. Additional markings not in conflict with DOT regulations may be used.

(ii) Except as provided in subdivision (iii) of this subparagraph each container shall be marked with its water capacity in pounds or other identified unit of weight.

(iii) If a container is filled and maintained only by the owner or his representative and if the water capacity of each container is identified by a code,

compliance with subdivision (ii) of this subparagraph is not required.

(iv) Each container shall be marked with its tare weight in pounds or other identified unit of weight including all permanently attached fittings but not the cap.

(3) *Description of a system.* A system shall include the container base or bracket, containers, container valves, connectors, manifold valve assembly, regulators, and relief valves.

(4) *Containers and regulating equipment installed outside of buildings or structures.* (i) Containers shall not be buried below ground. However, this shall not prohibit the installation in a compartment or recess below grade level, such as a niche in a slope or terrace wall which is used for no other purpose, providing that the container and regulating equipment are not in contact with the ground and the compartment or recess is drained and ventilated horizontally to the outside air from its lowest level, with the outlet at least 3 feet away from any building opening which is below the level of such outlet.

Except as provided in paragraph (b) (10) (xiii) of this section, the discharge from safety relief devices shall be located not less than 3 feet horizontally away from any building opening which is below the level of such discharge and shall not terminate beneath any building unless such space is well ventilated to the outside and is not enclosed on more than two sides.

(ii) Containers shall be set upon firm foundation or otherwise firmly secured; the possible effect on the outlet piping of settling shall be guarded against by a flexible connection or special fitting.

(5) *Containers and equipment used inside of buildings or structures.* (i) When operational requirements make portable use of containers necessary and their location outside of buildings or structure is impracticable, containers and equipment are permitted to be used inside of buildings or structures in accordance with (*a*) through (*l*) of this subdivision, and, in addition, such other provisions of this subparagraph as are applicable to the particular use or occupancy.

(*a*) Containers in use shall mean connected for use.

(*b*) Systems utilizing containers having a water capacity greater than 2½ pounds (nominal 1 pound LP-Gas capacity) shall be equipped with excess flow valves. Such excess flow valves shall be either integral with the container valves or in the connections to the container valve outlets. In either case, an excess flow valve shall be installed in such a manner that any undue strain beyond the excess flow valve will not cause breakage between the container and the excess flow valve. The installation of excess flow valves shall take into account the type of valve protection provided.

(*c*) Regulators, if used, shall be either directly connected to the container valves or to manifolds connected to the container values. The regulator shall be suitable for use with LP-Gas. Manifolds and fittings connecting containers to pressure regulator inlets shall be designed for at least 250 p.s.i.g. service pressure.

(*d*) Valves on containers having a water capacity greater than 50 pounds (nominal 20 pounds LP-Gas capacity) shall be protected while in use.

(*e*) Containers shall be marked in accordance with paragraph (b) (5) (iii) of this section and subparagraph (2) of this paragraph.

(*f*) Pipe or tubing shall conform to paragraph (b) (8) of this section except that aluminum pipe or tubing shall not be used.

(*g*) (*1*) Hose shall be designed for a working pressure of at least 250 p.s.i.g. Hose and hose connections shall have their correctness as to design, construction and performance determined by listing by Underwriters Laboratories, Inc., or Factory Mutual Engineering Corp. The hose length may exceed the length specified in paragraph (b) (9) (vii) (*b*) of this section, but shall be as short as practicable.

(2) Hose shall be long enough to permit compliance with spacing provisions of this subparagraph without kinking or straining or causing hose to be so close to a burner as to be damaged by heat.

(*h*) Portable heaters, including salamanders, shall be equipped with an approved automatic device to shut off the flow of gas to the main burner, and pilot if used, in the event of flame extinguishment. Such heaters having inputs above 50,000 B.t.u. manufactured on or after May 17, 1967, and such heaters having inputs above 100,000 B.t.u. manufactured before May 17, 1967, shall be equipped with either.

(*1*) A pilot which must be lighted and proved before the main burner can be turned on; or

(2) An electric ignition system.

The provisions of (*g*) of this subdivision do not apply to tar kettle burners, torches, melting pots, nor do they apply to portable heaters under 7,500 B.t.u.h. input when used with containers having a maximum water capacity of 2½ pounds. Container valves, connectors, regulators, manifolds, piping, and tubing shall not be used as structural supports for heaters.

(*i*) Containers, regulating equipment, manifolds, pipe, tubing, and hose shall be located so as to minimize exposure to abnormally high temperatures (such as may result from exposure to convection or radiation from heating equipment or installation in confined spaces), physical damage, or tampering by unauthorized persons.

(*j*) Heat producing equipment shall be located and used so as to minimize the possibility of ignition of combustibles.

(*k*) Containers having a water capacity greater than 2½ pounds (nominal 1 pound LP-Gas capacity) connected for use, shall stand on a firm and substantially level surface and, when necessary, shall be secured in an upright position.

(*l*) Containers, including the valve protective devices, shall be installed so as to minimize the probability of impingement of discharge of safety relief devices upon containers.

(ii) Containers having a maximum water capacity of 2½ pounds (nominal 1 pound LP-Gas capacity) are permitted to be used inside of buildings as part of approved self-contained hand torch assemblies or similar appliances.

(iii) Containers having a maximum water capacity of 12 pounds (nominal 5 pounds LP-Gas capacity) are permitted to be used temporarily inside of buildings for public exhibition or demonstration purposes, including use for classroom demonstrations.

(iv) (*a*) When buildings frequented by the public are open to the public, containers are permitted to be used for repair or minor renovation as follows:

(*1*) The maximum water capacity of individual containers shall be 50 pounds (nominal 20 pounds LP-Gas capacity).

(2) The number of LP-Gas containers shall not exceed the number of workmen assigned to using the LP-Gas.

(3) Containers having a water capacity greater than 2½ pounds (nominal 1 pound LP-Gas capacity) shall not be left unattended in such buildings.

(*b*) When buildings frequented by the public are not open to the public, containers are permitted to be used for repair or minor renovations, as follows:

The provisions of subdivision (v) of this subparagraph shall apply except that containers having a water capacity greater than 2½ pounds (nominal 1 pound LP-Gas capacity) shall not be left unattended in such buildings.

(v) Containers are permitted to be used in buildings or structures under construction or undergoing major renovation when such buildings or structures are not occupied by the public, as follows:

(*a*) The maximum water capacity of individual containers shall be 245 pounds (nominal 100 pounds LP-Gas capacity).

(*b*) For temporary heating such as curing concrete, drying plaster and similar applications, heaters (other than integral heater-container units) shall be located at least 6 feet from any LP-Gas container. This shall not prohibit the use of heaters specifically designed for attachment to the container or to a supporting standard, provided they are designed and installed so as to prevent direct or radiant heat application from the heater onto the container. Blower and radiant type heaters shall not be directed toward any LP-Gas container within 20 feet.

(*c*) If two or more heater-container units, of either the integral or nonintegral type, are located in an unpartitioned area on the same floor, the container or containers of each unit shall be separated from the container or containers of any other unit by at least 20 feet.

(*d*) When heaters are connected to containers for use in an unpartitioned area on the same floor, the total water capacity of containers manifolded together for connection to a heater or heaters shall not be greater than 735 pounds (nominal 300 pounds LP-Gas

capacity). Such manifolds shall be separated by at least 20 feet.

(e) On floors on which heaters are not connected for use, containers are permitted to be manifolded together for connection to a heater or heaters on another floor, *Provided*:

(1) The total water capacity of containers connected to any one manifold is not greater than 2,450 pounds (nominal 1,000 pounds LP-Gas capacity) and;

(2) Where more than one manifold having a total water capacity greater than 735 pounds (nominal 300 pounds LP-Gas capacity) are located in the same unpartitioned area, they shall be separated by at least 50 feet.

(f) Storage of containers awaiting use shall be in accordance with paragraph (f) of this section.

(vi) Containers are permitted to be used in industrial occupancies for processing, research, or experimental purposes as follows:

(a) The maximum water capacity of individual containers shall be 245 pounds (nominal 100 pounds LP-Gas capacity).

(b) Containers connected to a manifold shall have a total water capacity not greater than 735 pounds (nominal 300 pounds LP-Gas capacity) and not more than one such manifold may be located in the same room unless separated at least 20 feet from a similar unit.

(c) The amount of LP-Gas in containers for research and experimental use shall be limited to the smallest practical quantity.

(vii) (a) Containers are permitted to be used in industrial occupancies with essentially noncombustible contents where portable equipment for space heating is essential and where a permanent heating installation is not practical, as follows:

(b) Containers and heaters shall comply with and be used in accordance with subdivision (v) of this subparagraph.

(viii) Containers are permitted to be used in buildings for temporary emergency heating purposes, if necessary to prevent damage to the buildings or contents, when the permanent heating system is temporarily out of service, as follows:

(a) Containers and heaters shall comply with and be used in accordance with subdivision (v) of this subparagraph.

(b) The temporary heating equipment shall not be left unattended.

(ix) Containers are permitted to be used temporarily in buildings for training purposes related in installation and use of LP-gas systems, as follows:

(a) The maximum water capacity of individual containers shall be 245 pounds (nominal 100 pounds LP-Gas capacity), but the maximum quantity of LP-Gas that may be placed in each container shall be 20 pounds.

(b) If more than one such container is located in the same room, the containers shall be separated by at least 20 feet.

(c) Containers shall be removed from the building when the training class has terminated.

(6) *Container valves and accessories.* (i) Valves in the assembly of multiple container systems shall be arranged so that replacement of containers can be made without shutting off the flow of gas in the system.

NOTE: This provision is not to be construed as requiring an automatic changeover device.

(ii) Regulators and low-pressure relief devices shall be rigidly attached to the cylinder valves, cylinders, supporting standards, the building walls or otherwise rigidly secured and shall be so installed or protected that the elements (sleet, snow, or ice) will not affect their operation.

(iii) Valves and connections to the containers shall be protected while in transit, in storage, and while being moved into final utilization, as follows:

(a) By setting into the recess of the container to prevent the possibility of their being struck if the container is dropped upon a flat surface, or

(b) By ventilated cap or collar, fastened to the container capable of withstanding a blow from any direction equivalent to that of a 30-pound weight dropped 4 feet. Construction must be such that a blow will not be transmitted to the valve or other connection.

(iv) When containers are not connected to the system, the outlet valves shall be kept tightly closed or plugged, even though containers are considered empty.

(v) Containers having a water capacity in excess of 50 pounds (approximately 21 pounds LP-Gas capacity), recharged at the installation, shall be provided with excess flow or backflow check valves to prevent the discharge of container contents in case of failure of the filling or equalizing connection.

(7) *Safety devices.* (i) Containers shall be provided with safety devices as required by DOT regulations.

(ii) A final stage regulator of an LP-Gas system (excluding any appliance regulator) shall be equipped on the low-pressure side with a relief valve which is set to start to discharge within the limits specified in Table H-30.

TABLE H-30

Regulator delivery pressure	Relief valve start-to-discharge pressure setting (percent of regulator delivery pressure)	
	Minimum	Maximum
1 p.s.i.g. or less	200	300
Above 1 p.s.i.g. but not over 3 p.s.i.g.	140	200
Above 3 p.s.i.g.	125	200

(iii) When a regulator or pressure relief valve is used inside a building for other than purposes specified in paragraph (b)(6)(i) (a)–(g) of this section, the relief valve and the space above the regulator and relief valve diaphragms shall be vented to the outside air with the discharge outlet located not less than 3 feet horizontally away from any building opening which is below such discharge. These provisions do not apply to individual appliance regulators when protection is otherwise provided nor to subparagraph (5) of this paragraph and paragraph (b)(10)(xiii) of this section. In buildings devoted exclusively to gas distribution purposes, the space above the diaphragm need not be vented to the outside.

(8) *Reinstallation of containers.* Containers shall not be reinstalled unless they are requalified in accordance with DOT regulations.

(9) *Permissible product.* A product shall not be placed in a container marked with a service pressure less than four-fifths of the maximum vapor pressure of product at 130° F.

(d) *Systems utilizing containers other than DOT containers.*

(1) *Application.* This paragraph applies specifically to systems utilizing storage containers other than those constructed in accordance with DOT specifications. Paragraph (b) of this section applies to this paragraph unless otherwise noted in paragraph (b) of this section.

(2) *Design pressure and classification of storage containers.* Storage containers shall be designed and classified in accordance with Table H-31.

TABLE H-31

Container type	For gases with vapor press. Not to exceed lb. per sq. in. gage at 100° F. (37.8° C.)	Minimum design pressure of container, lb. per sq. in. gage	
		1949 and earlier editions of ASME Code (Par. U-68, U-69)	1949 edition of ASME Code (Par. U-200, U-201); 1950, 1952, 1956, 1959, 1962, 1965, and 1968 (Division 1) editions of ASME Code; All editions of API-ASME Code[2]
[1] 80	[1] 80	[1] 80	[1] 100
100	100	100	125
125	125	125	156
150	150	150	187
175	175	175	219
[2] 200	215	200	250

[1] New storage containers of the 80 type have not been authorized since Dec. 31, 1947.

[2] Container type may be increased by increments of 25. The minimum design pressure of containers shall be 100% of the container type designation when constructed under 1949 or earlier editions of the ASME Code (Par. U-68 and U-69). The minimum design pressure of containers shall be 125% of the container type designation when constructed under: (1) the 1949 ASME Code (Par. U-200 and U-201), (2) 1950, 1952, 1956, 1959, 1962, 1965, and 1968 (Division 1) editions of the ASME Code, and (3) all editions of the API-ASME Code.

[3] Construction of containers under the API-ASME Code is not authorized after July 1, 1961.

(3) *Container valves and accessories, filler pipes, and discharge pipes.* (i) The filling pipe inlet terminal shall not be located inside a building. For containers with a water capacity of 125 gallons or more, such termials shall be located not less than 10 feet from any building (see paragraph (b)(6)(ii) of this section), and preferably not less than 5 feet from any driveway, and shall be located in a protective housing built for the purpose.

(ii) The filling connection shall be fitted with one of the following:

(a) Combination back-pressure check valve and excess flow valve.

(b) One double or two single back-pressure check valves.

(c) A positive shutoff valve, in conjunction with either:

(1) An internal back pressure valve, or
(2) An internal excess flow valve.

(iii) All openings in a container shall be equipped with approved automatic excess flow valves except in the following: filling connections as provided in subdivision (ii) of this subparagraph; safety relief connections, liquid-level gaging devices as provided in paragraphs (b)(7)(iv), (19)(v), and (19)(viii) of this section; pressure gage connections as provided in paragraph (b)(7)(v) of this section, as provided in subdivisions (iv), (vi), and (vii) of this subparagraph.

(iv) An excess flow valve is not required in the withdrawal service line providing the following are complied with:

(a) Such systems' total water capacity does not exceed 2,000 U.S. gallons.

(b) The discharge from the service outlet is controlled by a suitable manually operated shutoff valve and is:

(1) Threaded directly into the service outlet of the container; or

(2) Is an integral part of a substantial fitting threaded into or on the service outlet of the container; or

(3) Threaded directly into a substantial fitting threaded into or on the service outlet of the container.

(c) The shutoff valve is equipped with an attached handwheel or the equivalent.

(d) The controlling orifice between the contents of the container and the outlet of the shutoff valve does not exceed five-sixteenths inch in diameter for vapor withdrawal systems and one-eighth inch in diameter for liquid withdrawal systems.

(e) An approved pressure-reducing regulator is directly attached to the outlet of the shutoff valve and is rigidly supported, or that an approved pressure-reducing regulator is attached to the outlet of the shutoff valve by means of a suitable flexible connection, provided the regulator is adequately supported and properly protected on or at the tank.

(v) All inlet and outlet connections except safety relief valves, liquid level gaging devices and pressure gages on containers of 2,000 gallons water capacity, or more, and on any container used to supply fuel directly to an internal combustion engine, shall be labeled to designate whether they communicate with vapor or liquid space. Labels may be on valves.

(vi) In lieu of an excess flow valve openings may be fitted with a quick-closing internal valve which, except during operating periods shall remain closed. The internal mechanism for such valves may be provided with a secondary control which shall be equipped with a fusible plug (not over 220° F. melting point) which will cause the internal valve to close automatically in case of fire.

(vii) Not more than two plugged openings shall be permitted on a container of 2,000 gallons or less water capacity.

(viii) Containers of 125 gallons water capacity or more manufactured after July 1, 1961, shall be provided with an approved device for liquid evacuation, the size of which shall be three-fourths inch national pipe thread minimum. A plugged opening will not satisfy this requirement.

(4) *Safety devices.* (i) All safety devices shall comply with the following:

(a) All container safety relief devices shall be located on the containers and shall have direct communication with the vapor of space of the container.

(b) In industrial and gas manufacturing plants, discharge pipe from safety relief valves on pipe lines within a building shall discharge vertically upward and shall be piped to a point outside a building.

(c) Safety relief device discharge terminals shall be so located as to provide protection against physical damage and such discharge pipes shall be fitted with loose raincaps. Return bends and restrictive pipefittings shall not be permitted.

(d) If desired, discharge lines from two or more safety relief devices located on the same unit, or similar lines from two or more different units, may be run into a common discharge header, provided that the cross-sectional area of such header be at least equal to the sum of the cross-sectional area of the individual discharge lines, and that the setting of safety relief valves are the same.

(e) Each storage container of over 2,000 gallons water capacity shall be provided with a suitable pressure gage.

(f) A final stage regulator of an LP-Gas system (excluding any appliance regulator) shall be equipped on the low-pressure side with a relief valve which is set to start to discharge within the limits specified in Table H–30.

(g) When a regulator or pressure relief valve is installed inside a building, the relief valve and the space above the regulator and relief valve diaphragms shall be vented to the outside air with the discharge outlet located not less than 3 feet horizontally away from any opening into the building which is below such discharge. (These provisions do not apply to individual appliance regulators when protection is otherwise provided. In buildings devoted exclusively to gas distribution purposes, the space above the diaphragm need not be vented to the outside.)

(ii) Safety devices for aboveground containers shall be provided as follows:

(a) Containers of 1,200 gallons water capacity or less which may contain liquid fuel when installed above ground shall have the rate of discharge required by paragraph (b)(10)(ii) of this section provided by a spring-loaded relief valve or valves. In addition to the required spring-loaded relief valve(s), suitable fuse plug(s) may be used provided the total discharge area of the fuse plug(s) for each container does not exceed 0.25 square inch.

(b) The fusible metal of the fuse plugs shall have a yield temperature of 208° F. minimum and 220° F. maximum. Relief valves and fuse plugs shall have direct communication with the vapor space of the container.

(c) On a container having a water capacity greater than 125 gallons, but not over 2,000 gallons, the discharge from the safety relief valves shall be vented away from the container vertically upwards and unobstructed to the open air in such a manner as to prevent any impingement of escaping gas upon the container; loose-fitting rain caps shall be used. Suitable provision shall be made for draining condensate which may accumulate in the relief valve or its discharge pipe.

(d) On containers of 125 gallons water capacity or less, the discharge from safety relief devices shall be located not less than 5 feet horizontally away from any opening into the building below the level of such discharge.

(e) On a container having a water capacity greater than 2,000 gallons, the discharge from the safety relief valves shall be vented away from the container vertically upwards to a point at least 7 feet above the container, and unobstructed to the open air in such a manner as to prevent any impingement of escaping gas upon the container; loose-fitting rain caps shall be used. Suitable provision shall be made so that any liquid or condensate that may accumulate inside of the safety relief valve or its discharge pipe will not render the valve inoperative. If a drain is used, a means shall be provided to protect the container, adjacent containers, piping, or equipment against impingement of flame resulting from ignition of product escaping from the drain.

(iii) On all containers which are installed underground and which contain no liquid fuel until buried and covered, the rate of discharge of the spring-loaded relief valve installed thereon may be reduced to a minimum of 30 percent of the rate of discharge specified in paragraph (b)(10)(ii) of this section. Containers so protected shall not be uncovered after installation until the liquid fuel has been removed therefrom. Containers which may contain liquid fuel before being installed under ground and before being completely covered with earth are to be considered aboveground containers when determining the rate of discharge requirement of the relief valves.

(iv) On underground containers of more than 2,000 gallons water capacity, the discharge from safety relief devices shall be piped vertically and directly upward to a point at least 7 feet above the ground.

Where there is a probability of the manhole or housing becoming flooded, the discharge from regulator vent lines shall be above the highest probable water level. All manholes or housings shall be provided with ventilated louvers or their equivalent, the area of such openings equaling or exceeding the combined discharge areas of the safety relief valves and other vent lines which discharge their content into the manhole housing.

(v) Safety devices for vaporizers shall be provided as follows:

(a) Vaporizers of less than 1 quart total capacity, heated by the ground or the surrounding air, need not be equipped with safety relief valves provided that

adequate tests certified by any of the authorities referred to in paragraph (b)(2) of this section, demonstrate that the assembly is safe without safety relief valves.

(b) No vaporizer shall be equipped with fusible plugs.

(c) In industrial and gas manufacturing plants, safety relief valves on vaporizers within a building shall be piped to a point outside the building and be discharged upward.

(5) *Reinstallation of containers.* Containers may be reinstalled if they do not show any evidence of harmful external corrosion or other damage. Where containers are reinstalled underground, the corrosion resistant coating shall be put in good condition (see subparagraph (7)(vi) of this paragraph). Where containers are reinstalled above ground, the safety devices and gaging devices shall comply with subparagraph (4) of this paragraph and paragraph (b)(19) of this section respectively for aboveground containers.

(6) *Capacity of containers.* A storage container shall not exceed 90,000 gallons water capacity.

(7) *Installation of storage containers.* (i) Containers installed above ground, except as provided in subdivision (vii) of this subparagraph, shall be provided with substantial masonry or noncombustile structural supports on firm masonry foundation.

(ii) Aboveground containers shall be supported as follows:

(a) Horizontal containers shall be mounted on saddles in such a manner as to permit expansion and contraction. Structural metal supports may be employed when they are protected against fire in an approved manner. Suitable means of preventing corrosion shall be provided on that portion of the container in contact with the foundations or saddles.

(b) Containers of 2,000 gallons water capacity or less may be installed with nonfireproofed ferrous metal supports if mounted on concrete pads or footings, and if the distance from the outside bottom of the container shell to the concrete pad, footing, or the ground does not exceed 24 inches.

(iii) Any container may be installed with nonfireproofed ferrous metal supports if mounted on concrete pads or footings, and if the distance from the outside bottom of the container to the ground does not exceed 5 feet, provided the container is in an isolated location.

(iv) Containers may be partially buried providing the following requirements are met:

(a) The portion of the container below the surface and for a vertical distance not less than 3 inches above the surface of the ground is protected to resist corrosion, and the container is protected against settling and corrosion as required for fully buried containers.

(b) Spacing requirements shall be as specified for underground tanks in paragraph (b)(6)(ii) of this section.

(c) Relief valve capacity shall be as required for aboveground containers.

(d) Container is located so as not to be subject to vehicular damage, or is adequately protected against such damage.

(e) Filling densities shall be as required for above-ground containers.

(v) Containers buried underground shall be placed so that the top of the container is not less than 6 inches below grade. Where an underground container might be subject to abrasive action or physical damage due to vehicular traffic or other causes, then it shall be:

(a) Placed not less than 2 feet below grade, or

(b) Otherwise protected against such physical damage.

It will not be necessary to cover the portion of the container to which manhole and other connections are affixed; however, where necessary, protection shall be provided against vehicular damage. When necessary to prevent floating, containers shall be securely anchored or weighted.

(vi) (a) Containers shall be given a protective coating before being placed under ground. This coating shall be equivalent to hot-dip galvanizing or to two coatings of red lead followed by a heavy coating of coal tar or asphalt. In lowering the container into place, care shall be exercised to prevent damage to the coating. Any damage to the coating shall be repaired before backfilling.

(b) Containers shall be set on a firm foundation (firm earth may be used) and surrounded with earth or sand firmly tamped in place. Backfill should be free of rocks or other abrasive materials.

(vii) Containers with foundations attached (portable or semiportable containers with suitable steel "runners" or "skids" and popularly known in the industry as "skid tanks") shall be designed, installed, and used in accordance with these rules subject to the following provisions:

(a) If they are to be used at a given general location for a temporary period not to exceed 6 months they need not have fire-resisting foundations or saddles but shall have adequate ferrous metal supports.

(b) They shall not be located with the outside bottom of the container shell more than 5 feet above the surface of the ground unless fire-resisting supports are provided.

(c) The bottom of the skids shall not be less than 2 inches or more than 12 inches below the outside bottom of the container shell.

(d) Flanges, nozzles, valves, fittings, and the like, having communication with the interior of the container, shall be protected against physical damage.

(e) When not permanently located on fire-resisting foundations, piping connections shall be sufficiently flexible to minimize the possibility of breakage or leakage of connections if the container settles, moves, or is otherwise displaced.

(f) Skids, or lugs for attachment of skids, shall be secured to the container in accordance with the code or rules under which the container is designed and built (with a minimum factor of safety of four) to withstand loading in any direction equal to four times the weight of the container and attachments when filled to the maximum permissible loaded weight.

(viii) Field welding where necessary shall be made only on saddle plates or brackets which were applied by the manufacturer of the tank.

(ix) For aboveground containers, secure anchorage or adequate pier height shall be provided against possible container flotation wherever sufficiently high floodwater might occur.

(x) When permanently installed containers are interconnected, provision shall be made to compensate for expansion, contraction, vibration, and settling of containers, and interconnecting piping. Where flexible connections are used, they shall be of an approved type and shall be designed for a bursting pressure of not less than five times the vapor pressure of the product at 100° F. The use of nonmetallic hose is prohibited for permanently interconnecting such containers.

(xi) Container assemblies listed for interchangeable installation above ground or under ground shall conform to the requirements for aboveground installations with respect to safety relief capacity and filling density. For installation above ground all other requirements for aboveground installations shall apply. For installation under ground all other requirements for underground installations shall apply.

(8) *Protection of container accessories.* (i) Valves, regulating, gaging, and other container accessory equipment shall be protected against tampering and physical damage. Such accessories shall also be so protected during the transit of containers intended for installation underground.

(ii) On underground or combination aboveground-underground containers, the service valve handwheel, the terminal for connecting the hose, and the opening through which there can be a flow from safety relief valves shall be at least 4 inches above the container and this opening shall be located in the dome or housing. Underground systems shall be so installed that all the above openings, including the regulator vent, are located above the normal maximum water table.

(iii) All connections to underground containers shall be located within a substantial dome, housing, or manhole and with access thereto protected by a substantial cover.

(9) *Drips for condensed gas.* Where vaporized gas on the low-pressure side of the system may condense to a liquid at normal operating temperatures and pressures, suitable means shall be provided for revaporization of the condensate.

(10) *Damage from vehicles.* When damage to LP-Gas systems from vehicular traffic is a possibility, precautions against such damage shall be taken.

(11) *Pits and drains.* Every effort should be made to avoid the use of pits,

except pits fitted with automatic flammable vapor detecting devices. No drains or blowoff shall be directed into or in proximity to sewer systems used for other purposes.

(12) *General provisions applicable to systems in industrial plants (of 2,000 gallons water capacity and more) and to bulk filling plants.* (i) When standard watch service is provided, it shall be extended to the LP-Gas installation and personnel properly trained.

(ii) If loading and unloading are normally done during other than daylight hours, adequate lights shall be provided to illuminate storage containers, control valves, and other equipment.

(iii) Suitable roadways or means of access for extinguishing equipment such as wheeled extinguishers or fire department apparatus shall be provided.

(iv) To minimize trespassing or tampering, the area which includes container appurtenances, pumping equipment, loading and unloading facilities, and cylinder-filling facilities shall be enclosed with at least a 6-foot-high industrial type fence unless otherwise adequately protected. There shall be at least two means of emergency access.

(13) *Container-charging plants.* (i) The container-charging room shall be located not less than:

(*a*) Ten feet from bulk storage containers.

(*b*) Twenty-five feet from line of adjoining property which may be built upon.

(ii) Tank truck filling station outlets shall be located not less than:

(*a*) Twenty-five feet from line of adjoining property which may be built upon.

(*b*) Ten feet from pumps and compressors if housed in one or more separate buildings.

(iii) The pumps or compressors may be located in the container-charging room or building, in a separate building, or outside of buildings. When housed in a separate building, such building (a small noncombustible weather cover is not to be construed as a building) shall be located not less than:

(*a*) Ten feet from bulk storage tanks.

(*b*) Twenty-five feet from line of adjoining property which may be built upon.

(*c*) Twenty-five feet from sources of ignition.

(iv) When a part of the container-charging building is to be used for a boiler room or where open flames or similar sources of ignition exist or are employed, the space to be so occupied shall be separated from container charging room by a partition wall or walls of fire-resistant construction continuous from floor to roof or ceiling. Such separation walls shall be without openings and shall be joined to the floor, other walls, and ceiling or roof in a manner to effect a permanent gas-tight joint.

(v) Electrical equipment and installations shall conform with paragraphs (b) (17) and (18) of this section.

(14) *Fire protection.* (i) Each bulk plant shall be provided with at least one approved portable fire extinguisher having a minimum rating of 12–B, C.

(ii) In industrial installations involving containers of 150,000 gallons aggregate water capacity or more, provision shall be made for an adequate supply of water at the container site for fire protection in the container area, unless other adequate means for fire control are provided. Water hydrants shall be readily accessible and so spaced as to provide water protection for all containers. Sufficient lengths of firehose shall be provided at each hydrant location on a hose cart, or other means provided to facilitate easy movement of the hose in the container area. It is desirable to equip the outlet of each hose line with a combination fog nozzle. A shelter shall be provided to protect the hose and its conveyor from the weather.

(15) *Painting.* Aboveground containers shall be kept properly painted.

(16) *Lighting.* Electrical equipment and installations shall conform to paragraphs (b) (17) and (18) of this section.

(17) *Vaporizers for internal combustion engines.* The provisions of paragraph (e) (8) of this section shall apply.

(18) *Gas regulating and mixing equipment for internal combustion engines.* The provisions of paragraph (e) (9) of this section shall apply.

(e) *Liquefied petroleum gas as a motor fuel*—(1) *Application.* (i) This paragraph applies to internal combustion engines, fuel containers, and pertinent equipment for the use of liquefied petroleum gases as a motor fuel on easily movable, readily portable units including self-propelled vehicles.

(ii) Fuel containers and pertinent equipment for internal combustion engines using liquefied petroleum gas where installation is of the stationary type are covered by paragraph (d) of this section. This paragraph does not apply to containers for transportation of liquefied petroleum gases nor to marine fuel use. All requirements of paragraph (b) of this section apply to this paragraph, unless otherwise noted in paragraph (b) of this section.

(2) *General.* (i) Fuel may be used from the cargo tank of a truck while in transit, but not from cargo tanks on trailers or semitrailers. The use of fuel from the cargo tanks to operate stationary engines is permitted providing wheels are securely blocked.

(ii) Passenger-carrying vehicles shall not be fueled while passengers are on board.

(iii) Industrial trucks (including lift trucks) equipped with permanently mounted fuel containers shall be charged outdoors. Charging equipment shall comply with the provisions of paragraph (h) of this section.

(iv) LP-Gas fueled industrial trucks shall comply with the Standard for Type Designations, Areas of Use, Maintenance and Operation of Powered Industrial Trucks, NFPA 505–1969.

(v) Engines on vehicles shall be shut down while fueling if the fueling operation involves venting to the atmosphere.

(3) *Design pressure and classification of fuel containers.* (i) Except as covered in subdivisions (ii) and (iii) of this subparagraph, containers shall be in accordance with Table H–32.

(ii) Fuel containers for use in industrial trucks (including lift trucks) shall be either DOT containers authorized for LP-Gas service having a minimum service pressure of 240 p.s.i.g. or minimum Container Type 250. Under 1950 and later ASME codes, this means a 312.5-p.s.i.g. design pressure container.

TABLE H–32

Container type	For gases with vapor press. not to exceed lb. per sq. in. gage at 100° F. (37.8 C.)	Minimum design pressure of container lb. per sq. in. gage: 1949 and earlier editions of ASME Code (Par. U–68, U–69)	Minimum design pressure of container lb. per sq. in. gage: 1949 edition of ASME Code (Par. U–200, U–201); 1950, 1952, 1956, 1959, 1962, 1965, and 1968 (Division I) editions of ASME Code; All editions of API–ASME Code[3]
[1] 200	215	200	250

[1] Container type may be increased by increments of 25. The minimum design pressure of containers shall be 100% of the container type designation when constructed under 1949 or earlier editions of the ASME Code (Par. U–68 and U–69). The minimum design pressure of containers shall be 125% of the container type designation when constructed under: (1) the 1949 ASME Code (Par. U–200 and U–201), (2) 1950, 1952, 1956, 1959, 1962, 1965, and 1968 (Division I) editions of the ASME Code, and (3) all editions of the API–ASME Code.

[2] Construction of containers under the API–ASME Code is not authorized after July 1, 1961.

(iii) Containers manufactured and maintained under DOT specifications and regulations may be used as fuel containers. When so used they shall conform to all requirements of this paragraph.

(iv) All container inlets and outlets except safety relief valves and gaging devices shall be labeled to designate whether they communicate with vapor or liquid space. Labels may be on valves.

(4) *Installation of fuel containers.* (i) Containers shall be located in a place and in a manner to minimized the possibility of damage to the container. Containers located in the rear of trucks and buses, when protected by substantial bumpers, will be considered in conformance with this requirement. Fuel containers on passenger-carrying vehicles shall be installed as far from the engine as is practicable, and the passenger space and any space containing radio equipment shall be sealed from the container space to prevent direct seepage of gas to these spaces. The container compartment shall be vented to the outside. In case the fuel container is mounted near the engine or the exhaust system, the container shall be shielded against direct heat radiation.

(ii) Containers shall be installed with as much clearance as practicable but never less than the minimum road clearance of the vehicle under maximum spring deflection. This minimum clearance shall be to the bottom of the container or to the lowest fitting on the container or housing, whichever is lower.

(iii) Permanent and removable fuel containers shall be securely mounted to prevent jarring loose, slipping, or rotating, and the fastenings shall be designed

and constructed to withstand static loading in any direction equal to twice the weight of the tank and attachments when filled with fuel using a safety factor of not less than four based on the ultimate strength of the material to be used. Field welding, when necessary, shall be made only on saddle plates, lugs or brackets, originally attached to the container by the tank manufacturer.

(iv) Fuel containers on buses shall be permanently installed.

(v) Containers from which vapor only is to be withdrawn shall be installed and equipped with suitable connections to minimize the accidental withdrawal of liquid.

(5) *Valves and accessories.* (i) Container valves and accessories shall have a rated working pressure of at least 250 p.s.i.g., and shall be of a type suitable for liquefied petroleum gas service.

(ii) The filling connection shall be fitted with an approved double back-pressure check valve, or a positive shutoff in conjunction with an internal back-pressure check valve. On a removable container the filler valve may be a hand operated shutoff valve with an internal excess flow valve. Main shutoff valves on the container on liquid and vapor must be readily accessible.

(iii) With the exceptions of subdivision (iv) (*c*) of this subparagraph, filling connections equipped with approved automatic back-pressure check valves, and safety relief valves, all connections to containers having openings for the flow of gas in excess of a No. 54 drill size shall be equipped with approved automatic excess flow valves to prevent discharge of content in case connections are broken.

(iv) Liquid-level gaging devices:

(*a*) Variable liquid-level gages which require the venting of fuel to the atmosphere shall not be used on fuel containers of industrial trucks (including lift trucks).

(*b*) On portable containers that may be filled in the vertical and/or horizontal position, the fixed liquid-level gage must indicate maximum permitted filling level for both vertical and horizontal filling with the container oriented to place the safety relief valve in communication with the vapor space.

(*c*) In the case of containers used solely in farm tractor service, and charged at a point at least 50 feet from any important building, the fixed liquid-level gaging device may be so constructed that the outward flow of container content exceeds that passed by a No. 54 drill size opening, but in no case shall the flow exceed that passed by a No. 31 drill-size opening. An excess flow valve is not required. Fittings equipped with such restricted drill size opening and container on which they are used shall be marked to indicate the size of the opening.

(*d*) All valves and connections on containers shall be adequately protected to prevent damage due to accidental contact with stationary objects or from loose objects thrown up from the road, and all valves shall be safeguarded against damage due to collision, overturning or other accident. For farm tractors where parts of the vehicle provide such protection to valves and fittings, the foregoing requirements shall be considered fulfilled. However, on removable type containers the protection for the fittings shall be permanently attached to the container.

(*e*) Exchange of removable fuel containers preferably should be done outdoors but may be done indoors. When removable fuel containers are used, means shall be provided in the fuel system to minimize the escape of fuel when the containers are exchanged. This may be accomplished by either of the following methods:

(*1*) Using an approved automatic quick-closing coupling (a type closing in both directions when uncoupled) in the fuel line, or

(*2*) Closing the valve at the fuel container and allowing the engine to run until the fuel in the line is consumed.

(6) *Piping—including pipe, tubing, and fittings.* (i) Pipe from fuel container to first-stage regulator shall be not less than schedule 80 wrought iron or steel (black or galvanized), brass or copper; or seamless copper, brass, or steel tubing. Steel tubing shall have a minimum wall thickness of 0.049 inch. Steel pipe or tubing shall be adequately protected against exterior corrosion. Copper tubing shall be types K or L or equivalent having a minimum wall thickness of 0.032 inch. Approved flexible connections may be used between container and regulator or between regulator and gas-air mixer within the limits of approval. The use of aluminum pipe or tubing is prohibited. In the case of removable containers an approved flexible connection shall be used between the container and the fuel line.

(ii) All piping shall be installed, braced, and supported so as to reduce to a minimum the possibility of vibration strains or wear.

(7) *Safety devices.* (i) Spring-loaded internal type safety relief valves shall be used on all motor fuel containers.

(ii) The discharge outlet from safety relief valves shall be located on the outside of enclosed spaces and as far as practicable from possible sources of ignition, and vented upward within 45 degrees of the vertical in such a manner as to prevent impingement of escaping gas upon containers, or parts of vehicles, or on vehicles in adjacent lines of traffic. A rain cap or other protector shall be used to keep water and dirt from collecting in the valve.

(iii) When a discharge line from the container safety relief valve is used, the line shall be metallic, other than aluminum, and shall be sized, located, and maintained so as not to restrict the required flow of gas from the safety relief valve. Such discharge line shall be able to withstand the pressure resulting from the discharge of vapor when the safety relief valve is in the full open position. When flexibility is necessary, flexible metal hose or tubing shall be used.

(iv) Portable containers equipped for volumetric filling may be filled in either the vertical or horizontal position only when oriented to place the safety relief valve in communication with the vapor space.

(v) Paragraph (b)(10)(xii) of this section for hydrostatic relief valves shall apply.

(8) *Vaporizers.* (i) Vaporizers and any part thereof and other devices that may be subjected to container pressure shall have a design pressure of at least 250 p.s.i.g.

(ii) Each vaporizer shall have a valve or suitable plug which will permit substantially complete draining of the vaporizer. It shall be located at or near the lowest portion of the section occupied by the water or other heating medium.

(iii) Vaporizers shall be securely fastened so as to minimize the possibility of becoming loosened.

(iv) Each vaporizer shall be permanently marked at a visible point as follows:

(*a*) With the design pressure of the fuel-containing portion in p.s.i.g.

(*b*) With the water capacity of the fuel-containing portion of the vaporizer in pounds.

(v) Devices to supply heat directly to a fuel container shall be equipped with an automatic device to cut off the supply of heat before the pressure inside the fuel container reaches 80 percent of the start to discharge pressure setting of the safety relief device on the fuel container.

(vi) Engine exhaust gases may be used as a direct source of heat supply for the vaporization of fuel if the materials of construction of those parts of the vaporizer in contact with exhaust gases are resistant to the corrosive action of exhaust gases and the vaporizer system is designed to prevent excessive pressures.

(vii) Vaporizers shall not be equipped with fusible plugs.

(9) *Gas regulating and mixing equipment.* (i) Approved automatic pressure reducing equipment shall be installed in a secure manner between the fuel supply container and gas-air mixer for the purpose of reducing the pressure of the fuel delivered to the gas-air mixer.

(ii) An approved automatic shutoff valve shall be provided in the fuel system at some point ahead of the inlet of the gas-air mixer, designed to prevent flow of fuel to the mixer when the ignition is off and the engine is not running. In the case of industrial trucks and engines operating in buildings other than those used exclusively to house engines, the automatic shutoff valve shall be designed to operate if the engine should stop. Atmospheric type regulators (zero governors) shall be considered adequate as an automatic shutoff valve only in cases of outdoor operation such as farm tractors, construction equipment, irrigation pump engines, and other outdoor stationary engine installations.

(iii) The source of the air for combustion shall be completely isolated from the passenger compartment, ventilating system, or air-conditioning system.

(10) *Capacity of containers.* No single fuel container used on passenger carry-

ing vehicles shall exceed 200 gallons water capacity. No single fuel container on other vehicles normally operating on the highway shall exceed 300 gallons water capacity except as provided in subparagraph (2)(i) of this paragraph.

(11) *Stationary engines in buildings.* Stationary engines and gas turbines installed in buildings, including portable engines used instead of or to supplement stationary engines, shall comply with the standard for the installation and use of Stationary Combustion Engines and Gas Turbines, NFPA 37–1970, and the appropriate provisions of paragraphs (b), (c), and (d) of this section.

(12) *Portable engines in buildings.* (i) Portable engines may be used in buildings only for emergency use, except as provided by subparagraph (11) of this paragraph.

(ii) Exhaust gases shall be discharged to outside the building or to an area where they will not constitute a hazard.

(iii) Provision shall be made to supply sufficient air for combustion and cooling.

(iv) An approved automatic shutoff valve shall be provided in the fuel system ahead of the engine, designed to prevent flow of fuel to the engine when the ignition is off or if the engine should stop.

(v) The capacity of LP-Gas containers used with such engines shall comply with the applicable occupancy provision of paragraph (c)(5) of this section.

(13) *Industrial trucks inside buildings.* (i) LP-Gas-fueled industrial trucks are permitted to be used in buildings and structures.

(ii) No more than two LP-Gas containers shall be used on an industrial truck for motor fuel purposes.

(iii) LP-Gas-fueled industrial trucks are permitted to be used in buildings frequented by the public, when occupied by the public. The total water capacity of containers on each industrial truck shall not exceed 105 pounds (nominal 45 pounds LP-Gas).

(iv) Trucks shall not be left unattended in areas occupied by the public.

(v) Industrial trucks shall not be parked and left unattended in areas of possible excessive heat or sources of ignition.

(14) *Garaging LP-Gas-fueled vehicles.* (i) LP-Gas-fueled vehicles may be stored or serviced inside garages provided there are no leaks in the fuel system and the fuel tanks are not filled beyond the maximum filling capacity specified in paragraph (b)(12)(i) of this section.

(ii) LP–Gas-fueled vehicles being repaired in garages shall have the container shutoff valve closed except when fuel is required for engine operation.

(iii) Such vehicles shall not be parked near sources of heat, open flames, or similar sources of ignition or near open pits unless such pits are adequately ventilated.

(f) *Storage of containers awaiting use or resale.*—(1) *Application.* This paragraph shall apply to the storage of portable containers not in excess of 1,000 pounds water capacity, filled or partially filled, at user location but not connected for use, or in storage for resale by dealers or resellers. This paragraph shall not apply to containers stored at charging plants or at plants devoted primarily to the storage and distribution of LP–Gas or other petroleum products.

(2) *General.* (i) Containers in storage shall be located so as to minimize exposure to excessive temperature rise, physical damage, or tampering by unauthorized persons.

(ii) Containers when stored inside shall not be located near exits, stairways, or in areas normally used or intended for the safe exit of people.

(iii) Container valves shall be protected while in storage as follows:

(*a*) By setting into recess of container to prevent the possibility of their being struck if the container is dropped upon a flat surface, or

(*b*) By ventilated cap or collar, fastened to container capable of withstanding blow from any direction equivalent to that of a 30-pound weight dropped 4 feet. Construction must be such that a blow will not be transmitted to a valve or other connection.

(iv) The outlet valves of containers in storage shall be closed.

(v) Empty containers which have been in LP-Gas service should preferably be stored in the open. When stored inside, they shall be considered as full containers for the purpose of determining the maximum quantity of LP-Gas permitted by this paragraph.

(3) *Storage within buildings frequented by the public.* (i) DOT specification containers having a maximum individual water capacity of 2½ pounds, used with completely self-contained hand torches and similar applications, are permitted to be stored or displayed in a building frequented by the public. The display of such containers shall be limited to a total of 24 units of each brand and size. The total quantity on display and in storage shall not exceed 200 pounds LP-Gas.

(ii) Storage as provided in subparagraph (5) of this paragraph shall not be permitted within or attached to such a building.

(4) *Storage within buildings not frequented by the public (such as industrial buildings).* (i) The quantity of LP-Gas stored shall not exceed 300 pounds (approximately 2,550 cubic feet in vapor form) except as provided in subparagraph (5) of this paragraph.

(ii) Containers carried as a part of service equipment on highway mobile vehicles are not to be considered in the total storage capacity in subdivision (i) of this subparagraph provided such vehicles are stored in private garages, and are limited to one container per vehicle with an LP-Gas capacity of not more than 100 pounds. All container valves shall be closed.

(5) *Storage within special buildings or rooms.* (i) The qauntity of LP-Gas stored in special buildings or rooms shall not exceed 10,000 pounds.

(ii) The walls, floors, and ceilings of container storage rooms that are within or adjacent to other parts of the building shall be constructed of material having at least a 2-hour fire resistance rating.

(iii) A portion of the exterior walls or roof having an area not less than 10 percent of that of the combined area of the enclosing walls and roof, shall be of single-strength glass or other similar explosion relieving construction.

(iv) Each opening from such storage rooms to other parts of the building shall be protected by a 1½ hour (B) fire door listed by Underwriters Laboratories Inc.

(v) Such rooms shall have no open flames for heating or lighting.

(vi) Such rooms shall be adequately ventilated both top and bottom to the outside only. The openings from such vents shall be at least 5 feet away from any other opening into any building.

(vii) The floors of such rooms shall not be below ground level. Any space below the floor shall be of solid fill or properly ventilated to the open air.

(viii) Such storage rooms shall not be located adjoining the line of property occupied by schools, churches, hospitals, athletic fields or other points of public gathering.

(ix) Fixed electrical equipment shall be installed in accordance with paragraph (b)(18) of this section.

(6) *Storage outside of buildings.* (i) Storage outside of buildings, for containers awaiting use or resale, shall be located in accordance with Table H–33 with respect to the nearest important building or group of buildings; the line of adjoining property which may be built upon; busy thoroughfares; the line of adjoining property occupied by schools, churches, hospitals, athletic fields, or other points of public gathering.

TABLE H–33

Quantity of LP-Gas Stored:	*Distance*
500 pounds or less	0
501 to 2,500 pounds	0*
2,501 to 6,000 pounds	10 feet
6,001 to 10,000 pounds	20 feet
Over 10,000 pounds	25 feet

*Container or containers shall be at least 10 feet from any building on adjoining property, any sidewalk, or any of the exposures described in subparagraph (6)(i) (*c*) or (*d*) of this paragraph.

(ii) Containers shall be in a suitable enclosure or otherwise protected against tampering.

(7) *Fire protection.* Storage locations other than supply depots separated and located apart from dealer, reseller, or user establishments shall be provided with at least one approved portable fire extinguisher having a minimum rating of 8–B, C.

(g) *LP-Gas system installations on commercial vehicles*—(1) *Application.* This paragraph applies to LP-Gas-system installations on vehicles (whether self-propelled or of the trailer or semi-trailer type) used for commercial, construction, or public service purposes such

as mobile libraries and clinics; to all exchangeable container systems with container capacities greater than 105 pounds water capacity (approximately 45 pounds LP-Gas capacity) and to systems using containers permanently mounted on vehicles. It does not apply to LP-Gas motor fuel systems covered by paragraph (e) of this section. Paragraph (b) of this section applies to this paragraph unless otherwise noted. When such a vehicle is permanently parked, and LP-Gas is supplied from a system not mounted on and secured to the unit, paragraphs (c) and (d) of this section shall apply.

(2) *Construction and marking of containers.* Containers shall be constructed in accordance with paragraph (b)(3) of this section, and marked in accordance with the applicable requirements of paragraph (b)(5) of this section, and shall also meet the following:

(i) Containers designed for use as portable cylinders shall be constructed in accordance with DOT specifications, and in accordance with paragraph (b)(3)(iv) of this section; where applicable.

(ii) All other containers whether designed for permanent mounting, or for portable or semiportable use (such as skid tanks), shall be constructed as provided for by paragraphs (b)(3)(i) and (iv) of this section. Mounting, securing, and protection of such containers shall be as in subdivisions (iii) and (iv) of this subparagraph.

(iii) Permanently installed containers shall meet the requirements of subdivision (*a*) of this subdivision with regard to container valves and accessories, and subdivision (*b*) of this subdivision as to mounting.

(*a*) (*1*) Nonrecessed container fittings and appurtenances shall be protected against damage by either:

(*i*) Their location.

(*ii*) The vehicle frame or bumper, or

(*iii*) A protective housing. The protective housing, if used, shall comply with the requirements under which the tanks are fabricated with respect to design and construction and shall be designed to withstand static loadings in any direction equal to twice the weight of the tank and attachments when filled with the lading using a safety factor of not less than four, based on the ultimate strength of the material to be used. The housing shall be provided with a weather cover if necessary to insure proper operation of valves and safety devices.

(2) Manually operated shutoff valves, except as covered in paragraph (e)(2)(i) of this section, or self-closing internal valves shall be closed except during transfer operations.

(*b*) (*1*) Tank motor vehicles with frames not made integral with the tank, as by welding, shall be provided with turnbuckles or similar positive devices for drawing the tank down tight on the frame. In addition, suitable stops or anchors shall be attached to the frame and/or the tank to prevent relative motion between them due to starting, stopping, and turning. The stops and anchors shall be so installed as to be readily accessible for inspection and maintenance.

(2) Any tank motor vehicle designed and constructed so that the cargo tank constitutes in whole or in part the stress member used in lieu of a frame shall be supported by external cradles subtending at least 120 degrees of the shell circumference. The design calculations shall include beam stress, shear stress, torsion stress, bending moment, and acceleration stress for the cargo tank as a whole using a factor of safety of four, based on the ultimate tensile strength of the material. Maximum concentrated stresses which might be created at pads and cradles due to shear, bending, and torsion shall also be calculated in accordance with Appendix G of the American Society of Mechanical Engineers, Unfired Pressure Vessel Code, 1968. Fully loaded vehicles shall be assumed to be operating under highway conditions equal to two "g" loading. The effects of fatigue shall be taken into consideration. Cargo tanks mounted on frames may be supported by longitudinal members attached to pads providing the above-stated factors are taken into account.

(*3*) Where any tank support is attached to any part of a tank head, the stresses imposed upon the head shall be provided for as required in (*2*) of this subdivision.

(*4*) Tank supports, stops, anchors, and bumpers shall not be welded directly to the tank but shall be attached by means of pads of the same material as the tank. The pad thickness shall be not less than one-fourth inch, or the thickness of the shell material if less, and no greater than the shell material. Each pad shall extend at least four times its thickness, in each direction, beyond the weld attaching the support, bumper, stop, or anchor. Each pad shall be preformed to an inside radius no greater than the outside radius of the tank at the place of attachment. Each pad corner shall be rounded to a radius at least one-fourth the width of the pad, and no greater than one-half the width of the pad. Weepholes and telltale holes, if used, shall be drilled or punched before the pads are attached to the tank. Each pad shall be attached to the tank by continuous fillet welding using filler material having properties conforming to the recommendations of the maker of the shell and head material.

(iv) Portable or semiportable containers (skid tanks as covered by paragraph (d)(7)(vii) of this section) shall meet the applicable requirements of (*a*) to (*f*) of this subdivision inclusive with regard to container valves and accessories and paragraph (e)(4)(iii) of this section as to mounting. Containers designed for permanent installation as part of systems under paragraph (d) of this section shall not be used.

(*a*) Nonrecessed container fittings and appurtenances shall be protected against damage by either—

(*1*) Their location.

(2) The vehicle frame or bumper, or

(*3*) A protective housing. The protective housing, if used, shall comply with the requirements under which the tanks are fabricated with respect to design and construction and shall be designed to withstand static loadings in any direction equal to twice the weight of the tank and attachments when filled with the lading using a safety factor of not less than four, based on the ultimate strength of the material to be used. The housing shall be provided with a weather cover if necessary to insure proper operation of valves and safety devices.

(*b*) Filling connections shall be provided with approved automatic back pressure check valves, excess flow check valves or quick closing internal valves to prevent excessive escape of gas in case the filling connection is broken, except that where the filling and discharge connect on a common opening in the container shell, and that opening is fitted with a quick-closing internal valve as specified in subdivision (*c*) of this subdivision, the automatic valve shall not be required. In addition every inlet and outlet connection shall be equipped with a manually or automatically operated shutoff valve. Liquid discharge openings, except those for engine fuel lines, on tanks built after September 1, 1965, shall be fitted with a remotely controlled internal shutoff valve. Such valve shall conform to the following requirements:

(*1*) The seat of the valve shall be inside the tank, or in the opening nozzle or flange, or in a companion flange bolted to the nozzle or flange.

(*2*) All parts of the valve inside the tank, nozzle, or companion flange shall be made of material not subject to corrosion or other deterioration in the presence of the lading.

(*3*) The arrangement of parts shall be such that damage to parts exterior to the tank will not prevent effective seating of the valve.

(*4*) The valve may be operated normally by mechanical means, by hydraulic means, or by air, or gas pressure.

(*5*) The valve shall be provided with remote means of automatic closure, both mechanical and thermal, in at least two places for tanks over 3,500 gallons water capacity. These remote control stations shall be located at each end of the tank and diagonally opposite each other. The thermal control mechanism shall have a fusible element with a melting point not over 220° F. or less than 208° F. At least one remote control station shall be provided for tanks of 3,500 gallons water capacity or less, and such actuating means may be mechanical.

(*c*) All other connections to containers, except those used for gaging devices, thermometer wells, safety relief devices, and plugged openings, shall be provided with suitable automatic excess flow valves, or in lieu thereof may be fitted with quick-closing internal valves.

The control mechanism for the internal valve shall be provided with a secondary control, remote from the fill or discharge connections (for use in the event of accidents or fire during delivery operations), and such control mechanism shall have a fusible element with a melting point not over 220° F. or less than 208° F.

(*d*) Manually operated shutoff valves, except as covered in paragraphs (e)(2)(i) of this section, or self-closing internal valves shall be closed except during transfer operations.

(*e*) Excess flow valves shall close automatically at the rated flow of vapor or liquid as specified by the valve manufacturers. The flow rating of the piping beyond the excess flow valve shall be greater than that of the excess flow valve and such rating shall include valves, fittings, and hose, except, when branching or necessary restrictions are incorporated in such a piping system so that flow ratings are less than that of the excess flow valve and the tank, then additional excess flow valves shall be installed in the piping where such flow rate is reduced.

(*f*) Container inlets and outlets, except those used for safety relief valves, liquid-level gaging devices, and pressure gages, shall be labeled to designate whether they communicate with vapor or liquid space when the container is filled to maximum permitted filling density. Labels may be on valves.

(3) *Capacity of a system.* No single fuel container used on passenger carrying vehicles shall exceed 200 gallons water capacity.

(4) *Description of a system.* A system consists of an assembly of equipment installed on a commercial vehicle.

(5) *Location of containers and systems.* (i) Containers shall not be installed, transported, or stored (even temporarily) inside any vehicle covered by this paragraph except as provided by the applicable regulations of DOT.

(ii) Containers, control valves, and regulating equipment comprising a complete system shall be suitably protected against damage and weather. Systems may be installed in a recess vaportight to the inside of the vehicle and accessible from and vented to the outside.

(iii) Systems installed outside of mobile units shall be so located that discharge from safety relief devices shall be not less than 3 feet horizontally away from any opening into the unit below the level of such discharge. When the system is located in a recess vaportight to the inside (see subparagraph (5) of this paragraph), vent openings in such recess shall be not less than 3 feet horizontally away from any opening into the mobile unit below the level of these vents.

(iv) There shall be no fuel connection between tractor and trailer or other vehicle units.

(v) The container or container carrier shall be secured in place by fastenings designed and constructed with a minimum safety factor of four to withstand loading in any direction equal to twice the weight of the container when filled to normal capacity with LP-Gas.

(6) *Container valves and accessories.* Container valves and accessories shall be provided, protected and mounted as follows:

(i) Systems utilizing DOT cylinders in accordance with paragraph (c)(6) of this section.

(ii) All other systems in accordance with paragraph (d)(3)(ii) through (vii) of this section.

(iii) Portable, semiportable and permanently mounted containers shall be mounted and protected as provided under subparagraph (2)(ii) through (iv) of this paragraph.

(7) *Safety-relief devices.* (i) DOT containers shall be provided with safety-relief devices as required by the regulations of DOT.

(ii) ASME containers and API-ASME containers shall be provided with safety-relief devices as required by paragraph (b)(10) of this section.

(iii) (*a*) A final stage regulator of an LP-Gas system (excluding any appliance regulator) shall be equipped on the low-pressure side with a relief valve which is set to start to discharge within the limits specified in Table H–30.

(*b*) The relief valve and space above the regulator and relief valve diaphragms shall be vented to the outside air and terminate at a position to minimize the possibility of vapors accumulating at sources of ignition.

(iv) Whenever equipment such as a cargo heater or cooler on commercial vehicles is a type designed to be in operation while in transit, suitable means to stop the flow such as an excess flow valve or other device, shall be installed. This device will be actuated to stop the flow in the event of the break in the fuel supply line. All excess flow valves shall comply with paragraph (b)(7)(iii) of this section.

(8) *System design and line pressure.* Systems may be of either vapor withdrawal or liquid withdrawal type and shall comply with the applicable requirements for the type of usage involved.

(9) *System enclosure and mounting.* (i) Housing or enclosures shall be designed to provide proper ventilation.

(ii) Hoods, domes, or removable portions of cabinets shall be provided with means to keep them firmly in place during transit.

(iii) Provision shall be incorporated in the assembly to hold the containers firmly in position and prevent their movement during transit in accordance with paragraph (e)(4)(iii) of this section.

(iv) Containers shall be mounted on a substantial support or base secured firmly to the vehicle chassis. Neither the container nor its support shall extend below the frame.

(10) *Piping—including pipe, tubing, and fittings.* (i) Regulators shall be connected directly to the container valve outlet or mounted securely by means of a support bracket and connected to the container valve or valves with a listed high pressure flexible connector.

(ii) Provision shall be made between the regulator outlet and the gas service lines by either a flexible connector or a tubing loop to provide for expansion, contraction, jarring, and vibration.

(iii) Pipe, tubing, and fittings shall conform to paragraph (b)(8) of this section except that the use of aluminum alloy piping is prohibited. Steel tubing shall have a minimum wall thickness of 0.049 inch. Steel piping or tubing shall be adequately protected against exterior corrosion.

(iv) Approved gas tubing fittings shall be employed for making tubing connections.

(v) The fuel line shall be firmly fastened in a protected location and where under the vehicle and outside and below any insulation or false bottom, fastenings shall be such as to prevent abrasion or damage to the gasline due to vibration. Where the fuel line passes through structural members or floors, a rubber grommet or equivalent shall be installed to prevent chafing.

(vi) The fuel line shall be installed to enter the vehicle through the floor directly beneath or adjacent to the appliance which it serves. When a branch line is required the tee connection shall be in the main fuel line and located under the floor and outside the vehicle.

(vii) All parts of the system assembly shall be so designed and secured as to preclude such parts working loose during transit.

(11) *Appliances.* (i) LP-Gas appliances shall be approved for use on commercial vehicles.

(ii) In the case of vehicles not intended for human occupancy and where the gas-fired heating appliance is used to protect the cargo, such heater may be of the unvented type but provision shall be made to dispose of the products of combustion to the outside.

(iii) In the case of vehicles intended for human occupancy, all gas-fired heating appliances, including water heaters, shall be designed or installed to provide for complete separation of the combustion system from the atmosphere of the living space. Such appliances shall be installed with the combustion air inlet assembly furnished as a component of the appliance and, also, with either—

(*a*) The flue gas outlet assembly furnished as a component of the appliance, or

(*b*) A listed roof jack if the appliance is listed for such use.

The combustion air inlet assembly, flue gas outlet assembly, and roof jack shall extend to the outside atmosphere.

(iv) Provision shall be made to insure an adequate supply of outside air for combustion.

(v) All gas-fired heating appliances and water heaters shall be equipped with an approved automatic device designed to shut off the flow of gas to the main burner and to the pilot in the event the pilot flame is extinguished.

(vi) Gas-fired appliances installed in the cargo space shall be located so they are readily accessible.

(vii) Appliances shall be constructed or protected to reduce to a minimum possible damage or impaired operation resulting from cargo shifting or handling.

(viii) Appliances inside the vehicle shall be located so that a fire at an appliance will not block egress of persons therefrom.

(12) *General precautions.* (i) DOT containers shall be marked, maintained, and requalified for use in accordance with the regulations of DOT.

(ii) Requalification of containers for continued service is the responsibility of the owner; containers shall be stamped with the date of requalification. When DOT cylinders are requalified by retesting, such retest shall be made in accordance with DOT regulations.

(iii) Containers shall not be charged with fuel unless they bear the proper markings of the code or specifications under which they were constructed, and in addition, with their water capacity. In the case of cylinders or portable containers filled by weight, the container shall be marked with its tareweight.

(iv) DOT containers which have been involved in a fire shall not be recharged until they have been requalified for service according to DOT regulations.

(v) American Petroleum Institute–American Society of Mechanical Engineers (API–ASME) containers or ASME containers which have been involved in a fire shall not be recharged until they have been retested in accordance with the requirements for their original hydrostatic test and found to be suitable for continued service.

(vi) Containers shall not be charged without the consent of the owner.

(vii) A permanent caution plate shall be provided on the appliance or adjacent to the container outside of any enclosure. It shall include the word "Caution" and following instructions, or instructions embodying substantially similar language.

(*a*) Be sure all appliance valves are closed before opening container valve.

(*b*) Connections at appliances, regulators, and containers must be checked periodically for leaks with soapy water or its equivalent.

(*c*) Never use a match or flame to check for leaks.

(*d*) Container valves must be closed when the equipment is not in use.

(13) *Charging of containers.* Containers shall be charged as provided in paragraph (b) (12) of this section.

(14) *Fire extinguisher.* Mobile cookunits shall be provided with at least one approved portable fire extinguisher having a minimum rating of 8–B,C.

(h) *Liquefied petroleum gas service stations.*—(1) *Application.* This paragraph applies to storage containers, and dispensing devices, and pertinent equipment in service stations where LP-Gas is stored and is dispensed into fuel tanks of motor vehicles. See paragraph (e) of this section for requirements covering use of LP-Gas as a motor fuel. All requirements of paragraph (b) of this section apply to this paragraph unless otherwise noted.

(2) *Design pressure and classification of storage containers.* Storage containers shall be designed and classified in accordance with Table H–34.

TABLE H–34

Container type	For gases with vapor pressure not to exceed lb. per sq. in. gage of 100° F. (37.8 C.)	Minimum design pressure of container, lb. per sq. in. gage: 1949 and earlier editions of ASME Code (Par. U–68, U–69)	Minimum design pressure of container, lb. per sq. in. gage: 1949 edition of ASME Code (Par. U–200 U–201); 1950, 1952 1956, 1959, 1962, 1965 and 1968 (Division 1) editions of ASME Code, all editions of API–ASME Code [2]
[1] 200	215	200	250

[1] Container type may be increased by increments of 25. The minimum design pressure of containers shall be 100 percent of the container type designation when constructed under 1949 or earlier editions of the ASME Code (Par. U–68 and U–69). The minimum design pressure of containers shall be 125 percent of the container type designation when constructed under: (1) the 1949 ASME Code (Paragraphs U–200 and U–201), (2) 1950, 1952, 1956, 1959, 1962, 1965, and 1968 (Division 1) editions of the ASME Code, and (3) all editions of the API–ASME Code.

[2] Construction of containers under the API–ASME Code is not authorized after July 1, 1961.

(3) *Container valves and accessories.* (i) A filling connection on the container shall be fitted with one of the following:

(*a*) A combination back-pressure check and excess flow valve.

(*b*) One double or two single back-pressure valves.

(*c*) A positive shutoff valve, in conjunction with either.

(*1*) An internal back-pressure valve, or

(*2*) An internal excess flow valve.

In lieu of an excess flow valve, filling connections may be fitted with a quick-closing internal valve, which shall remain closed except during operating periods. The mechanism for such valves may be provided with a secondary control which will cause it to close automatically in case of fire. When a fusible plug is used its melting point shall not exceed 220° F.

(ii) A filling pipe inlet terminal not on the container shall be fitted with a positive shutoff valve in conjunction with either;

(*a*) A back pressure check valve, or

(*b*) An excess flow check valve.

(iii) All openings in the container except those listed below shall be equipped with approved excess flow check valves:

(*a*) Filling connections as provided in subdivision (i) of this subparagraph.

(*b*) Safety relief connections as provided in paragraph (b) (7) (ii) of this section.

(*c*) Liquid-level gaging devices as provided in paragraphs (b) (7) (iv) and (19) (iv) of this section.

(*d*) Pressure gage connections as provided in paragraph (b) (7) (v) of this section.

(iv) All container inlets and outlets except those listed below shall be labeled to designate whether they connect with vapor or liquid (labels may be on valves):

(*a*) Safety relief valves.

(*b*) Liquid-level gaging devices.

(*c*) Pressure gages.

(v) Each storage container shall be provided with a suitable pressure gage.

(4) *Safety-relief valves.* (i) All safety-relief devices shall be installed as follows:

(*a*) On the container and directly connected with the vapor space.

(*b*) Safety-relief valves and discharge piping shall be protected against physical damage. The outlet shall be provided with loose-fitting rain caps. There shall be no return bends or restrictions in the discharge piping.

(*c*) The discharge from two or more safety relief valves having the same pressure settings may be run into a common discharge header. The cross-sectional area of such header shall be at least equal to the sum of the individual discharges.

(*d*) Discharge from any safety relief device shall not terminate in any building nor beneath any building.

(ii) Aboveground containers shall be provided with safety relief valves as follows:

(*a*) The rate of discharge, which may be provided by one or more valves, shall be not less than that specified in paragraph (b) (10) (ii) of this section.

(*b*) The discharge from safety relief valves shall be vented to the open air unobstructed and vertically upwards in such a manner as to prevent any impingement of escaping gas upon the container; loose-fitting rain caps shall be used. On a container having a water capacity greater than 2,000 gallons, the discharge from the safety relief valves shall be vented away from the container vertically upwards to a point at least 7 feet above the container. Suitable provisions shall be made so that any liquid or condensate that may accumulate inside of the relief valve or its discharge pipe will not render the valve inoperative. If a drain is used, a means shall be provided to protect the container, adjacent containers, piping, or equipment against impingement of flame resulting from ignition of the product escaping from the drain.

(iii) Underground containers shall be provided with safety relief valves as follows:

(*a*) The discharge from safety-relief valves shall be piped vertically upward to a point at least 10 feet above the ground. The discharge lines or pipes shall be adequately supported and protected against physical damage.

(*b*) Where there is a probability of the manhole or housing becoming flooded, the discharge from regulator vent lines should be above the highest probable water level.

(*c*) If no liquid is put into a container until after it is buried and covered, the rate of discharge of the relief valves may be reduced to not less than 30 percent of the rate shown in paragraph (b) (10) (ii) of this section. If liquid fuel is present during installation of containers, the rate of discharge shall be the same as for aboveground containers. Such containers shall not be uncovered until emptied of liquid fuel.

(5) *Capacity of liquid containers.* Individual liquid storage containers shall not exceed 30,000 gallons water capacity.

(6) *Installation of storage containers.* (i) (*a*) Each storage container used exclusively in service station operation shall comply with the following table which specifies minimum distances to a building, groups of buildings, and adjoining property lines which may be built upon.

Water capacity per container (gallons)	Minimum distances: Above ground and underground (feet)	Minimum distances: Between aboveground containers (feet)
Up to 2,000	25	3
Over 2,000	50	5

NOTE: The above distances may be reduced to not less than 10 feet for service station buildings of other than wood frame construction.

(*b*) Readily ignitible material including weeds and long dry grass, shall be removed within 10 feet of containers.

(*c*) The minimum separation between LP-Gas containers and flammable liquid tanks shall be 20 feet and the minimum separation between a container and the centerline of the dike shall be 10 feet.

(*d*) LP-Gas containers located near flammable liquid containers shall be protected against the flow or accumulation of flammable liquids by diking, diversion curbs, or grading.

(*e*) LP-Gas containers shall not be located within diked areas for flammable liquid containers.

(*f*) Field welding is permitted only on saddle plates or brackets which were applied by the container manufacturer.

(*g*) When permanently installed containers are interconnected, provision shall be made to compensate for expansion, contraction, vibration, and settling of containers and interconnecting piping. Where flexible connections are used, they shall be of an approved type and shall be designed for a bursting pressure of not less than five times the vapor pressure of the product at 100° F. The use of nonmetallic hose is prohibited for interconnecting such containers.

(*h*) Where high water table or flood conditions may be encountered protection against container flotation shall be provided.

(ii) Aboveground containers shall be installed in accordance with this subdivision.

(*a*) Containers may be installed horizontally or vertically.

(*b*) Containers shall be protected by crash rails or guards to prevent physical damage unless they are so protected by virtue of their location. Vehicles shall not be serviced within 10 feet of containers.

(*c*) Container foundations shall be of substantial masonry or other noncombustible material. Containers shall be mounted on saddles which shall permit expansion and contraction, and shall provide against the excessive concentration of stresses. Corrosion protection shall be provided for tank-mounting areas. Structural metal container supports shall be protected against fire. This protection is not required on prefabricated storage and pump assemblies, mounted on a common base, with container bottom not more than 24 inches above ground and whose water capacity is 2,000 gallons or less if the piping connected to the storage and pump assembly is sufficiently flexible to minimize the possibility of breakage or leakage in the event of failure of the container supports.

(iii) Underground containers shall be installed in accordance with this subdivision.

(*a*) Containers shall be given a protective coating before being placed under ground. This coating shall be equivalent to hot-dip galvanizing or to two coatings of red lead followed by a heavy coating of coal tar or asphalt. In lowering the container into place, care shall be exercised to minimize abrasion or other damage to the coating. Damage to the coating shall be repaired before backfilling.

(*b*) Containers shall be set on a firm foundation (firm earth may be used) and surrounded with earth or sand firmly tamped in place. Backfill should be free of rocks or other abrasive materials.

(*c*) A minimum of 2 feet of earth cover shall be provided. Where ground conditions make compliance with this requirement impractical, equivalent protection against physical damage shall be provided. The portion of the container to which manhole and other connections are attached need not be covered. If the location is subjected to vehicular traffic, containers shall be protected by a concrete slab or other cover adequate to prevent the weight of a loaded vehicle imposing concentrated direct loads on the container shell.

(7) *Protection of container fittings.* Valves, regulators, gages, and other container fittings shall be protected against tampering and physical damage.

(8) *Transport truck unloading point.* (i) During unloading, the transport truck shall not be parked on public thoroughfares and shall be at least 5 feet from storage containers, and shall be positioned so that shutoff valves are readily accessible.

(ii) The filling pipe inlet terminal shall not be located within a building nor within 10 feet of any building or driveway. It shall be protected against physical damage.

(9) *Piping, valves, and fittings.* (i) Piping may be underground, above ground, or a combination of both. It shall be well supported and protected against physical damage and corrosion.

(ii) Piping laid beneath driveways shall be installed to prevent physical damage by vehicles.

(iii) Piping shall be wrought iron or steel (black or galvanized), brass or copper pipe; or seamless copper, brass, or steel tubing and shall be suitable for a minimum pressure of 250 p.s.i.g. Pipe joints may be screwed, flanged, brazed, or welded. The use of aluminum alloy piping or tubing is prohibited.

(iv) All shutoff valves (liquid or gas) shall be suitable for liquefied petroleum gas service and designed for not less than the maximum pressure to which they may be subjected. Valves which may be subjected to container pressure shall have a rated working pressure of at least 250 p.s.i.g.

(v) All materials used for valve seats, packing, gaskets, diaphragms, etc., shall be resistant to the action of LP-Gas.

(vi) Fittings shall be steel, malleable iron, or brass having a minimum working pressure of 250 p.s.i.g. Cast iron pipe fittings, such as ells, tees, and unions shall not be used.

(vii) All piping shall be tested after assembly and proved free from leaks at not less than normal operating pressures.

(viii) Provision shall be made for expansion, contraction, jarring, and vibration, and for settling. This may be accomplished by flexible connections.

(10) *Pumps and accessories.* All pumps and accessory equipment shall be suitable for LP-Gas service, and designed for not less than the maximum pressure to which they may be subjected. Accessories shall have a minimum rated working pressure of 250 p.s.i.g. Positive displacement pumps shall be equipped with suitable pressure actuated bypass valves permitting flow from pump discharge to storage container or pump suction.

(11) *Dispensing devices.* (i) Meters, vapor separators, valves, and fittings in the dispenser shall be suitable for LP-Gas service and shall be designed for a minimum working pressure of 250 p.s.i.g.

(ii) Provisions shall be made for venting LP-Gas contained in a dispensing device to a safe location.

(iii) Pumps used to transfer LP-Gas shall be equipped to allow control of the flow and to prevent leakage or accidental discharge. Means shall be provided outside the dispensing device to readily shut off the power in the event of fire or accident.

(iv) A manual shutoff valve and an excess flow check valve shall be installed downstream of the pump and ahead of the dispenser inlet.

(*a*) Dispensing hose shall be resistant to the action of LP-Gas in the liquid phase and designed for a minimum bursting pressure of 1,250 p.s.i.g.

(*b*) An excess flow check valve or automatic shutoff valve shall be installed at the terminus of the liquid line at the point of attachment of the dispensing hose.

(v) (*a*) LP-Gas dispensing devices shall be located not less than 10 feet from aboveground storage containers greater than 2,000 gallons water capacity. The dispensing devices shall not be less than 20 feet from any building (not including canopies), basement, cellar, pit, or line of adjoining property which may be built upon and not less than 10 feet from sidewalks, streets, or thoroughfares. No drains or blowoff lines shall be directed into or in proximity to the sewer systems used for other purposes.

(*b*) LP-Gas dispensing devices shall be installed on a concrete foundation or as part of a complete storage and dispensing assembly mounted on a common base,

and shall be adequately protected from physical damage.

(c) LP-Gas dispensing devices shall not be installed within a building except that they may be located under a weather shelter or canopy provided this area is not enclosed on more than two sides. If the enclosing sides are adjacent to each other, the area shall be properly ventilated.

(vi) The dispensing of LP-Gas into the fuel container of a vehicle shall be performed by a competent attendant who shall remain at the LP-Gas dispenser during the entire transfer operation.

(12) *Additional rules.* There shall be no smoking on the driveway of service stations in the dispensing areas or transport truck unloading areas. Conspicuous signs prohibiting smoking shall be posted within sight of the customer being served. Letters on such signs shall be not less than 4 inches high. The motors of all vehicles being fueled shall be shut off during the fueling operations.

(13) *Electrical.* Electrical equipment and installations shall conform to paragraphs (b) (17) and (18) of this section.

(14) *Fire protection.* Each service station shall be provided with at least one approved portable fire extinguisher having at least an 8-B, C, rating.

§ 1910.111 Storage and handling of anhydrous ammonia.

(a) *General*—(1) *Scope.* (i) This standard is intended to apply to the design, construction, location, installation, and operation of anhydrous ammonia systems including refrigerated ammonia storage systems.

(ii) This standard does not apply to:

(*a*) Ammonia manufacturing plants.

(*b*) Refrigeration plants where ammonia is used solely as a refrigerant.

(2) *Definitions.* As used in this section.

(i) "Appurtenances"—All devices such as pumps, safety relief devices, liquid-level gaging devices, valves, and pressure gages.

(ii) "Cylinder"—A container of 1,000 pounds of water capacity or less constructed in accordance with Department of Transportation specifications.

(iii) "Code"—The Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels of the American Society of Mechanical Engineers (ASME)—1968.

(iv) "Container"—Includes all vessels, tanks, cylinders, or spheres used for transportation, storage, or application of anhydrous ammonia.

(v) "DOT"—U.S. Department of Transportation.

(vi) "Design pressure" is identical to the term "Maximum Allowable Working Pressure" used in the Code.

(vii) "Farm vehicle" (implement of husbandry)—A vehicle for use on a farm on which is mounted a container of not over 1,200 gallons water capacity.

(viii) "Filling density"—the percent ratio of the weight of the gas in a container to the weight of water at 60° F. that the container will hold.

(ix) "Gas"—Anhydrous ammonia in either the gaseous or liquefied state.

(x) "Gas mask"—Gas masks approved by the Bureau of Mines, U.S. Department of the Interior (see 30 CFR Part 11).

(xi) "Capacity"—Total volume of the container in standard U.S. gallons.

(xii) DOT specifications—Regulations of the Department of Transportation published in 49 CFR Chapter I.

(xiii) "DOT regulations"—See § 1910.-911(a)(1)(xii).

(xiv) "DOT requirements"—See § 1910.911(a)(1)(xii).

(b) *Basic rules.* This paragraph applies to all paragraphs of this section unless otherwise noted.

(1) *Approval of equipment and systems.* The appurtenances of each system shall be listed by at least one of the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

(2) *Requirements for construction, original test and requalification of nonrefrigerated containers.* (i) Containers used with systems covered in paragraphs (c), (f), (g), and (h) of this section shall be constructed and tested in accordance with the Code except that construction under Table UW12 at a basic joint efficiency of under 80 percent is not authorized.

(ii) Containers built according to the Code do not have to comply with Paragraphs UG125 to UG128 inclusive, and Paragraphs UG132 and UG133 of the Code.

(iii) Containers exceeding 36 inches in diameter or 250 gallons water capacity shall be constructed to comply with one or more of the following:

(*a*) Containers shall be stress relieved after fabrication in accordance with the Code, or

(*b*) Cold-formed heads, when used, shall be stress relieved, or

(*c*) Hot-formed heads shall be used.

(iv) Welding to the shell, head, or any other part of the container subject to internal pressure shall be done in compliance with the Code. Other welding is permitted only on saddle plates, lugs, or brackets attached to the container by the container manufacturer.

(v) Containers used with systems covered in paragraph (e) of this section shall be constructed and tested in accordance with the DOT specifications.

(vi) The provisions of subdivision (i) of this subparagraph shall not be construed as prohibiting the continued use or reinstallation of containers constructed and maintained in accordance with the 1949, 1950, 1952, 1956, 1959, and 1962 editions of the Code or any revisions thereof in effect at the time of fabrication.

(3) *Marking nonrefrigerated containers.* (i) System nameplates, when required, shall be permanently attached to the system so as to be readily accessible for inspection and shall include markings as prescribed in subdivision (ii) of this subparagraph.

(ii) Each container or system covered in paragraphs (c), (f), (g), and (h) of this section shall be marked as specified in the following:

(*a*) With a notation "Anhydrous Ammonia."

(*b*) With a marking identifying compliance with the rules of the Code under which the container is constructed.

Under ground: Container and system nameplate.
Above ground: Container.

(*c*) With a notation whether the system is designed for underground or aboveground installation or both.

(*d*) With the name and address of the supplier of the system or the trade name of the system and with the date of fabrication.

Under ground and above ground: System nameplate.

(*e*) With the water capacity of the container in pounds at 60° F. or gallons, U.S. Standard.

Under ground: Container and system nameplate.
Above ground: Container.

(*f*) With the design pressure in pounds per square inch.

Under ground: Container and system nameplate.
Above ground: Container.

(*g*) With the wall thickness of the shell and heads.

Under ground: Container and system nameplate.
Above ground: Container.

(*h*) With marking indicating the maximum level to which the container may be filled with liquid anhydrous ammonia at temperatures between 20° F. and 130° F. except on containers provided with fixed level indicators, such as fixed length dip tubes, or containers that are filled with weight. Markings shall be in increments of not more than 20° F.

Above ground and under ground: System nameplate or on liquid-level gaging device.

(*i*) With the total outside surface area of the container in square feet.

Under ground: System nameplate.
Above ground: No requirement.

(*j*) Marking specified on the container shall be on the container itself or on a nameplate permanently attached to it.

(4) *Marking refrigerated containers.* Each refrigerated container shall be marked with nameplate on the outer covering in an accessible place as specified in the following:

(i) With the notation, "Anhydrous Ammonia."

(ii) With the name and address of the builder and the date of fabrication.

(iii) With the water capacity of the container in gallons, U.S. Standard.

(iv) With the design pressure.

(v) With the minimum temperature in degrees Fahrenheit for which the container was designed.

(vi) The maximum allowable water level to which the container may be filled for test purposes.

(vii) With the density of the product in pounds per cubic foot for which the container was designed.

(viii) With the maximum level to which the container may be filled with liquid anhydrous ammonia.

(5) *Location of containers.* (i) Consideration shall be given to the physiological effects of ammonia as well as to adjacent fire hazards in selecting the location for a storage container. Containers shall be located outside of buildings or in buildings or sections thereof especially provided for this purpose.

(ii) Permanent storage containers shall be located at least 50 feet from a dug well or other sources of potable water supply, unless the container is a part of a water-treatment installation.

(iii) Permanent storage containers shall be located outside densely populated areas.

(iv) Container locations shall comply with table H–35:

TABLE H–35

Nominal capacity of container (gallons)	Minimum distances (feet) from container to: Line of adjoining property which may be built upon highways and mainline of railroad	Place of public assembly	Institution occupancy
Over 500 to 2,000	25	150	250
Over 2,000 to 30,000	50	300	500
Over 30,000 to 100,000	50	450	750
Over 100,000	50	600	1,000

(v) Storage areas shall be kept free of readily ignitible materials such as waste, weeds, and long dry grass.

(6) *Container appurtenances.* (i) All appurtenances shall be designed for not less than the maximum working pressure of that portion of the system on which they are installed. All appurtenances shall be fabricated from materials proved suitable for anhydrous ammonia service.

(ii) All connections to containers except safety relief devices, gaging devices, or those fitted with No. 54 drill-size orifice shall have shutoff valves located as close to the container as practicable.

(iii) Excess flow valves where required by these standards shall close automatically at the rated flows of vapor or liquid as specified by the manufacturer. The connections and line including valves and fittings being protected by an excess flow valve shall have a greater capacity than the rated flow of the excess flow valve so that the valve will close in case of failure of the line or fittings.

(iv) Liquid-level gaging devices that require bleeding of the product to the atmosphere and which are so constructed that outward flow will not exceed that passed by a No. 54 drill-size opening need not be equipped with excess flow valves.

(v) Openings from the container or through fittings attached directly on the container to which pressure gage connections are made need not be equipped with excess flow valves if such openings are not larger than No. 54 drill size.

(vi) Excess flow and back pressure check valves where required by the standards in this section shall be located inside of the container or at a point outside as close as practicable to where the line enters the container. In the latter case installation shall be made in such manner that any undue strain beyond the excess flow or back pressure check valve will not cause breakage between the container and the valve.

(vii) Excess flow valves shall be designed with a bypass, not to exceed a No. 60 drill-size opening to allow equalization of pressures.

(viii) All excess flow valves shall be plainly and permanently marked with the name or trademark of the manufacturer, the catalog number, and the rated capacity.

(7) *Piping, tubing, and fittings.* (i) All piping, tubing, and fittings shall be made of material suitable for anhydrous ammonia service.

(ii) All piping, tubing, and fittings shall be designed for a pressure not less than the maximum pressure to which they may be subjected in service.

(iii) All refrigerated piping shall conform to the Refrigeration Piping Code, American National Standards Institute, B31.5–1966 with addenda B31.1a–1968 as it applies to ammonia.

(iv) Piping used on non-refrigerated systems shall be at least American Society for Testing and Materials (ASTM) A–53–69 Grade B Electric Resistance Welded and Electric Flash Welded Pipe or equal. Such pipe shall be at least schedule 40 when joints are welded, or welded and flanged. Such pipe shall be at least schedule 80 when joints are threaded. Threaded connections shall not be back-welded. Brass, copper, or galvanized steel pipe shall not be used.

(v) Tubing made of brass, copper, or other material subject to attack by ammonia shall not be used.

(vi) Cast iron fittings shall not be used but this shall not prohibit the use of fittings made specifically for ammonia service of malleable, nodular, or high strength gray iron meeting American Society for Testing and Materials (ASTM) A47–68, ASTM 395–68, or ASTM A126–66 Class B or C.

(vii) Joint compounds shall be resistant to ammonia.

(8) *Hose specifications.* (i) Hose used in ammonia service shall conform to the joint Agricultural Ammonia Institute—Rubber Manufacturers Association Specifications for Anhydrous Ammonia Hose.

(ii) Hose subject to container pressure shall be designed for a minimum working pressure of 350 p.s.i.g. and a minimum burst pressure of 1,750 p.s.i.g. Hose assemblies, when made up, shall be capable of withstanding a test pressure of 500 p.s.i.g.

(iii) Hose and hose connections located on the low-pressure side of flow control or pressure-reducing valves shall be designed for a bursting pressure of not less than five times the pressure setting of the safety relief devices protecting that portion of the system but not less than 125 p.s.i.g. All connections shall be so designed and constructed that there will be no leakage when connected.

(iv) Where hose is to be used for transfering liquid from one container to another, "wet" hose is recommended. Such hose shall be equipped with approved shutoff valves at the discharge end. Provision shall be made to prevent excessive pressure in the hose.

(v) On all hose one-half inch outside diameter and larger, used for the transfer of anhydrous ammonia liquid or vapor, there shall be etched, cast, or impressed at 5-foot intervals the following information.

"Anhydrous Ammonia" xxx p.s.i.g. (maximum working pressure), manufacturer's name or trademark, year of manufacture.

In lieu of this requirement the same information may be contained on a nameplate permanently attached to the hose.

TABLE H–36

Minimum required rate of discharge in cubic feet per minute of air at 120 percent of the maximum permitted start to discharge pressure for safety relief valves.

Surface area (sq. ft.)	*Flow rate CFM air*
20	258
25	310
30	360
35	408
40	455
45	501
50	547
55	591
60	635
65	678
70	720
75	762
80	804
85	845
90	885
95	925
100	965
105	1,010
110	1,050
115	1,090
120	1,120
125	1,160
130	1,200
135	1,240
140	1,280
145	1,310
150	1,350
155	1,390
160	1,420
165	1,460
170	1,500
175	1,530
180	1,570
185	1,600
190	1,640
195	1,670
200	1,710
210	1,780
220	1,850
230	1,920
240	1,980
250	2,050
260	2,120
270	2,180
280	2,250
290	2,320
300	2,380
310	2,450
320	2,510
330	2,570
340	2,640
350	2,700
360	2,760
370	2,830
380	2,890
390	2,950

Surface area (sq. ft.)	Flow rate CFM air
400	3,010
450	3,320
500	3,620
550	3,910
600	4,200
650	4,480
700	4,760
750	5,040
800	5,300
850	5,590
900	5,850
950	6,120
1,000	6,380
1,050	6,640
1,100	6,900
1,150	7,160
1,200	7,410
1,250	7,660
1,300	7,910
1,350	8,160
1,400	8,410
1,450	8,650
1,500	8,900
1,550	9,140
1,600	9,380
1,650	9,620
1,700	9,860
1,750	10,090
1,800	10,330
1,850	10,560
1,900	10,800
1,950	11,030
2,000	11,260
2,050	11,490
2,100	11,720
2,150	11,950
2,200	12,180
2,250	12,400
2,300	12,630
2,350	12,850
2,400	13,080
2,450	13,300
2,500	13,520

"Surface Area=total outside surface area of container in square feet. When the surface area is not stamped on the nameplate or when the marking is not legible the area can be calculated by using one of the following formulas:

(1) Cylindrical container with hemispherical heads:

Area=overall length in feet times outside diameter in feet times 3.1416.

(2) Cylindrical container with other than hemispherical heads:

Area=(overall length in feet plus 0.3 outside diameter in feet) times outside diameter in feet times 3.1416.

(3) Spherical container:

Area=outside diameter in feet squared times 3.1416."

"Flow Rate—CFM Air=cubic feet per minute of air required at standard conditions, 60° F. and atmospheric pressure (14.7 p.s.i.a.)."

"The rate of discharge may be interpolated for intermediate values of surface area. For containers with total outside surface area greater than 2,500 square feet, the required flow rate can be calculated using the formula: Flow Rate CFM Air=22.11 $A^{0.82}$, where A=outside surface area of the container in square feet."

(9) *Safety relief devices.* (i) Every container used in systems covered by paragraphs (c), (f), (g), and (h) of this section shall be provided with one or more safety relief valves of the spring-loaded or equivalent type. The discharge from safety-relief valves shall be vented away from the container upward and unobstructed to the atmosphere. All relief-valve discharge openings shall have suitable rain caps that will allow free discharge of the vapor and prevent entrance of water. Provision shall be made for draining condensate which may accumulate. The rate of the discharge shall be in accordance with the provisions of Table H–36.

(ii) Container safety-relief valves shall be set to start-to-discharge as follows, with relation to the design pressure of the container:

Containers	Minimum (percent)	Maximum (percent)
ASME–U–68, U–69	110	125
ASME–U–200, U–201	95	100
ASME 1959, 1956, 1952, or 1962	95	100
API–ASME	95	100
U.S. Coast Guard	95	100

As required by DOT Regulations.

(iii) Safety relief devices used in systems covered by paragraphs (c), (f), (g), and (h) of this section shall be constructed to discharge at not less than the rates required in subdivision (i) of this subparagraph before the pressure is in excess of 120 percent (not including the 10 percent tolerance referred to in subdivision (ii) of this subparagraph) of the maximum permitted start-to-discharge pressure setting of the device.

(iv) Safety-relief valves shall be so arranged that the possibility of tampering will be minimized. If the pressure setting adjustment is external, the relief valves shall be provided with means for sealing the adjustment.

(v) Shutoff valves shall not be installed between the safety-relief valves and the container; except, that a shutoff valve may be used where the arrangement of this valve is such as always to afford full required capacity flow through the relief valves.

(vi) Safety-relief valves shall direct communication with the vapor space of the container.

(vii) Each container safety-relief valve used with systems covered by paragraphs (c), (f), (g), and (h) of this section shall be plainly and permanently marked with the symbol "NH_3" or "AA"; with the pressure in pounds-per-square-inch gage at which the valve is set to start-to-discharge; with the actual rate of discharge of the valve at its full open position in cubic feet per minute of air at 60° F. and atmospheric pressure; and with the manufacturer's name and catalog number. Example: "NH_3 250—4050 Air" indicates that the valve is suitable for use on an anhydrous ammonia container, is set to start-to-discharge at a pressure of 250 p.s.i.g., and that its rate of discharge at full open position (subdivisions (ii) and (iii) of this subparagraph) is 4,050 cubic feet per minute of air.

(viii) The flow capacity of the relief valve shall not be restricted by any connection to it on either the upstream or downstream side.

(ix) A hydrostatic relief valve shall be installed between each pair of valves in the liquid ammonia piping or hose where liquid may be trapped so as to relieve into the atmosphere at a safe location.

(10) *General.* (i) Personnel required to handle ammonia should be trained in safe operating practices and in the proper action to take in the event of emergencies.

(ii) All stationary storage installations shall have at least two suitable gas masks in readily accessible locations. Full face masks with ammonia cannisters as approved by the Bureau of Mines, U.S. Department of the Interior (see 30 CFR Part 11), are suitable for emergency action for most leaks, particularly those that occur outdoors. For protection in concentrated ammonia atmospheres self-contained breathing air apparatus is required.

(iii) Stationary storage installations shall have an easily accessible shower or a 50-gallon drum of water.

(iv) Each vehicle transporting ammonia in bulk except farm applicator vehicles shall carry a container of at least 5 gallons of water and shall be equipped with a full face mask.

(11) *Charging of containers.* (i) The filling densities for containers that are not refrigerated shall not exceed the following:

Type of container	Percent by weight	Percent by volume
Aboveground—Uninsulated	56	82
Aboveground—Uninsulated		87.5
Aboveground—Insulated	57	83.5
Underground—Uninsulated	58	85
DOT—In accord with DOT regulations.		

(ii) Aboveground uninsulated containers may be charged 87.5 percent by volume provided the temperature of the anhydrous ammonia being charged is determined to be not lower than 30° F. or provided the charging of the container is stopped at the first indication of frost or ice formation on its outside surface and is not resumed until such frost or ice has disappeared.

(iii) Any container, including DOT cargo and portable tanks, shipped under DOT jurisdiction shall be filled according to DOT regulations.

(iv) Refer to paragraph (d) of this section for filling densities of refrigerated storage containers.

(12) *Transfer of liquids.* (i) Anhydrous ammonia shall always be at a temperature suitable for the material of construction and the design of the receiving container.

(ii) The employer shall require the continuous presence of an attendant in the vicinity of the operation during such time as ammonia is being transferred.

(iii) Containers shall be charged or used only upon authorization of the owner.

(iv) Containers shall be gaged and charged only in the open atmosphere or in buildings or areas thereof provided for that purpose.

(v) Pumps used for transferring ammonia shall be those manufactured for that purpose.

(*a*) Pumps shall be designed for at least 250 p.s.i.g. working pressure.

(b) Positive displacement pumps shall have, installed off the discharged port, a constant differential relief valve discharging into the suction port of the pump through a line of sufficient size to carry the full capacity of the pump at relief valve setting, which setting and installation shall be according to the pump manufacturer's recommendations.

(c) On the discharge side of the pump, before the relief valve line, there shall be installed a pressure gage graduated from 0 to 400 p.s.i.

(d) Plant piping shall contain shutoff valves located as close as practical to pump connections.

(vi) Compressors used for transferring or refrigerating ammonia shall be recommended for ammonia service by the manufacturer.

(a) Compressors shall be designed for at least 250 p.s.i.g. working pressure.

(b) Plant piping shall contain shutoff valves located as close as practical to compressor connections.

(c) A relief valve large enough to discharge the full capacity of the compressor shall be connected to the discharge before any shutoff valve.

(d) Compressors shall have pressure gages at suction and discharge graduated to at least one and one-half times the maximum pressure that can be developed.

(e) Adequate means, such as drainable liquid trap, shall be provided on the compressor suction to minimize the entry of liquid into the compressor.

(f) Where necessary to prevent contamination, an oil separator shall be provided on the discharge side of the compressor.

(vii) Loading and unloading systems shall be protected by suitable devices to prevent emptying of the storage container or the container being loaded or unloaded in the event of severance of the hose. Backflow check valves or properly sized excess flow valves shall be installed where necessary to provide such protection. In the event that such valves are not practical, remotely operated shutoff valves may be installed.

(13) *Tank car unloading points and operations.* (i) Provisions for unloading tank cars shall conform to the applicable recomendations contained in the DOT regulations.

(ii) The employer shall insure that unloading operations are performed by reliable persons properly instructed and given the authority to monitor careful compliance with all applicable procedures.

(iii) Caution signs shall be so placed on the track or car as to give necessary warning to persons approaching the car from open end or ends of siding and shall be left up until after the car is unloaded and disconnected from discharge connections. Signs shall be of metal or other suitable material, at least 12 by 15 inches in size and bear the words "STOP—Tank Car Connected" or "STOP—Men at Work" the word, "STOP," being in letters at least 4 inches high and the other words in letters at least 2 inches high. The letters shall be white on a blue background.

(iv) The track of a tank car siding shall be substantially level.

(v) Brakes shall be set and wheels blocked on all cars being unloaded.

(14) *Liquid-level gaging device.* (i) Each container except those filled by weight shall be equipped with an approved liquid-level gaging device. A thermometer well shall be provided in all containers not utilizing a fixed liquid-level gaging device.

(ii) All gaging devices shall be arranged so that the maximum liquid level to which the container is filled is readily determined.

(iii) Gaging devices that require bleeding of the product to the atmosphere such as the rotary tube, fixed tube, and slip tube devices shall be designed so that the maximum opening of the bleed valve is not larger than No. 54 drill size unless provided with an excess flow valve. (This requirement does not apply to farm vehicles used for the application of ammonia as covered in paragraph (h) of this section.)

(iv) Gaging devices shall have a design pressure equal to or greater than the design pressure of the container on which they are installed.

(v) Fixed tube liquid-level gages shall be designed and installed to indicate that level at which the container is filled to 85 percent of its water capacity in gallons.

(vi) Gage glasses of the columnar type shall be restricted to stationary storage installations. They shall be equipped with shutoff valves having metallic handwheels, with excess-flow valves, and with extra heavy glass adequately protected with a metal housing applied by the gage manufacturer. They shall be shielded against the direct rays of the sun.

(15) *Painting of containers.* Aboveground uninsulated containers should have a reflective surface maintained in good condition.

(16) *Electrical equipment and wiring.* (i) Electrical equipment and wiring for use in ammonia installations shall be general purpose or weather resistant as appropriate.

(ii) Electrical systems shall be installed and maintained in accordance with Subpart S of this part.

(c) *Systems utilizing stationary, nonrefrigerated storage containers.* This paragraph applies to stationary, nonrefrigerated storage installations utilizing containers other than those covered in paragraph (e) of this section. Paragraph (b) of this section applies to this paragraph unless otherwise noted.

(1) *Design pressure and construction of containers.* The minimum design pressure for nonrefrigerated containers shall be 250 p.s.i.g.

(2) *Container valves and accessories, filling and discharge connections.* (i) Each filling connection shall be provided with combination back-pressure check valve and excess-flow valve; one double or two single back-pressure check valves; or a positive shutoff valve in conjunction with either an internal back-pressure check valve or an internal excess flow valve.

(ii) All liquid and vapor connections to containers except filling pipes, safety relief connections, and liquid-level gaging and pressure gage connections provided with orifices not larger than No. 54 drill size as required in paragraphs (b)(6) (iv) and (v) of this section shall be equipped with excess-flow valves.

(iii) Each storage container shall be provided with a pressure gage graduated from 0 to 400 p.s.i. Gages shall be designated for use in ammonia service.

(iv) All containers shall be equipped with vapor return valves.

(3) *Safety-relief devices.* (i) Every container shall be provided with one or more safety-relief valves of the spring-loaded or equivalent type in accordance with paragraph (b)(9) of this section.

(ii) The rate of discharge of spring-loaded safety relief valves installed on underground containers may be reduced to a minimum of 30 percent of the rate of discharge specified in Table H-36. Containers so protected shall not be uncovered after installation until the liquid ammonia has been removed. Containers which may contain liquid ammonia before being installed underground and before being completely covered with earth are to be considered aboveground containers when determining the rate of discharge requirements of the safety-relief valves.

(iii) On underground installations where there is a probability of the manhole or housing becoming flooded, the discharge from vent lines shall be located above the high water level. All manholes or housings shall be provided with ventilated louvers or their equivalent, the area of such openings equalling or exceeding combined discharge areas of safety-relief valves and vent lines which discharge their content into the manhole housing.

(iv) Vent pipes, when used, shall not be restricted or of smaller diameter than the relief-valve outlet connection.

(v) If desired, vent pipes from two or more safety-relief devices located on the same unit, or similar lines from two or more different units may be run into a common discharge header, provided the capacity of such header is at least equal to the sum of the capacities of the individual discharge lines.

(4) *Reinstallation of containers.* (i) Containers once installed under ground shall not later be reinstalled above ground or under ground, unless they successfully withstand hydrostatic pressure retests at the pressure specified for the original hydrostatic test as required by the code under which constructed and show no evidence of serious corrosion.

(ii) Where containers are reinstalled under ground, the corrosion-resistant coating shall be put in good condition; see subpargraph (5)(iv) of this paragraph. Where containers are reinstalled above ground, safety devices or gaging devices shall comply with paragraph (b)(9) of this section and this subparagraph respectively for aboveground containers.

(5) *Installation of storage containers* (i) Containers installed above ground, except as provided in subdivision (v) of this subparagraph shall be provided with substantial concrete or masonry supports, or structural steel supports on firm concrete or masonry foundations. All foundations shall extend below the frost line.

(ii) Horizontal aboveground containers shall be so mounted on foundations as to permit expansion and contraction. Every container shall be supported to prevent the concentration of excessive loads on the supporting portion of the shell. That portion of the container in contact with foundations or saddles shall be protected against corrosion.

(iii) Containers installed under ground shall be so placed that the top of the container is below the frost line and in no case less than 2 feet below the surface of the ground. Should ground conditions make compliance with these requirements impracticable, installation shall be made otherwise to prevent physical damage. It will not be necessary to cover the portion of the container to which manhole and other connections are affixed. When necessary to prevent floating, containers shall be securely anchored or weighted.

(iv) Underground containers shall be set on a firm foundation (firm earth may be used) and surrounded with earth or sand well tamped in place. The container, prior to being placed under ground, shall be given a corrosion resisting protective coating. The container thus coated shall be so lowered into place as to prevent abrasion or other damage to the coating.

(v) Containers with foundations attached (portable or semiportable tank containers with suitable steel "runners" or "skids" and commonly known in the industry as "skid tanks") shall be designed and constructed in accordance with subparagraph (1) of this paragraph.

(vi) Secure anchorage or adequate pier height shall be provided against container flotation wherever sufficiently high flood water might occur.

(vii) The distance between underground containers of over 2,000 gallons capacity shall be at least 5 feet.

(6) *Protection of appurtenances.*

(i) Valves, regulating, gaging, and other appurtenances shall be protected against tampering and physical damage. Such appurtenances shall also be protected during transit of containers.

(ii) All connections to underground containers shall be located within a dome, housing, or manhole and with access thereto by means of a substantial cover.

(7) *Damage from vehicles.* Precaution shall be taken against damage to ammonia systems from vehicles.

(d) *Refrigerated storage systems.* This paragraph applies to systems utilizing containers with the storage of anhydrous ammonia under refrigerated conditions. All applicable rules of paragraph (b) of this section apply to this paragraph unless otherwise noted.

(1) *Design of containers.*

(i) The design temperature shall be the minimum temperature to which the container will be refrigerated.

(ii) Containers with a design pressure exceeding 15 p.s.i.g. shall be constructed in accordance with paragraph (b) (2) of this section, and the materials shall be selected from those listed in API Standard 620, Recommended Rules for Design and Construction of Large, Welded, Low-Pressure Storage Tanks, Fourth Edition, 1970, Tables 2.02, R2.2, R2.2(A), R2.2.1, or R2.3.

(iii) Containers with a design pressure of 15 p.s.i.g. and less shall be constructed in accordance with the applicable requirements of API Standard 620 including its Appendix R.

(iv) When austenitic steels or nonferrous materials are used, the Code shall be used as a guide in the selection of materials for use at the design temperature.

(v) The filling density for refrigerated storage containers shall be such that the container will not be liquid full at a liquid temperature corresponding to the vapor pressure at the start-to-discharge pressure setting of the safety-relief valve.

(2) *Installation of refrigerated storage containers.* (i) Containers shall be supported on suitable noncombustible foundations designed to accommodate the type of container being used.

(ii) Adequate protection against flotation or other water damage shall be provided wherever high flood water might occur.

(iii) Containers for product storage at less than 32° F. shall be supported in such a way, or heat shall be supplied, to prevent the effects of freezing and consequent frost heaving.

(3) *Shutoff valves.* When operating conditions make it advisable, a check valve shall be installed on the fill connection and a remotely operated shutoff valve on other connections located below the maximum liquid level.

(4) *Safety relief devices.* (i) Safety relief valves shall be set to start-to-discharge at a pressure not in excess of the design pressure of the container and shall have a total relieving capacity sufficient to prevent a maximum pressure in the container of more than 120 percent of the design pressure. Relief valves for refrigerated storage containers shall be self-contained spring-loaded, weight-loaded, or self-contained pilot-operated type.

(ii) The total relieving capacity shall be the larger of:

(*a*) Possible refrigeration system upset such as (*1*) cooling water failure, (*2*) power failure, (*3*) instrument air or instrument failure, (*4*) mechanical failure of any equipment, (*5*) excessive pumping rates.

(*b*) Fire exposure determined in accordance with Compressed Gas Association (CGA) S–1, Part 3, Safety Relief Device Standards for Compressed Gas Storage Containers, 1959, except that "A" shall be the total exposed surface area in square feet up to 25 foot above grade or to the equator of the storage container if it is a sphere, whichever is greater. If the relieving capacity required for fire exposure is greater than that required by (*a*) of this subdivision, the additional capacity may be provided by weak roof to shell seams in containers operating at essentially atmospheric pressure and having an inherently weak roof-to-shell seam. The weak roof-to-shell seam is not to be considered as providing any of the capacity required in (*a*) of this subdivision.

(iii) If vent lines are installed to conduct the vapors from the relief valve, the back pressure under full relieving conditions shall not exceed 50 percent of the start-to-discharge pressure for pressure balanced valves or 10 percent of the start-to-discharge pressure for conventional valves. The vent lines shall be installed to prevent accumulation of liquid in the lines.

(iv) The valve or valve installation shall provide weather protection.

(v) Atmospheric storage shall be provided with vacuum breakers. Ammonia gas, nitrogen, methane, or other inert gases can be used to provide a pad.

(5) *Protection of container appurtenances.* Appurtenances shall be protected against tampering and physical damage.

(6) *Reinstallation of refrigerated storage containers.* Containers of such size as to require field fabrication shall, when moved and reinstalled, be reconstructed and reinspected in complete accordance with the requirements under which they were constructed. The containers shall be subjected to a pressure retest and if rerating is necessary, rerating shall be in accordance with applicable requirements.

(7) *Damage from vehicles.* Precaution shall be taken against damage from vehicles.

(8) *Refrigeration load and equipment.*

(i) The total refrigeration load shall be computed as the sum of the following:

(*a*) Load imposed by heat flow into the container caused by the temperature differential between design ambient temperature and storage temperature.

(*b*) Load imposed by heat flow into the container caused by maximum sun radiation.

(*c*) Maximum load imposed by filling the container with ammonia warmer than the design storage temperature.

(ii) More than one storage container may be handled by the same refrigeration system.

(9) *Compressors.*

(i) A minimum of two compressors shall be provided either of which shall be of sufficient size to handle the loads listed in subparagraphs (8) (i) (*a*) and (*b*) of this paragraph. Where more than two compressors are provided minimum standby equipment equal to the largest normally operating equipment shall be installed. Filling compressors may be used as standby equipment for holding compressors.

(ii) Compressors shall be sized to operate with a suction pressure at least 10 percent below the minimum setting of

the safety valve(s) on the storage container and shall withstand a suction pressure at least equal to 120 percent of the design pressure of the container.

(10) *Compressor drives.*

(i) Each compressor shall have its individual driving unit.

(ii) An emergency source of power of sufficient capacity to handle the loads listed in subparagraphs (8)(i) (*a*) and (*b*) of this paragraph shall be provided unless facilities are available to safely dispose of vented vapors while the refrigeration system is not operating.

(11) *Automatic control equipment.*

(i) The refrigeration system shall be arranged with suitable controls to govern the compressor operation in accordance with the load as evidenced by the pressure in the container(s).

(ii) An emergency alarm system shall be installed to function in the event the pressure in the container(s) rises to the maximum allowable operating pressure.

(iii) An emergency alarm and shutoff shall be located in the condenser system to respond to excess discharge pressure caused by failure of the cooling medium.

(iv) All automatic controls shall be installed in a manner to preclude operation of alternate compressors unless the controls will function with the alternate compressors.

(12) *Separators for compressors.*

(i) An entrainment separator of suitable size and design pressure shall be installed in the compressor suction line of lubricated compression. The separator shall be equipped with a drain and gaging device.

(ii) An oil separator of suitable size shall be installed in the compressor discharge line. It shall be designed for at least 250 p.s.i.g. and shall be equipped with a gaging device and drain valve.

(13) *Condensers.* The condenser system may be cooled by air or water or both. The condenser shall be designed for at least 250 p.s.i.g. Provision shall be made for purging noncondensibles either manually or automatically.

(14) *Receiver and liquid drain.* A receiver shall be provided with a liquid-level control to discharge the liquid ammonia to storage. The receiver shall be designed for at least 250 p.s.i.g. and be equipped with the necessary connections, safety valves, and gaging device.

(15) *Insulation.* Refrigerated containers and pipelines which are insulated shall be covered with a material of suitable quality and thickness for the temperatures encountered. Insulation shall be suitably supported and protected against the weather. Weatherproofing shall be of a type which will not support flame propagation.

(e) *Systems utilizing portable DOT containers.* (1) *Conformance.* Cylinders shall comply with DOT specifications and shall be maintained, filled, packaged, marked, labeled, and shipped to comply with 49 CFR Chapter I and Marking Portable Compressed Gas Containers to Identify the Material Contained, ANSI Z48.1–1954 (R1970).

(2) *Storage.* Cylinders shall be stored in an area free from ignitable debris and in such manner as to prevent external corrosion. Storage may be indoors or outdoors.

(3) *Heat protection.* Cylinders filled in accordance with DOT regulations will become liquid full at 145° F. Cylinders shall be protected from heat sources such as radiant flame and steampipes. Heat shall not be applied directly to cylinders to raise the pressure.

(4) *Protection.* Cylinders shall be stored in such manner as to protect them from moving vehicles or external damage.

(5) *Valve cap.* Any cylinder which is designed to have a valve protection cap shall have the cap securely in place when the cylinder is not in service.

(f) *Tank motor vehicles for the transportation of ammonia.* (1) This paragraph applies to containers and pertinent equipment mounted on tank motor vehicles including semitrailers and full trailers used for the transportation of ammonia. This paragraph does not apply to farm vehicles. For requirements covering farm vehicles, refer to paragraphs (g) and (h) of this section.

Paragraph (b) of this section applies to this paragraph unless otherwise noted. Containers and pertinent equipment for tank motor vehicles for the transportation of anhydrous ammonia, in addition to complying with the requirements of this section, shall also comply with the requirements of DOT.

(2) *Design pressure and construction of containers.* (i) The minimum design pressure for containers shall be that specified in the regulations of the DOT.

(ii) The shell or head thickness of any container shall not be less than three-sixteenth inch.

(iii) All container openings, except safety relief valves, liquid-level gaging devices, and pressure gages, shall be labeled to designate whether they communicate with liquid or vapor space.

(3) *Container appurtenances.* (i) All appurtenances shall be protected against physical damage.

(ii) All connections to containers, except filling connections, safety relief devices, and liquid-level and pressure gage connections, shall be provided with suitable automatic excess flow valves, or in lieu thereof, may be fitted with quick-closing internal valves, which shall remain closed except during delivery operations. The control mechanism for such valves may be provided with a secondary control remote from the delivery connections and such control mechanism shall be provided with a fusible section (melting point 208° F. to 220° F.) which will permit the internal valve to close automatically in case of fire.

(iii) Filling connections shall be provided with automatic back-pressure check valves, excess-flow valves, or quick-closing internal valves, to prevent backflow in case the filling connection is broken. Where the filling and discharge connect to a common opening in the container shell and that opening is fitted with a quick-closing internal valve as specified in subdivision (ii) of this subparagraph, the automatic valve shall not be required.

(iv) All containers shall be equipped for spray loading (filling in the vapor space) with an approved vapor return valve of adequate capacity.

(4) *Piping and fittings.* (i) All piping, tubing, and fittings shall be securely mounted and protected against damage. Means shall be provided to protect hoses while the vehicle is in motion.

(ii) Fittings shall comply with paragraph (b)(6) of this section. Pipe shall be schedule 80.

(5) *Safety relief devices.* (i) The discharge from safety relief valves shall be vented away from the container upward and unobstructed to the open air in such a manner as to prevent any impingement of escaping gas upon the container; loose-fitting rain caps shall be used. Size of discharge lines from safety valves shall not be smaller than the nominal size of the safety-relief valve outlet connection. Suitable provision shall be made for draining condensate which may accumulate in the discharge pipe.

(ii) Any portion of liquid ammonia piping which at any time may be closed at both ends shall be provided with a hydrostatic relief valve.

(6) *Transfer of liquids.* (i) The content of tank motor vehicle containers shall be determined by weight, by a suitable liquid-level gaging device, or other approved methods. If the content of a container is to be determined by liquid-level measurement, the container shall have a thermometer well so that the internal liquid temperature can be easily determined. This volume when converted to weight shall not exceed the filling density specified by the DOT.

(ii) Any pump, except a constant speed centrifugal pump, shall be equipped with a suitable pressure actuated bypass valve permitting flow from discharge to suction when the discharge pressure rises above the predetermined point. Pump discharge shall also be equipped with a spring-loaded safety relief valve set at a pressure not more than 135 percent of the setting of the bypass valve or more than 400 p.s.i.g., whichever is larger.

(iii) Compressors shall be equipped with manually operated shutoff valves on both suction and discharge connections. Pressure gages of bourdon-tube type shall be installed on the suction and discharge of the compressor before the shutoff valves. The compressor shall not be operated if either pressure gage is removed or is inoperative. A spring-loaded, safety-relief valve capable of discharging to atmosphere the full flow of gas from the compressor at a pressure not exceeding 300 p.s.i.g. shall be connected between the compressor discharge and the discharge shutoff valve.

(iv) Valve functions shall be clearly and legibly identified by metal tags or nameplates permanently affixed to each valve.

(7) *Full trailers and semitrailers.* (i) All full trailers shall be firmly and securely attached to the vehicle drawing

them by means of suitable drawbars supplemented by a safety chain (or chains) or safety cables.

(ii) Every full trailer or semitrailer shall have a reliable system of brakes, and adequate provision shall be made to operate the brakes from the driver's seat.

(iii) Every full trailer shall be equipped with self-energizing brakes.

(iv) Full trailers shall be so designed that the towed vehicle will follow substantially in the path of the towing vehicle and will not whip or swerve dangerously from side to side.

(v) Where a fifth wheel is employed, it shall be ruggedly designed, securely fastened to both units, and equipped with a positive locking mechanism which will prevent separation of the two units except by manual release.

(8) *Protection against collision.* Each tank motor vehicle shall be provided with properly attached bumpers or chassis extension arranged to protect the tank, piping, valves, and fittings from physical damage in case of collision.

(9) *Chock blocks.* At least two chock blocks shall be provided. These blocks shall be placed to prevent rolling of the vehicle whenever it is parked during loading and unloading operations.

(10) *Portable tank containers (skid tanks).* Where portable tank containers are used for farm storage they shall comply with paragraph (c)(1) of this section. When portable tank containers are used in lieu of cargo tanks and are permanently mounted on tank motor vehicles for the transportation of ammonia, they shall comply with the requirements of this paragraph.

(g) *Systems mounted on farm vehicles other than for the application of ammonia*—(1) *Application.* This paragraph applies to containers of 1,200 gallons capacity or less and pertinent equipment mounted on farm vehicles (implements of husbandry) and used other than for the application of ammonia to the soil. Paragraph (b) of this section applies to this paragraph unless otherwise noted.

(2) *Design pressure and classification of containers.* (i) The minimum design pressure for containers shall be 250 p.s.i.g.

(ii) The shell or head thickness of any container shall be not less than three-sixteenths of an inch.

(3) *Mounting containers.* (i) A suitable "stop" or "stops" shall be mounted on the vehicle or on the container in such a way that the container shall not be dislodged from its mounting due to the vehicle coming to a sudden stop. Back slippage shall also be prevented by proper methods.

(ii) A suitable "hold down" device shall be provided which will anchor the container to the vehicle at one or more places on each side of the container.

(iii) When containers are mounted on four-wheel trailers, care shall be taken to insure that the weight is distributed evenly over both axles.

(iv) When the cradle and the tank are not welded together suitable material shall be used between them to eliminate metal-to-metal friction.

(4) *Container appurtenances.* (i) All containers shall be equipped with a fixed liquid-level gage.

(ii) All containers with a capacity exceeding 250 gallons shall be equipped with a pressure gage having a dial graduated from 0–400 p.s.i.

(iii) The filling connection shall be fitted with combination back-pressure check valve and excess-flow valve; one double or two single back-pressure check valves; or a positive shutoff valve in conjunction with either an internal back-pressure check valve or an internal excess flow valve.

(iv) All containers with a capacity exceeding 250 gallons shall be equipped for spray loading or with an approved vapor return valve.

(v) All vapor and liquid connections except safety-relief valves and those specifically exempted by paragraph (b)(7)(v) of this section shall be equipped with approved excess-flow valves or may be fitted with quick-closing internal valves which, except during operating periods, shall remain closed.

(vi) Fittings shall be adequately protected from damage by a metal box or cylinder with open top securely fastened to the container or by rigid guards, well braced, welded to the container on both sides of the fittings or by a metal dome. If a metal dome is used, the relief valve shall be properly vented through the dome.

(vii) If a liquid withdrawal line is installed in the bottom of a container, the connections thereto, including hose, shall not be lower than the lowest horizontal edge of the vehicle axle.

(viii) Provision shall be made to secure both ends of the hose while in transit.

(5) *Marking the container.* There shall appear on each side and on the rear end of the container in letters at least 4 inches high, the words, "Caution—Ammonia" or the container shall be marked in accordance with DOT regulations.

(6) *Farm vehicles.*

(i) Farm vehicles shall conform with State regulations.

(ii) All trailers shall be securely attached to the vehicle drawing them by means of drawbars supplemented by suitable safety chains.

(ii) A trailer shall be constructed so that it will follow substantially in the path of the towing vehicle and will not whip or swerve dangerously from side to side.

(iii) All vehicles shall carry a can containing 5 gallons or more of water.

(h) *Systems mounted on farm vehicles for the application of ammonia.* (1) This paragraph applies to systems utilizing containers of 250 gallons capacity or less which are mounted on farm vehicles (implement of husbandry) and used for the application of ammonia to the soil. Paragraph (b) of this section applies to this paragraph unless otherwise noted. Where larger containers are used, they shall comply with paragraph (g) of this section.

(2) *Design pressure and classification of containers.* (i) The minimum design pressure for containers shall be 250 p.s.i.g.

(ii) The shell or head thickness of any container shall not be less than three-sixteenths inch.

(3) *Mounting of containers.* All containers and flow-control devices shall be securely mounted.

(4) *Container valves and accessories.* (i) Each container shall have a fixed liquid-level gage.

(ii) The filling connection shall be fitted with a combination back-pressure check valve and an excess-flow valve; one double or two single back-pressure check valves; or a positive shutoff valve in conjunction with an internal back-pressure check valve or an internal excess-flow valve.

(iii) The applicator tank may be filled by venting to open air provided the bleeder valve orifice does not exceed seven-sixteenths inch in diameter.

(iv) Regulation equipment may be connected directly to the tank coupling or flange, in which case a flexible connection shall be used between such regulating equipment and the remainder of the liquid withdrawal system. Regulating equipment not so installed shall be flexibly connected to the container shutoff valve.

(v) No excess flow valve is required in the liquid withdrawal line provided the controlling orifice between the contents of the container and the outlet of the shutoff valve does not exceed seven-sixteenths inch in diameter.

§ 1910.112 [Reserved]

§ 1910.113 [Reserved]

§ 1910.114 Additional delay in effective date.

The requirements of this Subpart H shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart upon the commencement of the Walsh-Healey requirement.

§ 1910.115 Sources of standards.

Sec.	*Source*
1910.101	41 CFR 50–204.67, 70, and 71.
1910.102	41 CFR 50–204.66.
1910.103	NFPA No. 50B–1968, Standard for Liquified Hydrogen Systems at Consumer Sites.
1910.104	NFPA No. 566–1965, Standard for the Installation of Bulk Oxygen Systems at Consumer Sites.
1910.105	NFPA No. 30–1969, Flammable and Combustible Liquids Code.
1910.107	NFPA No. 33–1969, Standard for Spray Finishing using Flammable and Combustible Materials.

Sec.	Source
1910.108	NFPA No. 34–1966, Standard for Dip Tanks Containing Flammable or Combustible Liquids.
1910.109	NFPA No. 492–1970, Code for Manufacture, Transportation, Storage and Use of Explosives and Blasting Agents.
1910.110	NFPA 58–69, Standard for the Handling of Liquified Petroleum Cases.
1910.111	ANSI K61.1–1966, Storage and Handling of Anhydrous Ammonia.

§ 1910.116 Standards organizations.

National Fire Protection Association (NFPA), 60 Batterymarch Street, Boston, MA 02110.
National Plant Food Institute, 1700 K Street NW., Washington, DC 20006.
Compressed Gas Association, Inc., 500 Fifth Avenue, New York, NY 10036.
American Society of Mechanical Engineers Inc., United Engineering Center, 345 East 47th Street, New York, NY 10017.
American Petroleum Institute, 1801 K Street NW., Washington, DC 20006.
National Board of Boiler and Pressure Vessel, Inspectors, 1155 North High Street, Columbus, OH 43201.
American National Standards Institute, 1430 Broadway, New York, NY 10018.
American Society for Testing and Materials (ASTM), 1916 Race Street Philadelphia, PA 19103.
Underwriters Laboratories, Inc. (UL), 207 East Ohio Street, Chicago, IL 60611.

Subpart I—Personal Protective Equipment

§ 1910.132 General requirements.

(a) *Application.* Protective equipment, including personal protective equipment for eyes, face, head, and extremities, protective clothing, respiratory devices, and protective shields and barriers, shall be provided, used, and maintained in a sanitary and reliable condition wherever it is necessary by reason of hazards of processes or environment, chemical hazards, radiological hazards, or mechanical irritants encountered in a manner capable of causing injury or impairment in the function of any part of the body through absorption, inhalation or physical contact.

(b) *Employee-owned equipment.* Where employees provide their own protective equipment, the employer shall be responsible to assure its adequacy, including proper maintenance, and sanitation of such equipment.

(c) *Design.* All personal protective equipment shall be of safe design and construction of the work to be performed.

§ 1910.133 Eye and face protection.

(a) *General.* (1) Protective eye and face equipment shall be required where there is a reasonable probability of injury that can be prevented by such equipment. In such cases, employers shall make conveniently available a type of protector suitable for the work to be performed, and employees shall use such protectors. No unprotected person shall knowingly be subjected to a hazardous environmental condition. Suitable eye protectors shall be provided where machines or operations present the hazard of flying objects, glare, liquids, injurious radiation, or a combination of these hazards.

(2) Protectors shall meet the following minimum requirements:

(i) They shall provide adequate protection against the particular hazards for which they are designed.

(ii) They shall be reasonably comfortable when worn under the designated conditions.

(iii) They shall fit snugly and shall not unduly interfere with the movements of the wearer.

(iv) They shall be durable.

(v) They shall be capable of being disinfected.

(vi) They shall be easily cleanable.

(vii) Protectors should be kept clean and in good repair.

(3) Persons whose vision requires the use of corrective lenses in spectacles, and who are required by this standard to wear eye protection, shall wear goggles or spectacles of one of the following types:

(i) Spectacles whose protective lenses provide optical correction.

(ii) Goggles that can be worn over corrective spectacles without disturbing the adjustment of the spectacles.

(iii) Goggles that incorporate corrective lenses mounted behind the protective lenses.

(4) Every protector shall be distinctly marked to facilitate identification only of the manufacturer.

(5) When limitations or precautions are indicated by the manufacturer, they shall be transmitted to the user and care taken to see that such limitations and precautions are strictly observed.

(6) Design, construction, testing, and use of devices for eye and face protection shall be in accordance with American National Standard for Occupational and Educational Eye and Face Protection, Z87, 1–1968.

§ 1910.134 Respiratory protection.

(a) *Permissible practice.* (1) In the control of those occupational diseases caused by breathing air contaminated with harmful dusts, fogs, fumes, mists, gases, smokes, sprays, or vapors, the primary objective shall be to prevent atmospheric contamination. This shall be accomplished as far as feasible by accepted engineering control measures (for example, enclosure or confinement of the operation, general and local ventilation, and substitution of less toxic materials). When effective engineering controls are not feasible, or while they are being instituted, appropriate respirators shall be used pursuant to the following requirements.

(2) Respirators shall be provided by the employer when such equipment is necessary to protect the health of the employee. The employer shall provide the respirators which are applicable and suitable for the purpose intended. The employer shall be responsible for the establishment and maintenance of a respiratory protective program which shall include the requirements outlined in paragraph (b) of this section.

(3) The employee shall use the provided respiratory protection in accordance with instructions and training received.

(b) *Requirements for a minimal acceptable program.* (1) Written standard operating procedures governing the selection and use of respirators shall be established.

(2) Respirators shall be selected on the basis of hazards to which the worker is exposed.

(3) The user shall be instructed and trained in the proper use of respirators and their limitations.

(4) Where practicable, the respirators should be assigned to individual workers for their exclusive use.

(5) Respirators shall be regularly cleaned and disinfected. Those issued for the exclusive use of one worker should be cleaned after each day's use, or more often if necessary. Those used by more than one worker shall be thoroughly cleaned and disinfected after each use.

(6) Respirators shall be stored in a convenient, clean, and sanitary location.

(7) Respirators used routinely shall be inspected during cleaning. Worn or deteriorated parts shall be replaced. Respirators for emergency use such as self-contained devices shall be thoroughly inspected at least once a month and after each use.

(8) Appropriate surveillance of work area conditions and degree of employee exposure or stress shall be maintained.

(9) There shall be regular inspection and evaluation to determine the continued effectiveness of the program.

(10) Persons should not be assigned to tasks requiring use of respirators unless it has been determined that they are physically able to perform the work and use the equipment. The local physician shall determine what health and physical conditions are pertinent. The respirator user's medical status should be reviewed periodically (for instance, annually).

(11) Approved or accepted respirators shall be used when they are available. The respirator furnished shall provide adequate respiratory protection against the particular hazard for which it is designed in accordance with standards established by competent authorities. The U.S. Department of Interior, Bureau of Mines, and the U.S. Department of Agriculture are recognized as such authorities. Although respirators listed by the U.S. Department of Agriculture continue to be acceptable for protection against specified pesticides, the U.S. Department of the Interior, Bureau of Mines, is the agency now responsible for testing and approving pesticide respirators.

(c) *Selection of respirators.* Proper selection of respirators shall be made according to the guidance of American National Standard Practices for Respiratory Protection Z88.2–1969.

(d) *Air quality.* (1) Compressed air, compressed oxygen, liquid air, and liquid oxygen used for respiration shall be of

high purity. Oxygen shall meet the requirements of the United States Pharmacopoeia for medical or breathing oxygen. Breathing air shall meet at least the requirements of the specification for Grade D breathing air as described in Compressed Gas Association Commodity Specification G–7.1–1966. Compressed oxygen shall not be used in supplied-air respirators or in open circuit self-contained breathing apparatus that have previously used compressed air. Oxygen must never be used with air line respirators.

(2) Breathing air may be supplied to respirators from cylinders or air compressors.

(i) Cylinders shall be tested and maintained in as prescribed in the Shipping Container Specification Regulations of the Department of Transportation (49 CFR Part 178).

(ii) The compressor for supplying air shall be equipped with necessary safety and standby devices. A breathing air-type compressor shall be used. Compressors shall be constructed and situated so as to avoid entry of contaminated air into the system and suitable in-line air purifying sorbent beds and filters installed to further assure breathing air quality. A receiver of sufficient capacity to enable the respirator wearer to escape from a contaminated atmosphere in event of compressor failure, and alarms to indicate compressor failure and overheating shall be installed in the system. If an oil-lubricated compressor is used, it shall have a high-temperature or carbon monoxide alarm, or both. If only a high-temperature alarm is used, the air from the compressor shall be frequently tested for carbon monoxide to insure that it meets the specifications in subparagraph (1) of this paragraph.

(3) Air line couplings shall be incompatible with outlets for other gas systems to prevent inadvertent servicing of air line respirators with nonrespirable gases or oxygen.

(4) Breathing gas containers shall be marked in accordance with American National Standard Method of Marking Portable Compressed Gas Containers to Identify the Material Contained, Z48.1–1954; Federal Specification BB–A–1034a, June 21, 1968, Air, Compressed for Breathing Purposes; or Interim Federal Specification GG–B–00675b, April 27, 1965, Breathing Apparatus, Self-Contained.

(e) *Use of respirators.* (1) Standard procedures shall be developed for respirator use. These should include all information and guidance necessary for their proper selection, use, and care. Possible emergency and routine uses of respirators should be anticipated and planned for.

(2) The correct respirator shall be specified for each job. The respirator type is usually specified in the work procedures by a qualified individual supervising the respiratory protective program. The individual issuing them shall be adequately instructed to insure that the correct respirator is issued. Each respirator permanently assigned to an individual should be durably marked to indicate to whom it was assigned. This mark shall not affect the respirator performance in any way. The date of issuance should be recorded.

(3) Written procedures shall be prepared covering safe use of respirators in dangerous atmospheres that might be encountered in normal operations or in emergencies. Personnel shall be familiar with these procedures and the available respirators.

(i) In areas where the wearer, with failure of the respirator, could be overcome by a toxic or oxygen-deficient atmosphere, at least one additional man shall be present. Communications (visual, voice, or signal line) shall be maintained between both or all individuals present. Planning shall be such that one individual will be unaffected by any likely incident and have the proper rescue equipment to be able to assist the other(s) in case of emergency.

(ii) When self-contained breathing apparatus or hose masks with blowers are used in atmospheres immediately dangerous to life or health, standby men must be present with suitable rescue equipment.

(iii) Persons using air line respirators in atmospheres immediately hazardous to life or health shall be equipped with safety harnesses and safety lines for lifting or removing persons from hazardous atmospheres or other and equivalent provisions for the rescue of persons from hazardous atmospheres shall be used. A standby man or men with suitable self-contained breathing apparatus shall be at the nearest fresh air base for emergency rescue.

(4) Respiratory protection is no better than the respirator in use, even though it is worn conscientiously. Frequent random inspections shall be conducted by a qualified individual to assure that respirators are properly selected, used, cleaned, and maintained.

(5) For safe use of any respirator, it is essential that the user be properly instructed in its selection, use, and maintenance. Both supervisors and workers shall be so instructed by competent persons. Training shall provide the men an opportunity to handle the respirator, have it fitted properly, test its face-piece-to-face seal, wear it in normal air for a long familiarity period, and, finally, to wear it in a test atmosphere.

(i) Every respirator wearer shall receive fitting instructions including demonstrations and practice in how the respirator should be worn, how to adjust it, and how to determine if it fits properly. Respirators shall not be worn when conditions prevent a good face seal. Such conditions may be a growth of beard, sideburns, a skull cap that projects under the facepiece, or temple pieces on glasses. Also, the absence of one or both dentures can seriously affect the fit of a facepiece. The worker's diligence in observing these factors shall be evaluated by periodic check. To assure proper protection, the facepiece fit shall be checked by the wearer each time he puts on the respirator. This may be done by following the manufacturer's facepiece fitting instructions.

(ii) Providing respiratory protection for individuals wearing corrective glasses is a serious problem. A proper seal cannot be established if the temple bars of eye glasses extend through the sealing edge of the full facepiece. As a temporary measure, glasses with short temple bars or without temple bars may be taped to the wearer's head. Wearing of contact lenses in contaminated atmospheres with a respirator shall not be allowed. Systems have been developed for mounting corrective lenses inside full facepieces. When a workman must wear corrective lenses as part of the facepiece, the facepiece and lenses shall be fitted by qualified individuals to provide good vision, comfort, and a gas-tight seal.

(iii) If corrective spectacles or goggles are required, they shall be worn so as not to affect the fit of the facepiece. Proper selection of equipment will minimize or avoid this problem.

(f) *Maintenance and care of respirators.* (1) A program for maintenance and care of respirators shall be adjusted to the type of plant, working conditions, and hazards involved, and shall include the following basic services:

(i) Inspection for defects (including a leak check),

(ii) Cleaning and disinfecting,

(iii) Repair, and

(iv) Storage

Equipment shall be properly maintained to retain its original effectiveness.

(2) (i) All respirators shall be inspected routinely before and after each use. A respirator that is not routinely used but is kept ready for emergency use shall be inspected after each use and at least monthly to assure that it is in satisfactory working condition.

(ii) Self-contained breathing apparatus shall be inspected monthly. Air and oxygen cylinders shall be fully charged according to the manufacturer's instructions. It shall be determined that the regulator and warning devices function properly.

(iii) Respirator inspection shall include a check of the tightness of connections and the condition of the facepiece, headbands, valves, connecting tube, and canisters. Rubber or elastomer parts shall be inspected for pliability and signs of deterioration. Stretching and manipulating rubber or elastomer parts with a massaging action will keep them pliable and flexible and prevent them from taking a set during storage.

(iv) A record shall be kept of inspection dates and findings for respirators maintained for emergency use.

(3) Routinely used respirators shall be collected, cleaned, and disinfected as frequently as necessary to insure that proper protection is provided for the wearer. Each worker should be briefed on the cleaning procedure and be assured that he will always receive a clean and disinfected respirator. Such assurances

are of greatest significance when respirators are not individually assigned to workers. Respirators maintained for emergency use shall be cleaned and disinfected after each use.

(4) Replacement or repairs shall be done only by experienced persons with parts designed for the respirator. No attempt shall be made to replace components or to make adjustment or repairs beyond the manufacturer's recommendations. Reducing or admission valves or regulators shall be returned to the manufacturer or to a trained technician for adjustment or repair.

(5) (i) After inspection, cleaning, and necessary repair, respirators shall be stored to protect against dust, sunlight, heat, extreme cold, excessive moisture, or damaging chemicals. Respirators placed at stations and work areas for emergency use should be quickly accessible at all times and should be stored in compartments built for the purpose. The compartments should be clearly marked. Routinely used respirators, such as dust respirators, may be placed in plastic bags. Respirators should not be stored in such places as lockers or tool boxes unless they are in carrying cases or cartons.

(ii) Respirators should be packed or stored so that the facepiece and exhalation valve will rest in a normal position and function will not be impaired by the elastomer setting in an abnormal position.

(iii) Instructions for proper storage of emergency respirators, such as gas masks and self-contained breathing apparatus, are found in "use and care" instructions usually mounted inside the carrying case lid.

(g) *Identification of gas mask canisters.* (1) The primary means of identifying a gas mask canister shall be by means of properly worded labels. The secondary means of identifying a gas mask canister shall be by a color code.

(2) All who issue or use gas masks falling within the scope of this section shall see that all gas mask canisters purchased or used by them are properly labeled and colored in accordance with these requirements before they are placed in service and that the labels and colors are properly maintained at all times thereafter until the canisters have completely served their purpose.

(3) On each canister shall appear in bold letters the following:

(i)—

Canister for _____
(Name for atmospheric contaminant)
or
Type N Gas Mask Canister

(ii) In addition, essentially the following wording shall appear beneath the appropriate phrase on the canister label: "For respiratory protection in atmospheres containing not more than _____ percent by volume of _____
_____."
(Name of atmospheric contaminant)

(iii) All of the markings specified above should be placed on the most conspicuous surface or surfaces of the canister.

(4) Canisters having a special high-efficiency filter for protection against radionuclides and other highly toxic particulates shall be labeled with a statement of the type and degree of protection afforded by the filter. The label shall be affixed to the neck end of, or to the gray stripe which is around and near the top of, the canister. The degree of protection shall be marked as the percent of penetration of the canister by a 0.3-micron-diameter dioctyl phthalate (DOP) smoke at a flow rate of 85 liters per minute.

(5) Each canister shall have a label warning that gas masks should be used only in atmospheres containing sufficient oxygen to support life (at least 16 percent by volume), since gas mask canisters are only designed to neutralize or remove contaminants from the air.

(6) Each gas mask canister shall be painted a distinctive color or combination of colors indicated in Table I-1. All colors used shall be such that they are clearly identifiable by the user and clearly distinguishable from one another. The color coating used shall offer a high degree of resistance to chipping, scaling, peeling, blistering, fading, and the effects of the ordinary atmospheres to which they may be exposed under normal conditions of storage and use. Appropriately colored pressure sensitive tape may be used for the stripes.

TABLE I-1

Atmospheric contaminants to be protected against	*Colors assigned**
Acid gases	White.
Hydrocyanic acid gas	White with ½-inch green stripe completely around the canister near the bottom.
Chlorine gas	White with ½-inch yellow stripe completely around the canister near the bottom.
Organic vapors	Black.
Ammonia gas	Green.
Acid gases and ammonia gas	Green with ½-inch white stripe completely around the canister near the bottom.
Carbon monoxide	Blue.
Acid gases and organic vapors	Yellow.
Hydrocyanic acid gas and chloropicrin vapor	Yellow with ½-inch blue stripe completely around the canister near the bottom.
Acid gases, organic vapors, and ammonia gases.	Brown.
Radioactive materials, excepting tritium and noble gases.	Purple (Magenta).
Particulates (dusts, fumes, mists, fogs, or smokes) in combination with any of the above gases or vapors.	Canister color for contaminant, as designated above, with ½-inch gray stripe completely around the canister near the top.
All of the above atmospheric contaminants	Red with ½-inch gray stripe completely around the canister near the top.

*Gray shall not be assigned as the main color for a canister designed to remove acids or vapors.

NOTE: Orange shall be used as a complete body, or stripe color to represent gases not included in this table. The user will need to refer to the canister label to determine the degree of protection the canister will afford.

§ 1910.135 Occupational head protection.

Helmets for the protection of heads of occupational workers from impact and penetration from falling and flying objects and from limited electric shock and burn shall meet the requirements and specifications established in American National Standard Safety Requirements for Industrial Head Protection, Z89.1–1969.

§ 1910.136 Occupational foot protection.

Safety-toe footwear for employees shall meet the requirements and specifications in American National Standard for Men's Safety-Toe Footwear, Z41.1–1967.

§ 1910.137 Electrical protective devices.

Rubber protective equipment for electrical workers shall conform to the requirements established in the American National Standards Institute Standards as specified in the following list:

Item	*Standard*
Rubber insulating gloves	J6.6–1967.
Rubber matting for use around electric apparatus.	J6.7–1935 (R1962).
Rubber insulating blankets.	J6.4–1970.
Rubber insulating hoods	J6.2–1950 (R1962).
Rubber insulating line hose.	J6.1–1950 (R1965).
Rubber insulating sleeves.	J6.5–1962.

§ 1910.138 Additional delay in effective date.

The requirements of this Subpart I shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart

upon the commencement of the Walsh-Healey requirement.

§ 1910.139 Sources of standards.

Sec.	Source
1910.132	41 CFR 50-204.7.
1910.133(a)	ANSI Z87.1-1968, Eye and Face Protection.
1910.134	ANSI Z88.2-1969, Standard Practice for Respiratory Protection.
1910.134 Table I-I.	ANSI K13.1-1967, Indentification of Gas Mask Canister.
1910.135	ASNI Z89.1-1969, Safety Requirements for Industrial Head Protection.
1910.136	ANSI Z41.1-1967, Men's Safety-Toe Footwear.
1910.137	ANSI Z9.4-1968, Ventilation and Safe Practices of Abrasive Blasting Operations.

§ 1910.140 Standards organizations.

Specific standards of the following organization have been referenced in this part. Copies of the referenced materials may be obtained from the issuing organization.

American National Standards Institute, 1430 Broadway, New York, NY 10018.

Subpart J—General Environmental Controls

§ 1910.141 Sanitation.

(a) *General requirements*—(1) *Housekeeping.* (i) All places of employment, passageways, storerooms, and servicerooms shall be kept clean and orderly and in a sanitary condition.

(ii) The floor of every workroom shall be maintained in a clean and, so far as possible, a dry condition. Where wet processes are used, drainage shall be maintained and false floors, platforms, mats, or other dry standing places should be provided where practicable.

(iii) Cleaning and sweeping shall be done in such a manner as to minimize the contamination of the air with dust and, so far as is practicable, shall be done outside of working hours.

(iv) To facilitate cleaning, every floor, working place, and passageway shall be kept free from protruding nails, splinters, holes, or loose boards.

(2) *Expectorating.* (i) Expectorating upon the walls, floors, work places, or stairs of any establishment shall not be permitted.

(ii) Cuspidors are considered undesirable, but, if used, they shall be of such construction that they are cleanable. They shall be cleaned at least daily when in use.

(3) *Waste disposal.* (i) Any receptacle used for putrescible solid or liquid waste or refuse shall be so constructed that it does not leak and may be conveniently and thoroughly cleaned, and it shall be maintained in a sanitary condition. Such a receptacle shall be equipped with a tight-fitting cover.

(ii) All sweepings, solid or liquid wastes, refuse, and garbage shall be removed in such a manner as to avoid creating a nuisance or menace to health and as often as necessary to maintain the place of employment in a sanitary condition.

(4) *Rodent, insect, and vermin control.* Every enclosed work place and personal service room shall be constructed, equipped, and maintained, so far as reasonably practicable, in such a manner as to prevent the entrance or harborage of rodents, insects, and vermin of any kind.

(b) *Water supply*—(1) *Potable water.* (i) An adequate supply of potable water shall be provided for drinking, ablutionary, and culinary purposes in all places of employment. Drinking water should be made available within 200 feet of any location at which employees are regularly engaged in work.

(ii) Sanitary drinking fountains shall be of a type and construction in accordance with the Standard Specification for Drinking Fountains, ANSI Z4.2-1942.

(iii) In all instances where water is cooled by ice, the construction of the container shall be such that the ice does not come in direct contact with the water.

(iv) Open containers such as barrels, pails, or tanks for drinking water from which the water must be dipped or poured, whether or not they are fitted with a cover, are prohibited.

(v) The common drinking cup is prohibited.

(vi) Where single service cups (to be used but once) are supplied, both a sanitary container for the unused cups and a receptacle for disposing of the used cups shall be provided.

(2) *Nonpotable water.* (i) Outlets for nonpotable water, such as water for industrial or firefighting purposes only, shall be posted to indicate clearly that the water is unsafe and is not to be used for drinking, washing, or cooking purposes.

(ii) There shall be no cross-connection, open or potential, between a system furnishing potable water and system furnishing nonpotable water.

(iii) Construction shall be such as to prevent backflow of contaminated water into a potable water system.

(iv) Nonpotable water shall not be used for bathing or for washing any portion of the person, clothing, dishes, or premises.

(c) *Toilet facilities*—(1) *General.* (i) Every place of employment shall be provided with adequate toilet facilities which are separate for each sex. The sewage disposal method shall comply with requirements of the health or other authorities having jurisdiction.

(ii) Toilet facilities shall be provided so as to be readily accessible to all employees. Toilet facilities so located that employees must use more than one floor-to-floor flight of stairs to or from them are not considered as readily accessible. As far as is practicable, toilet facilities should be located within 200 feet of all locations at which workers are regularly employed.

(iii) Water closets shall be provided for each sex according to the following table. The number to be provided for each sex shall in every case be based on the maximum number of persons of that sex employed at any one time at work on the premises for which the facilities are furnished. When persons other than employees are permitted the use of toilet facilities on the premises, a reasonable allowance shall be made for such other persons in estimating the minimum number of toilet facilities required.

Number of persons	Minimum number of facilities
1 to 9	1.
10 to 24	2.
25 to 49	3.
50 to 74	4.
75 to 100	5.
over 100	1 for each additional 30 persons.

Where 10 or more are employed, urinals may be provided. One water closet less than the number specified in the foregoing may be provided for each urinal, except that the number of water closets in such cases may not be reduced to less than two-thirds of the number specified in the foregoing. Two feet of trough urinal shall be considered as equivalent to one individual urinal.

(iv) An adequate supply of toilet paper with holder shall be provided for every water closet.

(v) Covered receptacles shall be kept in all toilet rooms used by women.

(vi) Adequate washing facilities shall be provided in every toilet room or be adjacent thereto.

(2) *Construction of toilet rooms.* (i) Each toilet facility (closet) shall occupy a separate compartment, which should be equipped with a door, latch, and clothes hanger.

(ii) The walls of compartments or partitions between fixtures may be less than the height of room walls, but the top shall not be less than 6 feet from the floor and the bottom not more than 1 foot from the floor.

(iii) The door to every toilet room shall be fitted with an effective self-closing device, and the entrance to the toilet room shall be so screened that the interior of the toilet room is not visible from the workroom.

(iv) In all toilet rooms installed after July 1, 1971, the floors and side walls, to a height of at least 6 inches, including the angle formed by the floor and side walls, shall be of watertight construction.

(v) The floors, walls, ceilings, partitions, and doors of all toilet rooms shall be of a finish that can be easily cleaned. In installations made after July 1, 1971, cove bases shall be provided to facilitate cleaning.

(vi) Toilet rooms, except those in work places accessible to men only, shall be completely enclosed with solid material that is nontransparent from the outside.

(3) *Construction and installation of toilet facilities.* (i) Every water closet bowl shall be set entirely free and open from all enclosing structures and shall be so installed that the space around the fixture can be easily cleaned. This provision does not prohibit the use of wall-hung type water closets.

(ii) Every water closet shall have a hinged openfront seat made of substantial material having a nonabsorbent finish.

(4) *Chemical closets and privies.* Chemical closets and privies shall be constructed and maintained in accordance with § 1910.143.

(d) *Washing facilities*—(1) *General.* Adequate facilities for maintaining personal cleanliness shall be provided in every place of employment. These shall be convenient for the employees for whom they are provided and shall be maintained in a sanitary condition.

(2) *Lavatories.* At least one lavatory with adequate hot and cold water, preferably from a combination supply fixture, shall be provided for every 10 employees (men or women) or portion thereof, up to 100 persons; and over 100 persons one lavatory for each additional 15 persons or portion thereof. Twenty-four inches of sink with individual faucet shall be considered as equal to one lavatory. In all instances, a suitable cleansing agent shall be provided at each wash place.

(3) *Towels.* Individual hand towels, or sections thereof, of cloth or paper, shall be provided and proper receptacles or other sanitary means maintained for the disposal of used towels. The provision of a towel for general or common use is prohibited.

(e) *Change rooms*—(1) *Separate facilities.* Separate change or dressing rooms equipped with individual clothes facilities shall be provided for each sex wherever it is the practice to change from street clothes or wherever it is necessary to change because the work performed involves exposure to excessive dirt, heat, fumes, vapor, or moisture. In the event that change rooms are not provided, facilities shall be furnished for hanging outer garments.

(2) *Drying facilities.* Where the process in which the worker is engaged is such that his working clothes become wet or have to be washed between shifts, provision shall be made to insure that such clothing is dry before reuse.

(f) *Retiring rooms for women.* Where 10 or more women are employed at any one time, at least one retiring room shall be provided for rest and emergencies. Where fewer than 10 women are employed and a restroom is not furnished, some equivalent space shall be provided which can be properly screened for privacy and made suitable for the use of women employees. At least one couch or bed shall be provided in every place where more than 10 women are employed. The required number of such beds or couches follows:

10 to 100	1 bed.
100 to 250	2 beds.

1 additional bed for each additional 250 women employees. A minimum of 60 square feet of floor space per bed or couch shall be provided.

(g) *Lunchrooms*—(1) *General.* In all places of employment where employees are permitted to lunch on the premises, an adequate space suitable for that purpose shall be provided for the maximum number of employees who may use such space at one time. Such space shall be physically separate from any location where there is exposure to toxic materials.

(2) *Waste disposal containers.* An adequate number of covered receptacles constructed of a smooth, corrosion-resistant, easily cleanable, or disposable material, shall be provided by the employer and used by the employees for the disposal of all waste food. Such receptacles shall be emptied not less than once daily and shall be maintained in a clean and sanitary manner.

(3) *Location.* (i) No food shall be stored or eaten where there are present any toxic materials or substances that may be injurious to health.

(ii) No food shall be stored or eaten in any toilet room.

(iii) In every establishment where there is exposure to injurious dusts or other toxic materials, a separate lunchroom shall be maintained unless it is convenient for the employees to lunch away from the premises. The following number of square feet per person, based on the maximum number of persons using the room at one time, shall be required:

Number of persons	*Square feet per person*
25 and less	13.
26–74	12.
75–149	11.
150 and over	10.

(h) *Food handling.* All employee food service facilities and operations shall meet the requirements of "Food Service Sanitation Ordinance and Code," Part V, "Food Service Sanitation Manual," U.S. Public Health Service Publication No. 934 (1965). In all places of employment where all or part of the food service is provided by vending machines, the food dispensed shall be prepared, and the machine operated in accordance with the requirements of "Vending of Foods and Beverages, A Sanitation Ordinance and Code," U.S. Public Health Service Publication No. 546 (1965).

§ 1910.142 Temporary labor camps.

(a) *Site.* (1) All sites used for camps shall be adequately drained. They shall not be subject to periodic flooding, nor located within 200 feet of swamps, pools, sink holes, or other surface collections of water unless such quiescent water surfaces can be subjected to mosquito control measures. The camp shall be located so the drainage from and through the camp will not endanger any domestic or public water supply. All sites shall be graded, ditched, and rendered free from depressions in which water may become a nuisance.

(2) All sites shall be adequate in size to prevent overcrowding of necessary structures. The principal camp area in which food is prepared and served and where sleeping quarters are located shall be at least 500 feet from any area in which livestock is kept.

(3) The grounds and open areas surrounding the shelters shall be maintained in a clean and sanitary condition free from rubbish, debris, waste paper, garbage, or other refuse.

(4) Whenever the camp is closed for the season or permanently, all garbage, manure, and other refuse shall be collected and so disposed of as to prevent nuisance. All abandoned privy pits shall be filled with earth and the grounds and buildings left in a clean and sanitary condition. If privy buildings remain, they shall be locked or otherwise secured to prevent entrance.

(b) *Shelter.* (1) Every shelter in the camp shall be constructed in a manner which will provide protection against the elements.

(2) Each room used for sleeping purposes shall contain at east 50 square feet of floor space for each occupant. At least a 7-foot ceiling shall be provided.

(3) Beds, cots, or bunks, and suitable storage facilities such as wall lockers for clothing and personal articles shall be provided in every room used for sleeping purposes. Such beds or similar facilities shall be spaced not closer than 36 inches both laterally and end to end, and shall be elevated at least 12 inches from the floor. If double-deck bunks are used, they shall be spaced not less than 48 inches both laterally and end to end. The minimum clear space between the lower and upper bunk shall be not less than 27 inches. Triple-deck bunks are prohibited.

(4) The floors of each shelter shall be constructed of wood, asphalt, or concrete. Wooden floors shall be of smooth and tight construction. The floors shall be kept in good repair.

(5) All wooden floors shall be elevated not less than 1 foot above the ground level at all points to prevent dampness and to permit free circulation of air beneath.

(6) Nothing in this section shall be construed to prohibit "banking" with earth or other suitable material around the outside walls in areas subject to extreme low temperatures.

(7) All living quarters shall be provided with windows the total of which shall be not less than one-tenth of the floor area. At least one-half of each window shall be so constructed that it can be opened for purposes of ventilation.

(8) All exterior openings shall be effectively screened with 16-mesh material. All screen doors shall be equipped with self-closing devices.

(9) In a room where workers cook, live, and sleep a minimum of 100 square feet per person shall be provided. Sanitary facilities shall be provided for storing and preparing food.

(10) In camps where cooking facilities are used in common, stoves (in ratio of one stove to 10 persons or one stove to two families) shall be provided in an enclosed and screened shelter. Sanitary facilities shall be provided for storing and preparing food.

(11) All heating, cooking, and water heating equipment shall be installed in accordance with State and local ordinances, codes, and regulations governing such installations. If a camp is used during cold weather, adequate heating equipment shall be provided.

(c) *Water supply.* (1) An adequate and convenient water supply, approved by the appropriate health authority, shall be provided in each camp for drinking, cooking, bathing, and laundry purposes.

(2) A water supply shall be deemed adequate if it is capable of delivering 35 gallons per person per day to the campsite at a peak rate of 2½ times the average hourly demand.

(3) The distribution lines shall be capable of supplying water at normal operating pressures to all fixtures for simultaneous operation. Water outlets shall be distributed throughout the camp in such a manner that no shelter is more than 100 feet from a yard hydrant if water is not piped to the shelters.

(4) Where water under pressure is available, one or more drinking fountains shall be provided for each 100 occupants or fraction thereof. The construction of drinking fountains shall comply with ANSI Standard Specifications for Drinking Fountains, Z4.2–1942. Common drinking cups are prohibited.

(d) *Toilet facilities.* (1) Toilet facilities adequate for the capacity of the camp shall be provided.

(2) Each toilet room shall be located so as to be accessible without any individual passing through any sleeping room. Toilet rooms shall have a window not less than 6 square feet in area opening directly to the outside area or otherwise be satisfactorily ventilated. All outside openings shall be screened with 16-mesh material. No fixture, water closet, chemical toilet, or urinal shall be located in a room used for other than toilet purposes.

(3) A toilet room shall be located within 200 feet of the door of each sleeping room. No privy shall be closer than 100 feet to any sleeping room, dining room, lunch area, or kitchen.

(4) Where the toilet rooms are shared, such as in multifamily shelters and in barracks type facilities, separate toilet rooms shall be provided for each sex. These rooms shall be distinctly marked "for men" and "for women" by signs printed in English and in the native language of the persons occupying the camp, or marked with easily understood pictures or symbols. If the facilities for each sex are in the same building, they shall be separated by solid walls or partitions extending from the floor to the roof or ceiling.

(5) Where toilet facilities are shared, the number of water closets or privy seats provided for each sex shall be based on the maximum number of persons of that sex which the camp is designed to house at any one time, in the ratio of one such unit to each 15 persons, with a minimum of two units for any shared facility.

(6) Urinals shall be provided on the basis of one unit or 2 linear feet of urinal trough for each 25 men. The floor from the wall and for a distance not less than 15 inches measured from the outward edge of the urinals shall be constructed of materials impervious to moisture. Where water under pressure is available, urinals shall be provided with an adequate water flush. Urinal troughs in privies shall drain freely into the pit or vault and the construction of this drain shall be such as to exclude flies and rodents from the pit.

(7) Every water closet installed after July 1, 1971, shall be located in a toilet room.

(8) Each toilet room shall be lighted naturally, or artificially by a safe type of lighting at all hours of the day and night.

(9) An adequate supply of toilet paper shall be provided in each privy, water closet, or chemical toilet compartment.

(10) Privies and toilet rooms shall be kept in a sanitary condition. They shall be cleaned at least daily.

(e) *Sewage disposal facilities.* In camps where public sewers are available, all sewer lines and floor drains from buildings shall be connected thereto.

(f) *Laundry, handwashing, and bathing facilities.* (1) Laundry, handwashing, and bathing facilities shall be provided in the following ratio:

(i) Handwash basin per family shelter or per six persons in shared facilities.

(ii) Shower head for every 10 persons.

(iii) Laundry tray or tub for every 30 persons.

(iv) Slop sink in each building used for laundry, hand washing, and bathing.

(2) Floors shall be of smooth finish but not slippery materials; they shall be impervious to moisture. Floor drains shall be provided in all shower baths, shower rooms, or laundry rooms to remove waste water and facilitate cleaning. All junctions of the curbing and the floor shall be coved. The walls and partitions of shower rooms shall be smooth and impervious to the height of splash.

(3) An adequate supply of hot and cold running water shall be provided for bathing and laundry purposes. Facilities for heating water shall be provided.

(4) Every service building shall be provided with equipment capable of maintaining a temperature of at least 70° F. during cold weather.

(5) Facilities for drying clothes shall be provided.

(6) All service buildings shall be kept clean.

(g) *Lighting.* Where electric service is available, each habitable room in a camp shall be provided with at least one ceiling-type light fixture and at least one separate floor-or wall-type convenience outlet. Laundry and toilet rooms and rooms where people congregate shall contain at least one ceiling- or wall-type fixture. Light levels in toilet and storage rooms shall be at least 20 foot-candles 30 inches from the floor. Other rooms, including kitchens and living quarters, shall be at least 30 foot-candles 30 inches from the floor.

(h) *Refuse disposal.* (1) Fly-tight, rodent-tight, impervious, cleanable or single service containers, approved by the appropriate health authority shall be provided for the storage of garbage. At least one such container shall be provided for each family shelter and shall be located within 100 feet of each shelter on a wooden, metal, or concrete stand.

(2) Garbage containers shall be kept clean.

(3) Garbage containers shall be emptied when full, but not less than twice a week.

(i) *Construction and operation of kitchens, dining hall, and feeding facilities.* (1) In all camps where central dining or multiple family feeding operations are permitted or provided, the food handling facilities shall comply with the requirements of the "Food Service Sanitation Ordinance and Code," Part V of the "Food Service Sanitation Manual," U.S. Public Health Service Publication 934 (1965).

(2) A properly constructed kitchen and dining hall adequate in size, separate from the sleeping quarters of any of the workers or their families, shall be provided in connection with all food handling facilities. There shall be no direct opening from living or sleeping quarters into a kitchen or dining hall.

(3) No person with any communicable disease shall be employed or permitted to work in the preparation, cooking, serving, or other handling of food, foodstuffs, or materials used therein, in any kitchen or dining room operated in connection with a camp or regularly used by persons living in a camp.

(j) *Insect and rodent control.* Effective measures shall be taken to prevent infestation by and harborage of animal or insect vectors or pests.

(k) *First aid.* (1) Adequate first aid facilities approved by a health authority shall be maintained and made available in every labor camp for the emergency treatment of injured persons.

(2) Such facilities shall be in charge of a person trained to administer first aid and shall be readily accessible for use at all times.

(l) *Reporting communicable disease.* (1) It shall be the duty of the camp superintendent to report immediately to the local health officer the name and address of any individual in the camp known to have or suspected of having a communicable disease.

(2) Whenever there shall occur in any camp a case of suspected food poisoning or an unusual prevalence of any illness in which fever, diarrhea, sore throat, vomiting, or jaundice is a prominent symptom, it shall be the duty of the camp superintendent to report immediately the existence of the outbreak to the health authority by telegram or telephone.

§ 1910.143 Nonwater carriage disposal systems.

(a) *Acceptable industrial disposal systems.* (1) The waste disposal systems described in subparagraphs (2), (3), (4), (5), (6), or (7) of this paragraph, may be used only where not prohibited by codes and regulations of local authorities, and where water closets are not feasible due either to the lack of an adequate

water supply or to the location or temporary nature of the operation requiring the facility. The number of units required for a place of employment shall be as specified in §§ 1910.141 and 1910.142.

(2) Privies constructed in conformity with paragraph (b) of this section may be used for the disposal of human excreta where their use will not contaminate ground or surface water because of privy location, type of soil, or ground-water table.

(3) Chemical toilets constructed in conformity with paragraph (c) of this section may be used in place of privies or where a privy is not permitted due to possible contamination of ground and surface water.

(4) Recirculating toilets constructed in conformity with paragraph (f) of this section may be used in place of privies or chemical toilets.

(5) Combustion toilets constructed in conformity with paragraph (e) of this section may be used in place of privies, chemical toilets, or recirculating toilets.

(6) Portable toilets constructed in conformity with paragraph (g) of this section may be used for temporary or mobile installations. Such temporary units may be:

(i) Chemical, recirculating, or combustion toilets designed for installation in or as an integral part of a skid mounted portable privy building, or in a separate toilet room, or

(ii) Portable privies designed for installation over a manhole of a sanitary or a combined waste water sewer system.

(7) A seepage pit constructed in conformity with paragraph (d) of this section may be used for the disposal of waste water from culinary activity, temporary bathing facilities, and clothes washing facilities where there is no available piped water supply. Human excreta shall not be discharged into a seepage pit. All units described in this paragraph shall comply with applicable codes and regulations of local authorities.

(b) *Privy specifications.* (1) A privy pit shall be separated by a minimum distance of 100 feet between the privy and a well, spring, or other source of water supply for drinking, bathing, or culinary purposes.

(i) At no time shall the pit bottom of a privy extend into ground water, nor shall it be constructed within 100 feet of the shoreline of any open body of water. Phreatic water, such as may be found in surface soil at depths of 10 feet or less, shall not be interpreted as ground water unless there is evidence of positive directional flow through the pit.

(ii) The privy shall be so located and so constructed that no surface water may enter into the pit either as runoff or as flood water.

(iii) The pit shall be constructed of such material and in such a manner as to prevent rapid deterioration, provide adequate capacity, and facilitate maintenance in a satisfactory manner under ordinary conditions of usage.

(iv) The pit and seat area shall be vented by a flue or vent pipe having not less than 7 square inches cross-sectional area, so as to provide a continuous escape of odors.

(v) The pit shall provide a capacity of 50 cubic feet for each seat installed in the privy building. The vault within 16 inches of the surface grade shall not be counted as part of the 50-cubic-foot capacity.

(vi) Pit cribbing shall fit firmly and be in uniform contact with the earth walls on all sides, and shall rise at least 6 inches above the original ground line and descend to the full depth of the pit. However, pit cribbing below the soil line may be omitted in rock formations.

(vii) An earth plateau shall be constructed level with the top of the pit cribbing, and extend horizontally for a distance of at least 18 inches before sloping to the original ground level.

(2) Privy building shall be firmly anchored, rigidly constructed, and free from hostile surface features, such as exposed nail points, sharp edges, rough or broken boards, etc., and shall provide privacy and protection from the elements. It shall be ventilated by leaving a 4-inch opening at the top of all the walls just beneath the roof.

(i) The building shall be of fly-tight construction, doors shall be self-closing, and vent and building openings shall be screened with 16-mesh screen of durable material. The vent shall extend 12 inches above the roof.

(ii) The seat shall be so spaced as to provide a minimum clear space of 24 inches between each seat in multiple unit installations, and shall provide 12 inches clear space from the seat opening to the side wall in single and multiple units.

(iii) The seat riser shall have an inside clearance of not less than 21 inches from the front wall and not less than 24 inches from the rear wall of the privy building.

(iv) The seat top shall be not less than 12 inches nor more than 16 inches above the floor.

(v) The seat opening shall be covered with an attached, movable toilet seat and lid, so constructed and installed that when closed it will limit access of insects, and which can be raised to allow sanitary use as a urinal.

(vi) The floor and riser shall be built of impervious material or tongue and groove lumber, and in a manner to deny access of insects.

(vii) Where electricity is available, lighting shall be provided with an intensity of not less than 10 foot-candles 30 inches above the floor.

(viii) A conveniently located receptacle or dispenser containing an adequate supply of toilet paper shall be provided for each seat in each privy building.

(c) *Chemical toilet specifications.* (1) Rooms, buildings, or shelters housing chemical toilets shall be of sound construction and easy to clean, and shall provide shelter and privacy. The toilet rooms shall be ventilated to the outside and adequately lighted, and all openings into the toilet room shall be covered with 16-mesh screen. The minimum requirements given in subparagraphs (2) through (7) of this paragraph shal apply.

(2) Caustic receptacles shall be durable and corrosion proof, and provide a minimum capacity of 100 gallons per seat.

(3) The caustic receptacle charge per seat shall be a minimum of 25 pounds of caustic dissolved in 10 gallons of water.

(4) The chemical shall be drained and receptacle recharged every 6 months of continuous use, or at the beginning of each season of operation when in intermittent use, or when three-fourths full, whichever occurs first.

(5) Each seat in the building shall be provided with a conveniently located agitator.

(6) Receptacles shall be vented as prescribed in paragraph (b)(1)(iv) of this section.

(7) The receptacle shall be equipped with a manhole external to the privy building for cleaning and caustic removal purposes. The manhole shall be covered so as to prevent the escape of gases and odors.

(d) *Seepage pit construction.* (1) Seepage pit construction shall conform with requirements for privy pit construction in paragraph (b)(1)(i), (ii), (iii), (vi) and (vii) of this section. The seepage pit may be filled with stone or rubble of not less than nominal 1 inch diameter.

(2) Seepage pits shall be of such dimensions as to provide side wall area equal to at least 10 square feet per person served by the facility, or such greater area as may be required by the health agency having jurisdiction.

(3) Temporary piping connections from sinks or shower platforms may be discharged beneath the floor if they have traps in accordance with the provisions of American National Standard National Plumbing Code, A 40.8–1955.

(4) The platform covering the seepage pits shall be built of impervious material and in a manner to exclude insects.

(5) The platform shall be provided with an opening at least 1 foot in each dimension and have a rim at least 1 inch above the floor to prevent precipitation from accumulating on the platform floor.

(6) The platform opening shall be covered with a self-closing lid, so constructed that it can be easily opened by foot or hand, and so installed that when closed it will exclude insects and fit closely over the raised rim of the opening.

(e) *Combustion toilet.* (1) Combustion toilets and combustion toilet buildings, rooms, or shelters shall conform to the applicable specifications given for chemical toilets in paragraph (c) of this section.

(2) All external surfaces, including bowl and hopper, shall be easy to clean.

(3) The residue must be sterile and inert.

(4) The flue effluents must be free of bacteria.

(5) The combustion system and all fuel and electrical parts shall be safe

and in compliance with applicable gas and electrical codes of local authorities. Where such codes do not exist, the installations shall comply with the American National Standard National Electrical Code, C1–1968 (NFPA No. 70–1968).

(f) *Recirculating toilet specifications.* (1) Recirculating toilet buildings, rooms, or shelters shall conform to the applicable specifications given for chemical toilets in paragraph (c) of this section.

(2) All materials, bowl, piping, and fittings shall be corrosion resistant.

(3) Waste passages shall have smooth surfaces and be free of obstructions, recesses, or chambers that would permit fouling.

(4) Flushing shall be accomplished by a single control so arranged as to be operated without special knowledge or effort.

(5) Recirculating toilets shall conform to "Self-Contained, Electrically Operated Recirculating, Chemically Controlled Toilet." International Association of Plumbing and Mechanical Officials Trailer Standard TSC 12–65.

(6) The unit shall be maintained and cleaned; and water, filter, and odor-controlling chemical shall be replaced in accordance with the instructions of the manufacturer.

(g) *Portable toilet construction.* (1) A portable toilet may comprise the seat and its treatment unit to be installed in a structure, or it may comprise an entire prefabricated, skid mounted, or otherwise portable structure containing a seat or treatment units with seat.

(2) No pit, tank, or other subsurface structure shall be construed as part of a portable toilet.

(i) Portable privies must be installed over a pit conforming to paragraph (b) (1) of this section, or a manhole that is part of a sanitary or combined waste water disposal system.

(ii) No portable toilet shall discharge into a storm sewer.

(3) A portable building shall be rigidly constructed, ventilated by a screened opening or a vent having a cross-sectional area of at least 1 square foot per seat, and equipped with a floor, riser, and seat meeting the requirements of paragraph (b) (2) of this section or an equivalent individual stool and seat in prefabricated metal, fiber glass, plastic, or ceramic material.

(i) The structure shall provide privacy and protection from the elements.

(ii) An airtight seal shall be provided between the structure base and any pit, receptacle, or manhole over which it is placed.

(iii) Ventilation of the pit, receptacle, or manhole shall conform to paragraph (b) (1) (iv) of this section.

(4) A portable toilet shall be provided with facilities, requisite to its construction, for the removal of chemicals, ash, or residue. All surfaces subject to soiling shall be readily accessible and easily cleaned.

§ 1910.144 Safety color code for marking physical hazards.

(a) *Color identification*—(1) *Red.* Red shall be the basic color for the identification of:

(i) *Fire protection equipment and apparatus.* (*a*) Fire alarm boxes (pull boxes).

(*b*) Fire blanket boxes.

(*c*) Fire buckets or pails.

(*d*) Fire exit signs.

(*e*) Fire extinguishers (if painting the extinguisher is impractical or undesirable, color should be used on the housing, wall, or support to identify the location).

(*f*) Fire hose locations (color should be used on the reel, supports, or housing but not on the hose).

(*g*) Fire hydrants (industrial).

(*h*) Fire pumps.

(*i*) Fire sirens.

(*j*) Post indicator valves for sprinkler system (it is suggested that if a traffic hazard is involved, the top should be colored red, and the barrel or post yellow and black stripes).

(*k*) Sprinkler piping. (See ANSI Standard Scheme for the Identification of Piping Systems, A13.1–1956.)

(ii) *Danger.* Safety cans or other portable containers of flammable liquids having a flashpoint at or below 80° F. table containers of flammable liquids (open cup tester), excluding shipping containers, shall be painted red with some additional clearly visible identification either in the form of a yellow band around the can or the name of the contents conspicuously stenciled or painted on the can in yellow. Red lights shall be provided at barricades and at temporary obstructions, as specified in ANSI Safety Code for Building Construction, A10.2–1944. Danger signs shall be painted red.

(iii) *Stop.* Emergency stop bars on hazardous machines such as rubber mills, wire blocks, flat work ironers, etc., shall be red. Stop buttons or electrical switches used for emergency stopping of machinery shall be red.

(2) *Orange.* Orange shall be used as the basic color for designating dangerous parts of machines or energized equipment which may cut, crush, shock, or otherwise injure and to emphasize such hazards when enclosure doors are open or when gear belt, or other guards around moving equipment are open or removed, exposing unguarded hazards.

(3) *Yellow.* Yellow shall be the basic color for designating caution and for marking physical hazards such as: Striking against, stumbling, falling, tripping, and "caught in between." Solid yellow, yellow and black stripes, yellow and black checkers (or yellow with suitable contrasting background) should be used interchangeably, using the combination which will attract the most attention in the particular environment.

(4) *Green.* Green shall be used as the basic color for designating "Safety" and the location of first aid equipment (other than firefighting equipment).

(5) *Blue.* Blue shall be the basic color for designating caution, limited to warning against the starting, the use of, or the movement of equipment under repair or being worked upon.

(6) *Purple.* Purple shall be the basic color for designating radiation hazards. "Radiation" as used in this subparagraph refers to radiation types such as X-ray, alpha, beta, gamma, neutron, proton, deutron, and meson. Yellow should be used in combination with purple for markers such as tags, labels, signs, and floor markers.

(7) *Black, white, or combinations of black and white.* Black, white, or a combination of these two, shall be the basic colors for the designation of traffic and housekeeping markings. Solid white, solid black, single color striping, alternate stripes of black and white, or black and white checkers should be used in accordance with local conditions.

(b) *Color specifications.* Colors shall meet the tests specified in section 3, Color Definitions, of ANSI Z53.1–1967, Safety Color Code for Marking Physical Hazards.

§ 1910.145 Specifications for accident prevention signs and tags.

(a) *Scope.* (1) These specifications apply to the design, application, and use of signs or symbols (as included in paragraphs (c) through (e) of this section) intended to indicate and, insofar as possible, to define specific hazards of a nature such that failure to designate them may lead to accidental injury to workers or the public, or both, or to property damage. These specifications are intended to cover all safety signs except those designed for streets, highways, railroads, and marine regulations. These specifications do not apply to plant bulletin boards or to safety posters.

(2) All new signs and replacements of old signs after July 1, 1971, shall be in accordance with these specifications.

(b) *Definitions.* As used in this section, the word "sign" refers to a surface on which letters or other markings appear, prepared for the warning of, or safety instructions of, industrial workers or members of the public who may be exposed to hazards. Excluded from this definition, however, are news releases, displays commonly known as safety posters, and bulletins used for employee education.

(c) *Classification of signs according to use*—(1) *Danger signs.* (i) Danger signs should be used only where an immediate hazard exists. There shall be no variation in the type of design of signs posted to warn of specific dangers and radiation hazards.

(ii) All employees shall be instructed that danger signs indicate immediate danger and that special precautions are necessary.

(2) *Caution signs.* (i) Caution signs shall be used only to warn against potential hazards or to caution against unsafe practices.

(ii) All employees shall be instructed that caution signs indicate a possible hazard against which proper precaution should be taken.

(3) *Safety instruction signs.* Safety instruction signs shall be used where there is a need for general instructions and suggestions relative to safety measures.

(d) *Sign design and colors*—(1) *Design features.* The colors, proportions, and location of the identification panels on each sign shall be in accordance with

this paragraph. All signs shall be furnished with rounded or blunt corners and shall be free from sharp edges, burrs, splinters, or other sharp projections. The ends or heads of bolts or other fastening devices shall be located in such a way that they do not constitute a hazard. When conditions warrant the use of a sign size not covered in the following tables, the ratio of the depth of the identifying panel (Danger, Caution, etc.) to the width of the sign shall be as established in Tables J–1 to J–4.

(2) *Danger signs.* (i) The colors red, black, and white shall be those of opaque glossy samples as specified in Table 1 of Fundamental Specification of Safety Colors for CIE Standard Source "C", American National Standard Z53.1–1967.

(ii) Standard Proportions shall be as indicated in Table J–1, and format shall be as in Fig. J–1.

Fig. J-1
Danger Sign

TABLE J-1—STANDARD PROPORTIONS FOR DANGER SIGNS

Sign size, inches Height	Width	Black rectangular panel, inches Height	Width	Red oval, inches Height	Width	Word danger, height inches	Maximum space available for sign wording, inches
			HORIZONTAL PATTERN				
7	10	3¼	9⅝	2⅞	8½	1 7/16	2¾ x 9¾
10	14	4⅝	13⅜	4⅛	11⅞	2 1/16	4¼ x 13⅜
14	20	6½	19¼	5¾	17	2⅞	6¼ x 19¼
20	28	9¼	27⅜	8¼	23⅞	4⅛	9½ x 27¾
			UPRIGHT PATTERN				
10	7	2⅜	6¾	2⅛	5⅞	1 1/16	6¾ x 6¾
14	10	3¼	9⅝	2⅞	8½	1 7/16	9½ x 9⅝
20	14	4⅝	13⅜	4⅛	11⅞	2 1/16	14 x 13⅜
28	20	6½	19⅜	5¾	17	2⅞	20¾ x 19⅜

(3) *Radiation warning signs.* (i) Standard color of the background shall be yellow; the panel, reddish purple with yellow letters; the symbol, reddish purple; any letters used against the yellow background shall be black. The colors shall be those of opaque glossy samples as specified in Table 1 of American National Standard, Z53.1–1967.

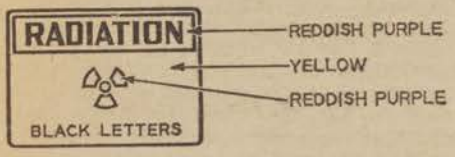

Fig.J-2
Radiation Warning Sign

(ii) The standard symbol shall be as in Figure J–3. Method of dimensioning, design, and orientation of the standard symbol (one blade pointed downward and centered on the vertical axis) shall be executed as illustrated. The symbol shall be prominently displayed, and of a size consistent with the size of the equipment or material or area to which it is attached.

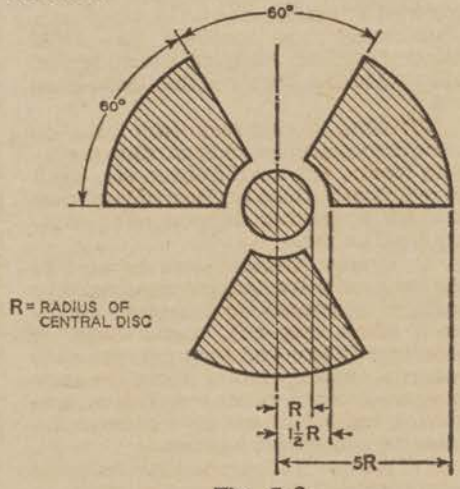

Fig. J-3
Standard Radiation Symbol

(iii) Format shall be as in Figure J–2. Sign proportions shall be the same as those for danger signs in Table J–1.

(4) *Caution signs.* (i) Standard color of the background shall be yellow; and the panel, black with yellow letters. Any letters used against the yellow background shall be black. The colors shall be those of opaque glossy samples as specified in Table 1 of American National Standard Z53.1–1967.

(ii) Standard proportions shall be as indicated in Table J–2, and format shall be as in Figure J–4.

Fig. J-4
Caution Sign

TABLE J-2—STANDARD PROPORTIONS FOR CAUTION SIGNS

Sign size inches height	width	Black rectangular panel, inches height	width	Word "Caution" height of letter, inches	Maximum space available for sign wording below panel inches height	width
			HORIZONTAL PATTERN			
7	10	2¼	9⅝	1⅝	3¼	9⅝
10	14	3¼	13⅜	2¼	5½	13⅜
14	20	3¾	19⅜	2¾	9	19⅜
20	28	4¼	27⅜	3¼	14½	27⅜
			UPRIGHT PATTERN			
10	7	1⅝	6¾	1⅛	7	6¾
14	10	2¼	9⅝	1⅝	10½	9⅝
20	14	3¼	13⅜	2¼	15½	13⅜
28	20	3¾	19⅜	2¾	24	19¼

(5) *Exit signs.* Exit signs shall be in accordance with § 1910.37(q).

(6) *Safety instruction signs.* (i) Standard color of the background shall be white; and the panel, green with white letters. Any letters used against the white background shall be black. The colors shall be those of opaque glossy samples as specified in Table 1 of American National Standard, Z53.1–1967.

(ii) Standard proportions shall be as indicated in Table J–3, and format shall be as in Figure J–5.

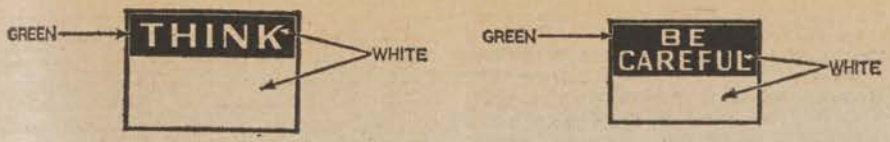

(NOTE: The words "Think" and "Be Careful," given here, are only illustrations. Other wordings may be used.)

Fig. J-5
Safety Instruction Signs

TABLE J-3—STANDARD PROPORTIONS FOR SAFETY INSTRUCTION SIGNS

Sign size, inches, height, width	Green rectangular panel, inches, height, width	Word "Think" height of letters, inches	Maximum space available for sign wording below panel, inches height, width	Sign size, inches height, width	Green panel, inches, height, width	Word "Be" height of letters, inches	Word "Careful" height of letters, inches	Maximum space available for sign wording below panel, inches, height, width
7 x 10	2¾ x 9⅜	1⅝	3½ x 9⅜	7 x 10	3⅜ x 9⅜	1¼	1 3/16	2½ x 9⅜
10 x 14	3¼ x 13⅜	2¼	5½ x 13⅜	10 x 14	4¼ x 13⅜	1¾	2 3/16	4 x 13⅜
14 x 20	3¾ x 19⅜	2⅝	9 x 19⅜	14 x 20	6¼ x 19⅜	2½	3⅛	6 x 19⅜
20 x 28	4¼ x 27⅜	3¼	14½ x 27⅜	20 x 28	9½ x 27⅜	3½	4⅜	9¼ x 27⅜

(7) *Directional signs.* (i) Standard color of the background shall be white; and the panel, black with white directional symbol. Any letters used against the white background shall be black. The colors shall be those of opaque glossy samples as specified in Table 1 of American National Standard Z53.1–1967.

(ii) Standard proportions shall be as indicated in Table J–4, and format shall be as in Figure J–6.

Fig. J-6
Directional Signs

Table J–4—Standard Proportions for Directional Signs

Sign size, inches height width	Black rectangular panel, inches height width	White arrow, inches				Maximum space for sign wording below panel height
		Overall length	Arrow head height width	Arrow shaft height	Arrow tail height width	
6½ x 14	3¼ x 13⅜	12⅝	2¾ x 3	1⅛	2⅜ x 3¼	2¼ x 13⅜
9 x 20	4½ x 19⅜	18⅜	3¾ x 4½	1⅝	3¼ x 4½	3⅜ x 19⅜
12 x 28	6 x 27⅜	26⅜	5⅛ x 5⅝	2⅛	4⅜ x 6	4⅜ x 27⅜
15 x 36	7½ x 35⅝	34⅝	6⅜ x 6⅞	2⅝	5½ x 7½	6¼ x 35⅝

(8) *In-Plant traffic signs.* Regulatory and control signs required for the safe movement of vehicles and pedestrians on thoroughfares on plant property shall conform to the standards established in American National Standard Manual on Uniform Traffic Control Devices for Streets and Highways, D6.1–1961.

(9) *Informational signs.* Blue shall be the standard color for informational signs. It may be used as the background color for the complete sign or as a panel at the top of such types of "Notice" signs, which have a white background. The colors shall be those of opaque glossy samples as specified in Table 1 of American National Standard Z53.1–1967.

(10) *Slow-moving vehicle emblem.* This emblem (see Fig. J–7) consists of a fluorescent yellow-orange triangle with a dark red reflective border. The yellow-orange fluorescent triangle is a highly visible color for daylight exposure. The reflective border defines the shape of the fluorescent color in daylight and creates a hollow red triangle in the path of motor vehicle headlights at night. The emblem is intended as a unique identification for, and it shall be used only on, vehicles which by design move slowly (25 m.p.h. or less) on the public roads. The emblem is not a clearance marker for wide machinery nor is it intended to replace required lighting or marking of slow-moving vehicles. Neither the color film pattern and its dimensions nor the backing shall be altered to permit use of advertising or other markings. The material, location, mounting, etc., of the emblem shall be in accordance with the American Society of Agricultural Engineers Emblem for Identifying Slow-Moving Vehicles, ASAE R276, 1967.

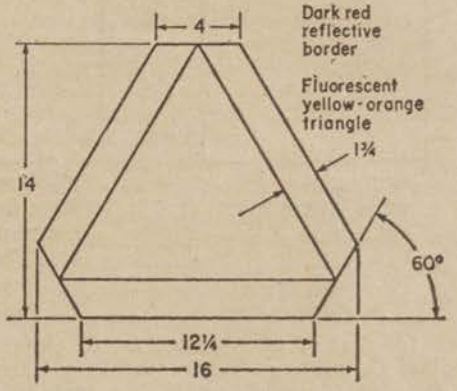

NOTE: All dimensions are in inches.

Fig. J-7
Slow-Moving Vehicle Emblem

(11) *Symbols.* Symbols used on signs shall follow recognized practices, such as in Figure J–8. For radioactive materials, see symbol in Figure J–3.

POISON:

ELECTRICITY:

Fig. J-8
Symbols Used on Signs

(e) *Sign wordings*—(1) *Examples of wordings.* The lists in subparagraphs (3) through (7) of this paragraph are intended to serve as a guide for choosing the correct sign design for the message to be displayed.

(2) *Nature of wording.* The wording of any sign should be easily read and concise. The sign should contain sufficient information to be easily understood. The wording should make a positive, rather than negative suggestion and should be accurate in fact.

(3) *Danger signs.*

Danger—Keep Off, Electric Current.
Danger—No Smoking, Matches, or Open Lights.
Danger—Men Working Above.
Danger—Not Room Enough Here to Clear Men on Cars.
Danger—Keep Away.
Danger—Men in Boiler.
Danger—Insufficient Clearance.
Danger—2,300 Volts.
Danger—Keep Out.
Danger—Crane Overhead.
Danger—Keep Off.

(4) *Biological hazard signs.* The biological hazard warning shall be used to signify the actual or potential presence of a biohazard and to identify equipment, containers, rooms, materials, experimental animals, or combinations thereof, which contain, or are contaminated with, viable hazardous agents. For the purpose of this subparagraph the term "biological hazard," or "biohazard," shall include only those infectious agents presenting a risk or potential risk to the well-being of man. The biohazard symbol shall be designed and proportioned as illustrated in figure J–9.

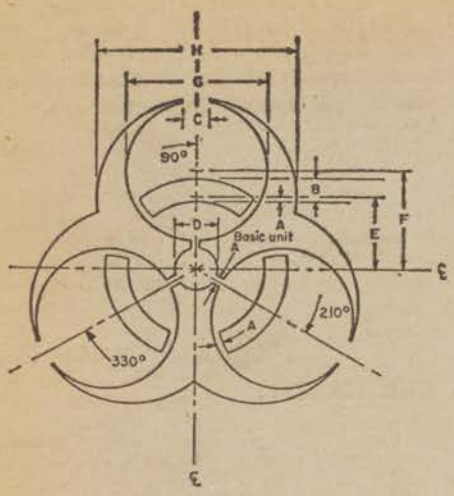

Dimension	A	B	C	D	E	F	G	H
Units	1	3½	4	6	11	15	21	30

Fig. J-9
Symbol for Biological Hazard

The symbol design shall be a fluorescent orange or orange-red color. Background color is optional as long as there is sufficient contrast for the symbol to be clearly defined. Appropriate wording may be used in association with the symbol to indicate the nature or identity of the hazard, name of individual responsible for its control, precautionary information, etc., but never should this information be superimposed on the symbol.

(5) *Caution signs.*

Caution—Do Not operate, Men Working on Repairs.
Caution—Hands Off Switch, Men Working on Line.
Caution—Working on Machines, Do Not Start.
Caution—Goggles Must Be Worn When Operating This Machine.
Caution—This Door Must Be Kept Closed.
Caution—Electric Trucks, Go Slow.
Caution—This Space Must Be Kept Clear at All Times.
Caution—Stop Machinery to Clean, Oil, or Repair.
Caution—Keep Aisles Clear.
Caution—Operators of This Machine Shall Wear Snug Fitting Clothing—No Gloves.
Caution—Close Clearance.
Caution—Watch Your Step.
Caution—Electric Fence.

(6) *Safety instruction signs.*

Report All Injuries to the First-Aid Room at Once.
Walk—Don't Run.
Report All Injuries No Matter How Slight.
Think, If Safe Go Ahead.
Make Your Work Place Safe Before Starting the Job.
Report All Unsafe Conditions to Your Foreman.
Help Keep This Plant Safe and Clean.

(7) *Directional signs.*

This Way Out (below arrow panel).
This Way (inside arrow) Out (below arrow panel).
Fire Exit (below arrow panel).
Fire (inside arrow) Extinguisher (below arrow panel).
To the (inside arrow) Fire Escape (below arrow panel).
To the (inside arrow) First Aid (below arrow panel).
Manway (below arrow panel).
This Way to (inside arrow) First-Aid Room (below arrow panel).

(8) *Informational signs.*

No Trespassing Under Penalty of the Law.
This Elevator Is for Freight Only, Not for Passengers.
No Admittance Except to Employees on Duty.
No Admittance.
No Admittance, Apply at Office.
No Trespassing.
Men.
Women.
For Employees Only.
Office.

NOTE: When sign wordings such as those listed in this section are contemplated, care should be taken to be sure that they are suitable for the particular location at which the sign is to be placed and that wording meets the requirements of the intended purpose. When there is a reasonable doubt, a sign of a standard design should be used.

(f) *Accident prevention tags*—(1) *Scope and purpose.* (i) The tags are a temporary means of warning all concerned of a hazardous condition, defective equipment, radiation hazards, etc. The tags are not to be considered as a complete warning method, but should be used until a positive means can be employed to eliminate the hazard; for example, a "Do Not Start" tag on power equipment shall be used for a few moments or a very short time until the switch in the system can be locked out; a "Defective Equipment" tag shall be placed on a damaged ladder and immediate arrangements made for the ladder to be taken out of service and sent to the repair shop.

(ii) The purpose of this paragraph is to establish a set of specifications for tags based on experience and previous use. The tags are to be used in industry, mercantile establishments, or wherever such tags can be utilized to help prevent accidental injury to personnel or damage to property, or both.

(2) *Definitions.* The word "tag" as used in this paragraph refers to a surface (usually card, paper, pasteboard, or some temporary or nonpermanent material) on which letters or markings, or both, appear. These letters or markings, or both, are for warning (cautioning) or safety instruction of employees who may be exposed to hazards. They are to be affixed to the device in question by string, wire, or adhesive.

(3) *Do not start tags.* (i) The standard background color for Do Not Start tags shall be red. (See Fig. J–10.)

(ii) Letters shall be white or grey or etched, provided that a long lasting and sharp contrast results.

(iii) Do Not Star tags shall be placed in a conspicuous location or shall be placed in such a manner that they effectively block the starting mechanism which would cause hazardous conditions should the equipment be energized.

(4) *Danger tags.* (i) Danger tags should be used only where an immediate hazard exists. There should be no variation in the type of design of tags posted or hung to warn of specific dangers. (See Fig. J–11.)

(ii) All employees should be instructed that Danger tags indicate immediate danger and that special precautions are necessary.

(5) *Caution tags.* (i) Caution tags should be used only to warn against potential hazards or to caution against unsafe practices. (See Fig. J–12.)

(ii) All employees should be instructed that Caution tags indicate a possible hazard against which proper precautions should be taken.

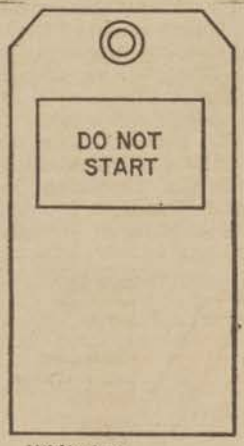

White tag
white letters on
red square

Fig. J-10
Do Not Start Tag

White tag
white letters on
red oval with a
black square

Fig. J-11
Danger Tag

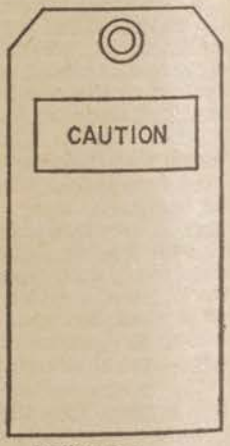

Yellow tag
yellow letters on a
black background

Fig. J-12
Caution Tag

(6) *Out of order tags.* Out of Order tags should be used only for the specific purpose of indicating that a piece of equipment, machinery, etc., is out of order and to attempt to use it might present a hazard. (See Fig. J–13.)

(7) *Radiation tags.* (i) The standard background for Radiation tags shall be yellow; the panel shall be reddish purple. Any letters used against the yellow background shall be black. The colors shall be those of opaque glossy samples as

specified in Table 1, Fundamental Specification of Safety Colors for CIE Standard Source "C" American National Standard Safety Color Code for Marking Physical Hazards and the Identification of Certain Equipment, Z53.1–1967.

(ii) The method of dimension, design, and orientation of the standard symbol (one blade pointed downward and centered on the vertical axis) shall be executed as illustrated in Figure J–14. The symbol shall be prominently displayed and of a size consistent with the size of the equipment or area in which it is to be used.

(8) *Biological hazard tags.* (i) The standard background color for the Biological Hazard symbol is optional as long as there is sufficient contrast for the symbol to be clearly defined. The symbol design (see Fig. J–15) shall be a fluorescent orange or orange-red color.

(ii) The biological Hazard tag shall be used to signify the actual or potential presence of a biohazard, to identify equipment, containers, rooms, materials, experimental animals, or combinations thereof, which contain or are contaminated with viable hazardous agents.

(iii) For the purpose of this subparagraph the term "biological hazard" shall include only those infectious agents presenting a risk or potential risk to the well-being of man.

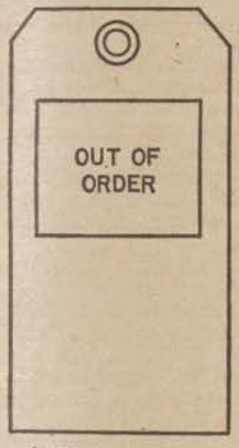

White tag
white letters on
black background

Fig. J-13
Out of Order Tag

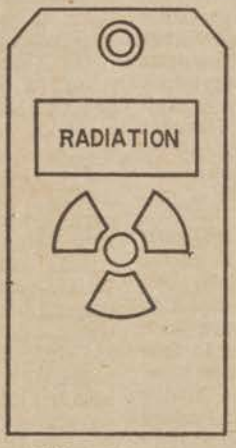

Yellow tag
yellow letters in
reddish-purple panel
(Added wording in black
on yellow background)

Fig. J-14
Radiation Tag

White tag
black letters on
fluorescent-orange
background and
symbol

Fig. J-15
Biological Hazard Tag

§ 1910.147 Sources of standards.

The standards in this Subpart J are derived from the following sources:

Sec.	Source
1910.141	ANSI Z4.1–1968, Minimum Requirements for Sanitation in Places of Employment.
1910.142	ANSI Z4.4–1968, Minimum Requirements for Sanitation in Temporary Labor Camps.
1910.143	ANSI Z4.3–1970, Minimum Requirements for Non-Water Carriage Disposal Systems.
1910.144	ANSI Z53.1–1967, Safety Color Code for Marking Physical Hazards.
1910.145 (a)–(e).	ANSI Z35.1–1968, Specifications for Accident Prevention signs.
1910.145(f)	ANSI Z35.2–1968, Specifications for Accident Prevention Tags.

§ 1910.148 Standards organizations.

Standards and specifications of the following organizations have been referenced in this Subpart J:

American National Standards Institute, 1430 Broadway, New York, NY 10018.

National Association of Plumbing and Mechanical Officials, 5032 Alhambra Avenue, Los Angeles, CA 90032.

American Society of Agricultural Engineers, 2950 Niles Road, Post Office Box 229, St. Joseph, MO 49085.

Subpart K—Medical and First Aid

§ 1910.151 Medical services and first aid.

(a) Employer shall insure the ready availability of medical personnel for advice and consultation on matters of plant health.

(b) In the absence of an infirmary, clinic, or hospital in near proximity to the workplace which is used for the treatment of all injured employees, a person or persons shall be adequately trained to render first aid. First aid supplies approved by the consulting physician shall be readily available.

(c) Where the eyes or body of any person may be exposed to injurious corrosive materials, suitable facilities for quick drenching or flushing of the eyes and body shall be provided within the work area for immediate emergency use.

§ 1910.152 [Reserved]

§ 1910.153 Sources of standards.

The standard in § 1910.151 is derived from 41 CFR 50–204.6.

Subpart L—Fire Protection

§ 1910.156 Definitions applicable to this subpart.

(a) "Class A fires" are fires in ordinary combustible materials, such as wood, cloth, paper, and rubber.

(b) "Class B fires" are fires in flammable liquids, gases, and greases.

(c) "Class C fires" are fires which involve energized electrical equipment where the electrical nonconductivity of the extinguishing media is of importance. (When electrical equipment is deenergized, extinguishers for Class A or B fires may be used safely.)

(d) "Class D fires" are fires in combustible metals, such as magnesium, titanium, zirconium, sodium, and potassium.

(e) Classification of portable fire extinguishers: "Portable fire extinguishers" are classified for use on certain classes of fires and rated for relative extinguishing effectiveness at a temperature of plus 70° F. by nationally recognized testing laboratories. This is based upon the preceding classification of fires and the fire extinguishment potentials as determined by fire tests.

NOTE: The classification and rating system described in this section is that used by Underwriters' Laboratories, Inc. and Underwriters Laboratories of Canada and is based on extinguishing preplanned fires of determined size and description as follows:

(i) Class A rating—Wood and excelsior fires excluding deep-seated conditions.

(ii) Class B rating—Two-inch depth gasoline fires in square pans.

(iii) Class C rating—No fire test. Agent must be a nonconductor of electricity.

(iv) Class D rating—Special tests on specific combustible metal fires.

(f) A "light hazard" is a situation where the amount of combustibles or flammable liquids present is such that fires of small size may be expected. These may include offices, schoolrooms, churches, assembly halls, telephone exchanges, etc.

(g) An "ordinary hazard" is a situation where the amount of combustibles or flammable liquids present is such that fires of moderate size may be expected. These may include mercantile storage and display, auto showrooms, parking garages, light manufacturing, warehouses not classified as extra hazard, school shop areas, etc.

(h) An "extra hazard" is a situation where the amount of combustibles or flammable liquids present is such that fires of severe magnitude may be expected. These may include woodworking, auto repair, aircraft servicing, warehouses with high-piled (14 feet or higher) combustibles, and processes such as flammable liquid handling, painting, dipping, etc.

(i) Sprinkler system: A "sprinkler system," for fire protection purposes, is an integrated system of underground and overhead piping designed in accordance with fire protection engineering standards. The system includes a suitable water supply, such as a gravity tank, fire pump, reservoir, or pressure tank and/or connection by underground piping to a city main. The portion of the

sprinkler system above ground is a network of specially sized or hydraulically designed piping installed in a building, structure or area, generally overhead, and to which sprinklers are connected in a systematic pattern. The system includes a controlling valve and a device for actuating an alarm when the system is in operation. The system is usually activated by heat from a fire and discharges water over the fire area.

NOTE: The design and installation of water supply facilities such as gravity tanks, fire pumps, reservoirs, or pressure tanks, and underground piping are covered by NFPA Standards No. 22–1970, Water Tanks For Private Fire Protection; No. 20–1970, Installation of Centrifugal Fire Pumps and No. 24–1970, Outside Protection.

(j) Sprinkler alarms: A "sprinkler alarm" unit is an assembly of apparatus approved for the service and so constructed and installed that any flow of water from a sprinkler system equal to or greater than that from a single automatic sprinkler will result in an audible alarm signal on the premises.

(k) Class of service—standpipe systems: "Standpipe systems" are grouped into three general classes of service for the intended use in the extinguishment of fire.

(1) Class I: For use by fire departments and those trained in handling heavy fire streams (2½-inch hose).

(2) Class II: For use primarily by the building occupants until the arrival of the fire department (small hose).

(3) Class III: For use by either fire departments and those trained in handling heavy hose streams or by the building occupants.

(l) Class I service: "Class I service" is a standpipe system capable of furnishing the effective fire streams required during the more advanced stages of fire on the inside of buildings or for exposure fire.

(m) Class II service: "Class II service" is a standpipe system which affords a ready means for the control of incipient fires by the occupants of buildings during the nighttime and holidays.

(n) Class III service: "Class III service" is a standpipe system capable of furnishing the effective fire streams required during the more advanced stages of fire on the inside of buildings as well as providing a ready means for the control of fires by the occupants of the building.

(o) Standpipe systems: "Standpipe systems" are usually of the following types:

(1) A wet standpipe system having a supply valve open and water pressure maintained at all times.

(2) A standpipe system so arranged through the use of approved devices as to admit water to the system automatically by opening a hose valve.

(3) A standpipe system arranged to admit water to the system through manual operation of approved remote control devices located at each hose station.

(4) Dry standpipe having no permanent water supply.

See also paragraph (k) of this section.

(p) Type I storage: "Type I storage" is that in which combustible commodities or noncombustible commodities involving combustible packaging or storage aids are stored not over 15 feet high in solid piles or not over 12 feet high in piles that contain horizontal channels. Minor quantities of commodities of hazard greater than ordinary combustibles may be included without affecting this general classification.

(q) Type II storage: "Type II storage" is that in which the stored commodities, packaging, and storage aids are noncombustible or contain only a small concentration of combustibles which are incapable of producing a fire that would cause appreciable damage to the commodities stored or to noncombustible wall, floor or roof construction. Ordinary combustible commodities in completely sealed noncombustible containers may qualify in this classification. General commodity storage that is subject to frequent changing and storage of combustible packaging and storage aids is excluded from this category.

(r) Type I storage: "Type I storage" is that in which combustible commodities or noncombustible commodities involving combustible packaging or storage aids are stored over 15 feet but not more than 21 feet high in solid piles or over 12 feet but not more than 21 feet high in piles that contain horizontal channels. Minor quantities of commodities of hazard greater than ordinary combustibles may be included without affecting this general classification.

(s) "Approved": "Approved" means listed or approved by: (1) At least one of the following nationally recognized testing laboratories: Factory Mutual Engineering Corp.; Underwriters' Laboratories, Inc., or (ii) Federal agencies such as Bureau of Mines, Department of the Interior: Department of Transportation; or U.S. Coast Guard, which issue approvals for such equipment.

PORTABLE FIRE SUPPRESSION EQUIPMENT

§ 1910.157 Portable fire extinguishers.

(a) *General requirements*—(1) *Operable condition.* Portable extinguishers shall be maintained in a fully charged and operable condition, and kept in their designated places at all times when they are not being used.

(2) *Location.* Extinguishers shall be conspicuously located where they will be readily accessible and immediately available in the event of fire. They shall be located along normal paths of travel.

(3) *Marking of location.* Extinguishers shall not be obstructed or obscured from view. In large rooms, and in certain locations where visual obstruction cannot be completely avoided, means shall be provided to indicate the location and intended use of extinguishers conspicuously.

(4) *Marking of extinguishers.* If extinguishers intended for different classes of fire are grouped, their intended use shall be marked conspicuously to insure choice of the proper extinguisher at the time of a fire.

(5) *Mounting of Extinguishers.* Extinguishers shall be installed on the hangers or in the brackets supplied, mounted in cabinets, or set on shelves unless the extinguishers are of the wheeled type.

(6) *Height of mounting.* Extinguishers having a gross weight not exceeding 40 pounds shall be installed so that the top of the extinguisher is not more than 5 feet above the floor. Extinguishers having a gross weight greater than 40 pounds (except wheeled types) shall be so installed that the top of the extinguisher is not more than 3½ feet above the floor.

(7) *Cabinet mounting.* Extinguisher mounted in cabinets or wall recesses or set on shelves shall be placed in a manner such that the extinguisher operating instructions face outward. The location of such extinguishers shall be marked conspicuously.

(8) *Vibrating locations.* Extinguishers installed under conditions where they are subject to severe vibration shall be installed in brackets specifically designed to cope with this vibration.

(9) *Temperature range.* Extinguishers shall be suitable for use within a temperature range of at least plus 40° to 120° Fahrenheit.

(10) *Extreme temperature exposure.* When extinguishers are installed in locations subjected to temperatures outside the range prescribed in this § 1910.157 (a)(10), they shall be of a type approved or listed for the temperature to which they will be exposed, or placed in an enclosure capable of maintaining the temperature within the range prescribed in this § 1910.157(a)(10).

(b) *Selection of extinguishers*—(1) *General.* The selection of extinguishers for a given situation will depend upon the character of the fires anticipated, the construction and occupancy of the individual property, the vehicle or hazard to be protected, ambient-temperature conditions, and other factors. The number of extinguishers required shall be determined by reference to paragraph (c) of this section.

(2) *Selection by hazard.* (i) Extinguishers shall be selected for the specific class or classes of hazards to be protected in accordance with the following paragraphs.

(ii) Extinguishers for protecting Class A hazards shall be selected from among the following: foam, loaded stream, multipurpose dry chemical, and water types. Certain smaller extinguishers which are charged with multipurpose dry chemical are rated on Class B and Class C fires, but have insufficient effectiveness to earn the minimum 1–A rating even though they have value in extinguishing smaller Class A fires.

Such smaller extinguishers shall not be used to meet the requirements of paragraph (c)(2)(i) of this section.

(iii) Extinguishers for protection of Class B hazards shall be selected from the following: Bromotrifluoromethane, carbon dioxide, dry chemical, foam, loaded stream, and multipurpose dry chemical. Extinguishers with ratings less than 1–B shall not be considered in determining suitability.

(iv) Extinguishers for protection of Class C hazards shall be selected from the

following: bromotrifluoromethane, carbon dioxide, dry chemical, and multipurpose dry chemical.

NOTE: Carbon dioxide extinguishers equipped with metal horns are not considered safe for use on fires in energized electrical equipment and, therefore, are not classified for use on Class C hazards.

(v) Extinguishers and extinguishing agents for the protection of Class D hazards shall be of types approved for use on the specific combustible-metal hazard.

(c) *Distribution of portable fire extinguishers*—(1) *General.* (i) The number of fire extinguishers needed to protect a property shall be determined as prescribed herein, considering the area and arrangement of the building or occupancy, the severity of the hazard, the anticipated classes of fires, and the distances to be traveled to reach extinguishers.

(ii) Fire extinguishers shall be provided for the protection of both the building structure, if combustible and the occupancy hazards contained therein.

(iii) Required building protection shall be provided by fire extinguishers suitable for Class A fires.

(iv) Occupancy hazard protection shall be provided by fire extinguishers suitable for such Class A, B, C, or D fire potentials as may be present.

(v) Extinguishers provided for building protection may be considered also for the protection of occupancies having a Class A fire potential.

(vi) Combustible buildings having an occupancy hazard subject to Class B, and/or Class C fires, shall have a standard complement of Class A fire extinguishers as required by Table L–1 for building protection, plus additional Class B and/or Class C extinguishers. Where fire extinguishers have more than one letter classification (such as 2–A: 20–B:C), they may be considered to satisfy the requirements of each letter class.

(vii) Rooms or areas shall be graded generally as light hazard, ordinary hazard, or extra hazard. Limited areas of greater or lesser hazard shall be protected as required.

(2) *Fire extinguisher size and placement for Class A hazards.* (i) Minimal sizes of fire extinguishers for the listed grades of hazard shall be provided on the basis of Table L–1. Extinguishers shall be located so that the maximum travel distances shall not exceed those specified in Table L–1.

TABLE L–1

Basic minimum extinguisher rating for area specified	Maximum travel distances to extinguishers (feet)	Areas to be protected per extinguisher		
		Light hazard occupancy (square feet)	Ordinary hazard occupancy (square feet)	Extra hazard occupancy (square feet)
1A	75	3,000	Note 1	Note 1
2A	75	6,000	3,000	Note 1
3A	75	9,000	4,500	3,000
4A	75	11,250	6,000	4,000
6A	75	11,250	9,000	6,000

NOTE 1: Not permitted except as specified in subdivision (ii) of this subparagraph.

(ii) The protection requirements specified in Table L–1 may be fulfilled by several extinguishers of lower ratings for ordinary or extrahazard occupancies.

(iii) Where the floor area of a building is less than that specified in Table L–1, at least one extinguisher of the minimum size recommended shall be provided.

(iv) The protection requirements may be fulfilled with extinguishers of higher rating provided the travel distance to such larger extinguishers shall not exceed 75 feet.

(3) *Fire extinguisher size and placement for Class B fires other than for fires in flammable liquids of appreciable depth.* (i) Minimal sizes of fire extinguishers for the listed grades of hazard shall be provided on the basis of Table L–2. Extinguishers shall be located so that the maximum travel distances shall not exceed those specified in Table L–2.

TABLE L–2

Type of hazard	Basic minimum extinguisher rating	Maximum travel distance to extinguishers (feet)
Light	4B	50
Ordinary	8B	50
Extra	12B	50

(ii) Two or more extinguishers of lower rating, except for foam extinguishers, shall not be used to fulfill the protection requirements of Table L–2. Up to three foam extinguishers may be used to fulfill these requirements.

(iii) The protection requirements may be fulfilled with extinguishers of higher ratings provided the travel distance to such larger extinguishers shall not exceed 50 feet.

(4) *Fire extinguisher size and placement for Class B fires in flammable liquids of appreciable depth.* (i) For flammable liquid hazards of appreciable depth (Class B), such as in dip or quench tanks, Class B fire extinguishers shall be provided on the basis of one numerical unit of Class B extinguishing potential per square foot of flammable liquid surface of the largest tank hazard within the area.

NOTE: Appreciable depth is defined as a depth of a liquid greater than one-quarter inch.

(ii) Two or more extinguishers of lower ratings except for foam extinguishers, shall not be used in lieu of the extinguisher required for the largest tank. Up to three foam extinguishers may be used to fulfill these requirements.

(iii) Scattered or widely separated hazards shall be individually protected if the specified travel distances in subparagraph (3) (i) of this paragraph are exceeded. Likewise, extinguishers in the proximity of a hazard shall be carefully located so as to be accessible in the presence of a fire without undue danger to the operator.

(5) *Fire extinguisher size and placement for Class C hazards.* (i) Extinguishers with Class C ratings shall be required where energized electrical equipment may be encountered which would require a nonconducting extinguishing media. This will include fire either directly involving or surrounding electrical equipment. Since the fire itself is a Class A or Class B hazard the extinguishers are sized and located on the basis of the anticipated Class A or B hazard.

(d) *Inspection, maintenance, and hydrostatic tests*—(1) *General.* (i) The owner or occupant of a property in which extinguishers are located shall be responsible for such inspection, maintenance, and testing.

(ii) For details of conducting needed inspections, proper maintenance operations, and required tests, see NFPA No. 10A–1970, Maintenance and Use of Portable Fire Extinguishers.

(2) *Inspection.* (i) Extinguishers shall be inspected monthly, or at more frequent intervals when circumstances require, to insure they are in their designated places, to insure they have not been actuated or tampered with, and to detect any obvious physical damage, corrosion, or other impairments.

(ii) Any extinguishers showing defects shall be given a complete maintenance check.

(3) *Maintenance.* (i) At regular intervals, not more than 1 year apart, or when specifically indicated by an inspection, extinguishers shall be thoroughly examined and/or recharged or repaired to insure operability and safety; or replaced as needed.

(ii) Extinguishers removed from the premises to be recharged shall be replaced by spare extinguishers during the period they are gone.

(iii) Pails or drums of powder-extinguishing agents for scoop or shovel application to metal fires shall be kept full at all times.

(iv) Each extinguisher shall have a durable tag securely attached to show the maintenance or recharge date and the initials or signature of the person who performs this service.

(4) *Hydrostatic tests.* (i) If, at any time, an extinguisher shows evidence of corrosion or mechanical injury, it shall be subjected to a hydrostatic pressure test, or replaced.

(ii) For evaluating the condition of extinguisher cylinders made to Department of Transportation specifications (cf. 49 CFR Chapter I), see the Standard for Visual Inspection of Compressed Gas Cylinders (CGA C–6), published by the Compressed Gas Association, 500 Fifth Avenue, New York, NY 10036.

(iii) At intervals not exceeding those specified in Table L–3 and subdivisions (iv) through (vi) of this subparagraph, extinguishers shall be hydrostatically tested. The first hydrostatic retest may be conducted between the fifth and sixth years for those with a designated test interval of 5 years.

TABLE L–3

HYDROSTATIC TEST INTERVAL FOR EXTINGUISHERS

Extinguisher type:	Test interval year
Soda-acid	5
Cartridge-operated water and/or antifreeze	5
Storage-pressure water and/or antifreeze	5
Wetting agent	5
Foam	5
Loaded stream	5
Dry chemical extinguishers with stainless steel shells, aluminum shells, or soldered-brass shells	5
Carbon dioxide extinguishers	5
Dry chemical extinguishers with brazed-brass shells, or mild-steel shell	12
Bromotrifluoromethane	12
Dry powder extinguishers for metal fires	12

NOTE: Cylinders under jurisdiction of the U.S. Department of Transportation (formerly Interstate Commerce Commission) may require hydrostatic testing at more frequent periods.

(iv) Nitrogen cylinders (or other cylinders used for inert-gas storage), such as found on wheeled extinguishers, shall be tested at a 5-year interval.

(v) On those extinguishers which are equipped with a shutoff nozzle at the outlet end of the hose, a hydrostatic test shall be performed on the hose with its couplings (but without the discharge nozzle) at the test interval specified for the unit on which the hose is installed.

(vi) The test pressure for dry chemical and dry powder hose assemblies requiring a hydrostatic test shall be at a test pressure of 300 pounds per square inch for a 1-minute period. Carbon dioxide hose assemblies requiring a hydrostatic test shall be at test pressure of 1,250 p.s.i. for a 1-minute period.

(vii) Hydrostatic tests are not required on fire pails, pump-type water and/or antifreeze extinguishers, and factory-sealed disposable (nonrefillable) containers. If such an extinguisher or water pail shows evidence of corrosion or mechanical injury, it may be unsafe or unsuitable for further use and shall be replaced with a new unit.

(viii) The hydrostatic test date shall be recorded on a record tag of metal or equally durable material, or a suitable metallized decal which shall be affixed (by a heatless process) to the shell of an extinguisher which favorably passes the hydrostatic test. The record tag shall contain the following information: Date of test, test pressure, and name or initials of person or agency making the test.

(ix) For extinguishers subjected to an original factory test pressure of 350 p.s.i. or greater, the test pressure shall be 75 percent of the factory test pressure (as noted on the extinguisher nameplate), but in no case less than 300 p.s.i., see Table L–4. For extinguishers subjected to an original factory test pressure of less than 350 p.s.i., the test pressure shall be 75 percent of the factory test pressure; see Table L–4. Pressure shall be applied at a rate of rise to reach the test pressure in approximately 1 minute, and the pressure shall be held for 1 minute, after which it shall be released.

TABLE L–4

HYDROSTATIC TEST PRESSURE REQUIREMENTS—NON-ICC SHELLS, SHELLS NOT SPECIFIED IN U.S. DEPARTMENT OF TRANSPORTATION REGULATIONS, (FORMERLY INTERSTATE COMMERCE COMMISSION)

Extinguisher type	Original factory test pressure	Required hydrostatic test pressure
All dry chemical and dry powder.	400 p.s.i. or greater.	75% of factory test pressure.
	350–399 p.s.i.	300 p.s.i.
	below 350 p.s.i.	75% of factory test pressure.
Foam—500 p.s.i. factory test.	500	375.
Foam—350 p.s.i. factory test.	350	300.
Soda-acid—500 p.s.i. factory test.	500	375.
Soda-acid—350 p.s.i. factory test.	350	300.
Stored-pressure or cartridge-operated water-type (including antifreeze and loaded-stream).	400 p.s.i. or greater.	75% of factory test pressure.
	350–399 p.s.i.	300 p.s.i.
	below 350.	75% of factory test pressure.

(x) Carbon dioxide extinguishers, nitrogen cylinders, and other cylinders or cartridges used for the storage of inert, compressed gases shall be hydrostatically tested in accordance with the requirements of the U.S. Department of Transportation (formerly Interstate Commerce Commission); see 49 CFR Parts 171–190.

(xi) Extinguisher shells, cartridges, or cylinders which show leakage or permanent distortion in excess of specified limits, or which rupture, shall be removed from service.

§ 1910.158 Standpipe and hose systems.

(a) *General requirements*—(1) *Application.* Where standpipe and hose systems are provided they shall meet the design requirements of the National Fire Protection Association's Standard for the Installation of Standpipe and Hose Systems NFPA 14–1970 and the requirements of this section.

(2) *Closets and cabinets.* Closets and cabinets used to contain fire hose shall be of sufficient size to permit the installation of the necessary equipment at hose stations, and so designed as not to interfere with the prompt handling of the hose and equipment at time of fire. They shall be used for fire equipment only.

(3) *Protection of standpipes.* Standpipes shall be so located that they are protected against mechanical and fire damage.

(b) *Hose outlets*—(1) *Location of hose.* (i) Hose outlets shall be within easy reach of a person standing on the floor and in no case shall be over 6 feet from the floor. Hose stations shall be located conspicuously within the immediate area and where not likely to be obstructed. Hose may be located at one side of the standpipe and supplied by short lateral connections to the standpipe where necessary to avoid obstructions.

(ii) For Class III service, the outlets for large hose shall be located in a stairway enclosure, and for small hose the outlets shall be located in the corridor or space adjacent to the stairway enclosure.

(2) *Hose connections.* (i) Standpipes for Class I service shall be provided with 2½-inch hose connections on each floor.

(ii) Standpipes for Class II service shall be provided with 1½-inch hose connections on each floor.

(iii) Standpipes for Class III service shall be provided with both a 2½-inch and 1½-inch hose connection on each floor. The hose connections may be through one 2½-inch hose valve and an easily removable 2½-inch by 1½-inch adapter.

(3) *Hose.* Each hose outlet provided for the use of building occupants (Class II and III services) shall be equipped with not more than 75 feet and preferably not more than 50 feet of approved small fire hose attached and ready for use.

(4) *Hose racks.* Each station provided with small hose shall be equipped with an approved rack securely fastened in position.

(5) *Hose valves.* (i) An approved hose valve shall be provided at each outlet for attachment of hose.

(ii) Where the static pressure at any standpipe outlet for small hose exceeds 100 pounds per square inch, an approved device shall be installed at the outlet to reduce the pressure so that the nozzle pressure will be approximately 80 pounds per square inch.

NOTE: Pressure reducers are not required on standpipe outlets for 2½-inch hose because it is assumed 2½-inch hose will be attached only when the persons likely to use it are trained in handling large streams.

(iii) National (American) Standard Fire Hose Coupling Screw Threads shall be used whenever they will fit existing equipment; see Standard for Screw Threads Gaskets for Fire Hose Couplings, NFPA No. 194–1968.

(6) *Nozzles.* Nozzles shall be of an approved type. Size of nozzles for small hose shall be not larger than one-half inch.

(7) *Dry standpipe identification.* Each hose connection on dry standpipes shall be provided with a conspicuous, durable, and permanently legible sign reading "Dry Standpipe for Fire Department Use Only."

(c) *Water supplies*—(1) *Minimum supply for Class I service.* (i) The minimum supply for Class I service shall be sufficient to provide 500 gallons per minute for a period of at least thirty (30) minutes.

(ii) Where more than one standpipe is required, the minimum supply shall be 500 gallons per minute for the first standpipe and 250 gallons per minute for each additional standpipe, the total supply not to exceed 2,500 gallons a minute, for a period of at least thirty (30) minutes.

(iii) The supply shall be sufficient to maintain a residual pressure of 65 pounds per square inch at the topmost outlet of each standpipe (including the roof outlet) with 500 gallons per minute flowing.

(2) *Minimum supply for Class II service.* The minimum supply for Class II service shall be sufficient to provide 100

gallons per minute for a period of at least thirty (30) minutes. The supply shall be sufficient to maintain a residual pressure of 65 pounds per square inch at the topmost outlet of each standpipe (including the roof outlet) with 100 gallons per minute flowing.

(3) *Minimum supply for Class III service.* The minimum supply for Class III service shall be the same as for Class I service.

(4) *Fire department connections.* (i) One or more fire department connections shall be provided for each Class I or Class III standpipe system.

(ii) In high-rise buildings having two or more zones, a fire department connection shall be provided for each zone.

(iii) Fire department connections shall be properly supported.

(iv) There shall be no shutoff valve in the fire department connection.

(v) An approved straightway check valve shall be installed in each fire department connection, located as near as practicable to the point where it joins the system.

(vi) The pipe between the check valve and the outside hose coupling shall be equipped with an approved automatic drip, arranged to discharge to a proper place.

(vii) Hose connections shall be approved type and shall be equipped with standard caps, properly secured and arranged for easy removal by fire departments.

(viii) Hose coupling threads shall conform to those used by the local fire department. (American) National Standard Fire-Hose Coupling Screw Threads shall be used whenever they will fit the local fire department hose threads; see standard for Screw Threads and Gaskets for Fire Hose Couplings, NFPA No. 194—1968.

(ix) Hose connections should be on the street side of buildings and shall be located and arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects including buildings, fences, posts, or other fire department connections.

(x) Hose connections shall be designated by a sign having raised letters at least one inch in size cast on a plate or fitting, reading "Standpipe."

(xi) If hose connection does not serve all of the building an appropriate and durable sign shall be attached indicating the portions of the building served.

(d) *Tests and maintenance* — (1) *Tests.* All new systems including yard piping shall be tested hydrostatically at not less than 200 pounds per square inch pressure for 2 hours, or at 50 pounds per square inch in excess of the normal pressure when the normal pressure is in excess of 150 pounds per square inch.

(2) *Periodic inspection.* (i) The tanks shall be kept properly filled, and where pressure tanks are employed, a pressure of at least 75 pounds per square inch shall be maintained at all times.

NOTE: For further details, see Standard for Water Tanks for Private Fire Protection, NFPA No. 22-1970.

(ii) The valves in the main connection to the automatic sources of water supply shall be open at all times. The hose valves should be frequently examined to see that they are tight.

NOTE: For further details, see Care of Fire Hose, NFPA No. 198-1969.

FIXED FIRE SUPPRESSION EQUIPMENT

§ 1910.159 Automatic sprinkler systems.

(a) *General requirements*—(1) *Design.* When automatic sprinkler systems are provided they shall meet design requirements of the National Fire Protection Association's Standard for the Installation of Sprinkler Systems NFPA No. 13-1969 and the requirements of this section.

(2) *Water supply.* Every automatic sprinkler system shall have at least one automatic water supply of adequate pressure, capacity and reliability.

(3) *Fire department connection.* A connection through which a fire department can pump water into the sprinkler system makes a desirable auxiliary supply. For this purpose, one or more fire department connections shall be provided in all cases.

(b) *Fire department connections*—(1) *Size.* Pipe size shall not be less than 4 inches for fire engine connections and not less than 6 inches for fireboat connections, except that 3-inch pipe may be used to connect a single hose connection to a 3-inch or smaller riser,

(2) *Valves.* (i) An approved straightaway check valve shall be installed in each fire department connection, located as near as practicable to the point where it joins the system.

(ii) There shall be no shutoff valve in the fire department connection.

(3) *Support.* Fire department connections shall be properly supported.

(4) *Hose connections.* (i) Hose connections shall be of approved type.

(ii) Hose coupling threads shall conform to those used by the local fire department. National (American) Standard Fire Hose Coupling Screw Threads shall be used whenever they will fit the local fire department hose.

(iii) Hose connections shall be equipped with caps, properly secured and arranged for easy removal by fire departments.

(iv) Hose connections shall be located and arranged so that hose lines can be readily and conveniently attached to the inlets without interference from any nearby objects including buildings, fences, posts, or other fire department connections.

(v) Hose connections shall be designated by a sign having raised letters at least 1 inch in size cast on plate or fitting reading for service designated: Viz—"AUTO-SPKR." or "OPEN SPKR."

(c) *Sprinkler alarms*—(1) *General.* (i) Waterflow alarms shall be provided on all sprinkler installations.

(ii) An alarm unit shall include an approved mechanical alarm, horn, or siren, or an approved weatherproof electric gong, bell, horn, or siren on the outside of the building or approved electric gongs, bells, horns, or sirens inside the building, or a combination of such devices.

(iii) All alarm apparatus shall be so located and installed that all parts are readily accessible for inspection, removal, and repair, and shall be substantially supported. Outdoor mechanical or electrically operated bells shall be of weatherproof and guarded type. On each alarm check valve used under conditions of variable water pressure, a retarding device shall be installed. Suitable valves shall be provided in the connections to retarding chambers, to permit repair or removal without shutting off sprinklers; these valves shall be so arranged that they may be locked or sealed in the open position.

(2) *Waterflow detecting devices.* (i) The alarm apparatus for a wet-pipe system shall consist of an approved alarm check valve or other approved water flow detecting alarm device with the necessary attachments required to give an alarm.

(ii) The alarm apparatus for a dry-pipe system shall consist of approved alarm attachments to the dry-pipe valve. When a dry-pipe valve is located on the system side of an alarm valve, the actuating device of the alarms for the dry-pipe valve may be connected to the alarms on the wet-pipe system.

(iii) The alarm apparatus for preaction and deluge systems shall consist of approved electric alarm attachments, actuated by a thermostatic system independently of flow of water in the system.

(3) *Drains.* Drains from alarm devices shall be so arranged that there will be no danger of freezing, and so that there will be no overflowing at the alarm apparatus, at domestic connections or elsewhere with the sprinkler drains wide open and under pressure.

(d) *Maintenance of sprinkler system.* A sprinkler system installed under this Standard must be properly maintained for efficient service. The owner is responsible for the condition of his sprinkler system and must use due diligence in keeping the system in good operating condition.

(e) *Sprinkler head clearance*—(1) *Type I storage.* Clearance of at least 36 inches shall be maintained between sprinkler deflectors and top of storage to reduce the possibility of obstruction to the distribution of water.

(2) *Type II storage.* Clearance of at least 18 inches shall be maintained between sprinkler deflectors and top of storage to reduce the possibility of obstruction to the distribution of water.

(3) *Type III storage.* In sprinklered buildings, at least 18 inches clearance between sprinkler deflectors and top of storage shall be maintained.

§ 1910.160 Fixed dry chemical extinguishing systems.

(a) *General requirements*—(1) *Design.* When dry chemical extinguishing systems are provided they shall meet the design requirements of the National Fire Protection Association's "Standard for Dry Chemical Extinguishing Systems" NFPA No. 17-1969 and the requirements of this section.

(2) *Safety requirements.* Where there is a possibility that personnel may be exposed to a dry chemical discharge, suitable safeguards shall be provided to insure prompt evacuation of such locations, and also to provide means for prompt rescue of any trapped personnel.

(b) *Alarms and indicators*—(1) *General.* Alarms and/or indicators are used to indicate the operation of the system, hazard to personnel, or failure of any supervised device or equipment. The devices may be audible or visual. The type, number, and location of the devices shall be such that their purpose is satisfactorily accomplished. The extent and type of alarm and/or indicator equipment shall be approved.

(2) *Operation alarm.* (i) An alarm or indicator shall be provided to show that the system has operated, that personnel response may be needed, and that the system should be charged.

(ii) Alarms indicating failure of supervised devices or equipment shall give prompt and positive indication of any failure and shall be distinctive from alarms indicating operation or hazardous conditions.

(c) *Inspection and maintenance*—(1) *Inspection and tests.* (i) At least annually, all dry chemical systems including alarms, shutdowns, and other associated equipment, shall be thoroughly inspected and checked for proper operation by a competent inspector.

(ii) The purpose of the inspection and testing prescribed by paragraph (c) of this section shall be not only to insure that the system is in full operating condition but also to indicate the probable continuance of that condition until the next inspection. Attention at this inspection shall be given to any extension of the hazard protected by the system.

(iii) The inspector's report, with recommendations, if any, shall be filed with the owner or with whomever is designated by the owner.

(iv) Between the regular service contract inspection or tests, the system shall be inspected visually or otherwise by competent personnel, following an approved schedule.

(v) At least semiannually, all expellant gas containers shall be checked by pressure or weight against the required minimums.

(vi) At least semiannually, all stored pressure dry chemical containers shall be checked by pressure and weight against the required minimums.

(vii) Except for stored pressure systems, at least annually the dry chemical in the system storage container shall be sampled from the top center and also near the wall to determine the existence of lumps harder than will be friable when dropped from a height of 4 inches.

(2) *Maintenance.* (i) These fixed dry chemical systems shall be maintained in full operating condition at all times. Use, impairment, and restoration of this protection shall be reported promptly to the owner.

(ii) Any troubles or impairments shall be corrected at once by competent personnel.

§ 1910.161 Carbon dioxide extinguishing systems.

(a) *General requirements*—(1) *Design.* When carbon dioxide extinguishing systems are provided they shall meet the design requirements of the National Fire Protection Association's "Standard on Carbon Dioxide Extinguishing Systems" NFPA No. 12–1968 and the requirements of this section.

(2) *Safety requirements.* In any use of carbon dioxide where there is a possibility that employees may be trapped in, or enter into atmospheres made hazardous by a carbon dioxide discharge, suitable safeguards shall be provided to insure prompt evacuation of and to prevent entry into such atmospheres and also to provide means for prompt rescue of any trapped personnel. Such safety items as personnel training, warning signs, discharge alarms, predischarge alarms, and breathing apparatus shall be considered.

(b) *Inspection and maintenance*—(1) *Inspection and tests.* (i) At least annually, all carbon dioxide systems shall be thoroughly inspected and tested for proper operation by a competent engineer or inspector.

(ii) The goal of this inspection and testing shall be not only to insure that the system is in full operating condition but shall indicate the probable continuance of that condition until the next inspection.

(iii) Suitable discharge tests shall be made when any inspection indicates their advisability.

(iv) Between the regular service contract inspection or tests, the system shall be inspected visually or otherwise by competent personnel, following a schedule.

(v) At least semiannually, all high pressure cylinders shall be weighed. If, at any time, a container shows a loss in net content of more than 10 percent, it shall be refilled or replaced.

(vi) If, at any time, a container shows a loss of more than 10 percent, it shall be refilled, unless the minimum gas requirements are still provided.

(2) *Maintenance.* (i) These carbon dioxide systems shall be maintained in full operating condition at all times.

(ii) Any troubles or impairments shall be corrected at once by competent personnel.

§ 1910.162 Other special fixed extinguishing systems. [Reserved]

Other Fire Protection Systems

§ 1910.163 Local fire alarm signaling systems.

(a) *General requirements.* Where local fire alarm signaling systems are provided they shall meet the design requirements of the National Fire Protection Association's "Standard for the Installation, Maintenance, and Use of Local Protective Signaling Systems for Watchman, Fire Alarm and Supervisory Service." NFPA No. 72A–1967 and the requirements of this section.

(b) *Fire alarm boxes*—(1) *General.* Manual fire alarm boxes shall be approved for the particular application and shall be used only for fire protective signaling purposes. Combined fire alarm and watchman's signaling boxes are acceptable.

(2) *Mounting.* Each box shall be securely mounted.

(3) *Distribution.* Manual fire alarm boxes shall be distributed throughout the protected area so that they are unobstructed, readily accessible, and located in the normal path of exit from the area. Additional boxes shall be provided on each floor to obtain a maximum horizontal travel distance of 200 feet to the nearest box.

(c) *Maintenance.* All systems shall be under the supervision of qualified persons. These persons shall cause tests and inspections to be made at prescribed intervals and shall have general charge of all alterations and additions to the systems under their supervision.

§ 1910.164 Fire brigades. [Reserved]

§ 1910.165 Additional delay in effective date.

The requirements of this Subpart L shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart upon the commencement of the Walsh-Healey requirement.

§ 1910.165a Sources of standards.

Section	*Source*
1910.156(a)–(h)	NFPA No. 10–1970, Standard for the Installation of Portable Fire Extinguishers.
1910.156(i)–(j)	NFPA No. 13–1969, Standard for the Installation of Sprinkler Systems.
1910.156(k)–(o)	NFPA No. 14–1970, Standard for the Installation of Standpipe and Hose Systems.
1910.156(p)–(s)	NFPA No. 231–1970, Standard for Indoor General Storage.
1910.157	NFPA No. 10–1970, Standard for the Installation of Portable Fire Extinguishers.
1910.158	NFPA No. 14–1970, Standard for the Installation of Standpipe and Hose Systems.
1910.159(a)–(d)	NFPA No. 13–1969, Standard for the Installation of Sprinkler Systems.
1910.159(e)	NFPA No. 231–1970, Standard for Indoor General Storage.
1910.160	NFPA No. 17–1969, Standard for Dry Chemical Extinguishing Systems.
1910.161	NFPA No. 12–1968, Standard on Carbon Dioxide Extinguishing Systems.

Section	Source
1910.163 ------	NFPA No. 72A–1967, Standard for the Installation, Maintenance, and Use of Local Protective Signalling Systems for Watchman, Fire Alarm and Supervisory Service.

§ 1910.165b Standards organizations.

Compressed Gas Association, Inc., 500 Fifth Avenue, New York, NY 10036.
National Fire Protection Association, 60 Batterymarch Street, Boston MA 02110.
American National Standards Institute, 1430 Broadway, New York NY.

Subpart M—Compressed Gas and Compressed Air Equipment

§ 1910.166 Inspection of compressed gas cylinders.

(a) *Definitions.* As used in this section:

(1) High- and low-pressure cylinders: High-pressure cylinders means those cylinders with a marked service pressure of 900 p.s.i. or greater; low-pressure cylinders are those with a marked service pressure less than 900 p.s.i.

(2) Minimum allowable wall thickness: The minimum allowable wall thickness means the minimum wall thickness required by the specification under which the cylinder was manufactured.

(3) Dents: Dents (in cylinders) means deformations caused by the cylinder coming in contact with a blunt object in such a way that the thickness of metal is not materially impaired.

(4) Cuts, gouges, or digs: Cuts, gouges, or digs (in cylinders) means deformations caused by contact with a sharp object in such a way as to cut into or upset the metal of the cylinder, decreasing the wall thickness at that point.

(5) Corrosion or pitting: Means corrosion or pitting in cylinders involving the loss of wall thickness by corrosive media. There are several kinds of pitting or corrosion to be considered.

(6) Isolated pitting: Means isolated pits of small cross-section which do not effectively weaken the cylinder wall but are indicative of possible complete penetration and leakage. Since the pitting is isolated the original wall is essentially intact.

(7) Line corrosion: Means pits which are not isolated but are connected or nearly connected to others in a narrow band or line. This condition is more serious than isolated pitting. Line corrosion frequently occurs in the area of intersection of the footring and bottom of a cylinder. This is sometimes referred to as "crevice corrosion."

(8) General corrosion: Means corrosion which covers considerable surface areas of the cylinder. It reduces the structural strength. It is often difficult to measure or estimate the depth of general corrosion because direct comparison with the original wall cannot always be made. General corrosion is often accompanied by pitting.

(9) "DOT" means the U.S. Department of Transportation.

(b) *General requirements*—(1) *Application.* (i) Each employer shall determine that compressed gas cylinders under his control are in a safe condition to the extent that this can be determined by visual and other inspection required by this subparagraph.

(ii) The requirements contained in this section are not intended to apply to cylinders manufactured under specification DOT (ICC)–3HT (49 CFR Ch. 1). Separate requirements covering service life and standards for visual inspection of these cylinders are contained in Compressed Gas Association Pamphlet C–8, "Standard for Requalification of ICC–3HT Cylinders."

(2) *Quality of inspection.* Experience in the inspection of cylinders is an important factor in determining the acceptability of a given cylinder for continued service. Users lacking this experience and having doubtful cylinders should return them to a manufacturer of the same type of cylinders for reinspection.

(c) *Inspection of low-pressure cylinders exempt from the hydrostatic test including acetylene cylinders*—(1) *Application.* This section covers cylinders of the type that are exempt from the hydrostatic retest requirements of the DOT by virtue of their exclusive use in certain noncorrosive gas service. They are not subject to internal corrosion and do not require internal shell inspection.

(2) *Preparation for inspection.* Rust, scale, caked paint, etc., shall be removed from the exterior surface so that the surface can be adequately observed. Facilities shall be provided for inverting the cylinder to facilitate inspection of the bottom. This is important because experience has shown this area to be the most susceptible to corrosion.

(3) *Exterior inspection.* Cylinders shall be checked as outlined below for corrosion, general distortion, or any other defect that might indicate a weakness which would render it unfit for service.

(i) To fix corrosion limits for all types, designs, and sizes of cylinders, and include them in this section is not practicable. Cylinders shall meet the requirements of this subdivision. Failure to meet any of the requirements of this subdivision is of itself cause for rejection of a cylinder.

(*a*) A cylinder shall be rejected when the tare weight is less than 95 percent of the original tare weight marked on the cylinder. When determining tare weight, be sure that the cylinder is empty.

(*b*) A cylinder shall be rejected when the remaining wall in an area having isolated pitting only is less than one-third of the minimum allowable wall thickness as determined under subdivision (ii), (iii), or (iv) of this subparagraph.

(*c*) A cylinder shall be rejected when line corrosion on the cylinder is 3 inches in length or over and the remaining wall is less than three-fourths of the minimum allowable wall thickness or when line corrosion is less than 3 inches in length and the remaining wall thickness is less than one-half the minimum allowable wall thickness as determined under subdivision (ii), (iii), or (iv) of this subparagraph.

(*d*) A cylinder shall be rejected when the remaining wall in an area of general corrosion is less than one-half of the minimum allowable wall thickness as determined under subdivision (ii), (iii), or (iv) of this subparagraph.

(ii) To use the criteria in subdivision (i) of this subparagraph, it is necessary to know the original wall thickness of the cylinder or the minimum allowable wall thickness. Table M–1 lists the minimum allowable wall thickness under DOT specifications (49 CFR Ch. 1) for a number of common size low-pressure cylinders.

TABLE M–1

Cylinder size O.D. x length (inches)	DOT Specification marking	Nominal water capacity (pounds)	Minimum allowable wall thickness (inches)
15 x 46	[1] 4B240	239	0.128
14 13/16 x 47	4E240	239	.140
14 15/16 x 46	4BA240	239	.086
14 13/16 x 28 3/4	4BA240	143	.086
11 29/32 x 32 13/16	4BA240	95	.078
11 29/32 x 18 13/32	4BA240	48	.078

[1] Without longitudinal seam

(iii) When the wall thickness of the cylinder at manufacture is not known, and the actual wall thickness cannot be measured, this cylinder shall be rejected when the inspection reveals that the deepest pit in a general corrosion area exceeds three sixty-fourths inch. This is arrived at by considering that in no case shall the pitting exceed one-half the minimum allowable wall thickness which is 0.064 inch. When a pit measures 0.043 inch (approximately three sixty-fourths inch) in a corrosion area, general corrosion will already have removed 0.021 inch of the original wall and the total pit depth as compared to the initial wall will be 0.064 inch.

(iv) When the original wall thickness at manufacture is known, or the actual wall thickness is measured, this thickness less one and one-half times the maximum measured pit depth shall be 0.064 inch or greater. If it is less, the cylinder shall be rejected.

(v) Dents are of concern where the metal deformation is sharp and confined, or where they are near a weld. Where metal deformation is not sharp, dents of larger magnitude can be tolerated.

(vi) Where denting occurs so that any part of the deformation includes a weld, the maximum allowable dent depth shall be one-fourth inch.

(vii) When denting occurs so that no part of the deformation includes a weld, the cylinder shall be rejected if the depth of the dent is greater than one-tenth of the mean diameter of the dent.

(viii) Cuts, gouges, or digs reduce the wall thickness of the cylinder and in addition are considered to be stress raisers. Depth limits are set in this subparagraph; however, cylinders shall be rejected at one-half of the limit set whenever the length of the defect is 3 inches or more.

(*a*) When the original wall thickness at manufacture is not known, and the

actual wall thickness cannot be measured a cylinder shall be rejected if the cut, gouge, or dig exceeds one-half of the minimum allowable wall thickness as determined under subdivision (ii), (iii), or (iv) of this subparagraph.

(b) When the original wall thickness at manufacture is known, or the actual wall thickness is measured, a cylinder shall be rejected if the original wall thickness minus the depth of the defect is less than one-half of the minimum allowable wall thickness as determined under subdivision (ii), (iii), or (iv) of this subparagraph.

(ix) Leaks can originate from a number of sources, such as defects in a welded or brazed seam, defects at the threaded opening, or from sharp dents, digs, gouges, or pits.

(a) To check for leaks, the cylinder shall be charged and carefully examined. All seams and pressure openings shall be coated with a soap or other suitable solution to detect the escape of gas. Any leakage is cause for rejection.

(b) Safety relief devices as defined in § 1910.167(a)(1) shall be tested for leaks before a charged cylinder is shipped from the cylinder filling plant.

(x) After fire damage, cylinders shall be carefully inspected for evidence of exposure to fire.

(a) Common evidences of exposure to fire are:

(1) Charring or burning of the paint or other protective coat,

(2) Burning or sintering of the metal,

(3) Distortion of the cylinder,

(4) Melted out fuse plugs,

(5) Burning or melting of valve.

(b) The evaluation of fire damage by DOT Regulations state that, "A cylinder which has been subjected to the action of fire must not again be placed in service until it has been properly reconditioned", in accordance with 49 CFR 173.34(f) The general intent of this requirement is to remove from service cylinders which have been subject to the action of fire which has changed the metallurgical structure or the strength properties of the steel, or in the case of acetylene cylinders caused breakdown of porous filler. This is normally determined by visual examination as covered above with particular emphasis to the condition of the protective coating. If the protective coating has been burnt off or if the cylinder body is burnt, warped, or distorted, it is assumed that the cylinder has been overheated and 49 CFR 173.34(f) shall be complied with. If, however, the protective coating is only dirtied from smoke or other debris, and is found by examination to be intact underneath, the cylinder shall not be considered affected with the scope of this requirement.

(xi) Cylinders are manufactured with a reasonably symmetrical shape. Cylinders which have definite visible bulges shall be removed from service and evaluated. Cylinders shall be rejected when a variation of 1 percent or more is found in the measured circumferences or in peripheral distances measured from the valve spud to the center seam (or equivalent fixed point).

(xii) Cylinder necks shall be examined for serious cracks, folds, and flaws. Neck cracks are normally detected by testing the neck during charging operations with a soap solution.

(xiii) Cylinder neck threads shall be examined whenever the valve is removed from the cylinder. Cylinders shall be rejected if the required number of effective threads are materially reduced, or if a gas tight seal cannot be obtained by reasonable valving methods. Gages shall be used to measure the number of effective threads.

(xiv) If the valve is noticeably tilted the cylinder shall be rejected.

(xv) The footring and headring of cylinders may become so distorted through service abuse that they no longer perform their functions:

(a) To cause the cylinder to remain stable and upright,

(b) To protect the valve. Rings shall be examined for distortion; for looseness, and for failure of welds. Appearances may often warrant rejection of the cylinder.

(d) *Low-pressure cylinders subject to hydrostatic testing.*—(1) *Application.* Cylinders covered in this section are low-pressure cylinders other than those covered in paragraph (c) of this section. They differ essentially from such cylinders in that they require a periodic hydrostatic retest which includes an internal and external examination. Defect limits for the external examination are prescribed in paragraph (c) of this section, with exceptions for aluminum cylinders shown in subparagraph (4) of this paragraph.

(2) *Preparation for inspection.* Flammable gas cylinders shall be purged before being examined with a light. Lamps used for flammable gas cylinder inspection shall be explosion proof.

(3) *Internal inspection.* Cylinders shall be inspected internally at least every time the cylinder is periodically retested. The examination shall be made with a light of sufficient intensity to clearly illuminate the interior walls.

(4) *External inspection of aluminum cylinders.* The inspection requirements of paragraph (c) of this section shall be met, except as follows:

(i) Aluminum cylinders shall be rejected when impairment to the surface (corrosion or mechanical defect) exceeds a depth where the remaining wall is less than three-fourths of the minimum allowable wall thickness required by the specification under which the cylinder was manufactured.

(ii) Aluminum cylinders subjected to the action of fire shall be removed from service.

(e) *High-pressure cylinders*—(1) *Application.* High-pressure cylinders are those with a marked service pressure of 900 p.s.i. or higher. They are seamless; no welding is permitted. The great bulk of such cylinders are of the 3A or 3AA types under DOT Specifications (49 CFR Ch. I).

(2) *Preparation for inspection.* (i) Cylinders shall be cleaned for inspection so that the inside and outside surfaces and all conditions can be observed. This shall include removal of scale and caked paint from the exterior and the thorough removal of internal scale. Cylinders with interior coating shall be examined for defects in the coating. If the coating is defective, it shall be removed.

(ii) A good inspection light of sufficient intensity to clearly illuminate the interior wall is mandatory for internal inspection. Flammable gas cylinders shall be purged before being examined with a light. Lamps for flammable gas cylinder inspection shall be explosion proof.

(3) *Exterior inspection.* (i) To fix corrosion limits for all types, designs, and sizes of cylinders, and include them in this section, is not practicable. Considerable judgment is required in evaluating cylinders fit for service. Experience is a major factor, aside from strength considerations for high pressure cylinders.

(ii) When the original wall thickness of the cylinder is not known, and the actual wall thickness cannot be measured, the cylinder is rejected if corrosion exceeds one thirty-second inch in depth. This is arrived at by subtracting from the minimum allowable wall at manufacture (0.221 inch), the limiting wall in service (0.195 inch), to give the maximum allowable corrosion limit of 0.026 inch, say one thirty-second inch.

(iii) When the wall thickness is known, or the actual wall thickness is measured, the difference between this known wall and the limiting value establishes the maximum corrosion figure. The normal hot forged cylinder of this size will have a measured wall of about 0.250 inch. Comparison of this with the limiting wall thickness shows that defects up to about one-sixteenth inch are allowable provided, of course, that the actual wall is measured or is known.

(iv) Cylinders with general corrosion are evaluated by subjecting them to a hydrostatic test. Thus, a cylinder with an elastic expansion of 227 cc. or greater shall be rejected. If areas of pronounced pitting are included within the general corrosion, the depth of such pitting should also be measured (with the high spots of the actual surface as a reference plane) and the criteria established in the first example apply. Thus, the maximum corrosion limit would be one thirty-second inch when the wall was not known.

(v) Any defect of appreciable depth having a sharp bottom is a stress raiser and even though a cylinder may be acceptable from a stress standpoint, it is common practice to remove such defects. After any such repair operation, verification of the cylinder strength and structure shall be made by a hydrostatic test or other suitable means.

(vi) Dents can be tolerated when the cylinder wall is not deformed excessively or abruptly. Generally speaking, dents are accepted up to a depth of about one-sixteenth inch when the major diameter

of the dent is equal to or greater than 32 times the depth of the dent. Sharper dents than this are considered too abrupt and shall require rejection of the cylinder. On small diameter cylinders these general rules may have to be adjusted. Considerations of appearance play a major factor in the evaluation of dents.

(vii) Cylinders with arc or torch burns shall be removed from service. Defects of this nature may be recognized by one of the following conditions:

(*a*) Removal of metal by scarfing or cratering.

(*b*) A sintering or burning of the base metal.

(*c*) A hardened heat affected zone. A simple method for verifying the presence of small arc burns is to file the suspected area. The hardened zone will resist filing as compared to the softer base metal.

(viii) Cylinders are normally produced with a symmetrical shape. Cylinders with distinct visual bulges shall be removed from service until the nature of the defect is determined. Some cylinders may have small discontinuities related to the manufacturing process—mushroomed bottoms, offset shoulders, etc. These usually can be identified and are not normally cause for concern.

(ix) Cylinders shall be carefully inspected for evidences of exposure to fire, see paragraph (c)(3)(x) of this section.

(x) Cylinder necks shall be examined for serious cracks, folds, and flaws. See paragraphs (c)(3)(xii) and (xiii) of this section.

(f) *Internal inspection.* (1) Cylinders shall be inspected internally at least every time the cylinder is periodically retested. This examination shall be made with a light of sufficient intensity to clearly illuminate the interior walls.

(2) A hammer test consists of tapping a cylinder a light blow with a suitably sized hammer. A cylinder, emptied of liquid content, with a clean internal surface, standing free, will have a clear ring. Cylinders with internal corrosion will give a duller ring dependent upon the amount of corrosion and accumulation of foreign material. Such cylinders shall be investigated. The hammer test is very sensitive and is an easy, quick, and convenient test that can be made without removing the valve before each charging. It is an invaluable indicator of internal corrosion.

§ 1910.167 Safety relief devices for compressed gas cylinders.

(a) *Definitions.* As used in this section:

(1) *Safety relief device.* A "safety relief device" is a device intended to prevent rupture of a cylinder under certain conditions of exposures. (The term as used herein shall include the approach channel, the operating parts, and the discharge channel.)

(2) *Approach channel.* An "approach channel" is the passage or passages through which gas must pass from the cylinder to reach the operating parts of the safety relief device.

(3) *Discharge channel.* A "discharge channel" is the passage or passages beyond the operating parts through which gas must pass to reach the atmosphere exclusive of any piping attached to the outlet of the device.

(4) *Safety relief device channel.* A "safety relief device channel" is the channel through which gas released by operation of the device must pass from the cylinder to the atmosphere exclusive of any piping attached to the inlet or outlet of the device.

(5) *Operating part.* The "operating part" of a safety relief device is the part of a safety relief device that normally closes the safety discharge channel but when moved from this position as a result of the action of heat or pressure, or a combination of the two, permits escape of gas from the cylinder.

(6) *Frangible disc.* A "frangible disc" is an operating part in the form of a disc, usually of metal and which is so held as to close the safety relief device channel under normal conditions. The disc is intended to burst at a predetermined pressure to permit the escape of gas.

(7) *Pressure opening.* A "pressure opening" is the orifice against which the frangible disc functions.

(8) *Rated bursting pressure.* A "rated bursting pressure" of a frangible disc is the maximum pressure for which the disc is designed to burst when in contact with the pressure opening for which it was designed when tested.

(9) *Fusible plug.* A "fusible plug" is an operating part in the form of a plug of suitable low melting material, usually a metal alloy, which closes the safety relief device channel under normal conditions and is intended to yield or melt at a predetermined temperature to permit the escape of gas.

(10) *Yield temperature.* The "yield temperature" of a fusible plug is the temperature at which the fusible metal or alloy will yield when tested.

(11) *Reinforced fusible plug.* A "reinforced fusible plug" is a fusible plug consisting of a core of suitable material having a comparatively high yield temperature surrounded by a low-melting point fusible metal of the required yield temperature.

(12) *Combination frangible disc-fusible plug.* A "combination frangible disc-fusible plug" is a frangible disc in combination with a low melting point fusible metal, intended to prevent its bursting at its predetermined bursting pressure unless the temperature also is high enough to cause yielding or melting of the fusible metal.

(13) *Safety relief valve.* A "safety relief valve" is a safety relief device containing an operating part that is held normally in a position closing the safety relief device channel by spring force and is intended to open and to close at predetermined pressures.

(14) *Combination safety relief valve and fusible plug.* A "combination safety relief valve and fusible plug" is a safety relief device utilizing a safety relief valve in combination with a fusible plug. This combination device may be an integral unit or separate units and is intended to open and to close at predetermined pressures or to open at a predetermined temperature.

(15) *Set pressure.* The "set pressure" of a safety relief valve is the pressure marked on the valve and at which it is set to start-to-discharge.

(16) *Start-to-discharge pressure.* The "start-to-discharge pressure" of a safety relief valve is the pressure at which the first bubble appears through a water seal of not over 4 inches on the outlet of the safety relief valve.

(17) *Flow capacity.* The "flow capacity" of a safety relief device is the capacity in cubic feet per minute of free air discharged at the required flow rating pressure.

(18) *Flow rating pressure.* The "flow rating pressure" is the pressure at which a safety relief device is rated for capacity.

(19) *Nonliquefied compressed gas.* A "nonliquefied compressed gas" is a gas, other than a gas in solution which under the charging pressure, is entirely gaseous at a temperature of 70° F.

(20) *Liquefied compressed gas.* A "liquefied compressed gas" is a gas which, under the charging pressure, is partially liquid at a temperature of 70° F. A flammable compressed gas which is normally nonliquefied at 70° F. but which is partially liquid under the charging pressure and temperature, shall follow the requirements for liquefied compressed gases.

(21) *Compressed gas in solution.* A "compressed gas in solution" (Acetylene) is a nonliquefied gas which is dissolved in a solvent.

(22) *Pressurized liquid compressed gas.* A "pressurized liquid compressed gas" is a compressed gas other than a compressed gas in solution, which cannot be liquefied at a temperature of 70° F., and which is maintained in the liquid state at a pressure not less than 40 p.s.i.a. by maintaining the gas at a temperature less than 70° F.

(23) *Test pressure of the cylinder.* The "test pressure of the cylinder" is the minimum pressure at which a cylinder must be tested as prescribed in DOT specifications for compressed gas cylinders 41 CFR Ch. I.

(24) *Free air or free gas.* "Free air" or "free gas" is air or gas measured at a pressure of 14.7 pounds per square inch absolute and a temperature of 60° F.

(25) *DOT regulations.* As used in this section "DOT regulations" refers to the U.S. Department of Transportation Regulations for Transportation of Explosives and Other Dangerous Articles by Land and Water in Rail Freight, Express and Baggage Services and by Motor Vehicle (Highway) and Water, including Specifications for Shipping Containers, Code of Federal Regulations, Title 49, Parts 171 to 178.

(b) *General requirements*—(1) *Application.* Compressed gas cylinder, portable tanks, and cargo tanks shall have pressure relief devices installed and maintained in accordance with Compressed Gas Association Pamphlets S–1.1–1963 and 1965 addenda and S–1.2–1963.

(2) *Types of safety relief devices.* Types of safety relief devices as covered by this section are designated as follows:

(i) Type CG–1: Frangible disc.

(ii) Type CG–2: Fusible plug or reinforced fusible plug utilizing a fusible alloy with yield temperature not over 170° F., nor less than 157° F. (165° F. nominal).

(iii) Type CG–3: Fusible plus or reinforced fusible plug utilizing a fusible alloy with yield temperature not over 220° F., nor less than 208° F. (212° F. nominal).

(iv) Type CG–4: Combination frangible disc-fusible plug, utilizing a fusible alloy with yield temperature not over 170° F., nor less than 157° F. (165° F. nominal).

(v) Type CG–5: Combination frangible disc-fusible plug, utilizing a fusible alloy with yield temperature not over 220° F., nor less than 208° F. (212° F. nominal).

(vi) Type CG–7: Safety relief valve.

(vii) Type CG–8: Combination safety relief valve and fusible plug.

(3) *Specifications and tests.* All safety relief devices covered by this section shall meet the design, construction, marking and test specification of the "Compressed Gas Association Safety Relief Device Standards Part 1—Cylinders for Compressed Gases: S1.1–1963."

(4) *Specific requirements for safety relief devices.* (i) Compressed gas cylinders, which under the Regulations of the Department of Transportation must be equipped with safety relief devices, shall be considered acceptable when equipped with devices of proper construction, location, and discharge capacity under the conditions prescribed in Table 1 of the Compressed Gas Associations Standard S–1.1–1963.

(ii) Only replacement parts or assemblies provided by the manufacturer shall be used unless the advisability of interchange is proved by adequate tests.

(iii) When a frangible disc is used with a compressed gas cylinder, the rated bursting pressure of the disc shall not exceed the minimum required test pressure of the cylinder with which the device is used, except for DOT–3E cylinders (49 CFR Ch. I) the rated bursting pressure of the device shall not exceed 4,500 pounds per square inch gage (p.s.i.g.).

(iv) When a safety relief valve is used on a compressed gas cylinder, the flow rating pressure shall not exceed the minimum required test pressure of the cylinder on which the safety relief valve is installed and the reseating pressure shall not be less than the pressure in a normally charged cylinder at 130° F.

(v) When fittings and piping are used on either the upstream or downstream side of both of a safety relief device or devices, the passages shall be so designed that the flow capacity of the safety relief device will not be reduced below the capacity required for the container on which the safety relief device assembly is installed, nor to the extent that the operation of the device could be impaired. Fittings, piping, and method of attachment shall be designed to withstand normal handling and the pressures developed when the device or devices function.

(vi) No shutoff valve shall be installed between the safety relief devices and the cylinder.

(5) *Maintenance requirements for safety relief devices.* (i) As a precaution to keep cylinder safety relief devices in reliable operating condition, care shall be taken in the handling or storing of compressed gas cylinders to avoid damage. Care shall also be exercised to avoid plugging by paint or other dirt accumulation of safety relief device channels or other parts which could interfere with the functioning of the device. Only qualified personnel shall be allowed to service safety relief devices.

(ii) Each time a compressed gas cylinder is received at a point for refilling, all safety relief devices shall be examined externally for corrosion, damage, plugging of external safety relief device channels, and mechanical defects such as leakage or extrusion of fusible metal. If there is any doubt regarding the suitability of the safety relief device for service the cylinder shall not be filled until it is equipped with a suitable device.

§ 1910.168 Safety relief devices for cargo and portable tanks storing compressed gases.

(a) *Definitions applicable to this section.*—(1) *Cargo tank.* A "cargo tank" means any container designed to be permanently attached to any motor vehicle or other highway vehicle and in which is to be transported any compressed gas. The term "cargo tank" shall not be construed to include any tank used solely for the purpose of supplying fuel for the propulsion of the vehicle or containers fabricated under specifications for cylinders.

(2) *Portable tank.* A "portable tank" means any container designed primarily to be temporarily attached to a motor vehicle, other vehicle, railroad car other than tank car, or marine vessel, and equipped with skids, mountings, or accessories to facilitate handling of the container by mechanical means, in which is to be transported any compressed gas. The term "portable tank" shall not be construed to include any cargo tank, any tank car tank, or any tank of the DOT–106A and DOT–110A–W type.

(3) *Safety relief device.* A "safety relief device" means a device intended to prevent rupture of a container under certain conditions of exposure.

(4) *Safety relief valve.* A "safety relief valve" means a safety relief device containing an operating part that is held normally in a position closing the safety relief device channel by spring force and is intended to open and to close at predetermined pressures.

(5) *Set pressure.* The "set pressure" of a safety relief valve is the pressure marked on the valve and at which the valve is set to start-to-discharge.

(6) *Start-to-discharge pressure.* The "start-to-discharge pressure" of a safety relief valve is the pressure at which the first bubble appears through a water seal of not over 4 inches on the outlet of the valve.

NOTE: When the nature of the service requires the use of a metal-to-metal seat safety relief, valve, with or without secondary sealing means, the start-to-discharge pressure may be considered the pressure at which an audible discharge occurs.

(7) *Reseating pressure.* The "reseating pressure" of a safety relief valve is the pressure at which leakage ceases through a water seal of not over 4 inches on the outlet of the valve.

(8) *Flow capacity.* The "flow capacity" of a safety relief device is the capacity in cubic feet per minute of free air discharged at the required flow rating pressure.

(9) *Flow rating pressure.* The "flow rating pressure" means the pressure at which a safety relief device is rated for capacity.

(10) *Free air or free gas.* "Free air" or "free gas" means air or gas measured at a pressure of 14.7 pounds per square inch absolute and a temperature of 60° F.

(11) *Frangible disc.* A "frangible disc" means a safety relief device in the form of a disc, usually of metal, which is so held as to close the safety relief device channel under normal conditions. The disc is intended to burst at a predetermined pressure to permit the escape of gas.

(12) *Fusible plug.* A "fusible plug" means a safety relief device in the form of a plug of suitable low-melting material, usually a metal alloy, which closes the safety relief device channel under normal conditions and is intended to yield or melt at a predetermined temperature to permit the escape of gas.

(13) *DOT design pressure.* The "DOT design pressure" is identical to the term "maximum allowable working pressure" as used in the "Code" and is the maximum gage pressure at the top of the tank in its operating position. To determine the minimum permissible thickness of physical characteristics of the different parts of the vessel, the static head of the lading shall be added to the DOT design pressure to determine the thickness of any specific part of the vessel. If vacuum insulation is used, the liquid container shall be designed for a pressure of 15 p.s.i. more than DOT design pressure, plus static head of the lading.

EXCEPTION: For containers constructed in accordance with paragraph U–68 or U–69 of section VIII of the ASME Boiler and Pressure Vessel Code, 1949 Edition, the maximum allowable working pressure for the purpose of these standards is considered to be 125 percent of the design pressure as provided in 49 CFR 173.315 of DOT Regulations.

(14) *Code.* "Code" is defined as paragraph U–68, U–69, U–200 or U–201 of section VIII of the Boiler and Pressure Vessel Code of the American Society of Mechanical Engineers, 1949 Edition; or section VIII of the Boiler and Pressure Vessel Code of the American Society of Mechanical Engineers, 1950, 1952, 1956,

1959, and 1962 Editions; or The Code for Unfired Pressure Vessels for Petroleum Liquids and Gases of the American Petroleum Institute and the American Society of Mechanical Engineers (API-ASME), 1951 Edition.

(15) *DOT regulations.* The "DOT regulations" refers to Department of Transportation Regulations for Transportation of Explosives and Other Dangerous Articles by Land and Water in Rail Freight, Express and Baggage Services and by Motor Vehicle (Highway) and Water, including Specifications for Shipping Containers," Code of Federal Regulations, Title 49, Parts 171 to 178.

(b) *General requirements*—(1) *Application.* See § 1910.167(b)(1).

(2) *Specifications and tests.* All safety relief devices covered by this section shall meet the design, construction, marking, and test specifications of the "Compressed Gas Associations Safety Relief Device Standards Part 2—Cargo and Portable Tanks for Compressed Gases: S-1.2-1963."

(3) *Specific requirements for safety relief devices.* (i) Each container shall be provided with one or more safety relief devices which, unless otherwise specified, shall be safety relief valves of the spring-loaded type.

(ii) Safety relief valves shall be set to start-to-discharge at a pressure not in excess of 110 percent of the DOT design pressure of the container nor less than the DOT design pressure of the container except as follows:

(*a*) If an overdesigned container is used, the set pressure of the safety relief valve may be between the minimum required DOT design pressure for the lading and 110 percent of the DOT design pressure of the container used.

(*b*) For sulfur dioxide containers, a minimum set pressure of 120 and 110 p.s.i.g. is permitted for the 150 and 125 p.s.i.g. DOT design pressure containers, respectively.

(*c*) For carbon dioxide (refrigerated), nitrous oxide (refrigerated), and pressurized liquid argon, nitrogen and oxygen, there shall be no minimum set pressure.

(*d*) For butadiene, inhibited, and liquefied petroleum gas containers, a minimum set pressure of 90 percent of the minimum design pressure permitted for these ladings may be used.

(*e*) For containers constructed in accord with paragraph U-68 or U-69 of the Code 1949 Edition, the set pressure marked on the safety relief valve may be 125 percent of the original DOT design pressure of the container.

(iii) Only replacement parts or assemblies provided by the manufacturer of the device shall be used unless the suitability of interchange is proved by adequate tests.

(iv) Safety relief valves shall have direct communication with the vapor space of the container.

(v) Any portion of liquid piping or hose which at any time may be closed at each end must be provided with a safety relief device to prevent excessive pressure.

(vi) The additional restrictions of this subdivision apply to safety relief devices on containers for carbon dioxide or nitrous oxide which are shipped in refrigerated and insulated containers. The maximum operating pressure in the container may be regulated by the use of one or more pressure controlling devices, which devices shall not be in lieu of the safety relief valve required in subdivision (i) of this subparagraph.

(vii) All safety relief devices shall be so installed and located that the cooling effect of the contents will not prevent the effective operation of the device.

(viii) In addition to the safety relief valves required by subdivision (i) of this subparagraph each container for carbon dioxide may be equipped with one or more frangible disc safety relief devices of suitable design set to function at a pressure not exceeding two times the DOT design pressure of the container.

(ix) Subject to conditions of 49 CFR 173.315(a)(1) (DOT Regulations) for methyl chloride and sulfur dioxide optional portable tanks of 225 p.s.i.g. minimum DOT design pressure, one or more fusible plugs approved by the Bureau of Explosives, 63 Vesey Street, New York, NY 10007, may be used in lieu of safety relief valves of the spring-loaded type. If the container is over 30 inches long a safety relief device having the total required flow capacity must be at both ends.

(x) When storage containers for liquefied petroleum gas are permitted to be shipped in accordance with 49 CFR 173.315(j) (DOT Regulations), they must be equipped with safety relief devices in compliance with the requirements for safety relief devices on above-ground containers as specified in the National Fire Protection Association Pamphlet No. 58-1969 "Standard for the Storage and Handling of Liquefied Petroleum Gases."

(xi) When containers are filled by pumping equipment which has a discharge capacity in excess of the capacity of the container safety relief devices, and which is capable of producing pressures in excess of DOT design pressure of the container, precautions should be taken to prevent the development of pressures in the container in excess of 120 percent of its DOT design pressure. This may be done by providing additional capacity of the safety relief valves on the container, by providing a bypass on the pump discharge, or by any other suitable method.

(xii) This additional requirement applies to safety relief devices on containers for liquefied hydrogen and pressurized liquid argon, nitrogen, and oxygen. The liquid container shall be protected by one or more safety relief valves and one or more frangible discs.

(xiii) Safety relief devices shall be arranged to discharge unobstructed to the open air in such a manner as to prevent any impingement of escaping gas upon the container. Safety relief devices shall be arranged to discharge upward except this is not required for carbon dioxide, nitrous oxide and pressurized liquid argon, nitrogen, and oxygen.

(xiv) No shutoff valves shall be installed between the safety relief devices and the container except, in cases where two or more safety relief devices are installed on the same container, a shutoff valve may be used where the arrangement of the shutoff valve or valves is such as always to insure full required capacity flow through at least one safety relief device.

(4) *Maintenance requirements for safety relief devices.* (i) Care shall be exercised to avoid damage to safety relief devices. Care shall also be exercised to avoid plugging by paint or other dirt accumulation of safety relief device channels or other parts which could interfere with the functioning of the device.

(ii) Only qualified personnel shall be allowed to service safety relief devices. Any servicing or repairs which require resetting of safety relief valves shall be done only by or after consultation with the valve manufacturer.

(iii) Safety relief devices periodically shall be examined externally for corrosion damage, plugging of external safety relief device channels, and mechanical defects such as leakage or extrusion of fusible metal. Valves equipped with secondary resilient seals shall have the seals inspected periodically. If there is any doubt regarding the suitability of the safety relief device for service the container shall not be filled until it is equipped with a suitable safety relief device.

§ 1910.169 Air receivers.

(a) *General requirements*—(1) *Application.* This section applies to compressed air receivers, and other equipment used in providing and utilizing compressed air for performing operations such as cleaning, drilling, hoisting, and chipping. On the other hand, however, this section does not deal with the special problems created by using compressed air to convey materials nor the problems created when men work in compressed air as in tunnels and caissons. This section is not intended to apply to compressed air machinery and equipment used on transportation vehicles such as steam railroad cars, electric railway cars, and automotive equipment.

(2) *New and existing equipment* (i) All new air receivers installed after the effective date of these regulations shall be constructed in accordance with the 1968 edition of the A.S.M.E. Boiler and Pressure Vessel code section VIII.

(ii) All safety valves used shall be constructed, installed, and maintained in accordance with the A.S.M.E. Boiler and Pressure Vessel Code, section VIII edition 1968.

(b) *Installation and equipment requirements*—(1) *Installation.* Air receivers shall be so installed that all drains, handholes, and manholes therein are easily accessible. Air receivers should be supported with sufficient clearance to permit a complete external inspection and to avoid corrosion of external surfaces. Under no circumstances shall an air receiver be buried underground or

located in an inaccessible place. The receiver should be located as close to the compressor or aftercooler as is possible in order to keep the discharge pipe short.

(2) *Drains and traps.* A drain pipe and valve shall be installed at the lowest point of every air receiver to provide for the removal of accumulated oil and water. Adequate automatic traps may be installed in addition to drain valves. The drain valve on the air receiver shall be opened and the receiver completely drained frequently and at such intervals as to prevent the accumulation of excessive amounts of liquid in the receiver.

(3) *Gages and valves.* (i) Every air receiver shall be equipped with an indicating pressure gage (so located as to be readily visible) and with one or more spring-loaded safety valves. The total relieving capacity of such safety valves shall be such as to prevent pressure in the receiver from exceeding the maximum allowable working pressure of the receiver by more than 10 percent.

(ii) No valve of any type shall be placed between the air receiver and its safety valve or valves.

(iii) Safety appliances, such as safety valves, indicating devices and controlling devices, shall be constructed, located, and installed so that they cannot be readily rendered inoperative by any means, including the elements.

(iv) All safety valves shall be tested frequently and at regular intervals to determine whether they are in good operating condition.

§ 1910.170 Sources of standards.

Sec.	Source
1910.166	41 CFR 50-204.65 referencing CGA C-6-1968, Standards for Visual Inspection of Compressed Gas Cylinders.
1910.167	41 CFR 50-204.71 and CGA Pamphlets S-1.1-1963 and 1965 addenda and S-1.2-1963 and 1965 addenda and S-1.2-1963, Safety Relief Device Standards.
1910.169	ANSI B-19, 1938 Safety Code for Compressed Air Machinery.

§ 1910.171 Standards organizations.

Specific standards of the following organizations have been referenced in this part. Copies of the referenced materials may be obtained from the issuing organizations.

Compressed Gas Association, Inc., 500 Fifth Avenue, New York, NY 10036.

American Society of Mechanical Engineers, Inc., United Engineering Center, 345 East 47th Street, New York, NY 10017.

National Fire Protection Association, 60 Batterymarch Street, Boston, MA 02110.

American National Standards Institute, 1430 Broadway, New York, NY 10018.

Subpart N—Materials Handling and Storage

§ 1910.176 Handling materials—general.

(a) *Use of mechanical equipment.* Where mechanical handling equipment is used, sufficient safe clearances shall be allowed for aisles, at loading docks, through doorways and wherever turns or passage must be made. Aisles and passageways shall be kept clear and in good repair, with no obstruction across or in aisles that could create a hazard. Permanent aisles and passageways shall be appropriately marked.

(b) *Secure storage.* Storage of material shall not create a hazard. Bags, containers, bundles, etc., stored in tiers shall be stacked, blocked, interlocked and limited in height so that they are stable and secure against sliding or collapse.

(c) *Housekeeping.* Storage areas shall be kept free from accumulation of materials that constitute hazards from tripping, fire, explosion, or pest harborage. Vegetation control will be exercised when necessary.

(d) *Drainage.* Proper drainage shall be provided.

(e) *Clearance limits.* Clearance signs to warn of clearance limits shall be provided.

(f) *Rolling railroad cars.* Derail and/or bumper blocks shall be provided on spur railroad tracks where a rolling car could contact other cars being worked, enter a building, work or traffic area.

(g) *Guarding.* Covers and/or guardrails shall be provided to protect personnel from the hazards of open pits, tanks, vats, ditches, etc.

§ 1910.177 Indoor general storage.

(a) *Definitions applicable to this section.* (1) "Available height for storage" means the maximum height at which commodities can be stored above the floor and still maintain adequate clearance from structural members and the required clearance below sprinklers.

(2) "Ordinary combustibles" designates commodities packaging or storage aids which have heats of combustion (British thermal units per pound) similar to wood, cloth, or paper and which produce fires that may normally be extinguished by the quenching and cooling effect of water. This type of fire is defined as a Class A fire in the Standard for the Installation of Portable Fire Extinguishers, NFPA No. 10-1970.

(3) "Exposure" means the exterior presence of combustibles which, if ignited, could cause damage to the storage building or its contents.

(4) A "firewall" is a wall designed to prevent the spread of fire, having a fire resistance rating of not less than 4 hours and having sufficient structural stability under fire conditions to allow collapse of construction on either side without collapse of wall.

(5) "Horizontal channel" means any uninterrupted space in excess of 5 feet in length between horizontal layers of stored commodities. Such channels may be formed by pallets, shelving, racks, or other storage arrangements.

(6) "Noncombustible" designates commodities, packaging, or storage aids which will not ignite, burn or liberate flammable gases when heated to a temperature of 1,380° Fahrenheit for 5 minutes.

(7) "Packaging" designates any commodity wrapping, cushioning, or container.

(8) "Storage aids" means commodity storage devices such as shelves, pallets, dunnage, decks, platforms, trays, bins, separators, and skids.

(9) A "warehouse" is any building or area within a building used principally for the storage of commodities.

(10) "Type I storage" is that in which combustible commodities or noncombustible commodities involving combustible packaging or storage aids are stored over 15 feet but not more than 21 feet high in solid piles or over 12 feet but not more than 21 feet high in piles that contain horizontal channels. Minor quantities of commodities of hazard greater than ordinary combustibles may be included without affecting this general classification.

(11) "Type II storage" is that in which combustible commodities or noncombustible commodities involving combustible packaging or storage aids are stored not over 15 feet high in solid piles or not over 12 feet high in piles that contain horizontal channels. Minor quantities of commodities of hazard greater than ordinary combustibles may be included without affecting this general classification.

(12) "Type III storage" is that in which the stored commodities, packaging and storage aids are noncombustible or contain only a small concentration of combustibles which are incapable of producing a fire that would cause appreciable damage to the commodities stored or to noncombustible wall, floor or roof construction. Ordinary combustible commodities in completely sealed noncombustible containers may qualify in this classification. General commodity storage that is subject to frequent changing and storage of combustible packaging and storage aids is excluded from this category.

(13) "Approved" means listed or approved by at least one of the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

(b) *General requirements*—(1) *Application.* This standard applies to storage, 21 feet or less in height, of commodities which with their packaging and storage aids would classify as ordinary combustibles. This standard also applies to storage of commodities which with their packaging and storage aids would classify as noncombustibles regardless of storage height. This standard does not cover unpackaged bulk storage such as grain, coal, or similar commodities. The provisions contained in this standard apply to new buildings. Certain specific commodities introduce hazards different from those contemplated by this standard. Examples are rubber tires, roll paper, and wax-coated cartons.

(2) *Exemptions.* (i) Ordinary combustibles piled higher than 21 feet introduce serious fire protection problems which are not within the scope of this standard.

(ii) The provisions of this standard do not apply to Refrigerated Warehouses.

(3) *Portable fire extinguishers.* Portable fire extinguishers shall be provided at convenient conspicuously accessible locations. In locations where small hose is provided, portable fire extinguishers for Class A fires may be omitted.

(4) *Alarm service.* Storage facilities shall be provided with alarm service. (It may be in the form of central station supervision of automatic fire detection or sprinkler waterflow alarms or watchman making recorded rounds during unattended periods.)

(c) *Piling procedures and precautions.* (1) All commodities shall be stored, handled and piled with due regard to their fire characteristics.

(2) Significant quantities of commodities with fire hazards greater than ordinary combustible commodities as contemplated by this standard, shall be separated from the main bulk of storage by firewalls.

(3) Any commodities which may be hazardous in combination with each other shall be stored so that they cannot come in contact with each other.

(4) Safe floor loads shall not be exceeded.

(d) *Fire protection requirements—* (1) *Sprinkler systems.* All warehouses having combustible roof or floor construction and all warehouses containing Type I or Type II storage shall be protected with a system of automatic sprinklers designed and installed in accordance with the Standard for the Installation of Sprinkler Systems, NFPA No. 13–1969.

(2) *Hose system water supply.* (i) Water supplies for hose streams shall be provided to supplement that required for automatic sprinklers.

(ii) Where private underground supply mains are necessary, they shall be installed in accordance with Standard for Outside Protection, NFPA No. 24–1970.

(3) *Hose systems.* (i) Small hose (1½ inch) where required by this standard shall be installed in accordance with Standard for the Installation of Sprinkler Systems, NFPA No. 13–1969 and Standard for the Installation of Standpipe and Hose Systems, NFPA No. 14–1970.

(ii) In Type I and Type II storage, sufficient small hose (1½ inch) shall be provided so that one hose stream can reach any portion of the storage area. In buildings three stories or less high, small hose (1½ inch) may be supplied from the sprinkler system in accordance with limitations outlined in Standard for the Installation of Sprinkler Systems, NFPA No. 13–1969.

(iii) Standpipe and hose systems conforming to the requirements of Standard for the Installation of Standpipe and Hose Systems, NFPA No. 14–1970, shall be provided for buildings over three stories in height or having a floor level 75 feet or more above grade. Standpipes shall be fully equipped for fire department operations including fire department connections.

(iv) Large hose (2½ inch) and related equipment shall be provided unless the public fire department will provide such equipment promptly.

(e) *Mechanical handling equipment.* (1) Power-operated industrial trucks shall be of type designated in Standard for the Use, Maintenance and Operation of Powered Industrial Trucks, NFPA No. 505–1969, Part A, in accordance with the hazards of the location in which they are used.

(2) Maintenance and operation of electric, liquid, and gaseous fueled industrial trucks shall be in accordance with Standard for the Use, Maintenance and Operation of Powered Industrial Trucks, NFPA No. 505–1969, Parts B and C.

(f) *Building service equipment.* (1) Heating, lighting, and service equipment shall be of approved types, installed, maintained and operated in accordance with good practice.

(2) Steam lines and other heating equipment and machinery shall be installed or protected so that the stored commodities cannot come in contact with the heating elements.

(3) Electrical equipment shall be installed in accordance with the provisions of the National Electrical Code, NFPA No. 70–1968.

(4) Refrigeration systems, if used, shall conform to the recommendations of Safety Code for Mechanical Refrigeration, American Society of Heating, Refrigeration and Air Conditioning Engineers, Inc. (ASHRE) 15–63, ANSI B9.1–1964.

(5) Stored commodities shall not be located under liquid fuel heating equipment.

(g) *Smoking.* Smoking shall be strictly prohibited, except in locations prominently designated as smoking areas, and "No Smoking" signs shall be posted in prohibited areas.

§ 1910.178 Powered industrial trucks.

(a) *General requirements.* (1) The requirements of this section apply to fire protection for fork trucks, tractors, platform lift trucks, motorized hand trucks and other specialized industrial trucks powered by electric motors or internal combustion engines. These fire protection requirements do not apply to compressed air or nonflammable compressed gas-operated industrial trucks, nor to farm vehicles, nor automotive vehicles for highway use.

(2) All new powered industrial trucks acquired after the effective date of this subpart shall meet the design specifications established in the "American National Standard for Powered Industrial Trucks, Part II, ANSI B56.1–1969", except for vehicles intended primarily for earth moving or over-the-road hauling.

(3) Approved trucks shall bear a label or some other identifying mark indicating approval by the testing laboratory.

(4) Modifications and additions which affect capacity and safe operation shall not be performed by the customer or user without manufacturers prior written approval. Capacity, operation, and maintenance instruction plates, tags, or decals shall be changed accordingly.

(5) If the truck is equipped with front-end attachments other than factory installed attachments, the user shall request that the truck be marked to identify the attachments and show the approximate weight of the truck and attachment combination at maximum elevation with load laterally centered.

(6) The user shall see that all nameplates and markings are in place and are maintained in a legible condition.

(7) Definition: As used in this section, "approved" means listed or approved by at least one of the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

(b) *Designations.* For the purpose of this standard there are eleven different designations of industrial trucks or tractors as follows: D, DS, DY, E, ES, EE, EX, G, GS, LP, and LPS.

(1) The D designated units are units similar to the G units except that they are diesel engine powered instead of gasoline engine powered.

(2) The DS designated units are diesel powered units that are provided with additional safeguards to the exhaust, fuel and electrical systems. They may be used in some locations where a D unit may not be considered suitable.

(3) The DY designated units are diesel powered units that have all the safeguards of the DS units and in addition do not have any electrical equipment including the ignition and are equipped with temperature limitation features.

(4) The E designated units are electrically powered units that have minimum acceptable safeguards against inherent fire hazards.

(5) The ES designated units are electrically powered units that, in addition to all of the requirements for the E units, are provided with additional safeguards to the electrical system to prevent emission of hazardous sparks and to limit surface temperatures. They may be used in some locations where the use of an E unit may not be considered suitable.

(6) The EE designated units are electrically powered units that have, in addition to all of the requirements for the E and ES units, the electric motors and all other electrical equipment completely enclosed. In certain locations the EE unit may be used where the use of an E and ES unit may not be considered suitable.

(7) The EX designated units are electrically powered units that differ from the E, ES, or EE units in that the electrical fittings and equipment are so designed, constructed and assembled that the units may be used in certain atmospheres containing flammable vapors or dusts.

(8) The G designated units are gasoline powered units having minimum acceptable safeguards against inherent fire hazards.

(9) The GS designated units are gasoline powered units that are provided with additional safeguards to the exhaust,

fuel, and electrical systems. They may be used in some locations where the use of a G unit may not be considered suitable.

(10) The LP designated unit is similar to the G unit except that liquefied petroleum gas is used for fuel instead of gasoline.

(11) The LPS designated units are liquefied petroleum gas powered units that are provided with additional safeguards to the exhaust, fuel, and electrical systems. They may be used in some locations where the use of an LP unit may not be considered suitable.

(12) The atmosphere or location shall have been classified as to whether it is hazardous or nonhazardous prior to the consideration of industrial trucks being used therein and the type of industrial truck required shall be as provided in paragraph (d) of this section for such location.

(c) *Designated locations.* (1) The industrial trucks specified under subparagraph (2) of this paragraph are the minimum types required but industrial trucks having greater safeguards may be used if desired.

(2) For specific areas of use see Table N–1 which tabulates the information contained in this section.

TABLE N–1

SUMMARY TABLE ON USE OF INDUSTRIAL TRUCKS IN VARIOUS LOCATIONS

Classes	Unclassified	Class I locations				Class II locations			Class III locations	
Description of classes	Locations not possessing atmospheres as described in other columns.	Locations in which flammable gases or vapors are, or may be, present in the air in quantities sufficient to produce explosive or ignitible mixtures.				Locations which are hazardous because of the presence of combustible dust.			Locations where easily ignitible fibers or flyings are present but not likely to be in suspension in quantities sufficient to produce ignitible mixtures.	
Groups in classes	None	A	B	C	D	E	F	G	None	
Examples of locations or atmospheres in classes and groups	Piers and Wharves inside and outside general storage General industrial or commercial properties	Acetylene	Hydrogen	Ethyl ether	Gasoline Naphtha Alcohols Acetone Lacquer solvent Benzene	Metal dust	Carbon black Coal dust Coke dust	Grain dust Flour dust Starch dust Organic dust	Baled waste, cocoa fiber, cotton, excelsior, hemp, istle, jute, kapok, oakum, sisal, Spanish moss, synthetic fibers, tow.	
		1		2		1		2	1	2
Divisions (Nature of Hazardous Conditions)	None	Above condition exists continuously, intermittently, or periodically under normal operating conditions.		Above condition may occur accidentally as due to a puncture of a storage drum.		Explosive mixture may be present under normal operating conditions, or where failure of equipment may cause the condition to exist simultaneously with arcing or sparking of electrical equipment, or where dusts of an electrically conducting nature may be present.		Explosive mixture not normally present, but where deposits of dust may cause heat rise in electrical equipment, or where such deposits may be ignited by arcs or sparks from electrical equipment.	Locations in which easily ignitible fibers or materials producing combustible flyings are handled, manufactured, or used.	Locations in which easily ignitible fibers are stored or handled (except in the process of manufacture).
Authorized uses of trucks by types in groups of classes and divisions										
Groups in classes	None	A	B	C	D	E	F	G	None	None
Types of trucks authorized:										
Diesel:										
Type D	D**									
Type DS					DS			DS		DS
Type DY					DY			DY	DY	DY
Electric:										
Type E	E**									E
Type ES					ES			ES		ES
Type EE					EE			EE	EE	EE
Type EX			EX		EX		EX	EX	EX	EX
Gasoline:										
Type G	G**									
Type GS					GS			GS		GS
LP-Gas:										
Type LP	LP**									
Type LPS					LPS			LPS		LPS
Paragraph Ref. in No. 505	210.211	201 (a)	203 (a)	209 (a)	204 (a), (b)	202 (a)	205 (a)	206 (a), (b)	207 (a)	208 (a)

**Trucks conforming to these Types may also be used—see subdivision (c)(2)(x) and (c)(2)(xii) of this section.

References in parentheses are to the corresponding classification as used in the National Electrical Code (NFPA No. 70, ANSI Standard CI–1968) for the convenience of persons familiar with those classifications.

(i) Power-operated industrial trucks shall not be used in atmospheres containing hazardous concentration of acetylene, butadiene, ethylene oxide, hydrogen (or gasses or vapors equivalent in hazard to hydrogen, such as manufactured gas), propylene oxide, acetaldehyde, cyclopropane, diethyl ether, ethylene, isoprene, or unsymmetrical dimethyl hydrazine (UDMH).

(ii) (*a*) Power-operated industrial trucks shall not be used in atmospheres containing hazardous concentrations of metal dust, including aluminum, magnesium, and their commercial alloys, other metals of similarly hazardous characteristics, or in atmospheres containing carbon black, coal or coke dust except approved power-operated industrial trucks designated as EX may be used in such atmospheres.

(*b*) In atmospheres where dust of magnesium, aluminum or aluminum bronze may be present, fuses, switches, motor controllers, and circuit breakers of trucks shall have enclosures specifically approved for such locations.

(iii) Only approved power-operated industrial trucks designated as EX may be used in atmospheres containing acetone, acrylonitrile, alcohol, ammonia, benzine, benzol, butane, ethylene dichloride, gasoline, hexane, lacquer solvent vapors, naphtha, natural gas, propane, propylene, styrene, vinyl acetate, vinyl chloride, or xylenes in quantities sufficient to produce explosive or ignitable mixtures and where such concentrations of these gases or vapors exist continuously, intermittently or periodically under normal operating conditions or may exist frequently because of repair, maintenance operations, leakage, breakdown or faulty operation of equipment.

(iv) Power-operated industrial trucks designated as DY, EE, or EX may be used in locations where volatile flammable liquids or flammable gases are handled, processed or used, but in which the hazardous liquids, vapors or gases will normally be confined within closed containers or closed systems for which they can escape only in case of accidental rupture or breakdown of such containers or systems, or in the case of abnormal operation of equipment; also in locations in which hazardous concentrations of gases or vapors are normally prevented by positive mechanical ventilation but which might become hazardous through failure or abnormal operation of the ventilating equipment; or in locations which are adjacent to Class I, Division 1 locations, and to which hazardous concentrations of gases or vapors might occasionally be communicated unless such communication is prevented by adequate positive-pressure ventilation from a source of clear air, and effective safeguards against ventilation failure are provided.

(v) In locations used for the storage of hazardous liquids in sealed containers or liquified or compressed gases in containers, approved power-operated industrial trucks designated as DS, ES, GS, or LPS may be used. This classification includes locations where volatile flammable liquids or flammable gases or vapors are used, but which, would become hazardous only in case of an accident or of some unusual operating condition. The quantity of hazardous material that might escape in case of accident, the adequacy of ventilating equipment, the total area involved, and the record of the industry or business with respect to explosions or fires are all factors that should receive consideration in determining whether or not the DS or DY, ES, EE, GS, LPS designated truck possesses sufficient safeguards for the location. Piping without valves, checks, meters and similar devices would not ordinarily be deemed to introduce a hazardous condition even though used for hazardous liquids or gases. Locations used for the storage of hazardous liquids or of liquified or compressed gases in sealed containers would not normally be considered hazardous unless subject to other hazardous conditions also.

(vi) (*a*) Only approved power-operating industrial trucks designated as EX shall be used in atmospheres in which combustible dust is or may be in suspension continuously, intermittently, or periodically under normal operating conditions, in quantities sufficient to produce explosive or ignitable mixtures, or where mechanical failure or abnormal operation of machinery or equipment might cause such mixtures to be produced.

(*b*) The EX classification usually includes the working areas of grain handling and storage plants, room containing grinders or pulverizers, cleaners, graders, scalpers, open conveyors or spouts, open bins or hoppers, mixers, or blenders, automatic or hopper scales, packing machinery, elevator heads and boots, stock distributors, dust and stock collectors (except all-metal collectors vented to the outside), and all similar dust producing machinery and equipment in grain processing plants, starch plants, sugar pulverizing plants, malting plants, hay grinding plants, and other occupancies of similar nature; coal pulverizing plants (except where the pulverizing equipment is essentially dust tight); all working areas where metal dusts and powders are produced, processed, handled, packed, or stored (except in tight containers); and other similar locations where combustible dust may, under normal operating conditions, be present in the air in quantities sufficient to produce explosive or ignitable mixtures.

(vii) Only approved power-operated industrial trucks designated as DY, EE, or EX shall be used in atmospheres in which combustible dust will not normally be in suspension in the air or will not be likely to be thrown into suspension by the normal operation of equipment or apparatus in quantities sufficient to produce explosive or ignitable mixtures but where deposits or accumulations of such dust may be ignited by arcs or sparks originating in the truck.

(viii) Only approved power-operated industrial trucks designated as DY, EE, or EX shall be used in locations which are hazardous because of the presence of easily ignitible fibers or flyings but in which such fibers or flyings are not likely to be in suspension in the air in quantities sufficient to produce ignitible mixtures.

(ix) Only approved power-operated industrial trucks designated as DS, DY, ES, EE, EX, GS, or LPS be used in locations where easily ignitible fibers are stored or handled, including outside storage, but are not being processed or manufactured. Industrial trucks designated as E, which have been previously used in these locations may be continued in use.

(x) On piers and wharves handling general cargo, any approved power-operated industrial truck designated as Type D, E, G, or LP may be used, or trucks which conform to the requirements for these types may be used.

(xi) If storage warehouses and outside storage locations are hazardous only the approved power-operated industrial truck specified for such locations in this paragraph (c)(2) shall be used. If not classified as hazardous, any approved power-operated industrial truck designated as Type D, E, G, or LP may be used, or trucks which conform to the requirements for these types may be used.

(xii) If general industrial or commercial properties are hazardous, only approved power-operated industrial trucks specified for such locations in this paragraph (c)(2) shall be used. If not classified as hazardous, any approved power-operated industrial truck designated as Type D, E, G, or LP may be used, or trucks which conform to the requirements of these types may be used.

(d) *Converted industrial trucks.* Power-operated industrial trucks that have been originally approved for the use of gasoline for fuel, when converted to the use of liquefied petroleum gas fuel in accordance with paragraph (q) of this section, may be used in those locations where G, GS or LP, and LPS designated trucks have been specified in the preceding paragraphs.

(e) *Safety guards.* (1) High Lift Rider trucks shall be fitted with an overhead guard manufactured in accordance with paragraph (a)(2) of this section, unless operating conditions do not permit.

(2) If the type of load presents a hazard, the user shall equip fork trucks with a vertical load backrest extension manufactured in accordance with paragraph (a)(2) of this section.

(f) *Fuel handling and storage.* (1) The storage and handling of liquid fuels such as gasoline and diesel fuel shall be in accordance with NFPA Flammable and Combustible Liquids Code (NFPA No. 30–1969).

(2) The storage and handling of liquefied petroleum gas fuel shall be in accordance with Handling of Liquefied Petroleum Gases (NFPA No. 58–1969).

(g) *Changing and charging storage batteries.* (1) Battery charging installations shall be located in areas designated for that purpose.

(2) Facilities shall be provided for flushing and neutralizing spilled electrolyte, for fire protection, for protecting charging apparatus from damage by trucks, and for adequate ventilation for dispersal of fumes from gassing batteries.

(3) When racks are used for support of batteries, they should be made of materials nonconductive to spark generation or be coated or covered to achieve this objective.

(4) A conveyor, overhead hoist, or equivalent material handling equipment shall be provided for handling batteries.

(5) Reinstalled batteries shall be properly positioned and secured in the truck.

(6) A carboy tilter or siphon shall be provided for handling electrolyte.

(7) When charging batteries, acid shall be poured into water; water shall not be poured into acid.

(8) Trucks shall be properly positioned and brake applied before attempting to change or charge batteries.

(9) When charging batteries, the vent caps should be kept in place to avoid electrolyte spray. Care shall be taken to assure that vent caps are functioning. The battery (or compartment) cover(s) shall be open to dissipate heat.

(10) Smoking shall be prohibited in the charging area.

(11) Precautions shall be taken to prevent open flames, sparks, or electric arcs in battery charging areas.

(12) Tools and other metallic objects shall be kept away from the top of uncovered batteries.

(h) *Lighting for operating areas.* (1) Controlled lighting of adequate intensity should be provided in operating areas. (See American National Standard Practice for Industrial Lighting, A11.1–1965 (R1970)).

(2) Where general lighting is less than 2 lumens per square foot, auxiliary directional lighting shall be provided on the truck.

(i) *Control of noxious gases and fumes.* (1) Concentration levels of carbon monoxide gas created by powered industrial truck operations shall not exceed the levels specified in § 1910.93.

(2) Questions concerning degree of concentration and methods of sampling to ascertain the condition should be referred to a qualified industrial hygienist.

(j) *Dockboards (bridge plates).* See § 1910.30(a).

(k) *Trucks and railroad cars.* (1) The brakes of highway trucks shall be set and wheel chocks placed under the rear wheels to prevent the trucks from rolling while they are boarded with powered industrial trucks.

(2) Wheel stops or other recognized positive protection shall be provided to prevent railroad cars from moving during loading or unloading operations.

(3) Fixed jacks may be necessary to support a semitrailer and prevent upending during the loading or unloading when the trailer is not coupled to a tractor.

(4) Positive protection shall be provided to prevent railroad cars from being moved while dockboards or bridge plates are in position.

(l) *Operator training.* Only trained and authorized operators shall be permitted to operate a powered industrial truck. Methods shall be devised to train operators in the safe operation of powered industrial trucks.

(m) *Truck operations.* (1) Trucks shall not be driven up to anyone standing in front of a bench or other fixed object.

(2) No person shall be allowed to stand or pass under the elevated portion of any truck, whether loaded or empty.

(3) Unauthorized personnel shall not be permitted to ride on powered industrial trucks. A safe place to ride shall be provided where riding of trucks is authorized.

(4) The employer shall prohibit arms or legs from being placed between the uprights of the mast or outside the running lines of the truck.

(5) When leaving a powered industrial truck unattended, load engaging means shall be fully lowered, controls shall be neutralized, power shut off, brakes set, key or connector plug removed. Wheels shall be blocked if the truck is parked on an incline.

(6) A safe distance shall be maintained from the edge of ramps or platforms while on any elevated dock, or platform or freight car. Trucks shall not be used for opening or closing freight doors.

(7) Brakes shall be set and wheel blocks shall be in place to prevent movement of trucks, trailers, or railroad cars while loading or unloading. Fixed jacks may be necessary to support a semitrailer during loading or unloading when the trailer is not coupled to a tractor. The flooring of trucks, trailers, and railroad cars shall be checked for breaks and weakness before they are driven onto.

(8) There shall be sufficient headroom under overhead installations, lights, pipes, sprinkler system, etc.

(9) An overhead guard shall be used as protection against falling objects. It should be noted that an overhead guard is intended to offer protection from the impact of small packages, boxes, bagged material, etc., representative of the job application, but not to withstand the impact of a falling capacity load.

(10) A load backrest extension shall be used whenever necessary to minimize the possibility of the load or part of it from falling rearward.

(11) Only approved industrial trucks shall be used in hazardous locations.

(12) Whenever a truck is equipped with vertical only, or vertical and horizontal controls elevatable with the lifting carriage or forks for lifting personnel, the following additional precautions shall be taken for the protection of personnel being elevated.

(i) Use of a safety platform firmly secured to the lifting carriage and/or forks.

(ii) Means shall be provided whereby personnel on the platform can shut off power to the truck.

(iii) Such protection from falling objects as indicated necessary by the operating conditions shall be provided.

(13) Spinner knobs must not be attached to steering handwheels of trucks not originally equipped with such.

(14) Fire aisles, access to stairways, and fire equipment shall be kept clear.

(n) *Traveling.* (1) All traffic regulations shall be observed, including authorized plant speed limits. A safe distance shall be maintained approximately three truck lengths from the truck ahead, and the truck shall be kept under control at all times.

(2) The right of way shall be yielded to ambulances, fire trucks, or other vehicles in emergency situations.

(3) Other trucks traveling in the same direction at intersections, blind spots, or other dangerous locations shall not be passed.

(4) The driver shall be required to slow down and sound the horn at cross aisles and other locations where vision is obstructed. If the load being carried obstructs forward view, the driver shall be required to travel with the load trailing.

(5) Railroad tracks shall be crossed diagonally wherever possible. Parking closer than 8 feet from the center of railroad tracks is prohibited.

(6) The driver shall be required to look in the direction of, and keep a clear view of the path of travel.

(7) Grades shall be ascended or descended slowly.

(i) When ascending or descending grades in excess of 10 percent, loaded trucks shall be driven with the load upgrade.

(ii) Unloaded trucks should be operated on all grades with the load engaging means downgrade.

(iii) On all grades the load and load engaging means shall be tilted back if applicable, and raised only as far as necessary to clear the road surface.

(8) Under all travel conditions the truck shall be operated at a speed that will permit it to be brought to a stop in a safe manner.

(9) Stunt driving and horseplay shall not be permitted.

(10) The driver shall be required to slow down for wet and slippery floors.

(11) Dockboard or bridgeplates, shall be properly secured before they are driven over. Dockboard or bridgeplates shall be driven over carefully and slowly and their rated capacity never exceeded.

(12) Elevators shall be approached slowly, and then entered squarely after the elevator car is properly leveled. Once on the elevator, the controls shall be neutralized, power shut off, and the brakes set.

(13) Motorized hand trucks must enter elevator or other confined areas with load end forward.

(14) Running over loose objects on the roadway surface shall be avoided.

(15) While negotiating turns, speed shall be reduced to a safe level, by means of turning the hand steering wheel in a

smooth, sweeping motion. Except when maneuvering at a very low speed, the hand steering wheel shall be turned at a moderate, even rate.

(o) *Loading.* (1) Only stable or safely arranged loads shall be handled. Caution shall be exercised when handling off-center loads which cannot be centered.

(2) Only loads within the rated capacity of the truck shall be handled.

(3) The long or high (including multiple-tiered) loads which may affect capacity shall be adjusted.

(4) When attachments are used, particular care should be taken in securing, manipulating, positioning, and transporting the load. Trucks equipped with attachments shall be operated as partially loaded trucks when not handling a load.

(5) A load engaging means shall be placed under the load as far as possible; the mast shall be carefully tilted backward to stabilize the load.

(6) Extreme care shall be used when tilting the load forward or backward, particularly when high tiering. Tilting forward with load engaging means elevated shall be prohibited except to pick up a load. An elevated load shall not be tilted forward except when the load is in a deposit position over a rack or stack. When stacking or tiering, only enough backward tilt to stabilize the load shall be used.

(p) *Operation of the truck.* (1) If at any time a powered industrial truck is found to be in need of repair, defective, or in any way unsafe, the truck shall be taken out of service until it has been restored to safe operating condition.

(2) Fuel tanks shall not be filled while the engine is running. Spillage shall be avoided.

(3) Spillage of oil or fuel shall be carefully washed away or completely evaporated and the fuel tank cap replaced before restarting engine.

(4) No truck shall be operated with a leak in the fuel system until the leak has been corrected.

(5) Open flames shall not be used for checking electrolyte level in storage batteries or gasoline level in fuel tanks.

(q) *Maintenance of industrial trucks.* (1) Any power-operated industrial truck not in safe operating condition shall be removed from service. All repairs shall be made by authorized personnel.

(2) No repairs shall be made in Classes I, II, and III locations.

(3) Those repairs to the fuel and ignition systems of industrial trucks which involve fire hazards shall be conducted only in locations designated for such repairs.

(4) Trucks in need of repairs to the electrical system shall have the battery disconnected prior to such repairs.

(5) All parts of any such industrial truck requiring replacement shall be replaced only by parts equivalent as to safety with those used in the original design.

(6) Industrial trucks shall not be altered so that the relative positions of the various parts are different from what they were when originally received from the manufacturer, nor shall they be altered either by the addition of extra parts not provided by the manufacturer or by the elimination of any parts, except as provided in subparagraph (12) of this paragraph. Additional counterweighting of fork trucks shall not be done unless approved by the truck manufacturer.

(7) Industrial trucks shall be examined before being placed in service, and shall not be placed in service if the examination shows any condition adversely affecting the safety of the vehicle. Such examination shall be made at least daily.

Where industrial trucks are used on a round-the-clock basis, they shall be examined after each shift. Defects when found shall be immediately reported and corrected.

(8) Water mufflers shall be filled daily or as frequently as is necessary to prevent depletion of the supply of water below 75 percent of the filled capacity. Vehicles with mufflers having screens or other parts that may become clogged shall not be operated while such screens or parts are clogged. Any vehicle that emits hazardous sparks or flames from the exhaust system shall immediately be removed from service, and not returned to service until the cause for the emission of such sparks and flames has been eliminated.

(9) When the temperature of any part of any truck is found to be in excess of its normal operating temperature, thus creating a hazardous condition, the vehicle shall be removed from service and not returned to service until the cause for such overheating has been eliminated.

(10) Industrial trucks shall be kept in a clean condition, free of lint, excess oil, and grease. Noncombustible agents should be used for cleaning trucks. Low flash point (below 100° F.) solvents shall not be used. High flash point (at or above 100° F.) solvents may be used. Precautions regarding toxicity, ventilation, and fire hazard shall be consonant with the agent or solvent used.

(11) Where it is necessary to use antifreeze in the engine cooling system, only those products having a glycol base shall be used.

(12) Industrial trucks originally approved for the use of gasoline for fuel may be converted to liquefied petroleum gas fuel provided the complete conversion results in a truck which embodies the features specified for LP or LPS designated trucks. Such conversion equipment shall be approved. The description of the component parts of this conversion system and the recommended method of installation on specific trucks are contained in the "Listed by Report."

§ 1910.179 Overhead and gantry cranes.

(a) *Definitions applicable to this section.* (1) A "crane" is a machine for lifting and lowering a load and moving it horizontally, with the hoisting mechanism an integral part of the machine. Cranes whether fixed or mobile are driven manually or by power.

(2) An "automatic crane" is a crane which when activated operates through a preset cycle or cycles.

(3) A "cab-operated crane" is a crane controlled by an operator in a cab located on the bridge or trolley.

(4) "Cantilever gantry crane" means a gantry or semigantry crane in which the bridge girders or trusses extend transversely beyond the crane runway on one or both sides.

(5) "Floor-operated crane" means a crane which is pendant or nonconductive rope controlled by an operator on the floor or an independent platform.

(6) "Gantry crane" means a crane similar to an overhead crane except that the bridge for carrying the trolley or trolleys is rigidly supported on two or more legs running on fixed rails or other runway.

(7) "Hot metal handling crane" means an overhead crane used for transporting or pouring molten material.

(8) "Overhead crane" means a crane with a movable bridge carrying a movable or fixed hoisting mechanism and traveling on an overhead fixed runway structure.

(9) "Power-operated crane" means a crane whose mechanism is driven by electric, air, hydraulic, or internal combustion means.

(10) A "pulpit-operated crane" is a crane operated from a fixed operator station not attached to the crane.

(11) A "remote-operated crane" is a crane controlled by an operator not in a pulpit or in the cab attached to the crane, by any method other than pendant or rope control.

(12) A "semigantry crane" is a gantry crane with one end of the bridge rigidly supported on one or more legs that run on a fixed rail or runway, the other end of the bridge being supported by a truck running on an elevated rail or runway.

(13) "Storage bridge crane" means a gantry type crane of long span usually used for bulk storage of material; the bridge girders or trusses are rigidly or nonrigidly supported on one or more legs. It may have one or more fixed or hinged cantilever ends.

(14) "Wall crane" means a crane having a jib with or without trolley and supported from a side wall or line of columns of a building. It is a traveling type and operates on a runway attached to the side wall or columns.

(15) "Appointed" means assigned specific responsibilities by the employer or the employer's representative.

(16) "ANSI" means the American National Standards Institute.

(17) An "auxiliary hoist" is a supplemental hoisting unit of ligther capacity and usually higher speed than provided for the main hoist.

(18) A "brake" is a device used for retarding or stopping motion by friction or power means.

(19) A "drag brake" is a brake which provides retarding force without external control.

(20) A "holding brake" is a brake that automatically prevents motion when power is off.

(21) "Bridge" means that part of a crane consisting of girders, trucks, end ties, footwalks, and drive mechanism which carries the trolley or trolleys.

(22) "Bridge travel" means the crane movement in a direction parallel to the crane runway.

(23) A "bumper" (buffer) is an energy absorbing device for reducing impact when a moving crane or trolley reaches the end of its permitted travel; or when two moving cranes or trolleys come in contact.

(24) The "cab" is the operator's compartment on a crane.

(25) "Clearance" means the distance from any part of the crane to a point of the nearest obstruction.

(26) "Collectors" (current) are contacting devices for collecting current from runway or bridge conductors.

(27) "Conductors, bridge" are the electrical conductors located along the bridge structure of a crane to provide power to the trolley.

(28) "Conductors, runway" (main) are the electrical conductors located along a crane runway to provide power to the crane.

(29) The "control braking means" is a method of controlling crane motor speed when in an overhauling condition.

(30) "Countertorque" means a method of control by which the power to the motor is reversed to develop torque in the opposite direction.

(31) "Dynamic" means a method of controlling crane motor speeds when in the overhauling condition to provide a retarding force.

(32) "Regenerative" means a form of dynamic braking in which the electrical energy generated is fed back into the power system.

(33) "Mechanical" means a method of control by friction.

(34) "Controller, spring return" means a controller which when released will return automatically to a neutral position.

(35) "Designated" means selected or assigned by the employer or the employer's representative as being qualified to perform specific duties.

(36) A "drift point" means a point on a travel motion controller which releases the brake while the motor is not energized. This allows for coasting before the brake is set.

(37) The "drum" is the cylindrical member around which the ropes are wound for raising or lowering the load.

(38) An "equalizer" is a device which compensates for unequal length or stretch of a rope.

(39) "Exposed" means capable of being contacted inadvertently. Applied to hazardous objects not adequately guarded or isolated.

(40) "Fail-safe" means a provision designed to automatically stop or safely control any motion in which a malfunction occurs.

(41) "Footwalk" means the walkway with handrail, attached to the bridge or trolley for access purposes.

(42) A "hoist" is an apparatus which may be a part of a crane, exerting a force for lifting or lowering.

(43) "Hoist chain" means the load bearing chain in a hoist.

NOTE: Chain properties do not conform to those shown in ANSI B30.9–1971, Safety Code for Slings.

(44) "Hoist motion" means that motion of a crane which raises and lowers a load.

(45) "Load" means the total superimposed weight on the load block or hook.

(46) The "load block" is the assembly of hook or shackle, swivel, bearing, sheaves, pins, and frame suspended by the hoisting rope.

(47) "Magnet" means an electromagnetic device carried on a crane hook to pick up loads magnetically.

(48) "Main hoist" means the hoist mechanism provided for lifting the maximum rated load.

(49) A "man trolley" is a trolley having an operator's cab attached thereto.

(50) "Rated load" means the maximum load for which a crane or individual hoist is designed and built by the manufacturer and shown on the equipment nameplate(s).

(51) "Rope" refers to wire rope, unless otherwise specified.

(52) "Running sheave" means a sheave which rotates as the load block is raised or lowered.

(53) "Runway" means an assembly of rails, beams, girders, brackets, and framework on which the crane or trolley travels.

(54) "Side pull" means that portion of the hoist pull acting horizontally when the hoist lines are not operated vertically.

(55) "Span" means the horizontal distance center to center of runway rails.

(56) "Standby crane" means a crane which is not in regular service but which is used occasionally or intermittently as required.

(57) A "stop" is a device to limit travel of a trolley or crane bridge. This device normally is attached to a fixed structure and normally does not have energy absorbing ability.

(58) A "switch" is a device for making, breaking, or for changing the connections in an electric circuit.

(59) An "emergency stopswitch" is a manually or automatically operated electric switch to cut off electric power independently of the regular operating controls.

(60) A "limit switch" is a switch which is operated by some part or motion of a power-driven machine or equipment to alter the electric circuit associated with the machine or equipment.

(61) A "main switch" is a switch controlling the entire power supply to the crane.

(62) A "master switch" is a switch which dominates the operation of contractors, relays, or other remotely operated devices.

(63) The "trolley" is the unit which travels on the bridge rails and carries the hoisting mechanism.

(64) "Trolley travel" means the trolley movement at right angles to the crane runway.

(65) "Truck" means the unit consisting of a frame, wheels, bearings, and axles which supports the bridge girders or trolleys.

(b) *General requirements*—(1) *Application.* This section applies to overhead and gantry cranes, including semigantry, cantilever gantry, wall cranes, storage bridge cranes, and others having the same fundamental characteristics. These cranes are grouped because they all have trolleys and similar travel characteristics.

(2) *New and existing equipment.* All new overhead and gantry cranes installed after the effective date of the regulations in this subpart shall meet the design specifications of the American National Standard Safety Code for Overhead and Gantry Cranes, ANSI B30.2.0–1967. Equipment constructed and installed prior to the effective date of this subpart shall be modified to conform to these specifications.

(3) *Modifications.* Cranes may be modified and rerated provided such modifications and the supporting structure are checked thoroughly for the new rated load by a qualified engineer or the equipment manufacturer. The crane shall be tested in accordance with paragraph (k)(2) of this section. New rated load shall be displated in accordance with subparagraph (5) of this paragraph.

(4) *Wind indicators and rail clamps.* Outdoor storage bridges shall be provided with automatic rail clamps. A wind-indicating device shall be provided which will give a visible or audible alarm to the bridge operator at a predetermined wind velocity. If the clamps act on the rail heads, any beads or weld flash on the rail heads shall be ground off.

(5) *Rated load marking.* The rated load of the crane shall be plainly marked on each side of the crane, and if the crane has more than one hoisting unit, each hoist shall have its rated load marked on it or its load block and this marking shall be clearly legible from the ground or floor.

(6) *Clearance from obstruction.* (i) Minimum clearance of 3 inches overhead and 2 inches laterally shall be provided and maintained between crane and obstructions in conformity with Crane Manufacturers Association of America, Inc., Specification No. 61 (formerly the Electric Overhead Crane Institute, Inc).

(ii) Where passageways or walkways are provided obstructions shall not be placed so that safety of personnel will be jeopardized by movements of the crane.

(7) *Clearance between parallel cranes.* If the runways of two cranes are parallel, and there are no intervening walls or structure, there shall be adequate clearance provided and maintained between the two bridges.

(c) *Cabs*—(1) *Cab location.* (i) The general arrangement of the cab and the

location of control and protective equipment shall be such that all operating handles are within convenient reach of the operator when facing the area to be served by the load hook, or while facing the direction of travel of the cab. The arrangement shall allow the operator a full view of the load hook in all positions.

(ii) The cab shall be located to afford a minimum of 3 inches clearance from all fixed structures within its area of possible movement.

(iii) The clearance of the cab above the working floor or passageway should be not less than 7 feet.

(2) *Access to crane.* Access to the cab and/or bridge walkway shall be by a conveniently placed fixed ladder, stairs, or platform, requiring no step over any gap exceeding 12 inches. Fixed ladders shall be in conformance with the American National Standard Safety Code for Fixed Ladders, ANSI A14.3–1956.

(3) *Fire extinguisher.* A carbon dioxide, dry-chemical, or equivalent hand fire extinguisher should be kept in the cab. Carbon tetrachloride extinguishers shall not be used.

(4) *Lighting.* Light in the cab shall be sufficient to enable the operator to see clearly enough to perform his work.

(d) *Footwalks and ladders*—(1) *Location of footwalks.* (i) If sufficient headroom is available on cab-operated cranes, a footwalk shall be provided on the drive side along the entire length of the bridge of all cranes having the trolley running on the top of the girders. To give sufficient access to the opposite side of the trolley, there should be provided either a footwalk mounted on the trolley, a suitable footwalk or platform in the building, or a footwalk on the opposite side of the crane at least twice the length of the trolley.

(ii) Footwalks should be located to give a headroom not less than 78 inches. In no case shall less than 48 inches be provided. If 48 inches of headroom cannot be provided, footwalks should be omitted from the crane and a stationary platform or landing stage built for workmen making repairs.

(2) *Construction of footwalks.* (i) Footwalks shall be of rigid construction and designed to sustain a distributed load of at least 50 pounds per square foot.

(ii) Footwalks shall have a walking surface of antislip type.

NOTE: Wood will meet this requirement.

(iii) Footwalks should be continuous and permanently secured.

(iv) Footwalks shoud have a clear passageway at least 18 inches wide except opposite the bridge motor, where they should be not less than 15 inches. The inner edge shall extend at least to the line of the outside edge of the lower cover plate or flange of the girder.

(3) *Toeboards and handrails for footwalks.* Toeboards and handrails shall be in compliance with section 1910.23 of this part.

(4) *Ladders and stairways.* (i) Gantry cranes shall be provided with ladders or stairways extending from the ground to the footwalk or cab platform.

(ii) Stairways shall be equipped with rigid and substantial metal handrails. Walking surfaces shall be of an antislip type.

(iii) Ladders shall be permanently and securely fastened in place and shall be constructed in compliance with § 1910.27.

(e) *Stops, bumpers, rail sweeps, and guards*—(1) *Trolley stops.* (i) Stops shall be provided at the limits of travel of the trolley.

(ii) Stops shall be fastened to resist forces applied when contacted.

(iii) A stop engaging the tread of the wheel shall be of a height at least equal to the radius of the wheel.

(2) *Bridge bumpers.* (i) A crane shall be provided with bumpers capable of stopping the crane (not including the lifted load) at a rate of deceleration not to exceed 3 feet per second per second when traveling in either direction at 20 percent of the rated load speed.

(*a*) The bumper shall have sufficient energy absorbing capacity to stop the crane when traveling at a speed of at least 40 percent of rated load speed.

(*b*) The bumper shall be so mounted that there is no direct shear on bolts.

(ii) Bumpers shall be so designed and installed as to minimize parts falling from the crane in case of breakage.

(3) *Trolley bumpers.* (i) Trolley shall be provided with bumpers capable of stopping the trolley (not including the lifted load) at a rate of deceleration not to exceed 4.7 feet per second per second when traveling in either direction at one-third of the rated load speed.

(ii) When more than one trolley is operated on the same bridge, each shall be equipped with bumpers on their adjacent ends.

(iii) Bumpers shall be designed and installed to minimize parts falling from the trolley in case of breakage.

(4) *Rail sweeps.* Bridge trucks shall be equipped with sweeps which extend below the top of the rail and project in front of the truck wheels.

(5) *Guards for hoisting ropes.* (i) If hoisting ropes run near enough to other parts to make fouling or chafing possible, guards shall be installed to prevent this condition.

(ii) A guard shall be provided to prevent contact between bridge conductors and hoisting ropes if they could come into contact.

(6) *Guards for moving parts.* (i) Exposed moving parts such as gears, set screws, projecting keys, chains, chain sprockets, and reciprocating components which might constitute a hazard under normal operating conditions shall be guarded.

(ii) Guards shall be securely fastened.

(iii) Each guard shall be capable of supporting without permanent distortion the weight of a 200-pound person unless the guard is located where it is impossible for a person to step on it.

(f) *Brakes*—(1) *Brakes for hoists.* (i) Each independent hoisting unit of a crane shall be equipped with at least one self-setting brake, hereafter referred to as a holding brake, applied directly to the motor shaft or some part of the gear train.

(ii) Each independent hoisting unit of a crane, except worm-geared hoists, the angle of whose worm is such as to prevent the load from accelerating in the lowering direction shall, in addition to a holding brake, be equipped with control braking means to prevent overspeeding.

(2) *Holding brakes.* (i) Holding brakes for hoist motors shall have not less than the following percentage of the full load hoisting torque at the point where the brake is applied.

(*a*) 125 percent when used with a control braking means other than mechanical.

(*b*) 100 percent when used in conjunction with a mechanical control braking means.

(*c*) 100 percent each if two holding brakes are provided.

(ii) Holding brakes on hoists shall have ample thermal capacity for the frequency of operation required by the service.

(iii) Holding brakes on hoists shall be applied automatically when power is removed.

(iv) Where necessary holding brakes shall be provided with adjustment means to compensate for wear.

(v) The wearing surface of all holding-brake drums or discs shall be smooth.

(vi) Each independent hoisting unit of a crane handling hot metal and having power control braking means shall be equipped with at least two holding brakes.

(3) *Control braking means.* (i) A power control braking means such as regenerative, dynamic or countertorque braking, or a mechanically controlled braking means shall be capable of maintaining safe lowering speeds of rated loads.

(ii) The control braking means shall have ample thermal capacity for the frequency of operation required by service.

(4) *Brakes for trolleys and bridges.* (i) Foot operated brakes shall not require an applied force of more than 70 pounds to develop manufacturer's rated brake torque.

(ii) Brakes may be applied by mechanical, electrical, pneumatic, hydraulic, or gravity means.

(iii) Where necessary brakes shall be provided with adjustment means to compensate for wear.

(iv) The wearing surface of all brake-drums or discs shall be smooth.

(v) All foot-brake pedals shall be constructed so that the operator's foot will not easily slip off the pedal.

(vi) Foot-operated brakes shall be equipped with automatic means for positive release when pressure is released from the pedal.

(vii) Brakes for stopping the motion of the trolley or bridge shall be of sufficient size to stop the trolley or bridge within a distance in feet equal to 10 percent of full load speed in feet per minute when traveling at full speed with full load.

(viii) If holding brakes are provided on the bridge or trolley(s), they shall not prohibit the use of a drift point in the control circuit.

(ix) Brakes on trolleys and bridges shall have ample thermal capacity for the frequency of operation required by the service to prevent impairment of functions from overheating.

(5) *Application of trolley brakes.* (i) On cab-operated cranes with cab on trolley, a trolley brake shall be required as specified under subparagraph (4) of this paragraph.

(ii) A drag brake may be applied to hold the trolley in a desired position on the bridge and to eliminate creep with the power off.

(6) *Application of bridge brakes.* (i) On cab-operated cranes with cab on bridge, a bridge brake is required as specified under subparagraph (4) of this paragraph.

(ii) On cab-operated cranes with cab on trolley, a bridge brake of the holding type shall be required.

(iii) On all floor, remote and pulpit-operated crane bridge drives, a brake or noncoasting mechanical drive shall be provided.

(g) *Electric equipment*—(1) *General.* (i) Wiring and equipment shall comply with § 1910.401.

(ii) The control circuit voltage shall not exceed 600 volts for a.c. or d.c. current.

(iii) The voltage at pendant pushbuttons shall not exceed 150 volts for a.c. and 300 volts for d.c.

(iv) Where multiple conductor cable is used with a suspended pushbutton station, the station must be supported in some satisfactory manner that will protect the electrical conductors against strain.

(v) Pendant control boxes shall be constructed to prevent electrical shock and shall be clearly marked for identification of functions.

(2) *Equipment.* (i) Electrical equipment shall be so located or enclosed that live parts will not be exposed to accidental contact under normal operating conditions.

(ii) Electric equipment shall be protected from dirt, grease, oil, and moisture.

(iii) Guards for live parts shall be substantial and so located that they cannot be accidently deformed so as to make contact with the live parts.

(3) *Controllers.* (i) Cranes not equipped with spring-return controllers or momentary contact pushbuttons shall be provided with a device which will disconnect all motors from the line on failure of power and will not permit any motor to be restarted until the controller handle is brought to the "off" position, or a reset switch or button is operated.

(ii) Lever operated controllers shall be provided with a notch or latch which in the "off" position prevents the handle from being inadvertently moved to the "on" position. An "off" detent or spring return arrangement is acceptable.

(iii) The controller operating handle shall be located within convenient reach of the operator.

(iv) As far as practicable, the movement of each controller handle shall be in the same general directions as the resultant movements of the load.

(v) The control for the bridge and troller travel shall be so located that the operator can readily face the direction of travel.

(vi) For floor-operated cranes, the controller or controllers if rope operated, shall automatically return to the "off" position when released by the operator.

(vii) Pushbuttons in pendant stations shall return to the off position when pressure is released by the crane operator.

(viii) Automatic cranes shall be so designed that all motions shall fail-safe if any malfunction of operation occurs.

(ix) Remote-operated cranes shall function so that if the control signal for any crane motion becomes ineffective that crane motion shall stop.

(4) *Resistors.* (i) Enclosures for resistors shall have openings to provide adequate ventilation, and shall be installed to prevent the accumulation of combustible matter too near to hot parts.

(ii) Resistor units shall be supported so as to be free as possible from vibration.

(iii) Provision shall be made to prevent broken parts or molten metal falling upon the operator or from the crane.

(5) *Switches.* (i) The power supply to the runway conductors shall be controlled by a switch or circuit breaker located on a fixed structure, accessible from the floor, and arranged to be locked in the open position.

(ii) On cab-operated cranes a switch or circuit breaker of the enclosed type, with provision for locking in the open position shall be provided in the leads from the runway conductors. A means of opening this switch or circuit breaker shall be located within easy reach of the operator.

(iii) On floor-operated cranes, a switch or circuit breaker of the enclosed type, with provision for locking in the open position, shall be provided in the leads from the runway conductors. This disconnect shall be mounted on the bridge or footwalk near the runway collectors. One of the following types of floor operated disconnects shall be provided:

(*a*) Nonconductive rope attached to the main disconnect switch.

(*b*) An undervoltage trip for the main circuit breaker operated by an emergency stop button in the pendant pushbutton in the pendant pushbutton station.

(*c*) A main line contactor operated by a switch or pushbutton in the pendant pushbutton station.

(iv) The hoisting motion of all electric traveling cranes shall be provided with an overtravel limit switch in the hoisting direction.

(v) All cranes using a lifting magnet shall have a magnet circuit switch of the enclosed type with provision for locking in the open position. Means for discharging the inductive load of the magnet shall be provided.

(6) *Runway conductors.* Conductors of the open type mounted on the crane runway beams or overhead shall be so located or so guarded that persons entering or leaving the cab or crane footwalk normally could not come into contact with them.

(7) *Extension lamps.* If a service receptacle is provided in the cab or on the bridge of cab-operated cranes, it shall be a grounded three-prong type permanent receptacle, not exceeding 300 volts.

(h) *Hoisting equipment*—(1) *Sheaves.* (i) Sheave grooves shall be smooth and free from surface defects which could cause rope damage.

(ii) Sheaves carrying ropes which can be momentarily unloaded shall be provided with closs-fitting guards or other suitable devices to guide the rope back into the groove when the load is applied again.

(iii) The sheaves in the bottom block shall be equipped with close-fitting guards that will prevent ropes from becoming fouled when the block is lying on the ground with ropes loose.

(iv) Pockets and flanges of sheaves used with hoist chains shall be of such dimensions that the chain does not catch or bind during operation.

(v) All running sheaves shall be equipped with means for lubrication. Permanently lubricated, sealed and/or shielded bearings meet this requirement.

(2) *Ropes.* (i) In using hoisting ropes, the crane manufacturer's recommendation shall be followed. The rated load divided by the number of parts of rope shall not exceed 20 percent of the nominal breaking strength of the rope.

(ii) Socketing shall be done in the manner specified by the manufacturer of the assembly.

(iii) Rope shall be secured to the drum as follows:

(*a*) No less than two wraps of rope shall remain on the drum when the hook is in its extreme low position.

(*b*) Rope end shall be anchored by a clamp securely attached to the drum, or by a socket arrangement approved by the crane or rope manufacturer.

(iv) Eye splices. [Reserved.]

(v) Rope clips attached with U-bolts shall have the U-bolts on the dead or short end of the rope. Spacing and number of all types of clips shall be in accordance with the clip manufacturer's recommendation. Clips shall be drop-forged steel in all sizes manufactured commercially. When a newly installed rope has been in operation for an hour, all nuts on the clip bolts shall be retightened.

(vi) Swaged or compressed fittings shall be applied as recommended by the rope or crane manufacturer.

(vii) Wherever exposed to temperatures, at which fiber cores would be damaged, rope having an independent wire-rope or wire-strand core, or other temperature-damage resistant core shall be used.

(viii) Replacement rope shall be the same size, grade, and construction as the original rope furnished by the crane manufacturer, unless otherwise recommended by a wire rope manufacturer due to actual working condition requirements.

(3) *Equalizers.* If a load is supported by more than one part of rope, the tension in the parts shall be equalized.

(4) *Hooks.* Hooks shall meet the manufacturer's recommendations and shall not be overloaded.

(i) *Warning device.* Except for floor-operated cranes a gong or other effective warning signal shall be provided for each crane equipped with a power traveling mechanism.

(j) *Inspection*—(1) *Inspection classification.* (i) Initial inspection. Prior to initial use all new and altered cranes shall be inspected to insure compliance with the provisions of this section.

(ii) Inspection procedure for cranes in regular service is divided into two general classifications based upon the intervals at which inspection should be performed. The intervals in turn are dependent upon the nature of the critical components of the crane and the degree of their exposure to wear, deterioration, or malfunction. The two general classifications are herein designated as "frequent" and "periodic" with respective intervals between inspections as defined below:

(*a*) Frequent inspection—Daily to monthly intervals.

(*b*) Periodic inspection—1 to 12-month intervals.

(2) *Frequent inspection.* The following items shall be inspected for defects at intervals as defined in subparagraph (1)(ii) of this paragraph or as specifically indicated, including observation during operation for any defects which might appear between regular inspections. All deficiencies such as listed shall be carefully examined and determination made as to whether they constitute a safety hazard:

(i) All functional operating mechanisms for maladjustment interfering with proper operation. Daily.

(ii) Deterioration or leakage in lines, tanks, valves, drain pumps, and other parts of air or hydraulic systems. Daily.

(iii) Hooks with deformation or cracks. Visual inspection daily; monthly inspection with signed reports. For hooks with cracks or having more than 15 percent in excess of normal throat opening or more than 10° twist from the plane of the unbent hook refer to paragraph (1)(3)(iii)(*a*) of this section.

(iv) Hoist or load attachment chains, including end connections, for excessive wear, twist, distorted links interfering with proper function, or stretch beyond manufacturer's recommendations. Visual inspection daily; monthly inspection with signed report.

(v) Rope slings, including end connections, for excessive wear, broken wires, stretch, kinking, or twisting. Visual inspection daily; monthly inspection with signed report.

(vi) All functional operating mechanisms for excessive wear of components.

(vii) Rope reeving for noncompliance with manufacturer's recommendations.

(3) *Periodic inspection.* Complete inspections of the crane shall be performed at intervals as generally defined in subparagraph (1)(ii)(*b*) of this paragraph, depending upon its activity, severity of service, and environment, or as specifically indicated below. These inspections shall include the requirements of subparagraph (2) of this paragraph and in addition, the following items. Any deficiencies such as listed shall be carefully examined and determination made as to whether they constitute a safety hazard:

(i) Deformed, cracked, or corroded members.

(ii) Loose bolts or rivets.

(iii) Cracked or worn sheaves and drums.

(iv) Worn, cracked or distorted parts such as pins, bearings, shafts, gears, rollers, locking and clamping devices.

(v) Excessive wear on brake system parts, linings, pawls, and ratchets.

(vi) Load, wind, and other indicators over their full range, for any significant inaccuracies.

(vii) Gasoline, diesel, electric, or other powerplants for improper performance or noncompliance with applicable safety requirements.

(viii) Excessive wear of chain drive sprockets and excessive chain stretch.

(ix) Crane hooks. Magnetic particle or other suitable crack detecting inspection should be performed at least once each year.

(x) Electrical apparatus, for signs of pitting or any deterioration of controller containers, limit switches and pushbutton stations.

(4) *Cranes not in regular use.* (i) A crane which has been idle for a period of 1 month or more, but less than 6 months, shall be given an inspection conforming with requirements of subparagraph (2) of this paragraph and paragraph (m)(2) of this section, before placing in service.

(ii) A crane which has been idle for a period of over 6 months shall be given a complete inspection conforming with requirements of subparagraphs (2) and (3) of this paragraph and paragraph (m)(2) of this section before placing in service.

(iii) Standby cranes shall be inspected at least semi-annually in accordance with requirements of subparagraph (2) of this paragraph and paragraph (m)(2) of this section. Standby cranes exposed to adverse environment should be inspected more frequently.

(k) *Testing*—(1) *Operational tests.* (i) Prior to initial use all new and altered cranes shall be tested to insure compliance with this section including the following functions:

(*a*) Hoisting and lowering.

(*b*) Trolley travel.

(*c*) Bridge travel.

(*d*) Limit switches, locking and safety devices.

(ii) The trip setting of hoist limit switches shall be determined by tests with an empty hook traveling in increasing speeds up to the maximum speed. The actuating mechanism of the limit switch shall be located so that it will trip the switch, under all conditions, in sufficient time to prevent contact of the hook or hook block with any part of the trolley.

(2) *Rated load test.* Prior to initial use all new, extensively repaired, and altered cranes should be tested by or under the direction of an appointed or authorized person, confirming the load rating of the crane. The load rating should not be more than 80 percent of the maximum load sustained during the test. Test loads shall not be more than 125 percent of the rated load unless otherwise recommended by the manufacturer. The test reports shall be placed on file where readily available to appointed personnel.

(l) *Maintenance*—(1) *Preventive maintenance.* A preventive maintenance program based on the crane manufacturer's recommendations shall be established.

(2) *Maintenance procedure.* (i) Before adjustments and repairs are started on a crane the following precautions shall be taken:

(*a*) The crane to be repaired shall be run to a location where it will cause the least interference with other cranes and operations in the area.

(*b*) All controllers shall be at the off position.

(*c*) The main or emergency switch shall be open and locked in the open position.

(*d*) Warning or "out of order" signs shall be placed on the crane, also on the floor beneath or on the hook where visible from the floor.

(*e*) Where other cranes are in operation on the same runway, rail stops or other suitable means shall be provided to prevent interference with the idle crane.

(*f*) Where temporary protective rail stops are not available, or practical, a signalman should be placed at a visual vantage point for observing the approach of an active crane and warning its operator when reaching the limit of safe distance from the idle crane.

(ii) After adjustments and repairs have been made the crane shall not be operated until all guards have been reinstalled, safety devices reactivated and maintenance equipment removed.

(3) *Adjustments and repairs.* (i) Any unsafe conditions disclosed by the inspection requirements of paragraph (j) of this section shall be corrected before operation of the crane is resumed. Adjustments and repairs shall be done only by designated personnel.

(ii) Adjustments shall be maintained to assure correct functioning of components. The following are examples:

(*a*) All functional operating mechanisms.

(*b*) Limit switches.

(*c*) Control systems.

(*d*) Brakes.
(*e*) Power plants.
(iii) Repairs or replacements shall be provided promptly as needed for safe operation. The following are examples:
(*a*) Crane hooks showing defects described in paragraph (j)(2)(iv) of this section shall be discarded. Repairs by welding or reshaping are not generally recommended. If such repairs are attempted they shall only be done under competent supervision and the hook shall be tested to the load requirements of paragraph (k)(2) of this section before further use.
(*b*) Load attachment chains and rope slings showing defects described in paragraph (j)(2)(iv) and (v) of this section respectively.
(*c*) All critical parts which are cracked, broken, bent, or excessively worn.
(*d*) Pendant control stations shall be kept clean and function labels kept legible.
(m) *Rope inspection*—(1) *Running ropes.* A thorough inspection of all ropes shall be made at least once a month and a full written, dated, and signed report of rope condition kept on file where readily available to appointed personnel. Any deterioration, resulting in appreciable loss of original strength, such as described below, shall be carefully noted and determination made as to whether further use of the rope would constitute a safety hazard:
(i) Reduction of rope diameter below nominal diameter due to loss of core support, internal or external corrosion, or wear of outside wires.
(ii) A number of broken outside wires and the degree of distribution or concentration of such broken wires.
(iii) Worn outside wires.
(iv) Corroded or broken wires at end connections.
(v) Corroded, cracked, bent, worn, or improperly applied end connections.
(vi) Severe kinking, crushing, cutting, or unstranding.
(2) *Other ropes.* All rope which has been idle for a period of a month or more due to shutdown or storage of a crane on which it is installed shall be given a thorough inspection before it is placed in service. This inspection shall be for all types of deterioration and shall be performed by an appointed person whose approval shall be required for further use of the rope. A written and dated report of the rope condition shall be available for inspection.
(n) *Handling the load*—(1) *Size of load.* The crane shall not be loaded beyond its rated load except for test purposes as provided in paragraph (k) of this section.
(2) *Attaching the load.* (i) The hoist chain or hoist rope shall be free from kinks or twists and shall not be wrapped around the load.
(ii) The load shall be attached to the load block hook by means of slings or other approved devices.
(iii) Care shall be taken to make certain that the sling clears all obstacles.
(3) *Moving the load.* (i) The load shall be well secured and properly balanced in the sling or lifting device before it is lifted more than a few inches.
(ii) Before starting to hoist the following conditions shall be noted:
(*a*) Hoist rope shall not be kinked.
(*b*) Multiple part lines shall not be twisted around each other.
(*c*) The hook shall be brought over the load in such a manner as to prevent swinging.
(iii) During hoisting care shall be taken that:
(*a*) There is no sudden acceleration or deceleration of the moving load.
(*b*) The load does not contact any obstructions.
(iv) Cranes shall not be used for side pulls except when specifically authorized by a responsible person who has determined that the stability of the crane is not thereby endangered and that various parts of the crane will not be overstressed.
(v) While any employee is on the load or hook, there shall be no hoisting, lowering, or traveling.
(vi) The employer shall require that the operator avoid carrying loads over people.
(vii) The operator shall test the brakes each time a load approaching the rated load is handled. The brakes shall be tested by raising the load a few inches and applying the brakes.
(viii) The load shall not be lowered below the point where less than two full wraps of rope remain on the hoisting drum.
(ix) When two or more cranes are used to lift a load one qualified responsible person shall be in charge of the operation. He shall analyze the operation and instruct all personnel involved in the proper positioning, rigging of the load, and the movements to be made.
(x) The employer shall insure that the operator does not leave his position at the controls while the load is suspended.
(xi) When starting the bridge and when the load or hook approaches near or over personnel, the warning signal shall be sounded.
(4) *Hoist limit switch.* (i) At the beginning of each operator's shift, the upper limit switch of each hoist shall be tried out under no load. Extreme care shall be exercised; the block shall be "inched" into the limit or run in at slow speed. If the switch does not operate properly, the appointed person shall be immediately notified.
(ii) The hoist limit switch which controls the upper limit of travel of the load block shall never be used as an operating control.
(o) *Other requirements, general*—(1) *Ladders.* (i) The employer shall insure that hands are free from encumbrances while personnel are using ladders.
(ii) Articles which are too large to be carried in pockets or belts shall be lifted and lowered by hand line.
(2) *Cabs.* (i) Necessary clothing and personal belongings shall be stored in such a manner as not to interfere with access or operation.
(ii) Tools, oil cans, waste, extra fuses, and other necessary articles shall be stored in the tool box, and shall not be permitted to lie loose in or about the cab.
(3) *Fire extinguishers.* The employer shall insure that operators are familiar with the operation and care of fire extinguishers provided.

§ 1910.180 Crawler locomotive and truck cranes.

(a) *Definitions applicable to this section.* (1) A "crawler crane" consists of a rotating superstructure with power plant, operating machinery, and boom, mounted on a base, equipped with crawler treads for travel. Its function is to hoist and swing loads at various radii.
(2) A "locomotive crane" consists of a rotating superstructure with powerplant, operating machinery and boom, mounted on a base or car equipped for travel on railroad track. It may be self-propelled or propelled by an outside source. Its function is to hoist and swing loads at various radii.
(3) A "truck crane" consists of a rotating superstructure with powerplant, operating machinery and boom, mounted on an automotive truck equipped with a powerplant for travel. Its function is to hoist and swing loads at various radii.
(4) A "wheel mounted crane" (wagon crane) consists of a rotating superstructure with powerplant, operating machinery and boom, mounted on a base or platform equipped with axles and rubber-tired wheels for travel. The base is usually propelled by the engine in the superstructure, but it may be equipped with a separate engine controlled from the superstructure. Its function is to hoist and swing loads at various radii.
(5) An "accessory" is a secondary part or assembly of parts which contributes to the overall function and usefulness of a machine.
(6) "Appointed" means assigned specific responsibilities by the employer or the employer's representative.
(7) "ANSI" means the American National Standards Institute.
(8) An "angle indicator" (boom) is an accessory which measures the angle of the boom to the horizontal.
(9) The "axis of rotation" is the vertical axis around which the crane superstructure rotates.
(10) "Axle" means the shaft or spindle with which or about which a wheel rotates. On truck- and wheel-mounted cranes it refers to an automotive type of axle assembly including housings, gearing, differential, bearings, and mounting appurtenances.
(11) "Axle" (bogie) means two or more automotive-type axles mounted in tandem in a frame so as to divide the load between the axles and permit vertical oscillation of the wheels.
(12) The "base" (mounting) is the traveling base or carrier on which the rotating superstructure is mounted such

as a car, truck, crawlers, or wheel platform.

(13) The "boom" (crane) is a member hinged to the front of the rotating superstructure with the outer end supported by ropes leading to a gantry or "A" frame and used for supporting the hoisting tackle.

(14) The "boom angle" is the angle between the longitudinal centerline of the boom and the horizontal. The boom longitudinal centerline is a straight line between the boom foot pin (heel pin) centerline and boom point sheave pin centerline.

(15) The "boom hoist" is a hoist drum and rope reeving system used to raise and lower the boom. The rope system may be all live reeving or a combination of live reeving and pendants.

(16) The "boom stop" is a device used to limit the angle of the boom at the highest position.

(17) A "brake" is a device used for retarding or stopping motion by friction or power means.

(18) A "cab" is housing which covers the rotating superstructure machinery and/or operator's station. On truck-crane trucks a separate cab covers the driver's station.

(19) The "clutch" is a friction, electromagnetic, hydraulic, pneumatic, or positive mechanical device for engagement or disengagement of power.

(20) The "counterweight" is a weight used to supplement the weight of the machine in providing stability for lifting working loads.

(21) "Designated" means selected or assigned by the employer or the employer's representative as being qualified to perform specific duties.

(22) The "drum" is the cylindrical members around which ropes are wound for raising and lowering the load or boom.

(23) "Dynamic" (loading) means loads introduced into the machine or its components by forces in motion.

(24) The "gantry" (A-frame) is a structural frame, extending above the superstructure, to which the boom supports ropes are reeved.

(25) A "jib" is an extension attached to the boom point to provide added boom length for lifting specified loads. The jib may be in line with the boom or offset to various angles.

(26) "Load" (working) means the external load, in pounds, applied to the crane, including the weight of load-attaching equipment such as load blocks, shackles, and slings.

(27) "Load block" (upper) means the assembly of hook or shackle, swivel, sheaves, pins, and frame suspended from the boom point.

(28) "Load block" (lower) means the assembly of hook or shackle, swivel, sheaves, pins, and frame suspended by the hoisting ropes.

(29) A "load hoist" is a hoist drum and rope reeving system used for hoisting and lowering loads.

(30) "Load ratings" are crane ratings in pounds established by the manufacturer in accordance with paragraph (c) of this section.

(31) "Outriggers" are extendable fixed metal arms, attached to the mounting base, which rest on supports at the outer ends.

(32) "Rail clamp" means a tong-like metal device, mounted on a locomotive crane car, which can be connected to the track.

(33) "Reeving" means a rope system in which the rope travels around drums and sheaves.

(34) "Rope" refers to a wire rope unless otherwise specified.

(35) "Side loading" means a load applied at an angle to the vertical plane of the boom.

(36) A "standby crane" is a crane which is not in regular service but which is used occasionally or intermittently as required.

(37) A "standing (guy) rope" is a supporting rope which maintains a constant distance between the points of attachment to the two components connected by the rope.

(38) "Structural competence" means the ability of the machine and its components to withstand the stresses imposed by applied loads.

(39) "Superstructure" means the rotating upper frame structure of the machine and the operating machinery mounted thereon.

(40) "Swing" means the rotation of the superstructure for movement of loads in a horizontal direction about the axis of rotation.

(41) "Swing mechanism" means the machinery involved in providing rotation of the superstructure.

(42) "Tackle" is an assembly of ropes and sheaves arranged for hoisting and pulling.

(43) "Transit" means the moving or transporting of a crane from one jobsite to another.

(44) "Travel" means the functions of the machine moving from one location to another, on a jobsite.

(45) The "travel mechanism" is the machinery involved in providing travel.

(46) "Wheelbase" means the distance between centers of front and rear axles. For a multiple axle assembly the axle center for wheelbase measurement is taken as the midpoint of the assembly.

(47) The "whipline" (auxiliary hoist) is a separate hoist rope system of lighter load capacity and higher speed than provided by the main hoist.

(48) A "winch head" is a power driven spool for handling of loads by means of friction between fiber or wire rope and spool.

(b) *General requirements*—(1) *Application.* This section applies to crawler cranes, locomotive cranes, wheel mounted cranes of both truck and self-propelled wheel type, and any variations thereof which retain the same fundamental characteristics. This section includes only cranes of the above types, which are basically powered by internal combustion engines or electric motors and which utilize drums and ropes. Cranes designed for railway and automobile wreck clearances are excepted. The requirements of this section are applicable only to machines when used as lifting cranes.

(2) *New and existing equipment.* All new crawler, locomotive, and truck cranes utilized after the effective date of this subpart shall meet the design specifications of the "American National Standard Safety Code for Crawler, Locomotive and Truck Cranes," ANSI B30.5–1968. Equipment constructed and utilized prior to the effective date of the regulations in this section shall be modified to conform to these specifications.

(c) *Load ratings*—(1) *Load ratings—where stability governs lifting performance.* (i) The margin of stability for determination of load ratings, with booms of stipulated lengths at stipulated working radii for the various types of crane mountings is established by taking a percentage of the loads which will produce a condition of tipping or balance with the boom in the least stable direction, relative to the mounting. The load ratings shall not exceed the following percentages for cranes, with the indicated types of mounting under conditions stipulated in subdivisions (ii) and (iii) of this subparagraph.

Type of crane mounting:	*Maximum load ratings (percent of tipping loads)*
Locomotive, without outriggers:	
Booms 60 feet or less	85
Booms over 60 feet	[1] 85
Locomotive, using outriggers fully extended	80
Crawler, without outriggers	75
Crawler, using outriggers fully extended	85
Truck and wheel mounted without outriggers or using outriggers fully extended	85

[1] Unless this results in less than 30,000 pound-feet net stabilizing moment about the rail, which shall be minimum with such booms.

(ii) The following stipulation shall govern the application of the values in subdivision (i) of this subparagraph for locomotive cranes:

(*a*) Tipping with or without the use of outriggers occurs when half of the wheels farthest from the load leave the rail.

(*b*) The crane shall be standing on track which is level within 1 percent grade.

(*c*) Radius of the load is the horizontal distance from a projection of the axis of rotation to the rail support surface, before loading, to the center of vertical hoist line or tackle with load applied.

(*d*) Tipping loads from which ratings are determined shall be applied under static conditions only, i.e., without dynamic effect of hoisting, lowering, or swinging.

(*e*) The weight of all auxiliary handling devices such as hoist blocks, hooks, and slings shall be considered a part of the load rating.

(iii) Stipulations governing the application of the values in subdivision (i) of this subparagraph for crawler, truck, and wheel-mounted cranes shall be in accordance with Crane Load-Stability Test Code. Society of Automotive Engineers (SAE) J765.

(iv) The effectiveness of these preceding stability factors will be influenced by such additional factors as free suspended loads, track, wind, or ground conditions, condition and inflation of rubber tires, boom lengths, proper operating speeds for existing conditions, and, in general, careful and competent operation. All of these shall be taken into account by the user.

(2) *Load rating chart.* A substantial and durable rating chart with clearly legible letters and figures shall be provided with each crane and securely fixed to the crane cab in a location easily visible to the operator while seated at his control station.

(d) *Inspection classification*—(1) *Initial inspection.* Prior to initial use all new and altered cranes shall be inspected to insure compliance with provisions of this section.

(2) *Regular inspection.* Inspection procedure for cranes in regular service is divided into two general classifications based upon the intervals at which inspection should be performed. The intervals in turn are dependent upon the nature of the critical components of the crane and the degree of their exposure to wear, deterioration, or malfunction. The two general classifications are herein designated as "frequent" and "periodic" with respective intervals between inspections as defined below:

(i) Frequent inspection: Daily to monthly intervals.

(ii) Periodic inspection: One- to 12-month intervals, or as specifically recommended by the manufacturer.

(3) *Frequent inspections.* Items such as the following shall be inspected for defects at intervals as defined in subdivision (2)(i) of this subparagraph or as specifically indicated including observation during operation for any defects which might appear between regular inspections. Any deficiencies such as listed shall be carefully examined and determination made as to whether they constitute a safety hazard:

(i) All control mechanisms for maladjustment interfering with proper operation: Daily.

(ii) All control mechanisms for excessive wear of components and contamination by lubricants or other foreign matter.

(iii) All safety devices for malfunction.

(iv) Deterioration or leakage in air or hydraulic systems: Daily.

(v) Crane hooks with deformations or cracks. For hooks with cracks or having more than 15 percent in excess of normal throat opening or more than 10° twist from the plane of the unbent hook.

(vi) Rope reeving for noncompliance with manufacturer's recommendations.

(vii) Electrical apparatus for malfunctioning, signs of excessive deterioration, dirt, and moisture accumulation.

(4) *Periodic inspection.* Complete inspections of the crane shall be performed at intervals as generally defined in subparagraph (2)(ii) of this paragraph depending upon its activity, severity of service, and environment, or as specifically indicated below. These inspections shall include the requirements of subparagraph (3) of this paragraph and in addition, items such as the following. Any deficiencies such as listed shall be carefully examined and determination made as to whether they constitute a safety hazard:

(i) Deformed, cracked, or corroded members, in the crane structure and boom.

(ii) Loose bolts or rivets.

(iii) Cracked or worn sheaves and drums.

(iv) Worn, cracked, or distorted parts such as pins, bearings, shafts, gears, rollers and locking devices.

(v) Excessive wear on brake and clutch system parts, linings, pawls, and ratchets.

(vi) Load, boom angle, and other indicators over their full range, for any significant inaccuracies.

(vii) Gasoline, diesel, electric, or other power plants for improper performance or noncompliance with safety requirements.

(viii) Excessive wear of chain-drive sprockets and excessive chain stretch.

(ix) Travel steering, braking, and locking devices, for malfunction.

(x) Excessively worn or damaged tires.

(5) *Cranes not in regular use.* (i) A crane which has been idle for a period of one month or more, but less than 6 months, shall be given an inspection conforming with requirements of subparagraph (3) of this paragraph and paragraph (g)(2)(ii) of this section before placing in service.

(ii) A crane which has been idle for a period of six months shall be given a complete inspection conforming with requirements of subparagraphs (3) and (4) of this paragraph and paragraph (g)(2)(ii) of this section before placing in service.

(iii) Standby cranes shall be inspected at least semiannually in accordance with requirements of subparagraph (3) of this paragraph and paragraph (g)(2)(ii) of this section. Such cranes which are exposed to adverse environment should be inspected more frequently.

(6) *Inspection records.* Written, dated, and signed inspection reports and records shall be made monthly on critical items in use such as brakes, crane hooks, and ropes. Records shall be kept readily available.

(e) *Testing*—(1) *Operational tests.* (i) In addition to prototype tests and quality-control measures, each new production crane shall be tested by the manufacturer to the extent necessary to insure compliance with the operational requirements of this paragraph including functions such as the following:

(*a*) Load hoisting and lowering mechanisms

(*b*) Boom hoisting and lower mechanisms

(*c*) Swinging mechanism

(*d*) Travel mechanism

(*e*) Safety devices

(ii) Where the complete production crane is not supplied by one manufacturer such tests shall be conducted at final assembly.

(iii) Certified production-crane test results shall be made available.

(2) *Rated load test.* (i) Written reports shall be available showing test procedures and confirming the adequacy of repairs or alterations.

(ii) Test loads shall not exceed 110 percent of the rated load at any selected working radius.

(iii) Where rerating is necessary:

(*a*) Crawler, truck, and wheel-mounted cranes shall be tested in accordance with SAE Recommended Practice, Crane Load Stability Test Code J765 (April 1961).

(*b*) Locomotive cranes shall be tested in accordance with paragraph (a)(1)(i) and (ii) of this section.

(*c*) Rerating test report shall be readily available.

(iv) No cranes shall be rerated in excess of the original load ratings unless such rating changes are approved by the crane manufacturer or final assembler.

(f) *Maintenance procedure*—(1) *General.* After adjustments and repairs have been made the crane shall not be operated until all guards have been reinstalled, safety devices reactivated, and maintenance equipment removed.

(g) *Rope inspection*—(1) *Running ropes.* A thorough inspection of all ropes in use shall be made at least once a month and a full written, dated, and signed report of rope condition kept on file where readily available. All inspections shall be performed by an appointed or authorized person. Any deterioration, resulting in appreciable loss of original strength, such as described below, shall be carefully noted and determination made as to whether further use of the rope would constitute a safety hazard:

(i) Reduction of rope diameter below nominal diameter due to loss of core support, internal, or external corrosion or wear of outside wires.

(ii) A number of broken outside wires and the degree of distribution of concentration of such broken wires.

(iii) Worn outside wires.

(iv) Corroded or broken wires at end connections.

(v) Corroded, cracked, bent, worn, or improperly applied end connections.

(vi) Severe kinking, crushing, cutting, or unstranding.

(2) *Other ropes.* (i) Heavy wear and/or broken wires may occur in sections in contact with equalizer sheaves or other sheaves where rope travel is limited, or with saddles. Particular care shall be taken to inspect ropes at these locations.

(ii) All rope which has been idle for a period of a month or more due to shut down or storage of a crane on which it is installed shall be given a thorough inspection before it is placed in service. This inspection shall be for all types of deterioration and shall be performed by

an appointed or authorized person whose approval shall be required for further use of the rope. A written and dated report of the rope condition shall be available.

(iii) Particular care shall be taken in the inspection of nonrotating rope.

(h) *Handling the load*—(1) *Size of load.* (i) No crane shall be loaded beyond the rated load, except for test purposes as provided in paragraph (e) of this section.

(ii) When loads which are limited by structural competence rather than by stability are to be handled, it shall be ascertained that the weight of the load has been determined within plus or minus 10 percent before it is lifted.

(2) *Attaching the load.* (i) The hoist rope shall not be wrapped around the load.

(ii) The load shall be attached to the hook by means of slings or other approved devices.

(3) *Moving the load.* (i) The employer shall assure that:

(*a*) The crane is level and where necessary blocked properly.

(*b*) The load is well secured and properly balanced in the sling or lifting device before it is lifted more than a few inches.

(ii) Before starting to hoist, the following conditions shall be noted:

(*a*) Hoist rope shall not be kinked.

(*b*) Multiple part lines shall not be twisted around each other.

(*c*) The hook shall be brought over the load in such a manner as to prevent swinging.

(*d*) If there is a slack rope condition, it should be determined that the rope is properly seated on the drum and in the sheaves.

(iii) During hoisting care shall be taken that:

(*a*) There is not sudden acceleration or deceleration of the moving load.

(*b*) The load does not contact any obstructions.

(iv) Side loading of booms shall be limited to freely suspended loads. Cranes shall not be used for dragging loads sideways.

(v) No hoisting, lowering, swinging, or traveling shall be done while anyone is on the load or hook.

(vi) The operator should avoid carrying loads over people.

(vii) On truck mounted cranes, no loads shall be lifted over the front area except as approved by the crane manufacturer.

(viii) The operator shall test the brakes each time a load approaching the rated load is handled by raising it a few inches and applying the brakes.

(ix) Outriggers shall be used when the load to be handled at that particular radius exceeds the rated load without outriggers as given by the manufacturer for that crane. Where floats are used they shall be securely attached to the outriggers. Wood blocks used to support outriggers shall:

(*a*) Be strong enough to prevent crushing.

(*b*) Be free from defects.

(*c*) Be of sufficient width and length to prevent shifting or toppling under load.

(x) Neither the load nor the boom shall be lowered below the point where less than two full wraps of rope remain on their respective drums.

(xi) Before lifting loads with locomotive cranes without using outriggers, means shall be applied to prevent the load from being carried by the truck springs.

(xii) When two or more cranes are used to lift one load, one designated person shall be responsible for the operation. He shall be required to analyze the operation and instruct all personnel involved in the proper positioning, rigging of the load, and the movements to be made.

(xiii) In transit the following additional precautions shall be exercised:

(*a*) The boom shall be carried in line with the direction of motion.

(*b*) The superstructure shall be secured against rotation, except when negotiating turns when there is an operator in the cab or the boom is supported on a dolly.

(*c*) The empty hook shall be lashed or otherwise restrained so that it cannot swing freely.

(xiv) Before traveling a crane with load, a designated person shall be responsible for determining and controlling safety. Decisions such as position of load, boom location, ground support, travel route, and speed of movement shall be in accord with his determinations.

(xv) A crane with or without load shall not be traveled with the boom so high that it may bounce back over the cab.

(xvi) When rotating the crane, sudden starts and stops shall be avoided. Rotational speed shall be such that the load does not swing out beyond the radii at which it can be controlled. A tag or restraint line shall be used when rotation of the load is hazardous.

(xvii) When a crane is to be operated at a fixed radius, the boom-hoist pawl or other positive locking device shall be engaged.

(xviii) Ropes shall not be handled on a winch head without the knowledge of the operator.

(xix) While a winch head is being used, the operator shall be within convenient reach of the power unit control lever.

(4) *Holding the load.* (i) The operator shall not be permitted to leave his position at the controls while the load is suspended.

(ii) No person should be permitted to stand or pass under a load on the hook.

(iii) If the load must remain suspended for any considerable length of time, the operator shall hold the drum from rotating in the lowering direction by activating the positive controllable means of the operator's station.

(i) *Other requirements*—(1) *Rail clamps.* Rail clamps shall not be used as a means of restraining tipping of a locomotive crane.

(2) *Ballast or counterweight.* Cranes shall not be operated without the full amount of any ballast or counterweight in place as specified by the maker, but truck cranes that have dropped the ballast or counterweight may be operated temporarily with special care and only for light loads without full ballast or counterweight in place. The ballast or counterweight in place specified by the manufacturer shall not be exceeded.

(3) *Cabs.* (i) Necessary clothing and personal belongings shall be stored in such a manner as to not interfere with access or operation.

(ii) Tools, oil cans, waste, extra fuses, and other necessary articles shall be stored in the tool box, and shall not be permitted to lie loose in or about the cab.

(4) *Refueling.* (i) Refueling with small portable containers shall be done with Underwriters' Laboratories or Factory Mutual Laboratories approved, or equivalent, safety type can equipped with an automatic closing cap and flame arrester.

(ii) Machines shall not be refueled with the engine running.

(5) *Fire extinguishers.* (i) A carbon dioxide, dry chemical, or equivalent fire extinguisher shall be kept in the cab or vicinity of the crane.

(ii) Operating and maintenance personnel shall be made familiar with the use and care of the fire extinguishers provided.

(6) *Swinging locomotive cranes.* A locomotive crane shall not be swung into a position where railway cars on an adjacent track might strike it, until it has been ascertained that cars are not being moved on the adjacent track and proper flag protection has been established.

(j) *Operating near electric power lines*—(1) *Clearances.* Except where the electrical distribution and transmission lines have been deenergized and visibly grounded at point of work or where insulating barriers not a part of or an attachment to the crane have been erected to prevent physical contact with the lines, cranes shall be operated proximate to, under, over, by, or near powerlines only in accordance with the following:

(i) For lines rated 50 kv. or below, minimum clearance between the lines and any part of the crane or load shall be 10 feet.

(ii) For lines rated over 50 kv. minimum, clearance between the lines and any part of the crane or load shall be 10 feet plus 0.4 inch for each 1 kv. over 50 kv., or twice the length of the line insulator but never less than 10 feet.

(iii) In transit with no load and boom lowered the clearance shall be a minimum of 4 feet.

(2) *Boom guards.* Cage-type boom guards, insulating links, or proximity warning devices may be used on cranes, but the use of such devices shall not operate to alter the requirements of subparagraph (1) of this paragraph.

(3) *Notification.* Before the commencement of operations near electrical lines, the owners of the lines or their authorized representative shall be notified and provided with all pertinent information.

The cooperation of the owner shall be requested.

(4) *Overhead wires.* Any overhead wire shall be considered to be an energized line unless and until the person owning such line or the electrical utility authorities indicate that it is not an energized line.

§ 1910.181 Derricks.

(a) *Definitions applicable to this section.* (1) A "derrick" is an apparatus consisting of a mast or equivalent member held at the head by guys or braces, with or without a boom, for use with a hoisting mechanism and operating ropes.

(2) "A-frame derrick" means a derrick in which the boom is hinged from a cross member between the bottom ends of two upright members spread apart at the lower ends and joined at the top; the boom point secured to the junction of the side members, and the side members are braced or guyed from this junction point.

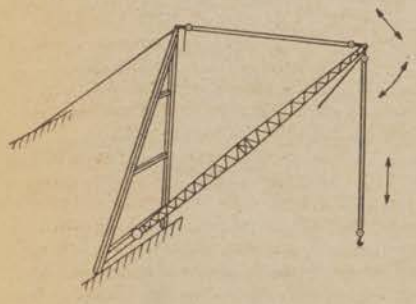

A-FRAME

(3) A "basket derrick" is a derrick without a boom, similar to a gin pole with its base supported by ropes attached to corner posts or other parts of the structure. The base is at a lower elevation than its supports. The location of the base of a basket derrick can be changed by varying the length of the rope supports. The top of the pole is secured with multiple reeved guys to position the top of the pole to the desired location by varying the length of the upper guy lines. The load is raised and lowered by ropes through a sheave or block secured to the top of the pole.

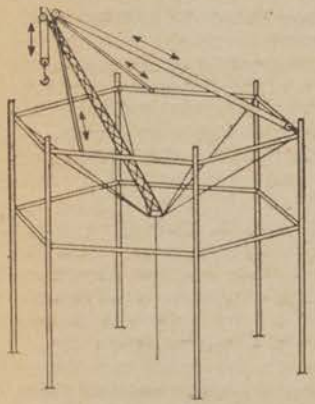

BASKET

(4) "Breast derrick" means a derrick without boom. The mast consists of two side members spread farther apart at the base than at the top and tied together at top and bottom by rigid members. The mast is prevented from tipping forward by guys connected to its top. The load is raised and lowered by ropes through a sheave or block secured to the top crosspiece.

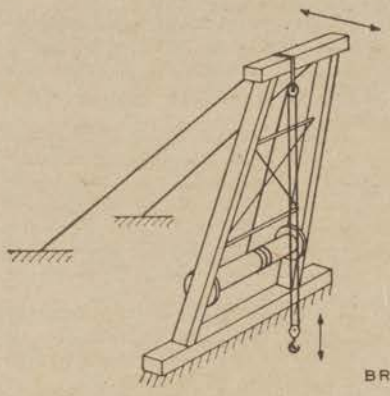

BREAST

(5) "Chicago boom derrick" means a boom which is attached to a structure, and outside upright member of the structure serving as the mast, and the boom being stepped in a fixed socket clamped to the upright. The derrick is complete with load, boom, and boom point swing line falls.

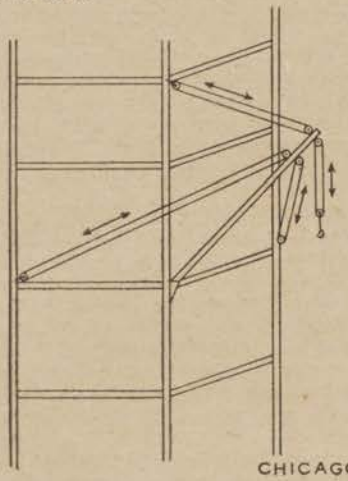

CHICAGO BOOM

(6) A "gin pole derrick" is a derrick without a boom. Its guys are so arranged from its top as to permit leaning the mast in any direction. The load is raised and lowered by ropes reeved through sheaves or blocks at the top of the mast.

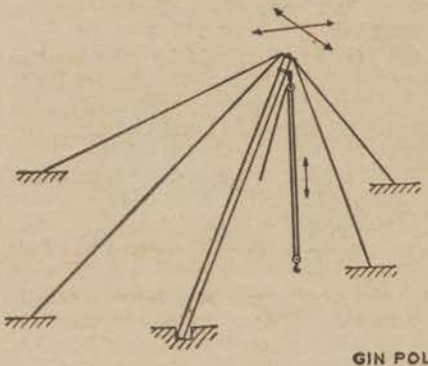

GIN POLE

(7) "Guy derrick" means a fixed derrick consisting of a mast capable of being rotated, supported in a vertical position by guys, and a boom whose bottom end is hinged or pivoted to move in a vertical plane with a reeved rope between the head of the mast and the boom point for raising and lowering the boom, and a reeved rope from the boom point for raising and lowering the load.

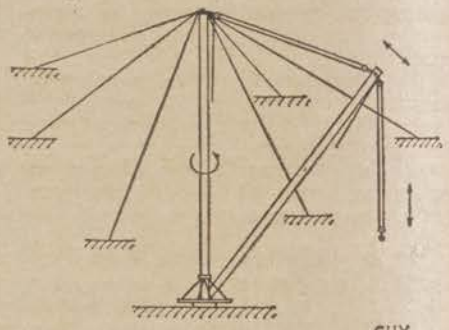

GUY

(8) "Shearleg derrick" means a derrick without a boom and similar to a breast derrick. The mast, wide at the bottom and narrow at the top, is hinged at the bottom and has its top secured by a multiple reeved guy to permit handling loads at various radii by means of load tackle suspended from the mast top.

(9) A "stiffleg derrick" is a derrick similar to a guy derrick except that the mast is supported or held in place by two or more stiff members, called stifflegs, which are capable of resisting either tensile or compressive forces. Sills are generally provided to connect the lower ends of the stifflegs to the foot of the mast.

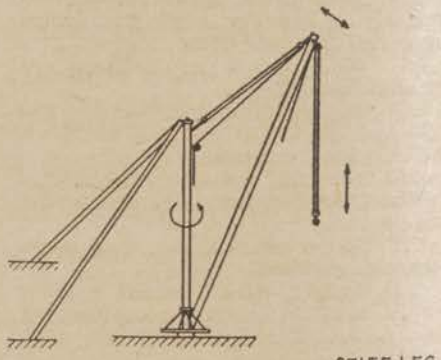

STIFF LEG

(10) "Appointed" means assigned specific responsibilities by the employer or the employer's representative.

(11) "ANSI" means the American National Standards Institute.

(12) A boom is a timber or metal section or strut, pivoted or hinged at the heel (lower end) at a location fixed in height on a frame or mast or vertical member, and with its point (upper end) supported by chains, ropes, or rods to the upper end of the frame, mast, or vertical member. A rope for raising and lowering the load is reeved through sheaves or a block at the boom point. The length of the boom shall be taken as the straight line distance between the axis of the foot pin and the axis of the boom point sheave pin, or where used, the axis of the upper load block attachment pin.

(13) "Boom harness" means the block and sheave arrangement on the boom point to which the topping lift cable is reeved for lowering and raising the boom.

(14) The "boom point" is the outward end of the top section of the boom.

(15) "Derrick bullwheel" means a horizontal ring or wheel, fastened to the foot of a derrick, for the purpose of turning the derrick by means of ropes leading from this wheel to a powered drum.

(16) "Designated" means selected or assigned by the employer or employer's representative as being qualified to perform specific duties.

(17) "Eye" means a loop formed at the end of a rope by securing the dead end to the live end at the base of the loop.

(18) A "fiddle block" is a block consisting of two sheaves in the same plane held in place by the same cheek plates.

(19) The "foot bearing" or "foot block" (sill block) is the lower support on which the mast rotates.

(20) A "gudgeon pin" is a pin connecting the mast cap to the mast allowing rotation of the mast.

(21) A "guy" is a rope used to steady or secure the mast or other member in the desired position.

(22) "Load, working" means the external load, in pounds, applied to the derrick, including the weight of load attaching equipment such as load blocks, shackles, and slings.

(23) "Load block, lower" means the assembly of sheaves, pins, and frame suspended by the hoisting rope.

(24) "Load block, upper" means the assembly of sheaves, pins, and frame suspended from the boom.

(25) "Mast" means the upright member of the derrick.

(26) "Mast cap (spider)" means the fitting at the top of the mast to which the guys are connected.

(27) "Reeving" means a rope system in which the rope travels around drums and sheaves.

(28) "Rope" refers to wire rope unless otherwise specified.

(29) "Safety Hook" means a hook with a latch to prevent slings or load from accidentally slipping off the hook.

(30) "Side loading" is a load applied at an angle to the vertical plane of the boom.

(31) The "sill" is a member connecting the foot block and stiffleg or a member connecting the lower ends of a double member mast.

(32) A "standby derrick" is a derrick not in regular service which is used occasionally or intermittently as required.

(33) "Stiff leg" means a rigid member supporting the mast at the head.

(34) "Swing" means rotation of the mast and/or boom for movements of loads in a horizontal direction about the axis of rotation.

(b) *General requirements*—(1) *Application.* This section applies to guy, stiffleg, basket, breast, gin pole, Chicago Boom and A-frame derricks of the stationary type, capable of handling loads at variable reaches and powered by hoists through systems of rope reeving, used to perform lifting hook work, single or multiple line bucket work, grab, grapple, and magnet work. Derricks may be permanently installed for temporary use as in construction work. The requirements of this section also apply to any modification of these types which retain their fundamental features, except for floating derricks.

(2) *New and existing equipment.* All new derricks installed after the effective date of this subpart shall meet the design specifications of the "American aNtional Standard Safety Code for Derricks ANSI B30.6–1969." Equipment constructed and installed prior to the effective date of this pubpart shall be modified to conform to these specifications, unless the equipment as constructed and installed presents serious difficulties to being modified and the equipment substantially complies with the requirements of this subpart.

(c) *Load ratings*—(1) *Rated load marking.* For permanently installed derricks with fixed lengths of boom, guy, and mast, a substantial, durable, and clearly legible rating chart shall be provided with each derrick and securely affixed where it is visible to personnel responsible for the safe operation of the equipment. The chart shall include the following data:

(i) Manufacturer's approved load ratings at corresponding ranges of boom angle or operating radii.

(ii) Specific lengths of components on which the load ratings are based.

(iii) Required parts for hoist reeving. Size and construction of rope may be shown either on the rating chart or in the operating manual.

(2) *Nonpermanent installations.* For nonpermanent installations, the manufacturer shall provide sufficient information from which capacity charts can be prepared for the particular installation. The capacity charts shall be located at the derricks or the jobsite office.

(d) *Inspection*—(1) *Inspection classification.* (i) Prior to initial use all new and altered derricks shall be inspected to insure compliance with the provisions of this section.

(ii) Inspection procedure for derricks in regular service is divided into two general classifications based upon the intervals at which inspection should be performed. The intervals in turn are dependent upon the nature of the critical components of the derrick and the degree of their exposure to wear, deterioration, or malfunction. The two general classifications are herein designated as frequent and periodic with respective intervals between inspections as defined below:

(*a*) Frequent inspection—Daily to monthly intervals.

(*b*) Periodic inspection—1- to 12-month intervals, or as specified by the manufacturer.

(2) *Frequent inspection.* Items such as the following shall be inspected for defects at intervals as defined in subparagraph (1) (ii) (*a*) of this paragraph or as specifically indicated, including observation during operation for any defects which might appear between regular inspections. Deficiencies shall be carefully examined for any safety hazard:

(i) All control mechanisms: Inspect daily for adjustment, wear, and lubrication.

(ii) All chords and lacing: Inspect daily, visually.

(iii) Tension in guys: Daily.

(iv) Plumb of the mast.

(v) Deterioration or leakage in air or hydraulic systems: Daily.

(vi) Derrick hooks for deformations or cracks; for hooks with cracks or having more than 15 percent in excess of normal throat opening or more than 10° twist from the plane of the unbent hook, refer to paragraph (e) (3) (iii) of this section.

(vii) Rope reeving; visual inspection for noncompliance with derrick manufacturer's recommendations.

(viii) Hoist brakes, clutches, and operating levers: check daily for proper functioning before beginning operations.

(ix) Electrical apparatus for malfunctioning, signs of excessive deterioration, dirt, and moisture accumulation.

(3) *Periodic inspection.* (i) Complete inspections of the derrick shall be performed at intervals as generally defined in subparagraph (1) (ii) (*b*) of this paragraph depending upon its activity, severity of service, and environment, or as specifically indicated below. These inspections shall include the requirements of subparagraph (2) of this paragraph and in addition, items such as the following. Deficiencies shall be carefully examined and a determination made as to whether they constitute a safety hazard:

(*a*) Structural members for deformations, cracks, and corrosion.

(*b*) Bolts or rivets for tightness.

(*c*) Parts such as pins, bearings, shafts, gears, sheaves, drums, rollers, locking and clamping devices, for wear, cracks, and distortion.

(*d*) Gudgeon pin for cracks, wear, and distortion each time the derrick is to be erected.

(*e*) Powerplants for proper performance and compliance with applicable safety requirements.

(*f*) Hooks; magnetic particle or other suitable crack detecting inspection should be performed at least once each year.

(ii) Foundation or supports shall be inspected for continued ability to sustain the imposed loads.

(4) *Derricks not in regular use.* (i) A derrick which has been idle for a period of 1 month or more, but less than 6 months, shall be given an inspection conforming with requirements of subparagraph (2) of this paragraph and paragraph (g) (3) of this section before placing in service.

(ii) A derrick which has been idle for a period of over 6 months shall be given a complete inspection conforming with requirements of subparagraphs (2) and (3) of this paragraph and paragraph (g)

(3) of this section before placing in service.

(iii) Standby derricks shall be inspected at least semiannually in accordance with requirements of subparagraph (2) of this paragraph and paragraph (g) (3) of this section. Those exposed to adverse environment should be inspected more frequently.

(e) *Testing*—(1) *Operational tests.* Prior to initial use all new and altered derricks shall be tested to insure compliance with this section including the following functions:

(i) Load hoisting and lowering.

(ii) Boom up and down.

(iii) Swing.

(iv) Operation of clutches and brakes of hoist.

(2) *Anchorages.* All anchorages shall be approved by the appointed person. Rock and hairpin anchorages may require special testing.

(f) *Maintenance*—(1) *Preventive maintenance.* A preventive maintenance program based on the derrick manufacturer's recommendations shall be established.

(2) *Maintenance procedure.* (i) Before adjustments and repairs are started on a derrick the following precautions shall be taken:

(*a*) The derrick to be repaired shall be arranged so it will cause the least interference with other equipment and operations in the area.

(*b*) All hoist drum dogs shall be engaged.

(*c*) The main or emergency switch shall be locked in the open position, if an electric hoist is used.

(*d*) Warning or out of order signs shall be placed on the derrick and hoist.

(*e*) The repairs of booms of derricks shall either be made when the booms are lowered and adequately supported or safely tied off.

(*f*) A good communication system shall be set up between the hoist operator and the appointed individual in charge of derrick operations before any work on the equipment is started.

(*g*) Welding repairs shall be approved by an appointed person.

(ii) After adjustments and repairs have been made the derrick shall not be operated until all guards have been reinstalled, safety devices reactivated, and maintenance equipment removed.

(3) *Adjustments and repairs.* (i) Any unsafe conditions disclosed by inspection shall be corrected before operation of the derrick is resumed.

(ii) Adjustments shall be maintained to assure correct functioning of components.

(iii) Repairs or replacements shall be provided promptly as needed for safe operation. The following are examples of conditions requiring prompt repair or replacement:

(*a*) Hooks showing defects described in paragraph (d) (2) (vi) of this section shall be discarded.

(*b*) All critical parts which are cracked, broken, bent, or excessively worn.

(*c*) Pitted or burned electrical contacts should be corrected only by replacement and in sets. Controller parts should be lubricated as recommended by the manufacturer.

(*d*) All replacement and repaired parts shall have at least the original safety factor.

(g) *Rope inspection*—(1) *Running ropes.* A thorough inspection of all ropes in use shall be made at least once a month and a full written, dated, and signed report of rope condition kept on file where readily available. Any deterioration, resulting in appreciable loss of original strength, such as described below, shall be carefully noted and determination made as to whether further use of the rope would constitute a safety hazard:

(i) Reduction of rope diameter below nominal diameter due to loss of core support, internal or external corrosion, or wear of outside wires.

(ii) A number of broken outside wires and the degree of distribution or concentration of such broken wires.

(iii) Worn outside wires.

(iv) Corroded or broken wires at end connections.

(v) Corroded, cracked, bent, worn, or improperly applied end connections.

(vi) Severe kinking, crushing, cutting, or unstranding.

(2) *Limited travel ropes.* Heavy wear and/or broken wires may occur in sections in contact with equalizer sheaves or other sheaves where rope travel is limited, or with saddles. Particular care shall be taken to inspect ropes at these locations.

(3) *Idle ropes.* All rope which has been idle for a period of a month or more due to shutdown or storage of a derrick on which it is installed shall be given a thorough inspection before it is placed in service. This inspection shall be for all types of deterioration. A written and dated report of the rope condition shall be available.

(4) *Nonrotating ropes.* Particular care shall be taken in the inspection of nonrotating rope.

(h) *Operations of derricks.* Derrick operation shall be directed only by the individual specifically designated for that purpose.

(i) *Handling the load*—(1) *Size of load.* (i) No derrick shall be loaded beyond the rated load.

(ii) When loads approach the maximum rating of the derrick, it shall be ascertained that the weight of the load has been determined within plus or minus 10 percent before it is lifted.

(2) *Attaching the load.* (i) The hoist rope shall not be wrapped around the load.

(ii) The load shall be attached to the hook by means of slings or other suitable devices.

(3) *Moving the load.* (i) The load shall be well secured and properly balanced in the sling or lifting device before it is lifted more than a few inches.

(ii) Before starting to hoist, the following conditions shall be noted:

(*a*) Hoist rope shall not be kinked.

(*b*) Multiple part lines shall not be twisted around each other.

(*c*) The hook shall be brought over the load in such a manner as to prevent swinging.

(*d*) If there is a slack rope condition, it should be determined that the rope is properly seated on the drum and in the sheaves.

(iii) During hoisting, care shall be taken that:

(*a*) There is no sudden acceleration or deceleration of the moving load.

(*b*) Load does not contact any obstructions.

(iv) A derrick shall not be used for side loading except when specifically authorized by a responsible person who has determined that the various structural components will not be overstressed.

(v) No hoisting, lowering, or swinging shall be done while anyone is on the load or hook.

(vi) The operator should avoid carrying loads over people.

(vii) The operator shall test the brakes each time a load approaching the rated load is handled by raising it a few inches and applying the brakes.

(viii) Neither the load nor boom shall be lowered below the point where less than two full wraps of rope remain on their respective drums.

(ix) When rotating a derrick, sudden starts and stops shall be avoided. Rotational speed shall be such that the load does not swing out beyond the radius at which it can be controlled.

(x) Boom and hoisting rope systems shall not be twisted.

(4) *Holding the load.* (i) The operator shall not be allowed to leave his position at the controls while the load is suspended.

(ii) People should not be permitted to stand or pass under a load on the hook.

(iii) If the load must remain suspended for any considerable length of time, a dog, or pawl and ratchet, or other equivalent means, rather than the brake alone, shall be used to hold the load.

(5) *Use of winch heads.* (i) Ropes shall not be handled on a winch head without the knowledge of the operator.

(ii) While a winch head is being used, the operator shall be within convenient reach of the power unit control lever.

(6) *Securing boom.* Dogs, pawls, or other positive holding mechanism on the hoist shall be engaged. When not in use, the derrick boom shall:

(i) Be laid down;

(ii) Be secured to a stationary member, as nearly under the head as possible, by attachment of a sling to the load block; or

(iii) Be hoisted to a vertical position and secured to the mast.

(j) *Other requirements*—(1) *Guards.* (i) Exposed moving parts, such as gears, ropes, setscrews, projecting keys, chains, chain sprockets, and reciprocating components, which constitute a hazard under normal operating conditions shall be guarded.

(ii) Guards shall be securely fastened.

(iii) Each guard shall be capable of supporting without permanent distortion, the weight of a 200-pound person unless the guard is located where it is impossible for a person to step on it.

(2) *Hooks.* (i) Hooks shall meet the manufacturer's recommendations and shall not be overloaded.

(ii) Safety latch type hooks shall be used wherever possible.

(3) *Fire extinguishers.* (i) A carbon dioxide, dry chemical, or equivalent fire extinguisher shall be kept in the immediate vicinity of the derrick.

(ii) Operating and maintenance personnel shall be familiar with the use and care of the fire extinguishers provided.

(4) *Refueling.* (i) Refueling with portable containers shall be done with Underwriters' Laboratory, Inc. (UL), or Factory Mutual Laboratories approved, or equivalent, safety type containers equipped with automatic closing spout and flame arrester.

(ii) Machines shall not be refueled with the engine running.

(5) *Operating near electric powerlines.* (i) Except where the electrical distribution and transmission lines have been deenergized and visibly grounded at point of work or where insulating barriers not a part of or an attachment to the derrick have been erected to prevent physical contact with the lines, derricks shall be operated proximate to, under, over, by, or near powerlines only in accordance with the following:

(*a*) For lines rated 50 kv. or below minimum clearance between the lines and any part of the derrick or load shall be 10 feet.

(*b*) For lines rated over 50 kv. minimum clearance between the lines and any part of the derrick or load shall be 10 feet plus 0.4 inch for each 1 kv. over 50 kv., or use twice the length of the line insulator, but never less than 10 feet.

(ii) Cage-type boom guards, insulating links, or proximity warning devices may be used on derricks, but the use of such devices shall not operate to alter the requirements of subdivision (i) of this subparagraph.

(iii) Before the commencement of operations near electrical lines, the owners of the lines or their authorized representatives shall be notified and provided with pertinent information. The owner's cooperation shall be requested.

(iv) Any overhead wire shall be considered to be an energized line until the owner of the line or their authorized representatives state that it is deenergized.

(6) *Cab or operating enclosure.* (i) Necessary clothing and personnel belongings shall be stored in such a manner as to not interfere with access or operation.

(ii) Tools, oilcans, waste, extra fuses, and other necessary articles shall be stored in the toolbox, and shall not be permitted to lie loose in or about the cab or operating enclosure.

§ 1910.182 Additional delay in effective date.

The requirements of this Subpart N shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart upon commencement of the Walsh-Healey requirement.

§ 1910.183 Sources of standards.

Sec.	Source
1910.176	41 CFR 50–204.3.
1910.177	NFPA No. 231–1970, General Indoor Storage.
1910.178(a)(1)	NFPA No. 505–1969, Powered Industrial Trucks.
1910.178(a)(2)	ANSI B56.1–1969, Standard for Powered Industrial Trucks, Part II.
1910.178(a)(3)	NFPA No. 505–1969, Powered Industrial Trucks.
1910.178(a)(4)–(7)	ANSI B56.1–1969, Standard for Powered Industrial Trucks.
1910.178(b)–(d)	NFPA No. 505–1969, Powered Industrial Trucks.
1910.178(e)–(p)	ANSI B56.1–1969, Powered Industrial Trucks.
1910.178(q)	NFPA No. 505–1969, Powered Industrial Trucks.
1910.179	ANSI B30.2.0–1967, Safety Code for Overhead and Gantry Cranes.
1910.180	ANSI B30.5–1968, Safety Code for Crawler, Locomotive, and Truck Cranes.
1910.181	ANSI B30.6–1969, Safety Code for Derricks.

§ 1910.184 Standards organizations.

Specific standards of the following organizations have been referenced in this part. Copies of the referenced materials may be obtained from the issuing organizations.

American Society of Heating, Refrigeration, and Air Conditioning Engineers, Inc., 345 East 47th Street, New York, NY 10017.

Crane Manufacturers Association of America, Inc., 1 Thomas Circle NW., Washington, DC 20005.

American National Standards Institute, 1430 Broadway, New York, NY 10018.

National Fire Protection Association, 60 Batterymarch Street, Boston, MA 02110.

Society of Automotive Engineers, Inc., 485 Lexington Avenue, New York, NY 10017.

Subpart O—Machinery and Machine Guarding

§ 1910.211 Definitions.

(a) As used in §§ 1910.213 and 1910.214 unless the context clearly requires otherwise, the following woodworking machinery terms shall have the meaning prescribed in this paragraph.

(1) "Point of operations" means that point at which cutting, shaping, boring, or forming is accomplished upon the stock.

(2) "Push stick" means a narrow strip of wood or other soft material with a notch cut into one end and which is used to push short pieces of material through saws.

(3) "Block" means a short block of wood, provided with a handle similar to that of a plane and a shoulder at the rear end, which is used for pushing short stock over revolving cutters.

(b) As used in § 1910.215 unless the context clearly requires otherwise, the following abrasive wheel machinery terms shall have the meanings prescribed in this paragraph.

(1) "Type 1 straight wheels" means wheels having diameter, thickness, and hole size dimensions, and they should be used only on the periphery. Type 1 wheels shall be mounted between flanges.

LIMITATION: Hole dimension (H) should not be greater than two-thirds of wheel diameter dimension (D) for precision, cylindrical, centerless, or surface grinding applications. Maximum hole size for all other applications should not exceed one-half wheel diameter.

Figure No. O-1

TYPE 1 STRAIGHT WHEELS

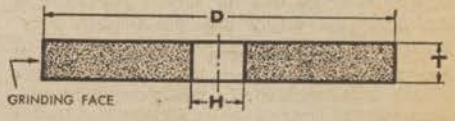

Type 1 — Straight Wheel.
Peripheral grinding wheel having a diameter, thickness and hole.

(2) "Type 2 cylinder wheels" means wheels having diameter, wheel thickness, and rim thickness dimensions. Grinding is performed on the rim face only, dimension W. Cylinder wheels may be plain, plate mounted, inserted nut, or of the projecting stud type.

LIMITATION: Rim height, T dimension, is generally equal to or greater than rim thickness, W dimension.

Figure No. O-2

TYPE 2 CYLINDER WHEELS

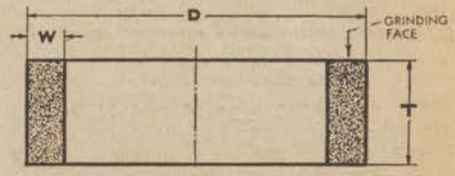

Type 2 — Cylinder Wheel
Side grinding wheel having a diameter, thickness and wall—wheel is mounted on the diameter.

(3) "Type 6 straight cup wheels" means wheels having diameter, thickness, hole size, rim thickness, and back thickness dimensions. Grinding is always performed on rim face, W dimension.

LIMITATION: Minimum back thickness, E dimension, should not be less than one-fourth T dimension. In addition, when unthreaded hole wheels are specified, the inside flat, K dimension, must be large enough to accommodate a suitable flange.

Figure No. 0-3

TYPE 6 STRAIGHT CUP WHEELS

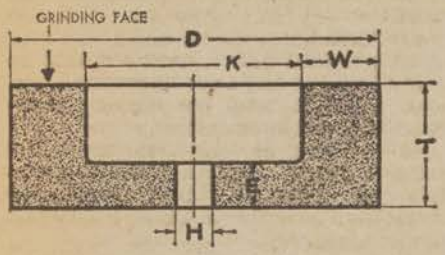

Type 6 — Straight-cup Wheel
Side grinding wheel having a diameter, thickness and hole with one side straight or flat and the opposite side recessed. This type, however, differs from Type 5 in that the grinding is performed on the wall of the abrasive created by the difference between the diameter of the recess and the outside diameter of the wheel. Therefore, the wall dimension "W" takes precedence over the diameter of the recess as an essential intermediate dimension to describe this shape type.

(4) "Type 11 flaring cup wheels" mean wheels having double diameter dimensions D and J, and in addition have thickness, hole size, rim and back thickness dimensions. Grinding is always performed on rim face, W dimension. Type 11 wheels are subject to all limitations of use and mounting listed for type 6 straight sided cup wheels definition.

LIMITATION: Minimum back thickness, E dimension, should not be less than one-fourth T dimension. In addition when unthreaded hole wheels are specified the inside flat, K dimension, shall be large enough to accommodate a suitable flange.

Figure No. 0-4

TYPE 11 FLARING CUP WHEELS

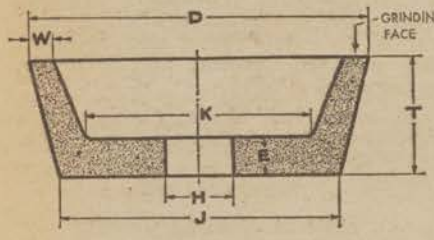

Type 11 — Flaring-cup Wheel
Side grinding wheel having a wall flared or tapered outward from the back. Wall thickness at the back is normally greater than at the grinding face (W).

(5) "Modified types 6 and 11 wheels (terrazzo)" mean some type 6 and 11 cup wheels used in the terrazzo trade having tapered K dimensions to match a special tapered flange furnished by the machine builder.

LIMITATION: These wheels shall be mounted only with a special tapered flange.

Figure No. 0-5

Type 6& 11 Wheels (Terrazzo)

Typical examples of modified types 6 and 11 wheels (terrazzo) showing tapered K dimensions.

(6) "Types 27 and 28 depressed center wheels" mean have diameter, thickness, and hole size dimensions. Both types are reinforced, organic bonded wheels having offset hubs which permit side and peripheral grinding operations without interference with the mounting. Type 27 wheels are manufactured with flat grinding rims permitting notching and cutting operations. Type 28 wheels have saucer shaped grinding rims.

(i) Limitations: Special supporting, back adapter and inside flange nuts are required for the proper mounting of these types of wheels subject to limitations of § 1910.215(c)(4) (i) and (ii).

(ii) Mounts which are affixed to the wheel by the manufacturer may not require an inside nut and shall not be reused.

(7) "Type 27A depressed center, cutting-off wheels" mean wheels having diameter, thickness, and hole size dimensions. They are reinforced, organic bonded, offset hub type wheels, usually 16 inches diameter and larger, specially designed for use on cutting-off machines where mounting nut or outer flange interference cannot be tolerated.

LIMITATIONS: See § 1910.215(c).

(8) "Surface feet per minute" (s.f.p.m.) means the distance in feet any one abrasive grain on the peripheral surface on a grinding wheel travels in 1 minute.

$$\text{Surface Feet Per Minute} = \frac{3.1416 \times \text{diameter in inches} \times \text{r.p.m.}}{12}$$

or

$$.262 \times \text{diameter in inches} \times \text{r.p.m.}$$

Examples: (a) 24-inch diameter wheel, 1,000 revolutions per minute. Surface Feet per minute $.262 \times 24 \times 1{,}000 = 6{,}288$ s.f.p.m.

(b) 12-inch diameter wheel, 1,000 revolutions per minute. Surface Feet per minute $.262 \times 12 \times 1{,}000 = 3{,}144$ s.f.p.m.

(9) "Flanges" means collars, discs or plates between which wheels are mounted and are referred to as adaptor, sleeve, or back up type. See paragraph (c) of § 1910.215 for full description.

(10) "Snagging" means grinding which removes relatively large amounts of material without regard to close tolerances or surface finish requirements.

(11) "Off-hand grinding" means the grinding of any material or part which is held in the operator's hand.

(12) "Safety guard" means an enclosure designed to restrain the pieces of the grinding wheel and furnish all possible protection in the event that the wheel is broken in operation. See paragraph (b) of § 1910.215.

(13) "Cutting off wheels" mean wheels having diameter thickness and hole size dimensions and are subject to all limitations of mounting and use listed for type 1 wheels, the definition in subparagraph (1) of this paragraph and paragraph (d) of § 1910.215. They may be steel centered, diamond abrasive or organic bonded abrasive of the plain or reinforced type.

(i) Limitation: Cutting off wheels are recommended only for use on specially designed and fully guarded machines and are subject to the following maximum thickness and hole size limitations.

Wheel diameter:	*Max. thickness (inch)*
6 inch and smaller	3/16
Larger than 6 inches to 12 inches	1/4
Larger than 12 inches to 23 inches	3/8
Larger than 23 inches	1/2

(ii) Maximum hole size for cutting-off wheels should not be larger than 1/4-wheel diameter.

(14) "Abrasive wheel" means a cutting tool consisting of abrasive grains held together by organic or inorganic bonds. Diamond and reinforced wheels are included.

(15) "Organic wheels" means wheels which are bonded by means of an organic material such as resin, rubber, shellac, or other similar bonding agent.

(16) "Inorganic wheels" means wheels which are bonded by means of inorganic material such as clay, glass, porcelain, sodium silicate, magnesium oxychloride, or metal. Wheels bonded with clay, glass, porcelain or related ceramic materials are characterized as "vitrified bonded wheels."

(c) As used in 1910.216, unless the context clearly requires otherwise, the following mills and calendars in the rubber and plastic industries terms shall have the meanings prescribed in this paragraph. (1) "Bite" means the nip point between any two inrunning rolls.

(2) "Calender" means a machine equipped with two or more metal rolls revolving in opposite directions and used for continuously sheeting or plying up rubber and plastics compounds and for frictioning or coating materials with rubber and plastics compounds.

(3) "Mill" means a machine consisting of two adjacent metal rolls, set horizontally, which revolve in opposite directions (i.e., toward each other as viewed from above) used for the mechanical working of rubber and plastics compounds.

(d) As used in § 1910.217, unless the context clearly requires otherwise, the following power press terms shall have the meaning prescribed in this paragraph.

(1) "Antirepeat" means the part of the clutch/brake control system designed to limit the press to a single stroke if the tripping means is held operated. Antirepeat requires release of all tripping mechanisms before another stroke can be initiated. "Antirepeat" is also called single stroke reset or reset circuit.

(2) "Brake" means the mechanism used on a mechanical power press to stop and/or hold the crankshaft, either directly or through a gear train, when the clutch is disengaged.

(3) "Bolster plate" means the plate attached to the top of the bed of the press having drilled holes or T-slots for attaching the lower die or die shoe.

(4) "Clutch" means the coupling mechanism used on a mechanical power press to couple the flywheel to the crankshaft, either directly or through a gear train.

(5) "Full revolution clutch" means a type of clutch that, when tripped, cannot be disengaged until the crankshaft has completed a full revolution and the press slide a full stroke.

(6) "Part revolution clutch" means a type of clutch that can be disengaged at any point before the crankshaft has completed a full revolution and the press slide a full stroke.

(7) "Direct drive" means the type of driving arrangement wherein no clutch is used; coupling and decoupling of the driving torque is accomplished by energization and deenergization of a motor. Even though not employing a clutch, direct drives match the operational characteristics of "part revolution clutches" because the driving power may be disengaged during the stroke of the press.

(8) "Concurrent" means acting in conjunction, and is used to describe a situation wherein two or more controls exist in an operated condition at the same time.

(9) "Continuous" means uninterrupted multiple strokes of the slide without intervening stops (or other clutch control action) at the end of individual strokes.

(10) "Counterbalance" means the mechanism that is used to balance or support the weight of the connecting rods, slide, and slide attachments.

(11) "Device" means a press control or attachment that:

(i) Restrains the operator from inadvertently reaching into the point of operation, or

(ii) Prevents normal press operation if the operator's hands are inadvertently within the point of operation, or

(iii) Automatically withdraws the operator's hands if the operator's hands are inadvertently within the point of operation as the dies close.

(12) "Presence sensing device" means a device designed, constructed and arranged to create a sensing field or area and deactivate the clutch control of the press when an operator's hand or any other parts of his body is within such field or area.

(13) "Gate or movable barrier device" means a movable barrier arranged to enclose the point of operation before the press stroke can be started.

(14) "Holdout or restraint device" means a mechanism, including attachments for operator's hands, that when anchored and adjusted prevent the operator's hands from entering the point of operation.

(15) "Pull-out device" means a mechanism attached to the operator's hands and connected to the upper die or slide of the press, that is designed, when properly adjusted, to withdraw the operator's hands as the dies close, if the operator's hands are inadvertently within the point of operation.

(16) "Sweep device" means a single or double arm (rod) attached to the upper die or slide of the press and designed to move the operator's hands to a safe position as the dies close, if the operator's hands are inadvertently within the point of operation.

(17) "Two hand control device" means two hand trip that further requires concurrent pressure from both hands of the operator during a substantial part of the die-closing portion of the stroke of the press.

(18) "Die" means the tooling used in a press for cutting or forming material. An upper and a lower die make a complete set.

(19) "Die builder" means any person who builds dies for power presses.

(20) "Die set" means a tool holder held in alignment by guide posts and bushings and consisting of a lower shoe, an upper shoe or punch holder, and guide posts and bushings.

(21) "Die setter" means an individual who places or removes dies in or from mechanical power presses, and who, as a part of his duties, makes the necessary adjustments to cause the tooling to function properly and safely.

(22) "Die setting" means the process of placing or removing dies in or from a mechanical power press, and the process of adjusting the dies, other tooling and safeguarding means to cause them to function properly and safely.

(23) "Die shoe" means a plate or block upon which a die holder is mounted. A die shoe functions primarily as a base for the complete die assembly, and, when used, is bolted or clamped to the bolster plate or the face of slide.

(24) "Ejector" means a mechanism for removing work or material from between the dies.

(25) "Face of slide" means the bottom surface of the slide to which the punch or upper die is generally attached.

(26) "Feeding" means the process of placing or removing material within or from the point of operation.

(27) "Automatic feeding" means feeding wherein the material or part being processed is placed within or removed from the point of operation by a method or means not requiring action by an operator on each stroke of the press.

(28) "Semiautomatic feeding" means feeding wherein the material or part being processed is placed within or removed from the point of operation by an auxiliary means controlled by operator on each stroke of the press.

(29) "Manual feeding" means feeding wherein the material or part being processed is handled by the operator on each stroke of the press.

(30) "Foot control" means the foot operated control mechanism designed to be used with a clutch or clutch/brake control system.

(31) "Foot pedal" means the foot operated lever designed to operate the mechanical linkage that trips a full revolution clutch.

(32) "Guard" means a barrier that prevents entry of the operator's hands or fingers into the point of operation.

(33) "Die enclosure guard" means an enclosure attached to the die shoe or stripper, or both, in a fixed position.

(34) "Fixed barrier guard" means a die space barrier attached to the press frame.

(35) "Interlocked press barrier guard" means a barrier attached to the press frame and interlocked so that the press stroke cannot be started normally unless the guard itself, or its movable sections, enclose the point of operation.

(36) "Adjustable barrier guard" means a barrier requiring adjustment for each job or die setup.

(37) "Guide post" means the pin attached to the upper or lower die shoe, operating within the bushing on the opposing die shoe, to maintain the alignment of the upper and lower dies.

(38) "Hand feeding tool" means any hand held tool designed for placing or removing material or parts to be processed within or from the point of operation.

(39) "Inch" means an intermittent motion imparted to the slide (on machines using part revolution clutches) by momentary operation of the "Inch" operating means. Operation of the "Inch" operating means engages the driving clutch so that a small portion of one stroke or indefinite stroking can occur, depending upon the length of time the "Inch" operating means is held operated. "Inch" is a function used by the die setter for setup of dies and tooling, but is not intended for use during production operations by the operator.

(40) "Jog" means an intermittent motion imparted to the slide by momentary operation of the drive motor, after the clutch is engaged with the flywheel at rest.

(41) "Knockout" means a mechanism for releasing material from either die.

(42) "Liftout" means the mechanism also known as knockout.

(43) "Operator's station" means the complete complement of controls used by or available to an operator on a given operation for stroking the press.

(44) "Pinch point" means any point other than the point of operation at which it is possible for a part of the body to be caught between the moving parts of a press or auxiliary equipment, or between moving and stationary parts of a press or auxiliary equipment or between the material and moving part or parts of the press or auxiliary equipment.

(45) "Joint of operation" means the area of the press where material is actually positioned during any process such as shearing, punching, forming, or assembling.

(46) "Press" means a mechanically powered machine that shears, punches, forms or assembles metal or other material by means of cutting, shaping, or combination dies attached to slides. A press consists of a stationary bed or anvil, and a slide (or slides) having a controlled reciprocating motion toward and away from the bed surface, the slide being guided in a definite path by the frame of the press.

(47) "Repeat" means an unintended or unexpected successive stroke of the press resulting from a malfunction.

(48) "Safety block" means a prop that, when inserted between the upper and lower dies or between the bolster plate and the face of the slide, prevents

the slide from falling of its own deadweight.

(49) "Single stroke" means one complete stroke of the slide, usually initiated from a full open (or up) position, followed by closing, (or down), and then a return to the full open position.

(50) "Single stroke mechanism" means an arrangement used on a full revolution clutch to limit the travel of the slide to one complete stroke at each engagement of the clutch.

(51) "Slide" means the main reciprocating press member. A slide is also called a ram, plunger, or platen.

(52) "Stop control" means an operator control designed to immediately deactivate the clutch control and activate the brake to stop slide motion.

(53) "Stripper" means a mechanism or die part for removing the parts of material from the punch.

(54) "Stroking selector" means the part of the clutch/brake control that determines the type of stroking when the operating means is actuated. The stroking selector generally includes positions for "Off" (Clutch Control), "Inch," "Single Stroke," and "Continuous" (when continuous is furnished).

(55) "Trip or (tripping)" means activation of the clutch to "run" the press.

(56) "Turnover bar" means a bar used in die setting to manually turn the crankshaft of the press.

(57) "Two-hand trip" means a clutch actuating means requiring the concurrent use of both hands of the operator to trip the press.

(58) "Unitized tooling" means a type of die in which the upper and lower members are incorporated into a selfcontained unit so arranged as to hold the die members in alignment.

(e) As used in § 1910.218, unless the context clearly requires otherwise, the following forging and hot metal terms shall have the meaning prescribed in this paragraph.

(1) "Forging" means the product of work on metal formed to a desired shape by impact or pressure in hammers, forging machines (upsetters), presses, rolls, and related forming equipment. Forging hammers, counterblow equipment and high-energy-rate forging machines impart impact to the workpiece, while most other types of forging equipment impart squeeze pressure in shaping the stock. Some metals can be forged at room temperature, but the majority of metals are made more plastic for forging by heating.

(2) "Open framehammers (or blacksmith hammers)" mean hammers used primarily for the shaping of forgings by means of impact with flat dies. Open frame hammers generally are so constructed that the anvil assembly is separate from the operating mechanism and machine supports; it rests on its own independent foundation. Certain exceptions are forging hammers made with frame mounted on the anvil; e.g., the smaller, single-frame hammers are usually made with the anvil and frame in one piece.

(3) "Steam hammers" mean a type of drop hammer where the ram is raised for each stroke by a double-action steam cylinder and the energy delivered to the workpiece is supplied by the velocity and weight of the ram and attached upper die driven downward by steam pressure. Energy delivered during each stroke may be varied.

(4) "Gravity hammers" mean a class of forging hammer wherein energy for forging is obtained by the mass and velocity of a freely falling ram and the attached upper die. Examples: Board hammers and air-lift hammers.

(5) "Forging presses" mean a class of forging equipment wherein the shaping of metal between dies is performed by mechanical or hydraulic pressure, and usually is accomplished with a single workstroke of the press for each die station.

(6) "Trimming presses" mean a class of auxiliary forging equipment which removes flash or excess metal from a forging. This trimming operation can also be done cold, as can coining, a product sizing operation.

(7) "High-energy-rate forging machines" mean a class of forging equipment wherein high ram velocities resulting from the sudden release of a compressed gas against a free piston impart impact to the workpiece.

(8) "Forging rolls" mean a class of auxiliary forging equipment wherein stock is shaped between power driven rolls bearing contoured dies. Usually used for preforming, roll forging is often employed to reduce thickness and increase length of stock.

(9) "Ring rolls" mean a class for forging equipment used for shaping weldless rings from pierced discs or thick-walled, ring-shaped blanks between rolls which control wall thickness, ring diameter, height and contour.

(10) "Bolt-headers" mean the same as an upsetter or forging machine except that the diameter of stock fed into the machine is much smaller, i.e., commonly three-fourths inch or less.

(11) Rivet making machines mean the same as upsetters and boltheaders when producing rivets with stock diameter of 1-inch or more. Rivet making with less than 1-inch diameter is usually a cold forging operation, and therefore not included in this subpart.

(12) Upsetters (or forging machines, or headers) type of forging equipment, related to the mechanical press, in which the main forming energy is applied horizontally to the workpiece which is gripped and held by prior action of the dies.

(f) As used in § 1910.219, unless, the context clearly requires otherwise, the following mechanical power-transmission guarding terms shall have the meaning prescribed in this paragraph.

(1) "Belts" include all power transmission belts, such as flat belts, round belts, V-belts, etc., unless otherwise specified.

(2) "Belt shifter" mean is a device for mechanically shifting belts from tight to loose pulleys or vice versa, or for shifting belts on cones of speed pulleys.

(3) "Belt pole" (sometimes called a "belt shipper" or "shipper pole,") mean a device used in shifting belts on and off fixed pulleys on line or countershaft where there are no loose pulleys.

(4) "Exposed to contact" means that the location of an object is such that a person is likely to come into contact with it and be injured.

(5) "Flywheels" include flywheels, balance wheels, and flywheel pulleys mounted and revolving on crankshaft of engine or other shafting.

(6) "Maintenance runway" means any permanent runway or platform used for oiling, maintenance, running adjustment, or repair work, but not for passageway.

(7) "Nip-point belt and pulley guard" means a device which encloses the pulley and is provided with rounded or rolled edge slots through which the belt passes.

(8) "Point of operation" means that point at which cutting, shaping, or forming is accomplished upon the stock and shall include such other points as may offer a hazard to the operator in inserting or manipulating the stock in the operation of the machine.

(9) "Prime movers" include steam, gas, oil, and air engines, motors, steam and hydraulic turbines, and other equipment used as a source of power.

(10) "Sheaves" mean grooved pulleys, and shall be so classified unless used as flywheels.

§ 1910.212 General requirements for all machines.

(a) *Machine guarding*—(1) *Types of guarding.* One or more methods of machine guarding shall be provided to protect the operator and other employees in the machine area from hazards such as those created by point of operation, ingoing nip points, rotating parts, flying chips and sparks. Examples of guarding methods are—barrier guards, two-hand tripping devices, electronic safety devices, etc.

(2) *General requirements for machine guards.* Guards shall be affixed to the machine where possible and secured elsewhere if for any reason attachment to the machine is not possible. The guard shall be such that it does not offer an accident hazard in itself.

(3) *Point of operation guarding.* (i) Point of operation is the area on a machine where work is actually performed upon the material being processed.

(ii) The point of operation of machines whose operation exposes an employee to injury, shall be guarded. The guarding device shall be in conformity with any appropriate standards therefor, or, in the absence of applicable specific standards, shall be so designed and constructed as to prevent the operator from having any part of his body in the danger zone during the operating cycle.

(iii) Special handtools for placing and removing material shall be such as to permit easy handling of material without the operator placing a hand in the danger zone. Such tools shall not be in lieu

of other guarding required by this section, but can only be used to supplement protection provided.

(iv) The following are some of the machines which usually require point of operation guarding:

(*a*) Guillotine cutters.
(*b*) Shears.
(*c*) Alligator shears.
(*d*) Power presses.
(*e*) Milling machines.
(*f*) Power saws.
(*g*) Jointers.
(*h*) Portable power tools.
(*i*) Forming rolls and calenders.

(4) *Barrels, containers, and drums.* Revolving drums, barrels, and containers shall be guarded by an enclosure which is interlocked with the drive mechanism, so that the barrel, drum, or container cannot revolve unless the guard enclosure is in place.

(5) *Exposure of blades.* When the periphery of the blades of a fan is less than seven (7) feet above the floor or working level, the blades shall be guarded. The guard shall have openings no larger than one half (½) inch.

(b) *Anchoring fixed machinery.* Machines designed for a fixed location shall be securely anchored to prevent walking or moving.

§ 1910.213 Woodworking machinery requirements.

(a) *Machine construction general.* (1) Each machine shall be so constructed as to be free from sensible vibration when the largest size tool is mounted and run idle at full speed.

(2) Arbors and mandrels shall be constructed so as to have firm and secure bearing and be free from play.

(3) The use of wooden bandsaw wheels other than those of commercial manufacture is prohibited.

(4) Any automatic cutoff saw that strokes continuously without the operator being able to control each stroke shall not be used.

(5) Saw frames or tables shall be constructed with lugs cast on the frame or with an equivalent means to limit the size of the saw blade that can be mounted, so as to avoid overspeed caused by mounting a saw larger than intended.

(6) Circular saw fences shall be so constructed that they can be firmly secured to the table or table assembly without changing their alignment with the saw. For saws with tilting tables or tilting arbors the fence shall be so constructed that it will remain in a line parallel with the saw, regardless of the angle of the saw with the table.

(7) Circular saw gages shall be so constructed as to slide in grooves or tracks that are accurately machined, to insure exact alignment with the saw for all positions of the guide.

(8) Hinged saw tables shall be so constructed that the table can be firmly secured in any position and in true alignment with the saw.

(9) All belts, pulleys, gears, shafts, and moving parts shall be guarded in accordance with the specific requirements of § 1910.219.

(10) It is recommended that each power-driven woodworking machine be provided with a disconnect switch that can be locked in the off position.

(11) The frames and all exposed, non-current-carrying metal parts of portable electric woodworking machinery operated at more than 90 volts to ground shall be grounded and other portable motors driving electric tools which are held in the hand while being operated shall be grounded if they operate at more than 90 volts to ground. The ground shall be provided through use of a separate ground wire and polarized plug and receptacle.

(12) For all circular saws where conditions are such that there is a possibility of contact with the portion of the saw either beneath or behind the table, that portion of the saw shall be covered with an exhaust hood, or, if no exhaust system is required, with a guard that shall be so arranged as to prevent accidental contact with the saw.

(13) Revolving double arbor saws shall be fully guarded in accordance with all the requirements for circular crosscut saws or with all the requirements for circular ripsaws, according to the kind of saws mounted on the arbors.

(14) No saw, cutter head, or tool collar shall be placed or mounted on a machine arbor unless the tool has been accurately machined to size and shape to fit the arbor.

(15) Combs (featherboards) or suitable jigs shall be provided at the workplace for use when a standard guard cannot be used, as in dadoing, grooving, jointing, moulding, and rabbeting.

(b) *Machine controls and equipment.* (1) A mechanical or electrical power control shall be provided on each machine to make it possible for the operator to cut off the power from each machine without leaving his position at the point of operation.

(2) On machines driven by belts and shafting, a locking-type belt shifter or an equivalent positive device shall be used.

(3) On applications where injury to the operator might result if motors were to restart after power failures, provision shall be made to prevent machines from automatically restarting upon restoration of power.

(4) Power controls and operating controls should be located within easy reach of the operator while he is at his regular work location, making it unnecessary for him to reach over the cutter to make adjustments. This does not apply to constant pressure controls used only for setup purposes.

(5) On each machine operated by electric motors, positive means shall be provided for rendering such controls or devices inoperative while repairs or adjustments are being made to the machines they control.

(6) Each operating treadle shall be protected against unexpected or accidental tripping.

(7) Feeder attachments shall have the feed rolls or other movable parts so covered or guarded as to protect the operator from hazardous points.

(c) *Hand-fed ripsaws.* (1) Each circular hand-fed ripsaw shall be guarded by a hood which shall completely enclose that portion of the saw above the table and that portion of the saw above the material being cut. The hood and mounting shall be arranged so that the hood will automatically adjust itself to the thickness of and remain in contact with the material being cut but it shall not offer any considerable resistance to insertion of material to saw or to passage of the material being sawed. The hood shall be made of adequate strength to resist blows and strains incidental to reasonable operation, adjusting, and handling, and shall be so designed as to protect the operator from flying splinters and broken saw teeth. It shall be made of material that is soft enough so that it will be unlikely to cause tooth breakage. The material should not shatter when broken, should be nonexplosive, and should be no more flammable than wood. The hood shall be so mounted as to insure that its operation will be positive, reliable, and in true alignment with the saw; and the mounting shall be adequate in strength to resist any reasonable side thrust or other force tending to throw it out of line.

(2) Each hand-fed circular ripsaw shall be furnished with a spreader to prevent material from squeezing the saw or being thrown back on the operator. The spreader shall be made of hard tempered steel, or its equivalent, and shall be thinner than the saw kerf. It shall be of sufficient width to provide adequate stiffness or rigidity to resist any reasonable side thrust or blow tending to bend or throw it out of position. The spreader shall be attached so that it will remain in true alignment with the saw even when either the saw or table is tilted, and should be placed so that there is not more than ½-inch space between the spreader and the back of the saw when the largest saw is mounted in the machine. The provision of a spreader in connection with grooving, dadoing, or rabbeting is not required. On the completion of such operations; the spreader shall be immediately replaced.

(3) Each hand-fed circular ripsaw shall be provided with nonkickback fingers or dogs so located as to oppose the thrust or tendency of the saw to pick up the material or to throw it back toward the operator. They shall be designed to provide adequate holding power for all the thicknesses of materials being cut.

(d) *Hand-fed crosscut table saws.* (1) Each circular crosscut table saw shall be guarded by a hood which shall meet all the requirements of paragraph (c) (1) of this section for hoods for circular ripsaws.

(2) Each circular crosscut saw should also be provided with a spreader which should meet all the requirements of paragraph (c) (2) of this section.

(e) *Circular resaws.* (1) Each circular resaw shall be guarded by a hood or shield of metal above the saw. This hood or shield shall be so designed as to guard against danger from flying splinters or broken saw teeth.

(2) Each circular resaw (other than self-feed saws with a roller or wheel at back of the saw) shall be provided with a spreader fastened securely behind the saw. The spreader shall be slightly thinner than the saw kerf and slightly thicker than the saw disk.

(f) *Self-feed circular saws.* (1) Feed rolls and saws shall be protected by a hood or guard to prevent the hands of the operator from coming in contact with the in-running rolls at any point. The guard shall be constructed of heavy material, preferably metal, and the bottom of the guard shall come down to within three-eighths inch of the plane formed by the bottom or working surfaces of the feed rolls. This distance (three-eighths inch) may be increased to three-fourths inch, provided the lead edge of the hood is extended to be not less than 5½ inches in front of the nip point between the front roll and the work.

(2) Each self-feed circular ripsaw shall be provided with sectional nonkickback fingers for the full width of the feed rools. They shall be located in front of the saw and so arranged as to be in continual contact with the wood being fed.

(g) *Swing cutoff saws.* The requirements of this paragraph are also applicable to sliding cutoff saws mounted above the table.

(1) Each swing cutoff saw shall be provided with a hood that will completely enclose the upper half of the saw, the arbor end, and the point of operation at all positions of the saw. The hood shall be constructed in such a manner and of such material that it will protect the operator from flying splinters and broken saw teeth. Its hood shall be so designed that it will automatically cover the lower portion of the blade, so that when the saw is returned to the back of the table the hood will rise on top of the fence, and when the saw is moved forward the hood will drop on top of and remain in contact with the table or material being cut.

(2) Each swing cutoff saw shall be provided with an effective device to return the saw automatically to the back of the table when released at any point of its travel. Such a device shall not depend for its proper functioning upon any rope, cord, or spring. If there is a counterweight, the bolts supporting the bar and counterweight shall be provided with cotter pins; and the counterweight shall be prevented from dropping by either a bolt passing through both the bar and counterweight, or a bolt put through the extreme end of the bar, or, where the counterweight does not encircle the bar, a safety chain attached to it.

(3) Limit chains or other equally effective devices shall be provided to prevent the saw from swinging beyond the front or back edges of the table, or beyond a forward position where the gullets of the lowest saw teeth will rise above the table top.

(4) Inverted swing cutoff saws shall be provided with a hood that will cover the part of the saw that protrudes above the top of the table or above the material being cut. It shall automatically adjust itself to the thickness of and remain in contact with the material being cut.

(h) *Radial saws.* (1) The upper hood shall completely enclose the upper portion of the blade down to a point that will include the end of the saw arbor. The upper hood shall be constructed in such a manner and of such material that it will protect the operator from flying splinters, broken saw teeth, etc., and will deflect sawdust away from the operator. The sides of the lower exposed portion of the blade shall be guarded to the full diameter of the blade by a device that will automatically adjust itself to the thickness of the stock and remain in contact with stock being cut to give maximum protection possible for the operation being performed.

(2) Each radial saw used for ripping shall be provided with nonkickback fingers or dogs located on both sides of the saw so as to oppose the thrust or tendency of the saw to pick up the material or to throw it back toward the operator. They shall be designed to provide adequate holding power for all the thickness of material being cut.

(3) An adjustable stop shall be provided to prevent the forward travel of the blade beyond the position necessary to complete the cut in repetitive operations.

(4) Installation shall be in such a manner that the front end of the unit will be slightly higher than the rear, so as to cause the cutting head to return gently to the starting position when released by the operator.

(5) Ripping and ploughing shall be against the direction in which the saw turns. The direction of the saw rotation shall be conspicuously marked on the hood. In addition, a permanent label not less than 1½ inches by ¾ inch shall be affixed to the rear of the guard at approximately the level of the arbor, reading as follows: "Danger: Do Not Rip or Plough From This End". Such a label should be colored standard danger red.

(i) *Bandsaws and band resaws.* (1) All portions of the saw blade shall be enclosed or guarded, except for the working portion of the blade between the bottom of the guide rolls and the table. Bandsaw wheels shall be fully encased. The outside periphery of the enclosure shall be solid. The front and back of the band wheels shall be either enclosed by solid material or by wire mesh or perforated metal. Such mesh or perforated metal shall be not less than 0.037 inch (U.S. Gage No. 20), and the openings shall be not greater than three-eighths inch. Solid material used for this purpose shall be of an equivalent strength and firmness. The guard for the portion of the blade between the sliding guide and the upper-saw-wheel guard shall protect the saw blade at the front and outer side. This portion of the guard shall be self-adjusting to raise and lower with the guide. The upper-wheel guard shall be made to conform to the travel of the saw on the wheel, and the top member of the guard should have at least a 2-inch clearance outside the saw and be lined with smooth material, preferably metal. Effective brakes should be provided to stop the wheel in case of blade breakage.

(2) Each bandsaw machine shall be provided with a tension control device to indicate a proper tension for the standard saws used on the machine, in order to assist in the elimination of saw breakage due to improper tension.

(3) Feed rolls of band resaws shall be protected with a suitable guard to prevent the hands of the operator from coming in contact with the in-running rolls at any point. The guard shall be constructed of heavy material, preferably metal, and the edge of the guard shall come to within three-eighths inch of the plane formed by the inside face of the feed roll in contact with the stock being cut.

(j) *Jointers.* (1) Each hand-fed planer and jointer with horizontal head shall be equipped with a cylindrical cutting head, the knife projection of which shall not exceed one-eighth inch beyond the cylindrical body of the head.

(2) The opening in the table shall be kept as small as possible. The clearance between the edge of the rear table and the cutter head shall be not more than one-eighth inch. The table throat opening shall be not more than 2½ inches when tables are set or aligned with each other for zero cut.

(3) Each hand-fed jointer with a horizontal cutting head shall have an automatic guard which will cover all the section of the head on the working side of the fence or gage. The guard shall effectively keep the operator's hand from coming in contact with the revolving knives. The guard shall automatically adjust itself to cover the unused portion of the head and shall remain in contact with the material at all times.

(4) Each hand-fed jointer with horizontal cutting head shall have a guard which will cover the section of the head back of the gage or fence.

(5) Each wood jointer with vertical head shall have either an exhaust hood or other guard so arranged as to enclose completely the revolving head, except for a slot of such width as may be necessary and convenient for the application of the material to be jointed.

(k) *Tenoning machines.* (1) Feed chains and sprockets of all double end tenoning machines shall be completely enclosed, except for that portion of chain used for conveying the stock.

(2) At the read ends of frames over which feed conveyors run, sprockets and chains shall be guarded at the sides by plates projecting beyond the periphery of sprockets and the ends of lugs.

(3) Each tenoning machine shall have all cutting heads, and saws if used, covered by metal guards. These guards shall

cover at least the unused part of the periphery of the cutting head. If such a guard is constructed of sheet metal, the material used shall be not less than one-sixteenth inch in thickness, and if cast iron is used, it shall be not less than three-sixteenths inch in thickness.

(4) Where an exhaust system is used, the guard shall form part or all of the exhaust hood and shall be constructed of metal of a thickness not less than that specified in subparagraph (3) of this paragraph.

(l) *Boring and mortising machines.* (1) Safety-bit chucks with no projecting set screws shall be used.

(2) Boring bits should be provided with a guard that will enclose all portions of the bit and chuck above the material being worked.

(3) The top of the cutting chain and driving mechanism shall be enclosed.

(4) If there is a counterweight, one of the following or equivalent means shall be used to prevent its dropping:

(i) It shall be bolted to the bar by means of a bolt passing through both bar and counterweight;

(ii) A bolt shall be put through the extreme end of the bar;

(iii) Where the counterweight does not encircle the bar, a safety chain shall be attached to it;

(iv) Other types of counterweights shall be suspended by chain or wire rope and shall travel in a pipe or other suitable enclosure wherever they might fall and cause injury.

(5) Universal joints on spindles of boring machines shall be completely enclosed in such a way as to prevent accidental contact by the operator.

(6) Each operating treadle shall be covered by an inverted U-shaped metal guard, fastened to the floor, and of adequate size to prevent accidental tripping.

(m) *Wood shapers and similar equipment.* (1) The cutting heads of each wood shaper, hand-fed panel raiser, or other similar machine not automatically fed, shall be enclosed with a cage or adjustable guard so designed as to keep the operator's hand away from the cutting edge. The diameter of circular shaper guards shall be not less than the greatest diameter of the cutter. In no case shall a warning device of leather or other material attached to the spindle be acceptable.

(2) Cylindrical heads should be used whenever the nature of the work will permit. Single cutter knives in shaper heads shall not be used unless properly balanced.

(3) All double-spindle shapers shall be provided with a spindle starting and stopping device for each spindle.

(n) *Planing, molding, sticking, and matching machines.* (1) Each planing, molding, sticking, and matching machine shall have all cutting heads, and saws if used, covered by a metal guard. If such guard is constructed of sheet metal, the material used shall be not less than three-sixteenths inch in thickness. and if cast iron is used, it shall be not less than three-sixteenths inch in thickness.

(2) Where an exhaust system is used, the guards shall form part or all of the exhaust hood and shall be constructed of metal of a thickness not less than that specified in subparagraph (1) of this paragraph.

(3) Feed rolls shall be guarded by a hood or suitable guard to prevent the hands of the operator from coming in contact with the in-running rolls at any point. The guard shall be fastened to the frame carrying the rolls so as to remain in adjustment for any thickness of stock.

(4) Surfacers or planers used in thicknessing multiple pieces of material simultaneously shall be provided with sectional infeed rolls having sufficient yield in the construction of the sections to provide feeding contact pressure on the stock, over the permissible range of variation in stock thickness specified or for which the machine is designed. In lieu of such yielding sectional rolls, suitable section kickback finger devices shall be provided at the infeed end.

(o) *Profile, swing-head lathes and wood heel turning machine.* (1) Each profile and swing-head lathe shall have all cutting heads covered by a metal guard. If such a guard is constructed of sheet metal, the material used shall be not less than one-sixteenth inch in thickness; and if cast iron is used, it shall not be less than three-sixteenths inch in thickness.

(2) Cutting heads on wood-turning lathes, whether rotating or not, shall be covered as completely as possible by hoods or shields, which should be hinged to the machines so that they can be thrown back for making adjustments.

(3) Shoe last and spoke lathes, doweling machines, wood heel turning machines, and other automatic wood-turning lathes of the rotating knife type shall be equipped with hoods enclosing the cutter blades completely except at the contact points while the stock is being cut.

(4) Lathes used for turning long pieces of wood stock held only between the two centers shall be equipped with long curved guards extending over the tops of the lathes in order to prevent the work pieces from being thrown out of the machines if they should become loose.

(5) Where an exhaust system is used, the guard shall form part or all of the exhaust hood and shall be constructed of metal of a thickness not less than that specified in subparagraph (1) of this paragraph.

(p) *Sanding machines.* (1) Feed rolls of self-feed sanding machines shall be protected with a semicylindrical guard to prevent the hands of the operator from coming in contact with the in-running rolls at any point. The guard shall be constructed of heavy material, preferably metal, and firmly secured to the frame carrying the rolls so as to remain in adjustment for any thickness of stock. The bottom of the guard should come down to within three-eighths inch of a plane formed by the bottom or contact face of the feed roll where it touches the stock.

(2) Each drum sanding machine shall have an exhaust hood, or other guard if no exhaust system is required, so arranged as to enclose the revolving drum, except for that portion of the drum above the table, if a table is used, which may be necessary and convenient for the application of the material to be finished.

(3) Each disk sanding machine shall have the exhaust hood, or other guard if no exhaust system is required, so arranged as to enclose the revolving disk, except for that portion of the disk above the table, if a table is used, which may be necessary for the application of the material to be finished.

(4) Belt sanding machines shall be provided with guards at each nip point where the sanding belt runs on to a pulley. These guards shall effectively prevent the hands or fingers of the operator from coming in contract with the nip points. The unused run of the sanding belt shall be guarded against accidental contact.

(q) *Veneer cutters and wringers.* (1) Veneer slicer knives shall be guarded to prevent accidental contact with knife edge, at both front and rear.

(2) Veneer clippers shall have automatic feed or shall be provided with a guard which will make it impossible to place a finger or fingers under the knife while feeding or removing the stock.

(3) Sprockets on chain or slat-belt conveyors shall be enclosed.

(4) Where practicable, hand and foot-power guillotine veneer cutters shall be provided with rods or plates or other satisfactory means, so arranged on the feeding side that the hands cannot reach the cutting edge of the knife while feeding or holding the stock in place.

(5) Power-driven guillotine veneer cutters, except continuous feed trimmers, shall be equipped with:

(i) Starting devices which require the simultaneous action of both hands to start the cutting motion and of at least one hand on a control during the complete stroke of the knife; or

(ii) An automatic guard which will remove the hands of the operator from the danger zone at every descent of the blade, used in conjunction with one-hand starting devices which require two distinct movements of the device to start the cutting motion, and so designed as to return positively to the nonstarting position after each complete cycle of the knife.

(6) Where two or more workers are employed at the same time on the same power-driven guillotine veneer cutter equipped with two-hand control, the device shall be so arranged that each worker shall be required to use both hands simultaneously on the controls to start the cutting motion, and at least one hand on a control to complete the cut.

(7) Power-driven guillotine veneer cutters, other than continuous trimmers, shall be provided, in addition to the brake or other stopping mechanism, with an emergency device which will prevent the machine from operating in the event of failure of the brake when the starting mechanism is in the nonstarting position.

(r) *Miscellaneous woodworking machines.* (1) The feed rolls of roll type glue spreaders shall be guarded by a semicylindrical guard. The bottom of the

guard shall come to within three-eights inch of a plane formed by bottom or contact face of the feed roll where it touches the stock.

(2) Drag saws shall be so located as to give at least a 4-foot clearance for passage when the saw is at the extreme end of the stroke; or if such clearance is not obtainable, the saw and its driving mechanism shall be provided with a standard enclosure.

(3) For combination or universal woodworking machines each point of operation of any tool shall be guarded as required for such a tool in a separate machine.

(4) The mention of specific machines in paragraphs (a) thru (q) and this paragraph (r) of this section, inclusive, is not intended to exclude other woodworking machines from the requirement that suitable guards and exhaust hoods be provided to reduce to a minimum the hazard due to the point of operation of such machines.

(s) *Inspection and maintenance of woodworking machinery.* (1) Dull, badly set, improperly filed, or improperly tensioned saws shall be immediately removed from service, before they begin to cause the material to stick, jam, or kick back when it is fed to the saw at normal speed. Saws to which gum has adhered on the sides shall be immediately cleaned.

(2) All knives and cutting heads of woodworking machines shall be kept sharp, properly adjusted, and firmly secured. Where two or more knives are used in one head, they shall be properly balanced.

(3) Bearings shall be kept free from lost motion and shall be well lubricated.

(4) Arbors of all circular saws shall be free from play.

(5) Sharpening or tensioning of saw blades or cutters shall be done only by persons of demonstrated skill in this kind of work.

(6) Emphasis is placed upon the importance of maintaining cleanliness around woodworking machinery, particularly as regards the effective functioning of guards and the prevention of fire hazards in switch enclosures, bearings, and motors.

(7) All cracked saws shall be removed from service.

(8) The practice of inserting wedges between the saw disk and the collar to form what is commonly known as a "wobble saw" shall not be permitted.

(9) Push sticks or push blocks shall be provided at the work place in the several sizes and types suitable for the work to be done.

(10) Twists or kinks in bandsaws and band resaws shall be promptly removed with a hammer.

(11) To avoid vibration, brazed joints in bandsaws and band resaws shall be the same thickness as the saw blade.

(12) The knife blade of jointers shall be so installed and adjusted that it does not protrude more than one-eighth inch beyond the cylindrical body of the head. Push sticks or push blocks shall be provided at the work place in the several sizes and types suitable for the work to be done.

(13) Whenever veneer slicers or rotary veneer-cutting machines have been shutdown for the purpose of inserting logs or to make adjustments, operators shall make sure that machine is clear and other workmen are not in a hazardous position before starting the machine.

(14) Operators shall not ride the carriage of a veneer slicer.

§ 1910.214 Cooperage machinery.

(a) *Heading bolt sawing machine.* (1) Each heading saw shall be guarded by a hood curved to the contour of the saw. The hood shall cover the saw at least to the depth of the teeth, except for that portion actually used in making the cut. The exhaust hood shall be so arranged and maintained as to guard effectively the bottom portion of the saw. The hood shall be made of adequate strength to resist strains incidental to reasonable operation.

(2) The balance wheel shall be covered to enclose the rim and outside portion of the wheel. Expanded metal curved to fit the contour of the wheel is recommended.

(3) The swing carriage shall be provided with an effective device that will return the carriage automatically to a position in front of the saw. Such a device shall not depend entirely upon any rope, cord, or spring for its proper functioning. If a counterweight is used, a safety chain shall be attached to it to prevent dropping, should the bar break or the weight become disengaged. All bolts supporting the bar, weight, and chain shall be provided with cotter pins or equally effective devices. A bolt shall be put through the extreme end of the counterweight bar to prevent dropping of the weight.

(4) A limit stop shall be provided to prevent the carriage from swinging too far back and thereby exposing the unguarded portion of the saw to contact.

(b) *Bolt equalizer, stave, and heading saws (tilting table style).* (1) All heading and stave bolt equalizer saws shall be guarded by hoods, curved to the contour of all the saws. The hood shall cover the saw at least to the depth of the teeth, except for that portion actually used in making the cut. The exhaust hood shall be so arranged and maintained as to guard effectively the bottom portion of the saws.

(2) Hoods shall be attached to each end of the tilting table and shall extend forward to cover the portion of the saws which cannot be enclosed by a stationary guard.

(3) A limit stop shall be provided to prevent the table from coming too far back and thereby exposing the unguarded portion of the saws to contact.

(c) *Barrel stave saws (cylindrical saws).* (1) Each machine of this type shall have the saw and the revolving part (head) to which the saw blade is bolted enclosed with a hinged guard to prevent accidental contact, except for that part of the saw immediately adjacent to the carriage, which is the point of operation of the saw.

(2) The exhaust hood shall be so arranged and maintained as to guard effectively the bottom portion of the saw. The hood shall be made of adequate strength to resist strains incidental to reasonable operation.

(d) *Hand-fed ripsaws.* (1) Each circular hand-fed ripsaw shall be guarded with a hood. The hood shall be stationary and cover the saw to a distance of approximately three-fourths inch above the stave being ripped. This will prevent the material being cut from being raised by upward centrifugal force of the saw in cases of pinching or binding before the stave reaches the splitter. The hood shall provide inside clearance between the top edge of saw and guard to allow an accidental blow to strike it to the table and not engage the teeth with the guard. The hood shall be constructed of heavy material, preferably metal. That portion of the saw remaining below the table shall be completely enclosed in an exhaust hood.

(2) Spreader requirements for this equipment are contained in § 1910.213 (c)(2).

(e) *Self-feed stave and heading equalizer saws.* (1) Self-feed equalizer saws shall be guarded with a hood guard which will cover the top and sides of the saws. The hood should adjust itself automatically to the thickness of, and remain in contact with, the material being cut.

(2) The portion of the saw blade extending beneath the mandrel shall be enclosed in an exhaust hood and be easily accessible for changing saws.

(f) *Stave and heading planers (single and double heads).* (1) The exhaust hood, or other guards, if no exhaust system is required, shall be so arranged and maintained as to guard effectively all cutting heads and knives of single and double planers.

(2) Feed rolls, except for such portion as may be necessary to admit stock, shall be completely enclosed.

(3) Pressure bars or holddown arrangements shall be properly adjusted to assure correct pressure and clearance at all times.

(g) *Stave jointing machines (wheel).* (1) Stave jointer wheels shall be covered on both sides with a removable metal hood connected to the exhaust system, except for that portion where the stock is applied to the knives.

(2) A limit stop should be installed on the frame to prevent any part of the carriage from coming in contact with any moving part of the wheel.

(3) The equipment described in subparagraphs (1) and (2) of this paragraph include double independent stave jointer wheels, double jointer stave wheels, single jointer stave wheels, and all kinds of keg stave jointer wheels.

(h) *Heading jointer and doweler machine (wheel).* (1) Each heading jointer shall be equipped with a removable guard covering the upper half of the wheel, except for that portion where the stock is applied to the knives.

(2) The lower portion of the wheel shall be guarded with sheet metal or ex-

panded metal to prevent accidental contact with the knives.

(i) *Heading rounder.* The cutter head shall be enclosed in a hood attached to the exhaust system, arranged and maintained in such a manner as to guard effectively the entire cutting mechanism, except for that portion of the cutting head where the stock is applied.

(j) *Power windlass machine.* Windlass machines having counterweights shall operate with the weights in a stationary casing. On all machines having a friction gear, the gear shall be properly guarded.

(k) *Crozing machine (stationary heads).* (1) Feed chains and sprockets shall be completely enclosed. This includes all types of barrel, keg, bucket, tub, and individual stave crozers, chamfering, crozing, and doweling machines.

(l) *Heading-up machine.* The outside portion and teeth of both drive gears for the racks shall be completely guarded. This includes all types of heading-up machines.

(m) *Head charring machine.* All tripping mechanisms shall be completely guarded.

(n) *Bilge truss hoop ring removing machine.* (1) Both eccentric cams and gear works on horizontal machines shall be guarded.

(2) Combined flywheel and gear shall be completely enclosed by a guard. This includes the horizontal and upright-type machines.

(o) *Hoop elevators and conveyors.* Lower sprockets and chains shall be guarded by complete enclosure to a height of at least 7 feet.

(p) *Barrel sanding machine.* Belt sanding machines shall be provided with guards at each nip point where the sanding belt runs onto a pulley. This guard may be a part of the exhaust system. The unused run of the sanding belt shall be enclosed.

(q) *Hoop drivers and trussers.* (1) All friction pulleys shall be enclosed by a guard. A hinged gate should be provided for that portion of the guard covering adjustments to the friction blocks.

(2) The foregoing recommendation covers drivers for keg hoops, tin barrel hoops, truss hoops, and both screw and rack and pinion-type hoop drivers.

(r) *Head sanding machine.* The exhaust hood of automatic horizontal disk head sanders shall be so arranged as to enclose each disk, except for that portion necessary for the application of the barrel being finished.

(s) *Hand jointer.* All hand-fed jointers shall be guarded in accordance with the provisions of § 1910.213(j).

(t) *Hoop punching and coiling machine.* Miter gears, spur gears, drive pulley, and pulley for coiling attachment shall be guarded. This includes the horizontal hoop punching and coiling machine as well as the upright hoop punching machine.

(u) *Hoop riveting machine.* The balance and drive wheels shall be effectively guarded. This includes automatic, single, and double hoop riveters.

(v) *Hoop flaring and expanding machine.* Gearing shall be completely enclosed.

(w) *Inspection and maintenance of cooperage machinery.* For inspection and maintenance of cooperage machinery see **§ 1910.213(s).**

§ 1910.215 Abrasive wheel machinery.

(a) *General requirements*—(1) *Machine guarding.* Abrasive wheels shall be used only on machines provided with safety guards as defined in the following paragraphs of this section, except:

(i) Wheels used for internal work while within the work being ground;

(ii) Mounted wheels used in portable operations 2 inches and smaller in diameter; and

(iii) Types 16, 17, 18, 18R, and 18 cones, plugs, and threaded hole pot balls where the work offers protection.

(2) *Guard design.* The safety guard shall cover the spindle end, nut, and flange projections. The safety guard shall be mounted so as to maintain proper alignment with the wheel, and the strength of the fastenings shall exceed the strength of the guard, except:

(i) Safety guards on all operations where the work provides a suitable measure of protection to the operator, may be so constructed that the spindle end, nut, and outer flange are exposed; and where the nature of the work is such as to entirely cover the side of the wheel, the side covers of the guard may be omitted; and

(ii) The spindle end, nut, and outer flange may be exposed on machines designed as portable saws.

(3) *Flanges.* Grinding machines shall be equipped with flanges in accordance with paragraph (c) of this section.

(4) *Work rests.* On offhand grinding machines, work rests shall be used to support the work. They shall be of rigid construction and designed to be adjustable to compensate for wheel wear. Work rests shall be kept adjusted closely to the wheel with a maximum opening of one-eighth inch to prevent the work from being jammed between the wheel and the rest, which may cause wheel breakage. The work rest shall be securely clamped after each adjustment. The adjustment shall not be made with the wheel in motion.

(b) *Guarding of abrasive wheel machinery*—(1) *Cup wheels.* Cup wheels (Types 6 and 11) shall be protected by:

(i) Safety guards as specified in subparagraphs (1) through (10) of this paragraph:

(ii) Band type guards as specified in subparagraph (11) of this paragraph; and

(iii) Special "Revolving Cup Guards" which mount behind the wheel and turn with it. They shall be made of steel or other material with adequate strength and shall enclose the wheel sides upward from the back for one-third of the wheel thickness. The mounting features shall conform with all requirements of this section. It is necessary to maintain clearance between the wheel side and the guard. This clearance shall not exceed one-sixteenth inch.

(2) *Guard exposure angles.* The maximum exposure angles specified in subparagraphs (3) through (8) of this paragraph shall not be exceeded. Visors or other accessory equipment shall not be included as a part of the guard when measuring the guard opening, unless such equipment has strength equal to that of the guard.

(3) *Bench and floor stands.* The angular exposure of the grinding wheel periphery and sides for safety guards used on machines known as bench and floor stands should not exceed 90° or one-fourth of the periphery. This exposure shall begin at a point not more than 65° above the horizontal plane of the wheel spindle. (See Figures O–6 and O–7 and subparagraph (9) of this paragraph.)



FIGURE NO. O-6



FIGURE NO. O-7

Wherever the nature of the work requires contact with the wheel below the horizontal plane of the spindle, the exposure shall not exceed 125°. (See Figures O–8 and O–9.)

FIGURE NO. O-8



FIGURE NO. O-9

(4) *Cylindrical grinders.* The maximum angular exposure of the grinding wheel periphery and sides for safety guards used on cylindrical grinding machines shall not exceed 180°. This exposure shall begin at a point not more than 65° above the horizontal plane of the wheel spindle. (See Figures O–10 and O–11 and subparagraph (9) of this paragraph.)

FIGURE NO. O-10

FIGURE NO. O-11

(5) *Surface grinders and cutting-off machines.* The maximum angular exposure of the grinding wheels periphery and sides for safety guards used on cutting-off machines and on surface grinding machines which employ the wheel periphery shall not exceed 150°. This exposure shall begin at a point not less

than 15° below the horizontal plane of the wheel spindle. (See Figures O–12 and O–13)

FIGURE NO. 0-12



FIGURE NO. 0-13

(6) *Swing frame grinders.* The maximum angular exposure of the grinding wheel periphery and sides for safety guards used on machines known as swing frame grinding machines shall not exceed 180°, and the top half of the wheel shall be enclosed at all times. (See Figure O–14 and O–15.)

FIGURE NO. 0-14

FIGURE NO. 0-15

(7) *Automatic snagging machines.* The maximum angular exposure of the grinding wheel periphery and sides for safety guards used on grinders known as automatic snagging machines shall not exceed 180° and the top half of the wheel shall be enclosed at all times. (See Figures O–14 and O–15.)

(8) *Top grinding.* Where the work is applied to the wheel above the horizontal centerline, the exposure of the grinding wheel periphery shall be as small as possible and shall not exceed 60°. (See Figures O–16 and O–17.)

FIGURE NO. 0-16



FIGURE NO. 0-17

(9) *Exposure adjustment.* Safety guards of the types described in subparagraphs (3) and (4) of this paragraph, where the operator stands in front of the opening, shall be constructed so that the peripheral protecting member can be adjusted to the constantly decreasing diameter of the wheel. The maximum angular exposure above the horizontal plane of the wheel spindle as specified in subparagraphs (3) and (4) of this paragraph shall never be exceeded, and the distance between the wheel periphery and the adjustable tongue or the end of the peripheral member at the top shall never exceed one-fourth inch. (See Figures O–18, O–19, O–20, O–21, O–22, and O–23.)

FIGURE NO. 0-18



FIGURE NO. 0-19

CORRECT

Showing adjustable tongue giving required angular protection for all sizes of wheel used.



FIGURE NO. 0-20



FIGURE NO. 0-21

CORRECT

Showing movable guard with opening small enough to give required protection for smallest size wheel used.

FIGURE NO. 0-22

FIGURE NO. 0-23

INCORRECT

Showing movable guard with size of opening correct for full size wheel but too large for smaller wheels.

(10) *Material requirements and minimum dimensions.* (i) See Figures O–36 and O–37 and Table O–9 for minimum basic thickness of peripheral and side members for various types of safety guards and classes of service.

(ii) If operating speed does not exceed 8,000 surface feet per minute cast iron safety guards, malleable iron guards or other guards as described in subparagraph (11) (ii) of this paragraph shall be used.

(iii) Cast steel, or structural steel, safety guards as specified in Figures O–36 and O–37 and Table O–9 shall be used where operating speeds of wheels are faster than 8,000 surface feet per minute up to a maximum of 16,000 surface feet per minute.

(iv) For cutting-off wheels 16 inches diameter and smaller and where speed does not exceed 16,000 surface feet per minute, cast iron or malleable iron safety guards as specified in Figures O–36 and O–37, and in Table O–9 shall be used.

(v) For cutting-off wheels larger than 16 inches diameter and where speed does not exceed 14,200 surface feet per minute, safety guards as specified in O–27 and O–28, and in Table O–1 shall be used.

(vi) For thread grinding wheels not exceeding 1 inch in thickness cast iron or malleable iron safety guards as specified in Figures O–36 and O–37, and in Table O–9 shall be used.

(11) *Band type guards—general specifications.* Band type guards shall conform to the following general specifications:

(i) The bands shall be of steel plate or other material of equal or greater strength. They shall be continuous, the ends being either riveted, bolted, or welded together in such a manner as to leave the inside free from projections.

(ii) The inside diameter of the band shall not be more than 1 inch larger than the outside diameter of the wheel, and shall be mounted as nearly concentric with the wheel as practicable.

(iii) The band shall be of sufficient width and its position kept so adjusted that at no time will the wheel protrude beyond the edge of the band a distance greater than that indicated in Figure O–29 and in Table O–2 or the wall thickness (W), whichever is smaller.

(12) *Guard design specifications.* Abrasive wheel machinery guards shall meet the design specifications of the American National Standard Safety Code for the Use, Care, and Protection of Abrasive Wheels, ANSI Z7.1–1970. This requirement shall not apply to natural sandstone wheels or metal, wooden, cloth, or paper discs, having a layer of abrasive on the surface.

(c) *Flanges*—(1) *General requirements.* All abrasive wheels shall be mounted between flanges which shall not be less than one-third the diameter of the wheel.

(i) Exceptions:

(*a*) Mounted wheels.

(*b*) Portable wheels with threaded inserts or projecting studs.

(*c*) Abrasive discs (inserted nut, inserted washer and projecting stud type).

(*d*) Plate mounted wheels.

(*e*) Cylinders, cup, or segmental wheels that are mounted in chucks.

(*f*) Types 27 and 28 wheels.

(*g*) Certain internal wheels.

(*h*) Modified types 6 and 11 wheels (terrazzo).

(*i*) Cutting-off wheels, Types 1 and 27A (see subdivisions (ii) and (iii) of this subparagraph).

(ii) Type 1 cutting-off wheels are to be mounted between properly relieved flanges which have matching bearing surfaces. Such flanges shall be at least one-fourth the wheel diameter.

(iii) Type 27A cutting-off wheels are designed to be mounted by means of flat, not relieved, flanges having matching bearing surfaces and which may be less than one-third but shall not be less than one-fourth the wheel diameter. (See Figure O–24 for one such type of mounting.)

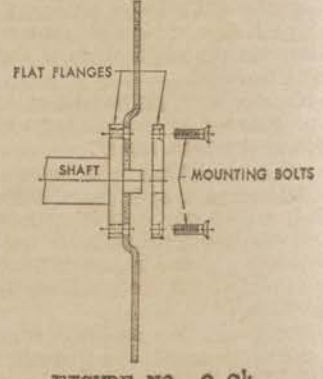

FIGURE NO. 0-24

The Type 27A Wheel is mounted between flat non-relieved flanges of equal bearing surfaces.

(iv) There are three general types of flanges:

(*a*) straight relieved flanges (see Figure O–32);

(*b*) straight unrelieved flanges (see Figure O–30);

(*c*) adaptor flanges (see Figures O–33 and O–34);

(v) Regardless of flange type used, the wheel shall always be guarded. Blotters shall be used in accordance with subparagraph (6) of this paragraph.

(2) *Design and material.* (i) Flanges shall be of such design as to satisfactorily transmit the driving torque from the spindle to the grinding wheel.

(ii) Flanges may be made of steel, cast iron, or other material of equal or greater strength and rigidity.

(iii) Flanges shall be designed with respect to rigidity so that when tightened, the radial width of bearing surface of contact on the wheel is maintained. (See Table O–6 and Figure O–32.)

(3) *Finish and balance.* Flanges shall be dimensionally accurate and in good balance. There shall be no rough surfaces or sharp edges.

(4) *Uniformity of diameter.* (i) Both flanges, of any type, between which a wheel is mounted, shall be of the same diameter and have equal bearing surface. Exceptions are set forth in the remaining subdivisions of this subparagraph.

(ii) Type 27 and Type 28 wheels, because of their shape and usage, require specially designed adaptors. The back flange shall extend beyond the central hub or raised portion and contact the wheel to counteract the side pressure on the wheel in use. The adaptor nut which is less than the minimum one-third diameter of wheel fits in the depressed side of wheel to prevent interference in side grinding and serves to drive the wheel by its clamping force against the depressed portion of the back flange. The variance in flange diameters, the adaptor nut being less than one-third wheel diameter, and the use of side pressure in wheel operation limit the use to reinforced organic bonded wheels. Mounts which are affixed to the wheel by the manufacturer shall not be reused. Type 27 and Type 28 wheels shall be used only with a safety guard located between wheel and operator during use. (See Figure O–24–A.)

FIGURE NO. O-24-A

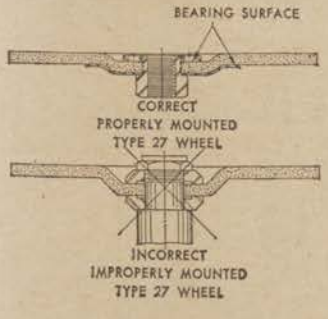

Types 27 and 28 wheels, because of their shape, require specially designed adaptors.

(iii) Modified Types 6 and 11 wheels (terrazzo) with tapered K dimension.

(5) *Recess and undercut.* (i) Straight relieved flanges made according to Table O–6 and Figure O–32 shall be recessed at least one-sixteenth inch on the side next to the wheel for a distance as specified in Table O–6.

(ii) Straight flanges of the adaptor or sleeve type (Table O–7 and Figures O–33 and O–34) shall be undercut so that there will be no bearing on the sides of the wheel within one-eighth inch of the arbor hole.

(6) *Blotters.* (i) Blotters (compressible washers) shall always be used between flanges and abrasive wheel surfaces to insure uniform distribution of flange pressure. (See paragraph (d)(5) of this section.)

(ii) Exception:

(*a*) Mounted wheels.

(*b*) Abrasive discs (inserted nut, inserted washer, and projecting stud type).

(*c*) Plate mounted wheels.

(*d*) Cylinders, cups, or segmental wheels that are mounted in chucks.

(*e*) Types 27 and 28 wheels.

(*f*) Certain Type 1 and Type 27A cutting-off wheels.

(*g*) Certain internal wheels.

(*h*) Type 4 tapered wheels.

(*i*) Diamond wheels, except certain vitrified diamond wheels.

(*j*) Modified types 6 and 11 wheel (terrazzo)—blotters applied flat side of wheel only.

(7) *Driving flange.* The driving flange shall be securely fastened to the spindle and the bearing surface shall run true. When more than one wheel is mounted between a single set of flanges, wheels may be cemented together or separated by specially designed spacers. Spacers shall be equal in diameter to the mounting flanges and have equal bearing surfaces. (See paragraph (d)(6) of this section.)

(8) *Dimensions.* (i) Tables O–4 and O–6 and Figures O–30 and O–32 show minimum dimensions for straight relieved and unrelieved flanges for use with wheels with small holes that fit directly on the machine spindle. Dimensions of such flanges shall never be less than indicated and should be greater where practicable.

(ii) Table O–5, and Table O–7 and Figures O–31, O–33, O–34 show minimum dimensions for straight adaptor flanges for use with wheels having holes larger than the spindle. Dimensions of such adaptor flanges shall never be less than indicated and should be greater where practicable.

(iii) Table O–8 and Figure O–35 show minimum dimensions for straight flanges that are an integral part of wheel sleeves which are frequently used on precision grinding machines. Dimensions of such flanges shall never be less than indicated and should be greater where practicable.

(9) *Repairs and maintenance.* All flanges shall be maintained in good condition. When the bearing surfaces become worn, warped, sprung, or damaged they should be trued or refaced. When refacing or truing, care shall be exercised to make sure that proper relief and rigidity is maintained as specified in subparagraphs (2) and (5) of this paragraph and they shall be replaced when they do not conform to these subparagraphs and Table O–4, Figure O–30, Table O–5, Figure O–31; Table O–6, Figure O–32, and Table O–8, Figure O–35. Failure to observe these rules might cause excessive flange pressure around the hole of the wheel. This is especially true of wheel-sleeve or adaptor flanges.

(d) *Mounting.*—(1) *Inspection.* Immediately before mounting, all wheels shall be closely inspected and sounded by the user (ring test) to make sure they have not been damaged in transit, storage, or otherwise. The spindle speed of the machine shall be checked before mounting of the wheel to be certain that it does not exceed the maximum operating speed marked on the wheel. Wheels should be tapped gently with a light nonmetallic implement, such as the handle of a screwdriver for light wheels, or a wooden mallet for heavier wheels. If they sound cracked (dead), they shall not be used. This is known as the "Ring Test".

(i) Wheels must be dry and free from sawdust when applying the ring test, otherwise the sound will be deadened. It should also be noted that organic bonded wheels do not emit the same clear metallic ring as do vitrified and silicate wheels.

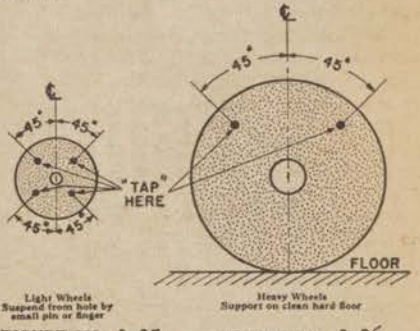

FIGURE NO. O-25 FIGURE NO. O-26

(ii) "Tap" wheels about 45° each side of the vertical centerline and about 1 or 2 inches from the periphery as indicated by the spots in Figure O–25 and Figure O–26. Then rotate the wheel 45° and repeat the test. A sound and undamaged wheel will give a clear metallic tone. If cracked, there will be a dead sound and not a clear "ring."

(2) *Arbor size.* Grinding wheels shall fit freely on the spindle and remain free under all grinding conditions. A controlled clearance between the wheel hole and the machine spindle (or wheel sleeves or adaptors) is essential to avoid excessive pressure from mounting and spindle expansion. To accomplish this, the machine spindle shall be made to nominal (standard) size plus zero minus .002 inch, and the wheel hole shall be made suitably oversize to assure safety clearance under the conditions of operating heat and pressure.

(3) *Surface condition.* All contact surfaces of wheels, blotters and flanges shall be flat and free of foreign matter.

(4) *Bushing.* When a bushing is used in the wheel hole it shall not exceed the width of the wheel and shall not contact the flanges.

(5) *Blotters.* When blotters or flange facings of compressible material are required, they shall cover entire contact area of wheel flanges. Highly compressible material such as blotting paper as normally used should not exceed .025 inch in thickness. If material of lower compressibility is used, greater thickness may be necessary. Blotters need not be used with the following types of wheels:

(i) Mounted wheels.

(ii) Abrasive discs (inserted nut, inserted washer, and projecting-stud type).

(iii) Plate mounted wheels.

(iv) Cylinders, cups, or segmental wheels that are mounted in chucks.

(v) Types 27 and 28 wheels.

(vi) Certain Type 1 and Type 27A cutting-off wheels.

(vii) Certain internal wheels.

(viii) Type 4 tapered wheels.

(ix) Diamond wheels, except certain vitrified diamond wheels.

(6) *Multiple wheel mounting.* When more than one wheel is mounted between a single set of flanges, wheels may be cemented together or separated by specially designed spacers. Spacers shall be equal in diameter to the mounting flanges and have equal bearing surfaces. When mounting wheels which have not been cemented together, or ones which do not utilize separating spacers, care must be exercised to use wheels specially manufactured for that purpose.

(7) *Replacing safety guard.* After mounting a wheel, care should be taken to see that the safety guard is properly positioned before starting the wheel.

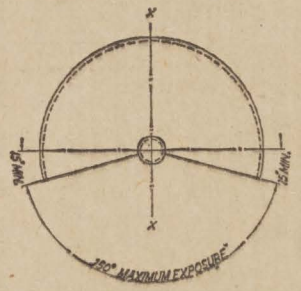

FIGURE NO. 0-27

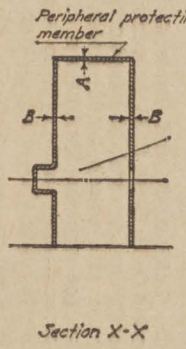

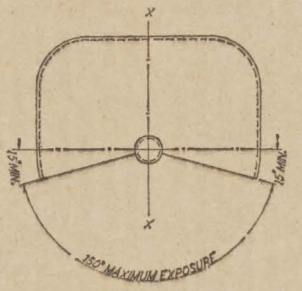

FIGURE NO. 0-28

TABLE O-1—MINIMUM BASIC THICKNESS FOR PERIPHERAL AND SIDE MEMBERS FOR SAFETY GUARDS USED WITH CUTTING-OFF WHEELS

Material used in construction of guard	Maximum thickness of cutting off wheel	Speed not to exceed	Cutting off wheel diameters: 6 to 11 inches A	6 to 11 inches B	Over 11 to 20 inches A	Over 11 to 20 inches B	Over 20 to 30 inches A	Over 20 to 30 inches B	Over 30 to 48 inches A	Over 30 to 48 inches B	Over 48 to 72 inches A	Over 48 to 72 inches B
Structural steel (min. tensile strength 60,000 p.s.i.)	½ inch or less	14,200 SFPM	1/16	1/16	3/32	3/32	1/8	1/8	3/16	3/16	1/4	1/4
	½ inch or less	16,000 SFPM	3/32	1/8	1/8	1/8	3/16	1/8	1/4	3/16	5/16	1/4

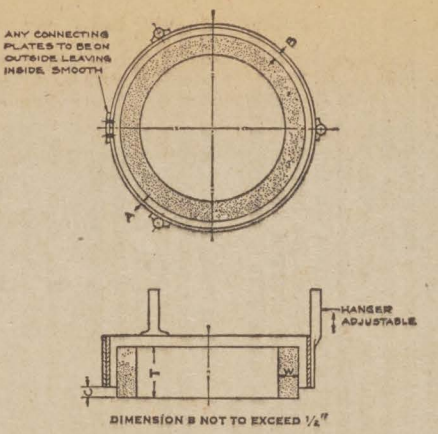

FIGURE NO. 0-29

TABLE O-2—EXPOSURE VERSUS WHEEL THICKNESS

Overall thickness of wheel (T) (inches)	*Maximum exposure of wheel (C) (inches)*
½	¼
1	½
2	¾
3	1
4	1½
5 and over	2

TABLE O-3—GUIDE FOR CONSTRUCTION OF BAND TYPE GUARDS

[Maximum Wheel Speed 7,000 SFPM]

Minimum material specifications	Diameter of wheel	Minimum thickness of band A	Minimum diameter of rivets	Maximum distance between centers of rivets
	Inches	*Inches*	*Inches*	*Inches*
Hot rolled steel SAE 1008	Under 8	1/16	3/16	3/4
	8 to 24	1/8	1/4	1
	Over 24 to 30	1/4	3/8	1¼



FIGURE NO. 0-30

Driving flange secured to spindle for use only on portable wheels with threaded inserts or projecting studs.

TABLE O-4—MINIMUM DIMENSIONS FOR STRAIGHT UNRELIEVED FLANGES FOR WHEELS WITH THREADED INSERTS OR PROJECTING STUDS

A Diameter of wheel	B[1] Minimum outside diameter of flange	T Minimum thickness of flange
Inches	*Inches*	*Inches*
1	5/8	1/8
2	1	1/8
3	1	3/16
4	1 3/8	3/16
5	1¾	¼
6	2	3/8

[1] NOTE: Must be large enough to extend beyond the bushing. Where prong anchor or cupback bushing are used, this footnote does not apply.

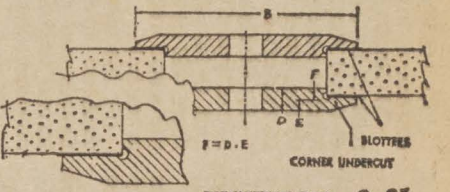

FIGURE NO. 0-31

TABLE O-5—MINIMUM DIMENSIONS FOR STRAIGHT ADAPTOR FLANGE—FOR ORGANIC BONDED WHEELS OVER 1¼ INCHES THICK [1]

Wheel diameter	Wheel hole diameter	B Minimum flange diameter	D Minimum thickness of flange at bore	E Minimum thickness of flange at edge of undercut	F [1] (D-E) minimum thickness
Inches	*Inches*	*Inches*	*Inches*	*Inches*	*Inches*
12 to 14	4	6	7/8	3/8	1/2
	5	7	7/8	3/8	1/2
	6	8	7/8	3/8	1/2
Larger than 14 to 18	4	6	7/8	3/8	1/2
	5	7	7/8	3/8	1/2
	6	8	7/8	3/8	1/2
	7	9	7/8	3/8	1/2
	8	10	7/8	3/8	1/2
Larger than 18 to 24	6	8	1	1/2	1/2
	7	9	1	1/2	1/2
	8	10	1	1/2	1/2
	10	12	1	1/2	1/2
	12	14	1	1/2	1/2
Larger than 24 to 30	12	15	1	1/2	1/2
Larger than 30 to 36	12	15	1 3/8	7/8	1/2

[1] For wheels under 1¼ inches thick F dimension shall not exceed 40 percent of wheel thickness.



FIGURE NO. O-32

Driving flange secured to spindle.

TABLE O-6—MINIMUM DIMENSIONS FOR STRAIGHT RELIEVED FLANGES

A [1] Diameter of wheel	B Minimum outside diameter of flanges	C Radial width of bearing surface		D Minimum thickness of flange at bore	E Minimum thickness of flange at edge of recess
		Minimum	Maximum		
Inches	*Inches*	*Inches*	*Inches*	*Inches*	*Inches*
1	3/8	1/16	1/8	1/16	1/16
2	3/4	1/8	3/16	1/8	3/32
3	1	1/8	3/16	3/16	3/32
4	1 3/8	1/8	3/16	3/16	1/8
5	1 3/4	3/16	1/4	1/4	1/8
6	2	1/4	1/2	3/8	3/16
7	2 1/2	1/4	1/2	3/8	3/16
8	3	1/4	1/2	3/8	3/16
10	3 1/2	5/16	5/8	3/8	1/4
12	4	5/16	5/8	1/2	5/16
14	4 1/2	3/8	3/4	1/2	5/16
16	5 1/2	1/2	1	1/2	5/16
18	6	1/2	1	5/8	3/8
20	7	5/8	1 1/4	5/8	3/8
22	7 1/2	5/8	1 1/4	5/8	7/16
24	8	3/4	1 1/4	5/8	7/16
26	8 1/2	3/4	1 1/4	5/8	1/2
28	10	7/8	1 1/2	3/4	1/2
30	10	7/8	1 1/2	3/4	5/8
36	12	1	2	7/8	3/4
42	14	1	2	7/8	3/4
48	16	1 1/4	2	1 1/8	1
60	20	1 1/4	2	1 1/4	1 1/8
72	24	1 1/2	2 1/2	1 3/8	1 1/4

[1] Flanges for wheels under 2 inches diameter may be unrelieved and shall be maintained flat and true.

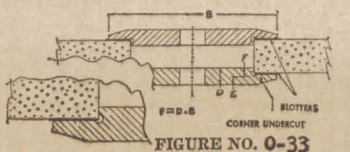

FIGURE NO. O-33

Central Nut Mounting

Driving flange secured to spindle.

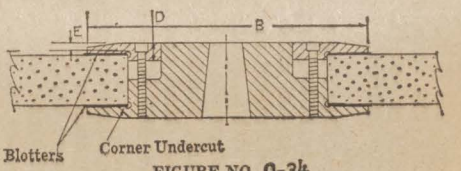

FIGURE NO. O-34

Multiple Screw Mounting

Driving flange secured to spindle.

TABLE O-7—MINIMUM DIMENSIONS FOR STRAIGHT FLANGES—FOR MECHANICAL GRINDERS 12,500 S.F.P.M. TO 16,500 S.F.P.M. [1]

Wheel diameter	Wheel hole diameter	B Minimum flange diameter	D Minimum thickness of flange at bore	E Minimum thickness of flange at edge of undercut	F [2] (D-E) minimum thickness
20	6	8	1	1/2	1/2
20	8	10	1 1/2	3/4	3/4
24	12	15	2	1	1
30	12	15	2	1	1
36	12	15	2	1	1

[1] Flanges shall be of steel, quality SAE 1040 or equivalent, annealed plate, heat treated to R_c 25-30.
[2] For wheels under 1¼ inch thick F dimension shall not exceed 40 percent of wheel thickness.

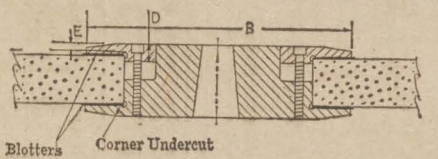

FIGURE NO. O-35

Driving flange secured to spindle.

TABLE O-8—MINIMUM DIMENSIONS FOR STRAIGHT FLANGES USED AS WHEEL SLEEVES FOR PRECISION GRINDING ONLY

Wheel diameter	Wheel hole diameter	B Minimum outside diameter of flange	D Minimum thickness of flange at bore	E Minimum thickness of flange at edge of undercut
Inches	*Inches*	*Inches*	*Inches*	*Inches*
12 to 14	5	7	1/2	7/16
	5	7	5/8	7/16
	6	8	5/8	7/16
Larger than 14 to 20	8	10	5/8	7/16
	10	11 1/2	5/8	7/16
	12	13 1/2	5/8	7/16
Larger than 20 to 30	8	10	3/4	1/2
	10	11 1/2	3/4	1/2
	12	13 1/2	3/4	1/2
	16	17 1/2	3/4	1/2
Larger than 30 to 42	12	13 1/2	3/4	1/2
	16	17 1/2	3/4	1/2
	18	19 1/2	3/4	1/2
	20	21 1/2	3/4	1/2
Larger than 42 to 60	16	20	1	3/4
	20	24	1	3/4
	24	29	1 1/8	7/8

NOTE: These flanges may be clamped together by means of a central nut, or by a series of bolts or some other equivalent means of fastening. For hole sizes smaller than shown in this table, use table 12.

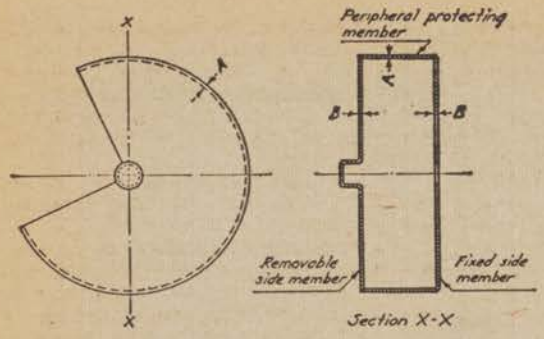

FIGURE NO. 0-36



FIGURE NO. 0-37

TABLE O-9—MINIMUM BASIC THICKNESSES OF PERIPHERAL AND SIDE MEMBERS FOR SAFETY GUARDS

Material used in construction of guard	Maximum thickness of grinding wheel	Grinding wheel diameters: 3 to 6 inches A	3 to 6 inches B	Over 6 to 12 inches A	Over 6 to 12 inches B	Over 12 to 16 inches A	Over 12 to 16 inches B	Over 16 to 20 inches A	Over 16 to 20 inches B	Over 20 to 24 inches A	Over 20 to 24 inches A	Over 24 to 40 inches A	Over 24 to 40 inches B	Over 40 to 48 inches A	Over 40 to 48 inches B
	Inches	*Inches*		*Inches*		*Inches*		*Inches*		*Inches*		*Inches*		*Inches*	
Material satisfactory [1] for speeds up to 8,000 SFPM. Cast iron (min. tensile strength 20,000 p.s.i.) Class 20.	2	1/4	1/4	3/8	5/16	1/2	3/8	5/8	1/2	7/8	5/8	1	3/4	1 1/4	1
	4	5/16	5/16	3/8	5/16	1/2	3/8	3/4	5/8	1	5/8	1 1/4	3/4	1 3/8	1
	6	3/8	5/16	1/2	7/16	5/8	1/2	1	5/8	1 1/4	3/4	1 1/4	7/8	1 1/2	1 1/4
	8			5/8	9/16	7/8	3/4	1	3/4	1 1/4	3/4	1 1/4	7/8	1 1/2	1 1/8
	10			3/4	11/16	7/8	3/4	1	3/4	1 3/8	3/4	1 1/4	7/8	1 1/2	1 1/8
	16					1 3/8	1	1 1/4	1	1 5/16	1	1 7/16	1 1/16	1 3/4	1 3/8
	20							1 3/8	1 1/8	1 3/8	1 1/8	1 1/2	1 3/8	2	1 3/8
Material satisfactory [1] for speeds up to 9,000 SFPM. Malleable iron (min. tensile strength 50,000 p.s.i.) Grade 32510.	2	1/4	1/4	3/8	5/16	1/2	3/8	5/8	1/2	3/4	5/8	7/8	3/4	1	7/8
	4	5/16	5/16	3/8	5/16	1/2	3/8	5/8	1/2	3/4	5/8	7/8	3/4	1 1/4	7/8
	6	3/8	5/16	1/2	7/16	5/8	1/2	3/4	5/8	7/8	5/8	1	3/4	1 1/4	7/8
	8			1/2	7/16	5/8	1/2	3/4	5/8	7/8	5/8	1	3/4	1 1/4	7/8
	10			1/2	7/16	5/8	1/2	3/4	5/8	7/8	5/8	1	3/4	1 1/4	7/8
	16					13/16	11/16	13/16	11/16	1	3/4	1 1/8	7/8	1 3/8	1
	20							7/8	3/4	1	3/4	1 1/8	7/8	1 1/2	1 1/8
Materials satisfactory [1] for speeds up to 16,000 SFPM. Steel castings (min. tensile strength 60,000 p.s.i.) Grade V60-30.	2	1/4	1/4	5/16	5/16	3/8	3/8	1/2	7/16	5/8	1/2	3/4	5/8	7/8	3/4
	4	1/4	1/4	1/2	1/2	1/2	1/2	9/16	1/2	5/8	1/2	3/4	5/8	1	3/4
	6	3/8	1/4	3/4	5/8	3/4	5/8	3/4	5/8	13/16	11/16	13/16	11/16	1 1/8	3/4
	8			7/8	3/4	7/8	3/4	7/8	3/4	7/8	3/4	13/16	13/16	1 3/8	1
	10			1	7/8	1	7/8	1	7/8	1 1/16	15/16	1 1/16	1	1 7/16	1 1/16
	16					1 1/4	1 1/8	1 1/4	1 1/8	1 1/4	1 1/8	1 1/4	1 1/4	1 13/16	1 7/16
	20							1 3/8	1 1/4	1 3/8	1 1/4	1 7/16	1 5/16	2 1/16	1 11/16
Structural steel (min. tensile strength 60,000 p.s.i.).	2	1/8	1/16	5/16	1/4	5/16	1/4	5/16	1/4	5/16	1/4	3/8	5/16	1/2	3/8
	4	1/8	1/16	3/8	5/16	3/8	5/16	3/8	5/16	3/8	5/16	3/8	5/16	1/2	3/8
	6	3/16	1/16	1/2	3/8	7/16	3/8	7/16	3/8	7/16	3/8	7/16	3/8	3/4	1/2
	8			1/2	3/8	9/16	7/16	9/16	7/16	9/16	7/16	5/8	1/2	3/4	1/2
	10			9/16	7/16	5/8	1/2	5/8	1/2	5/8	1/2	5/8	1/2	7/8	5/8
	16					5/8	9/16	3/4	5/8	3/4	5/8	13/16	11/16	1 1/16	13/16
	20							13/16	11/16	13/16	11/16	7/8	3/4	1 3/16	1 1/16

[1] The recommendations listed in the above table are guides for the conditions stated. Other material, designs or dimensions affording equal or superior protection are also acceptable.

§ 1910.216 Mills and calenders in the rubber and plastics industries.

(a) *General requirements*—(1) *New installations.* All new installations on or after August 31, 1971, shall be in conformity with this section.

(2) *Existing installations.* All existing plant installations or equipment contracted for prior to August 31, 1971, shall comply with this section.

(3) *Auxiliary equipment.* Mechanical and electrical equipment and auxiliaries shall be installed in accordance with this section and Subpart S of this part.

(4) *Mill roll heights.* All new mill installations shall be installed so that the top of the operating rolls is not less than 50 inches above the level on which the operator stands, irrespective of the size of the mill. This distance shall apply to the actual working level, whether it be at the general floor level, in a pit, or on a platform.

(b) *Mill safety controls*—(1) *Safety trip control.* A safety trip control shall be provided in front and in back of each mill. It shall be accessible and shall operate readily on contact. The safety trip control shall be one of the following types or a combination thereof:

(i) *Pressure-sensitive body bars.* Installed at front and back of each mill having a 46-inch roll height or over. These bars shall operate readily by pressure of the mill operator's body. Pressure-sensitive body bars should be installed on new equipment.

(ii) *Safety triprod.* Installed in the front and in the back of each mill and located within 2 inches of a vertical plane tangent to the front and rear rolls. The top rods shall be not more than 72 inches above the level on which the operator stands. The triprods shall be accessible and shall operate readily whether the rods are pushed or pulled.

(iii) *Safety tripwire cable or wire center cord.* Installed in the front and in the back of each mill and located within 2 inches of a vertical plane tangent to the front and rear rolls. The cables shall not be more than 72 inches above the level on which the operator stands. The tripwire cable or wire center cord shall operate readily whether cable or cord is pushed or pulled.

(2) *Fixed guards.* A fixed bar across the front and one across the back of the mill approximately 40 inches vertically above the working level and 20 inches horizontally from the crown face of the roll should be used where they are applicable.

(3) *Auxiliary equipment.* All auxiliary equipment such as mill divider, support bars, spray pipes, feed conveyors, strip knives, etc., shall be located in such a manner as to avoid interference with access to and operation of safety devices.

(c) *Calender safety controls*—(1) *Safety trip, face.* A safety triprod, cable, or wire center cord shall be provided across each pair of in-running rolls extending the length of the face of the rolls. It shall be readily accessible and operate whether pushed or pulled. The safety tripping devices shall be located within reach of the operator and the bite.

(2) *Safety trip, side.* On both sides of the calender and near each end of the face of the roll, there shall be a cable or wire center cord connected to the safety trip. These lines should be not more than 12 inches from the faces of the respective rolls and not less than 2 inches from the calender frame. They should be anchored to the frame not more than 6 inches from the floor or operator's platform. They shall operate readily when pushed or pulled.

(d) *Protection by location*—(1) *Mills.* Where a mill is so installed that persons cannot normally reach through, over, under, or around to come in contact with the roll bite or be caught between a roll and an adjacent object, then, provided such elements are made a fixed part of a mill, safety control devices listed in paragraph (b) of this section shall not apply.

(2) *Calenders.* Where a calender is so installed that persons cannot normally reach through, over, under, or around to come in contact with the roll bite or be caught between a roll and an adjacent object, then, provided such elements are made a fixed part of a calender, safety control devices listed in paragraph (c) of this section shall not apply.

(e) *Trip and emergency switches.* All trip and emergency switches shall not be of the automatically resetting type, but shall require manual resetting.

(f) *Stopping limits*—(1) *Determination of distance of travel.* All measurements on mills and calenders shall be taken with the rolls running empty at maximum operating speed. Stopping distances shall be expressed in inches of

surface travel of the roll from the instant the emergency stopping device is actuated.

(2) *Stopping limits for mills.* All mills irrespective of the size of the rolls or their arrangement (individually or group-driven) shall be stopped within a distance, as measured in inches of surface travel, not greater than 1½ percent of the peripheral no-load surface speeds of the respective rolls as determined in feet per minute.

(3) *Stopping limits for calenders.* (i) All calenders, irrespective of size of the rolls or their configuration, shall be stopped within a distance, as measured in inches of surface travel, not greater than 1¾ percent of the peripheral no-load surface speeds of the respective calender rolls as determined in feet per minute.

(ii) Where speeds above 250 feet per minute as measured on the surface of the drive roll are used, stopping distances of more than 1¾ percent are permissible. Such stopping distances shall be subject to engineering determination.

(g) *Alarm.* Where an exposure is created by the operation, and the operators are not within sight or hearing of other employees, a suitable alarm device should be provided so that assistance will be available in case of accidents.

§ 1910.217 Mechanical power presses.

(a) *General requirements*—(1) *New installations.* The requirements of this section pertaining to construction shall apply to all mechanical power presses installed on or after August 31, 1971.

(2) *Former installations.* All mechanical power presses installed prior to August 31, 1971, shall be brought into conformity with the requirements of this section, not later than that date, except as specifically noted otherwise.

(3) *All installations.* The requirements of this section pertaining to the care and use of mechanical power presses shall apply to all mechanical power press operations as of February 15, 1972.

(4) *Reconstruction and modification.* It shall be the responsibility of any person reconstructing, or modifying a mechanical power press to do so in accordance with paragraph (b) of this section.

(5) *Excluded machines.* Press brakes, hydraulic and pneumatic power presses, bulldozers, hot bending and hot metal presses, forging presses and hammers, riveting machines and similar types of fastener applicators are excluded from the requirements of this section.

(b) *Mechanical power press guarding and construction, general*—(1) *Hazards to personnel associated with broken or falling machine components.* Machine components shall be designed, secured, or covered to minimize hazards caused by breakage, or loosening and falling or release of mechanical energy (i.e. broken springs).

(2) *Brakes.* Friction brakes provided for stopping or holding the slide movement shall be set with compression springs. Brake capacity shall be sufficient to stop the motion of the slide quickly and capable of holding the slide and its attachments at any point in its travel.

(3) *Machines using full revolution positive clutches.* (i) Machines using full revolution clutches shall incorporate a single-stroke mechanism.

(ii) If the single-stroke mechanism is dependent upon spring action, the spring(s) shall be of the compression type, operating on a rod or guided within a hole or tube, and designed to prevent interleaving of the spring coils in event of breakage.

(4) *Foot pedals (treadle).* (i) The pedal mechanism shall be protected to prevent unintended operation from falling or moving objects or by accidental stepping onto the pedal.

(ii) A pad with a nonslip contact area shall be firmly attached to the pedal.

(iii) The pedal return spring(s) shall be of the compression type, operating on a rod or guided within a hole or tube, or designed to prevent interleaving of spring coils in event of breakage.

(iv) If pedal counterweights are provided, the path of the travel of the weight shall be enclosed.

(5) *Hand operated levers.* (i) Hand-lever-operated power presses shall be equipped with a spring latch on the operating lever to prevent premature or accidental tripping.

(ii) The operating levers on hand-tripped presses having more than one operating station shall be interlocked to prevent the tripping of the press except by the "concurrent" use of all levers.

(6) *Two-hand trip.* (i) A two-hand trip shall have the individual operators hand controls protected against unintentional operation and have the individual operators hand controls arranged by design and construction and/or separation to require the use of both hands to trip the press and use a control arrangement requiring concurrent operation of the individual operators hand controls.

(ii) Two-hand trip systems on full revolution clutch machines shall incorporate an antirepeat feature.

(iii) If two-hand trip systems are used on multiple operator presses, each operator shall have a separate set of controls.

(7) *Machines using part revolution clutches.* (i) The clutch shall release and the brake shall be applied when the external clutch engaging means is removed, deactivated, or deenergized.

(ii) A red color stop control shall be provided with the clutch/brake control system. Momentary operation of the stop control shall immediately deactivate the clutch and apply the brake. The stop control shall override any other control, and reactuation of the clutch shall require use of the operating (tripping) means which has been selected.

(iii) A means of selecting Off, "Inch," Single Stroke, and Continuous (when the continuous function is furnished) shall be supplied with the clutch/brake control to select type of operation of the press. Fixing of selection shall be by means capable of supervision by the employer.

(iv) The "Inch" operating means shall be designed to prevent exposure of the workers hands within the point of operation by:

(*a*) Requiring the concurrent use of both hands to actuate the clutch, or

(*b*) Being a single control protected against accidental actuation and so located that the worker cannot reach into the point of operation while operatng the single control.

(v) Two-hand controls for single stroke shall conform to the following requirements:

(*a*) Each hand control shall be protected against unintended operation and arranged by design, construction, and/or separation so that the concurrent use of both hands is required to trip the press.

(*b*) The control system shall be designed to permit an adjustment which will require concurrent pressure from both hands during the die closing portion of the stroke.

(*c*) The control system shall incorporate an antirepeat feature.

(*d*) The control system shall be designed to require release of all operator's hand controls before an interrupted stroke can be resumed.

(vi) The requirements of subdivision (v) of this subparagraph pertains only to those single stroke two-hand controls manufactured and installed after January 1, 1971.

(vii) Controls for more than one operating station shall be designed to be activated and deactivated in complete sets of two operator's hand controls per operating station by means capable of being supervised by the employer. The clutch/brake control system shall be designed and constructed to prevent actuation of the clutch if all operating stations are bypassed.

(viii) Those clutch/brake control systems which contain both single and continuous functions shall be designed so that completion of continuous circuits may be supervised by the employer. The initiation of continuous run shall require a prior action or decision by the operator in addition to the selection of Continuous on the stroking selector, before actuation of the operating means will result in continuous stroking.

(ix) If foot control is provided, the selection method between hand and foot control shall be separate from the stroking selector and shall be designed so that the selection may be supervised by the employer.

(x) Foot operated tripping controls, if used, shall be protected so as to prevent operation from falling or moving objects, or from unintended operation by accidental stepping onto the foot control.

(xi) The control of air-clutch machines shall be designed to prevent a significant increase in the normal stopping time due to a failure within the operating valve mechanism, and to inhibit further operation if such failure does occur. This requirement shall apply only to those clutch/brake air-valve controls manufactured and installed on or after August 31, 1971, but shall not apply to machines intended only for continuous, automatic feeding applications.

(xii) The clutch/brake control shall incorporate an automatic means to prevent initiation or continued activation of the Single Stroke or Continuous func-

tions unless the press drive motor is energized and in the forward direction.

(xiii) The clutch/brake control shall automatically deactivate in event of failure of the power or pressure supply for the clutch engaging means. Reactivation of clutch shall require restoration of normal supply and the use of the tripping mechanism(s).

(xiv) The clutch/brake control shall automatically deactivate in event of failure of the counterbalance(s) air supply. Reactivation of the clutch shall require restoration of normal air supply and use of the tripping mechanism(s).

(xv) Selection of bar operation shall be by means capable of being supervised by the employer. A separate pushbutton shall be employed to activate the clutch, and the clutch shall be activated only if the driver motor is deenergized.

(8) *Electrical.* (i) A main power disconnect switch capable of being locked only in the Off position shall be provided with every power press control system.

(ii) The motor start button shall be protected against accidental operation.

(iii) All mechanical power press controls shall incorporate a type of drive motor starter that will disconnect the drive motor from the power source in event of control voltage or power source failure, and require operation of the motor start button to restart the motor when voltage conditions are restored to normal.

(iv) All a.c. control circuits and solenoid valve coils shall be powered by not more than a nominal 120-volt a.c. supply obtained from a transformer with an isolated secondary. Higher voltages that may be necessary for operation of machine or control mechanisms shall be isolated from any control mechanism handled by the operator, but motor starters with integral Start-Stop buttons may utilize line voltage control. All d.c. control circuits shall be powered by not more than nominal 240-volt d.c. supply isolated from any higher voltages.

(v) All clutch/brake control electrical circuits shall be protected against the possibility of an accidental ground in the control circuit causing false operation of the press.

(vi) Electrical clutch/brake control circuits shall incorporate features to minimize the possibility of an unintended stroke in event of the failure of any control component to function properly, including relays, limit switches, and static output circuits.

(9) *Slide counterbalance systems.* (i) Spring counterbalance systems when used shall incorporate means to retain system parts in event of breakage.

(ii) Spring counterbalances when used shall have the capability to hold the slide and its attachments at midstroke, without brake applied.

(iii) Air counterbalance cylinders shall incorporate means to retain the piston and rod in case of breakage or loosening.

(iv) Air counterbalance cylinders shall have adequate capability to hold the slide and its attachments at any point in stroke, without brake applied.

(v) Air counterbalance cylinders shall incorporate means to prevent failure of capability (sudden loss of pressure) in event of air supply failure.

(10) *Air controlling equipment.* Air controlling equipment shall be protected against foreign material and water entering the pneumatic system of the press. A means of air lubrication shall be provided when needed.

(11) *Hydraulic equipment.* The maximum anticipated working pressures in any hydraulic system on a mechanical power press shall not exceed the safe working pressure rating of any component used in that system.

(12) *Pressure vessels.* All pressure vessels used in conjunction with power presses shall conform to the American Society of Mechanical Engineers Code for Pressure Vessels, 1968 Edition.

(c) *Safeguarding the point of operation*—(1) *General requirements.* (i) It shall be the responsibility of the employer to provide and insure the usage of "point of operation guards" or properly applied and adjusted point of operation devices on every operation performed on a mechanical power press. See Table O–10.

(ii) The requirement of subdivision (i) of this subparagraph shall not apply when the point of operation opening is one-fourth inch or less. See Table O–10.

(2) *Point of operation guards.* (i) Every point of operation guard shall meet the following design, construction, application, and adjustment requirements:

(*a*) It shall prevent entry of hands or fingers into the point of operation by reaching through, over, under or around the guard;

(*b*) It shall conform to the maximum permissible openings of Table O–10;

(*c*) It shall, in itself, create no pinch point between the guard and moving machine parts;

(*d*) It shall utilize fasteners not readily removable by operator, so as to minimize the possibility of misuse or removal of essential parts;

(*e*) It shall facilitate its inspection, and

(*f*) It shall offer maximum visibility of the point of operation consistent with other requirements.

(ii) A die enclosure guard shall be attached to the die shoe or stripper in a fixed position.

(iii) A fixed barrier guard shall be attached securely to the frame of the press or to the bolster plate.

(iv) An interlocked press barrier guard shall be attached to the press frame or bolster and shall be interlocked with the press clutch control so that the clutch cannot be activated unless the guard itself, or the hinged or movable sections of the guard are in position to conform to the requirements of Table O–10.

(v) With full revolution clutches, a interlocked press barrier guard shall be used only on single stroke.

(vi) The adjustable barrier guard shall be securely attached to the press bed, bolster, or die shoe, and shall be adjusted and operated in conformity with Table O–10 and the requirements of this subparagraph. Adjustments shall be made only by authorized personnel whose qualifications include a knowledge of the provisions of Table O–10 and this subparagraph.

(vii) A point of operation enclosure which does not meet the requirements of this subparagraph and Table O–10 shall be used only in conjunction with point of operation devices.

(3) *Point of operation devices.* (i) Point of operation devices shall protect the operator by:

(*a*) Preventing and/or stopping normal stroking of the press if the operator's hands are inadvertently placed in the point of operation; or

(*b*) Preventing the operator from inadvertently reaching into the point of operation or withdrawing his hands if they are inadvertently located in the point of operation, as the dies close; or

(*c*) Preventing the operator from inadvertently reaching into the point of operation at all times; or

(*d*) Requiring application of both of the operator's hands to machine operating controls during the die closing portion of the press stroke; or

(*e*) Locating single cycle operating controls so that the slide completes its downward travel before the operator's hands can inadvertently reach into the point of operation.

(ii) The gate or movable barrier device shall protect the operator in accordance with subdivision (i) (*a*) of this subparagraph, and shall enclose the point of operation before the press clutch can be actuated.

(*a*) When used with a power press having a full revolution clutch the device shall be operated only with a single-stroke mechanism, and shall be so applied as to make impossible any attempt, after tripping the clutch, to open the device and reach into the point of operation prior to die closure.

(*b*) When used with a part revolution clutch the device shall be interlocked into the clutch/brake control system to prevent or stop activation of the clutch unless the device is in its closed (protecting) position.

(iii) The presence sensing point of operation device shall protect the operator as provided in subdivision (i) (*a*) of this subparagraph and shall be interlocked into the clutch/brake control circuit to prevent or stop clutch activation and apply the brake if an operator's hand or other part of his body is detected in the sensing field of the device.

(*a*) The device shall not in itself create any hazard to the operator.

(*b*) The device shall not be used on machines using full revolution clutches.

(*c*) The device shall not be used as a tripping mechanism.

(*d*) The device shall be designed for failsafe.

(iv) The pull-out device shall protect the operator as specified in subdivision (i) (*b*) of this subparagraph, and shall include attachments for each of the operator's hands. Such attachments shall be connected with and operated

only by the press slide or upper die, and shall be adjusted to prevent the operator from reaching into the point of operation or to withdraw the operator's hands from the point of operation before the dies close. A separate pull-out device shall be provided for each operator if more than one operator is required on a press.

(v) The sweep device shall protect the operator as specified in subdivision (i)(*b*) of this subparagraph, by moving his hands safely to a safe position if they are inadvertently in the point of operation as the dies close or prior to tripping the clutch. Devices operating in this manner shall have a barrier attached to the sweep arm in such a manner as to prevent the operator from reaching into the point of operation past the trailing edge of the sweep arm on the downward stroke of the press.

(*a*) The sweep device shall be activated by the slide or by motion of a foot pedal triprod.

(*b*) The sweep device shall be designed, installed and operated so as to prevent the operator from reaching into the point of operation before the dies close.

(*c*) The sweep device shall be installed so that it will not itself create an impact or shear hazard between the sweep arm and the press tie rods, dies, or any other part of the press or barrier.

(*d*) Partial enclosures conforming with this subparagraph insofar as the area of entry which they protect shall be provided on both sides of the point of operation to prevent the operator from reaching around or behind the sweep device and into the point of operation after the dies start to close. Side partial enclosures shall not themselves create a pinch point or shear hazard.

(vi) The holdout of the restraint device shall protect the operator as specified in subdivision (i)(*c*) of this subparagraph and shall include attachments for each of the operator's hands. Such attachments shall be securely anchored and adjusted in such a way that the operator is restrained from reaching into the point of operation. A separate set of restraints shall be provided for each operator if more than one operator is required on a press.

(vii) The two hand control devices shall protect the operator as specified in subdivision (i)(*d*) of this subparagraph. In press operations requiring more than one operator, separate two-hand controls shall be provided for each operator.

(viii) The two-hand trip shall protect the operator as specified in subdivision (i)(*e*) of this subparagraph. When a two-hand trip is used as a point of operation device it shall meet the construction requirements of paragraph (b) of this section.

(ix) Two-hand tripping devices used with full revolution clutches shall be considered as a point of operation device only when installed on presses of high speed, short stroke, or by having these control mechanisms mounted at a distance away from the point of operation so as to insure that the operator cannot inadvertently reach into the point of operation after tripping the clutch and at any time prior to die closure.

(4) *Hand feeding tools.* Hand feeding tools are intended for placing and removing materials in and from the press. Hand feeding tools are not a point of operation guard or protection device and shall not be used in lieu of the "guards" or devices required in this section.

(d) *Design, construction, setting, and feeding of dies*—(1) *General requirements.* It shall be the responsibility of the employer to institute die procurement, construction and modification policies and procedures that will eliminate by August 31, 1974, the need for the operator to place his hands or fingers within the point of operation. Effective August 31, 1974, the employer shall:

(i) Use dies designed and constructed to eliminate hazards to operating personnel.

(ii) Furnish and enforce the use of a handtool specifically designed for the purpose of freeing and/or removing struck work or scrap pieces from the die to avoid requiring the operator to place his hands or fingers within the point of operation, and

(iii) Furnish and enforce the use of hand feeding tools when necessary with manual feeding methods to avoid requiring the operator to place his hands or fingers within the point of operation.

(2) *Ejecting stock and scrap.* (i) Dies shall be designed to permit use of press knockouts and lower liftouts where the press is so equipped.

(ii) Spring or rubber strippers or an equivalent means shall be provided on punching or piercing dies, to prevent material from riding up with the punch, except where a special mechanism is provided for scrap ejection. Dies should be designed to allow automatic ejection of stock and scrap.

(3) *Scrap handling.* The employer shall provide means for handling scrap from roll feed or random length stock operations. Scrap cutters used in conjunction with scrap handling systems shall be safeguarded in accordance with paragraph (b) of this section and with § 1910.219.

(4) *Guide post hazard.* The hazard created by a guide post (when it is located in the immediate vicinity of the operator) when separated from its bushing by more than one-fourth inch shall be considered as a point of operation hazard and protected in accordance with paragraph (b) of this section.

(5) *Unitized tooling.* If unitized tooling is used, the opening between the top of the punch holder and the face of the slide, or striking pad, shall be safeguarded in accordance with the requirements of paragraph (b) of this section.

(6) *Tonnage, stroke, and weight designation.* All dies shall be:

(i) Stamped with the tonnage and stroke requirements, or have these characteristics recorded if these records are readily available to the die setter;

(ii) Stamped to indicate upper die weight when necessary for air counterbalance pressure adjustment; and

(iii) Stamped to indicate complete die weight when handling equipment may become overloaded.

(7) *Die fastening.* Provision shall be made in both the upper and lower shoes for securely mounting the die to the bolster and slide. Where clamp caps or setscrews are used in conjunction with punch stems, additional means of securing the upper shoe to the slide shall be used.

(8) *Die handling.* Handling equipment attach points shall be provided on all dies requiring mechanical handling.

(9) *Diesetting.* (i) The employer shall establish a diesetting procedure that will insure compliance with paragraph (b) of this section.

(ii) The employer shall provide spring loaded turnover bars, for presses designed to accept such turnover bars.

(iii) The employer shall provide die stops or other means to prevent losing control of the die while setting or removing dies in presses which are inclined.

(iv) The employer shall provide and enforce the use of safety blocks for use whenever dies are being adjusted or repaired in the press.

(v) The employer shall provide brushes, swabs, lubricating rolls, and automatic or manual pressure guns so that operators and diesetters shall not be required to reach into the point of operation or other hazard areas to lubricate material, punches or dies.

(e) *Inspection, maintenance, and modification of presses*—(1) *Inspection and maintenance records.* It shall be the responsibility of the employer to establish and follow a program of periodic and regular inspections of his power presses to insure that all their parts, auxiliary equipment, and safeguards are in a safe operating condition and adjustment. The employer shall maintain records of these inspections and the maintenance work performed.

(2) *Modification.* It shall be the responsibility of any person modifying a power press to furnish instructions with the modification to establish new or changed guidelines for use and care of the power press so modified.

(3) *Training of maintenance personnel.* It shall be the responsibility of the employer to insure the original and continuing competence of personnel caring for, inspecting, and maintaining power presses.

(f) *Operation of power presses*—(1) *Employment of minors.* The employer shall permit no one under 18 years of age to operate or assist in the operation of machinery covered in this section.

(2) *Instruction to operators.* The employer shall train and instruct the operator in the safe method of work before starting work on any operation covered by this section. The employer shall insure by adequate supervision that correct operating procedures are being followed.

(3) *Work area.* The employer shall provide clearance between machines so that movement of one operator will not interfere with the work of another. Ample room for cleaning machines, handling material, work pieces, and scrap

shall also be provided. All surrounding floors shall be kept in good condition and free from obstructions, grease, oil, and water.

(4) *Overloading.* The employer shall operate his presses within the tonnage and attachment weight ratings specified by the manufacturer.

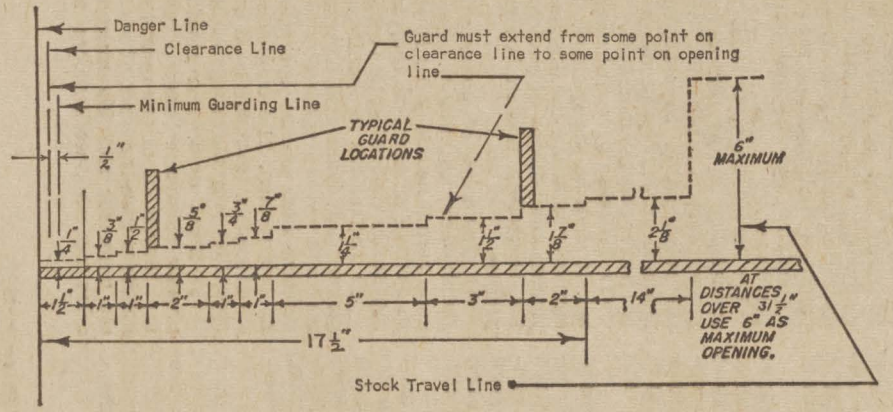

Explanation of above diagram:

This diagram shows the accepted safe openings between the bottom edge of a guard and feed table at various distances from the danger line (point of operation).

The *clearance line* marks the distance required to prevent contact between guard and moving parts.

The *minimum guarding line* is the distance between the infeed side of the guard and the danger line which is one-half inch from the danger line.

The various openings are such that for average size hands an operator's fingers won't reach the point of operation.

After installation of point of operation guards and before a job is released for operation a check should be made to verify that the guard will prevent the operator's hands from reaching the point of operation.

TABLE O–10

Distance of opening from point of operation hazard (inches)	*Maximum width of opening (inches)*
½ to 1½	¼
1½ to 2½	⅜
2½ to 3½	½
3½ to 5½	⅝
5½ to 6½	¾
6½ to 7½	⅞
7½ to 12½	1¼
12½ to 15½	1½
15½ to 17½	1⅞
17½ to 31½	2⅛

This table shows the distances that guards shall be positioned from the danger line in accordance with the required openings.

§ 1910.218 Forging machines.

(a) *General requirements*—(1) *Use of lead.* The safety requirements of this subparagraph apply to lead casts or other use of lead in the forge shop or die shop.

(i) Thermostatic control of heating elements shall be provided to maintain proper melting temperature and prevent overheating.

(ii) Fixed or permanent lead pot installations shall be exhausted.

(iii) Portable units shall be used only in areas where good, general room ventilation is provided.

(iv) Personal protective equipment (gloves, goggles, aprons, and other items) shall be worn.

(v) A covered container shall be provided to store dross skimmings.

(vi) Equipment shall be kept clean, particularly from accumulations of yellow lead oxide.

(2) *Inspection and maintenance.* It shall be the responsibility of the employer to maintain all forge shop equipment in a condition which will insure continued safe operation. This responsibility includes:

(i) Establishing periodic and regular maintenance safety checks and keeping records of these inspections.

(ii) Scheduling and recording inspection of guards and point of operation protection devices at frequent and regular intervals.

(iii) Training personnel for the proper inspection and maintenance of forging machinery and equipment.

(iv) All overhead parts shall be fastened or protected in such a manner that they will not fly off or fall in event of failure.

(3) *Hammers and presses.* (i) All hammers shall be positioned or installed in such a manner that they remain on or are anchored to foundations sufficient to support them according to applicable engineering standards.

(ii) All presses shall be installed in such a manner that they remain where they are positioned or they are anchored to foundations sufficient to support them according to applicable engineering standards.

(iii) Means shall be provided for disconnecting the power to the machine and for locking out or rendering cycling controls inoperable.

(iv) The ram shall be blocked when dies are being changed or other work is being done on the hammer. Blocks or wedges shall be made of material the strength and construction of which should meet or exceed the specifications and dimensions shown in Table O–11.

TABLE O–11—STRENGTH AND DIMENSIONS FOR WOOD RAM PROPS

Size of timber, inches [1]	Square inches in cross section	Minimum allowable crushing strength parallel to grain, p.s.i.[2]	Maximum static load within short column range [3]	Safety factor	Maximum recommended weight of forging hammer for timber used	Maximum allowable length of timber, inches
4 x 4	16	5,000	80,000	10	8,000	44
6 x 6	36	5,000	180,000	10	18,000	66
8 x 8	64	5,000	320,000	10	32,000	88
10 x 10	100	5,000	500,000	10	50,000	100
12 x 12	144	5,000	720,000	10	72,000	132

[1] Actual dimension.
[2] Adapted from U.S. Department of Agriculture Technical Bulletin 479. Hardwoods recommended are those whose ultimate crushing strengths in compression parallel to grain are 5,000 p.s.i. (pounds per square inch) or greater.
[3] Slenderness ratio formula for short columns is $L/d=11$, where L=length of timber in inches and d=least dimension in inches; this ratio should not exceed 11.

(v) Tongs shall be sufficient length to clear the body of the worker in case of kickback, and shall not have sharp handle ends. The worker should be instructed in the proper body position when using tongs. Tongs should be checked periodically to see that they remain at the proper hardness level for the job. When rings or equivalent devices for locking tongs are used they should be inspected periodically to insure safe condition.

(vi) Oil swabs, or scale removers, or other devices to remove scale shall be provided. These devices shall be long enough to enable a man to reach the full length of the die without placing his hand or arm between the dies.

(vii) Material handling equipment shall be of adequate strength, size, and dimension to handle diesetting operations safely.

(viii) A scale guard of substantial construction shall be provided at the back of every hammer, so arranged as to stop flying scale.

(ix) A scale guard of substantial construction shall be provided at the back of every press, so arranged as to stop flying scale.

(b) *Hammers, general*—(1) *Keys.* Die keys and shims shall be made from a grade of material that will not unduly crack or splinter, and should not project more than 2 inches in front and 4 inches in back of ram or die.

(2) *Foot operated devices.* All foot operated devices (i.e., treadles, pedals, bars, valves, and switches) shall be substantially and effectively protected from unintended operation.

(c) *Presses.* All manually operated valves and switches shall be clearly identified and readily accessible.

(d) *Power-driven hammers*—(1) *Safety cylinder head.* Every steam or airhammer shall have a safety cylinder head to act as a cushion if the rod should break or pullout of the ram.

(2) *Shutoff valve.* Steam hammers shall be provided with a quick closing emergency valve in the admission pipe-

line at a convenient location. This valve shall be closed and locked in the off position while the hammer is being adjusted, repaired, or serviced, or when the dies are being changed.

(3) *Cylinder draining.* Steam hammers shall be provided with a means of cylinder draining, such as a self-draining arrangement or a quick-acting drain cock.

(4) *Pressure pipes.* Steam or air piping shall conform to the specifications of American National Standard ANSI B31.1.0–1967, Power Piping with Addendum issued before April 28, 1971.

(e) *Gravity hammers*—(1) *Air-lift hammers.* (i) Air-lift hammers shall have a safety cylinder head as required in paragraph (d)(1) of this section.

(ii) Air-lift hammers shall have an air shutoff valve as required in paragraph (d)(2) of this section and should be conveniently located and distinctly marked for ease of identification.

(iii) Air-lift hammers shall be provided with two drain cocks: one on main head cylinder, and one on clamp cylinder.

(iv) Air piping shall conform to the specifications of the ANSI B31.1.0–1967, Power Piping with Addenda issued before April 28, 1971.

(2) *Board drophammers.* (i) A suitable enclosure shall be provided to prevent damaged or detached boards from falling. The board enclosure shall be securely fastened to the hammer.

(ii) All major assemblies and fittings which can loosen and fall shall be properly secured in place.

(f) *Forging presses*—(1) *Mechanical forging presses.* When dies are being changed or maintenance being performed on the press, the following shall be accomplished:

(i) The power to the press shall be locked out.

(ii) The flywheel shall be at rest.

(iii) The ram shall be blocked with a material the strength of which shall meet or exceed the specifications or dimensions shown in Table O–11.

(2) *Hydraulic forging presses.* When dies are being changed or maintenance is being performed on the press, the following shall be accomplished:

(i) The hydraulic pumps and power apparatus shall be locked out.

(ii) The ram shall be blocked with a material the strength of which shall meet or exceed the specifications or dimensions shown in Table O–11.

(g) *Trimming presses*—(1) *Hot trimming presses.* The requirements of paragraph (f)(1) of this section shall also apply to hot trimming presses.

(2) *Cold trimming presses.* Cold trimming presses shall be safeguarded in accordance with § 1910.217(c).

(h) *Upsetters*—(1) *General requirements.* All upsetters shall be installed so that they remain on their supporting foundations.

(2) *Lockouts.* Upsetters shall be provided with a means for locking out the power at its entry point to the machine and rendering its cycling controls inoperable.

(3) *Manually operated controls.* All manually operated valves and switches shall be clearly identified and readily accessible.

(4) *Tongs.* Tongs shall be of sufficient length to clear the body of the worker in case of kickback, and shall not have sharp handle ends. The worker should be instructed in the proper body position when using tongs. Tongs should be checked periodically to see that they remain at the proper hardness level for the job. When rings or equivalent devices for locking tongs are used they should be inspected periodically to ensure safe condition.

(5) *Changing dies.* When dies are being changed, maintenance performed, or any work done on the machine, the power to the upsetter shall be locked out, and the flywheel shall be at rest.

(i) *Other forging equipment*—(1) *Boltheading.* The provisions of paragraph (h) of this section shall apply to boltheading.

(2) *Rivet making.* The provisions of paragraph (h) of this section shall apply to rivet making.

(j) *Other forge facility equipment*—(1) *Billet shears.* A positive-type lockout device for disconnecting the power to the shear shall be provided.

(2) *Saws.* Every saw shall be provided with a guard of not less than one-eighth inch sheet metal positioned to stop flying sparks. Suitable means should be provided to trap sparks below the saw. A tank of water placed below the saw is also desirable.

(3) *Conveyors.* Conveyor power transmission equipment shall be guarded in accordance with ANSI B20.1–1957, Safety Code for Conveyors, Cableways, and Related Equipment, and with subpart M of this part.

(4) *Shot blast.* The cleaning chamber shall have doors or guards to protect operators.

(5) *Grinding.* Personal protective equipment shall be used in grinding operations, and equipment shall be used and maintained in accordance with ANSI B7.1–1970, Safety Code for the Use, Care, and Protection of Abrasive Wheels, and with § 1910.215.

§ 1910.219 Mechanical power-transmission apparatus.

(a) *General requirements.* (1) This section covers all types and shapes of power-transmission belts, except the following when operating at two hundred and fifty (250) feet per minute or less: (i) Flat belts one (1) inch or less in width, (ii) flat belts two (2) inches or less in width which are free from metal lacings or fasteners, (iii) round belts one-half (½) inch or less in diameter; and (iv) single strand V-belts, the width of which is thirteen thirty-seconds (13/32) inch or less.

(2) Vertical and inclined belts (paragraphs (e) (3) and (4) of this section) if not more than two and one-half (2½) inches wide and running at a speed of less than one thousand (1,000) feet per minute, and if free from metal lacings or fastenings may be guarded with a nip-point belt and pulley guard.

(3) For the Textile Industry, because of the presence of excessive deposits of lint, which constitute a serious fire hazard, the sides and face sections only of nip-point belt and pulley guards are required, provided the guard shall extend at least six (6) inches beyond the rim of the pulley on the in-running and off-running sides of the belt and at least two (2) inches away from the rim and face of the pulley in all other directions.

(4) This section covers the principal features with which power transmission safeguards shall comply.

(b) *Prime-mover guards*—(1) *Flywheels.* Flywheels located so that any part is seven (7) feet or less above floor or platform shall be guarded in accordance with the requirements of this subparagraph:

(i) With an enclosure of sheet, perforated, or expanded metal, or woven wire;

(ii) With guard rails placed not less than fifteen (15) inches nor more than twenty (20) inches from rim. When flywheel extends into pit or is within 12 inches of floor, a standard toeboard shall also be provided;

(iii) When the upper rim of flywheel protrudes through a working floor, it shall be entirely enclosed or surrounded by a guardrail and toeboard.

(iv) For flywheels with smooth rims five (5) feet or less in diameter, where the preceding methods cannot be applied, the following may be used: A disk attached to the flywheel in such manner as to cover the spokes of the wheel on the exposed side and present a smooth surface and edge, at the same time providing means for periodic inspection. An open space, not exceeding four (4) inches in width, may be left between the outside edge of the disk and the rim of the wheel if desired, to facilitate turning the wheel over. Where a disk is used, the keys or other dangerous projections not covered by disk shall be cut off or covered. This subdivision does not apply to flywheels with solid web centers.

(v) Adjustable guard to be used for starting engine or for running adjustment may be provided at the flywheel of gas or oil engines. A slot opening for jack bar will be permitted.

(vi) Wherever flywheels are above working areas, guards shall be installed having sufficient strength to hold the weight of the flywheel in the event of a shaft or wheel mounting failure.

(2) *Cranks and connecting rods.* Cranks and connecting rods, when exposed to contact, shall be guarded in accordance with paragraphs (m) and (n) of this section, or by a guardrail as described in paragraph (o)(5) of this section.

(3) *Tail rods or extension piston rods.* Tail rods or extension piston rods shall be guarded in accordance with paragraphs (m) and (o) of this section, or by a guardrail on sides and end, with a clearance of not less than fifteen (15) nor more than twenty (20) inches when rod is fully extended.

(4) *Governor balls.* Governor balls six (6) feet or less from the floor or other

working level, when exposed to contact, shall be provided with an enclosure extending to the top of the governor balls when at their highest position. The material used in the construction of this enclosure shall conform to paragraphs (m) and (o) of this section.

(c) *Shafting*—(1) *Installation.* (i) Each continuous line of shafting shall be secured in position against excessive endwise movement.

(ii) Inclined and vertical shafts, particularly inclined idler shafts, shall be securely held in position against endwise thrust.

(2) *Guarding horizontal shafting.* (i) All exposed parts of horizontal shafting seven (7) feet or less from floor or working platform, excepting runways used exclusively for oiling, or running adjustments, shall be protected by a stationary casing enclosing shafting completely or by a trough enclosing sides and top or sides and bottom of shafting as location requires.

(ii) Shafting under bench machines shall be enclosed by a stationary casing, or by a trough at sides and top or sides and bottom, as location requires. The sides of the trough shall come within at least six (6) inches of the underside of table, or if shafting is located near floor within six (6) inches of floor. In every case the sides of trough shall extend at least two (2) inches beyond the shafting or protuberance.

(3) *Guarding vertical and inclined shafting.* Vertical and inclined shafting seven (7) feet or less from floor or working platform, excepting maintenance runways, shall be enclosed with a stationary casing in accordance with requirements of paragraphs (m) and (o) of this section.

(4) *Projecting shaft ends.* (i) Projecting shaft ends shall present a smooth edge and end and shall not project more than one-half the diameter of the shaft unless guarded by nonrotating caps or safety sleeves.

(ii) Unused keyways shall be filled up or covered.

(5) *Power-transmission apparatus located in basements.* All mechanical power transmission apparatus located in basements, towers, and rooms used exclusively for power transmission equipment shall be guarded in accordance with this section, except that the requirements for safeguarding belts, pulleys, and shafting need not be implied with when the following requirements are met:

(i) The basement, tower, or room occupied by transmission equipment is locked against unauthorized entrance.

(ii) The vertical clearance in passageways between the floor and power transmission beams, ceiling, or any other objects, is not less than five feet six inches (5 ft. 6 in.).

(iii) The intensity of illumination conforms to the requirements of ANSI A11.1–1965 (R–1970).

(iv) The footing is dry, firm, and level.

(v) The route followed by the oiler is protected in such manner as to prevent accident.

(d) *Pulleys*—(1) *Guarding.* Pulleys, any parts of which are seven (7) feet or less from the floor or working platform, shall be guarded in accordance with the standards specified in paragraphs (m) and (o) of this section. Pulleys serving as balance wheels (e.g., punch presses) on which the point of contact between belt and pulley is more than six feet six inches (6 ft. 6 in.) from the floor or platform may be guarded with a disk covering the spokes.

(2) *Location of pulleys.* (i) Unless the distance to the nearest fixed pulley, clutch, or hanger exceeds the width of the belt used, a guide shall be provided to prevent the belt from leaving the pulley on the side where insufficient clearance exists.

(ii) Where there are overhanging pulleys on line, jack, or countershafts with no bearing between the pulley and the outer end of the shaft, a guide to prevent the belt from running off the pulley should be provided.

(3) *Broken pulleys.* Pulleys with cracks, or pieces broken out of rims, shall not be used.

(4) *Pulley speeds.* Pulleys intended to operate at rim speed in excess of manufacturers normal recommendations shall be specially designed and carefully balanced for the speed at which they are to operate.

(5) *Composition and wood pulleys.* Composition or laminated wood pulleys shall not be installed where they are subjected to influences detrimental to their structural composition.

(e) *Belt, rope, and chain drives*—(1) *Horizontal belts and ropes.* (i) Where both runs of horizontal belts are seven (7) feet or less from the floor level, the guard shall extend to at least fifteen (15) inches above the belt or to a standard height (see Table O–12), except that where both runs of a horizontal belt are 42 inches or less from the floor, the belt shall be fully enclosed in accordance with paragraphs (m) and (o) of this section.

(ii) In powerplants or power-development rooms, a guardrail may be used in lieu of the guard required by subdivision (i) of this subparagraph.

(2) *Overhead horizontal belts.* (i) Overhead horizontal belts, with lower parts seven (7) feet or less from the floor or platform, shall be guarded on sides and bottom in accordance with paragraph (o)(3) of this section.

(ii) Horizontal overhead belts more than seven (7) feet above floor or platform shall be guarded for their entire length under the following conditions:

(*a*) If located over passageways or work places and traveling 1,800 feet or more per minute.

(*b*) If center to center distance between pulleys is ten (10) feet or more.

(*c*) If belt is eight (8) inches or more in width.

(iii) Where the upper and lower runs of horizontal belts are so located that passage of persons between them would be possible, the passage shall be either:

(*a*) Completely barred by a guardrail or other barrier in accordance with paragraphs (m) and (o) of this section; or

(*b*) Where passage is regarded as necessary, there shall be a platform over the lower run guarded on either side by a railing completely filled in with wire mesh or other filler, or by a solid barrier. The upper run shall be so guarded as to prevent contact therewith either by the worker or by objects carried by him. In powerplants only the lower run of the belt need be guarded.

(iv) Overhead chain and link belt drives are governed by the same rules as overhead horizontal belts and shall be guarded in the same manner as belts.

(v) American or Continuous System rope drives so located that the condition of the rope (particularly the splice) cannot be constantly and conveniently observed, shall be equipped with a telltale device (preferably electric-bell type) that will give warning when rope begins to fray.

(3) *Vertical and inclined belts.* (i) Vertical and inclined belts shall be enclosed by a guard conforming to standards in paragraphs (m) and (o) of this section.

(ii) All guards for inclined belts shall be arranged in such a manner that a minimum clearance of seven (7) feet is maintained between belt and floor at any point outside of guard.

(4) *Vertical belts.* Vertical belts running over a lower pulley more than seven (7) feet above floor or platform shall be guarded at the bottom in the same manner as horizontal overhead belts, if conditions are as stated in subparagraphs (2)(ii) (*a*) and (*c*) of this paragraph.

(5) *Cone-pulley belts.* (i) The cone belt and pulley shall be equipped with a belt shifter so constructed as to adequately guard the nip point of the belt and pulley. If the frame of the belt shifter does not adequately guard the nip point of the belt and pulley, the nip point shall be further protected by means of a vertical guard placed in front of the pulley and extending at least to the top of the largest step of the cone.

(ii) If the belt is of the endless type or laced with rawhide laces, and a belt shifter is not desired, the belt will be considered guarded if the nip point of the belt and pulley is protected by a nip point guard located in front of the cone extending at least to the top of the largest step of the cone, and formed to show the contour of the cone in order to give the nip point of the belt and pulley the maximum protection.

(iii) If the cone is located less than 3 feet from the floor or working platform, the cone pulley and belt shall be guarded to a height of 3 feet regardless of whether the belt is endless or laced with rawhide.

(6) *Belt tighteners.* (i) Suspended counterbalanced tighteners and all parts thereof shall be of substantial construction and securely fastened; the bearings shall be securely capped. Means must be provided to prevent tighteners from falling, in case the belt breaks.

(ii) Where suspended counterweights are used and not guarded by location, they shall be so encased as to prevent accident.

(f) *Gears, sprockets, and chains*—(1) *Gears.* Gears shall be guarded in accordance with one of the following methods:

(i) By a complete enclosure; or

(ii) By a standard guard as described in paragraph (o) of this section, at least seven (7) feet high extending six (6) inches above the mesh point of the gears; or

(iii) By a band guard covering the face of gear and having flanges extended inward beyond the root of the teeth on the exposed side or sides. Where any portion of the train of gears guarded by a band guard is less than six (6) feet from the floor a disk guard or a complete enclosure to the height of six (6) feet shall be required.

(2) *Hand-operated gears.* Subparagraph (1) of this paragraph does not apply to hand-operated gears used only to adjust machine parts and which do not continue to move after hand power is removed. However, the guarding of these gears is highly recommended.

(3) *Sprockets and chains.* All sprocket wheels and chains shall be enclosed unless they are more than seven (7) feet above the floor or platform. Where the drive extends over other machine or working areas, protection against falling shall be provided. This subparagraph does not apply to manually operated sprockets.

(4) *Openings for oiling.* When frequent oiling must be done, openings with hinged or sliding self-closing covers shall be provided. All points not readily accessible shall have oil feed tubes if lubricant is to be added while machinery is in motion.

(g) *Guarding friction drives.* The driving point of all friction drives when exposed to contact shall be guarded, all arm or spoke friction drives and all web friction drives with holes in the web shall be entirely enclosed, and all projecting belts or friction drives where exposed to contact shall be guarded.

(h) *Keys, setscrews, and other projections.* (1) All projecting keys, setscrews, and other projections in revolving parts shall be removed or made flush or guarded by metal cover. This subparagraph does not apply to keys or setscrews within gear or sprocket casings or other enclosures, nor to keys, setscrews, or oilcups in hubs of pulleys less than twenty (20) inches in diameter where they are within the plane of the rim of the pulley.

(2) It is recommended, however, that no projecting setscrews or oilcups be used in any revolving pulley or part of machinery.

(i) *Collars and couplings*—(1) *Collars.* All revolving collars, including split collars, shall be cylindrical, and screws or bolts used in collars shall not project beyond the largest periphery of the collar.

(2) *Couplings.* Shaft couplings shall be so constructed as to present no hazard from bolts, nuts, setscrews, or revolving surfaces. Bolts, nuts, and setscrews will, however, be permitted where they are covered with safety sleeves or where they are used parallel with the shafting and are countersunk or else do not extend beyond the flange of the coupling.

(j) *Bearings and facilities for oiling.* Self lubricating bearings are recommended and all drip cups and pans shall be securely fastened.

(k) *Guarding of clutches, cutoff couplings, and clutch pulleys*—(1) *Guards.* Clutches, cutoff couplings, or clutch pulleys having projecting parts, where such clutches are located seven (7) feet or less above the floor or working platform, shall be enclosed by a stationary guard constructed in accordance with this section. A "U" type guard is permissible.

(2) *Enginerooms.* In enginerooms a guardrail, preferably with toeboard, may be used instead of the guard required by subparagraph (1) of this paragraph, provided such a room is occupied only by engineroom attendants.

(3) *Bearings.* A bearing support immediately adjacent to a friction clutch or cutoff coupling shall have self-lubricating bearings requiring attention at infrequent intervals.

(l) *Belt shifters, clutches, shippers, poles, perches, and fasteners*—(1) *Belt shifters.* (i) Tight and loose pulleys on all new installations made on or after August 31, 1971, shall be equipped with a permanent belt shifter provided with mechanical means to prevent belt from creeping from loose to tight pulley. It is recommended that old installations be changed to conform to this rule.

(ii) Belt shifter and clutch handles shall be rounded and be located as far as possible from danger of accidental contact, but within easy reach of the operator. Where belt shifters are not directly located over a machine or bench, the handles shall be cut off six feet six inches (6 ft. 6 in.) above floor level.

(iii) All belt and clutch shifters of the same type in each shop should move in the same direction to stop machines, i.e., either all right or all left. This does not apply to friction clutch on countershaft carrying two clutch pulleys with open and crossed belts, respectively. In this case the shifter handle has three positions and the machine is at a standstill when clutch handle is in the neutral or center position.

(2) *Belt shippers and shipper poles.* The use of belt poles as substitutes for mechanical shifters is not recommended. Where necessity compels their use, they shall be of sufficient size to enable workmen to grasp them securely. (A two-inch (2 in.) diameter or 1½ by 2 inches cross-section is suggested.) Poles shall be smooth and preferably of straight grain hardwood, such as ash or hickory. The edges of rectangular poles should be rounded. Poles should extend from the top of the pulley to within about forty (40) inches of floor or working platform.

(3) *Belt perches.* Where loose pulleys or idlers are not practicable, belt perches in form of brackets, rollers, etc., shall be used to keep idle belts away from the shafts. Perches should be substantial and designed for the safe shifting of belts.

(4) *Belt fasteners.* Belts which of necessity must be shifted by hand and belts within seven (7) feet of the floor or working platform which are not guarded in accordance with this section shall not be fastened with metal in any case, nor with any other fastening which by construction or wear will constitute an accident hazard.

(m) *Standard guards—general requirements*—(1) *Materials.* (i) Standard conditions shall be secured by the use of the following materials. Expanded metal, perforated or solid sheet metal, wire mesh on a frame of angle iron, or iron pipe securely fastened to floor or to frame of machine.

(ii) All metal should be free from burrs and sharp edges.

(iii) Wire mesh should be of the type in which the wires are securely fastened at every cross point either by welding, soldering, or galvanizing, except in case of diamond or square wire mesh made of No. 14 gage wire, ¾-inch mesh or heavier.

(2) *Methods of manufacture.* (i) Expanded metal, sheet or perforated metal, and wire mesh shall be securely fastened to frame by one of the following methods:

(*a*) With rivets or bolts spaced not more than five (5) inches center to center. In case of expanded metal or wire mesh, metal strips or clips shall be used to form a washer for rivets or bolts.

(*b*) by welding to frame every four (4) inches.

(*c*) By weaving through channel or angle frame, or if No. 14 gage ¾-inch mesh or heavier is used by bending entirely around rod frames.

(*d*) Where openings in pipe railing are to be filled in with expanded metal, wire mesh or sheet metal, the filler material shall be made into panels with rolled edges or bound with "V" or "U" edging of No. 24 gage or heavier sheet metal fastened to the panels with bolts or rivets spaced not more than five (5) inches center to center. The bound panels shall be fastened to the railing by sheet-metal clips spaced not more than five (5) inches center to center.

(*e*) Diamond or square mesh made of crimped wire fastened into channels, angle or round-iron frames, may also be used as a filler in guards. Size of mesh shall correspond to Table O–12.

(ii) Where the design of guards requires filler material of greater area than 12 square feet, additional frame members shall be provided to maintain panel area within this limit.

(iii) All joints of framework shall be made equivalent in strength to the material of the frame.

(n) *Disk, shield, and "U" guards*—(1) *Disk guards.* A disk guard shall consist of a sheet-metal disk not less than No. 22 gage fastened by "U" bolts or rivets to spokes of pulleys, flywheels, or gears. Where possibility of contact with sharp edges of the disk exists, the edge shall be rolled or wired. In all cases the nuts shall be provided with locknuts which shall be placed on the unexposed side of the wheel.

(2) *Shield guards.* (i) A shield guard shall consist of a frame filled in with wire mesh, expanded, perforated, or solid sheet metal.

(ii) If area of shield does not exceed six (6) square feet the wire mesh or expanded metal may be fastened in a framework of 3/8-inch solid rod, 3/4-inch by 3/4-inch by 1/8-inch angle iron or metal construction of equivalent strength. Metal shields may have edges entirely rolled around a 3/8-inch solid rod.

(3) *"U" guards.* A "U" guard consisting of a flat surface with edge members shall be designed to cover the under surface and lower edge of a belt, multiple chain, or rope drive. It shall be constructed of materials specified in Table O–12, and shall conform to the requirements of paragraphs (o) (3) and (4) of this section. Edges shall be smooth and, if size of guard requires, the edges shall be reinforced by rolling, wiring, or by binding with angle or flat iron.

(o) *Approved materials*—(1) *Minimum requirements.* The materials and dimensions specified in this paragraph shall apply to all guards, except horizontal overhead belts, rope, cable, or chair guards more than seven (7) feet above floor, or platform. (For the latter, see Table O–13.)

TABLE O–12—TABLE OF STANDARD MATERIALS AND DIMENSIONS

Material	Clearance from moving part at all points	Largest mesh or opening allowable	Minimum gauge (U.S. Standard) or thickness	Minimum height of guard from floor or platform level
	Inches	*Inches*	*Inches*	*Feet*
Woven wire	Under 2	3/8	No. 16	7
	2–4	1/2	No. 16	7
	Under 4	1/2	No. 16	7
	4–15	2	No. 12	7
Expanded metal	Under 4	1/2	No. 18	7
	4–15	2	No. 13	7
Perforated metal	Under 4	1/2	No. 20	7
	4–15	2	No. 14	7
Sheet metal	Under 4		No. 22	7
	4–15		No. 22	7
Wood or metal strip crossed	Under 4	3/8	Wood 3/4 Metal No. 16	7
	4–15	2	Wood 3/4 Metal No. 16	7
Wood or metal strip not crossed	Under 4	1/2 width	Wood 3/4 Meatl No. 16	7
	4–15	1 width	Wood 3/4 Metal No. 16	7
Standard rail	Min. 15			
	Max. 20			

(i) Minimum dimensions of materials for the framework of all guards, except as noted in this subdivision (i) shall be angle iron 1 inch by 1 inch by 1/8 inch, metal pipe of 3/4-inch inside diameter or metal construction of equivalent strength.

(*a*) All guards shall be rigidly braced every three (3) feet or fractional part of their height to some fixed part of machinery or building structure. Where guard is exposed to contact with moving equipment additional strength may be necessary.

(*b*) The framework for all guards fastened to floor or working platform and without other support or bracing shall consist of 1 1/2-inch by 1 1/2-inch by 1/8-inch angle iron, metal pipe of 1 1/2-inch inside diameter, or metal construction of equivalent strength. All rectangular guards shall have at least four upright frame members each of which shall be carried to the floor and be securely fastened thereto. Cylindrical guards shall have at least three supporting members carried to floor.

(*c*) Guards thirty (30) inches or less in height and with a total surface area not in excess of ten (10) square feet may have a framework of 3/8-inch solid rod, 3/4-inch by 3/4-inch by 1/8-inch angle, or metal construction of equivalent strength. The filling material shall correspond to the requirements of Table O–12.

(ii) The specifications given in Table O–12 and subdivision (i) of this subparagraph are minimum requirements; where guards are exposed to unusual wear, deterioration or impact, heavier material and construction should be used to protect amply against the specific hazards involved.

(2) *Wood guards.* (i) Wood guards may be used in the woodworking and chemical industries, in industries where the presence of fumes or where manufacturing conditions would cause the rapid deterioration of metal guards; also in construction work and in locations outdoors where extreme cold or extreme heat make metal guards and railings undesirable. In all other industries, wood guards shall not be used.

(ii) (*a*) Wood shall be sound, tough, and free from any loose knots.

(*b*) Guards shall be made of planed lumber not less than one (1) inch rough board measure, and edges and corners rounded off.

(*c*) Wood guards shall be securely fastened together with wood screws, hardwood dowel pins, bolts, or rivets.

(*d*) While no definite dimensions are given under this heading for framework or filler materials, wood guards shall be equal in strength and rigidity to metal guards specified in subparagraphs (1) (i) and (ii) of this paragraph and Table O–12.

(*e*) For construction of standard wood railing, see subpargraph (5) of this paragraph.

(3) *Guards for horizontal overhead belts.* (i) Guards for horizontal overhead belts shall run the entire length of the belt and follow the line of the pulley to the ceiling or be carried to the nearest wall, thus enclosing the belt effectively. Where belts are so located as to make it impracticable to carry the guard to wall or ceiling, construction of guard shall be such as to enclose completely the top and bottom runs of belt and the face of pulleys.

(ii) The guard and all its supporting members shall be securely fastened to wall or ceiling by gimlet-point lag screws or through bolts. In case of masonry construction, expansion bolts shall be used. The use of bolts placed horizontally through floor beams or ceiling rafters is recommended.

(iii) Suitable reinforcement shall be provided for the ceiling rafters or overhead floor beams, where such is necessary, to sustain safely the weight and stress likely to be imposed by the guard. The interior surface of all guards, by which is meant the surface of the guard with which a belt will come in contact, shall be smooth and free from all projections of any character, except where construction demands it; protruding shallow roundhead rivets may be used. Overhead belt guards shall be at least one-quarter wider than belt which they protect, except that this clearance need not in any case exceed six (6) inches on each side. Overhead rope drive and block and roller-chain-drive guards shall be not less than six (6) inches wider than the drive on each side. In overhead silent chain-drive guards where the chain is held from lateral displacement on the sprockets, the side clearances required on drives of twenty (20) inch centers or under shall be not less than one-fourth inch from the nearest moving chain part, and on drives of over twenty (20) inch centers a minimum of one-half inch from the nearest moving chain part.

(iv) Table O–13 gives the sizes of materials to be used and the general construction specifications of guards for belts ten (10) inches or more in width. No material for overhead belt guards should be smaller than that specified in Table O–13 for belts ten (10) to fourteen (14) inches wide, even if the overhead belt is less than ten (10) inches in width. However, No. 20 gage sheet metal may be used as a filler on guards for belts less than ten (10) inches wide. Expanded metal, because of the sharp edges, should not be used as a filler in horizontal belt guards.

(v) For clearance between guards and belts, ropes or chains of various center to center dimensions between the shafts, see bottom of Table O–13.

(4) *Guards for horizontal overhead rope and chain drives.* Overhead-rope and chain-drive guard construction shall conform to the rules for overhead-belt guard construction of similar width, except that the filler material shall be of the solid type as shown in Table O–13, unless the fire hazard demands the use of open construction. A side guard member of the same solid filling material should be carried up in a vertical position two (2) inches above the level of the lower run of the rope or chain drive and two (2) inches within the periphery of the pulleys which the guard encloses thus forming a trough. These side filler members should be reinforced on the edges with 1 1/2-inch by 1/4-inch flat steel, riveted to the filling material at not greater than eight (8) inch centers; the reinforcing strip should be fastened or bolted

to all guard supporting members with at least one ⅜-inch rivet or bolt at each intersection, and the ends should be secured to the ceiling with lag screws or bolts. The filling material shall be fastened to the framework of the guard and the filler supports by 3/16-inch rivets spaced on 4-inch centers. The width of the multiple drive shall be determined by measuring the distance from the outside of the first to the outside of the last rope or chain in the group accommodated by the pulley.

(5) *Guardrails and toeboards.* (i) Guardrail shall be forty-two (42) inches in height, with midrail between top rail and floor.

(ii) Posts shall be not more than eight (8) feet apart; they are to be permanent and substantial, smooth, and free from protruding nails, bolts, and splinters. If made of pipe, the post shall be one and one-fourth (1¼) inches inside diameter, or larger. If made of metal shapes or bars, their section shall be equal in strength to that of one and one-half (1½) by one and one-half (1½) by three-sixteenths (3/16) inch angle iron. If made of wood, the posts shall be two by four (2 x 4) inches or larger. The upper rail shall be two by four (2 x 4) inches, or two one by four (1 x 4) strips, one at the top and one at the side of posts. The midrail may be one by four (1 x 4) inches or more. The rails (metal shapes, metal bars, or wood), should be on that side of the posts which gives the best protection and support. Where panels are fitted with expanded metal or wire mesh as noted in Table O–12 the middle rails may be omitted. Where guard is exposed to contact with moving equipment, additional strength may be necessary.

(iii) Toeboards shall be four (4) inches or more in height, of wood, metal, or of metal grill not exceeding one (1) inch mesh. Toeboards at flywheel pits should preferably be placed as close to edge of the pit as possible.

(p) *Care of equipment*—(1) *General.* All power-transmission equipment shall be inspected at intervals not exceeding 60 days and be kept in good working condition at all times.

(2) *Shafting.* (i) Shafting shall be kept in alignment, free from rust and excess oil or grease.

(ii) Where explosives, explosive dusts, flammable vapors or flammable liquids exist, the hazard of static sparks from shafting shall be carefully considered.

(3) *Bearings.* Bearings shall be kept in alignment and properly adjusted.

(4) *Hangers.* Hangers shall be inspected to make certain that all supporting bolts and screws are tight and that supports of hanger boxes are adjusted properly.

(5) *Pulleys.* (i) Pulleys shall be kept in proper alignment to prevent belts from running off.

(ii) One or both pulleys carrying a nonshifting belt should have crowned faces.

(iii) Cast-iron pulleys should be tested frequently with a hammer to disclose cracks in rim or spokes. It should be borne in mind that the sound is usually much different if the belt is or is not on the pulley.

(iv) Split pulleys should be inspected to ascertain if all bolts holding together the sections of the pulley are tight.

(6) *Care of belts.* (i) Quarter-twist belts when installed without an idler can be used on drives running in one direction only. They will run off a pulley when direction of motion is reversed.

(ii) Inspection shall be made of belts, lacings, and fasteners and such equipment kept in good repair.

(iii) Where possible, dressing should not be applied when belt or rope is in motion; but, if this is necessary, it should be applied where belts or rope leave pulley, not where they approach. The same precautions apply to lubricating chains. In the case of V-belts, belt dressing is neither necessary nor advisable.

(7) *Lubrication.* The regular oilers shall wear tight-fitting clothing and should use cans with long spouts to keep their hands out of danger. Machinery shall be oiled when not in motion, whereever possible.

TABLE O-13—HORIZONTAL OVERHEAD BELTS, ROPES, AND CHAINS 7 FEET OR MORE ABOVE FLOOR OR PLATFORM

	Width			
	From 0" to 14" inclusive	Over 14" to 24" inclusive	Over 24"	Material
MEMBERS				
Framework	1½" x 1½" x ¼"	2" x 2" x 5/16"	3" x 3" x ⅜"	Angle iron.
Filler (belt guards)	1½" x 3/16"	2" x 3/16"	2" x 3/16"	Flat iron.
Filler and vertical side member.	No. 20 A. W. G.	No. 18 A. W. G.	No. A. W. G.	Solid sheet metal.
Filler supports	2" x 5/16" flat iron	2" x ⅜" flat iron	2½" x 2½" x ¼" angle	Flat and angle.
Guard supports	2" x 5/16	2" x ⅜"	2½" x ⅜"	Flat iron.
FASTENINGS				
Filler supports to framework	(2) 3/16"	(2) ¼"	(3) ½"	Rivets.
Filler flats to supports (belt guards).	(1) 3/16"	(1) 5/16"	(2) ⅜"	Flush rivets.
Filler to frame and supports (chain guards).	3/16" rivets spaced	8" centers on sides and 4" centers on bottom.		
Guard supports to frame work.	(2) ⅜"	(2) 7/16"	(2) ⅝"	Rivets or bolts.
Guard and supports to overhead ceiling.	¼" x 3½" lag screws or ½" bolts.	⅜" x 4" lag screws or ⅝" bolts.	¾" x 6" lag screws or ¾" bolts.	Lag screws or bolts.
DETAILS—SPACING, ETC.				
Width of guards	One-quarter wider than belt, rope, or chain drive.			
Spacing between filler supports.	20" C. to C.	16" C. to C.	16" C. to C.	
Spacing between filler flats (belt guards).	2" apart	2½" apart	4" apart	
Spacing between guard supports.	36" C. to C.	36" C. to C.	36" C. to C.	
OTHER BELT GUARD FILLING PERMITTED				
Sheet metal fastened as in chain guards.	No. 20 A. W. G.	No. 18 A. W. G.	No. 18 A. W. G.	Solid or perforated.
Woven wire, 2" mesh	No. 12 A. W. G.	No. 10 A. W. G.	No. 8 A. W. G.	
CLEARANCE FROM OUTSIDE OF BELT, ROPE, OR CHAIN DRIVE TO GUARD				
Distance center to center of shafts.	Up to 15' inclusive	Over 15' to 25' inclusive.	Over 25' to 40' inclusive.	Over 40'.
Clearance from belt, or chain to guard.	6"	10"	15"	20".

§ 1910.220 Additional delay in effective date.

The requirements of this Subpart O shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart upon the commencement of the Walsh-Healey requirement.

§ 1910.221 Sources of standards.

The standards contained in this Subpart O are derived from the following sources:

Standard	*Source*
§ 1910.212	41 CFR 50–204.5.
§ 1910.213	AMCI 01.1–1954–(R 1961), Safety Code for Woodworking Machinery.
§ 1910.214	ANSI 01.1–1954–(R 1961), Safety Code for Woodworking Machinery.
§ 1910.215	ANSI B 7.1–1970, Safety Code for Abrasive Wheels.
§ 1910.216	ANSI B 28.1–1967, Saftey Code for Mills Calenders in the Rubber and Plastic Industries.
§ 1910.217	ANSI B 11.1–1970, Safety Standard for Construction Care and Use of Mechanical Power Presses.
§ 1910.218	ANSI B 24.1, 1970 Safety Standard for Forging.
§ 1910.219	ANSI B 15.1–1953–(R 1958) Safety Code for Mechanical Power Transmission Apparatus

§ 1910.222 Standards organizations.

The standards and specifications of the following organizations have been referenced in this Subpart O: Copies of the references materials may be obtained from the issuing organizations

1. American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.
2. American Society of Mechanical Engineers. 345 East 47 Street, New York, NY 10017.

Subpart P—Hand and Portable Powered Tools and Other Hand-Held Equipment

§ 1910.241 Definitions.

As used in this subpart:

(a) *Explosive-actuated fastening tool terms*—(1) *Hammer-operated piston tool—low-velocity type.* A tool which, by means of a heavy mass hammer supplemented by a load, moves a piston designed to be captive to drive a stud, pin, or fastener into a work surface, always starting the fastener at rest and in contact with the work surface. It shall be so designed that when used with any load that accurately chambers in it and that is commercially available at the time the tool is submitted for approval, it will not cause such stud, pin, or fastener to have a mean velocity in excess of 300 feet per second when measured 6.5 feet from the muzzle end of the barrel.

(2) *High-velocity tool.* A tool or machine which, when used with a load, propels or discharges a stud, pin, or fastener, at velocities in excess of 300 feet per second when measured 6.5 feet from the muzzle end of the barrel, for the purpose of impinging it upon, affixing it to, or penetrating another object or material.

(3) *Low-velocity piston tool.* A tool that utilizes a piston designed to be captive to drive a stud, pin, or fastener into a work surface. It shall be so designed that when used with any load that accurately chambers in it and that is commercially available at the time the tool is submitted for approval, it will not cause such stud, pin, or fastener to have a mean velocity in excess of 300 feet per second when measured 6.5 feet from the muzzle end of the barrel.

(4) *Stud, pin, or fastener.* A fastening device specifically designed and manufactured for use in explosive-actuated fastening tools.

(5) *To chamber.* To fit properly without the use of excess force, the case being duly supported.

(6) *Explosive powerload, also known as load.* Any substance in any form capable of producing a propellant force.

(7) *Tool.* An explosive-actuated fastening tool, unless otherwise indicated, and all accessories pertaining thereto.

(8) *Protective shield or guard.* A device or guard attached to the muzzle end of the tool, which is designed to confine flying particles.

(b) *Abrasive wheel terms*—(1) *Mounted wheels.* Mounted wheels, usually 2-inch diameter or smaller, and of various shapes, may be either organic or inorganic bonded abrasive wheels. They are secured to plain or threaded steel mandrels.

(2) *Tuck pointing.* Removal, by grinding, of cement, mortar, or other nonmetallic jointing material.

(3) *Tuck pointing wheels.* Tuck pointing wheels, usually Type 1, reinforced organic bonded wheels have diameter, thickness and hole size dimension. They are subject to the same limitations of use and mounting as Type 1 wheels defined in subparagraph (10) of this paragraph.

LIMITATION: Wheels used for tuck pointing should be reinforced, organic bonded. (See § 1910.243(C)(1).)

(4) *Portable grinding.* A grinding operation where the grinding machine is designed to be hand held and may be easily moved from one location to another.

(5) *Organic bonded wheels.* Organic wheels are wheels which are bonded by means of an organic material such as resin, rubber, shellac, or other similar bonding agent.

(6) *Safety guard.* A safety guard is an enclosure designed to restrain the pieces of the grinding wheel and furnish all possible protection in the event that the wheel is broken in operation.

(7) *Reinforced wheels.* The term "reinforced" as applied to grinding wheels shall define a class of organic wheels which contain strengthening fabric or filament. The term "reinforced" does not cover wheels using such mechanical additions as steel rings, steel cup backs or wire or tape winding.

(8) *Type 11 flaring cup wheels.* Type 11 flaring cup wheels have double diameter dimensions D and J, and in addition have thickness, hole size, rim and back thickness dimensions. Grinding is always performed on rim face, W dimension. Type 11 wheels are subject to all limitations of use and mounting listed for Type 6 straight sided cup wheels definition in subparagraph (9) of this paragraph.

LIMITATION: Minimum back thickness, E dimension, should not be less than one-fourth T dimension. In addition when unthreaded hole wheels are specified the inside flat, K dimension, shall be large enough to accommodate a suitable flange.

TYPE 11 FLARING CUP WHEELS

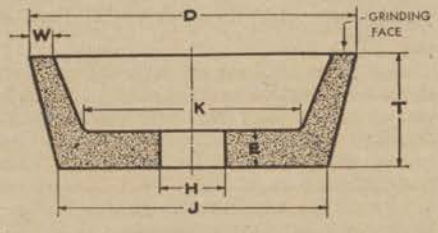

Figure P-1

Type 11 — Flaring-cup Wheel
Side grinding wheel having a wall flared or tapered outward from the back. Wall thickness at the back is normally greater than at the grinding face (W).

(9) *Type 6 straight cup wheels.* Type 6 cup wheels have diameter, thickness, hole size, rim thickness, and back thickness dimensions. Grinding is always performed on rim face, W dimension.

LIMITATION: Minimum back thickness, E dimension, should not be less than one-fourth T dimension. In addition, when unthreaded hole wheels are specified, the inside flat, K dimension, must be large enough to accommodate a suitable flange.

TYPE 6 STRAIGHT CUP WHEELS

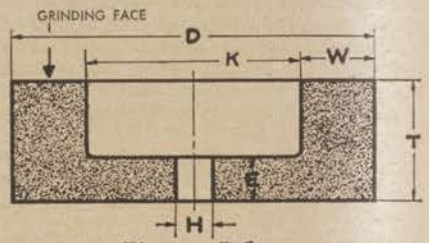

Figure P-2

Type 6 — Straight-cup Wheel
Side grinding wheel having a diameter, thickness and hole with one side straight or flat and the opposite side recessed. This type, however, differs from Type 5 in that the grinding is performed on the wall of the abrasive created by the difference between the diameter of the recess and the outside diameter of the wheel. Therefore, the wall dimension "W" takes precedence over the diameter of the recess as an essential intermediate dimension to describe this shape type.

(10) *Type 1 straight wheels.* Type 1 straight wheels have diameter, thickness, and hole size dimensions and should be used only on the periphery. Type 1 wheels shall be mounted between flanges.

LIMITATION: Hole dimension (H) should not be greater than two-thirds of wheel diameter dimension (D) for precision, cylindrical, centerless, or surface grinding applications. Maximum hole size for all other applications should not exceed one-half wheel diameter.

TYPE 1 STRAIGHT WHEELS



Figure P-3

Type 1 — Straight Wheel
Peripheral grinding wheel having a diameter, thickness and hole.

(c) *Power lawnmower terms*—(1) *Blade tip circle.* The path described by the outermost point of the blade as it is rotated about its shaft axis.

(2) *Guards.* A part or an assembly provided for shielding a hazardous area of a machine.

(3) *Catcher assemblies.* Parts or combinations of parts which provide a means for collecting grass clippings or debris.

(4) *Walk-behind mower.* A mower either pushed or self-propelled and normally guided by the operator walking behind the unit.

(5) *Operator area, walk-behind mowers.* For discharge interference purposes, that area confined within a circle no smaller than 30 inches in diameter, the center of which is located to the rear of the mower on its longitudinal centerline 30 inches behind the nearest blade tip circle.

(6) *Power reel mower.* A lawn-cutting machine utilizing a power source to rotate one or more helically formed blades about a horizontal axis to provide a

shearing action with a stationary cutter bar or bed knife.

(7) *Power rotary mower.* A lawn-cutting machine utilizing a power source to rotate one or more cutting blades about a vertical axis.

(8) *Lowest blade position.* The lowest blade position under static conditions.

(9) *Riding mower.* A powered, self-propelled lawn-cutting vehicle on which the operator rides and controls the machine.

(10) *Sulky type mower.* Normally, a walk-behind mower which has been converted to a riding mower by the addition of a sulky.

(11) *Deadman control.* A control designed so that it will automatically interrupt power to a drive when the operator's actuating force is removed.

(d) *Jack terms*—(1) *Jack.* A jack is an appliance for lifting and lowering or moving horizontally a load by application of a pushing force.

NOTE: Jacks may be of the following types: Lever and ratchet, screw and hydraulic.

(2) *Rating.* The rating of a jack is the maximum working load for which it is designed to lift safely that load throughout its specified amount of travel.

NOTE: To raise the rated load of a jack, the point of application of the load, the applied force, and the length of lever arm should be those designated by the manufacturer for the particular jack considered.

§ 1910.242 Hand and portable powered tools and equipment, general.

(a) *General requirements.* Each employer shall be responsible for the safe condition of tools and equipment used by employees, including tools and equipment which may be furnished by employees.

(b) *Compressed air used for cleaning.* Compressed air shall not be used for cleaning purposes except where reduced to less than 30 p.s.i. and then only with effective chip guarding and personal protective equipment.

(c) *Modification and procurement of safety equipment.* As applicable, a period up to 180 days after the effective date of these regulations is allowed for procurement of new protective devices and equipment or for substantial modification of existing equipment to meet the requirements of this subpart.

§ 1910.243 Guarding of portable powered tools.

(a) *Woodworking, portable powered tools*—(1) *Portable circular saws.* All portable, power-driven saws shall be equipped with guards above and below the base plate or shoe. The upper guard shall cover the saw to the depth of the teeth, except for the minimum arc required to permit the base to be tilted for bevel cuts. The lower guard shall cover the saw to the depth of the teeth, except for the minimum arc required to allow proper retraction and contact with the work. When the tool is withdrawn from the work, the lower guard shall automatically and instantly return to covering position.

(2) *"Dead man" controls.* Hand-held, power-driven woodworking tools shall be provided with "dead man" control, such as a spring-actuated switch, valve, or equivalent device, so that the power will be automatically shut off whenever the operator releases the control.

(3) *Portable belt sanding machines.* Belt sanding machines shall be provided with guards at each nip point where the sanding belt runs onto a pulley. These guards shall effectively prevent the hands or fingers of the operator from coming in contact with the nip points. The unused run of the sanding belt shall be guarded against accidental contact.

(4) *Cracked saws.* All cracked saws shall be removed from service.

(5) *Grounding.* Electrical grounding requirements for portable woodworking machinery see Subpart O, § 1910.213(a)(11).

(b) *Pneumatic powered tools and hose*—(1) *Portable tools.* (i) The operating trigger on portable hand-operated utilization equipment shall be so located as to minimize the possibility of its accidental operation and shall be arranged to close the air inlet valve automatically when the pressure of the operator's hand is removed.

(ii) A tool retainer shall be installed on each piece of utilization equipment which, without such a retainer, may eject the tool.

(2) *Airhose.* Hose and hose connections used for conducting compressed air to utilization equipment shall be designed for the pressure and service to which they are subjected.

(c) *Portable abrasive wheels*—(1) *General requirements.* (i) All abrasive wheels shall be used only on machines provided with Safety Guards as defined in the following paragraphs of this section.

EXCEPTIONS: This requirement shall not apply to the following classes of wheels and conditions.

(*a*) Wheels used for internal work while within the work being ground.

(*b*) Mounted wheels used in portable operations (see definition § 1910.241(b)(1)) 2 inches and smaller in diameter.

(*c*) Types 16, 17, 18, 18R, and 19 cones and plugs and threaded hole pot balls where the work offers protection.

(ii) (*a*) The safety guard shall cover the spindle end, nut, and flange projections. The safety guard shall be mounted so as to maintain proper alignment with the wheel, and the strength of the fastenings shall exceed the strength of the guard.

(*b*) Exception: Safety guards on all operations where the work provides a suitable measure of protection to the operator, may be so constructed that the spindle end, nut, and outer flange are exposed; and where the nature of the work is such as to entirely cover the side of the wheel, the side covers of the guard may be omitted.

(*c*) Exception: The spindle end, nut, and outer flange may be exposed on machines designed as portable saws.

(2) *Cup wheels.* Cup wheels (Types 6 and 11) shall be protected by:

(i) Safety guards as specified in subparagraph (1) of this paragraph; or,

(ii) Special "revolving cup guards" which mount behind the wheel and turn with it. They shall be made of steel or other material with adequate strength and shall enclose the wheel sides upward from the back for one-third of the wheel thickness. The mounting features shall conform with all regulations. (See subparagraph (5) of this paragraph.) It is necessary to maintain clearance between the wheel side and the guard. The clearance shall not exceed one-sixteenth inch; or,

(iii) Some other form of guard that will insure as good protection as that which would be provided by the guards specified in subdivision (i) or (ii) of this subparagraph.

(3) *Vertical portable grinders.* Safety guards used on machines known as right angle head or vertical portable grinders shall have a maximum exposure angle of 180°, and the guard shall be so located so as to be between the operator and the wheel during use. Adjustment of guard shall be such that pieces of an accidentally broken wheel will be deflected away from the operator. (See Figure P–4.)

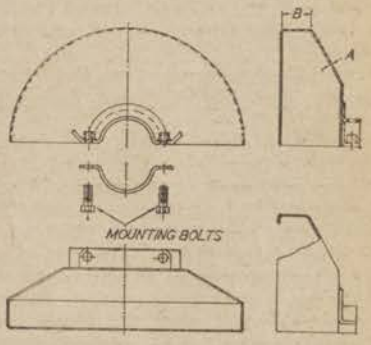

FIGURE NO. P-4

(4) *Other portable grinders.* The maximum angular exposure of the grinding wheel periphery and sides for safety guards used on other portable grinding machines shall not exceed 180° and the top half of the wheel shall be enclosed at all times. (See Figures P–5 and P–6.)

FIGURE NO. P-5

FIGURE NO. P-6

(5) *Mounting and inspection of abrasive wheels.* (i) Immediately before mounting, all wheels shall be closely inspected and sounded by the user (ring test, see Subpart O, § 1910.215(d)) to make sure they have not been damaged in transit, storage, or otherwise. The spindle speed of the machine shall be checked before mounting of the wheel to be certain that it does not exceed the maximum operating speed marked on the wheel.

(ii) Grinding wheels shall fit freely on the spindle and remain free under all grinding conditions. A controlled clearance between the wheel hole and the machine spindle (or wheel sleeves or adaptors) is essential to avoid excessive pressure from mounting and spindle expansion. To accomplish this, the machine spindle shall be made to nominal (standard) size plus zero minus .002 inch, and the wheel hole shall be made suitably oversize to assure safety clearance under the conditions of operating heat and pressure.

(iii) All contact surfaces of wheels, blotters, and flangers shall be flat and free of foreign matter.

(iv) When a bushing is used in the wheel hole it shall not exceed the width of the wheel and shall not contact the flanges.

(v) Requirements for the use of flanges and blotters, see Subpart O, § 1910.215(c).

(d) *Explosive actuated fastening tools*—(1) *General requirements.* (i) Explosive-actuated fastening tools which are actuated by explosives or any similar means and propel a stud, pin, fastener, or other object for the purpose of affixing it by penetration to any other object shall meet the design requirements in "American National Standard Safety Requirements for Explosive-Actuated Fastening Tools," ANSI A10.3–1970. This requirement does not apply to devices designed for attaching objects to soft construction materials, such as wood, plaster, tar, dry wallboard, and the like, or to stud welding equipment.

(ii) Operators and assistants using tools shall be safeguarded by means of eye protection. Head and face protection shall be used, as required by working conditions, as set forth in Subpart I.

(2) *Inspection, maintenance, and tool handling*—(i) *High-velocity tools.* Tools of this type shall have the characteristics outlined in (*a*) through (*h*) of this subdivision and, at the discretion of the manufacturer, any additional safety features he may wish to incorporate.

(*a*) The muzzle end of the tool shall have a protective shield or guard at least 3½ inches in diameter, mounted perpendicular to and concentric with the barrel, and designed to confine any flying fragments of particles that might otherwise create a hazard at the time of firing.

(*b*) Where a standard shield or guard cannot be used, or where it does not cover all apparent avenues through which flying particles might escape, a special shield, guard, fixture, or jig designed and built by the manufacturer of the tool being used, which provides this degree of protection, shall be used as a substitute.

(*c*) The tool shall be so designed that it cannot be fired unless it is equipped with a standard protective shield or guard, or a special shield, guard, fixture, or jig.

(*d*) (*1*) The firing mechanism shall be so designed that it cannot fire during loading or preparation to fire, or if the tool should be dropped while loaded.

(*2*) Firing of the tool shall be dependent upon at least two separate and distinct operations of the operator, with the final firing movement being separate from the operation of bringing the tool into the firing position.

(*e*) The tool shall be so designed as not to be operable other than against a work surface, and unless the operator is holding the tool against the work surface with a force at least 5 pounds greater than the total weight of the tool.

(*f*) The tool shall be so designed that it will not operate when equipped with the standard guard indexed to the center position if any bearing surface of the guard is tilted more than 8° from contact with the work surface.

(*g*) The tool shall be so designed that positive means of varying the power are available or can be made available to the operator as part of the tool, or as an auxiliary, in order to make it possible for the operator to select a power level adequate to perform the desired work without excessive force.

(*h*) The tool shall be so designed that all breeching parts will be reasonably visible to allow a check for any foreign matter that may be present.

(ii) Tools of the low-velocity-piston type shall have the characteristics outlined in (*a*) through (*e*) of this subdivision and, at the discretion of the manufacturer, any additional safety features he may wish to incorporate.

(*a*) The muzzle end of the tool shall be designed so that suitable protective shields, guards, jigs, or fixtures, designed and built by the manufacturer of the tool being used, can be mounted perpendicular to the barrel. A standard spall shield shall be supplied with each tool.

(*b*) (*1*) The tool shall be so designed so that it shall not in ordinary usage propel or discharge a stud, pin, or fastener while loading or during preparation to fire, or if the tool should be dropped while loaded.

(*2*) Firing of the tool shall be dependent upon at least two separate and distinct operations of the operator, with the final firing movement being separate from the operation of bringing the tool into the firing position.

(*c*) The tool shall be so designed as not to be operable other than against a work surface, and unless the operator is holding the tool against the work surface with a force at least 5 pounds greater than the total weight of the tool.

(*d*) The tool shall be so designed that positive means of varying the power are available or can be made available to the operator as part of the tool, or as an auxiliary, in order to make it possible for the operator to select a power level adequate to perform the desired work without excessive force.

(*e*) The tool shall be so designed that all breeching parts will be reasonably visible to allow a check for any foreign matter that may be present.

(iii) Tools of the hammer-operated piston tools—low-velocity type shall have the characteristics outlined in (*a*) through (*e*) of this subdivision and, at the discretion of the manufacturer, any additional safety features he may wish to incorporate.

(*a*) The muzzle end of the tool shall be so designed that suitable protective shields, guards, jigs, or fixtures, designed and built by the manufacturer of the tool being used, can be mounted perpendicular to the barrel. A standard spall shield shall be supplied with each tool.

(*b*) The tool shall be so designed that it shall not in ordinary usage propel or discharge a stud, pin, or fastener while loading, or during preparation to fire, or if the tool should be dropped while loaded.

(*c*) Firing of the tool shall be dependent upon at least two separate and distinct operations of the operator, with the final firing movement being separate from the operation of bringing the tool into the firing position.

(*d*) The tool shall be so designed that positive means of varying the power are available or can be made available to the operator as part of the tool, or as an auxiliary, in order to make it possible for the operator to select a power level adequate to perform the desired work without excessive force.

(*e*) The tool shall be so designed that all breeching parts will be reasonably visible to allow a check for any foreign matter that may be present.

(3) *Requirements for loads and fasteners.* (i) There shall be a standard means of identifying the power levels of loads used in tools. Such means of identification shall be a uniform color and numbering system, as shown in Table P–1. Colors and printed descriptions shall be strikingly printed on the container to provide a visual indication of the power level of the load.

(ii) Caseless loads shall be coded to identify similar powerload levels by color, number, configuration, or other appropriate method.

TABLE P-1—IDENTIFICATION OF CASED LOADS

Power level	Color identification		Nominal velocity (=45 f.p.s)
	Case color	Load color	
1	Brass	Gray	300
2	Brass	Brown	390
3	Brass	Green	480
4	Brass	Yellow	570
5	Brass	Red	660
6	Brass	Purple	750
7	Nickel	Gray	840
8	Nickel	Brown	930
9	Nickel	Green	1,020
10	Nickel	Yellow	1,110
11	Nickel	Red	1,200
12	Nickel	Purple	1,290

NOTE: The nominal velocity applies to ¾-inch diameter 350-grain ballistic slug fired in a test device and has no reference to actual fastener velocity developed in any specific size or type of tool.

(iii) No load (cased or caseless) shall be used if it will accurately chamber in any existing approved commercially

available low-velocity piston tool or hammer operated piston tool—low-velocity type and will cause a fastener to have a mean velocity in excess of 300 feet per second when measured 6.5 feet from the muzzle end of the barrel. No individual test firing of a series shall exceed 300 feet per second by more than 8 percent.

(iv) Fasteners used in tools shall be only those specifically manufactured for use in such tools.

(4) *Operating requirements.* (i) Before using a tool the operator shall inspect it to determine to his satisfaction that it is clean, that all moving parts operate freely, and that the barrel is free from obstructions.

(ii) When a tool develops a defect during use the operator shall immediately cease to use it, until it is properly repaired.

(iii) Tools shall not be loaded until just prior to the intended firing time. Neither loaded nor empty tools are to be pointed at any workmen, and hands should be kept clear of the open barrel end.

(iv) No tools shall be loaded unless being prepared for immediate use, nor shall an unattended tool be left loaded.

(v) In case of a misfire, the operator shall hold the tool in the operating position for at least 30 seconds. He shall then try to operate the tool a second time. He shall wait another 30 seconds, holding the tool in the operating position; then he shall proceed to remove the explosive load in strict accordance with the manufacturer's instructions. Misfired cartridges should be placed carefully in a metal container filled with water, and returned to the supervisor for disposal.

(vi) A tool shall never be left unattended in a place where it would be available to unauthorized persons.

(vii) Fasteners shall not be driven into very hard or brittle materials including, but not limited to, cast iron, glazed tile, surface-hardened steel, glass block, live rock, face brick, or hollow tile.

(viii) Driving into materials easily penetrated shall be avoided unless such materials are back by a substance that will prevent the pin or fastener from passing completely through and creating a flying-missile hazard on the other side.

(ix) (*a*) Fasteners shall not be driven directly into materials such as brick or concrete closer than 3 inches from the unsupported edge or corner, or into steel surfaces closer than one-half inch from the unsupported edge or corner, unless a special guard, fixture, or jig is used. (Exception: Low-velocity tools may drive no closer than 2 inches from an edge in concrete or one-fourth inch in steel.)

(*b*) When fastening other materials, such as a 2- by 4-inch wood section to a concrete surface, it is permissible to drive a fastener of no greater than 7/32-inch shank diameter not closer than 2 inches from the unsupported edge or corner of the work surface.

(x) Fasteners shall not be driven through existing holes unless a positive guide is used to secure accurate alignment.

(xi) No fastener shall be driven into a spalled area caused by an unsatisfactory fastening.

(xii) Tools shall not be used in an explosive or flammable atmosphere.

(xiii) All tools shall be used with the correct shield, guard, or attachment recommended by the manufacturer.

(xiv) Any tool found not in proper working order shall be immediately removed from service. The tool shall be inspected at regular intervals and shall be repaired in accordance with the manufacturer's specifications.

(e) *Power lawnmowers*—(1) *General requirements.* (i) Power lawnmowers of the walk-behind, riding-rotary, and reel power lawnmowers designed for sale to the general public shall meet the design specifications in "American National Standard Safety Specifications for Power Lawnmowers" ANSI B71.1–1968. These specifications do not apply to sulky-type mowers, flail mowers, sicklebar mowers, or mowers designs for commercial use.

(ii) All power-driven chains, belts, and gears shall be so positioned or otherwise guarded to prevent the operator's accidental contact therewith, during normal starting, mounting, and operation of the machine.

(iii) A shutoff device shall be provided to stop operation of the motor or engine. This device shall require manual and intentional reactivation to restart the motor or engine.

(iv) All positions of the operating controls shall be clearly identified.

(v) The words, "Caution. Be sure the operating control(s) is in neutral before starting the engine," or similar wording shall be clearly visible at an engine starting control point on self-propelled mowers.

(2) *Walk-behind and riding rotary mowers.* (i) The mower blade shall be enclosed except on the bottom and the enclosure shall extend to or below the lowest cutting point of the blade in the lowest blade position.

(ii) Guards which must be removed to install a catcher assembly shall comply with the following:

(*a*) Warning instructions shall be affixed to the mower near the opening stating that the mower shall not be used without either the catcher assembly or the guard in place.

(*b*) The catcher assembly or the guard shall be shipped and sold as part of the mower.

(*c*) The instruction manual shall state that the mower shall not be used without either the catcher assembly or the guard in place.

(*d*) The catcher assembly, when properly and completely installed, shall not create a condition which violates the limits given for the guarded opening.

(iii) Openings in the blade enclosure, intended for the discharge of grass, shall be limited to a maximum vertical angle of the opening of 30°. Measurements shall be taken from the lowest blade position.

(iv) The total effective opening area of the grass discharge opening(s) shall not exceed 1,000 square degrees on units having a width of cut less than 27½ inches, or 2,000 square degrees on units having a width of cut 27½ inches or over.

(v) The word "Caution." or stronger wording, shall be placed on the mower at or near each discharge opening.

(vi) Wheel drive disengaging controls, except dead-man controls, shall move opposite to the direction of vehicle motion in order to disengage the drive. Dead-man controls shall comply with § 1910.241(c)(11), and may operate in any direction to disengage the drive.

(vii) Blade(s) shall stop rotating from the manufacturer's specified maximum speed within 15 seconds after declutching, or shutting off power.

(viii) In a multipiece blade, the means of fastening the cutting members to the body of the blade or disc shall be so designed that they will not become worn to a hazardous condition before the cutting members themselves are worn beyond use.

(ix) The maximum tip speed of any blade shall be 19,000 feet per minute.

(3) *Walk-behind rotary mowers.* (i) The horizontal angle of the opening(s) in the blade enclosure, intended for the discharge of grass, shall not contact the operator area.

(ii) There shall be one of the following at all openings in the blade enclosure intended for the discharge of grass:

(*a*) A minimum unobstructed horizontal distance of 3 inches from the end of the discharge chute to the blade tip circle.

(*b*) A rigid bar fastened across the discharge opening, secured to prevent removal without the use of tools. The bottom of the bar shall be no higher than the bottom edge of the blade enclosure.

(iii) The highest point(s) on the front of the blade enclosure, except discharge openings, shall be such that any line extending a maximum of 15° downward from the horizontal toward the blade shaft axis (axes) shall not intersect the horizontal plane within the blade tip circle. The highest point(s) on the blade enclosure, front, except discharge openings, shall not exceed 1¼ inches above the lowest blade position. Mowers with a swing-over handle are to be considered as having no front in the blade enclosure and therefore shall comply with subparagraph (2)(i) of this paragraph.

(iv) The mower handle shall be fastened to the mower so as to prevent loss of control by unintentional uncoupling while in operation.

(v) A positive upstop or latch shall be provided for the mower handle in the normal operating position(s). The upstop shall not be subject to unintentional disengagement during normal operation of the mower. The upstop or latch shall not allow the center or the handle grips to come closer than 17 inches horizontally behind the closest path of the mower blade(s) unless manually disengaged.

(vi) A swing-over handle, which complies with the above requirements, will be permitted.

(4) *Riding rotary mowers.* (i) The highest point(s) of all openings in the blade enclosure, front shall be limited by

a vertical angle of opening of 15° and a maximum distance of 1¼ inches above the lowest cutting point of the blade in the lowest blade position.

(ii) Opening(s) shall be placed so that grass or debris will not discharge directly toward any part of an operator seated in a normal operator position.

(iii) There shall be one of the following at all openings in the blade enclosure intended for the discharge of grass:

(*a*) A minimum unobstructed horizontal distance of 6 inches from the end of the discharge chute to the blade tip circle.

(*b*) A rigid bar fastened across the discharge opening, secured to prevent removal without the use of tools. The bottom of the bar shall be no higher than the bottom edge of the blade enclosure.

(iv) Mowers shall be provided with stops to prevent jackknifing or locking of the steering mechanism.

(v) Vehicle stopping means shall be provided.

(vi) Hand-operated wheel drive shall move opposite to the direction of vehicle motion in order to disengage the drive. Foot-operated wheel drive disengaging controls shall be depressed to disengage the drive. Dead-man controls, both hand and foot operated, shall comply with § 1910.241(c)(ii) and may operate in any direction to disengage the drive.

§ 1910.244 Other portable tools and equipment.

(a) *Jacks*—(1) *Loading and marking.* (i) The operator shall make sure that the jack used has a rating sufficient to lift and sustain the load.

(ii) The rated loss shall be legibly and permanently marked in a prominent location on the jack by casting, stamping, or other suitable means.

(2) *Operation and maintenance.* (i) In the absence of a firm foundation, the base of the jack shall be blocked. If there is a possibility of slippage of the cap, a block shall be placed in between the cap and the load.

(ii) The operator shall watch the stop indicator, which shall be kept clean, in order to determine the limit of travel. The indicated limit shall not be overrun.

(iii) After the load has been raised, it shall be cribbed, blocked, or otherwise secured at once.

(iv) Hydraulic jacks exposed to freezing temperatures shall be supplied with an adequate antifreeze liquid.

(v) All jacks shall be properly lubricated at regular intervals. The lubricating instructions of the manufacturer should be followed, and only lubricants recommended by him should be used.

(vi) Each jack shall be thoroughly inspected at times which depend upon the service conditions. Inspections shall be not less frequent than the following:

(*a*) For constant or intermittent use at one locality, once every 6 months,

(*b*) For jacks sent out of shop for special work, when sent out and when returned,

(*c*) For a jack subjected to abnormal load or shock, immediately before and immediately thereafter.

(vii) Repair or replacement parts shall be examined for possible defects.

(viii) Jacks which are out of order shall be tagged accordingly, and shall not be used until repairs are made.

(b) *Abrasive blast cleaning nozzles.* The blast cleaning nozzles shall be equipped with an operating valve which must be held open manually. A support shall be provided on which the nozzle may be mounted when it is not in use.

§ 1910.245 Additional delay in effective date.

The requirements of this Subpart P shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this subpart. In which event, the standard shall be effective under this subpart upon the commencement of the Walsh-Healey requirement.

§ 1910.246 Sources of standards.

Sec.	*Source*
1910.241(a)	ANSI A10.3 (1970), Safety Requirements for explosive actuated fastening tools.
1910.241(b)	ANSI B7.1–1970, Safety Code for the use, care, and protection of abrasive wheels.
1910.241(c)	ANSI B71.1–1968, Safety Specifications for power lawn mowers.
1910.241(d)	ANSI B30.1–1943. Safety Code for jacks.
1910.242	41 CFR 50–204.4 and 50–204.8.
1910.243(a)	ANSI O1.1–1954 (R1961), Safety Code for woodworking machines.
1910.243(b)	ANSI B19.1–1938, Compressed Air Machinery and Equipment.
1910.243(c)	ANSI B7.1–1970, Safety Code for Abrasive Materials.
1910.243(d)	ANSI 10.3–1970, Explosive Actuated Fastening Tools.
1910.243(e)	ANSI, BF1–1968, Safety Specifications for Power Lawn Mowers.
1910.244(a)	ANSI B30.1–1943 (R1952), Safety Code for Jacks.
1910.244(b)	ANSI Z9.4–1968, Ventilation and Safe Practices of Abrasive Blasting Operations.

§ 1910.247 Standards organizations.

Specific standards of the following organization have been referenced in this subpart. Copies of the referenced materials may be obtained from the issuing organization.

American National Standards Institute, 1430 Broadway, New York, N.Y. 10018.

Subpart Q—Welding, Cutting, and Brazing

§ 1910.251 Definitions.

As used in this subpart:

(a) "Welder" and "welding operator" mean any operator of electric or gas welding and cutting equipment.

(b) "Approved" means listed or approved by a nationally recognized testing laboratory, such as Factory Mutual Engineering Corp., or Underwriters' Laboratories, Inc.

(c) All other welding terms are used in accordance with American Welding Society—Terms and Definitions—A3.0–1969.

§ 1910.252 Welding, cutting, and brazing.

(a) *Installation and operation of oxygen-fuel gas systems for welding and cutting*—(1) *General requirements.* (i) *Flammable mixture.* Mixtures of fuel gases and air or oxygen may be explosive and shall be guarded against. No device or attachment facilitating or permitting mixtures of air or oxygen with flammable gases prior to consumption, except at the burner or in a standard torch, shall be allowed unless approved for the purpose.

(ii) *Maximum pressure.* Under no condition shall acetylene be generated, piped (except in approved cylinder manifolds) or utilized at a pressure in excess of 15 p.s.i. gage pressure or 30 p.s.i. absolute pressure. (The 30 p.s.i. absolute pressure limit is intended to prevent unsafe use of acetylene in pressurized chambers such as caissons, underground excavations or tunnel construction.) This requirement is not intended to apply to storage of acetylene dissolved in a suitable solvent in cylinders manufactured and maintained according to U.S. Department of Transportation requirements, or to acetylene for chemical use. The use of liquid acetylene shall be prohibited.

(iii) *Apparatus.* Only approved apparatus such as torches, regulators or pressure-reducing valves, acetylene generators, and manifolds shall be used.

(iv) *Personnel.* Workmen in charge of the oxygen or fuel-gas supply equipment, including generators, and oxygen or fuel-gas distribution piping systems shall be instructed and judged competent by their employers for this important work before being left in charge. Rules and instructions covering the operation and maintenance of oxygen or fuel-gas supply equipment including generators, and oxygen or fuel-gas distribution piping systems shall be readily available.

(2) *Cylinders and containers*—(i) *Approval and marking.* (*a*) All portable cylinders used for the storage and shipment of compressed gases shall be constructed and maintained in accordance with the regulations of the U.S. Department of Transportation, 49 CFR Parts 171–179.

(*b*) Compressed gas cylinders shall be legibly marked, for the purpose of identifying the gas content, with either the chemical or the trade name of the gas. Such marking shall be by means of stenciling, stamping, or labeling, and shall not be readily removable. Whenever practical, the marking shall be located on the shoulder of the cylinder. This method conforms to the American National Standard Method for Marking Portable Compressed Gas Containers to Identify the Material Contained, ANSI Z48.1–1954.

(*c*) Compressed gas cylinders shall be equipped with connections complying with the American National Standard

Compressed Gas Cylinder Valve Outlet and Inlet Connections, ANSI B57.1–1965.

(*d*) All cylinders with a water weight capacity of over 30 pounds shall be equipped with means of connecting a valve protection cap or with a collar or recess to protect the valve.

(ii) *Storage of cylinders—general.* (*a*) Cylinders shall be kept away from radiators and other sources of heat.

(*b*) Inside of buildings, cylinders shall be stored in a well-protected, well-ventilated, dry location, at least 20 feet from highly combustible materials such as oil or excelsior. Cylinders should be stored in definitely assigned places away from elevators, stairs, or gangways. Assigned storage spaces shall be located where cylinders will not be knocked over or damaged by passing or falling objects, or subject to tampering by unauthorized persons. Cylinders shall not be kept in unventilated enclosures such as lockers and cupboards.

(*c*) Empty cylinders shall have their valves closed.

(*d*) Valve protection caps, where cylinder is designed to accept a cap, shall always be in place, hand-tight, except when cylinders are in use or connected for use.

(iii) *Fuel-gas cylinder storage:* Inside a building, cylinders, except those in actual use or attached ready for use, shall be limited to a total gas capacity of 2,000 cubic feet or 300 pounds of liquefied petroleum gas.

(*a*) For storage in excess of 2,000 cubic feet total gas capacity of cylinders or 300 pounds of liquefied petroleum gas, a separate room or compartment conforming to the requirements specified in subparagraphs (*6*) (vi(*a*) (*8*) and (*9*) of this paragraph shall be provided, or cylinders shall be kept outside or in a special building. Special buildings, rooms or compartments shall have no open flame for heating or lighting and shall be well ventilated. They may also be used for storage of calcium carbide in quantities not to exceed 600 pounds, when contained in metal containers complying with subparagraphs (7) (i) (*a*) and (*b*) of this paragraph. Signs should be conspicuously posted in such rooms reading, "Danger—No Smoking, Matches or Open Lights," or other equivalent wording.

(*b*) Acetylene cylinders shall be stored valve end up.

(iv) *Oxygen storage.* (*a*) Oxygen cylinders shall not be stored near highly combustible material, especially oil and grease; or near reserve stocks of carbide and acetylene or other fuel-gas cylinders, or near any other substance likely to cause or accelerate fire; or in an acetylene generator compartment.

(*b*) Oxygen cylinders stored in outside generator houses shall be separated from the generator or carbide storage rooms by a noncombustible partition having a fire-resistance rating of at least 1 hour. This partition shall be without openings and shall be gastight.

(*c*) Oxygen cylinders in storage shall be separated from fuel-gas cylinders or combustible materials (especially oil or grease), a minimum distance of 20 feet or by a noncombustible barrier at least 5 feet high having a fire-resistance rating of at least one-half hour.

(*d*) Where a liquid oxygen system is to be used to supply gaseous oxygen for welding or cutting and the system has a storage capacity of more than 13,000 cubic feet of oxygen (measured at 14.7 p.s.i.a. and 70° F.), connected in service or ready for service, or more than 25,000 cubic feet of oxygen (measured at 14.7 p.s.i.a. and 70° F), including unconnected reserves on hand at the site, it shall comply with the provisions of the Standard for Bulk Oxygen Systems at Consumer Sites, NFPA No. 566–1965.

(v) *Operating procedures.* (*a*) Cylinders, cylinder valves, couplings, regulators, hose, and apparatus shall be kept free from oily or greasy substances. Oxygen cylinders or apparatus shall not be handled with oily hands or gloves. A jet of oxygen must never be permitted to strike an oily surface, greasy clothes, or enter a fuel oil or other storage tank.

(*b*) (*1*) When transporting cylinders by a crane or derrick, a cradle, boat, or suitable platform shall be used. Slings or electric magnets shall not be used for this purpose. Valve-protection caps, where cylinder is designed to accept a cap, shall always be in place.

(*2*) Cylinders shall not be dropped or struck or permitted to strike each other violently.

(*3*) Valve-protection caps shall not be used for lifting cylinders from one vertical position to another. Bars shall not be used under valves or valve-protection caps to pry cylinders loose when frozen to the ground or otherwise fixed; the use of warm (not boiling) water is recommended. Valve-protection caps are designed to protect cylinder valves from damage.

(*4*) Unless cylinders are secured on a special truck, regulators shall be removed and valve-protection caps, when provided for, shall be put in place before cylinders are moved.

(*5*) Cylinders not having fixed hand wheels shall have keys, handles, or nonadjustable wrenches on valve stems while these cylinders are in service. In multiple cylinder installations only one key or handle is required for each manifold.

(*6*) Cylinder valves shall be closed before moving cylinders.

(*7*) Cylinder valves shall be closed when work is finished.

(*8*) Valves of empty cylinders shall be closed.

(*9*) Cylinders shall be kept far enough away from the actual welding or cutting operation so that sparks, hot slag, or flame will not reach them, or fire-resistant shields shall be provided.

(*10*) Cylinders shall not be placed where they might become part of an electric circuit. Contacts with third rails, trolley wires, etc., shall be avoided. Cylinders shall be kept away from radiators, piping systems, layout tables, etc., that may be used for grounding electric circuits such as for arc welding machines. Any practice such as the tapping of an electrode against a cylinder to strike an arc shall be prohibited.

(*11*) Cylinders shall never be used as rollers or supports, whether full or empty.

(*12*) The numbers and markings stamped into cylinders shall not be tampered with.

(*13*) No person, other than the gas supplier, shall attempt to mix gases in a cylinder. No one, except the owner of the cylinder or person authorized by him, shall refill a cylinder.

(*14*) No one shall tamper with safety devices in cylinders or valves.

(*15*) Cylinders shall not be dropped or otherwise roughly handled.

(*16*) Unless connected to a manifold, oxygen from a cylinder shall not be used without first attaching an oxygen regulator to the cylinder valve. Before connecting the regulator to the cylinder valve, the valve shall be opened slightly for an instant and then closed. Always stand to one side of the outlet when opening the cylinder valve.

(*17*) A hammer or wrench shall not be used to open cylinder valves. If valves cannot be opened by hand, the supplier shall be notified.

(*18*) (*i*) Cylinder valves shall not be tampered with nor should any attempt be made to repair them. If trouble is experienced, the supplier should be sent a report promptly indicating the character of the trouble and the cylinder's serial number. Supplier's instructions as to its disposition shall be followed.

(*ii*) Complete removal of the stem from a diaphragm-type cylinder valve shall be avoided.

(*c*) (*1*) Fuel-gas cylinders shall be placed with valve end up whenever they are in use. Liquefied gases shall be stored and shipped with the valve end up.

(*2*) Cylinders shall be handled carefully. Rough handling, knocks, or falls are liable to damage the cylinder, valve or safety devices and cause leakage.

(*3*) Before connecting a regulator to a cylinder valve, the valve shall be opened slightly and closed immediately. The valve shall be opened while standing to one side of the outlet; never in front of it. Never crack a fuel-gas cylinder valve near other welding work or near sparks, flame, or other possible sources of ignition.

(*4*) Before a regulator is removed from a cylinder valve, the cylinder valve shall be closed and the gas released from the regulator.

(*5*) Nothing shall be placed on top of an acetylene cylinder when in use which may damage the safety device or interfere with the quick closing of the valve.

(*6*) If cylinders are found to have leaky valves or fittings which cannot be stopped by closing of the valve, the cylinders shall be taken outdoors away from sources of ignition and slowly emptied.

(*7*) A warning should be placed near cylinders having leaking fuse plugs or other leaking safety devices not to approach them with a lighted cigarette or other source of ignition. Such cylinders should be plainly tagged; the supplier should be promptly notified and his instructions followed as to their return.

(8) Safety devices shall not be tampered with.

(9) Fuel-gas shall never be used from cylinders through torches or other devices equipped with shutoff valves without reducing the pressure through a suitable regulator attached to the cylinder valve or manifold.

(10) The cylinder valve shall always be opened slowly.

(11) An acetylene cylinder valve shall not be opened more than one and one-half turns of the spindle, and preferably no more than three-fourths of a turn.

(12) Where a special wrench is required it shall be left in position on the stem of the valve while the cylinder is in use so that the fuel-gas flow can be quickly turned off in case of emergency. In the case of manifolded or coupled cylinders at least one such wrench shall always be available for immediate use.

(3) *Manifolding of cylinders*—(i) *Fuel-gas manifolds.* (*a*) Manifolds shall be approved either separately for each component part or as an assembled unit.

(*b*) Except as provided in subdivision (*c*) of this subdivision fuel-gas cylinders connected to one manifold inside a building shall be limited to a total capacity not exceeding 300 pounds of liquefied petroleum gas or 3,000 cubic feet of other fuel-gas. More than one such manifold with connected cylinders may be located in the same room provided the manifolds are at least 50 feet apart or separated by a noncombustible barrier at least 5 feet high having a fire-resistance rating of at least one-half hour.

(*c*) Fuel-gas cylinders connected to one manifold having an aggregate capacity exceeding 300 pounds of liquefied petroleum gas or 3,000 cubic feet of other fuel-gas shall be located outdoors, or in a separate building or room constructed in accordance with subparagraphs (6)(vi)(*a*) (8) and (9) of this paragraph.

(*d*) Separate manifold buildings or rooms may also be used for the storage of drums of calcium carbide and cylinders containing fuel gases as provided in subparagraph (2)(iii) of this paragraph. Such buildings or rooms shall have no open flames for heating or lighting and shall be well-ventilated.

(*e*) High-pressure fuel-gas manifolds shall be provided with approved pressure regulating devices.

(ii) *High-pressure oxygen manifolds (for use with cylinders having a Department of Transportation service pressure above 200 p.s.i.g.).* (*a*) Manifolds shall be approved either separately for each component part or as an assembled unit.

(*b*) Oxygen manifolds shall not be located in an acetylene generator room. Oxygen manifolds shall be separated from fuel-gas cylinders or combustible materials (especially oil or grease), a minimum distance of 20 feet or by a noncombustible barrier at least 5 feet high having a fire-resistance rating of at least one-half hour.

(*c*) Except as provided in subdivision (*d*) of this subdivision oxygen cylinders connected to one manifold shall be limited to a total gas capacity of 6,000 cubic feet. More than one such manifold with connected cylinders may be located in the same room provided the manifolds are at least 50 feet apart or separated by a noncombustible barrier at least 5 feet high having a fire-resistance rating of at least one-half hour.

(*d*) An oxygen manifold, to which cylinders having an aggregate capacity of more than 6,000 cubic feet of oxygen are connected, should be located outdoors or in a separate noncombustible building. Such a manifold, if located inside a building having other occupancy, shall be located in a separate room of noncombustible construction having a fire-resistance rating of at least one-half hour or in an area with no combustible material within 20 feet of the manifold.

(*e*) An oxygen manifold or oxygen bulk supply system which has storage capacity of more than 13,000 cubic feet or oxygen (measured at 14.7 p.s.i.a. and 70° F.), connected in service or ready for service, or more than 25,000 cubic feet of oxygen (measured at 14.7 p.s.i.a. and 70° F.), including unconnected reserves on hand at the site, shall comply with the provisions of the Standard for Bulk Oxygen Systems at Consumer Sites, NFPA No. 566–1965.

(*f*) High-pressure oxygen manifolds shall be provided with approved pressure-regulating devices.

(iii) *Low-pressure oxygen manifolds (for use with cylinders having a Department of Transportation service pressure not exceeding 200 p.s.i.g.).* (*a*) Manifolds shall be of substantial construction suitable for use with oxygen at a pressure of 250 p.s.i.g. They shall have a minimum bursting pressure of 1,000 p.s.i.g. and shall be protected by a safety relief device which will relieve at a maximum pressure of 500 p.s.i.g. DOT–4L200 cylinders have safety devices which relieve at a maximum pressure of 250 p.s.i.g. (or 235 p.s.i.g. if vacuum insulation is used).

(*b*) Hose and hose connections subject to cylinder pressure shall comply with subparagraph (5)(v) of this paragraph. Hose shall have a minimum bursting pressure of 1,000 p.s.i.g.

(*c*) The assembled manifold including leads shall be tested and proven gastight at a pressure of 300 p.s.i.g. The fluid used for testing oxygen manifolds shall be oil-free and not combustible.

(*d*) The location of manifolds shall comply with subdivisions (ii) (*b*), (*c*), (*d*), and (*e*) of this subdivision.

(*e*) The following sign shall be conspicuously posted at each manifold:

Low-Pressure Manifold
Do Not Connect High-Pressure Cylinders
Maximum Pressure—250 P.S.I.G.

(iv) *Portable outlet headers.* (*a*) Portable outlet headers shall not be used indoors except for temporary service where the conditions preclude a direct supply from outlets located on the service piping system.

(*b*) Each outlet on the service piping from which oxygen or fuel-gas is withdrawn to supply a portable outlet header shall be equipped with a readily accessible shutoff valve.

(*c*) Hose and hose connections used for connecting the portable outlet header to the service piping shall comply with subparagraph (5)(v) of this paragraph.

(*d*) Master shutoff valves for both oxygen and fuel-gas shall be provided at the entry end of the portable outlet header.

(*e*) Portable outlet headers for fuel-gas service shall be provided with an approved hydraulic back-pressure valve installed at the inlet and preceding the service outlets, unless an approved pressure-reducing regulator, an approved back-flow check valve, or an approved hydraulic back-pressure valve is installed at each outlet. Outlets provided on headers for oxygen service may be fitted for use with pressure-reducing regulators or for direct hose connection.

(*f*) Each service outlet on portable outlet headers shall be provided with a valve assembly that includes a detachable outlet seal cap, chained or otherwise attached to the body of the valve.

(*g*) Materials and fabrication procedures for portable outlet headers shall comply with subparagraphs (4) (i), (ii), and (v) of this paragraph.

(*h*) Portable outlet headers shall be provided with frames which will support the equipment securely in the correct operating position and protect them from damage during handling and operation.

(v) *Manifold operating procedures.* (*a*) Cylinder manifolds shall be installed under the supervision of someone familiar with the proper practices with reference to their construction and use.

(*b*) All component parts used in the methods of manifolding described in subdivision (*i*) of this subdivision shall be approved as to materials, design and construction either separately or as an assembled unit.

(*c*) All manifolds and parts used in methods of manifolding shall be used only for the gas or gases for which they are approved.

(*d*) When acetylene cylinders are coupled, approved flash arresters shall be installed between each cylinder and the coupler block. For outdoor use only, and when the number of cylinders coupled does not exceed three, one flash arrester installed between the coupler block and regulator is acceptable.

(*e*) Each fuel-gas cylinder lead should be provided with a backflow check valve.

(*f*) The aggregate capacity of fuel-gas cylinders connected to a portable manifold inside a building shall not exceed 3,000 cubic feet of gas.

(*g*) Acetylene and liquefied fuel-gas cylinders shall be manifolded in a vertical position.

(*h*) The pressure in the gas cylinders connected to and discharged simultaneously through a common manifold shall be approximately equal.

(4) *Service piping systems*—(i) *Materials and design.* (*a*)(*1*) Piping and fittings shall comply with Section 2, Industrial Gas and Air Piping Systems, of

the American National Standard Code for Pressure Piping ANSI B31.1, 1967, insofar as it does not conflict with subdivisions (*i*) and (*ii*) of this subdivision:

(*i*) Pipe shall be at least Schedule 40 and fittings shall be at least standard weight in sizes up to and including 6-inch nominal.

(*ii*) Copper tubing shall be Types K or L in accordance with the Standard Specification for Seamless Copper Water Tube, ASTM B88–66a.

(2) Piping shall be steel, wrought iron, brass or copper pipe, or seamless copper, brass or stainless steel tubing, except as provided in (*b*) and (*c*) of this subdivision.

(*b*) (*1*) Oxygen piping and fittings at pressures in excess of 700 p.s.i.g., shall be stainless steel or copper alloys.

(2) Hose connections and hose complying with subparagraph (5) (v) of this paragraph may be used to connect the outlet of a manifold pressure regulator to piping providing the working pressure of the piping is 250 p.s.i.g. or less and the length of the hose does not exceed 5 feet. Hose shall have a minimum bursting pressure of 1,000 p.s.i.g.

(3) When oxygen is supplied to a service piping system from a low-pressure oxygen manifold without an intervening pressure regulating device, the piping system shall have a minimum design pressure of 250 p.s.i.g. A pressure regulating device shall be used at each station outlet when the connected equipment is for use at pressures less than 250 p.s.i.g.

(*c*) (*1*) Piping for acetylene or acetylenic compounds shall be steel or wrought iron.

(2) Unalloyed copper shall not be used for acetylene or acetylenic compounds except in listed equipment.

(ii) *Piping joints.* (*a*) Joints in steel or wrought iron piping shall be welded, threaded or flanged. Fittings, such as ells, tees, couplings, and unions, may be rolled, forged or cast steel, malleable iron or nodular iron. Gray or white cast iron fittings are prohibited.

(*b*) Joints in brass or copper pipe shall be welded, brazed, threaded, or flanged. If of the socket type, they shall be brazed with silver-brazing alloy or similar high melting point (not less than 800° F.) filler metal.

(*c*) Joints in seamless copper, brass, or stainless steel tubing shall be approved gas tubing fittings or the joints shall be brazed. If of the socket type, they shall be brazed with silver-brazing alloy or similar high melting point (not less than 800° F.) filler metal.

(iii) *Installation.* (*a*) Distribution lines shall be installed and maintained in a safe operating condition.

(*b*) Piping located inside or outside of buildings may be placed above or below ground. All piping shall be run as directly as practicable, protected against physical damage, proper allowance being made for expansion and contraction, jarring and vibration. Pipe laid underground in earth shall be located below the frost line and protected against corrosion. After assembly, piping shall be thoroughly blown out with air, nitrogen, or carbon dioxide to remove foreign materials. For oxygen piping, only oil-free air, oil-free nitrogen, or oil-free carbon dioxide shall be used.

(*c*) Only piping which has been welded or brazed shall be installed in tunnels, trenches or ducts. Shutoff valves shall be located outside such conduits. Oxygen piping may be placed in the same tunnel, trench or duct with fuel-gas pipelines, provided there is good natural or forced ventilation.

(*d*) Low points in piping carrying moist gas shall be drained into drip pots constructed so as to permit pumping or draining out the condensate at necessary intervals. Drain valves shall be installed for this purpose having outlets normally closed with screw caps or plugs. No open end valves or petcocks shall be used, except that in drips located out of doors, underground, and not readily accessible, valves may be used at such points if they are equipped with means to secure them in the closed position. Pipes leading to the surface of the ground shall be cased or jacketed where necessary to prevent loosening or breaking.

(*e*) Gas cocks or valves shall be provided for all buildings at points where they will be readily accessible for shutting off the gas supply to these buildings in any emergency. Underground valve boxes or manholes should be avoided wherever possible. There shall also be provided a shutoff valve in the discharge line from the generator, gas holder, manifold or other source of supply.

(*f*) Shutoff valves shall not be installed in safety relief lines in such a manner that the safety relief device can be rendered ineffective.

(*g*) Fittings and lengths of pipe shall be examined internally before assembly and, if necessary, freed from scale or dirt. Oxygen piping and fittings shall be washed out with a suitable solution which will effectively remove grease and dirt but will not react with oxygen. Hot water solutions of caustic soda or trisodium phosphate are effective cleaning agents for this purpose.

(*h*) Piping shall be thoroughly blown out after assembly to remove foreign materials. For oxygen piping, oil-free air, oil-free nitrogen, or oil-free carbon dioxide shall be used. For other piping, air or inert gas may be used.

(*i*) When flammable gas lines or other parts of equipment are being purged of air or gas, open lights or other sources of ignition shall not be permitted near uncapped openings.

(*j*) No welding or cutting shall be performed on an acetylene or oxygen pipeline, including the attachment of hangers or supports, until the line has been purged. Only oil-free air, oil-free nitrogen, or oil-free carbon dioxide shall be used to purge oxygen lines.

(iv) *Painting and signs.* (*a*) Underground pipe and tubing and outdoor ferrous pipe and tubing shall be covered or painted with a suitable material for protection against corrosion.

(*b*) Aboveground piping systems shall be marked in accordance with the American National Standard Scheme for the Identification of Piping Systems, ANSI A13.1–1956.

(*c*) Station outlets shall be marked to indicate the name of the gas.

(v) *Testing.* (*a*) Piping systems shall be tested and proved gastight at 1½ times the maximum operating pressure, and shall be thoroughly purged of air before being placed in service. The material used for testing oxygen lines shall be oil free and noncombustible. Flames shall not be used to detect leaks.

(*b*) When flammable gas lines or other parts of equipment are being purged of air or gas, sources of ignition shall not be permitted near uncapped openings.

(5) *Protective equipment, hose, and regulators*—(i) *General.* Equipment shall be installed and used only in the service for which it is approved and as recommended by the manufacturer.

(ii) *Pressure relief devices.* Service piping systems shall be protected by pressure relief devices set to function at not more than the design pressure of the systems and discharging upwards to a safe location.

(iii) *Piping protective equipment.* (*a*) The fuel-gas and oxygen piping systems, including portable outlet headers shall incorporate the protective equipment shown in Figures Q–1, Q–2, and Q–3.

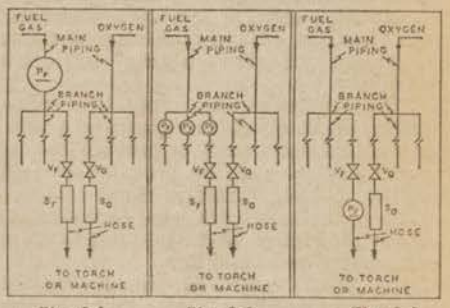

Fig. Q-1 Fig. Q-2 Fig. Q-3

LEGEND
P_F — Protective equipment in fuel gas piping
V_f — Fuel gas station outlet valve
V_o — Oxygen station outlet valve
S_f — Backflow prevention device(s) at fuel gas station outlet
S_o — Backflow prevention device(s) at oxygen station outlet

When only a portion of a fuel-gas system is to be used with oxygen, only that portion need comply with subparagraph (5) (iii) (*a*) of this paragraph.

(*b*) Approved protective equipment (designated P_F in Figs. Q–1, Q–2, and Q–3) shall be installed in fuel-gas piping to prevent:

(*1*) Backflow of oxygen into the fuel-gas supply system;

(2) Passage of a flash back into the fuel-gas supply system; and

(3) Excessive back pressure of oxygen in the fuel-gas supply system. The three functions of the protective equipment may be combined in one device or may be provided by separate devices.

(*i*) The protective equipment shall be located in the main supply line, as in Figure Q–1 or at the head of each branch line, as in Figure Q–2 or at each location where fuel-gas is withdrawn, as in Figure Q–3. Where branch lines are of 2-inch pipe size or larger or of substantial length, protective equipment (designated as P_F) shall be located as shown in either Q–2 and Q–3.

(*ii*) Backflow protection shall be provided by an approved device that will prevent oxygen from flowing into the fuel-gas system or fuel from flowing into the oxygen system (see S_F, Figs. Q–1 and Q–2)

(*iii*) Flash-back protection shall be provided by an approved device that will prevent flame from passing into the fuel-gas system.

(*iv*) Back-pressure protection shall be provided by an approved pressure-relief device set at a pressure not greater than the pressure rating of the backflow or the flashback protection device, whichever is lower. The pressure-relief device shall be located on the downstream side of the backflow and flashback protection devices. The vent from the pressure-relief device shall be at least as large as the relief device inlet and shall be installed without low points that may collect moisture. If low points are unavoidable, drip pots with drains closed with screw plugs or caps shall be installed at the low points. The vent terminus shall not endanger personnel or property through gas discharge; shall be located away from ignition sources; and shall terminate in a hood or bend.

(*c*) If pipeline protective equipment incorporates a liquid, the liquid level shall be maintained, and a suitable antifreeze may be used to prevent freezing.

(*d*) Fuel gas for use with equipment not requiring oxygen shall be withdrawn upstream of the piping protective devices.

(iv) *Station outlet protective equipment.* (*a*) A check valve, pressure regulator, hydraulic seal, or combination of these devices shall be provided at each station outlet, including those on portable headers, to prevent backflow, as shown in Figures Q–1, Q–2, and Q–3 and designated as S_F and S_O.

(*b*) When approved pipeline protective equipment (designated P_F) is located at the station outlet as in Figure Q–3, no additional check valve, pressure regulator, or hydraulic seal is required.

(*c*) A shutoff valve (designated V_F and V_O) shall be installed at each station outlet and shall be located on the upstream side of other station outlet equipment.

(*d*) If the station outlet is equipped with a detachable regulator, the outlet shall terminate in a union connection that complies with the Regulator Connection Standards, 1958, Compressed Gas Association.

(*e*) If the station outlet is connected directly to a hose, the outlet shall terminate in a union connection complying with the Standard Hose Connection Specifications, 1957, Compressed Gas Association.

(*f*) Station outlets may terminate in pipe threads to which permanent connections are to be made, such as to a machine.

(*g*) Station outlets shall be equipped with a detachable outlet seal cap secured in place. This cap shall be used to seal the outlet except when a hose, a regulator, or piping is attached.

(*h*) Where station outlets are equipped with approved backflow and flashback protective devices, as many as four torches may be supplied from one station outlet through rigid piping, provided each outlet from such piping is equipped with a shutoff valve and provided the fuel-gas capacity of any one torch does not exceed 15 cubic feet per hour.

This subdivision does not apply to machines.

(v) *Hose and hose connections.* (*a*) Hose for oxy-fuel gas service shall comply with the Specification for Rubber Welding Hose, 1958, Compressed Gas Association and Rubber Manufacturers Association.

(*b*) The generally recognized colors are red for acetylene and other fuel-gas hose, green for oxygen hose, and black for inert-gas and air hose.

(*c*) When parallel lengths of oxygen and acetylene hose are taped together for convenience and to prevent tangling, not more than 4 inches out of 12 inches shall be covered by tape.

(*d*) Hose connections shall comply with the Standard Hose Connection Specifications, 1957, Compressed Gas Association.

(*e*) Hose connections shall be clamped or otherwise securely fastened in a manner that will withstand, without leakage, twice the pressure to which they are normally subjected in service, but in no case less than a pressure of 300 p.s.i. Oil-free air or an oil-free inert gas shall be used for the test.

(*f*) Hose showing leaks, burns, worn places, or other defects rendering it unfit for service shall be repaired or replaced.

(vi) *Pressure-reducing regulators.* (*a*) Pressure-reducing regulators shall be used only for the gas and pressures for which they are intended. The regulator inlet connections shall comply with Regulator Connection Standards, 1958, Compressed Gas Association.

(*b*) When regulators or parts of regulators, including gages, need repair, the work shall be performed by skilled mechanics who have been properly instructed.

(*c*) Gages on oxygen regulators shall be marked "USE NO OIL."

(*d*) Union nuts and connections on regulators shall be inspected before use to detect faulty seats which may cause leakage of gas when the regulators are attached to the cylinder valves. Damaged nuts or connections shall be destroyed.

(6) *Acetylene generators*—(i) *Approval and marking.* (*a*) Generators shall be of approved construction and shall be plainly marked with the maximum rate of acetylene in cubic feet per hour for which they are designed; the weight and size of carbide necessary for a single charge; the manufacturer's name and address; and the name or number of the type of generator.

(*b*) Carbide shall be of the size marked on the generator nameplate.

(ii) *Rating and pressure limitations.* (*a*) The total hourly output of a generator shall not exceed the rate for which it is approved and marked. Unless specifically approved for higher ratings, carbide-feed generators shall be rated at 1 cubic foot per hour per pound of carbide required for a single complete charge.

(*b*) Relief valves shall be regularly operated to insure proper functioning. Relief valves for generating chambers shall be set to open at a pressure not in excess of 15 p.s.i.g. Relief valves for hydraulic back pressure valves shall be set to open at a pressure not in excess of 20 p.s.i.g.

(*c*) Nonautomatic generators shall not be used for generating acetylene at pressures exceeding 1 p.s.i.g., and all water overflows shall be visible.

(iii) *Location.* The space around the generator shall be ample for free, unobstructed operation and maintenance and shall permit ready adjustment and charging.

(iv) *Stationary acetylene generators (automatic and nonautomatic).* (*a*) (*1*) The foundation shall be so arranged that the generator will be level and so that no excessive strain will be placed on the generator or its connections. Acetylene generators shall be grounded.

(*2*) Generators shall be placed where water will not freeze. The use of common salt (sodium chloride) or other corrosive chemicals for protection against freezing is not permitted. (For heating systems see subdivision (6) (vi) (*c*) of this subparagraph.)

(*3*) Except when generators are prepared in accordance with subdivision (vii) (*a*) (*4*) of this subparagraph, sources of ignition shall be prohibited in outside generator houses or inside generator houses or inside generator rooms.

(*4*) Water shall not be supplied through a continuous connection to the generator except when the generator is provided with an adequate open overflow or automatic water shutoff which will effectively prevent overfilling of the generator. Where a noncontinuous connection is used, the supply line shall terminate at a point not less than 2 inches above the regularly provided opening for filling so that the water can be observed as it enters the generator.

(*5*) Unless otherwise specifically approved, generators shall not be fitted with continuous drain connections leading to sewers, but shall discharge through an open connection into a suitably vented outdoor receptacle or residue pit which may have such connections. An open connection for the sludge drawoff is desirable to enable the generator operator to observe leakage of generating water from the drain valve or sludge cock.

(*b*) (*1*) Each generator shall be provided with a vent pipe of Schedule 40 galvanized iron or steel, except that outside of buildings, vent pipes larger than 4 inches in diameter may be not less than 14 gage galvanized tubing or sheet steel.

(*2*) The escape or relief pipe shall be rigidly installed without traps and so that any condensation will drain back to the generator.

(*3*) The escape or relief pipe shall be carried full size to a suitable point outside the building. It shall terminate in a hood or bend located at least 12 feet above the ground, preferably above the roof, and as far away as practicable from windows or other openings into buildings and as far away as practicable from

sources of ignition such as flues or chimneys and tracks used by locomotives. Generating chamber relief pipes shall not be inter-connected but shall be separately led to the outside air. The hood or bend shall be so constructed that it will not be obstructed by rain, snow, ice, insects, or birds. The outlet shall be at least 3 feet from combustible construction.

(c) (1) Gas holders shall be constructed on the gasometer principle, the bell being suitably guided. The gas bell shall move freely without tendency to bind and shall have a clearance of at least 2 inches from the shell.

(2) The gas holder may be located in the generator room, in a separate room or out of doors. In order to prevent collapse of the gas bell or infiltration of air due to a vacuum caused by the compressor or booster pump or cooling of the gas, a compressor or booster cutoff shall be provided at a point 12 inches or more above the landing point of the bell. When the gas holder is located indoors, the room shall be ventilated in accordance with subdivision (vi)(b) of this subparagraph and heated and lighted in accordance with subdivisions (vi) (c) and (d) of this subparagraph.

(3) When the gas holder is not located within a heated building, gas holder seals shall be protected against freezing.

(4) Means shall be provided to stop the generator-feeding mechanism before the gas holder reaches the upper limit of its travel.

(5) When the gas holder is connected to only one generator, the gas capacity of the holder shall be not less than one-third of the hourly rating of the generator.

(6) If acetylene is used from the gas holder without increase in pressure at some points but with increase in pressure by a compressor or booster pump at other points, approved piping protective devices shall be installed in each supply line. The low-pressure protective device shall be located between the gas holder and the shop piping, and the medium-pressure protective device shall be located between the compressor or booster pump and the shop piping (see Figure Q-4). Approved protective equipment (designated P_F) is used to prevent: Backflow of oxygen into the fuel-gas supply system; passage of a flashback into the fuel-gas supply system; and excessive back pressure of oxygen in the fuel-gas supply system. The three functions of the protective equipment may be combined in one device or may be provided by separate devices.

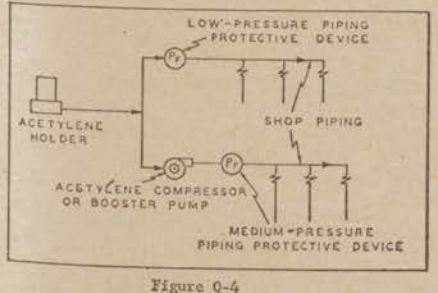

Figure Q-4

(d) (1) The compressor or booster system shall be of an approved type.

(2) Wiring and electrical equipment in compressor or booster pump rooms or enclosures shall conform to the provisions of section 1910.376 for Class I, Division 2 locations.

(3) Compressors and booster pump equipment shall be located in well-ventilated areas away from open flames, electrical or mechanical sparks, or other ignition sources.

(4) Compressor or booster pumps shall be provided with pressure relief valves which will relieve pressure exceeding 15 p.s.i.g. to a safe outdoor location as provided in subdivision (b) of this subdivision, or by returning the gas to the inlet side or to the gas supply source.

(5) Compressor or booster pump discharge outlets shall be provided with approved protective equipment. (See subparagraph (5) of this paragraph.)

(v) *Portable acetylene generators.* (a) (1) All portable generators shall be of a type approved for portable use.

(2) Portable generators shall not be used within 10 feet of combustible material other than the floor.

(3) Portable generators shall not be used in rooms of total volume less than 35 times the total gas-generating capacity per charge of all generators in the room. Generators shall not be used in rooms having a ceiling height of less than 10 feet. (To obtain the gas-generating capacity in cubic feet per charge, multiply the pounds of carbide per charge by 4.5.)

(4) Portable generators shall be protected against freezing. The use of salt or other corrosive chemical to prevent freezing is prohibited.

(b) (1) Portable generators shall be cleaned and recharged and the air mixture blown off outside buildings.

(2) When charged with carbide, portable generators shall not be moved by crane or derrick.

(3) When not in use, portable generators shall not be stored in rooms in which open flames are used unless the generators contain no carbide and have been thoroughly purged of acetylene. Storage rooms shall be well ventilated.

(4) When portable acetylene generators are to be transported and operated on vehicles, they shall be securely anchored to the vehicles. If transported by truck, the motor shall be turned off during charging, cleaning, and generating periods.

(5) Portable generators shall be located at a safe distance from the welding position so that they will not be exposed to sparks, slag, or misdirection of the torch flame or overheating from hot materials or processes.

(vi) *Outside generator houses and inside generator rooms for stationary acetylene generators.* (a) (1) No opening in any outside generator house shall be located within 5 feet of any opening in another building.

(2) Walls, floors, and roofs of outside generator houses shall be of noncombustible construction.

(3) When a part of the generator house is to be used for the storage or manifolding of oxygen cylinders, the space to be so occupied shall be separated from the generator or carbide storage section by partition walls continuous from floor to roof or ceiling, of the type of construction stated in subdivision (8) of this subdivision. Such separation walls shall be without openings and shall be joined to the floor, other walls and ceiling or roof in a manner to effect a permanent gas-tight joint.

(4) Exit doors shall be located so as to be readily accessible in case of emergency.

(5) Explosion venting for outside generator houses and inside generator rooms shall be provided in exterior walls or roofs. The venting areas shall be equal to not less than 1 square foot per 50 cubic feet of room volume and may consist of any one or any combination of the following: Walls of light, noncombustible material preferably single-thickness, single-strength glass; lightly fastened hatch covers; lightly fastened swinging doors in exterior walls opening outward; lightly fastened walls or roof designed to relieve at a maximum pressure of 25 pounds per square foot.

(6) The installation of acetylene generators within buildings shall be restricted to buildings not exceeding one story in height; *Provided, however,* That this will not be construed as prohibiting such installations on the roof or top floor of a building exceeding such height.

(7) Generators installed inside buildings shall be enclosed in a separate room of ample size.

(8) The walls, partitions, floors, and ceilings of inside generator rooms shall be of noncombustible construction having a fire-resistance rating of at least 1 hour. The walls or partitions shall be continuous from floor to ceiling and shall be securely anchored. At least one wall of the room shall be an exterior wall.

(9) Openings from an inside generator room to other parts of the building shall be protected by a swinging type, self-closing fire door for a Class B opening and having a rating of at least 1 hour. Windows in partitions shall be wired glass and approved metal frames with fixed sash. Installation shall be in accordance with the Standard for the Installation of Fire Doors and Windows, NFPA 80–1970.

(b) Inside generator rooms or outside generator houses shall be well ventilated with vents located at floor and ceiling levels.

(c) Heating shall be by steam, hot water, enclosed electrically heated elements or other indirect means. Heating by flames or fires shall be prohibited in outside generator houses or inside generator rooms, or in any enclosure communicating with them.

(d) (1) Generator houses or rooms shall have natural light during daylight hours. Where artificial lighting is necessary it shall be restricted to electric lamps installed in a fixed position. Unless specifically approved for use in atmospheres containing acetylene, such lamps shall be

provided with enclosures of glass or other noncombustible material so designed and constructed as to prevent gas vapors from reaching the lamp or socket and to resist breakage. Rigid conduit with threaded connections shall be used.

(2) Lamps installed outside of wired-glass panels set in gas-tight frames in the exterior walls or roof of the generator house or room are acceptable.

(e) Electric switches, telephone, and all other electrical apparatus which may cause a spark, unless specifically approved for use inside acetylene generator rooms, shall be located outside the generator house or in a room or space separated from the generator room by a gas-tight partition, except that where the generator system is designed so that no carbide fill opening or other part of the generator is open to the generator house or room during the operation of the generator, and so that residue is carried in closed piping from the residue discharge valve to a point outside the generator house or room, electrical equipment in the generator house or room shall conform to the provisions of Subpart S of this part for Class I, Division 2 locations.

(vii) *Maintenance and operation.* (a) Unauthorized persons shall not be permitted in outside generator houses or inside generator rooms.

(1) Operating instructions shall be posted in a conspicuous place near the generator or kept in a suitable place available for ready reference.

(2) When recharging generators the order of operations specified in the instructions supplied by the manufacturer shall be followed.

(3) In the case of batch-type generators, when the charge of carbide is exhausted and before additional carbide is added, the generating chamber shall always be flushed out with water, renewing the water supply in accordance with the instruction card furnished by the manufacturer.

(4) The water-carbide residue mixture drained from the generator shall not be discharged into sewer pipes or stored in areas near open flames. Clear water from residue settling pits may be discharged into sewer pipes.

(b) The carbide added each time the generator is recharged shall be sufficient to refill the space provided for carbide without ramming the charge. Steel or other ferrous tools shall not be used in distributing the charge.

(c) Generator water chambers shall be kept filled to proper level at all times except while draining during the recharging operation.

(d) Whenever repairs are to be made or the generator is to be charged or carbide is to be removed, the water chamber shall be filled to the proper level.

(e) Previous to making repairs involving welding, soldering, or other hot work or other operations which produce a source of ignition, the carbide charge and feed mechanism shall be completely removed. All acetylene shall be expelled by completely flooding the generator shell with water and the generator shall be disconnected from the piping system. The generator shall be kept filled with water, if possible, or positioned to hold as much water as possible.

(f) Hot repairs shall not be made in a room where there are other generators unless all the generators and piping have been purged of acetylene. Hot repairs should preferably be made out of doors.

(7) *Calcium carbide storage*—(i) *Packaging.* (a) Calcium carbide shall be contained in metal packages of sufficient strength to prevent rupture. The packages shall be provided with a screw top or equivalent. These packages shall be constructed water- and air-tight. Solder shall not be used in such a manner that the package will fail if exposed to fire.

(b) Packages containing calcium carbide shall be conspicuously marked "Calcium Carbide—Dangerous If Not Kept Dry" or with equivalent warning.

(c) Caution: Metal tools, even the so-called spark resistant type may cause ignition of an acetylene and air mixture when opening carbide containers.

(d) Sprinkler systems shall not be installed in carbide storage rooms.

(ii) *Storage indoors.* (a) Calcium carbide in quantities not to exceed 600 pounds may be stored indoors in dry, waterproof, and well-ventilated locations.

(1) Calcium carbide not exceeding 600 pounds may be stored indoors in the same room with fuel-gas cylinders.

(2) Packages of calcium carbide, except for one of each size, shall be kept sealed. The seals shall not be broken when there is carbide in excess of 1 pound in any other unsealed package of the same size of carbide in the room.

(b) Calcium carbide exceeding 600 pounds but not exceeding 5,000 pounds shall be stored:

(1) In accordance with subdivision (c) of this subdivision.

(2) In an inside generator room or outside generator house; or

(3) In a separate room in a one-story building which may contain other occupancies, but without cellar or basement beneath the carbide storage section. Such rooms shall be constructed in accordance with subdivision (vi)(a) (8) and (9) of this subdivision and ventilated in accordance with subdivision (vi)(b) of this subdivision. These rooms shall be used for no other purpose.

(c) Calcium carbide in excess of 5,000 pounds shall be stored in one-story buildings without cellar or basement and used for no other purpose, or in outside generator houses. The location of such storage buildings shall be away from congested mercantile and manufacturing districts. If the storage building is of noncombustible construction, it may adjoin other one-story buildings if separated therefrom by unpierced firewalls; if it is detached less than 10 feet from such building or buildings, there shall be no opening in any of the mutually exposing sides of such buildings within 10 feet. If the storage building is of combustible construction, it shall be at least 20 feet from any other one- or two-story building, and at least 30 feet from any other building exceeding two stories.

(iii) *Storage outdoors.* (a) Calcium carbide in unopened metal containers may be stored outdoors.

(b) Carbide containers to be stored outdoors shall be examined to make sure that they are in good condition. Periodic reexaminations shall be made for rusting or other damage to a container that might affect its water or air tightness.

(c) The bottom tier of each row shall be placed on wooden planking or equivalent, so that the containers will not come in contact with the ground or ground water.

(d) Storage areas shall be at least 10 feet from lines of adjoining property that may be built upon.

(e) Containers of carbide which have been in storage the longest shall be used first.

(8) *Public exhibitions and demonstrations*—(i) *Installation requirements.* Installation and operation of welding, cutting, and related equipment shall be done by, or under the supervision of, a competent operator to insure the personal protection of viewers and demonstrators as well as the protection from fire, of materials in and around the site and the building itself.

(ii) *Procedures.* (a) Cylinders containing compressed gases for use at the site shall not be charged in excess of one-half their maximum permissible content. (Cylinders of nonliquefied gases and acetylene shall be charged to not more than one-half their maximum permissible charged pressure in p.s.i.g. Cylinders of liquefied gases shall be charged to not more than one-half the maximum permissible capacity in pounds.)

(b) Cylinders located at the site shall be connected for use except that enough additional cylinders may be stored at the site to furnish approximately 1 day's consumption of each gas used. Other cylinders shall be stored, preferably outdoors, but this storage area shall not be located near a building exit.

(c) Cylinders in excess of 40 pounds total weight being transported to or from the site shall be carried on a hand or motorized truck.

(d) The site shall be constructed, equipped, and operated in such a manner that the demonstration will be carried out so as to minimize the possibility of injury to viewers.

(e) Sites involving the use of compressed gases shall be located so as not to interfere with the egress of people during an emergency.

(f) The fire department shall be notified in advance of such use of the site.

(g) (1) Each site shall be provided with a portable fire extinguisher of appropriate size and type and with a pail of water.

(2) The public and combustible materials at the site shall be protected from flames, sparks, and molten metal.

(h) Hoses shall be located and protected so that they will not be physically damaged.

(i) (1) Cylinder valves shall be closed when equipment is unattended.

(2) Where caps are provided for valve protection, such caps shall be in place

except when the cylinders are in service or connected ready for service.

(3) Cylinders shall be located or secured so that they cannot be knocked over.

(b) *Application, installation, and operation of arc welding and cutting equipment*—(1) *General*—(i) *Equipment selection.* Welding equipment shall be chosen for safe application to the work to be done as specified in subparagraph (2) of this paragraph.

(ii) *Installation.* Welding equipment shall be installed safely as specified by subparagraph (3) of this paragraph.

(iii) *Instruction.* Workmen designated to operate arc welding equipment shall have been properly instructed and qualified to operate such equipment as specified in subparagraph (4) of this paragraph.

(2) *Application of arc welding equipment*—(i) *General.* Assurance of consideration of safety in design is obtainable by choosing apparatus complying with the Requirements for Electric Arc-Welding Apparatus, NEMA EW–1–1962, National Electrical Manufacturers Association or the Safety Standard for Transformer-Type Arc-Welding Machines, ANSI C33.2—1956, Underwriters' Laboratories.

(ii) *Environmental conditions.* (a) Standard machines for arc welding service shall be designed and constructed to carry their rated load with rated temperature rises where the temperature of the cooling air does not exceed 40° C. (104° F.) and where the altitude does not exceed 3,300 feet, and shall be suitable for operation in atmospheres containing gases, dust, and light rays produced by the welding arc.

(b) Unusual service conditions may exist, and in such circumstances machines shall be especially designed to safely meet the requirements of the service. Chief among these conditions are:

(1) Exposure to unusually corrosive fumes.

(2) Exposure to steam or excessive humidity.

(3) Exposure to excessive oil vapor.

(4) Exposure to flammable gases.

(5) Exposure to abnormal vibration or shock.

(6) Exposure to excessive dust.

(7) Exposure to weather.

(8) Exposure to unusual seacoast or shipboard conditions.

(iii) *Voltage.* Open circuit (No load) voltages of arc welding and cutting machines should be as low as possible consistent with satisfactory welding or cutting being done. The following limits shall not be exceeded:

(a) Alternating-current machines

(1) Manual arc welding and cutting—80 volts.

(2) Automatic (machine or mechanized) arc welding and cutting—100 volts.

(b) Direct-current machines

(1) Manual arc welding and cutting—100 volts.

(2) *Automatic* (macihne or mechanized) arc welding and cutting—100 volts.

(c) When special welding and cutting processes require values of open circuit voltages higher than the above, means shall be provided to prevent the operator from making accidental contact with the high voltage by adequate insulation or other means.

(d) For a.c. welding under wet conditions or warm surroundings where perspiration is a factor, the use of reliable automatic controls for reducing no load voltage is recommended to reduce the shock hazard.

(iv) *Design.* (a) A controller integrally mounted in an electric motor driven welder shall have capacity for carrying rated motor current, shall be capable of making and interrupting stalled rotor current of the motor, and may serve as the running overcurrent device if provided with the number of overcurrent units as specified by Subpart S of this part. Starters with magnetic undervoltage release should be used with machines installed more than one to a circuit to prevent circuit overload caused by simultaneously starting of several motors upon return of voltage.

(b) On all types of arc welding machines, control apparatus shall be enclosed except for the operating wheels, levers, or handles. Control handles and wheels should be large enough to be easily grasped by a gloved hand.

(c) Input power terminals, tap change devices and live metal parts connected to input circuits shall be completely enclosed and accessible only by means of tools.

(d) Terminals for welding leads should be protected from accidental electrical contact by personnel or by metal objects i.e., vehicles, crane hooks, etc. Protection may be obtained by use of: Dead-front receptacles for plug connections; recessed openings with nonremovable hinged covers; heavy insulating sleeving or taping or other equivalent electrical and mechanical protection. If a welding lead terminal which is intended to be used exclusively for connection to the work is connected to the grounded enclosure, it must be done by a conductor at least two AWG sizes smaller than the grounding conductor and the terminal shall be marked to indicate that it is grounded.

(e) No connections for portable control devices such as push buttons to be carried by the operator shall be connected to an a.c. circuit of higher than 120 volts. Exposed metal parts of portable control devices operating on circuits above 50 volts shall be grounded by a grounding conductor in the control cable.

(f) Auto transformers or a.c. reactors shall not be used to draw welding current directly from any a.c. power source having a voltage exceeding 80 volts.

(3) *Installation of arc welding equipment*—(i) *General.* Installation including power supply shall be in accordance with the requirements of Subpart S of this part.

(ii) *Grounding.* (a) The frame or case of the welding machine (except engine-driven machines shall be grounded under the conditions and according to the methods prescribed in Subpart S of this part.

(b) Conduits containing electrical conductors shall not be used for completing a work-lead circuit. Pipelines shall not be used as a permanent part of a work-lead circuit, but may be used during construction, extension or repair providing current is not carried through threaded joints, flanged bolted joints, or caulked joints and that special precautions are used to avoid sparking at connection of the work-lead cable.

(c) Chains, wire ropes, cranes, hoists, and elevators shall not be used to carry welding current.

(d) Where a structure, conveyor, or fixture is regularly employed as a welding current return circuit, joints shall be bonded or provided with adequate current collecting devices and appropriate periodic inspection should be conducted to ascertain that no condition of electrolysis or shock, or fire hazard exists by virtue of such use.

(e) All ground connections shall be checked to determine that they are mechanically strong and electrically adequate for the required current.

(iii) *Supply connections and conductors.* (a) A disconnecting switch or controller shall be provided at or near each welding machine which is not equipped with such a switch or controller mounted as an integral part of the machine. The switch shall be in accordance with Subpart (s) of this part. Overcurrent protection shall be provided as specified in Subpart S of this part. A disconnect switch with overload protection or equivalent disconnect and protection means, permitted by Subpart (s) of this part, shall be provided for each outlet intended for connection to a portable welding machine.

(b) For individual welding machines, the rated current-carrying capacity of the supply conductors shall be not less than the rated primary current of the welding machines.

(c) For groups of welding machines, the rated current-carrying capacity of conductors may be less than the sum of the rated primary currents of the welding machines supplied. The conductor rating shall be determined in each case according to the machine loading based on the use to be made of each welding machine and the allowance permissible in the event that all the welding machines supplied by the conductors will not be in use at the same time.

(d) In operations involving several welders on one structure, d.c. welding process requirements may require the use of both polarities; or supply circuit limitations for a.c. welding may require distribution of machines among the phases of the supply circuit. In such cases no load voltages between electrode holders will be 2 times normal in d.c. or 1, 1.41, 1.73, or 2 times normal on a.c. machines. Similar voltage differences will exist if both a.c. and d.c. welding are done on the same structure.

(1) All d.c. machines shall be connected with the same polarity.

(2) All a.c. machines shall be connected to the same phase of the supply

circuit and with the same instantaneous polarity.

(4) *Operation and maintenance.*—(i) *General.* Workmen assigned to operate or maintain arc welding equipment shall be acquainted with the requirements of subparagraphs (b), (d), (e), and (f) of this section; if doing gas-shielded arc welding, also Recommended Safe Practices for Gas-Shielded Arc Welding, A6.1–1966, American Welding Society.

(ii) *Machine hook up.* Before starting operations all connections to the machine shall be checked to make certain they are properly made. The work lead shall be firmly attached to the work; magnetic work clamps shall be freed from adherent metal particles of spatter on contact surfaces. Coiled welding cable shall be spread out before use to avoid serious overheating and damage to insulation.

(iii) *Grounding.* Grounding of the welding machine frame shall be checked. Special attention shall be given to safety ground connections of portable machines.

(iv) *Leaks.* There shall be no leaks of cooling water, shielding gas or engine fuel.

(v) *Switches.* It shall be determined that proper switching equipment for shutting down the machine is provided.

(vi) *Manufacturers' instructions.* Printed rules and instructions covering operation of equipment supplied by the manufacturers shall be strictly followed.

(vii) *Electrode holders.* Electrode holders when not in use shall be so placed that they cannot make electrical contact with persons, conducting objects, fuel or compressed gas tanks.

(viii) *Electric shock.* Cables with splices within 10 feet of the holder shall not be used. The welder should not coil or loop welding electrode cable around parts of his body.

(ix) *Maintenance.* (*a*) The operator should report any equipment defect or safety hazard to his supervisor and the use of the equipment shall be discontinued until its safety has been assured. Repairs shall be made only by qualified personnel.

(*b*) Machines which have become wet shall be thoroughly dried and tested before being used.

(*c*) Work and electrode lead cables should be frequently inspected for wear and damage. Cables with damaged insulation or exposed bare conductors shall be replaced. Joining lengths of work and electrode cables shall be done by the use of connecting means specifically intended for the purpose. The connecting means shall have insulation adequate for the service conditions.

(c) *Installation and operation of resistance welding equipment*—(1) *General*—(i) *Installation.* All equipment shall be installed by a qualified electrician in conformance with Subpart (s) of this part. Theere shall be a safety-type disconnecting switch or a circuit breaker or circuit interrupter to open each power circuit to the machine, conveniently located at or near the machine, so that the power can be shut off when the machine or its controls are to be serviced.

(ii) *Thermal protection.* Ignitron tubes used in resistance welding equipment shall be equipped with a thermal protection switch.

(iii) *Personnel.* Workmen designated to operate resistance welding equipment shall have been properly instructed and judged competent to operate such equipment.

(iv) *Guarding.* Controls of all automatic or air and hydraulic clamps shall be arranged or guarded to prevent the operator from accidentally activating them.

(2) *Spot and seam welding machines (nonportable)*—(i) *Voltage.* All external weld initiating control circuits shall operate on low voltage, not over 120 volts, for the safety of the operators.

(ii) *Capacitor welding.* Stored energy or capacitor discharge type of resistance welding equipment and control panels involving high voltage (over 550 volts) shall be suitably insulated and protected by complete enclosures, all doors of which shall be provided with suitable interlocks and contacts wired into the control circuit (similar to elevator interlocks). Such interlocks or contacts shall be so designed as to effectively interrupt power and short circuit all capacitors when the door or panel is open. A manually operated switch or suitable positive device shall be installed, in addition to the mechanical interlocks or contacts, as an added safety measure assuring absolute discharge of all capacitors.

(iii) *Interlocks.* All doors and access panels of all resistance welding machines and control panels shall be kept locked and interlocked to prevent access, by unauthorized persons, to live portions of the equipment.

(iv) *Guarding.* All press welding machine operations, where there is a possibility of the operator's fingers being under the point of operation, shall be effectively guarded by the use of a device such as an electronic eye safety circuit, two hand controls or protection similar to that prescribed for punch press operation, § 1910.217. All chains, gears, operating bus linkage, and belts shall be protected by adequate guards, in accordance with § 1910.219.

(v) *Shields.* The hazard of flying sparks shall be, wherever practical, eliminated by installing a shield guard of safety glass or suitable fire-resistant plastic at the point of operation. Additional shields or curtains shall be installed as necessary to protect passing persons from flying sparks. (See paragraph (e) (2) (i) (*c*) of this section.)

(vi) *Foot switches.* All foot switches shall be guarded to prevent accidental operation of the machine.

(vii) *Stop buttons.* Two or more safety emergency stop buttons shall be provided on all special multispot welding machines, including 2-post and 4-post weld presses.

(viii) *Safety pins.* On large machines, four safety pins with plugs and receptacles (one in each corner) shall be provided so that when safety pins are removed and inserted in the ram or platen, the press becomes inoperative.

(ix) *Grounding.* Where technically practical, the secondary of all welding transformers used in multispot, projection and seam welding machines shall be grounded. This may be done by permanently grounding one side of the welding secondary current circuit. Where not technically practical, a center tapped grounding reactor connected across the secondary or the use of a safety disconnect switch in conjunction with the welding control are acceptable alternates. Safety disconnect shall be arranged to open both sides of the line when welding current is not present.

(3) *Portable welding machines*—(i) *Counterbalance.* All portable welding guns shall have suitable counterbalanced devices for supporting the guns, including cables, unless the design of the gun or fixture makes counterbalancing impractical or unnecessary.

(ii) *Safety chains.* All portable welding guns, transformers and related equipment that is suspended from overhead structures, eye beams, trolleys, etc. shall be equipped with safety chains or cables. Safety chains or cables shall be capable of supporting the total shock load in the event of failure of any component of the supporting system.

(iii) *Clevis.* When trolleys are used to support portable welding equipment, transformers, etc. they shall be equipped with suitable forged steel clevis for the attachment of safety chains. Each clevis shall be capable of supporting the total shock load of the suspended equipment in the event of trolley failure.

(iv) *Switch guards.* All initiating switches, including retraction and dual schedule switches, located on the portable welding gun shall be equipped with suitable guards capable of preventing accidental initiation through contact with fixturing, operator's clothing, etc. Initiating switch voltage shall not exceed 24 volts.

(v) *Moving holder.* The movable holder, where it enters the gun frame, shall have sufficient clearance to prevent the shearing of fingers carelessly placed on the operating movable holder.

(vi) *Grounding.* The secondary and case of all portable welding transformers shall be grounded. Secondary grounding may be by center tapped secondary or by a center tapped grounding reactor connected across the secondary.

(4) *Flash welding equipment.*—(i) *Ventilation and flash guard.* Flash welding machines shall be equipped with a hood to control flying flash. In cases of high production, where materials may contain a film of oil and where toxic elements and metal fumes are given off, ventilation shall be provided in accordance with paragraph (f) of this section.

(ii) *Fire curtains.* For the protection of the operators of nearby equipment, fire-resistant curtains or suitable shields shall be set up around the machine and in such a manner that the operators movements are not hampered.

(5) *Hazards and precautions.* A job hazard analysis shall be made, by qualified personnel, of the operations to be performed on each welding machine to determine the safeguards and personal

protective equipment that shall be used for each job.

(6) *Maintenance.* Periodic inspection shall be made by qualified maintenance personnel, and records of the same maintained. The operator shall be instructed to report any equipment defects to his supervisor and the use of the equipment shall be discontinued until safety repairs have been completed. .

(d) *Fire prevention and protection*—(1) *Basic precautions.* For elaboration of these basic precautions and of the special precautions of subparagraph (2) of this paragraph as well as a delineation of the fire protection and prevention responsibilities of welders and cutters, their supervisors (including outside contractors) and those in management on whose property cutting and welding is to be performed, see, Standard for Fire Prevention in Use of Cutting and Welding Processes, NFPA Standard 51B, 1962. The basic precautions for fire prevention in welding or cutting work are:

(i) *Fire hazards.* If the object to be welded or cut cannot readily be moved, all movable fire hazards in the vicinity shall be taken to a safe place.

(ii) *Guards.* If the object to be welded or cut cannot be moved and if all the fire hazards cannot be removed, then guards shall be used to confine the heat, sparks, and slag, and to protect the immovable fire hazards.

(iii) *Restrictions.* If the requirements stated in subdivision (i) and (ii) of this subdivision cannot be followed then welding and cutting shall not be performed.

(2) *Special precautions.* When the nature of the work to be performed falls within the scope of subdivision (ii) of this subdivision certain additional precautions may be necessary:

(i) *Combustible material.* Wherever there are floor openings or cracks in the flooring that cannot be closed, precautions shall be taken so that no readily combustible materials on the floor below will be exposed to sparks which might drop through the floor. The same precautions shall be observed with regard to cracks or holes in walls, open doorways and open or broken windows.

(ii) *Fire extinguishers.* Suitable fire extinguishing equipment shall be maintained in a state of readiness for instant use. Such equipment may consist of pails of water, buckets of sand, hose or portable extinguishers depending upon the nature and quantity of the combustible material exposed.

(iii) *Fire watch.* (*a*) Fire watchers shall be required whenever welding or cutting is performed in locations where other than a minor fire might develop, or any of the following conditions exist:

(*1*) Appreciable combustible material, in building construction or contents, closer than 35 feet to the point of operation.

(2) Appreciable combustibles are more than 35 feet away but are easily ignited by sparks.

(3) Wall or floor openings within a 35-foot radius expose combustible material in adjacent areas including concealed spaces in walls or floors.

(*4*) Combustible materials are adjacent to the opposite side of metal partitions, walls, ceilings, or roofs and are likely to be ignited by conduction or radiation.

(*b*) Fire watchers shall have fire extinguishing equipment readily available and be trained in its use. They shall be familiar with facilities for sounding an alarm in the event of a fire. They shall watch for fires in all exposed areas, try to extinguish them only when obviously within the capacity of the equipment available, or otherwise sound the alarm. A fire watch shall be maintained for at least a half hour after completion of welding or cutting operations to detect and extinguish possible smoldering fires.

(iv) *Authorization.* Before cutting or welding is permitted, the area shall be inspected by the individual responsible for authorizing cutting and welding operations. He shall designate precautions to be followed in granting authorization to proceed preferably in the form of a written permit.

(v) *Floors.* Where combustible materials such as paper clippings, wood shavings, or textile fibers are on the floor, the floor shall be swept clean for a radius of 35 feet. Combustible floors shall be kept wet, covered with damp sand, or protected by fire-resistant shields. Where floors have been wet down, personnel operating arc welding or cutting equipment shall be protected from possible shock.

(vi) *Prohibited areas.* Cutting or welding shall not be permitted in the following situations:

(*a*) In areas not authorized by management.

(*b*) In sprinklered buildings while such protection is impaired.

(*c*) In the presence of explosive atmospheres (mixtures of flammable gases, vapors, liquids, or dusts with air), or explosive atmospheres that may develop inside uncleaned or improperly prepared tanks or equipment which have previously contained such materials, or that may develop in areas with an accumulation of combustible dusts.

(*d*) In areas near the storage of large quantities of exposed, readily ignitible materials such as bulk sulfur, baled paper, or cotton.

(vii) *Relocation of combustibles.* Where practicable, all combustibles shall be relocated at least 35 feet from the work site. Where relocation is impracticable, combustibles shall be protected with flameproofed covers or otherwise shielded with metal or asbestos guards or curtains. Edges of covers at the floor should be tight to prevent sparks from going under them. This precaution is also important at overlaps where several covers are used to protect a large pile.

(viii) *Ducts.* Ducts and conveyor systems that might carry sparks to distant combustibles shall be suitably protected or shut down.

(ix) *Combustible walls.* Where cutting or welding is done near walls, partitions, ceiling or roof of combustible construction, fire-resistant shields or guards shall be provided to prevent ignition.

(x) *Noncombustible walls.* If welding is to be done on a metal wall, partition, ceiling or roof, precautions shall be taken to prevent ignition of combustibles on the other side, due to conduction or radiation, preferably by relocating combustibles. Where combustibles are not relocated, a fire watch on the opposite side from the work shall be provided.

(xi) *Combustible cover.* Welding shall not be attempted on a metal partition, wall, ceiling or roof having a combustible covering nor on walls or partitions of combustible sandwich-type panel construction.

(xii) *Pipes.* Cutting or welding on pipes or other metal in contact with combustible walls, partitions, ceilings or roofs shall not be undertaken if the work is close enough to cause ignition by conduction.

(xiii) *Management.* Management shall recognize its responsibility for the safe usage of cutting and welding equipment on its property and:

(*a*) Based on fire potentials of plant facilities, establish areas for cutting and welding, and establish procedures for cutting and welding, in other areas.

(*b*) Designate an individual responsible for authorizing cutting and welding operations in areas not specifically designed for such processes.

(*c*) Insist that cutters or welders and their supervisors are suitably trained in the safe operation of their equipment and the safe use of the process.

(*d*) Advise all contractors about flammable materials or hazardous conditions of which they may not be aware.

(xiv) *Supervisor.* The Supervisor:

(*a*) Shall be responsible for the safe handling of the cutting or welding equipment and the safe use of the cutting or welding process.

(*b*) Shall determine the combustible materials and hazardous area present or likely to be present in the work location.

(*c*) Shall protect combustibles from ignition by the following:

(*1*) Have the work moved to a location free from dangerous combustibles.

(2) If the work cannot be moved, have the combustibles moved to a safe distance from the work or have the combustibles properly shielded against ignition.

(3) See that cutting and welding are so scheduled that plant operations that might expose combustibles to ignition are not started during cutting or welding.

(*d*) Shall secure authorization for the cutting or welding operations from the designated management representative.

(*1*) Shall determine that the cutter or welder secures his approval that conditions are safe before going ahead.

(2) Shall determine that fire protection and extinguishing equipment are properly located at the site.

(3) Where fire watches are required, he shall see that they are available at the site.

(xv) *Fire prevention precautions.* Cutting or welding shall be permitted only in areas that are or have been made fire safe. Within the confines of an oper-

ating plant or building, cutting and welding should preferably be done in a specific area designed for such work, such as a maintenance shop or a detached outside location. Such areas should be of noncombustible or fire-resistive construction, essentially free of combustible and flammable contents, and suitably segregated from adjacent areas. When work cannot be moved practically, as in most construction work, the area shall be made safe by removing combustibles or protecting combustibles from ignition sources.

(3) *Welding or cutting containers*—(i) *Used containers.* No welding, cutting, or other hot work shall be performed on used drums, barrels, tanks or other containers until they have been cleaned so thoroughly as to make absolutely certain that there are no flammable materials present or any substances such as greases, tars, acids, or other materials subjected to heat, might produce flammable or toxic vapors. Any pipe lines or connections to the drum or vessel shall be disconnected or blanked.

(ii) *Venting and purging.* All hollow spaces, cavities of containers shall be vented to permit the escape of air or gases before preheating, cutting or welding. Purging with inert gas is recommended.

(4) *Confined spaces*—(i) *Accidental contact.* When arc welding is to be suspended for any substantial period of time, such as during lunch or overnight, all electrodes shall be removed from the holders and the holders carefully located so that accidental contact cannot occur and the machine be disconnected from the power source.

(ii) *Torch valve.* In order to eliminate the possibility of gas escaping through leaks or improperly closed valves, when gas welding or cutting, the torch valves shall be closed and the gas supply to the torch positively shutoff at some point outside the confined area whenever the torch is not to be used for a substantial period of time, such as during lunch hour or overnight. Where practicable, the torch and hose shall also be removed from the confined space.

(e) *Protection of personnel*—(1) *General*—(i) *Railing.* A welder or helper working on platforms, scaffolds, or runways shall be protected against falling. This may be accomplished by the use of railings, safety belts, life lines, or some other equally effective safeguards.

(ii) *Welding cable.* Welders shall place welding cable and other equipment so that it is clear of passageways, ladders, and stairways.

(2) *Eye protection*—(i) *Selection.* (*a*) Helmets or hand shields shall be used during all arc welding or arc cutting operations, excluding submerged arc welding. Goggles should also be worn during arc welding or cutting operations to provide protection from injurious rays from adjacent work, and from flying objects. The goggles may have either clear or colored glass, depending upon the amount of exposure to adjacent welding operations. Helpers or attendants shall be provided with proper eye protection.

(*b*) Goggles or other suitable eye protection shall be used during all gas welding or oxygen cutting operations. Spectacles without side shields, with suitable filter lenses are permitted for use during gas welding operations on light work, for torch brazing or for inspection.

(*c*) All operators and attendants of resistance welding or resistance brazing equipment shall use transparent face shields or goggles, depending on the particular job, to protect their faces or eyes, as required.

(*d*) Eye protection in the form of suitable goggles shall be provided where needed for brazing operations not covered in (*a*), (*b*), and (*c*) of this subdivision.

(ii) *Specifications for protectors.* (*a*) Helmets and hand shields shall be made of a material which is an insulator for heat and electricity. Helmets, shields and goggles shall be not readily flammable and shall be capable of withstanding sterilization.

(*b*) Helmets and hand shields shall be arranged to protect the face, neck and ears from direct radiant energy from the arc.

(*c*) Helmets shall be provided with filter plates and cover plates designed for easy removal.

(*d*) All parts shall be constructed of a material which will not readily corrode or discolor the skin.

(*e*) Goggles shall be ventilated to prevent fogging of the lenses as much as practicable.

(*f*) Cover lenses or plates should be provided to protect each helmet, hand shield or goggle filter lens or plate.

(*g*) All glass for lenses and cover plate shall be tempered, substantially free from striae, air bubbles, waves and other flaws. Except when a lens is ground to provide proper optical correction for defective vision, the front and rear surfaces of lenses and windows shall be smooth and parallel.

(*h*) Lenses shall bear some permanent distinctive marking by which the source and shade may be readily identified.

(*i*) The following is a guide for the selection of the proper shade numbers. These recommendations may be varied to suit the individual's needs.

Welding operation	*Shade No.*
Shielded metal-arc welding—1/16-, 3/32-, 1/8-, 5/32-inch electrodes	10
Gas-shielded arc welding (Nonferrous)—1/16-, 3/32-, 1/8-, 5/32-inch electrodes	11
Gas-shielded arc welding (ferrous)—1/16-, 3/32-, 1/8-, 5/32-inch electrodes	12
Shielded metal-arc welding:	
3/16-, 7/32-, 1/4-inch electrodes	12
5/16-, 3/8-inch electrodes	14
Atomic hydrogen welding	10–14
Carbon arc welding	14
Soldering	2
Torch brazing	3 or 4
Light cutting, up to 1 inch	3 or 4
Medium cutting, 1 inch to 6 inches	4 or 5
Heavy cutting, 6 inches and over	5 or 6
Gas welding (light) up to 1/8 inch	4 or 5
Gas welding (medium) 1/8 inch to 1/2 inch	5 or 6
Gas welding (heavy) 1/2 inch and over	6 or 8

NOTE: In gas welding or oxygen cutting where the torch produces a high yellow light, it is desirable to use a filter or lens that absorbs the yellow or sodium line in the visible light of the operation.

(*j*) All filter lenses and plates shall meet the test for transmission of radiant energy prescribed in ANSI Z87.1–1968—American National Standard Practice for Occupational and Educational Eye and Face Protection.

(iii) *Protection from arc welding rays.* Where the work permits, the welder should be enclosed in an individual booth painted with a finish of low reflectivity such as zinc oxide (an important factor for absorbing ultraviolet radiations) and lamp black, or shall be enclosed with noncombustible screens similiarly painted. Booths and screens shall permit circulation of air at floor level. Workers or other persons adjacent to the welding areas shall be protected from the rays by noncombustible or flameproof screens or shields or shall be required to wear appropriate goggles.

(3) *Protective clothing*—(i) *General requirements.* Employees exposed to the hazards created by welding, cutting, or brazing operations shall be protected by personal protective equipment in accordance with the requirements of § 1910.132. Appropriate protective clothing required for any welding operation will vary with the size, nature and location of the work to be performed.

(ii) *Specified protective clothing.* Protective means which may be employed are as follows:

(*a*) Except when engaged in light work, all welders should wear flameproof gauntlet gloves.

(*b*) Flameproof aprons made of leather, asbestos, or other suitable material may also be desirable as protection against radiated heat and sparks.

(*c*) Woolen clothing preferable to cotton because it is not so readily ignited and helps protect the welder from changes in temperature. Cotton clothing, if used, should be chemically treated to reduce its combustibility. All outer clothing such as jumpers or overalls should be reasonably free from oil or grease.

(*d*) Sparks may lodge in rolled-up sleeves or pockets of clothing, or cuffs of overalls or trousers. It is therefore recommended that sleeves and collars be kept buttoned and pockets be eliminated from the front of overalls and aprons. Trousers or overalls should not be turned up on the outside.

(*e*) For heavy work, fire-resistant leggings, high boots, or other equivalent means should be used.

(*f*) In production work a sheet metal screen in front of the worker's legs can provide further protection against sparks and molten metal in cutting operations.

(*g*) Capes or shoulder covers made of leather or other suitable materials should be worn during overhead welding or cutting operations. Leather skull caps may be worn under helmets to prevent head burns.

(*h*) For overhead welding and cutting, or welding and cutting in extremely confined spaces, ear protection is sometimes desirable.

(*i*) Where there is exposure to sharp or heavy falling objects, or a hazard of

bumping in confined spaces, hard hats or head protectors should be used.

(4) *Work in confined spaces*—(i) *General.* As used herein confined space is intended to mean a relatively small or restricted space such as a tank, boiler, pressure vessel, or small compartment of a ship.

(ii) *Ventilation.* Ventilation is a prerequisite to work in confined spaces. For ventilation requirements see paragraph (f) of this section.

(iii) *Securing cylinders and machinery.* When welding or cutting is being performed in any confined spaces the gas cylinders and welding machines shall be left on the outside. Before operations are started, heavy portable equipment mounted on wheels shall be securely blocked to prevent accidental movement.

(iv) *Lifelines.* Where a welder must enter a confined space through a manhole or other small opening, means shall be provided for quickly removing him in case of emergency. When safety belts and lifelines are used for this purpose they shall be so attached to the welder's body that his body cannot be jammed in a small exit opening. An attendant with a preplanned rescue procedure shall be stationed outside to observe the welder at all times and be capable of putting rescue operations into effect.

(v) *Electrode removal.* When arc welding is to be suspended for any substantial period of time, such as during lunch or overnight, all electrodes shall be removed from the holders and the holders carefully located so that accidental contact cannot occur and the machine disconnected from the power source.

(vi) *Gas cylinder shutoff.* In order to to eliminate the possibility of gas escaping through leaks or improperly closed valves, when gas welding or cutting, the torch valves shall be closed and the fuel-gas and oxygen supply to the torch positively shut off at some point outside the confined area whenever the torch is not to be used for a substantial period to time, such as during lunch hour or overnight. Where practicable the torch and hose shall also be removed from the confined space.

(vii) *Warning sign.* After welding operations are completed, the welder shall mark the hot metal or provide some other means of warning other workers.

(f) *Health protection and ventilation*—(1) *General*—(i) *Contamination.* The requirements in this paragraph have been established on the basis of the following three factors in arc and gas welding which govern the amount of contamination to which welders may be exposed:

(*a*) Dimensions of space in which welding is to be done (with special regard to height of ceiling).

(*b*) Number of welders.

(*c*) Possible evolution of hazardous fumes, gases, or dust according to the metals involved.

(ii) *Ventilation.* It is recognized that in individual instances other factors may be involved in which case ventilation or respiratory protective devices should be provided as needed to meet the equivalent requirements of this section. Such factors would include:

(*a*) Atmospheric conditions.

(*b*) Heat generated.

(*c*) Presence of volatile solvents.

(iii) *Screens.* When welding must be performed in a space entirely screened on all sides, the screens shall be so arranged that no serious restriction of ventilation exists. It is desirable to have the screens so mounted that they are about 2 feet above the floor unless the work is performed at so low a level that the screen must be extended nearer to the floor to protect nearby workers from the glare of welding.

(iv) *Maximum allowable concentration.* Local exhaust or general ventilating systems shall be provided and arranged to keep the amount of toxic fumes, gasses, or dusts below the maximum allowable concentration as specified in § 1910.93.

(v) *Precautionary labels.* A number of potentially hazardous materials are employed in fluxes, coatings, coverings, and filler metals used in welding and cutting or are released to the atmosphere during welding and cutting. These include but are not limited to the materials itemized in paragraphs (f) (5) through (12) of this section. The suppliers of welding materials shall determine the hazard, if any, associated with the use of their materials in welding, cutting, etc.

(*a*) All filler metals and fusible granular materials shall carry the following notice, as a minimum, on tags, boxes, or other containers:

CAUTION

Welding may produce fumes and gases hazardous to health. Avoid breathing these fumes and gases. Use adequate ventilation. See ANSI Z49.1–1967 Safety in Welding and Cutting published by the American Welding Society.

(*b*) Brazing (welding) filler metals containing cadmium in significant amounts shall carry the following notice on tags, boxes, or other containers:

WARNING

CONTAINS CADMIUM—POISONOUS FUMES MAY BE FORMED ON HEATING

Do not breathe fumes. Use only with adequate ventilation such as fume collectors, exhaust ventilators, or air-supplied respirators. See ANSI Z49.1–1967.

If chest pain, cough, or fever develops after use call physician immediately.

Keep children away when using.

(*c*) Brazing and gas welding fluxes containing fluorine compounds shall have a cautionary wording to indicate that they contain fluorine compounds. One such cautionary wording recommended by the American Welding Society for brazing and gas welding fluxes reads as follows:

CAUTION

CONTAINS FLUORIDES

This flux when heated gives off fumes that may irritate eyes, nose and throat.

1. Avoid fumes—use only in well-ventilated spaces.
2. Avoid contact of flux with eyes or skin.
3. Do not take internally.

(2) *Ventilation for general welding and cutting*—(i) *General.* Mechanical ventilation shall be provided when welding or cutting is done on metals not covered in subparagraphs (5) through (12) of this paragraph. (For specific materials, see the ventilation requirements of subparagraphs (5) through (12) of this paragraph.)

(*a*) In a space of less than 10,000 cubic feet per welder.

(*b*) In a room having a ceiling height of less than 16 feet.

(*c*) In confined spaces or where the welding space contains partitions, balconies, or other structural barriers to the extent that they significantly obstruct cross ventilation.

(ii) *Minimum rate.* Such ventilation shall be at the minimum rate of 2,000 cubic feet per minute per welder, except where local exhaust hoods and boots as per subparagraph (3) of this paragraph, or airline respirators approved by the U.S. Bureau of Mines for such purposes are provided. Natural ventilation is considered sufficient for welding or cutting operations where the restrictions in subdivision (i) of this subdivision are not present.

(3) *Local exhaust hoods and booths.* Mechanical local exhaust ventilation may be by means of either of the following:

(i) *Hoods.* Freely movable hoods intended to be placed by the welder as near as practicable to the work being welded and provided with a rate of airflow sufficient to maintain a velocity in the direction of the hood of 100 linear feet per minute in the zone of welding when the hood is at its most remote distance from the point of welding. The rates of ventilation required to accomplish this control velocity using a 3-inch wide flanged suction opening are shown in the following table:

Welding zone	Minimum air flow [1] cubic feet/minutes	Duct diameter, inches [2]
4 to 6 inches from arc or torch	150	3
6 to 8 inches from arc or torch	275	3½
8 to 10 inches from arc or torch	425	4½
10 to 12 inches from arc or torch	600	5¼

[1] When brazing with cadmium bearing materials or when cutting on such materials increased rates of ventilation may be required.

[2] Nearest half-inch duct diameter based on 4,000 feet per minute velocity in pipe.

(ii) *Fixed enclosure.* A fixed enclosure with a top and not less than two sides which surround the welding or cutting operations and with a rate of airflow sufficient to maintain a velocity away from the welder of not less than 100 linear feet per minute.

(4) *Ventilation in confined spaces*—(i) *Air replacement.* All welding and cutting operations carried on in confined spaces shall be adequately ventilated to prevent the accumulation of toxic materials or possible oxygen deficiency. This applies not only to the welder but also to helpers and other personnel in the immediate vicinity. All air replacing that

withdrawn shall be clean and respirable.

(ii) *Airline respirators.* In such circumstances where it is impossible to provide such ventilation, airline respirators or hose masks approved by the U.S. Bureau of Mines for this purpose shall be used.

(iii) *Self-contained units.* In areas immediately hazardous to life, hose masks with blowers or self-contained breathing equipment shall be used. The breathing equipment shall be approved by the U.S. Bureau of Mines.

(iv) *Outside helper.* Where welding operations are carried on in confined spaces and where welders and helpers are provided with hose masks, hose masks with blowers or self-contained breathing equipment approved by the U.S. Bureau of Mines, a worker shall be stationed on the outside of such confined spaces to insure the safety of those working within.

(v) *Oxygen for ventilation.* Oxygen shall never be used for ventilation.

(5) *Fluorine compounds*—(i) *General.* In confined spaces, welding or cutting involving fluxes, coverings, or other materials which contain fluorine compounds shall be done in accordance with subparagraph (4) of this paragraph. A fluorine compound is one that contains fluorine, as an element in chemical combination, not as a free gas.

(ii) *Maximum allowable concentration.* The need for local exhaust ventilation or airline respirators for welding or cutting in other than confined spaces will depend upon the individual circumstances. However, experience has shown such protection to be desirable for fixed-location production welding and for all production welding on stainless steels. Where air samples taken at the welding location indicate that the fluorides liberated are below the maximum allowable concentration, such protection is not necessary.

(6) *Zinc*—(i) *Confined spaces.* In confined spaces welding or cutting involving zinc-bearing base or filler metals or metals coated with zinc-bearing materials shall be done in accordance with subparagraph (4) of this paragraph.

(ii) *Indoors.* Indoors, welding or cutting involving zinc-bearing base or filler metals coated with zinc-bearing materials shall be done in accordance with subparagraph (3) of this paragraph.

(7) *Lead*—(i) *Confined spaces.* In confined spaces, welding involving lead-base metals (erroneously called lead-burning) shall be done in accordance with subparagraph (4) of this paragraph.

(ii) *Indoors.* Indoors, welding involving lead-base metals shall be done in accordance with subparagraph (3) of this paragraph.

(iii) *Local ventilation.* In confined spaces or indoors, welding or cutting involving metals containing lead, other than as an impurity, or involving metals coated with lead-bearing materials, including paint shall be done using local exhaust ventilation or airline respirators. Outdoors such operations shall be done using respiratory protective equipment approved by the U.S. Bureau of Mines for such purposes. In all cases, workers in the immediate vicinity of the cutting operation shall be protected as necessary by local exhaust ventilation or airline respirators.

(8) *Beryllium.* Welding or cutting indoors, outdoors, or in confined spaces involving beryllium-containing base or filler metals shall be done using local exhaust ventilation and airline respirators unless atmospheric tests under the most adverse conditions have established that the workers' exposure is within the acceptable concentrations defined by § 1910.93. In all cases, workers in the immediate vicinity of the welding or cutting operations shall be protected as necessary by local exhaust ventilation or airline respirators.

(9) *Cadmium.*—(i) *General.* Welding or cutting indoors or in confined spaces involving cadmium-bearing or cadmium-coated base metals shall be done using local exhaust ventilation or airline respirators unless atmospheric tests under the most adverse conditions have established that the workers' exposure is within the acceptable concentrations defined by § 1910.93. Outdoors such operations shall be done using respiratory protective equipment such as fume respirators approved by the U.S. Bureau of Mines for such purposes.

(ii) *Confined space.* Welding (brazing) involving cadmium-bearing filler metals shall be done using ventilation as prescribed in paragraph (3) or (4) of this paragraph if the work is to be done in a confined space.

(10) *Mercury.* Welding or cutting indoors or in a confined space involving metals coated with mercury-bearing materials including paint, shall be done using local exhaust ventilation or airline respirators unless atmospheric tests under the most adverse conditions have established that the workers' exposure is within the acceptable concentrations defined by § 1910.93. Outdoors such operations shall be done using respiratory protective equipment approved by the U.S. Bureau of Mines for such purposes.

(11) *Cleaning compounds*—(i) *Manufacturer's instructions.* In the use of cleaning materials, because of their possible toxicity or flammability, appropriate precautions such as manufacturers instructions shall be followed.

(ii) *Degreasing.* Degreasing or other cleaning operations involving chlorinated hydrocarbons shall be so located that no vapors from these operations will reach or be drawn into the atmosphere surrounding any welding operation. In addition, trichloroethylene and perchlorethylene should be kept out of atmospheres penetrated by the ultraviolet radiation of gas-shielded welding operations.

(12) *Cutting of stainless steels.* Oxygen cutting, using either a chemical flux or iron powder or gas-shielded arc cutting of stainless steel, shall be done using mechanical ventilation adequate to remove the fumes generated.

(13) *First-aid equipment.* First-aid equipment shall be available at all times. On every shift of welding operations there should be present employees trained to render first aid. All injuries shall be reported as soon as possible for medical attention. First aid shall be rendered until medical attention can be provided.

(g) *Industrial applications* — (1) *Transmission pipeline*—(i) *General.* The requirements of paragraphs (b), (e), and (f) of this section shall be observed.

(ii) *Field shop operations.* Where field shop operations are involved for fabrication of fittings, river crossings, road crossings, and pumping and compressor stations the requirements of paragraphs (a), (b), (d), (e), and (f) of this section shall be observed.

(iii) *Electric shock.* When arc welding is performed in wet conditions, or under conditions of high humidity, special protection against electric shock shall be supplied.

(iv) *Pressure testing.* In pressure testing of pipelines, the workers and the public shall be protected against injury by the blowing out of closures or other pressures restraining devices. Also, protection shall be provided against expulsion of loose dirt that may have become trapped in the pipe.

(v) *Construction standards.* The welded construction of transmission pipelines shall be conducted in accordance with the Standard for Welding Pipe Lines and Related Facilities, API Std. 1104–1968.

(vi) *Flammable substance lines.* The connection, by welding, of branches to pipelines carrying flammable substances shall be performed in accordance with Welding or Hot Tapping on Equipment Containing Flammables, API Std. PSD No. 2201–1963.

(vii) *X-ray inspection.* The use of X-rays and radioactive isotopes for the inspection of welded pipeline joints shall be carried out in conformance with the American National Standard Safety Standard for Non-Medical X-ray and Sealed Gamma-Ray Sources, ANSI Z54.1–1963.

(2) *Mechanical piping systems*—(i) *General.* The requirements of paragraphs (a), (b), (d), (e), and (f) of this section shall be observed.

(ii) *X-ray inspection.* The use of X-rays and radioactive isotopes for the inspection of welded piping joints shall be in conformance with the American National Standard Safety Standard for Non-Medical X-ray and Sealed Gamma-Ray Sources. ANSI Z54.1–1963.

§ 1910.253 Sources of standards.

Sec.	*Source*
1910.251	ANSI Z49.1–1967, Safety in Welding and Cutting.
1910.252	(a) NFPA—51–1969, Welding and Cutting Oxygen Fuel Gas Systems. (b) ANSI Z–49.1 1967, Safety in Welding and Cutting. (c) NFPA 51B 1962, Cutting and Welding Processes. (d) 41 CFR 50–204.7.

§ 1910.254 Standards organizations.

Specific standards of the following organizations have been referenced in this subpart. Copies of the referenced standards may be obtained from the issuing

organizations. The names and addresses of the issuing organizations are as follows:

(a) American National Standards Institute (ANSI), 1430 Broadway, New York, NY 10018.

(b) National Fire Protection Association (NFPA), 60 Batterymarch Street, Boston, MA 02110.

(c) Compressed Association, Inc., 500 Fifth Avenue, New York, NY 10036.

(d) American Petroleum Institute, 1801 K Street NW., Washington, DC 20006.

(e) American Welding Society, 444 Madison Avenue, New York, NY 10022.

(f) Rubber Manufacturers Association, 345 East 47th Street, New York, NY 10017.

Subpart R—Special Industries

§ 1910.261 Pulp, paper, and paperboard mills.

(a) *General requirements*—(1) *Application.* This section applies to establishments where pulp, paper, and paperboard are manufactured and converted. This section does not apply to logging and the transportation of logs to pulp, paper, and paperboard mills.

(2) *Standards incorporated by reference.* Standards covering issues of occupational safety and health which have general application without regard to any specific industry are incorporated by reference in paragraphs (b) through (m) of this section and in subparagraphs (3) and (4) of this paragraph and made applicable under this section. Such standards shall be construed according to the rules set forth in § 1910.05.

(3) *General incorporation of standards.* Establishments subject to this section shall comply with the following standards of the American National Standards Institute:

(i) Practice for Industrial Lighting, A11.1—1965 (R–1970).

(ii) Safety Requirements for Floor and Wall Openings, Railings, and Toe Boards, A12.1—1967.

(iii) Scheme for the identification of Piping Systems, A13.1—1956.

(iv) Safety Code for Portable Wood Ladders, A14.1—1968.

(v) Safety Code for Portable Metal Ladders, A14.2—1956.

(vi) Safety Code for Fixed Ladders, A14.3—1956.

(vii) Safety Code for Elevators, Dumbwaiters, and Moving Walks, A17.1—1965, including Supplements A17.1a—1967, A17.1b—1968, A17.1c—1969, and A17.1d—1970.

(viii) Practice for the Inspection of Elevators (Inspector's Manual), A17.2—1960, including Supplements A17.2a—1965 and A17.2b—1967.

(ix) Safety Code for Mechanical Power-Transmission Apparatus, B15.1—1953 (Reaffirmed 1958).

(x) Safety Code for Conveyors, Cableways, and Related Equipment, B20.1—1957.

(xi) Safety Code for Cranes, Derricks, and Hoists, B30.2—1943 (Reaffirmed 1968 and partially revised by B30.2.0—1967 and B30.5—1968).

(xii) Overhead and Gantry Cranes, B30.2.0—1967 (Partial Revision of B30.2—1943).

(xiii) Crawler, Locomotive, and Truck Cranes, B30.5—1968 (Partial Revision of B30.2—1943).

(xiv) Power Piping, B31.1.0—1967 and addenda B31.10a—1969. Fuel Gas Piping, B31.2—1968.

(xv) Safety Code for Powered Industrial Trucks, B56.1—1969.

(xvi) Identification of Gas-Mask Canisters, K13.1—1967.

(xvii) Safety Code for Woodworking Machinery, O1.1—1954 (Reaffirmed 1961).

(xviii) Requirements for Sanitation in Places of Employment, Z4.1—1968.

(xix) Safety Code for Ventilation and Operation of Open-Surface Tanks, Z9.1—1951.

(xx) Fundamentals Governing the Design and Operation of Local Exhaust Systems, Z9.2—1960.

(xxi) Prevention of Sulfur Fires and Explosions, Z12.12—1968.

(xxii) Method of Measurement of Real-Ear Attenuation of Ear Protectors at Threshold, Z24.22—1957.

(xxiii) Installation of Blower and Exhaust Systems for Dust, Stock, and Vapor Removal or Conveying, Z33.1—1961.

(xxiv) Specifications for Accident Prevention Signs, Z35.1—1968.

(xxv) Practice for Occupational and Educational Eye and Face Protection, Z87.1—1968 (Partial Revision of Z2.1—1959).

(xxvi) Practices for Respiratory Protection, Z88.2—1969.

(xxvii) Safety Requirements of Industrial Head Protection, Z89.1—1969.

(4) *Other standards.* The following standards shall be considered standards under this section:

(i) ASME Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels, including addenda 1969.

(ii) Building Exits Code for Life Safety from Fire, NFPA 101—1970.

(iii) Safety in the Handling and Use of Explosives, IME Pamphlet No. 17, July 1960, Institute of Makers of Explosives.

(b) *Safe practices*—(1) *Guards.* All driving mechanisms, power-transmission apparatus, and prime movers shall be constructed, guarded, and used in conformity with American National Standard B15.1—1963 (Reaffirmed 1958).

(2) *Personal protective clothing and equipment.* Foot protection, shin-guards, hard hats, noise attenuation devices, or other personal protective clothing and equipment shall be worn when the extent of the hazard is such as to warrant their use. Such equipment shall be worn whenever specifically required by other paragraphs of this section. All equipment shall be maintained in accordance with applicable American National Standards. Respirators, goggles, and protective masks, rubber gloves, rubber boots, and other such equipment shall be cleaned and disinfected before being used by another employee. Eye, head, respiratory, and ear protection, where specified, shall conform to American National Standards Z24.22—1957, Z87.1—1968, Z88.2—1969, and Z89.1—1969.

(3) *Floors and platforms.* Floors, platforms, and work surfaces shall be maintained in accordance with American National Standard A12.1—1967.

(4) *Lockouts.* Devices such as padlocks shall be provided for locking out the source of power at the main disconnect switch. Before any maintenance, inspection, cleaning, adjusting, or servicing of equipment (electrical, mechanical, or other) that requires entrance into or close contact with the machinery or equipment, the main power disconnect switch or valve, or both, controlling its source of power or flow of material, shall be locked out or blocked off with padlock, blank flange, or similar device.

(5) *Vessel entering.* Lifelines and safety harness shall be worn by anyone entering closed vessels, tanks, ship bins, and similar equipment, and a person shall be stationed outside in a position to handle the line and to summon assistance in case of emergency. The air in the vessels shall be tested for oxygen deficiency and the presence of both toxic and explosive gases and vapors, before entry into closed vessels, tanks, etc., is permitted. Self-contained air- or oxygen-supply masks shall be readily available in case of emergency. Work shall not be done on equipment under conditions where an injury would result if a valve were unexpectedly opened or closed unless the valve has been locked in a safe position.

(6) *Industrial power trucks.* All industrial power truck operations shall conform to American National Standard B56.1–1969. All forklift trucks shall be provided with overhead guards. All guards shall be designed in compliance with American National Standard B56.1—1969. Design requirements shall provide protection for the liquid petroleum tank.

(7) *Emergency lighting.* Emergency lighting shall be provided wherever it is necessary for employees to remain at their machines or stations to shut down equipment in case of power failure. Emergency lighting shall be provided at stairways and passageways or aisleways used by employees for emergency exit in case of power failure. Emergency lighting shall be provided in all plant first aid and medical facilities.

(c) *Handling and storage of pulpwood and pulp chips*—(1) *Handling pulpwood with forklift trucks.* Where large forklift trucks, or lift trucks with clam-jaws, are used in the yard, the operator's enclosed cab shall be provided with an escape hatch, whenever the hydraulic arm blocks escape through the side doors.

(2) *Handling pulpwood with cranes or stackers.* (i) Where locomotive cranes are used for loading or unloading pulpwood, the pulpwood shall be piled so as

to allow a clearance of not less than 24 inches between the pile and the end of the cab of any locomotive crane in use, when the cab is turned in any working position.

(ii) The minimum distance of the pulpwood pile from the centerline of a standard-gage track shall be maintained at not less than 8½ feet.

(iii) Logs shall be piled in an orderly and stable manner, with no projection into walkways or roadways.

(iv) Railroad cars shall not be spotted on tracks adjacent to the locomotive cranes unless a 24-inch clearance is maintained, as required in subdivision (i) of this subparagraph.

(v) The handling and storage of other materials shall conform to subdivisions (i) and (ii) of this subparagraph with respect to clearance.

(vi) Equipment and practices shall conform to American National Standards B30.2—1943 (Reaffirmed 1968) and B30.2.0—1967.

(vii) Personal protective equipment for such uses as foot, head, and eye protection shall be required for workers on a job basis.

(viii) No person shall be permitted to walk beneath a suspended load, bucket, or hook.

(3) *Handling pulpwood from ships.* (i) Ladders and gangplanks with railings to boat docks shall meet the requirements of American National Standards A12.1—1967, A14.1—1968, A14.2—1956, and A14.3—1956, and shall be securely fastened in place.

(ii) The hatch tender shall be required to signal the hoisting engineer to move the load only after the men working in the hold are in the clear.

(iii) The air in the ship's hold, tanks, or closed vessels shall be tested for oxygen deficiency and for both toxic and explosive gases and vapors.

(4) *Handling pulpwood from flatcars and all other railway cars.* (i) Railroad flatcars for the conveyance of pulpwood loaded parallel to the length of the car shall be equipped with safety-stake pockets.

(ii) Where pulpwood is loaded crosswise on a flatcar sufficient stakes of sizes not smaller than 4 by 4 inches shall be used to prevent the load from shifting.

(iii) When it is necessary to cut stakes, those on the unloading side should be partially cut through first, and then the binder wires cut on the opposite side. Wire cutters equipped with long extension handles shall be used. No person shall be permitted along the dumping side of the car after the stakes have been cut.

(iv) When steel straps without stakes are used, the steel straps shall be cut from a safe area to prevent employees from being struck by the falling logs.

(v) Flatcars and all other cars shall be chocked during unloading. Where equipment is not provided with hand brakes, rail clamping chocks shall be used.

(vi) A derail shall be used to prevent movement of other rail equipment into cars where persons are working.

(5) *Handling pulpwood from trucks.* (i) Cutting of stakes and binder wires shall be done in accordance with subparagraph 4(iii) of this paragraph.

(ii) Where binder chain and steel stakes are used, the binder chains shall be released and the stakes tripped from the opposite side of the load spillage.

(iii) Where binder chains and crane slings are used, the crane slings shall be attached and taut before the binder chains are released. The hooker shall see that the helper is clear before signaling for the movement of the load.

(6) *Handling pulp chips from railway cars.* (i) All cars shall be securely fastened in place and all employees in the clear before dumping is started.

(ii) Personal protective equipment for such uses as foot, head, and eye protection shall be provided, and employees shall wear the equipment when working in the woodyard. Ear protection shall be provided when the noise level may be harmful.

(7) *Handling pulp chips from trucks and trailers.* (i) All trucks and trailers shall be securely fastened in place and all employees in the clear before dumping is started.

(ii) Personal protective equipment shall be in accordance with subparagraph (6)(ii) of this paragraph.

(8) *Cranes.* (i) Crane boom and load capacities as specified by the manufacturer shall be posted in the cab of the crane in accordance with American National Standards B30.2—1943 (reaffirmed 1968) and B30.2.0—1967.

(ii) A safety device such as a heavy chain or cable at least equal in strength to the lifting cables shall be fastened to the boom and to the frame of the boom crane (if it is other than locomotive) at the base. Alternatively, a telescoping safety device shall be fastened to the boom and to the cab frame, so as to prevent the boom from snapping back over the cab in the event of lifting cable breakage.

(iii) A crane shall not be operated where any part thereof may come within 10 feet of overhead powerlines (or other overhead obstructions) unless the powerlines have been deenergized. The boom shall be painted bright yellow from and including the head sheave to a point 6 feet down the boom towards the cab.

(iv) Standard signals for the operation of cranes shall be established for all movements of the crane, in accordance with American National Standards B30.2—1943 (reaffirmed 1968) and B30.2.0—1967.

(v) Only one member of the crew shall be authorized to give signals to the crane operator.

(vi) All cranes shall be equipped with a suitable warning device such as a horn or whistle.

(vii) A sheave guard shall be provided beneath the head sheave of the boom.

(9) *Traffic warning signs or signals.* (i) A flagman shall direct the movement of cranes or locomotives being moved across railroad tracks or roads, and at any points where the vision of the operator is restricted. The flagman must always remain in sight of the operator when the crane or locomotive is in motion. The blue flag policy shall be used to mark stationary cars day and night. This policy shall include marking the track in advance of the spotted cars (flag for daytime, light for darkness).

(ii) After cars are spotted for loading or unloading, warning flags or signs shall be placed in the center of the track at least 50 feet away from the cars and a derail set to protect workmen in the car.

(10) *Illumination.* Artificial illumination shall be provided when loading or unloading is performed after dark, in accordance with American National Standard A11.1—1965 (R—1970).

(11) *Bridge or dock plates.* The construction and use of bridge or dock plates shall conform to requirements of American National Standard B56.1—1969.

(12) *Barking devices.* When barking drums are employed in the yard, the requirements of paragraph (e)(12) of this section shall apply.

(13) *Hand tools.* Handles of wood hooks shall be locked to the shank to prevent them from rotating.

(14) *Removal of pulpwood.* (i) The ends of a woodpile shall be properly sloped and cross-tiered into the pile. Upright poles shall not be used at the ends of woodpiles. To knock down wood from the woodpile, mechanical equipment shall be used to permit employees to keep in the clear of loosened wood.

(ii) If dynamite is used to loosen the pile, only authorized personnel shall be permitted to handle and discharge the explosive. An electric detonator is preferable for firing; if a fuse is used, it shall be an approved safety fuse with a burning rate of not less than 120 seconds per yard and a minimum length of 3 feet, in accordance with Safety in the Handling and Use of Explosives, IME Pamphlet No. 17, July 1960.

(15) *Belt conveyors.* (i) The sides of the conveyor shall be constructed so that the wood will not fall off.

(ii) Where conveyors cross passageways or roadways, a horizontal platform shall be provided under the conveyor extending out from the sides of the conveyor a distance equal to 1½ times the length of the wood handled. The platform shall extend the width of the road plus 2 feet on each side and shall be kept free of wood and rubbish. The edges of the platform shall be provided with toeboards or other protection to prevent wood from falling, in accordance with American National Standard A12.1—1967.

(iii) All conveyors for pulpwood shall have the inrunning nips between chain and sprockets guarded; also, turning drums shall be guarded.

(iv) Every belt conveyor shall have an emergency stop cable extending the length of the conveyor so that it may be stopped from any location along the line, or conveniently located stop buttons within 10 feet of each work station, in accordance with American National Standard B20.1—1957.

(16) *Signs.* Where conveyors cross walkways or roadways in the yards, signs

reading "Danger—Overhead Conveyor" or an equivalent warning shall be erected, in accordance with American National Standard Z35.1—1968.

(d) *Handling and storage of raw materials other than pulpwood or pulp chips*—(1) *Personal protective equipment.* (i) Whenever possible, all dust, fumes, and gases incident to handling materials shall be controlled at the source, in accordance with American National Standard Z9.2—1960. Where control at the source is not possible, respirators with goggles or protective masks shall be provided, and employees shall wear them when handling alum, clay, soda ash, lime, bleach powder, sulfur, chlorine, and similar materials, and when opening rag bales.

(ii) When handling liquid acid or alkali, workmen shall be provided with approved eye and face protection and protective clothing, in accordance with American National Standard Z87.1—1968.

(2) *Clearance.* (i) When materials are being piled inside a building and upon platforms, an aisle clearance at least 3 feet greater than the widest truck in use shall be provided.

(ii) Baled paper and rags stored inside a building shall not be piled closer than 18 inches to walls, partitions, or sprinkler heads.

(3) *Piling and unpiling pulp.* (i) Piles of wet lap pulp (unless palletized) shall be stepped back one-half the width of the sheet for each 8 feet of pile height. Sheets of pulp shall be interlapped to make the pile secure. Pulp shall not be piled over pipelines to jeopardize pipes, or so as to cause overloading of floors, or to within 18 inches below sprinkler heads.

(ii) Piles of pulp shall not be undermined when being unpiled.

(iii) Floor capacities shall be clearly marked on all floors.

(4) *Chocking rolls.* (i) Where pulp or paper rolls are of uniform size, cribbing should be constructed to keep rolls from moving.

(ii) Where rolls are pyramided two or more high, chocks shall be installed between each roll on the floor and at every row. The face of each chock should be formed on a radius to conform to the average roll size in use. Where pulp and paper rolls are stored on smooth floors in processing areas, rubber chocks with wooden core shall be used.

(iii) When rolls are decked two or more high, the bottom rolls shall be chocked on each side to prevent shifting in either direction.

(iv) A supply of portable roll chocks should be available to be used where there are gaps in the bottom row of rolls. These should be as light as possible while still providing maximum blocking effect.

(e) *Preparing pulpwood*—(1) *Gang and slasher saws.* A guard shall be provided in front of all gang and slasher saws to protect workers from wood thrown by saws. A guard shall be placed over tail sprockets.

(2) *Slasher tables.* Saws shall be stopped and power switches shall be locked out and tagged whenever it is necessary for any person to be on the slasher table.

(3) *Slasher drive belts, pulleys, and shafts.* All belts, pulleys, and shafts shall be guarded in accordance with American National Standard B15.1—1955 (Reaffirmed 1958).

(4) *Runway to the jack ladder.* The runway from the pond or unloading dock to the table shall be protected with standard handrails and toeboards. Inclined portions shall have cleats or equivalent nonslip surfacing, in accordance with American National Standard A12.1—1967. Protective equipment shall be provided for persons working over water.

(5) *Guards below table.* Where not protected by the frame of the machine, the underside of the slasher saws shall be enclosed with guards.

(6) *Conveyors.* The requirements of paragraph (c)(15)(iv) of this section shall apply.

(7) *Circular saws (not slasher saws).* Saws shall be provided with standard guards, in accordance with American National Standard 01.1—1954 (Reaffirmed 1961).

(8) *Barker feed.* Each barker shall be equipped with a feed and turnover device which will make it unnecessary for the operator to hold a bolt or log by hand during the barking operation. Eye, ear, and head protection shall be provided for the operator, in accordance with paragraph (b)(2) of this section.

(9) *Guards.* A guard shall be installed around barkers to confine flying particles, in accordance with American National Standard B15.1—1953 (Reaffirmed 1958).

(10) *Stops.* All control devices shall be locked out and tagged when knives are being changed.

(11) *Speed governor.* Water wheels, when directly connected to marker disks or grinders, shall be provided with speed governors, if operated with gate wide open.

(12) *Continuous barking drums.* (i) When platforms or floors allow access to the sides of the drums, a standard railing shall be constructed around the drums. When two or more drums are arranged side by side, proper walkways with standard handrails shall be provided between each set, in accordance with paragraph (b)(3) of this section.

(ii) Sprockets and chains, gears, and trunnions shall have standard guards, in accordance with paragraph (b)(1) of this section.

(iii) Whenever it becomes necessary for a workman to go within a drum, the driving mechanism shall be locked and tagged, at the main disconnect switch, in accordance with paragraph (b)(4) of this section.

(13) *Intermittent barking drums.* In addition to motor switch, clutch, belt shifter, or other power disconnecting device, intermittent barking drums shall be equipped with a device which may be locked to prevent the drum from moving while it is being emptied or filled.

(14) *Hydraulic brakers.* Hydraulic barkers shall be enclosed with strong baffles at the inlet and the outlet. The operator shall be protected by at least five-ply laminated glass.

(15) *Splitter block.* The block upon or against which the wood is rested shall have a corrugated surface or other means provided that the wood will not slip. Wood to be split, and also the splitting block, shall be free of ice, snow, or chips. The operator shall be provided with eye and foot protection. A clear and unobstructed view shall be maintained between equipment and workers around the block and the workers' help area.

(16) *Power control.* Power for the operation of the splitter shall be controlled by a clutch or equivalent device.

(17) *Knot cleaners.* The operators of knot cleaners of the woodpecker type shall wear eye protection equipment. Knot cleaners of the woodpecker type should be enclosed to protect passersby from flying chips.

(18) *Chipper spout.* The feed system to the chipper spout shall be arranged in such a way that the operator does not stand in a direct line with the chipper spout. All chipper spouts shall be enclosed to a height of at least 42 inches from the floor or operator's platform. If practical, a mirror should be installed to enable the chipper feeder to see the chute. When other protection is not sufficient, the operator shall wear a safety belt line. The safety belt line shall be fastened in such a manner as to make it impossible for the operator to fall into the throat of the chipper. Ear protection equipment shall be worn by the operator and others in the immediate area if there is any possibility that the noise level may be harmful (see § 1910.-95).

(19) *Carriers for knives.* Carriers shall be provided and used for transportation of knives.

(f) *Rag and old paper preparation*—(1) *Ripping and trimming tools.* (i) Hand knives and scissors shall have blunt points, shall be fastened to the table with chain or thong, and shall not be carried on the person but placed safely in racks or sheaths when not in use.

(ii) Hand knives and sharpening steels shall be provided with guards at the junction of the handle and the blade.

(2) *Shredders, cutters, and dusters.* (i) Rotating heads or cylinders shall be completely enclosed except for an opening at the feed side sufficient to permit only the entry of stock. The enclosure shall extend over the top of the feed rolls. It shall be constructed either of solid material or with mesh or openings not exceeding one-half inch and substantial enough to contain flying particles and prevent accidental contact with moving parts. The enclosure shall be bolted or locked into place.

(ii) A smooth-pivoted idler roll resting on the stock or feed table shall be provided in front of feed rolls except when arrangements prevent the operator from standing closer than 36 inches to any part of the feed rolls.

(iii) Any manually fed cutter, shredder, or duster shall be provided with an

idler roll as per subdivision (ii) of this subparagraph or the operator shall use special hand-feeding tools.

(iv) Hoods of cutters, shredders, and dusters shall have exhaust ventilation, in accordance with American National Standard Z9.2—1960.

(3) *Blowers.* (i) Blowers used for transporting rags shall be provided with feed hoppers having outer edges located not less than 48 inches from the fan.

(ii) The arrangement of the blower discharge outlets and work areas shall be such as to prevent material from falling on workers.

(4) *Conveyors.* Conveyors and conveyor drive belts and pulleys shall be fully enclosed or, if open and within 7 feet of the floor, shall be constructed and guarded in accordance with paragraph (c)(15) of this section and American National Standards B15.1—1953 (Reaffirmed 1958) and B20.1—1957.

(5) *Dust.* Measures for the control of dust shall be provided, in accordance with American National Standards Z33.1—1961, Z87.1—1968, and Z88.2—1969.

(6) *Rag cookers.* (i) When cleaning, inspection, or other work requires that persons enter rag cookers, all steam and water valves, or other control devices, shall be locked and tagged in the closed or "off" position. Blank flanging of pipelines is acceptable in place of closed and locked valves.

(ii) When cleaning, inspection, or other work requires that persons must enter the cooker, one person shall be stationed outside in a position to observe and assist in case of emergency, in accordance with paragraph (b)(5) of this section.

(iii) Supplied air respirators should be worn by persons when spreading material inside cookers.

(iv) Rag cookers shall be provided with safety valves in accordance with the ASME Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels—1968, with Addenda.

(g) *Chemical processes of making pulp*—(1) *Sulfur burners.* (i) Sulfur-burner houses shall be safely and adequately ventilated, and every precaution shall be taken to guard against dust explosion hazards and fires, in accordance with American National Standards Z9.2—1960 and Z12.12—1968.

(ii) Nonsparking tools and equipment shall be used in handling dry sulfur.

(iii) Sulfur storage bins shall be kept free of sulfur dust accumulation, and buildings should be designed with explosion relief, in accordance with American National Standard Z9.2—1960.

(iv) Electrical equipment shall be of the explosion-proof type, in accordance with the requirements of §§ 1910.322 through 1910.328.

(v) Sulfur-melting equipment shall not be located in the burner room.

(2) *Protection for employees (acid plants).* (i) Gas masks, fitted with canisters containing absorbents for the particular acids, gases, or mists involved, shall be provided for employees of the acid department.

(ii) Supplied air respirators shall be strategically located for emergency and rescue use.

(iii) During inspection, repairs, or maintenance of acid towers, the workman shall be provided with eye protection, a supplied air respirator, a safety belt, and an attached lifeline. The line shall be extended to an attendant stationed outside the tower opening.

(3) *Acid tower structure.* Outside elevators shall be inspected daily during winter months when ice materially affects safety. Elevators, runways, stairs, etc., for the acid tower shall be inspected monthly for defects that may occur because of exposure to acid or corrosive gases.

(4) *Tanks (acid).* (i) Tanks shall be free of acid and shall be washed out with water, and fresh air shall be blown into them before allowing men to enter. Men entering the tanks shall be provided with supplied air respirators, lifebelts, and attached lifelines.

(ii) A man shall be stationed outside to summon assistance if necessary. All intake valves to a tank shall be blanked off or disconnected.

(5) *Clothing.* Where lime slaking takes place, employees shall be provided with rubber boots, rubber gloves, protective aprons, and eye protection. A deluge shower and eye fountain shall be provided to flush the skin and eyes to counteract lime or acid burns.

(6) *Lead burning.* When lead burning is being done within tanks, fresh air shall be forced into the tanks so that fresh air will reach the face of the worker first and the direction of the current will never be from the source of the fumes toward the face of the workers. Supplied air respirators (constant-flow type) shall be provided.

(7) *Hoops for acid storage tanks.* Hoops of tanks shall be made of rods rather than flat strips and shall be safely maintained by scheduled inspections.

(8) *Chip and sawdust bins.* Steam or compressed-air lances, or other facilities, shall be used for breaking down the arches caused by jamming in chip lofts. No worker shall be permitted to enter a bin unless provided with a safety belt, with line attached, and an attendant stationed at the bin to summon assistance.

(9) *Exits (digester building).* At least one unobstructed exit at each end of the room shall be provided on each floor of a digester building.

(10) *Gas masks (digester building).* Gas masks shall be available. These masks shall furnish adequate protection against sulfurous acid and chlorine gases, and shall be inspected and tested at frequent intervals, not to exceed 1 month, in accordance with American National Standards Z87.1—1968, and Z88.2—1969.

(11) *Elevators.* (i) Elevators shall be constructed in accordance with American National Standard A17.1–1965.

(ii) Elevators shall be equipped with gas masks for the maximum number of passengers.

(iii) Elevators shall be equipped with an alarm system to advise of failure.

(12) *Blowoff valves and piping.* (i) The blowoff valve of a digester shall be arranged so as to be operated from another room, remote from safety valves.

(ii) Through bolts instead of cap bolts shall be used on all digester pipings.

(iii) Heavy duty pipe, valves, and fittings shall be used between the digester and blow pit. These valves, fittings, and pipes shall be inspected at least semiannually to determine the degree of deterioration and should be replaced when necessary.

(iv) Digester blow valves shall be pinned or locked in closed position throughout the entire cooking period.

(13) *Blow pits and blow tanks.* (i) Blow-pit openings shall be preferably on the side of the pit instead of on top. When located on top, openings shall be as small as possible and shall be provided with railings, in accordance with American National Standard A12.1—1967.

(ii) A specially constructed ladder shall be used for access to blow pits, to be constructed so that the door of the blow pit cannot be closed when the ladder is in place; other means shall be provided to prevent the closing of the pit door when anyone is in the pit.

(iii) A signaling device shall be installed in the digester and blow-pit rooms and chip bins to be operated as a warning before and while digesters are being blown.

(iv) Blow-pit hoops shall be maintained in a safe condition.

(14) *Blowing digester.* (i) Blowoff valves shall be opened slowly.

(ii) After the digester has started to be blown, the blowoff valve shall be left open, and the hand plate shall not be removed until the digester cook signals the blow-pit man that the blow is completed. Whenever it becomes necessary to remove the hand plate to clear stock, operators shall wear eye protection equipment and protective clothing to guard against burns from hot stock.

(iii) Means shall be provided whereby the digester cook shall signal the man in the chip bin before starting to load the digester.

(iv) When a digester is to be blown, or is blowing, red warning lights should be lighted, and these warning lights should be located in such a manner as to alert all personnel to leave whose duties do not require them to be in the vicinity of the digester during this operation.

(15) *Inspecting and repairing digester.* (i) Valves controlling lines leading into a digester shall be locked out and tagged. The keys to the locks shall be in the possession of a person or persons doing the inspecting or making repairs.

(ii) Fresh air shall be blown into the digester constantly while workmen are inside. Supplied air respirators shall be available in the event the fresh air supply fails or is inadequate.

(iii) No inspector shall enter a digester unless a lifeline is securely fastened to his body by means of a safety belt and at least one other experienced

employee is stationed outside the digester to handle the line and to summon assistance. All ladders and lifelines shall be inspected before each use.

(iv) The concentration of lead dust in the air shall not exceed the limits specified in § 1910.93.

(v) All employees entering digesters for inspection or repair work shall be provided with protective headgear. Eye protection and dust masks shall be provided to workmen while the old brick lining is being removed, in accordance with American National Standards, Z87.1—1968, Z88.2—1969, and Z89.1—1969.

(vi) Sanitary facilities shall be provided as specified in American National Standard Z4.1—1968.

(16) *Pressure tanks-accumulators (acid).* (i) Safety regulations governing inspection and repairing of pressure tanks-accumulators (acid) shall be the same as those specified in subparagraph (15) of this paragraph.

(ii) The pressure tanks-accumulators shall be inspected twice annually. (See the ASME Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels—1968, with Addenda.)

(17) *Pressure vessels (safety devices).* (i) A safety valve shall be installed in a separate line from each pressure vessel; no hand valve shall be installed between this safety valve and the pressure vessel. Safety valves shall be checked between each cook to be sure they have not become plugged or corroded to the point of being inoperative. (See the ASME Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels—1968, with Addenda.)

(ii) All safety devices shall conform to Paragraph U–2 in the ASME Boiler and Pressure Vessel Code, Section VIII, Unfired Pressure Vessels—1968, with Addenda.

(18) *Miscellaneous.* Insofar as the processes of the sulfate and soda operations are similar to those of the sulfite processes, the standard of subparagraphs (1) through (17) of this paragraph shall apply.

(i) Quick operating showers, bubblers, etc., shall be available for emergency use in case of caustic soda burns.

(ii) Rotary tenders, smelter operators, and those cleaning smelt spouts shall be provided with eye protection equipment (fitted with lenses that filter out the harmful rays emanating from the light source) when actively engaged in their duties, in accordance with American National Standard Z87.1—1968.

(iii) Heavy-duty pipe, valves, and fittings shall be used between digester and blow pit. These shall be inspected at least semiannually to determine the degree of deterioration and repaired or replaced when necessary, in accordance with American National Standards B31.1—1955, B31.1a—1963, B31.1.0—1967, and B31.2—1968.

(iv) Smelt-dissolving tanks shall be covered and the cover kept closed, except when samples are being taken.

(v) Smelt tanks shall be provided with vent stacks and explosion doors, in accordance with American National Standard Z9.1—1951.

(19) *Blow lines.* (i) Each digester should have two independent "gas-off" lines and a reducing valve in the high-pressure steam line with a safety valve between the digester and the reducing valve. Two gas-off lines are recommended so that if one plugs with pulp, the other may be used, and the hazard of unplugging with the digester under pressure overcome. With the installation of a reducing valve and a safety valve, it is improbable that pressure will exceed the maximum allowable working pressure of the digester.

(ii) Where the blow-off lines from several digesters lead into one pipe, the handles of all cocks should be set uniformly, or some equivalent arrangement should be provided so that a man can see at a glance whether all cocks are set right or not. If valves instead of cocks are provided, a type with a rising spindle should be used.

(iii) When blow lines from more than one digester lead into one pipe, the cock or valve of the blow line from the tank being inspected or repaired shall be locked or tagged out, or the line shall be disconnected and blocked off.

(20) *Furnace room.* Exhaust ventilation shall be provided where niter cake is fed into a rotary furnace and shall be so designed and maintained as to keep the concentration of hydrogen sulfide gas below the parts per million listed in § 1910.93.

(21) *Inspection and repair of tanks.* All piping leading to tanks shall be blanked off or valved and locked or tagged. Any lines to sewers shall be blanked off to protect workers from air contaminants.

(22) *Welding.* Welding on blow tanks, accumulator tanks, or any other vessels where turpentine vapor or other combustible vapor could gather shall be done only after the vessel has been completely purged of fumes. Fresh air shall be supplied workers inside of vessels.

(23) *Turpentine systems and storage tanks.* Nonsparking tools and ground hose shall be used when pumping out the tank. The tank shall be surrounded by a berm or moat.

(h) *Bleaching*—(1) *Bleaching engines.* Bleaching engines, except the Bellmer type, shall be completely covered on the top, with the exception of one small opening large enough to allow filling but too small to admit a man. This opening should be covered by a door and guarded with standard guardrail and toeboards. Platforms leading from one engine to another shall have standard guardrails, in accordance with American National Standard A12.1—1967.

(2) *Bleach mixing rooms.* (i) The room in which the bleach powder is mixed shall be provided with adequate exhaust ventilation, located at the floor level, in accordance with American National Standard Z9.1—1951.

(ii) Chlorine gas shall be carried away from the work place and breathing area by an exhaust system. The gas shall be rendered neutral or harmless before being discharged into the atmosphere. The requirements of American National Standard Z9.2—1960 shall apply to this subdivision.

(iii) Gas masks shall be provided for emergency use, in accordance with American National Standards K13.1—1967 and Z88.2—1969.

(iv) For emergency and rescue work, independent self-contained oxygen masks or supplied air equipment shall be provided. (See American National Standards Z88.2—1969.)

(3) *Liquid chlorine.* (i) Tanks of liquid chlorine shall be stored in an adequately ventilated unoccupied room, where their possible leakage cannot affect workers.

(ii) Gas masks capable of absorbing chlorine shall be supplied, conveniently placed, and regularly inspected, and workers who may be exposed to chlorine gas shall be instructed in their use.

(iii) For emergency and rescue work, independent self-contained oxygen-type masks or supplied air equipment shall be provided.

(iv) At least two exits, remote from each other, shall be provided for all rooms in which chlorine is stored.

(v) Spur tracks upon which tank cars containing chlorine and caustic are spotted and connected to pipelines shall be protected by means of a derail in front of the cars. Blue flag policy should be invoked, in accordance with paragraph (c)(9) of this section.

(vi) All chlorine, caustic, and acid lines shall be marked for positive identification, in accordance with American National Standard A13.1—1967.

(4) *Bagged or drummed chemicals.* Bagged or drummed chemicals require efficient handling to prevent damage and spillage. Certain oxidizing chemicals used in bleaching pulp and also in some sanitizing work require added precautions for safety in storage and handling. In storage, these chemicals must be isolated from combustible materials and other chemicals with which they will react, such as acids. They must also be kept dry, clean and uncontaminated.

(i) *Mechanical pulp process*—(1) *Pulp grinders.* (i) Water wheels directly connected to pulp grinders shall be provided with speed governors limiting the peripheral speed of the grinder to that recommended by the manufacturer.

(ii) Doors of pocket grinders shall be arranged so as to keep them from closing accidentally.

(2) *Butting saws.* Hood guards shall be provided on butting saws, in accordance with American National Standard O1.1—1954 (reaffirmed 1961).

(3) *Floors and platforms.* The requirements of paragraph (b)(3) of this section shall apply.

(4) *Personal protection.* Persons exposed to falling material shall wear eye, head, foot, and shin protection equipment, in accordance with American National Standards Z87.1—1968, Z88.2—1969, Z89.1—1969, and Z41.1—1967.

(j) *Stock preparation* — (1) *Pulp shredders.* (i) Cutting heads shall be completely enclosed except for an open-

ing at the feed side sufficient to permit only entry of stock. The enclosure shall be bolted or locked in place. The enclosure shall be of solid material or with mesh or other openings not exceeding one-half inch.

(ii) Either a slanting feed table with its outer edge not less than 36 inches from the cutting head or an automatic feeding device shall be provided.

(iii) Repairs for cleaning of blockage shall be done only when the shredder is shutdown and control devices locked.

(iv) All power-driven mechanisms shall be guarded in accordance with paragraph (b)(1) of this section.

(2) *Pulp conveyors.* Pulp conveyors and conveyor drive belts and pulleys shall be fully enclosed, or if open and within 7 feet of the floor, shall be constructed and guarded in accordance with American National Standard B20.1—1957.

(3) *Floors, steps, and platforms.* The requirements of paragraph (b)(3) of this section shall apply.

(4) *Beaters.* (i) Beater rolls shall be provided with covers.

(ii) Guard rails 42 inches high shall be provided around beaters where tub tops are less than 42 inches from the floor, in accordance with paragraph (b)(3) of this section and American National Standard A12.1—1967.

(iii) When cleaning, inspecting, or other work requires that persons enter the beaters, all control devices shall be locked or tagged out, in accordance with paragraph (b)(4) of this section.

(iv) When beaters are fed from floor above, the chute opening, if less than 42 inches from the floor, shall be provided with a complete rail or other enclosure. Openings for manual feeding shall be sufficient only for entry of stock and shall be provided with at least two permanently secured crossrails, in accordance American National Standard A12.1—1967.

(v) When beaters are fed manually from the floor above, conveniently located emergency stop devices should be provided at the top level.

(vi) Floors around beaters shall be provided with sufficient drainage to remove wastes.

(5) *Pulpers.* (i) All pulpers having the top or any other opening of vessel less than 42 inches from the floor or work platform shall have such openings guarded by railed or other enclosures. For manual charging, openings shall be sufficient only to permit the entry of stock and shall be provided with at least two permanently secured crossrails, in accordance with American National Standard A12.1—1967.

(ii) When cleaning, inspecting, or other work requires that persons enter the pulpers, they shall be equipped with safety belt and lifeline, and one person shall be stationed outside at a position to observe and assist in case of emergency.

(iii) When cleaning, inspecting, or other work requires that persons enter pulpers, all steam, water, or other control devices shall be locked or tagged out. Blank flanging and tagging of pipe lines is acceptable in place of closed and locked or tagged valves. Blank flanging of steam and water lines shall be acceptable in place of valve locks.

(iv) All power mechanisms shall be guarded in accordance with American National Standard B15.1—1953 (reaffirmed 1958).

(6) *Stock chests.* (i) All control devices shall be locked or tagged out when persons enter stock chests, in accordance with paragraph (b)(4) of this section.

(ii) See all power mechanisms shall be guarded in accordance with paragraph (b)(1) of this section.

(iii) When cleaning, inspecting, or other work requires that persons enter stock chests, they shall be provided with a low-voltage extension light.

(k) *Machine room*—(1) *Emergency stops.* Paper machines shall be equipped with devices that will stop the machine quickly in an emergency. The devices shall consist of push buttons for electric motive power (or electrically operated engine stops), full cords connected directly to the prime mover, control clutches, or other devices, interlocked with adequate braking action. The devices shall be tested periodically by making use of them when stopping the machine and shall be so located that any person working on the machine can quickly disconnect the machine from the source of power in case of emergency.

(2) *Drives.* (i) All drives, pulleys, couplings, and shafts on equipment requiring service while operating shall have standard guards in accordance with paragraph (b)(1) of this section.

(ii) All drives shall be provided with a lockout devices at the power switch which interrupts the flow of current to the unit.

(iii) All ends of rotating shafts including dryer drum shafts shall be completely guarded.

(iv) All accessible disengaged doctor blades should be covered.

(v) All exposed shafts shall be guarded. Crossovers shall be provided.

(vi) Oil cups and grease fittings shall be placed in a safe area remote from nip and heat hazards.

(3) *Protective equipment.* Face shields, aprons, and rubber gloves shall be provided for workmen handling acids in accordance wtih paragraphs (b)(2) and (d)(1) of this section.

(4) *Walkways.* Steps and footwalks along the fourdrinier and press section shall have nonslip surfacing and be complete with standard handrails, when practical, in accordance with paragraph (b)(3) of this section.

(5) *Floor openings.* All flush floor openings in the bottom of the wire pit should be guarded with a barrier-type guard.

(6) *Steps.* Steps of uniform rise and tread with nonslip surfaces shall be provided at each press in accrodance with American National Standard A12.1—1967.

(7) *Plank walkways.* A removable plank shall be provided along each press, with standard guardrails installed. The planks shall have nonslip surfaces in accordance with paragraph (b)(3) of this section.

(8) *Dryer lubrication.* If a gear bearing must be oiled while the machine is in operation, an automatic oiling device to protect the oiler shall be provided, or oil cups and grease fittings shall be placed along the walkways out of reach of hot pipes and dryer gears.

(9) *Levers.* All levers carrying weights shall be constructed so that weight will not slip or fall off.

(10) *First dryer.* Either a permanent guardrail or apron guard or both shall be installed in front of the first dryer in each section in accordance with paragraph (b)(1) of this section.

(11) *Steam and hot-water pipes.* All exposed steam and hot-water pipes within 7 feet of the floor or working platform or within 15 inches measured horizontally from stairways, ramps, or fixed ladders shall be covered with an insulating material, or guarded in such manner as to prevent contact.

(12) *Dryer gears.* Dryer gears shall be guarded excepting where the oilers' walkway is removed out of reach of the gears' nips and spokes and hot pipes in accordance with American National Standard B15.1—1953 (reaffirmed 1958).

(13) *Broke hole.* (i) A guardrail shall be provided at broke holes in accordance with American National Standard A12.1—1967.

(ii) Where pulpers are located directly below the broke hole on a paper machine and where the broke hole opening is large enough to permit a worker to fall through, any employee pushing broke down the hole shall wear a safety belt attached to a safety belt line. The safety belt line shall be fastened in such a manner that it is impossible for the person to fall into the pulper.

(iii) An alarm bell or a flashing light shall be actuated before dropping material through the broke hole.

(14) *Feeder belt.* A feeder belt or other effective device shall be provided for starting paper through the calendar stack.

(15) *Steps.* Steps or ladders of uniform rise and tread with nonslip surfaces shall be provided at each calendar stack. Handrails and hand grips shall be provided at each calendar stack in accordance with American National Standard A12.1—1967.

(16) *Grounding.* All calendar stacks and spreader bars shall be grounded as protection against shock induced by static electricity in accordance with the requirements of § 1910.314.

(17) *Sole plates.* All exposed sole plates between dryers, calenders, reels, and rewinders shall have a nonskid surface.

(18) *Nip points.* The hazard of the nip points on all calender rolls shall be eliminated or minimized by means of an effective barrier device, or by feeding the paper into the rolls by means of a rope carrier, air jets, or hand feeding devices. Nips where paper is not being fed into the calender should be protected by barriers. Adequate nip warning signs should be used at all nip points that cannot be guarded physically.

(19) *Platforms.* (i) A nonslip walkway with standard handrail should be provided on both sides of the stacks, in accordance with the American National Standard A12.1—1967.

(ii) A nonslip platform should also be provided at the top of the calender stack if access to that area is required for changing rolls.

(20) *Scrapers.* Alloy steel scrapers with pullthrough blades approximately 3 by 5 inches in size shall be used to remove "scabs" from calender rolls.

(21) *Illumination.* Permanent lighting shall be installed in all areas where employees are required to make machine adjustments and sheet transfers in accordance with the American National Standard A11.1—1965 (R 1970).

(22) *Control panels.* Floor stand panels should be protected from being hit by moving equipment. All control panel handles and buttons shall be protected from accidental contact.

(23) *Space between reels.* On stack reels, a clearance of at least 8 inches between the reels of paper shall be maintained.

(24) *Lifting reels.* (i) The reels shall stop rotating before being lifted from bearings.

(ii) All lifting equipment (clamps, cables, and slings) shall be maintained in a safe condition and inspected regularly.

(iii) Reel shafts with square block ends shall be guarded.

(25) *Feeder belts.* Feeder belts, carrier ropes, air carriage, or other equally effective means shall be provided for starting paper into the nip or drum-type reels.

(26) *Inrunning nip.* (i) Where the nipping point of all drum winders and rewinders is on the operator's side, it shall be guarded by barrier guards interlocked with the drive mechanism.

(ii) A zero speed switch should be installed to prevent the guard from being raised while the roll is turning.

(27) *Core collars.* Set screws for securing core collars to winding and unwinding shafts shall not protrude above the face of the collar. All edges of the collar with which an operator's hand comes in contact shall be beveled to remove all sharp corners.

(28) *Slitter knives.* Slitter knives shall be guarded so as to prevent accidental contact. Carriers shall be provided and used for transportation of slitter knives.

(29) *Winter shaft.* All shafts should be equipped with a winder collar guide. The winder shall have a guide rail to align the shaft for easy entrance into the opened rewind shaft bearing housings. If the winder is large and the rewind shafts are too heavy for manual insertion, powered rewind shaft injectors should be employed.

(30) *Core shaft.* When the core shaft weighs in excess of the safe standard, a mechanical device such as a dolly shall be provided for carrying all or part of the weight when it is being removed from the set of paper and placed in the dressing brackets on the winder. In the event that the force required to extract the shaft from the cores is excessive, even though the weight of the shaft is being supported, a powered shaft puller should be employed to relieve the operator of physical strain.

(31) *Winder area.* A nonskid surface shall be provided in the front vicinity of the winder to prevent accidental slipping.

(32) *Radiation.* Special standards regarding the use of radiation equipment shall be posted and followed as required by § 1910.96.

(l) *Finishing room*—(1) *Cleaning rolls.* Rolls shall be cleaned only on the outrunning side.

(2) *Emergency stops.* Electrically or manually operated quick power disconnecting devices, interlocked with braking action, shall be provided on all operating sides of the machine within easy reach of all employees. These devices shall be tested by making use of them when stopping the machine.

(3) *Core collars.* The requirements of paragraph (k)(27) of this section and the American National Standard B15.1—1953 (reaffirmed 1958) shall apply.

(4) *Elevators.* These shall be accordance with American National Standard A17.1—1965 shall apply.

(5) *Control panels.* The requirements of paragraph (k)(22) of this section shall apply.

(6) *Guillotine-type cutters.* (i) Each guillotine-type cutter shall be equipped with a control which requires the operator and his helper, if any, to use both hands to engage the clutch.

(ii) Each guillotine-type cutter shall be equipped with a nonrepeat device.

(iii) Carriers shall be provided and used for transportation of guillotine-type cutter knives.

(7) *Rotary cutter.* (i) On single-knife machines a guard shall be provided at a point of contact to the knife.

(ii) On duplex cutters the protection required for single-knife machines shall be provided for the first knife, and a hood shall be provided for the second knife.

(iii) Safe access shall be provided to the knives of a rotary cutter by means of catwalks with nonslip surfaces, railings, and toeboards in accordance with paragraph (b)(3) of this section.

(iv) A guard shall be provided for the spreader or squeeze roll at the nip side on sheet cutters.

(v) Electrically or manually operated quick power disconnecting devices with adequate braking action shall be provided on all operating sides of the machine within easy reach of all operators.

(vi) The outside slitters shall be guarded.

(8) *Platers.* (i) A guard shall be arranged across the face of the rolls to serve as a warning that the operator's hand is approaching the danger zone.

(ii) A quick power disconnecting device shall be installed on each machine within easy reach of the operator.

(9) *Finishing room rewinders.* (i) The nipping point of all drum winders and rewinders located on the operator's side shall be guarded by either automatic or manually operated barrier guards of sufficient height to protect fully anyone working around them. The barrier guard shall be interlocked with the drive mechanism to prevent operating above jog speed without the guard in place.

A zero speed switch should be installed to prevent the guard from being raised while the roll is turning.

(ii) A nonskid surface shall be provided in front of the rewinder to prevent an employee from slipping in accordance with paragraph (b)(3) of this section.

(iii) Mechanical lifting devices shall be provide for placing and removing rolls from the machine.

(10) *Control panels.* The requirements of paragraph (k)(22) of this section shall apply.

(11) *Roll-type embosser.* The nipping point located on the operator's side shall be guarded by either automatic or manually operated barrier guards interlocked with the drive.

(12) *Sorting and counting tables.* (i) Tables shall be smooth and free from splinters, with edges and corners rounded.

(ii) Paddles shall be smooth and free from splinters.

(13) *Roll splitters.* The nip point and cutter knife shall be guarded by either automatic or manually operated barrier guards.

(m) *Materials handling*—(1) *Hand trucks.* No person shall be permitted to ride on a powered hand truck unless it is so designed by the manufacturer. A limit switch shall be on operating handle—30 degrees each way from a 45-degree angle up and down.

(2) *Power trucks.* Power trucks shall comply with American National Standard B56.1—1969. Adequate ventilation be provided and the trucks properly maintained, so that dangerous concentrations of carbon monoxide cannot be generated, especially in warehouses or other isolated areas of a plant.

(3) *Cartons.* The carton-stitching machine shall be guarded to prevent the operator from coming in contact with the stitching head.

(4) *Banding of skids, cartons, cases, etc.* Banders and helpers shall wear eye protection equipment in accordance with paragraph (b)(2) of this section.

(5) *Unloading cars or trucks.* (i) Where steel bands or wires are used in boxcars or trucks, all loaders and helpers shall wear eye protection in accordance with paragraph (b)(2) of this section.

(ii) The construction and use of bridge or dock plates shall conform to the requirements of American National Standard B56.1—1969.

(iii) Flag signals, derails, or other protective devices shall be used to protect men during switching operations. The blue flag policy shall be invoked according to paragraph (c)(9)(i) of this section.

(n) The requirements of this § 1910.261 shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this section. In which

event, the standard shall be effective under this section upon the commencement of the Walsh-Healey requirement.

§ 1910.262 Textiles.

(a) *Application requirements*—(1) *Application.* The requirements of this subpart for textile safety apply to the design, installation, processes, operation, and maintenance of textile machinery, equipment, and other plant facilities in all plants engaged in the manufacture and processing of textiles, except those processes used exclusively in the manufacture of synthetic fibers.

(2) *Standards incorporated by reference.* Standards covering issues of occupational safety and health which are of general application without regard to any specific industry are incorporated by reference in paragraphs of this section and made applicable to textiles. All such standards shall be construed according to the rules of construction set out in § 1910.05.

(b) *Definitions applicable to this section*—(1) *Belt shifter.* A "belt shifter" is a device for mechanically shifting a belt from one pulley to another.

(2) *Belt shifter lock.* A "belt shifter lock" is a device for positively locking the belt shifter in position while the machine is stopped and the belt is idling on the loose pulleys.

(3) *Calender.* A "calender" in essence consists of a set of heavy rollers mounted on vertical side frames and arranged to pass cloth between them. Calenders may have two to ten rollers, or bowls, some of which can be heated.

(4) *Embossing calender.* An "embossing calender" is a calender with two or more rolls, one of which is engraved for producing figured effects of various kinds on a fabric.

(5) *Cans (drying).* Drying "cans" are hollow cylindrical drums mounted in a frame so they can rotate. They are heated with steam and are used to dry fabrics or yarn as it passes around the perimeter of the can.

(6) *Carbonizing.* "Carbonizing" means the removing of vegetable matter such as burns, straws, etc., from wool by treatment with acid, followed by heat. The undesired matter is reduced to a carbon-like form which may be removed by dusting or shaking.

(7) *Card.* A "card" machine consists of cylinders of various sizes—and in certain cases flats—covered with card clothing and set in relation to each other so that fibers in staple form may be separated into individual relationship. The speed of the cylinders and their direction of rotation varies. The finished product is delivered as a sliver. Cards of different types are: The revolving flat card, the roller-and-clearer card, etc.

(8) *Card clothing.* "Card clothing" is the material with which many of the surfaces of a card are covered; e.g., the cylinder, doffer, etc. It consists of a thick foundation material, usually made of textile fabrics, through which are pressed many fine, closely spaced, specially bent wires.

(9) *Comber.* A "comber" is a machine for combing fibers of cotton, wool, etc. The essential parts are a device for feeding forward a fringe of fibers at regular intervals and an arrangement of combs or pins which, at the right time, pass through the fringe. All tangled fibers, short fibers, and neps are removed and the long fibers are laid parallel.

(10) *Combing machinery.* "Combing machinery" is a general classification, including combers, sliver lap machines, ribbon lap machine, and gill boxes, but excluding cards.

(11) *Cutter (rotary staple).* A rotary staple "cutter" is a machine consisting of one or more rotary blades used for the purpose of cutting textile fibers into staple lengths.

(12) *Exposed to contact.* "Exposed to contact" shall mean that the location of an object, material, nip point, or point of operation is such that a person is liable to come in contact with it in his normal course of employment.

(13) *Garnett machine.* A "Garnett machine" means any of a number of types of machines for opening hard twisted waste of wool, cotton, silk, etc. Essentially, such machines consist of a lickerin; one or more cylinders, each having a complement worker and stripper rolls; and a fancy roll and doffer. The action of such machines is somewhat like that of a wool card, but it is much more severe in that the various rolls are covered with garnett wire instead of card clothing.

(14) *Gill box.* A "gill box" is a machine used in the worsted system of manufacturing yarns. Its function is to arrange the fibers in parallel order. Essentially, it consists of a pair of feed rolls and a series of followers where the followers move at a faster surface speed and perform a combing action.

(15) *Interlock.* An "interlock" is a device that operates to prevent the operation of machine while the cover or door of the machine is open or unlocked, and which will also hold the cover or door closed and locked while the machine is in motion.

(16) *Jig (dye).* A dye "jig" is a machine for dyeing piece goods. The cloth, at full width, passes from a roller through the dye liquor in an open vat and is then wound on another roller. The operation is repeated until the desired shade is obtained.

(17) *Kier.* A "kier" is a large metal vat, usually a pressure type, in which fabrics may be boiled out, bleached, etc.

(18) *Lapper (ribbon).* A ribbon "lapper" is a machine used to prepare laps for feeding a cotton comb; its purpose is to provide a uniform lap in which the fibers have been straightened as much as possible.

(19) *Lapper (Sliver).* A sliver "lapper" is a machine in which a number of parallel card slivers are drafted slightly, laid side by side in a compact sheet, and wound into a cylindrical package.

(20) *Loom.* A "loom" is a machine for effecting the interlacing of two series of yarns crossing one another at right angles. The warp yarns are wound on a warp beam and pass through heddles and reed. The filling is shot across in a shuttle and settled in place by reed and lay, and the fabric is wound on a cloth beam.

(21) *Mangle (starch).* A "starch mangle" is a mangle that is used specifically for starching cotton goods. It commonly consists of two large rolls and a shallow open vat with several immersion rolls. The vat contains the starch solution.

(22) *Mangle (water).* A "water mangle" is a calendar having two or more rolls used for squeezing water from fabrics before drying. Water mangles also may be used in other ways during the finishing of various fabrics.

(23) *Mule.* A "mule" is a type of spinning frame having a head stock and a carriage as its two main sections. The head stock is stationary. The carriage is movable and it carries the spindles which draft and spin the roving into the yarn. The carriage extends over the whole width of the machine and moves slowly toward and away from the head stock during the spinning operation.

(24) *Nip.* "Nip" shall mean the point of contact between two in-running rolls.

(25) *Openers and pickers.* "Openers and pickers" means a general classification which includes breaker pickers, intermediate pickers, finisher pickers, single process pickers, multiple process pickers, willow machines, card and picker waste cleaners, thread extractors, shredding machines, roving waste openers, shoddy pickers, bale breakers, feeders, vertical openers, lattice cleaners, horizontal cleaners, and any similar machinary equipped with either cylinders, screen section, calender section, rolls, or beaters used for the preparation of stock for further processing.

(26) *Paddler.* A "paddler" consists of a trough for a solution and two or more squeeze rolls between which cloth passes after being passed through a mordant or dye bath.

(27) *Point of operation.* "Point of operation" shall mean that part of the machine where the work of cutting, shearing, squeezing, drawing, or manipulating the stock in any other way is done.

(28) *Printing machine (roller type).* A "roller printing machine" is a machine consisting of a large central cylinder, or pressure bowl, around the lower part of the perimeter of which is placed a series of engraved color rollers (each having a color trough), a furnisher roller, doctor blades, etc. The machine is used for printing fabrics.

(29) *Ranges (bleaching continuous).* "Continuous bleaching ranges" are of several types and may be made for cloth in rope or open-width form. The goods, after wetting out, pass through a squeeze roll into a saturator containing a solution of caustic soda and then to an enclosed J-box. A V-shaped arrangement is attached to the front part of the J-box for uniform and rapid saturation of the cloth with steam before it is packed down in the J-box. The cloth, in a single strand rope form, passes over a guide roll down the first arm of the "V" and up the second. Steam is injected into the "V" at the upper end of the second arm so that the cloth is rapidly saturated with steam

at this point. The J-box capacity is such that cloth will remain hot for a sufficient time to complete the scouring action. It then passes a series of washers with a squeeze roll in between. The cloth then passes through a second set of saturator, J-box, and washer, where it is treated with the peroxide solution. By slight modification of the form of the unit, the same process can be applied to open-width cloth.

(30) *Range (mercerizing).* A "mercerizing range" consists generally of a 3-bowl mangle, a tenter frame, and a number of boxes for washing and scouring. The whole setup is in a straight line and all parts operate continuously. The combination is used to saturate the cloth with sodium hydroxide, stretch it while saturated, and washing out most of the caustic before releasing tension.

(31) *Sanforizing machine.* A "sanforizing machine" is a machine consisting of a large steam-heated cylinder, an endless, thick, woolen felt blanket which is in close contact with the cylinder for most of its perimeter, and an electrically heated shoe which presses the cloth against the blanket while the latter is in a stretched condition as it curves around feed-in roll.

(32) *Shearing machine.* A "shearing machine" is a machine used in shearing cloth. Cutting action is provided by a number of steel blades spirally mounted on a roller. The roller rotates in close contact with a fixed ledger blade. There may be from one to six such rollers on a machine.

(33) *Singeing machine.* A "singeing machine" is a machine used particularly with cotton; it comprises of a heated roller, plate, or an open gas flame. The material is rapidly passed over the roller or the plate or through the open gas flame to remove, fuzz or hairiness on yarn or cloth by burning.

(34) *Slasher.* A "slasher" is a machine used for applying a size mixture to warp yarns. Essentially, it consists of a stand for holding section beams, a size box, one or more cylindrical dryers or an enclosed hot air dryer, and a beaming end for finding the yarn on the loom beams.

(35) *Solvent (industrial organic).* "Industrial organic solvent" means any organic volatile liquid or compound, or any combination of these substances which are used to dissolve or suspend a nonvolatile or slightly volatile substance for industrial utilization. It shall also apply to such substances when used as detergents or cleansing agents. It shall not apply to petroleum products when such products are used as fuel.

(36) *Tenter frame.* A "tenter frame" is a machine for drying cloth under tension. It essentially consists of a pair of endless traveling chains fitted with clips of fine pins and carried on tracks. The cloth is firmly held at the selvages by the two chains which diverge as they move forward so that the cloth is brought to the desired width.

(37) *Warper.* A "warper" is any machine for preparing and arranging the yarns intended for the warp of a fabric, specifically, a beam warper.

(c) *General safety requirements*—(1) *Means of stopping machines.* Every textile machine shall be provided with individual mechanical or electrical means for stopping such machines. On machines driven by belts and shafting a locking-type shifter or an equivalent positive device shall be used. On operations where injury to the operator might result if motors were to restart after power failures, provision shall be made to prevent machines from automatically restarting upon restoration of power.

(2) *Handles.* Stopping and starting handles shall be designed to the proper length to prevent the worker's hand or fingers from striking against any revolving part, gear guard, or any other part of the machine.

(3) *Machine guarding.* Mechanical power-transmission equipment shall be guarded in conformity with § 1910.219.

(4) *Housekeeping.* Aisles and working spaces shall be kept in good order, clean and free of obstructions in accordance with requirements of § 1910.141.

(5) *Inspection and maintenance.* All guards and other safety devices, including starting and stopping devices, shall be properly maintained.

(6) *Lighting.* Lighting shall conform to American National Standard A11.1—1965.

(7) *Identification of piping systems.* Identification of piping systems shall conform to American National Standard A13.1—1956.

(8) *Identification of physical hazards.* Identification of physical hazards shall be in accordance with the requirements of § 1910.144.

(9) *Steam pipes.* All pipes carrying steam or hot water for process or servicing machinery, when exposed to contact and located within seven feet of the floor or working platform shall be covered with a heat-insulating material, or otherwise properly guarded.

(d) *Openers and pickers*—(1) *Beater guards.* When any opening or picker machinery is equipped with a beater, such beater shall be provided with metal covers which will prevent contact with the beater. Such covers shall be provided with an interlock which will prevent the cover from being raised while the machine is in motion and prevent the operation of the machine while the cover is open.

(2) *Cleanout holes.* Cleanout holes within reaching distance of the fan or picker beater shall have their covers securely fastened and they shall not be opened while the machine is in motion.

(3) *Feed rolls.* The feed rolls on all opening and picking machinery shall be covered with a guard designed to prevent the operator from reaching the nip while the machinery is in operation.

(4) *Removal of foreign ferrous material.* All textile opener lines shall be equipped with magnetic separators, tramp iron separators, or other means for the removal of foreign ferrous material.

(e) *Cotton cards*—(1) *Enclosures.* Cylinder and lickerins shall be completely protected and the doffers should be enclosed.

(2) *Enclosure fastenings.* The enclosures or covers shall be kept in place while the machine is in operation, except when stripping or grinding.

(3) *Stripping rolls.* On operations calling for flat strippings which are allowed to fall on the doffer cover, where such strippings are removed by hand, the doffer cover shall be kept closed and securely fastened to prevent the opening of the cover while the machine is in operation. When it becomes necessary to clean the cards while they are in motion, a long-handled brush or dust mop shall be used.

(f) *Garnett machines*—(1) *Lickerin.* Garnett lickerins shall be enclosed.

(2) *Fancy rolls.* Garnett fancy rolls shall be enclosed by covers. These shall be installed in a way that keeps worker rolls reasonably accessible for removal or adjustment.

(3) *Underside of machine.* The underside of the garnett shall be guarded by a screen mesh or other form of enclosure to prevent access.

(g) *Spinning mules*—A substantial fender of metal or hardwood shall be installed in front of the carriage wheels, the fender to extend to within one-fourth inch of the rail.

(h) *Slashers*—(1) *Cylinder dryers*—(i) *Reducing valves, safety valves, and pressure gages.* Reducing valves, safety valves, and pressure gages shall conform to the ASME Pressure Vessel Code, Section VIII, Unfired Pressure Vessels, 1968,

(ii) *Vacuum relief valves.* Vacuum relief valves shall conform to the ASME Code for Pressure Vessels, Section VIII, Unfired Pressure Vessels, 1968.

(iii) *Lever control.* When slashers are operated by control levers, these levers shall be connected to a horizontal bar or treadle located not more than 69 inches above the floor to control the operation from any point.

(iv) *Pushbutton control.* Slashers operated by pushbutton control shall have stop and start buttons located at each end of the machine, and additional buttons located on both sides of the machine, at the size box and the delivery end. If calender rolls are used, additional buttons shall be provided at both sides of the machine at points near the nips, except when slashers are equipped with an enclosed dryer.

(v) *Nip guards.* All nip guards shall comply with the requirements of subparagraph (2)(iv) of this paragraph.

(vi) *Cylinder enclosure.* When enclosures or hoods are used over cylinder drying rolls, such enclosures or hoods shall be provided with an exhaust system which will effectively prevent wet air and steam from escaping into the workroom.

(vii) *Expansion chambers.* Slasher kettles and cookers shall be provided with expansion chambers in the covers, or drains, to prevent surging over. Steam-control valves shall be so located that they can be operated without exposing the worker to moving parts, hot surfaces, or steam.

(2) *Enclosed hot air dryer*—(i) *Lever control.* When slashers are operated by control levers, these levers shall be connected to a horizontal bar or treadle located not more than 69 inches above the floor to control the operation from any point.

(ii) *Push-button control.* Slashers operated by push-button control shall have one start button at each end of the machine and stop buttons shall be located on both sides of the machines at intervals spaced not more than 6 feet on centers. Inching buttons should be installed.

(iii) *Dryer enclosure.* The dryer enclosure shall be provided with an exhaust system which will effectively prevent wet air and steam from escaping into the workroom.

(iv) *Nip guards.* All nip guards shall comply with Table R–1.

TABLE R–1

GUARD OPENINGS

Openings in the guard or between the guard and working surface shall not be greater than the following:

Distance of opening from nip point	*Maximum width of opening*
0 to 1½	¼
1½ to 2½	⅜
2½ to 3½	½
3½ to 5½	⅝
5½ to 6½	¾
6½ to 7½	⅞
7½ to 8½	1¼

The measurements in Table R–1 are all in inches.

(v) *Expansion chambers.* Slasher kettles and cookers shall be provided with expansion chambers into the covers, or drains, to prevent surging over. Steam control valves shall be so located that they can be operated without exposing the worker to moving parts, hot surfaces, or steam.

(i) *Warpers*—(1) *Swiveled double-bar gates.* Swiveled double-bar gates shall be installed on all warpers operating in excess of 450 yards per minute. These gates shall be so interlocked that the machine cannot be operated until the gate is in the "closed position," except for the purpose of inching or jogging.

(2) *Closed position.* "Closed position" shall mean that the top bar of the gate shall be at least 42 inches from the floor or working platform; and the lower bar shall be at least 21 inches from the floor or working platform; and the gate shall be located 15 inches from the vertical tangent to the beam head.

(j) *Drawing frames, slubbers, roving parts, cotton combers, ring spinning frames, twisters.* Gear housing covers on all installations of drawing frames, slubbers, roving frames, cotton combers, ring spinning frames, and twisters shall be equipped with interlocks.

(k) *Gill boxes*—(1) *Pin guard.* A guard shall be placed ahead of the feed end and shall be so designed that it will prevent the worker's fingers from being caught in the pins of the intersecting fallers.

(2) *Nip guards.* All nip guards shall comply with the requirements of paragraph (g)(2)(iv) of this section.

(l) *Heavy draw boxes, finishers, and speeders used in worsted drawing*—(1) *Band pulley covers.* Covers for band pulleys shall be closed when the machine is in motion.

(2) *Benches or working platforms.* Branches or working platforms approximately 10 inches in height and 8 inches in width should be installed along the entire running length of the machine for the worker to stand on while creeling the machine. Such benches or platforms shall be covered with an abrasive or nonslip material.

(m) *Silver and ribbon lappers (cotton).* Cover guard. An interlocking cover guard shall be installed over the large calendar drums and the lap spool, designed to prevent the operator from coming in contact with the nip.

(n) *Looms*—(1) *Shuttle guard.* Each loom shall be equipped with a guard designed to minimize the danger of the shuttle flying out of the shed.

(2) *Protection for loom fixer.* Provisions shall be made so that every loom fixer can prevent the loom from being started while he is at work on the loom. This may be accomplished by means of a lock, the key to which is retained in the possession of the loom fixer, or by some other effective means to prevent starting the loom.

(o) *Shearing machines.* All revolving blades on shearing machines shall be guarded so that the opening between the cloth surface and the bottom of the guard will not exceed three-eighths inch.

(p) *Continuous bleach range (cotton and rayon)*—(1) *J-box protection.* Each valve controlling the flow of steam, injurious gases, or liquids into a J-box shall be equipped with a chain, lock, and key, so that any worker who enters the J-box can lock the valve and retain the key in his possession. Any other method which will prevent steam, injurious gases, or liquids from entering the J-box while the worker is in it will be acceptable.

(2) *Open-width bleaching.* The nip of all in-running rolls on open-width bleaching machine rolls shall be protected with a guard to prevent the worker from being caught at the nip. The guard shall extend across the entire length of the nip.

(q) *Kiers*—(1) *Reducing valves, safety valves, and pressure gages.* Reducing valves, safety valves, and pressure gages shall conform to the ASME Code for Unfired Pressure Vessels, Section VIII, Unfired/Pressure Vessels, 1968.

(2) *Kier valve protection.* Each valve controlling the flow of steam, injurious gases, or liquids into a kier shall be equipped with a chain, lock, and key, so that any worker who enters the kier can lock the valve and retain the key in his possession. Any other method which will prevent steam, injurious gases, or liquids from entering the kier while the worker is in it will be acceptable.

(r) *Gray and white bins.* On new installations guard rails conforming to § 1910.23 shall be provided where workers are required to plait by hand from the top of the bin so as to protect the worker from falling to a lower level.

(s) *Mercerizing range (piece goods)*—(1) *Stopping devices.* A stopping device shall be provided at each end of the machine.

(2) *Frame ends.* A guard shall be installed at each end of the frame between the in-running chain and the clip opener, to prevent the worker's fingers from being caught.

(3) *Mangle and washers.* The nip at the in-running rolls shall conform to § 1910.264.

(t) *Tenter frames*—(1) *Stopping devices.* A stopping device shall be provided at each end of the machine.

(2) *Frame ends.* A guard shall be installed at each end of the frame at the in-running chain and clip opener.

(3) *Oil cups.* Oil cups shall be safety located to permit easy access.

(u) *Dyeing jigs*—(1) *Stopping devices.* Each dye jig shall be equipped with individual mechanical or electrical means for stopping the machine.

(2) *Roll arms.* Roll arms on jigs shall be built to allow for extra large batches, and to prevent the center bar from being forced off, causing the batch to fall.

(v) *Padders—Nip guards.* All nip guards shall comply with the requirements of paragraph (g)(2)(iv) of this section.

(w) *Drying cans*—(1) *Pressure reducing valves and pressure gages.* Pressure reducing valves and pressure gages shall conform to the ASME Code for Pressure Vessels, Section VIII, 1968, Unfired Pressure Vessels.

(2) *Vacuum collapse.* If cans are not designed to prevent vacuum collapse, each can shall be equipped with one or more vacuum relief valves with openings of sufficient size to prevent the collapse of the can if vacuum occurs.

(x) *Flat-work ironer*—(1) *Feed rolls.* The feed rolls shall be guarded to conform to § 1910.262.

(2) *Pressure rolls.* Pressure rolls shall be covered or guarded to conform to § 1910.262.

(y) *Extractors*—(1) *Centrifugal extractor*—(i) *Cover.* Each extractor shall be equipped with a metal cover.

(ii) *Interlocking device.* Each extractor shall be equipped with an interlocking device that will prevent the cover from being opened while the basket is in motion, and also prevent the power operation of the basket while the cover is open.

(iii) *Brakes.* Each extractor shall be equipped with a mechanically or electrically operated brake to quickly stop the basket when the power driving the basket is shut off.

(iv) *Maximum allowable speed.* Each centrifugal extractor shall be effectively secured in position on the floor or foundation so as to eliminate unnecessary vibration, and should not be operated at a speed greater than the manufacturer's rating, which shall be stamped where easily visible in letters not less than one-quarter inch in height. The maximum allowable speed shall be given in revolutions per minute (rpm).

(2) *Engine drum extractor—Overspeed governor.* Each engine individually driving an extractor shall be provided with an approved engine stop and speed limit governor.

(3) *Squeezer or wringer extractor—Nip guards.* All nip guards shall comply with the requirements of paragraph (g)(2)(iv) of this section.

(z) *Nip guards.* All nip guards for water mangle, starch mangle, backwasher (worsted yarn) crabbing machines, decating machines, shall comply with the requirements of paragraph (g)(2)(iv).

(aa) *Sanforizing and palmer machine.* A safety trip rod, cable, or wire center cord shall be provided across the front and back of all palmer cylinders extending the length of the face of the cylinder. It shall operate readily whether pushed or pulled. This safety trip shall be not more than 72 inches above the level on which the operator stands and shall be readily accessible.

(bb) *Rope washers—(1) Splash guard.* Splash guards shall be installed on all rope washers unless the machine is so designed as to prevent the water or liquid from splashing the operator, the floor, or working surface.

(2) *Safety stop bar.* A safety trip rod, cable or wire center cord shall be provided across the front and back of all rope washers extending the length of the face of the washer. It shall operate readily whether pushed or pulled. This safety trip shall be not more than 72 inches above the level on which the operator stands and shall be readily accessible.

(cc) *Laundry washer tumbler or shaker—(1) Interlocking device.* Each drying tumbler, each double cylinder shaker or clothes tumbler, and each washing machine shall be equipped with an interlock device which will prevent the power operation of the inside cylinder when the outer door on the case or shell is open, and which will also prevent the outer door on the case or shell from being opened without shutting off the power. This should not prevent the movement of the inner cylinder by means of a hand operated mechanism or an "inching device."

(2) *Means of holding covers or doors in open position.* Each enclosed barrel shall also be equipped with adequate means for holding open the doors or covers of the inner and outer cylinders or shells while it is being loaded or unloaded.

(dd) *Printing machine (roller type)—(1) Nip Guards.* All nip guards shall comply with the requirements of paragraph (g)(2)(iv) of this section.

(2) *Crown wheel and roller gear nip protection.* The engraved roller gears and the large crown wheel shall be provided with a protective disc which will enclose the nips of the in-running gears. Individual discs for each nip will be acceptable.

(ee) *Calenders.* The nip at the in-running side of the rolls shall be provided with a guard extending across the entire length of the nip and arranged to prevent the fingers of the workers from being pulled in between the rolls or between the guard and the rolls, and constructed so that the cloth can be fed into the rolls safely.

(ff) *Rotary staple cutters.* A guard shall be installed completely enclosing the cutters to prevent the hands of the operator from reaching the cutting zone.

(gg) *Clothing folding machine.* The crank arm and blade guide rods on both sides of the cloth-folding machines shall be protected from contact by barrier guards constructed to conform to the requirements of § 1910.217.

(hh) *Hand bailing machine.* An angle-iron-handle stop guard shall be installed at the right angle to the frame of the machine. The stop guard shall be so designed and so located that it will prevent the handle from traveling beyond the vertical position should the handle slip from the operator's hand when the pawl has been released from the teeth of the takeup gear.

(ii) *Roll bench.* Cleats shall be installed on the ends of roll benches.

(jj) *Cuttle or swing folder (overhead type).* The bottom of the overhead folders shall be located not less than 7 feet from the floor or working surface.

(kk) *Color-mixing room.* Floors in color-mixing rooms shall be constructed to drain easily.

(ll) *Open tanks and vats for mixing and storage of hot or corrosive liquids—(1) Protection against falls.* Open tanks and vats containing hot or corrosive liquids shall be protected to conform to the requirements of § 1910.23.

(2) *Shutoff valves.* Boiling tanks, caustic tanks, and hot liquid containers, so located that the operator cannot see the contents from the floor or working area, shall have emergency shutoff valves controlled from a point not subject to danger of splash. Valves shall conform to the ASME Pressure Vessel Code, section VIII, Unfired Pressure Vessels, 1968.

(mm) *Dye kettles and vats.*—Pipes or drains of sufficient capacity to carry the contents safely away from the working area shall be installed where there are dye kettles and vats which may at any time contain hot or corrosive liquids. These shall not empty directly onto the floor.

(nn) *Acid carboys.* Carboys shall be provided with inclinators, or the acid shall be withdrawn from the carboys by means of pumping without pressure in the carboy, or by means of hand operated siphons.

(oo) *Handling caustic soda and caustic potash.* Means shall be provided for handling and emptying caustic soda and caustic potash containers to prevent workers from coming in contact with the caustic (see paragraph (qq) of this section).

(pp) *First aid.* Wherever acids or caustics are used, provision shall be made for a copious and flowing supply of fresh, clean water.

(qq) *Personal protective equipment—(1) Personal protective equipment.* Workers engaged in handling acids or caustics in bulk, repairing pipe lines containing acids or caustics, etc., shall be provided with protective occupational (safety) equipment to conform to the requirements of § 1910.132, § 1910.133, and § 1910.134.

(2) Respirators, gas masks, and such appliances, for emergency use only, shall be of a type required by § 1910.134.

(rr) *Workroom ventilation.* In all workrooms in which potentially toxic substances are used, the maximum allowable concentrations listed in § 1910.93 shall be maintained. Open surface tanks shall conform to the requirements of § 1910.94(d).

§ 1910.263 Bakery equipment.

(a) *General requirements—(1) Application.* The requirements of this section shall apply to the design, installation, operation and maintenance of machinery and equipment used within a bakery.

(2) *Standards incorporated by reference.* Standards covering issues of occupational safety and health which are of general application without regard to any specific industry are incorporated by reference in paragraphs of this section and made applicable to bakeries. All such standards shall be construed according to the rules of construction set out in § 1910.05.

(b) *Definitions applicable to this section—(1) Dumpbin and blender.* The term "dumpbin and blender" applies to those elements of a flour handling system in which flour in bags is first emptied for distribution.

(2) *Flour elevator.* The term "flour elevator" means the conveyor which is used to convey flour in a vertical direction and it includes bucket, spiral screw, or bulkflow conveyors.

(3) *Screw conveyor.* The term "screw conveyor" means the conveyor which is used to convey flour in a horizontal or inclined plane by means of a continuous spiral screw enclosed in a suitable casing which follows the same general contour of the perimeter of the screw.

(4) *Bolting reel.* The term "bolting reel" means a device in which the flour is screened through a rotating drum.

(5) *Sifter.* The term "sifter" means a device in which flour is sifted. It may be of the brush, oscillating, or vibrating type.

(6) *Flour scale.* The term "flour scale" means a scale for weighing flour.

(7) *Flour gate.* The term "flour gate" means the device or devices used to control the delivery of flour.

(8) *Direct fired ovens.* Direct fired ovens are ovens which burn fuel directly inside the baking chamber.

(9) *Direct recirculating ovens.* "Direct recirculating ovens" are ovens which have heating systems consisting of one or more heaters (located inside or outside the baking chamber), each heater being equipped with a burner, the products of combustion of which are mixed with spent gasses returned from the oven. Combustion gases are circulated through the heater and oven chamber by a fan. An overflow or vent removes part of the spent combustion gases to

compensate for fresh combustion gases added by the burner.

(10) *Flue-type ovens.* "Flue-type ovens" are ovens which burn fuel in a furnace which is connected through flues which carry the combustion gases to a stack.

(11) *Indirect multiple-burner ovens.* "Indirect multiple-burner ovens" are ovens which are heated by burners (usually gas) which are totally enclosed in such a way that unburned gases or products of combustion cannot enter the baking chamber.

(12) *Steam-tube ovens.* "Steam-tube ovens" are ovens which are heated by a group of tubes which are partially filled with liquid and sealed at both ends. A small part of each tube is exposed to the heat of a furnace and the larger part placed inside the baking chamber. Heat is transmitted by evaporating liquid in the furnace end of the tube. Steam thus formed travels to the other end of the tube, where the steam condenses and returns to the furnace by gravity.

(13) *Indirect recirculating ovens.* "Indirect recirculating ovens" are ovens which are equipped with a gas tight duct system, a furnace, and a circulating fan. Gases of combustion are circulated through this enclosed system and mixed with fresh combustion gases generated by the burner in the combustion chamber. A vent or overflow removes a portion of the gases to compensate for the fresh gases added by the burner. No unburned gases or products of combustion have access to the baking chamber.

(14) *Electric ovens.* "Electric ovens" are ovens which are heated entirely by passing an electric current through resistance elements.

(c) *General machine guarding*—(1) *Electrical grounding.* The frame of each machine which is driven by an electric motor or has any electrical connection shall be effectively grounded.

(2) *Gears.* All gears shall be completely enclosed regardless of location.

(3) *Sprockets and V-belt drives.* Sprockets and V-belt drives located within reach from platforms or passageways or located within 8 feet 6 inches from the floor shall be completely enclosed.

(4) *Rotating parts.* Lubrication fittings on rotating parts shall be recessed or covered with collars so that the rotating surface will be smooth and flush.

(5) *Lubrication.* Where machinery must be lubricated while in motion, stationary lubrication fittings inside a machine shall be provided with extension piping to a point of safety so that the employee will not have to reach into any dangerous part of the machine when lubricating.

(6) *Removable covers or guards.* Any covers or guards which must be removed for cleaning and adjustment shall be made easily removable in order that they may be removed and replaced with the least effort.

(7) *Ventilation through machine guards.* Where it is necessary to guard motors or other equipment which require ventilation, guards should be so designed that they will not restrict the circulation of the air.

(8) *Hot pipes.* Exposed hot water and steam pipes shall be covered with insulating material wherever necessary to protect employee from contact.

(d) *Flour-handling equipment.*—(1) *General requirements for flour handling.* (i) Wherever any of the various pieces of apparatus comprising a flour-handling system are run in electrical unity with one another the following safeguards shall apply:

(*a*) Each apparatus shall be properly safeguarded by of disconnecting means for the motor circuits as required by §§ 1910.312 and 1910.320.

(*b*) Wherever a flour-handling system is of such size that the beginning of its operation is far remote from its final delivery end, all electric motors operating each apparatus comprising this system shall be controlled at each of two points, one located at each remote end, either of which will stop all motors.

(*c*) Motor control switches shall be capable of being locked in the open position.

(*d*) Control circuits for magnetic controllers shall be so arranged that the opening of any one of several limit switches, which may be on an individual unit, will serve to de-energize all of the motors of that unit.

(ii) Removable covers on all flour-handling equipment shall be so designed that the lifting effort shall not be more than 50.

(iii) Wherever flour-handling systems are of large construction, suitable walkways or platforms or both shall be constructed around and over bins and apparatus, in accordance with the requirements of §§ 1910.22 and 1910.23.

(*a*) All walkway surfaces shall be maintained in nonslip condition.

(*b*) Elevated walkways shall have railings and toeboards.

(*c*) All ladders leading to upper walkways shall be in accordance with the requirements of § 1910.25, § 1910.26, and § 1910.27.

(*d*) Wherever walkways are near the ceiling construction of the building, where obstruction to head room is lower than normal standing height, proper methods shall be provided to warn any occupant of the walkway. This should be done by means of "tell tales" or other suitable means located ahead of the obstruction. Suitable signs shall also be placed on walkways warning occupants of possible danger.

(iv) All oscillating and vibrating sifters shall be protected with guard rails of suitable height and design.

(v) All mechanical transmission shafting, gearing, and sprocket drives shall be completely guarded, preferably with dust-tight housing. Lubrication fittings shall extend to the outside of the guard.

(vi) All guards shall be readily removable.

(vii) All flour-handling equipment, each individual unit or the entire system collectively, shall be so constructed that all interior or exterior protruding corners are of a rounded nature.

(viii) When Class II hazardous conditions prevail, electric motors, motor controllers, and switches shall be of the type approved for such locations in accordance with the requirements of § 1910.326.

(2) *Bag chutes and bag lifts (bag-arm elevators).* (i) Bag chutes (gravity chutes for handling flour bags) shall be so designed so as to keep to a minimum the speed of flour bags. If the chute inclines more than 30° from the horizontal, there shall be an upturn at the lower end of the chute to slow down the bags.

(ii) Bag-arm elevators with manual takeoff shall be designed to operate at a capacity not exceeding seven bags per minute. The arms on the conveyor chain shall be so spaced as to obtain the full capacity of the elevator with the lowest possible chain speed. There shall be an electric limit switch at the unloading end of the bag-arm elevator so installed as to automatically stop the conveyor chain if any bag fails to clear the conveyor arms.

(iii) The conveyor chain on bag-arm elevators shall travel in a suitable structure and all drums shall be completely guarded, so that in case of a broken chain link the remainder of the chain will remain within its guides.

(iv) Man lifts shall be prohibited in bakeries. Bag or barrel lifts shall not be used as man lifts.

(3) *Dumpbin and Blender.* (i) The dumpbin or blender shall be constructed of metal or other nonsplintering material.

(ii) Openings shall be protected by means of bars or grids. If grids are made of mesh, the openings shall be not more than 3 inches in either length or width. If parallel bars or rods are used, they shall be spaced not more than 3 inches apart on centers.

(iii) Hinged dumpbin covers shall be provided with locks or latches to hold the covers in the open position, so that they will not accidentally fall down while the dumpbin is in operation.

(iv) Dumpbins and blenders shall be so constructed that no separate pits in floors shall be required at the point which connects the final discharge to the usual elevator.

(v) All dumpbin and blender hoods shall be of sufficient capacity to prevent circulation of flour dust outside the hoods.

(vi) All dumpbins shall be of a suitable height from floor to enable the operator to dump flour from bags, without causing undue strain or fatigue. Where the edge of any bin is more than 24 inches above the floor, a bag rest step shall be provided.

(vii) A control device for stopping the dumpbin and blender shall be provided close to the normal location of the operator.

(viii) A screen shall be provided in the suction nozzle over the bin or blender to prevent sacks that are being cleaned from getting into the rotor of the dust collecting fan.

(4) *Flour elevators.* (i) Flour elevators shall be constructed of metal or other nonsplintering material.

(ii) All removable sections of the elevator casing shall be equipped with suita-

ble stationary clamps for quick removal, or shall be equipped with equivalent locking devices which contain no loose parts which may become detached from either the casing or the cover.

(5) *Bolting reels.* (i) Bolting reels shall be constructed of metal or other nonsplintering material, with the exception of the bolting cloth.

(ii) Refuse tailing spouts shall be readily accessible and shall be located at a safe distance from unguarded moving parts.

(6) *Storage bins.* (i) Storage bins shall be constructed of metal or other nonsplintering material.

(ii) Storage bins shall be provided with gaskets and locks or latches to keep the cover closed, or other equivalent devices in order to insure the dust tightness of the cover. Covers at openings where an employee may enter the bin shall also be provided with a hasp and a lock, so located that the employee may lock the cover in the open position whenever it is necessary to enter the bin.

(iii) Storage bins where the side is more than 5 feet in depth shall be provided with standard stationary safety ladders, both inside and outside, to reach from floor level to top of bin and from top of bin to inside bottom, keeping the ladder end away from the moving screw conveyor.

(iv) Loading distribution conveyors shall be located in top of bin centrally unhoused, and all covers for entrance to the bins shall be located away from the loading distribution conveyor.

(v) An electric limit switch or other suitable protective device shall be provided in the top of the bin centrally over the loading screw conveyor on the opposite end of the flour entrance opening. It shall be so designed as to stop the loading screw if an excessive amount of flour is delivered to the bin.

(vi) The main entrance cover of large storage bins located at the interior exit ladder shall be provided with an electric interlock for motors operating both feed and unloading screw, so that these motors cannot operate while the cover is open.

(7) *Screw conveyors.* (i) Screw conveyors shall be constructed of metal or other nonsplintering material.

(ii) Each dead-end screw conveyer shall be provided with an overflow safety gate which will operate an electric limit switch to shut down the conveyer before dangerous pressure of material is built up at the dead end.

(iii) The covers of all screw conveyors shall be made removable in convenient sections, held on with stationary clamps located at proper intervals keeping all covers dust-tight. Where drop or hinged bottom sections are provided this provision shall not apply.

(8) *Sifters.* (i) Enclosures of all types of flour sifters shall be so constructed that they are dust-tight but readily accessible for interior inspection.

(ii) Oscillating and vibrating sifters shall be so constructed that all moving parts are well within the outer frame of the apparatus.

(iii) Refuse tailing spouts of all types of sifters shall be readily accessible and shall be located at a safe distance from unguarded moving parts.

(9) *Flour scales.* (i) Flour scales shall be constructed of metal or other nonsplintering material.

(ii) Where a transparent covering is provided over dial scales it shall be made of a nonshatterable transparent material.

(iii) Traveling or track-type scales shall be equipped with bar handles for moving same. The bar should be at least 1 inch in diameter and well away from trolley track wheels.

(iv) All moving trolley wheels located within 8 feet 6 inches of floors or platforms shall be fully guarded on sides and ahead of rotating motion.

(v) The scale cutoff switch shall be totally enclosed and connected to the scale beam in such a manner as to protect the operator from contact.

(vi) Where two or more scales are used on travelling flour scales, interlocks shall be provided so that the gate will not open unless the hopper is below.

(10) *Automatic flour gates.* Automatic flour-gate equipment shall be constructed of metal or other nonsplintering material.

(e) *Mixers*—(1) *Horizontal dough mixers.* (i) Mixers with external power application shall have all belts, chains, gears, pulleys, sprockets, clutches, and other moving parts completely enclosed.

(ii) Mixers with built-in power units shall have all drive elements enclosed in such a manner as to prevent injury to operators or maintenance personnel performing their normal duties.

(iii) Each mixer shall be equipped with an individual motor and control, and with a conventiently located manual switch to prevent the mixer from being started in the usual manner while the machine is being serviced and cleaned.

(iv) All electrical control stations shall be so located that the operator must be in full view of the bowl in its open position. No duplication of such controls other than a stop switch shall be permitted.

(v) All mixers with power and manual dumping arrangements shall be equipped with safety devices which shall:

(*a*) Engage both hands of the operator, when the agitator is in motion under power, and while the bowl is opened more than one-fifth of its total opening.

(*b*) Prevent the agitator from being started, while the bowl is more than one-fifth open, without engaging both hands of the operator;

(*c*) Permit the operator to have a full view of the bowl opening while he is in the act of maintaining operation of the agitator at any time while the bowl is more than one-fifth open.

(vi) Mixers with power dumping devices shall be arranged so that the bowl opening cannot be closed beyond four-fifths of its total opening unless the operator maintains the control contact which causes the dump motor to complete the bowl closure. Alternatively the control may be so arranged that the operator must keep at least one hand engaged, by holding in a push button, during the entire closure of the mixing bowl.

(vii) Mixers shall be provided with flour-gate operating mechanisms, ingredient openings, and water inlets, which can be conveniently manipulated by the operator from the normal area of activity (either platform or floor) without requiring abnormal reaching, or improvisations which might jeopardize his safety.

(viii) Every mixer shall be equipped with a full enclosure over the bowl which is closed at all times while the agitator is in motion. Only minor openings in this enclosure, such as ingredient doors, flour inlets, etc., each representing less than 1½ square feet in area, shall be capable of being opened while the mixer is in operation.

(ix) No loose access doors and covers weighing more than 2 pounds shall be used on mixers. Such parts shall be hinged or otherwise held in proximity to the openings that they cover.

(x) Overhead covers or doors which are subject to accidental closure shall be counterbalanced to remain in an open position or provided with means to hold them open until positively released by the operator.

(xi) Provision shall be made to bolt mixers solidly to the floor to prevent dislocation or excessive vibration, and no open space between mixers and platforms shall be permitted which may endanger the operator.

(xii) Mixers shall be installed only on substantial foundations which are capable of safely withstanding the live loads incurred in full-capacity mixing operations.

(xiii) Access for lubrication at all points shall be provided so as to avoid contact between the lubricating device or the operator's hands and any moving parts.

(xiv) Any device or mechanism used to return "sponges" to a mixer shall be so interlocked with the mixer as to prevent injury to the operator.

(xv) No electrical pilot or control circuits shall be employed at a potential in excess of 240 volts.

(xvi) A motor-running overcurrent protective device shall be provided for each motor. Undervoltage protection shall be provided in all magnetic controllers.

(xvii) Positive means shall be provided to prevent application of pressure above the stipulated maximum in all mixer cooling jackets.

(xviii) Valves and controls to regulate the coolant in mixer jackets shall be located so as to permit access by the operator without jeopardizing his safety.

(2) *Vertical Mixers.* (i) Vertical mixers shall comply with subdivisions (i), (ii), (iii), (x) through (xiv), (xvi), and (xvii) of subparagraph (1) of this paragraph.

(ii) Positive means shall be provided to prevent injury to the operator during speed-change manipulation.

(iii) Bowl locking devices shall be of a positive type which require the attention of the operator for unlocking.

(iv) Devices shall be made available for moving bowls weighing more than 80 pounds, with contents, into and out of the mixing position on the machine.

(v) Every precaution which does not impair the normal operation of the mixer shall be exercised in providing protection of the operator against injury by the moving agitators.

(f) *Dividers*—(1) *Pinch and shear points.* All pinch points and shear points from reciprocating or rotating parts of the divider shall be enclosed or guarded, to protect the operator's hands and fingers from these hazards.

(2) *Front guards.* Guards at front of a divider shall be so arranged that the weight of dough can be adjusted without removing the guard.

(3) *Rear of divider.* The back of the divider shall have a complete cover to enclose all of the moving parts, or each individual part shall be enclosed or guarded to remove the separate hazards. The rear cover shall be provided with a limit switch in order that the machine cannot operate when this cover is open. The guard on the back shall be hinged so that it cannot be completely removed and if a catch or brace is provided for holding the cover open, it shall be designed so that it will not release due to vibrations or minor bumping whereby the cover may drop on an employee.

(4) *Oil holes in knife.* The oil holes in the knife at the back of the divider shall be of such size that an employee's finger cannot go through the hole.

(5) *Knife actuating arm.* There shall be a saddle guard or other protective device on any elongated hole in the knife actuating arm at the back of the divider.

(6) *Shear pins.* Dividers shall be equipped with mechanical overload release devices such as sheer pins.

(g) *Moulders*—(1) *Hoppers.* Mechanical feed moulders shall be provided with hoppers so designed and connected to the proofer that an employee's hands cannot get into the hopper where they will come in contact with the in-running rolls.

(2) *Hand-fed moulders.* Hand-fed moulders shall be provided with a belt-feed device or the hopper shall be extended high enough so that the hands of the operator cannot get into the feed rolls. The top edge of such a hopper shall be well rounded to prevent injury when it is struck or bumped by the employee's hand.

(3) *Stopping devices.* There shall be a stopping device within easy reach of the operator who feeds the moulder and another stopping device within the reach of the employee taking the dough away from the moulder.

(4) *Cleanout holes.* Machines shall be so designed that there is no shear point in close proximity to the cleanout holes.

(5) *Rear of moulders.* At the rear of moulders all revolving shafts shall have round corners or cylindrical surfaces, and all bolts shall be flush. Tie rods shall be far enough from revolving parts to prevent a shearing or pinching hazard.

(6) *Adjustment crank.* Where a removable crank is used to adjust the moulder for different sizes of loaf, brackets shall be provided on the side of the machine for holding the crank when it is not in use.

(h) *Manually fed dough brakes*—(1) *Top-roll protection.* The top roll shall be protected by a heavy gage metal shield extending over the roll to go within 6 inches of the hopper bottom board. The shield may be perforated to permit observation of the dough entering the rolls.

(2) *Emergency stop bar.* An emergency stop bar shall be provided, so located that the body will press against it if the operator slips and falls toward the rolls, or if the operator gets his hand caught in the rolls, and this pressure shall positively open a circuit which will deenergize the drive motor. In addition a magnetic, spring-set brake shall be deenergized at the same time, causing the rolls to stop instantly. The emergency stop bar shall be checked every 30 days.

(i) *Miscellaneous equipment*—(1) *Proof boxes.* All door locks shall be operable both from within and outside the box. Guide rails shall be installed to center the rack as it enters, passes through, and leaves the proof box.

(2) *Fermentation room.* Fermentation room doors shall have nonshatterable wire glass or plastic panels for vision through doors.

(3) *Troughs.* Troughs shall be mounted on antifriction bearing casters thus making it possible for the operator to move and direct the motion of the trough with a minimum of effort.

(4) *Hand trucks.* (i) Casters shall be set back from corners to be out of the way of toes and heels, but not far enough back to cause the truck to be unstable.

(ii) A lock or other device shall be provided to hold the handle in vertical position when the truck is not in use.

(5) *Lift trucks.* A lock or other device shall be provided to hold the handle in vertical position when the truck is not in use.

(6) *Racks.* (i) Sharp splintered or rough corners and edges shall be eliminated.

(ii) Racks shall be equipped with handles so located with reference to the frame of the rack that no part of the operator's hands extends beyond the outer edge of the frame when holding onto the handles.

(iii) Antifriction bearing casters shall be used to give the operator better control of the rack.

(iv) End guards shall be used at shelf levels on proofing racks.

(7) *Conveyors.* (i) Wherever a conveyor passes over a main aisleway, regularly occupied work area, or passageway, the underside of the conveyor shall be completely enclosed to prevent broken chains or other material from falling in the passageway.

(ii) Stop bumpers shall be installed on all delivery ends of conveyors, wherever manual removal of the product carried is practiced.

(iii) Where hazard of getting caught exists a sufficient number of stop buttons shall be provided to enable quick stopping of the conveyor.

(8) *Overhead rail systems.* (i) Handles for operating devices for trolley switches which hang less than 6 feet 8 inches from the floor shall be of pliable material.

(ii) Floor scales. Nonshatterable transparent material shall be used to cover dials.

(9) *Dough chutes.* The entrance to the chute shall be guarded so as to protect the employee from falling into chute, stepping into chute, or tripping over too low an edge of the chute.

(10) *Skids.* (i) All sharp corners or edges shall be eliminated on all metal skids.

(ii) All edges and corners shall be protected on skids to prevent exposed splinters.

(11) *Ingredient premixers, emulsifiers, etc.* (i) All top openings shall be provided with covers attached to the machines. These covers should be so arranged and interlocked that power will be shutoff whenever the cover is opened to a point where the operator's fingers might come in contact with the beaters.

(ii) Portable electrical agitators for ingredient premixers shall have the attachment cord so wired that the agitator will be grounded whenever it is connected to a source of power.

(12) *Chain tackle.* (i) All chain tackle shall be marked prominently, permanently, and legibly with maximum load capacity.

(ii) All chain tackle shall be marked permanently, and legibly with minimum support specification.

(iii) Safety hooks shall be used.

(13) *Trough hoists, etc.* (i) All hoists shall be marked prominently, permanently, and legibly with maximum load capacity.

(ii) All hoists shall be marked permanently and legibly with minimum support specifications.

(iii) Safety catches shall be provided for the chain so that the chain will hold the load in any position.

(iv) Safety hooks shall be used.

(14) *Air-conditioning units.* (i) All sharp corners and edges shall be eliminated.

(ii) On large units with doors to chambers large enough to be entered, all door locks shall be operable from both inside and outside.

(15) *Pan washing tanks.* (i) Counterbalanced hinged covers, or sliding covers, shall be provided.

(ii) The surface of the floor of the working platform shall be maintained in nonslip condition.

(iii) Working platforms shall be kept at least 32 inches below the top of the tank or guardrail.

(iv) All electrical sockets in pan washing rooms shall be nonmetallic and keyless and other electrical equipment shall be moisture proof.

(v) Power ventilated exhaust hoods shall be provided over the tanks.

(16) *Pan washing machines.* Sharp corners and edges shall be eliminated.

(17) *Cake depositors.* All pinch points shall be eliminated, guarded, or shielded so that hands and arms cannot reach these pinch points while the machine is in operation.

(18) *Icing machines.* All pinch points shall be eliminated, or provided with guards or shields so hands and arms cannot reach these pinch points while the machine is in operation.

(19) *Bread coolers, conveyor type.* (i) All pinch points shall be eliminated or guarded.

(ii) Stop bumpers on all delivery ends of conveyors shall be installed wherever manual removal of the product carried is practiced.

(20) *Bread coolers, rack type.* (i) Guardrails shall be installed to the center rack as it enters and leaves the cooler.

(ii) All door locks shall be operable from both within and outside the cooler.

(21) *Bread and cake boxes, trays, etc.* (i) Sharp corners and edges shall be eliminated on metal parts.

(iii) All wooden corners and edges shall be protected to prevent splinters.

(22) *Doughnut machines.* Separate flues shall be provided, (i) for venting vapors from the frying section, and (ii) for venting products of combustion from the combustion chamber used to heat the fat.

(23) *Open fat kettles.* (i) The floor around kettles shall be maintained in nonslip condition.

(ii) Fire extinguishing devices suitable for Class–B fires shall be provided. See § 1910.157.

(iii) Goggles or face shields shall be provided to prevent injuries from hot fat splashes.

(iv) The top of the kettle shall be not less than 36 inches above floor or working level.

24) *Steam kettles.* (i) Positive locking devices shall be provided to hold kettles in the desired position.

(ii) Kettles with steam jackets shall be provided with safety valves in accordance with the ASME Pressure Vessel Code, Section VIII, Unfired Pressure Vessels, 1968.

(j) *Slicers and wrappers*—(1) *Slicers.* (i) Sprockets, chains, and V-belt drives on slicers shall be completely enclosed.

(ii) All slicing machines shall be provided with a mechanical device to push the last loaf through the slicer knives.

(iii) The cover over the knife head of reciprocating-blade slicers shall be provided with an interlocking arrangement so that the machine cannot operate unless the cover is in place.

(iv) On slicers with endless band knives, each motor shall be equipped with a magnet brake which operates whenever the motor is not energized. Each door, panel, or other point of access to the cutting blades shall be arranged by means of mechanical or electric interlocks so that the motor will be deenergized if all such access doors, panels, or access points are not closed.

(v) When it is necessary to sharpen slicer blades on the machine, a barrier shall be provided leaving only sufficient opening for the sharpening stone to reach the knife blades.

(vi) Where pusher fingers attached to the feed chain enter the bed plate of the cross feed, the end guard shall be extended to cover the pinch point.

(vii) *Slicer wrapper conditions:* (*a*) Where the flight chain on the slicer turns under the bed plate on the crossfeed to the wrapper, a spring-hinged section of bed plate shall be provided so that there is no shear point between the flight chain and the bed plate.

(*b*) Wrapping and slicing machines obtained from separate manufacturers, shall be installed and connected so that the chains, sprockets, belts, and moving parts are properly guarded. Safe interconnections for the starting and stopping of such devices shall be employed.

(*c*) Mechanical control levers for starting and stopping both slicing machine conveyors and wrapping machines shall be extended or so located that an operator in one location can control both machines. Such levers should be provided wherever necessary, but these should be so arranged that there is only one station capable of starting the wrapping machine and conveyor assembly, and this starting station should be so arranged or guarded as to prevent accidental starting. The electric control station for starting and stopping the electric motor driving the wrapping machine and conveyor should be located near the clutch starting lever.

(*d*) The transfer chain shall be completely covered on all sides, not just on front and top.

(2) *Wrappers.* (i) Any hand wheel which may be provided in order to turn the wrapping machine over by hand and which may run continuously shall be a smooth, solid disk wheel.

(ii) At the discharge end (or drive side) of the crossfeed conveyor there shall be either a one- or two-piece guard in front of the crossfeed chain.

(iii) Electrical heaters on wrappers shall be protected by a cover plate properly separated or insulated from the heaters in order that accidental contact with this cover plate will not cause a burn to the operator.

(iv) Electric wiring for the wrapper heaters shall be so arranged that a minimum number of wires are used to connect the movable heaters assembly to the permanent wiring of the machine. This wiring shall be heat-resisting type in accordance with the requirements of § 1910.320.

(v) Power-driven friction rollers used to feed paper into the wrapping machine shall be provided with a guard over the in-running nip point of the rubber rollers.

(vi) The nip point, between the chain and sprocket of the loose wrap attachment, shall be completely enclosed or guarded on both sides in such a way that employee's fingers cannot get into this nip point.

(vii) Sprocket, chain, and V-belt drives on wrappers shall be completely enclosed.

(k) *Biscuit and cracker equipment*—(1) *Meal, peanut, and fig grinders.* (i) If the hopper is removable it shall be provided with an electric interlock so that the machine cannot be put in operation when the hopper is removed.

(ii) Where grid guards cannot be used, feed conveyors to hoppers, or baffle-type hoppers, shall be provided. Hoppers in such cases shall be enclosed and provided with hinged covers, and equipped with electric interlock to prevent operation of the machine with the cover open.

(2) *Sugar and spice pulverizers.* (i) All drive belts used in connection with sugar and spice pulvizers shall be grounded by means of metal combs or other effective means of removing static electricity. All pulverizing of sugar or spice grinding shall be done in accordance with NFPA 62—1967 (Standard for Dust Hazards of Sugar and Cocoa), NFPA 656—1959 (standard for Dust Hazards in Spice Grinding Plants.

(ii) Magnetic separators shall be provided to reduce fire and explosion hazards.

(3) *Cheese, fruit, and food cutters.* These machines shall be protected in accordance with the requirements of subparagraph (1) of this paragraph.

(4) *Jam, icing, and marshmallow beaters of horizontal tub type.* All top openings shall be provided with covers attached to the machines.

(5) *Reversible dough brakes.* Reversible brakes shall be provided with a guard or tripping mechanism on each side of the rolls. These guards shall be so arranged as to stop the machine or reverse the direction of the rolls so that they are outrunning if the guard is moved by contact of the operator.

(6) *Cross-roll brakes.* Cross - roll brakes shall be provided with guards that are similar in number and equal in effectiveness to guards on hand-fed brakes.

(7) *Box- and roll-type dough sheeters.* (i) Sheeting rolls shall be guarded at the point where the dough enters the rolls so that the operator's fingers cannot get into the nip point.

(ii) Hoppers for sheeters shall have an automatic stop bar or automatic stopping device along the back edge of the hopper. If construction does not permit location at the back edge, the automatic stop bar or automatic stopping device shall be located where it will be most effective to accomplish the desired protection.

(8) *Cutting and panning, embossing, peeling, bar, and frutana machines.* (i) Roll stands, other than hand fed, shall be guarded at the point where the dough enters the rolls so that the operator's fingers cannot get into the nip points.

(ii) Guards shall be provided at each side of the cutter to prevent hands from getting under the cutter.

(iii) Reciprocating panner heads shall be guarded to protect the operator from being caught between moving and stationary parts.

(iv) Motor control buttons shall be located within view of the cutting head.

(9) *Rotary, die machines, pretzel rolling, and pretzel-stick extruding machines.* Dough hoppers shall have the entire opening protected with substantial grid-type guards to prevent the employee from getting his hands caught in moving parts, or the hopper shall be extended high enough so that the operator's hands cannot get into moving parts.

(10) *Band ovens.* Band ovens shall be so arranged, or guarded, that the opera-

tor cannot get caught at the nip point between the band and the drive pulley or the takeup pulley, or between the oven conveyor and the oven frame.

(11) *Wafer-cutting machines.* These machines shall be so guarded that it will be impossible for employee's fingers or hands to come in contact with the saws or knives while feeding the machine.

(12) *Pan cooling towers.* (i) Where pan cooling towers extend to two or more floors, a lockout switch shall be provided on each floor in order that mechanics working on the tower may positively lock the mechanism against starting. Only one start switch shall be used in the motor control circuit.

(ii) All unused sides of pan cooling tower conveyors shall be enclosed or effectively guarded to a height of 7 feet above each floor.

(iii) Wherever a pan cooling tower conveyor passes through a floor, the opening shall be protected by a standard railing and toe board, or by other equivalent protection.

(iv) Wherever a pan conveyor passes over a main aisleway, regularly occupied work area, or passageway, the underside of the conveyor shall be completely enclosed to prevent pans, broken chains, or other material from falling in the aisleway, work area or passageway.

(v) Sprocket wheels of pan conveyors shall be enclosed so that accidental contact cannot be made at the point where the chain comes in contact with the sprocket.

(vi) Wherever conveyor bars, flights, and attachments pass in opposite directions within 6 inches of each other, a sheet metal partition or screen with openings no larger than one-half inch shall be placed between the conveyor chains which run in opposite directions.

(13) *Chocolate melting, refining, and mixing kettles.* Each kettle shall be provided with a cover to enclose the top of the kettle. The bottom outlet of each kettle shall be of such size and shape that the operator cannot reach in to touch the revolving paddle or come in contact with the shear point between the paddle and the side of the kettle.

(14) *Caddie, cover, and box stitchers (wire stitchers).* A guard shall be mounted on the stitching head to prevent operators from getting fingers caught between the stitching head and the clincher block.

(15) *Carton-wrapping and bundling machines.* The end seal drums on carton and bundling machines shall be provided with guards.

(16) *Carton and lining feeding machines.* Cutting knives shall be provided with a hinged hood to cover the knives. These guards shall be electrically interlocked to stop the machine if they are removed.

(17) *Peanut cooling trucks.* Mechanically operated peanut cooling trucks shall have a grid-type cover over the entire top.

(l) *Ovens*—(1) *General location.* (i) Ovens shall be located with due regard to the possibility of fire resulting from overheating or from the escape of gas or fuel oil and the possibility of injury to persons resulting from explosions.

(ii) Ovens shall be built on noncombustible foundations; excepting that where unusual circumstances require that an oven be placed on a combustible floor, the sole of the oven itself shall be insulated and shall be separated from the floor by a ventilated air space of at least 3 inches. In no case shall the temperature of a combustible floor beneath an oven be permitted to exceed 160° F.

(iii) Sufficient insulation shall be used in the crown of any oven, and the space above this crown shall be sufficiently ventilated, to prevent the temperature of any combustible ceilings from rising above 200° F.

(iv) Where oven ducts or stacks pass through combustible walls or ceilings, sufficient clearance and insulation shall be provided to keep the temperature of combustible material below 160° F.

(v) Columns or structural members of a building shall not pass through an oven. When such columns or structural members are closer than 6 inches to the inner shell of an oven, fireproof material shall be used and insulated in such a way that the temperature of the column or structural member will be kept below 160° F.

(vi) Ovens shall be located so as to be accessible from all sides and adequately spaced to permit the proper functioning of explosion vents.

(vii) Ovens shall be located so that possible fire or explosion will not expose groups of persons to possible injury. For this reason ovens shall not adjoin lockers, lunch or sales rooms, main passageways, or exits.

(2) *Recommended construction.* (i) structural parts of ovens shall be protected against corrosion or deterioration.

(ii) Roofs and other parts of ovens shall be structurally strong enough to support the weight of men who may be required to climb on top of ovens or inside of them.

(3) *Safeguards of mechanical parts.* (i) Emergency stop buttons shall be provided on mechanical ovens near the point where operators are stationed.

(ii) All piping at ovens shall be tested to be gastight.

(*a*) Soldered pipe joints shall not be permitted in connection with ovens. Pipe joints may be either screwed, flanged, or welded, in connection with ovens where such pipes carry fuel or steam.

(*b*) All pipe and fittings used shall be of good material, clear and free from cutter burrs and defects in structure or threading.

(iii) Main shutoff valves, operable separately from any automatic valve, shall be provided to permit turning off the fuel or steam in case of an emergency.

(*a*) Main shutoff valves shall be located so that explosions, fires, etc. will not prevent access to these valves.

(*b*) Main shutoff valves shall be locked in the closed position when men must enter the oven or when the oven is not in service.

(4) *Gas-burning systems.* (i) Liquefied petroleum gas shall be stored and distributed in accordance with the requirements of § 1910.110.

(ii) Inspirators on atmospheric (low-pressure) gas-burning systems shall be so constructed and machined as to insure correct alignment of the gas jet with the axis of the inspirator. Air adjustments or shutters on inspirators on atmospheric gasburning systems shall either be permanently fixed or else provided with a locking device to positively prevent accidental change of setting. The shutter shall be so located that adjustments can be made when the oven is in normal operating condition.

(iii) Dampers controlling the draft on ovens equipped with atmospheric gas-burning systems shall be interconnected with the gas supply so that no gas can be admitted to the burners if the damper is closed.

(*a*) Atmospheric pipe burners extending into the baking chamber of ovens fired with atmospheric gas-burning systems shall have secondary air ducts installed below each burner and extending over its full length. Air inlets for these ducts shall be placed outside the baking chamber.

(*b*) Stack dampers on ovens equipped with atmospheric gas-burning systems shall have a hole of the following diameter:

Diameter of flue	*Diameter of opening*
3 to 5	½
6 to 10	1
11 to 15	1½

Dimensions given in inches.

(iv) Nozzle of blast burners on atmospheric gas-burning systems shall be equipped with gas pilots or electric ignition; with the exception that burners operated on a maximum-minimum flame or modulating principle which are equipped with quick acting combustion safeguards actuated by the main burner flame may be equipped with automatic or hand torch ignition to be used for initial lighting only.

(v) Burners of the perforated pipe, ribbon, slot, tip, or similar types, having many individual ports, shall be capable of maintaining a stable flame over the entire length (or surface) of the burner throughout the turndown range and under all draft conditions which may arise in the operation of the oven, unless ignition of gas from every port shall immediately result from the ignition of gas at any single port, when gas is supplied to the burner at the highest and lowest rating of the burners.

(vi) Premixed gas burners shall be so designed that the burner will not backfire or blow off within the operating range of the burner.

(*a*) Multiple port burners, such as ribbon, strip, or tip burners, when used on premixed gas systems, shall be capable of instant ignition of the burner over its entire length when operated within the proper range of the burner, either in a normal or steam-laden oven atmosphere or under any other oven conditions which might extinguish the flame.

(*b*) Where a number of premixed gas burners are connected to a single premixing device, each burner shall be equipped with electric or gas ignition.

(vii) High-pressure inspirators (using gas at pressures exceeding 1 p.s.i.) shall be so constructed and machined as to insure perfect alignment of the gas jet with the axis of the inspirator.

(*a*) No high-pressure inspirator shall be installed with a valve or other obstruction between the inspirator and the burner.

(*b*) Each high-pressure inspirator shall have a gas adjustment consisting of a fixed replaceable orifice or an adjustable orifice. When an adjustable orifice is used, the adjusting screw shall be protected by a gas-tight plug.

(*c*) Air adjustments on high-pressure inspirators shall be provided with positive locking means.

(*d*) High-pressure inspirators shall be so located that air adjustments can be made during the operation of the oven.

(*e*) High-pressure inspirators shall be mounted in such a position that should a backfire occur, it cannot injure the operator or ignite any combustible material.

(*f*) High-pressure inspirators used on gas-burning systems, which are supplied under pressure with a partial mixture of air and gas instead of straight gas, shall not be used unless the amount of air mixed with the gas is sufficiently low to keep the mixture rich enough to be above the upper explosive limit.

(*g*) Low-pressure proportioning inspirating sets (using air at pressures from one-half to 1½ p.s.i. and gas at or about atmospheric pressure) shall be equipped with a positive locking device on the adjustment for setting the gas-air ratio.

(viii) Low-pressure proportioning inspirators equipped with zero governors, which do not compensate for any change in resistance in the mixture pipe, shall be installed so that there is no valve or other obstruction between the inspirators and the burners. Diaphragm air spaces of governors on low-pressure proportioning inspirating sets shall be vented to the outside of the building.

(ix) Two-pipe systems: No valve or other obstruction shall be placed between the mixing valve and the burners on any two-pipe system which uses air and gas under pressure, unless the mixing valve is equipped with a device which automatically will prevent excessive pressure rise in the mixture pressures. Two-pipe systems shall be equipped with means for cleaning the air and gas before they enter the mixing valve.

(5) *Gas mixing machines.* (i) All burners supplied with complete mixture from the machine shall be equipped with flash and flame arrestors equipped with automatic shutoff valves actuated by heat installed as close to the burners as practical and also at the outlet of the premixing machine ahead of the individual burner shutoffs. This is to prevent the flame from reaching the mixture supply pipe.

(*a*) The main mixture lines and the gas machine proper shall be amply protected against fire or explosion hazard by flashback arrestors and relief vents or softheads located outside the building. Some gas mixing machines are used for partially premixing gas and air and supplying this mixture to high-pressure inspirators where additional air is entrained. If the gas-air ratio is such that the mixture remains so rich as to be above the upper explosive limit over the entire range of the machine, flash arrestors or explosion vents are not required. Positive means shall be provided which will prevent any such gas mixing machine from producing an explosive mixture.

(*b*) All diaphragm or similar chambers shall be connected to the atmosphere outside of the building.

(*c*) An automatic safety shutoff valve shall be provided in the gas line leading to the mixing valve which will close the gas supply in case the suction disappears at the compressor inlet or the current to the compressor is shutoff.

(*d*) Air inlets to gas mixing machines shall be piped to a location outside the building and shall be located at a point protected against dust.

(ii) No valve or obstruction shall be installed between mixing blowers and burners.

(*a*) Mixing blowers shall be so constructed that they will supply a mixture of air and gas that will not blow off or backfire over the entire range of adjustments.

(*b*) Mixing blowers shall be provided with a pressure regulator in the gas line at the inlet to the mixing valve (to prevent variations in the air-gas ratio).

(*c*) Housings of mixing blowers shall be constructed to withstand any possible internal explosion.

(*d*) Mixing blowers shall be provided with an automatic safety shutoff valve in the gas line leading to the blower, which safety shutoff valve will close in case of failure of either gas pressure or electric current.

(6) *Oil-burning equipment.* (i) The storage and distribution of fuel oil in bakeries shall be arranged according to reference NFPA 31—1968 Standard for Installation of Oil Burning Equipment.

(ii) Oil burners shall be of a type approved by Underwriters Laboratories, Inc.

(*a*) Each oil burner shall be equipped with an electric ignition or gas pilot.

(*b*) Oil burners shall be protected against flame failure and overflowing of oil by a quick-acting combustion safeguard operated by the main burner flame. The time interval between flame failure and fuel shutoff shall be short enough to prevent a dangerous accumulation of an explosive mixture or the entry of a dangerous amount of fuel oil into the heating system; with the exception that on ovens requiring 150,000 B.t.u. per hour or less any combustion safeguard listed by the Underwriters Laboratories, Inc., may be used.

(*c*) The shutting off of the fuel supply shall be accomplished by stopping the individual burner pump equipped with a pressure cutoff valve, or by closing a suitable valve.

(*d*) Oil-fired ovens shall have dampers so arranged that a small amount of air is passed through the furnace at all times.

(*e*) Oil burners capable of being withdrawn from the furnace (for adjustment, etc.) shall be provided with an interlock which will prevent the burner from starting when in the withdrawn position.

(*f*) Preheating of oil, where necessary, shall be done by steam, hot water, or electric heater, and shall be thermostatically controlled. Heaters shall be substantially constructed with all joints made oil tight. Thermometers shall be installed at suitable locations to indicate the temperature of the heated oil. Heaters shall be bypassed or provided with suitable means to prevent abnormal pressure.

(*g*) Oil burners equipped with mechanical means for supplying air shall have an interlock between the air pressure and the oil supply so that the burner cannot operate unless air for proper combustion is available.

(iii) High-pressure atomizing oil burners shall be provided with a pressure cutoff valve between the pump and the nozzle.

(iv) Air atomizing burners equipped with maximum-minimum or modulating controls, and which are arranged to have the ignition turned off after initial lighting has been accomplished, shall be equipped with a quick-acting flame safeguard directly actuated by the main flame of the burner.

(v) Mechanical atomizing burners of the rotary type shall be operated on the on-off principle and shall be equipped with safeguards actuated by the main flame.

(vi) Evaporator-type burners shall be installed in such a way that provision is made to open the draft damper before oil can be admitted to the burners.

(vii) Burners supplied by "vapofiers" shall be equipped with a protected gas or electric pilot. In combination vapofier-gas heating systems, the burner shall be protected in accordance with the requirements of subparagraph (4) of this paragraph.

(7) *Solid-fuel firing equipment.* (i) In solid-fuel firing systems proper draft shall be maintained at the stack as long as there is fuel in the furnace. All breachings and flues shall be kept in a tight and clean condition. Solid-fuel firing systems using forced draft shall have the air supply to the ash pit interconnected with the furnace in such a way that the air pressure is shut off when the furnace door is opened.

(ii) *Mechanical stokers.* (*a*) Fuel feed and air supply to mechanical stokers shall be interlocked in such a way that fuel cannot be fed without sufficient air being available.

(*b*) Dampers in mechanical-stoker fired systems shall be interlocked with the stoker in such a way that the stoker cannot be started unless the damper is open.

(8) *Electrical heating equipment.* (i) All electrical equipment shall be built and installed according to Subpart S of this part.

(ii) Open heating elements inside the baking chamber shall be guarded against accidental touching by the product being baked, by the body of the operator, or by current-conducting implements which may be used.

(iii) A main disconnect switch or circuit breaker shall be provided. This switch or circuit breaker shall be so located that it can be reached quickly and safely. The main switch or circuit breaker shall have provisions for locking it in the open position if any work on the electrical equipment or inside the oven must be performed.

(9) *General requirements.* (i) Protecting devices shall be properly maintained and kept in working order.

(ii) All safety devices on ovens shall be inspected at intervals of not less than twice a month by an especially appointed, properly instructed bakery employee, and not less than once a year by representatives of the oven manufacturers.

(iii) (*a*) Protection of gas pilot lights shall be provided when it is impracticable to protect the main flame of the burner and where the pilot flame cannot contact the flame electrode without being in the path of the main flame of the burner. Failure of any gas pilot shall automatically shut off the fuel supply to the burner.

(*b*) Ovens with multiple burners shall be equipped with individual atmospheric pilot lights where there is sufficient secondary air in the baking chamber and where gas is available; or else each burner shall be equipped with an electric spark-type ignition device.

(iv) Burners of a capacity exceeding 150,000 B.t.u. per hour equipped with electric ignition shall be protected in addition by quick-acting combustion safeguards.

(*a*) The high-tension current for any electric spark-type ignition device shall originate in a power supply line which is interlocked with the fuel supply for the oven in such a way that in case of current failure both the source of electricity to the high-tension circuits and the fuel supply shall be turned off simultaneously.

(*b*) All electric circuits in connection with ignition systems on ovens shall comply with Subpart S of this part.

(*c*) Combustion safeguards used in connection with electric ignition systems on ovens shall be so designed as to prevent an explosive mixture from accumulating inside the oven before ignition has taken place.

(v) When fuel is supplied and used at line pressure, safety shutoff valves shall be provided in the fuel line leading to the burner.

(*a*) When fuel is supplied in excess of line pressure, safety shutoff valves shall be provided in the fuel line leading to the burners, unless the fuel supply lines are equipped with other automatic valves which will prevent the flow of fuel when the compressing equipment is stopped.

(*b*) The safety shutoff valve shall be positively tight and shall be tested at least twice monthly.

(*c*) Packing glands shall be designed so that the valve will not be made inoperative by excessive tightening of the packing gland.

(*d*) Electrically operated safety shutoff valves shall be normally closed and not depend on electricity for shutting off the fuel supply.

(*e*) A safety shutoff valve shall require manual operation for reopening after it has closed, or the electric circuit shall be so arranged that it will require a manual operation for reopening the safety shutoff valve.

(*f*) Manual reset-type safety shutoff valves shall be so arranged that they cannot be locked in an open position by external means.

(*g*) Where blowers are used for supplying the air for combustion the safety shutoff valve shall be interlocked so that it will close in case of air failure.

(*h*) Where gas or electric ignition is used, the safety shutoff valve shall close in case of ignition failure. On burners equipped with combustion safeguards, the valve shall close in case of burner flame failure.

(vi) One main, manually operated, fuel shutoff valve shall be provided on each oven, and shall be located ahead of all other valves in the system.

(vii) All individual gas or oil burners with a heating capacity over 150,000 B.t.u. per hour shall be protected by a safeguard which is actuated by the flame and which will react to flame failure in a time interval not to exceed 2 seconds. All safeguards, once having shut down a gas or oil burner, shall require manual resetting and starting of the burner or burners.

(viii) Any space in an oven (except direct fired ovens) which could be filled with an explosive mixture shall be protected by explosion vents. Explosion vents shall be made of minimum weight consistent with adequate insulation.

(*a*) Explosion doors which have a substantial weight shall be attached by chains or similar means to prevent flying parts from injuring the personnel in case of an explosion.

(*b*) Where explosion vents are so located that flying parts or gases might endanger the personnel working on or near the oven, internal or external protecting means shall be provided in the form of heavily constructed shields or deflectors made from noncombustible material.

(*c*) Specifically a expanded from the provisions of this Code as contained in the immediately preceding three paragraphs heating systems on ovens in which the fuel is admitted only to enclosed spaces which shall have been tested to prove that their construction will resist repeated explosions without deformation are exempt from the requirements of subdivisions (viii) (*a*) and (*b*) of this paragraph.

(ix) *Flues and dampers.* (*a*) All ovens (except electrically heated) shall be properly and firmly connected to an active chimney or flue of ample size to carry away the flue gases.

(*b*) The chimney shall be preinspected after installation or repair to determine whether it is in suitable condition.

(*c*) The flue pipe or breeching shall be properly supported in all cases.

(*d*) Means shall be employed which will prevent the flue pipe or breeching from entering beyond the inner wall of the chimney flue.

(*e*) Flue pipe shall be cemented or otherwise sealed to the chimney wall so as to prevent infiltration of air.

(*f*) A flue damper or other equivalent means for regulating draft shall be installed on each oven, the proper operation of which depends on natural draft.

(*g*) Dampers, where used, shall be equipped with suitably located minimum and maximum stops. The minimum stop for dampers shall be adjusted to obtain sufficient air for combustion at the minimum oven output. Where stack dampers are used in connection with oil- or gas-fired ovens, they shall be equipped with means to turn the burner off when the damper is closed.

(x) Where the initial pressure of the fuel is lower than the air pressure used for combustion, check valves shall be installed in the fuel line to prevent air from backing up into the fuel lines. For instance, in gas burner apparatus, which uses air at pressures exceeding the gas service pressure, a check valve shall be provided in the gas line next to the mixing device.

(xi) Where the gas supply pressure is substantially higher than that at which the burners of an oven are designed to operate, a gas pressure regulator shall be employed.

(*a*) Gas pressure regulators, where used, shall maintain the gas pressure to the manifold within 10 percent of the operating pressure from maximum to minimum consumption rates.

(*b*) Regulators shall be of the spring-loaded, dead-weight, or pressure-balanced type. Spring- or weight-loaded regulators shall have springs or weights covered by suitable housing. Under no circumstances shall a weight and lever type of regulator be used.

(*c*) A gas pressure regulator, requiring access to atmosphere for successful operation, shall be vented to the outer air.

(*d*) A relief valve shall be placed on the outlet side of gas pressure regulators where gas is supplied at high pressure. The discharge from this valve shall be piped to the outside of the building.

(xii) All chambers which have to be connected to the atmosphere, but are separated from any gaseous or other volatile fuel by a flexible membrane, as, for instance, a diaphragm, bellows, etc., shall be connected by a pipe of at least one-half inch size to the outside atmosphere. The outside end of this pipe shall be protected against flooding or accidental plugging by ice formation, insects, or other causes, by providing a "tee" with double elbow connections pointing downwards at the top of the pipe, and screened outlets. Where several of such chambers are used in close proximity, a common vent line may be used.

(xiii) Where accumulation of dust in the air supply might affect the proper functioning of mixing devices and burn-

ers, the air supply inlet shall be equipped with suitable air filters. A standby filter should be available to permit interchanging filters for cleaning purposes.

(10) *Direct-fired ovens.* (i) Direct-fired ovens shall be safeguarded against failure of fuel, air, or ignition.

(ii) To prevent the possible accumulation of explosive gases from being ignited after a shutdown, all direct-fired ovens with a heating capacity over 150,000 B.t.u. per hour shall be ventilated before the ignition system, combustion air blower, and the fuel can be turned on. The preventilation shall insure at least four complete changes of atmosphere in the baking chamber by discharging the oven atmosphere to the outside of the building and entraining fresh air into it. The preventilation shall be repeated whenever the heating equipment is shut down by a safety device.

(11) *Direct recirculating ovens.* (i) Each circulating fan in direct recirculating ovens shall be interconnected with the burner in such a manner that the fuel is shut off by a safety valve when the fan is not running.

(ii) The flame of the burner or burners in direct recirculating ovens shall be protected by a quick-acting flame-sensitive safeguard which will automatically shut off the fuel supply in case of burner failure.

(iii) Direct recirculating ovens shall be equipped with preventilating devices.

(iv) Fans in direct recirculating ovens shall be constructed of materials suitable for the temperatures at which they will operate and designed with an ample safety factor to prevent rupture of the wheel.

(v) Fan wheel in direct recirculating oven shall be protected against direct impingement of the flame of the burner or burners.

(vi) Direct recirculating ovens, and particularly fans in and on such ovens, shall be protected from overheating by means of a temperature limiting device.

(vii) When the burner or burners on direct recirculating ovens are mounted at elevated positions permanent steps shall be provided for safe and convenient access to the burner or burners.

(12) *Flue-type ovens.* (i) Flue-type ovens shall be operated in such a way that less than atmospheric pressure is maintained in the flues.

(ii) Gas burners in flue-type ovens shall be protected against flame failure.

(iii) Oil burners on flue-type ovens shall be equipped with combustion safeguards as listed by the Underwriters Laboratories, Inc.

(iv) Solid-fuel stoker-fired flue-type ovens shall have the stack damper interlocked with the stoker so that the stoker cannot be operated when the damper is closed.

(13) *Indirect-fired multiple burner ovens.* (i) Indirect-fired multiple-burner ovens shall be equipped with safety shut-off valves which are interlocked with the ignition system, the air pressure and the gas pressure.

(ii) Parts of enclosures reaching through the wall of indirect-fired multiple-burner ovens, and observation windows on such ovens, shall be tested at least once each year with repeated explosions, and afterward inspected for leaks.

(14) *Steam-tube ovens.* Steam-tube ovens shall be protected against overfiring (firing at an excessive rate) and overheating (heating to excessive temperatures) by devices which control the maximum amount of fuel admitted to the furnace and the maximum permissible temperature in the baking chamber.

(15) *Indirect recirculating ovens.* (i) Indirect recirculating ovens shall have all oil and gas burners equipped with quick-acting flame sensitive combustion safeguards.

(ii) Duct systems in indirect-recirculating ovens shall be protected by explosion vents having a minimum total area of 1 square foot of vent to 15 cubic feet of total duct volume. These explosion vents shall be so located that they will not release hot gases or flying parts in the direction of an operator.

(iii) Duct systems (in ovens) operating under pressure shall be tested for tightness in the initial starting of the oven and also at intervals not farther apart than 6 months.

(iv) Fans and other parts in indirect recirculating ovens shall comply with requirements as listed under subparagraph (11) of this paragraph.

(16) *Electric ovens.* Electric ovens shall be installed, operated, and maintained in accordance with Subpart S of this part.

§ 1910.264 Laundry machinery and operations.

(a) *Definitions applicable to this section.* (1) *Laundry.* The term "laundry" shall mean an establishment wherein the washing, ironing, or other finishing of clothes, or any other textiles is done, but excluding printing, bleaching, dry cleaning, or dyeing of clothes or other textiles.

(2) *Marking machine.* The term "marking machine" shall mean a power-driven machine used for marking clothes or other textiles.

(3) *Washing machine.* The term "washing machine" shall mean a power-driven machine used for washing clothes or other textiles. It generally consists of a stationary case or shell inside of which is a revolving perforated cylinder.

(4) *Extractor.* The term "extractor" shall mean a power-driven centrifugal machine used for removing surplus moisture from clothes or other textiles by centrifugal action.

(5) *Wringer.* The term "wringer" shall mean one or more power-driven rolls used for removing surplus moisture from clothes or other textiles.

(6) *Starch mixer.* The term "starch mixer" shall mean a power-driven machine used for mixing or processing starch.

(7) *Starching machine.* The term "starching machine" shall mean a power-driven machine used for the starching of clothes or other textiles.

(8) *Drying tumbler.* The term "drying tumbler" shall mean a machine within which clothes or other textiles are dried by air, and which usually consists of an enclosure inside of which is a revolving cylinder.

(9) *Shaker.* The term "shaker" (clothes tumbler) shall mean a revolving cylinder used for shaking out clothes or other textiles.

(10) *Drying room.* The term "drying room" shall mean an enclosure used for drying clothes or other textiles, and containing any power-driven mechanism.

(11) *Dampening machine.* The term "dampening machine" shall mean a machine used for dampening clothes or other textiles.

(12) *Ironer.* The term "ironer" shall mean a hand- or power-operated machine, with one or more rolls or heated surfaces in contact, used for ironing or smoothing clothes or other textiles.

(13) *Shaping machine.* The term "shaping machine" shall mean a power-driven machine used to shape, mold, or otherwise finish clothes or other textiles; this term shall also include shaping tables, stands, or shelves upon which the machine may be mounted.

(14) *Sewing machine.* The term "sewing machine" shall mean a machine used for sewing or stiching clothes or other textiles.

(15) *Guarded.* The term "guarded" shall mean covered, shielded, fenced, enclosed, or otherwise protected by means of suitable covers or casings, barrier rails, safety bars, or screens, to eliminate the possibility of accidental contact with, or dangerous approach by, persons or objects.

(16) *Enclosed.* The term "enclosed" shall mean that the object or equipment or part thereof is so guarded that accidental contact at the point of danger, during the regular operation of the equipment, is not possible.

(17) *Safety interlock.* The term "safety interlock" shall mean a device that will prevent the operation of the machine while the cover or door is open or unlocked and will hold the cover or door closed and locked while the basket or cylinder is in motion.

(18) *Moving parts.* The term "moving parts" shall mean gears, sprockets, revolving shafts, clutches, belts, pulleys, or other revolving or reciprocating parts that are attached to, or form an integral part of, a machine.

(19) *Power transmission.* The term "power transmission" shall pertain to equipment such as shafting, gears, belts, pulleys, or other parts used for transmitting power to the machine, and shall include prime movers.

(20) *Prime movers.* The term "prime movers," shall include steam, gas, oil, and air engines or motors, and steam and hydraulic turbines.

(21) *Point of operation.* The term "point of operation" shall mean the point or points at which clothes or other textiles are inserted or manipulated in the operation of the machine.

(b) *General requirements.* This section applies to moving parts of equipment used in laundries and to conditions peculiar to this industry, with special

reference to the point of operation of laundry machines. This section does not apply to dry-cleaning operations.

(c) *Point-of-operation guards*—(1) *Washroom machines*—(i) *Marking machine.* Each power marking machine shall be equipped with a spring-compression device of such design as to prevent injury to fingers, should they be caught between the marking plunger and platen; or the marking machine shall be equipped with a control mechanism that will require the simultaneous action of both hands to operate the machine; or there shall be a guard that will act as a barrier in front of, and which will prevent the operator's fingers from coming into contact with, the marking plunger.

(ii) *Washing machine.* (*a*) Each washing machine shall be equipped with an interlocking device that will prevent the inside cylinder from moving when the outer door on the case or shell is open; and will also prevent the door from being opened while the inside cylinder is in motion. This device should not prevent the movement of the inner cylinder under the action of a hand-operated mechanism or under the operation of an "inching device."

(*b*) Each washing machine shall be provided with means for holding open the doors or covers of inner and outer cylinders or shells while being loaded or unloaded.

(iii) *Extractor.* (*a*) Each extractor shall be equipped with a metal cover.

(*b*) Each extractor shall be equipped with an interlocking device that will prevent the cover from being opened while the basket is in motion, and will also prevent the power operation of the basket while the cover is not fully closed and secured. This device should not prevent the movement of the basket by hand to ensure an even loading.

(*c*) Each extractor shall also be effectively secured in position on the floor or foundation so as to eliminate unnecessary vibrations, and shall not be operated at a speed greater than that given in the manufacturer's rating, which shall be stamped on the inside of the basket where it is easily visible, in letters not less than one-fourth inch in height. The maximum permissible speed shall be given in revolutions per minute.

(*d*) Each engine individually driving an extractor shall be provided with an engine stop approved by Underwriters Laboratories, Inc., and a speed-limit governor. It is suggested that where an extractor is driven by a direct-current motor a "no field" release be installed to prevent overspeed, which may result from an open or broken field.

(iv) *Power wringer.* Each power wringer shall be equipped with a safety bar or other guard across the entire front of the feed or first pressure rolls, so arranged that the striking of the bar or guard by the hand of the operator or other person will stop the machine.

(2) *Starching and drying machines*—(i) *Starching machine (cylinder or box type).* Each starching machine, cylinder or box type, shall be enclosed or guarded so as to prevent the operator or other person from coming into accidental contact with the cylinder or box while the machine is in motion.

(ii) *Drying-room fan.* Each drying-room fan, any part of which is within 7 feet of the floor or working platform, shall be guarded with wire mesh or screen of not less than No. 16 gage, the openings of which will reject a ball one-half inch in diameter.

(iii) *Drying tumbler.* (*a*) Each drying tumbler shall be equipped with an interlocking device that will prevent the inside cylinder from moving when the outer door on the case or shell is open, and also prevent the door from being opened while the inside cylinder is in motion. This device should not prevent the movement of the inner cylinder under the action of a hand-operated mechanism or under the operation of an inching device.

(*b*) Each drying tumbler shall be provided with means for holding open the doors or covers of inner and outer cylinders or shells while being loaded or unloaded.

(iv) *Shaker (clothes tumbler).* (*a*) (*1*) Each shaker or clothes tumbler of the single-cylinder type shall be equipped with a device that will automatically prevent the tumbler from moving while the door is open.

(*2*) The tumbler shall also be enclosed or guarded so as to prevent accidental contact by the operator or other person while the machine is in motion.

(*b*) (*1*) Each shaker or clothes tumbler of the double-cylinder type shall be equipped with an interlocking device that will prevent the inside cylinder from moving when the outer door on the case or shell is open, and will also prevent the door from being opened while the inside cylinder is in motion. This device should not prevent the movement of the inner cylinder under the action of a hand-operated mechanism or under the operation of an inching device.

(*2*) Each shaker or clothes tumbler of the double-cylinder type shall be provided with means for holding open the doors or covers of inner and outer cylinders or shells while being loaded or unloaded.

(v) *Exception.* Provisions of subdivision (iii), (iv) (*a*) (*1*), and (iv) (*b*) of this subparagraph shall not apply to shakeout or conditioning tumblers where the clothes are loaded into the open end of the revolving cylinder and are automatically discharged out of the opposite end.

(3) *Finishing machines*—(i) *Dampening machine.* Each roll-dampening machine shall be so equipped that the rolls will be entirely enclosed and so arranged as to prevent the fingers of the operator or other person from being caught between the rolls. This may be accomplished by:

(*a*) A slot or hopper;

(*b*) A rod or strip located directly in front of the feed and extending the full length of the rolls.

(ii) *Ironer.* (*a*) Each flat-work or collar ironer shall be equipped with a safety bar or other guard across the entire front of the feed or first pressure rolls, so arranged that the striking of the bar or guard by the hand of the operator or other person will stop the machine. The pressure rolls shall be covered or guarded so that the operator or other person cannot reach into the rolls without removing the guard. This may be either a vertical guard on all sides or a complete cover. If a vertical guard is used, the distance from the floor or working platform to the top of guard shall be not less than 6 feet.

(*b*) Each body-type ironer, roll or shoe type, including sleeve and band ironers, shall be equipped with a safety bar or other guard across the entire length of the feed roll or shoe, so arranged that the striking of the bar or guard by the hand of the operator or other person will stop the machine. The hot roll or shoe shall also be covered in such a way that the operator or other person cannot come into contact with the heated surfaces.

(*c*) Each combined rotary-bosom and coat ironer shall be equipped with a safety bar or other guard across the entire length of the feed roll or shoe, so arranged that the striking of the bar or guard by the hand of the operator or other person will stop the machine. The hot roll or shoe shall also be covered in such a way that the operator or other person cannot come into contact with the heated surfaces.

(*d*) Each ironing press (excluding hand or foot powered ones) shall be equipped with a guard or means that will prevent the fingers of the operator or other person from being caught between the ironing surfaces.

(4) *Miscellaneous machines and equipment*—(i) *Sewing machine.* Each sewing machine shall be equipped with a guard permanently attached to the machine, so that the operator's fingers cannot pass under the needle. It shall be of such form that the needle can be conveniently threaded without removing the guard.

(ii) *Exhaust or ventilating fans.* Each exhaust or ventilating fan within 7 feet of the floor or working platform shall be completely covered with wire mesh of not less than No. 16 gage, and with openings that will reject a ball one-half inch in diameter.

(iii) *Steam pipes.* (*a*) All steam pipes that are within 7 feet of the floor or working platform, and with which the worker may come into contact, shall be insulated or covered with a heat-resistive material or shall be otherwise properly guarded.

(*b*) Where pressure-reducing valves are used, one or more relief or safety valves shall be provided on the low-pressure side of the reducing valve, in case the piping or equipment on the low-pressure side does not meet the requirements for full initial pressure. The relief or safety valve shall be located adjacent to, or as close as possible to, the reducing valve. Proper protection shall be provided to prevent injury or damage caused by fluid escaping from relief or safety valves if vented to the atmosphere. The vents shall be of ample size and as short and direct as possible. The combined discharge capacity of the relief valves shall be such that the pressure rating of the lower-pressure piping and

equipment will not be exceeded if the reducing valve sticks or fails to open.

(iv) *Starting and stopping devices.* Each power-driven machine shall be provided with means for disconnecting from the source of power. Starting and stopping devices for machines shall be so located as to be operable from the front of the machine, and so constructed as to allow proper guarding of belts and pulleys.

(d) *Operating rules*—(1) *General*—(i) *Floors.*

(*a*) The floors of every room in a laundry that are used for washing purposes shall be properly constructed of cement, tile, or similar material. The floors shall be watertight, free from projections, crevices, or dangerous gradients. They shall be maintained in good repair and so drained that no water may accumulate.

(*b*) The floors of every room except washrooms shall be constructed of hardwood or any impervious material, free from protruding nails, splinters, or loose boards, and shall be maintained in a safe condition.

(ii) *Table tops, shelves, and machine woodwork.* Table tops, shelves, and machine woodwork shall be constructed of materials properly surfaced, finished free from splinters, and so maintained.

(iii) *Markers.* Markers and others handling soiled clothes shall be warned against touching the eyes, mouth, or any part of the body on which the skin has been broken by a scratch or abrasion; and they shall be cautioned not to touch or eat food until their hands have been thoroughly washed.

(iv) *Ventilation.* Where artificial ventilation is necessary to the maintenance of comfortable working conditions, an adequate ventilating system shall be installed.

(v) *Instruction of employees.* Employees shall be properly instructed as to the hazards of their work and be instructed in safe practices, by bulletins, printed rules, and verbal instructions.

(2) *Mechanical*—(i) *Safety guards.*

(*a*) No safeguard, safety appliance, or device attached to, or forming an integral part of any machinery shall be removed or made ineffective except for the purpose of making immediate repairs or adjustments. Any such safeguard, safety appliance, or device removed or made ineffective during the repair or adjustment of such machinery shall be replaced immediately upon the completion of such repairs or adjustments.

(*b*) No machine shall be operated until such repairs and adjustments have been made and the machine is in good working condition.

(ii) *Steam-pressure apparatus.* Steam machines shall not be operated at a pressure above that given by the manufacturer's pressure rating as shown on name plate. If the steam source is at a pressure higher than that given by the manufacturer's rating, a stop valve, reducing valve, pressure gage, and safety valve shall be installed, in the order named, from the source. The safety valve shall be located in a nonhazardous place.

(iii) *Machine adjustments.* No moving parts of any machine shall be oiled, cleaned, adjusted, or repaired while said machine is in operation or in motion except that the rolls of in adjusting machines not equipped with hand-power means be operated at the slowest speed possible with an operator constantly at the starting mechanism.

(iv) *Extractors.* Each extractor shall be dismantled and inspected at least once a year and, if necessary, repaired. Overdriven extractors, if provided with handholes through which basket and rings can be inspected, need not be dismantled.

(e) *Moving parts*—(1) *Machine guarding (other than point of operation).* Moving parts of machines, such as gears, sprockets, belts, pulleys, and shafts, shall be guarded in accordance with the requirements of § 1910.219.

(2) *Prime-mover guarding.* Moving parts of prime movers, such as flywheels, cranks and connecting rods, tail rods or extension piston rods, and governor balls, shall be guarded in accordance with the requirements of § 1910.219.

(f) *General industrial safety standards*—(1) *General.* The general safety standards adopted by reference in subparagraph (2) of this paragraph, the provisions of which apply to nearly every industrial plant, are now incorporated by reference in this section and are made applicable to laundry operations. The rules of construction set forth in paragraph (3) of § 1910.05 shall apply.

(2) *Additional requirements.* The employer shall comply with the provisions of the standards referenced in this subparagraph. In the event of any conflict between this subparagraph and paragraphs (b) through (e) of this section, the requirements of paragraphs (b) through (e) of this section shall apply.

(i) *Industrial lighting.* American National Standard Practice for Industrial Lighting, ANSI A11.1—1965 (R–1970).

(ii) *Floor and wall openings, railings, and toeboards.* American National Standard Safety Requirements for Floor and Wall Openings, Railings, and Toeboards, ANSI A12.1—1967.

(iii) *Identification of piping systems.* American National Standard Scheme for the Identification of Piping Systems, ANSI A13.1—1956.

(iv) *Mechanical power transmission apparatus.* American National Standard Safety Standard for Mechanical Power Transmission Apparatus, ANSI B15.1—1971.

(v) *Pressure piping—power piping.* American National Standard Code for Pressure Piping—Power Piping, ANSI 31.1.0—1967. Addenda to the American National Standard Code for Pressure Piping—Power Piping, ANSI B31.1.0a—1969.

(vi) *Sanitation.* American National Standard Requirements for Sanitation in Places of Employment, ANSI Z4.1—1968.

(vii) *Local exhaust systems.* American National Standard Fundamentals Governing the Design and Operation of Local Exhaust Systems, ANSI Z9.2—1960.

(viii) *Gas appliances and gas piping.* American National Standard for the Installation of Gas Appliances and Gas Piping, ANSI Z21.30—1964.

§ 1910.265 Sawmills.

(a) *General requirements*—(1) *Application.* This section includes safety requirements for sawmill operations including, but not limited to, log and lumber handling, sawing, trimming, and planing; waste disposal; operation of dry kilns; finishing; shipping; storage; yard and yard equipment; and for power tools and affiliated equipment used in connection with such operations, but excluding the manufacture of plywood, cooperage, and veneer.

(2) *Incorporation of standards by reference.* Certain of the paragraphs of this section incorporate and apply occupational safety and health standards of general application without regard to any specific industry. Such standards shall apply to sawmill operations in accordance with the rules of construction set forth in § 1910.05.

(b) *Definitions applicable to this section*—(1) *A-frame.* The term "A-frame" means a structure made of two independent columns fastened together at the top and separated at the bottom for stability.

(2) *Annealing.* The term "annealing" means heating then cooling to soften and render less brittle.

(3) *Binder.* The term "binder" means a chain, cable, rope, or other approved material used for binding loads.

(4) *Boom.* The term "boom" means logs or timbers fastened together end to end and used to contain floating logs. The term includes enclosed logs.

(5) *Brow log.* The term "brow log" means a log placed parallel to a roadway at a landing or dump to protect vehicles while loading or unloading.

(6) *Bunk.* The term "bunk" means a cross support for a load.

(7) *Cant.* The term "cant" means a log slabbed on one or more sides.

(8) *Carriage (log carriage).* The term "carriage" means a framework mounted on wheels which runs on tracks or in grooves in a direction parallel to the face of the saw, and which contains apparatus to hold a log securely and advance it towards the saw.

(9) *Carrier.* The term "carrier" means an industrial truck so designed and constructed that it straddles the load to be transported with mechanisms to pick up the load and support it during transportation.

(10) *Chipper.* The term "chipper" means a machine which cuts material into chips.

(11) *Chock (bunk block) (cheese block).* The terms "chock", "bunk block", and "cheese block" mean a wedge that prevents logs or loads from moving.

(12) *Cold deck.* The term "cold deck" means a pile of logs stored for future removal.

(13) *Crotch lines.* The term "crotch lines" means two short lines attached to

a hoisting line by a ring or shackle, the lower ends being attached to loading hooks.

(14) *Dog (carriage dog).* The term "dog" means a steel tooth, one or more of which are attached to each carriage knee to hold log firmly in place on carriage.

(15) *Drag saw.* The term "drag saw" means a power-driven, reciprocating crosscut saw mounted on suitable frame and used for bucking logs.

(16) *Head block.* The term "head block" means that part of a carriage which holds the log and upon which it rests. It generally consists of base, knee, taper set, and mechanism.

(17) *Head rig.* The term "head rig" means a combination of head saw and log carriage used for the initial breakdown of logs into timbers, cants, and boards.

(18) *Hog.* The term "hog" means a machine for cutting or grinding slabs and other coarse residue from the mill.

(19) *Husk.* The term "husk" means a head saw framework on a circular mill.

(20) *Industrial truck.* The term "industrial truck" means a mobile power-driven truck or tractor.

(21) *Kiln tender.* The term "kiln tender" means the operator of a kiln.

(22) *Lift truck.* The term "lift truck" means an industrial truck used for lateral transportation and equipped with a power-operated lifting device, usually in the form of forks, for piling or unpiling lumber units or packages.

(23) *Live rolls.* The term "live rolls" means cylinders of wood or metal mounted on horizontal axes and rotated by power, which are used to convey slabs, lumber, and other wood products.

(24) *Loading boom.* The term "loading boom" means any structure projecting from a pivot point to guide a log when lifted.

(25) *Log deck.* The term "log deck" means a platform in the sawmill on which the logs remain until needed for sawing.

(26) *Lumber hauling truck.* The term "lumber hauling truck" means an industrial truck, other than a lift truck or a carrier, used for the transport of lumber.

(27) *Log haul.* The term "log haul" means a conveyor for transferring logs to mill.

(28) *Package.* The term "package" means a unit of lumber.

(29) *Peavy.* The term "peavy" means a stout wooden handle fitted with a spike and hook and used for rolling logs.

(30) *Pike pole.* The term "pike pole" means a long pole whose end is shod with a sharp pointed spike.

(31) *Pitman rod.* The term "pitman rod" means connecting rod.

(32) *Resaw.* The term "resaw" means band, circular, or sash gang saws used to break down slabs, cants, or flitches into lumber.

(33) *Running line.* The term "running line" means any moving rope as distinguished from a stationary rope such as a guyline.

(34) *Safety factor.* The term "safety factor" means a calculated reduction factor which may be applied to laboratory test values to obtain safe working stresses for wooden beams and other mechanical members; ratio of breaking load to safe load.

(35) *Saw guide.* The term "saw guide" mean a device for steadying a circular or bandsaw.

(36) *Setwork.* The term "setwork" means a mechanism on a sawmill carriage which enables an operator to move the log into position for another cut.

(37) *Sorting gaps.* The term "sorting gaps" means the areas on a log pond enclosed by boom sticks into which logs are sorted.

(38) *Spreader wheel.* The term "spreader wheel" means a metal wheel that separates the board from the log in back of circular saws to prevent binding.

(39) *Splitter.* The term "splitter" means a knife-type, nonrotating spreader.

(40) *Sticker.* The term "sticker" means a strip of wood or other material used to separate layers of lumber.

(41) *Stiff boom.* The term "stiff boom" means the anchored, stationary boom sticks which are tied together and on which boom men work.

(42) *Swifter.* The term "swifter" is a means of tying boom sticks together to prevent them from spreading while being towed.

(43) *Telltale.* The term "telltale" means a device used to serve as a warning for overhead objects.

(44) *Top saw.* The term "top saw" means the upper of two circular saws on a head rig, both being on the same husk.

(45) *Tramway* The term "tramway" means a way for trams, usually consisting of parallel tracks laid on wooden beams.

(46) *Trestle.* The term "trestle" means a braced framework of timbers, piles or steelwork for carrying a road or railroad over a depression.

(c) *Building facilities, and isolated equipment*—(1) *Safety factor.* All buildings, docks, tramways, walkways, log dumps, and other structures shall be designed, constructed and maintained so as to support the imposed load in accordance with a safety factor.

(2) *Work areas.* Work areas under mills shall be as evenly surfaced as local conditions permit. They shall be free from unnecessary obstructions and provided with lighting facilities in accordance with American National Standard for Industrial Lighting A11.1—1965.

(3) *Floors.* Flooring in buildings and on ramps and walkways shall be constructed and installed in accordance with established principles of mechanics and sound engineering practices. They shall be of adequate strength to support the estimated or actual dead and live loads acting on them with the resultant stress not exceeding the allowable stress for the material being used.

(i) *Floor and wall openings.* All floor and wall openings shall be protected as prescribed in § 1910.23.

(ii) *Areas beneath floor openings.* Areas under floor openings shall, where practical, be fenced off. When this is not practical, they shall be painly marked and telltales shall be installed to hand over these areas.

(iii) *Floor maintenance.* The flooring of buildings, docks, and passageways shall be kept in good repair. When a hazardous condition develops that cannot be immediately repaired, the area shall be guarded until adequate repairs are made.

(iv) *Nonslip floors.* Floors, footwalks, and passageways in the work area around machines or other places where a person is required to stand or walk shall be provided with effective means to minimize slipping.

(4) *Walkways, docks, and platforms*—(i) *Width.* Walkways, docks, and platforms shall be of sufficient width to provide adequate passage and working areas.

(ii) *Maintenance.* Walkways shall be evenly floored and kept in good repair.

(iii) *Docks.* Docks and runways used for the operation of lift trucks and other vehicles shall have a substantial guard or shear timber except where loading and unloading are being performed.

(iv) *Elevated walks.* All elevated walks, runways, or platforms, if 4 feet or more from the floor level, shall be provided with a standard railing except on loading or unloading sides of platforms. If height exceeds 6 feet, a standard toe board also shall be provided to prevent material from rolling or falling off.

(v) *Elevated platforms.* Where elevated platforms are used routinely on a daily basis they shall be equipped with stairways or fixed ladders in accordance with § 1910.27.

(vi) *Hazardous locations.* Where required, walkways and stairways with standard handrails shall be provided in elevated and hazardous locations. Where such passageways are over walkways or work areas, standard toe boards shall be provided.

(5) *Stairways* — (i) *Construction.* Stairways shall be constructed in accordance with § 1910.24.

(ii) *Handrails.* Stairways shall be provided with a standard handrail on at least one side or on any open side. Where stairs are more than four feet wide there shall be a standard handrail at each side, and where more than eight feet wide, a third standard handrail shall be erected in the center of the stairway.

(iii) *Lighting.* All stairways shall be adequately lighted as prescribed in Subparagraph (9) of this paragraph.

(6) *Emergency exits including doors and fire escapes*—(i) *Opening.* Doors shall not open directly on or block a flight of stairs, and shall swing in the direction of exist travel.

(ii) *Identification.* Exits shall be located and identified in a manner that affords ready exit from all work areas.

(iii) *Swinging doors.* All swinging doors shall be provided with windows; with one window for each section of double swinging doors. Such windows shall be of shatterproof or safety glass unless otherwise protected against breakage.

(iv) *Sliding doors.* Where sliding doors are used as exits, an inner door shall be cut inside each of the main doors and arranged to open outward.

(v) *Barriers and warning signs.* Where a doorway opens upon a railroad track or upon a tramway or dock over which vehicles travel, a barrier or other warning device shall be placed to prevent workmen from stepping into moving traffic.

(7) *Air requirements.* Ventilation shall be provided to supply adequate fresh healthful air to rooms, buildings, and work areas.

(8) *Vats and tanks.* All open vats and tanks into which workmen could fall shall be guarded.

(9) *Lighting*—(i) *Adequacy.* Illumination shall be provided and designed to supply adequate general and local lighting to rooms, buildings, and work areas during the time of use.

(ii) *Effectiveness.* Factors upon which the adequacy and effectiveness of illumination will be judged, include the following:

(*a*) The quantity of light in footcandle intensity shall be sufficient for the work being done.

(*b*) The quality of the light shall be such that it is free from glare, and has correct direction, diffusion, and distribution.

(*c*) Shadows and extreme contrasts shall be avoided or kept to a minimum.

(10) *Ladders.* Ladders shall be installed and maintained as specified in §§ 1910.25, 1910.26, and 1910.27.

(11) *Hazard marking.* Physical hazard marking shall be as specified in § 1910.144 of this part.

(12) *Electrical wiring and equipment.* (i) All electrical equipment should be installed and maintained in accordance with requirements specified in Subpart S of this part.

(ii) *Repairs.* Electrical repairs shall be made only by authorized and qualified personnel.

(iii) *Identification.* Marks of identification on electrical equipment shall be clearly visible.

(iv) *Protective equipment.* Rubber protective equipment shall be provided as required by § 1910.137.

(v) *Open switches.* Before working on electrical equipment, switches shall be open and shall be tagged, blocked, or locked out.

(vi) *Concealed conductors.* Where electrical conductors are known to be concealed, no work shall be performed until such conductors are located.

(vii) *Overload relays.* Overload relays shall be reset by authorized qualified personnel only.

(viii) *Passageways to panels.* Passageways to switch centers or panels shall at all times be kept free from obstruction. Not less than 3 feet of clear space shall be maintained in front of switch centers or panels at all times.

(ix) *Bridging fuses.* Doubling or bridging fuses shall be prohibited.

(13) *Hydraulic systems.* Means shall be provided to block, chain, or otherwise secure equipment normally supported by hydraulic pressure so as to provide for safe maintenance.

(14) *Liquefied petroleum gas storage and handling.* Storage and handling of liquified petroleum gas shall be in accordance with the requirements of § 1910.110.

(15) *Gas piping and appliances.* All gas piping and appliances shall be installed in accordance with the American National Standard Requirements for Gas Appliances and Gas Piping Installations Z21.30—1964.

(16) *Flammable liquids.* Flammable liquids shall be stored and handled in accordance with § 1910.106.

(17) *Storage, handling, and use of chemicals*—(i) *Threshold limits.* Employees shall not be exposed to airborne concentration of toxic dusts, fumes, vapors, mists or gases that exceed the threshold limit values set forth by § 1910.93.

(ii) *Protective equipment.* The use of chemicals shall be controlled so as to protect employees from harmful exposure to toxic materials. Where necessary, employees shall be provided with and required to wear such protective equipment as will afford adequate protection against harmful exposure as required by Subpart I of this part.

(iii) *Open surface tank operations.* Open surface tank operations shall conform to the requirements of § 1910.94(d).

(18) *Conveyors*—(i) *Standards.* Construction, operation, and maintenance of conveyors shall be in accordance with American National Standard B20.1—1957.

(ii) *Guarding.* Spiked live rolls shall be guarded.

(19) *Stationary tramways and trestles*—(i) *Foundations and walkways.* Tramways and trestles shall have substantial mud sills or foundations which shall be frequently inspected and kept in repair. When vehicles are operated on tramways and trestles which are used for foot passage, traffic shall be controlled or a walkway with standard handrails at the outer edge and shear timber on the inner edge shall be provided. This walkway shall be wide enough to allow adequate clearance to vehicles. When walkways cross over other thoroughfares, they shall be solidly fenced at the outer edge to a height of 42 inches over such thoroughfares.

(ii) *Clearance.* Stationary tramways and trestles shall have a verticle clearance of 22 feet over railroad rails. When constructed over carrier docks or roads, they shall have a clearance of 6 feet above the driver's foot rest on the carrier, and in no event shall this clearance be less than 12 feet from the roadway. In existing operations where it is impractical to obtain such clearance, telltales, electric signals, signs or other precautionary measures shall be installed.

(20) *Blower, collecting, and exhaust systems*—(i) *Design, construction, and maintenance.* Blower collecting, and exhaust systems should be designed, constructed, and maintained in accordance with American National Standards Z33.-1—1961 (For the Installation of Blower and Exhaust Systems for Dust, Stock, and Vapor Removal or Conveying) and Z12.2—1962 (R1969) (Code for the Prevention of Dust Explosions in Woodworking and Wood Flour Manufacturing Plants).

(ii) *Collecting systems.* All mills containing one or more machines that create dust, shavings, chips, or slivers during a period of time equal to or greater than one-fourth of the working day, shall be equipped with a collecting system. It may be either continuous or automatic, and shall be of sufficient strength and capacity to enable it to remove such refuse from points of operation and immediate vicinities of machines and work areas.

(iii) *Exhaust or conveyor systems.* Each woodworking machine that creates dust, shavings, chips, or slivers shall be equipped with an exhaust or conveyor system located and adjusted to remove the maximum amount of refuse from the point of operation and immediate vicinity.

(iv) *Exhaust pipes.* Exhaust pipes shall be of such construction and internal dimensions as to minimize the possibility of clogging. They should be accessible for cleaning.

(v) *Dust chambers.* Exhaust pipes shall not discharge into an unconfined outside pile if uncontrolled fire or explosion hazards are created. They may empty into settling or dust chambers, designed to prevent the dust or refuse from entering any work area. Such chambers shall be constructed and operated to minimize the danger of fire or dust explosion.

(vi) *Hand removal of refuse.* Provision for the daily removal of refuse shall be made in all operations not required to have an exhaust system or having refuse too heavy, bulky, or otherwise unsuitable to be handled by the exhaust system.

(21) *Chippers*—(i) *Whole-log chippers.* The feed system to the chipper shall be arranged so the operator does not stand in direct line with the chipper spout (hopper). The chipper spout shall be enclosed to a height of not less than 36 inches from the floor or the operator's platform. A safety belt and lifeline shall be worn by workmen when working at or near the spout unless the spout is guarded. The lifeline shall be short enough to prevent workers from falling into the chipper.

(ii) *Hogs.* (*a*) Hog mills shall be so designed and arranged that from no position on the rim of the chute shall the distance to the cutter knives be less than 40 inches.

(*b*) Hog feed chutes shall be provided with suitable and approved baffles, which shall minimize material from being thrown from the mill.

(*c*) Employees feeding hog mills shall be provided with safety belts and lines unless guarded.

(22) *Mechanical power-transmission apparatus.* The construction, operation, and maintenance of all mechanical power-transmission apparatus shall be in accordance with the requirements of § 1910.219.

(23) *Bins, bunkers, hoppers, and fuel houses*—(i) *Guarding.* Open bins,

bunkers, and hoppers whose upper edges extend less than 3 feet above working level shall be equipped with standard handrails and toe boards, or have their tops covered by a substantial grill or grating with openings small enough to prevent a man from falling through.

(ii) *Use of wheeled equipment to load bins.* Where automotive or other wheeled equipment is used to move materials into bins, bunkers, and hoppers, adequate guard rails shall be installed along each side of the runway, and a substantial bumper stop provided when necessary.

(iii) *Exits, lighting, and safety devices.* Fuel houses and bins shall have adequate exits and lighting, and all necessary safety devices shall be provided and shall be used by persons entering these structures.

(iv) *Walkways.* Where needed, fuel houses and bins shall have a standard railed platform or walkway near the top.

(24) *Ropes, cables, slings, and chains*—(i) *Safe Usage.* Ropes, cables, slings, and chains shall be used in accordance with safe use practices recommended by the manufacturer or within safe limits recommended by the equipment manufacturer when used in conjunction with it.

(ii) *Hooks.* No open hook shall be used in rigging to lift any load where there is hazard from relieving the tension on the hook from the load or hook catching or fouling.

(iii) *Work by qualified persons.* Installation, inspection, maintenance, repair, and testing of ropes, cables, slings, and chains shall be done only by persons qualified to do such work.

(iv) *Slings.* (*a*) Slings and their fittings and fastenings, when in use, shall be inspected daily for evidence of overloading, excessive wear, or damage. Slings found to be defective shall be removed from service.

(*b*) Proper storage shall be provided for slings while not in use.

(*c*) Suitable protection shall be provided between the sling and sharp unyielding surfaces of the load to be lifted.

(v) *Ropes or cables.* (*a*) Wire rope or cable shall be inspected when installed and once each week thereafter, when in use. It shall be removed from hoisting or load-carrying service when kinked or when one of the following conditions exists:

(*1*) When three broken wires are found in one lay of 6 by 6 wire rope.

(*2*) When six broken wires are found in one lay of 6 by 19 wire rope.

(*3*) When nine broken wires are found in one lay of 6 by 37 wire rope.

(*4*) When eight broken wires are found in one lay of 8 by 19 wire rope.

(*5*) When marked corrosion appears.

(*6*) Wire rope of a type not described herein shall be removed from service when 4 percent of the total number of wires composing such rope are found to be broken in one lay.

(*b*) Wire rope removed from service due to defects shall be plainly marked or identified as being unfit for further use on cranes, hoists, and other load-carrying devices.

(*c*) The ratio between the rope diameter and the drum, block, sheave, or pulley tread diameter shall be such that the rope will adjust itself to the bend without exessive wear, deformation, or injury. In no case shall the safe value of drums, blocks, sheaves, or pulleys be reduced when replacing such items unless compensating changes are made for rope used and for safe loading limits.

(vi) *Drums, sheaves, and pulleys.* Drums, sheaves, and pulleys shall be smooth and free from surface defects liable to injure rope. Drums, sheaves, or pulleys having eccentric bores or cracked hubs, spokes, or flanges shall be removed from service.

(vii) *Connections.* Connections, fittings, fastenings, and other parts used in connection with ropes and cables shall be of good quality and of proper size and strength, and shall be installed in accordance with the manufacturer's recommendations.

(viii) *Socketing, splicing, and seizing.* (*a*) Socketing, splicing, and seizing of cables shall be performed only by qualified persons.

(*b*) All eye splices shall be made in an approved manner and wire rope thimbles of proper size shall be fitted in the eye, except that in slings the use of thimbles shall be optional.

(*c*) Wire rope clips attached with U-bolts shall have these bolts on the dead or short end of the rope. The U-bolt nuts shall be retightened immediately after initial load carrying use and at frequent intervals thereafter.

(*d*) When a wedge socket-type fastening is used, the dead or short end of the cable shall be clipped with a U-bolt or otherwise made secure against loosening.

(*e*) *Fittings.* Hooks, shackles, rings, pad eyes, and other fittings that show excessive wear or that have been bent, twisted, or otherwise damaged shall be removed from service.

(*f*) *Running lines.* Running lines of hoisting equipment located within 6 feet 6 inches of the ground or working level shall be boxed off or otherwise guarded, or the operating area shall be restricted.

(*g*) *Number of wraps on drum.* There shall be not less than two full wraps of hoisting cable on the drum of cranes and hoists at all times of operation.

(*h*) *Drum flanges.* Drums shall have a flange at each end to prevent the cable from slipping off.

(*i*) *Sheave guards.* Bottom sheaves shall be protected by close fitting guards to prevent cable from jumping the sheave.

(*j*) *Preventing abrasion.* The reeving of a rope shall be so arranged as to minimize chafing or abrading while in use.

(ix) *Chains.* (*a*) Chains used in load carrying service shall be inspected before initial use and weekly thereafter.

(*b*) Chain shall be normalized or annealed periodically as recommended by the manufacturer.

(*c*) If at any time any 3-foot length of chain is found to have stretched one-third the length of a link it shall be discarded.

(*d*) Bolts or nails shall not be placed between two links to shorten or join chains.

(*e*) Broken chains shall not be spliced by inserting a bolt between two links with the head of the bolt and nut sustaining the load, or by passing one link through another and inserting a bolt or nail to hold it.

(x) *Fiber rope.* (*a*) Frozen fiber rope shall not be used in load carrying service.

(*b*) Fiber rope that has been subjected to acid shall not be used for load carrying purposes.

(*c*) Fiber rope shall be protected from abrasion by padding where it is fastened or drawn over square corners or sharp or rough surfaces.

(25) Reserved.

(26) *Mechanical stackers and unstackers*—(i) *Power-transmission apparatus.* Stackers and unstackers, shall have all gears, sprockets, chains, belt drives, and other power transmission apparatus guarded as specified in § 1910.219.

(ii) *Lumber lifting devices.* Lumber lifting devices on all stackers shall be designed and arranged so as to minimize the possibility of lumber falling from such devices.

(iii) *Blocking hoisting platform.* Means shall be provided to positively block the hoisting platform when employees must go beneath the stacker or unstacker hoist.

(iv) *Identifying controls.* Every manually operated control switch shall be properly identified and so located as to be readily accessible to the operator.

(v) *Locking main control switches.* Main control switches shall be so designed that they can be locked in the open position.

(vi) *Guarding side openings.* The hoistway side openings at the top level of the stacker and unstacker shall be protected by enclosures of standard railings.

(vii) *Guarding hoistway openings.* When the hoist platform or top of the load is below the working platform, the hoistway openings shall be guarded.

(viii) *Guarding lower landing area.* The lower landing area of stackers and unstackers shall be guarded by enclosures that prevent entrance to the area or pit below the hoist platform. Entrances should be protected by electrically interlocked gates which, when open, will disconnect the power and set the hoist brakes. When the interlock is not installed, other positive means of protecting the entrance shall be provided.

(ix) *Inspection.* Every stacker and unstacker shall be inspected at frequent intervals and all defective parts shall be immediately repaired or replaced.

(x) *Cleaning pits.* Safe means of entrance and exit shall be provided to permit cleaning of pits.

(xi) *Preventing entry to hazardous area.* Where the return of trucks from unstacker to stacker is by mechanical power or gravity, adequate signs, warning devices, or barriers shall be erected to prevent entry into the hazardous area.

(27) *Lumber piling and storage*—(i) *Pile foundations.* In stacking units of

lumber, pile foundations shall be designed and arranged to support maximum loads without sinking, sagging, or permitting the piles to topple. In unit package piles, substantial bolsters or unit separators shall be placed between each package directly over the stickers.

(ii) *Stacking dissimilar unit packages.* Long units of lumber shall not be stacked upon shorter packages except where a stable pile can be made with the use of package separators.

(iii) *Unstable piles.* Piles of lumber which have become unstable shall be immediately made safe, or the area into which they might fall shall be fenced or barricaded and employees prohibited from entering it.

(iv) *Stickers.* Unit packages of lumber shall be provided with stickers as necessary to insure stability under ordinary operating conditions.

(v) *Sticker alignment.* Stickers shall extend the full width of the package, shall be uniformly spaced, and shall be aligned one above the other. Stickers may be lapped with a minimum overlapping of 12 inches. Stickers shall not protrude more than 2 inches beyond the sides of the package.

(vi) *Pile height.* The height of unit package piles shall be dependent on the dimensions of the packages and shall be such as to provide stability under normal operating conditions. Adjacent lumber piles may be tied together with separators to increase stability.

(28) *Lumber loading.* Loads shall be built and secured to insure stability in transit.

(29) *Burners*—(i) *Guying.* If the burner stack is not self-supporting, it shall be guyed or otherwise supported.

(ii) *Runway.* The conveyor runway to the burner shall be equipped with a standard handrail. If the runway crosses a roadway or thoroughfare, standard toe boards shall be provided in addition.

(30) *Vehicles*—(i) *Scope.* Vehicles shall include all mobile equipment normally used in sawmill, planing mill, storage, shipping, and yard operations.

(ii) *Warning signals and spark arrestors.* All vehicles shall be equipped with audible warning signals and where practicable shall have spark arrestors.

(iii) *Lights.* All vehicles operated in the dark or in poorly lighted areas shall be equipped with head and tail lights.

(iv) *Overhead guard.* All vehicles operated in areas where overhead hazards exist shall be equipped with an approved overhead guard. See American National Standard Safety Code for Powered Industrial Trucks, B56.1—1969.

(v) *Platform guard.* Where the operator is exposed to hazard from backing the vehicle into objects, an approved platform guard shall be provided and so arranged as to not impede exit of driver from vehicle.

(vi) *Exposed parts.* Vehicle flywheels, gears, sprockets, chains, shear points, and other exposed parts constituting a hazard to the operator or other persons shall be guarded in accordance with the requirements of § 1910.219.

(vii) *Operation in buildings.* Vehicles powered by internal combustion engines shall not operate in buildings unless the buildings are adequately ventilated.

(viii) *Load limits.* No vehicle shall be operated with loads exceeding its safe load capacity.

(ix) *Brakes.* All vehicles shall be equipped with brakes capable of holding and controlling the vehicle and capacity load upon any incline or grade over which they may be operated.

(x) *Lift trucks.* Lift trucks shall be designed, constructed, maintained, and operated in accordance with the requirements of § 1910.178.

(xi) *Carriers.* (*a*) Carriers shall be so designed and constructed that the operator's field of vision shall not be unnecessarily restricted.

(*b*) Carriers shall be provided with an access ladder or equivalent.

(xii) *Lumber hauling trucks.* (*a*) On trucks where movement of load on stopping would endanger the operator, a substantial bulkhead shall be installed behind the operator's seat. This shall extend to the top of the operator's compartment.

(*b*) Stakes, stake pockets, racks, tighteners, and binders and shall provide adequate means to secure the load against any movement during transit.

(*c*) Where rollers are used, at least two shall be equipped with locks which shall be locked when supporting loads during transit.

(31) *Traffic control and flow*—(i) *Hazardous crossings.* Railroad tracks and other hazardous crossings shall be plainly posted and appropriate traffic control devices (American National Standard D8.1—1967 for Railroad-Highway Grade Crossing Protection) should be utilized.

(ii) *Restricted overhead clearance.* All areas of restricted side or overhead clearance shall be plainly marked.

(iii) *Pickup and unloading points.* Pickup and unloading points and paths for lumber packages on conveyors and transfers and other areas where accurate spotting is required, shall be plainly marked and wheel stops provided where necessary.

(iv) *Aisles, passageways, and roadways.* Aisles, passageways, and roadways shall be sufficiently wide to provide safe side clearance. One-way aisles may be used for two-way traffic if suitable turnouts are provided.

(d) *Log handling, sorting, and storage*—(1) *Log unloading methods, equipment, and facilities*—(i) *Unloading methods.* (*a*) Stakes and chocks which trip shall be constructed in such manner that the tripping mechanism that releases the stake or chocks is activated at the opposite side of the load being tripped.

(*b*) Binders on logs shall not be released prior to securing with unloading lines or other unloading device.

(*c*) Binders shall be released only from the side on which the unloader operates, except when released by remote control devices or except when person making release is protected by racks or stanchions or other equivalent means.

(*d*) Loads on which a binder is fouled by the unloading machine shall have an extra binder or metal band of equal strength placed around the load, or the load shall be otherwise secured so the fouled binder can be safely removed.

(ii) *Unloading equipment and facilities.* (*a*) Machines used for hoisting, unloading, or lowering logs shall be equipped with brakes capable of controlling or holding the maximum load in midair.

(*b*) The lifting cylinders of all hydraulically operated log handling machines shall be equipped with a positive device for preventing the uncontrolled lowering of the load or forks in case of a failure in the hydraulic system.

(*c*) A limit switch shall be installed on powered log handling machines to prevent the lift arms from traveling too far in the event the control switch is not released in time.

(*d*) When forklift-type machines are used to load trailers, a means of securing the loading attachment to the fork shall be installed and used.

(*e*) A-frames and similar log unloading devices shall have adequate height to provide safe clearance for swinging loads and to provide for adequate crotch lines and spreader bar devices.

(*f*) Log handling machines used to stack logs or lift loads above operator's head shall be equipped with adequate overhead protection.

(*g*) All mobile log handling machines shall be equipped with headlights and backup lights.

(*h*) Unloading devices shall be equipped with a horn or other plainly audible signaling device.

(*i*) Movement of unloading equipment shall be coordinated by audible or hand signals when operator's vision is impaired or operating in the vicinity of other employees.

(*j*) Wood pike poles shall be made of straight-grained, select material. Metal or conductive pike poles shall not be used around exposed energized electrical conductors. Defective, blunt, or dull pike poles shall not be used.

(2) *Log unloading and storage areas*—(i) *General.* (*a*) Log dumps, booms, ponds, or storage areas used at night shall be illuminated in accordance with the requirements of American National Standard A11.1—1965 (R–1970) Standard Practice for Industrial Lighting.

(*b*) Log unloading areas shall be arranged and maintained to provide a safe working area.

(*c*) Where skids are used, space adequate to clear a man's body shall be maintained between the top of the skids and the ground.

(*d*) Signs prohibiting unauthorized foot or vehicle traffic in log unloading and storage areas shall be posted.

(ii) *Water log dumps.* (*a*) Ungrounded electrically powered hoists using handheld remote control in grounded locations, such as log dumps or mill log lifts, shall be actuated by circuits operating at less than 50 volts to ground.

(*b*) Roadbeds at log dumps shall be of sufficient width and evenness to insure safe operation of equipment.

(*c*) An adequate brow log or skid timbers or the equivalent shall be provided where necessary. Railroad-type dumps,

when located where logs are dumped directly into water or where entire loads are lifted from vehicle, may be exempted providing such practice does not create a hazardous exposure of personnel or equipment.

(*d*) Unloading lines shall be arranged so that it is not necessary for the employees to attach them from the pond or dump side of the load except when entire loads are lifted from the log-transporting vehicle.

(*e*) Unloading lines, crotch lines, or equally effective means shall be arranged and used in a manner to minimize the possibility of any log from swinging or rolling back.

(*f*) When logs are unloaded with peavys or similar manual methods, means shall be provided and used that will minimize the danger from rolling or swinging logs.

(*g*) Guardrails, walkways, and standard handrails shall be installed

(*h*) Approved life rings (see: 46 CFR 160.099 and 46 CFR 160.050) with line attached and maintained to retain buoyancy shall be provided.

(iii) *Log booms and ponds.* (*a*) Walkways and floats shall be installed and securely anchored to provide adequate passageway for employees.

(*b*) All regular boom sticks and foot logs shall be reasonably straight, with no protruding knots and bark, and shall be capable of supporting, above the water line at either end, the weight of an employee and equipment.

(*c*) Permanent cable swifters shall be so arranged that it will not be necessary to roll boom sticks in order to attach or detach them.

(*d*) Periodic inspection of cable or dogging lines shall be made to determine when repair or removal from service is necessary.

(*e*) The banks of the log pond in the vicinity of the log haul shall be reinforced to prevent caving in.

(*f*) Artificial log ponds shall be drained, cleaned, and refilled when unhealthy stagnation or pollution occurs.

(*g*) Employees whose duties require them to work from boats, floating logs, boom sticks, or walkways along or on water shall be provided with and shall wear appropriate buoyant devices while performing such duties.

(*h*) Stiff booms shall be two float logs wide secured by boom chains or other connecting devices, and of a width adequate for the working needs. Walking surfaces shall be free of loose material and maintained in good repair.

(*i*) Boom sticks shall be fastened together with adequate crossties or couplings.

(*j*) Floating donkeys or other power-driven machinery used on booms shall be placed on a raft or float with enough buoyancy to keep the deck well above water.

(*k*) All sorting gaps shall have a substantial stiff boom on each side.

(iv) *Pond boats and rafts.* The applicable provisions of the Standard for Fire Protection for Motorcraft, NFPA No. 302—1968, shall be complied with.

(*a*) Decks of pond boats shall be covered with nonslip material.

(*b*) Powered pond boats or rafts shall be provided with at least one approved fire extinguisher, and one lifering with line attached.

(*c*) Boat fuel shall be transported and stored in approved safety containers (Underwriters Laboratories, Inc.).

(*d*) Inspection, maintenance, and ventilation of the bilge area shall be provided to prevent accumulation of highly combustible materials.

(*e*) Adequate ventilation shall be provided for the cabin area on enclosed cabin-type boats to prevent accumulation of harmful gases or vapors.

(v) *Dry deck storage.* (*a*) Dry deck storage areas shall be kept orderly and shall be maintained in a condition which is conducive to safe operation of mobile equipment.

(*b*) Logs shall be stored in a safe and orderly manner, and roadways and traffic lanes shall be maintained at a width adequate for safe travel of log handling equipment.

(*c*) Logs shall be arranged to minimize the chance of accidentally rolling from the deck.

(vi) *Log hauls and slips.* (*a*) Walkways along log hauls shall have a standard handrail on the outer edge, and cleats or other means to assure adequate footing and enable employees to walk clear of the log chute.

(*b*) Log haul bull chains or cable shall be designed, installed, and maintained to provide adequate safety for the work need.

(*c*) Log haul gear and bull chain drive mechanism shall be guarded.

(*d*) Substantial troughs for the return strand of log haul chains shall be provided over passageways.

(*e*) Log haul controls shall be located and identified to operate from a position where the operator will, at all times, be in the clear of logs, machinery, lines, and rigging. In operations where control is by lever exposed to incoming logs, the lever shall be arranged to operate the log haul only when moved toward the log slip or toward the log pond.

(*f*) A positive stop shall be installed on all log hauls to prevent logs from traveling too far ahead in the mill.

(*g*) Overhead protection shall be provided for employees working below logs being moved to the log deck.

(*h*) Log wells shall be provided with safeguards to minimize the possibility of logs rolling back into well from log deck.

(3) *Log decks*—(i) *Access.* Safe access to the head rig shall be provided.

(ii) *Stops.* Log decks shall be provided with adequate stops, chains, or other safeguards to prevent logs from rolling down the deck onto the carirage or its runway.

(iii) *Barricade.* A barricade or other positive stop of sufficient strength to stop any log shall be erected between the sawyer's stand and the log deck.

(iv) *Loose chains.* Loose chains from overhead canting devices or other equipment shall not be allowed to hang over the log deck in such manner as to strike employees.

(v) *Swing saws.* Swing saws on log decks shall be equipped with a barricade and stops for protection of employees who may be on the opposite side of the log haul chute.

(vi) *Drag saws.* Where reciprocating log cutoff saws (drag saws) are provided, they shall not project into walkway or aisle.

(vii) *Circular cutoff saws.* Circular log bucking or cutoff saws shall be so located and guarded as to allow safe entrance to and exit from the building.

(viii) *Entrance doorway.* Where the cutoff saw partially blocks the entrance from the log haul runway the entrance shall be guarded.

(4) *Mechanical barkers*—(i) *Rotary barkers.* Rotary barking devices shall be so guarded as to prevent employees from flying chips, bark, or other extraneous material.

(ii) *Elevating ramp.* If an elevating ramp or gate is used, it shall be provided with a safety chain, hook, or other means of suspension while employees are underneath.

(iii) *Area around barkers.* The hazardous area around ring barkers and their conveyors shall be fenced off or posted as a prohibited area for unauthorized persons.

(iv) *Enclosing hydraulic barkers.* Hydraulic barkers shall be enclosed with strong baffles at the inlet and outlet. The operator shall be protected by adequate safety glass or equivalent.

(v) *Holddown rolls.* Holddown rolls shall be installed at the infeed and outfeed sections of mechanical ring barkers to control the movement of logs.

(e) *Log breakdown and related machinery and facilities*—(1) *Log carriages and carriage runways*—(i) *Bumpers.* A substantial stop or bumper with adequate shock-absorptive qualities shall be installed at each end of the carriage runway.

(ii) *Footing.* Rider-type carriages shall be floored to provide secure footing and a firm working platform for the block setter.

(iii) *Sheave housing.* Sheaves on rope-driven carriages shall be guarded at floor line with substantial housings.

(iv) *Carriage control.* A positive means shall be provided to prevent unintended movement of the carriage. This may involve a control locking device, a carriage tie-down, or both.

(v) *Barriers and warning signs.* A barrier shall be provided to prevent employees from entering the space necessary for travel of the carriage, with headblocks fully receded, for the full length and extreme ends of carriage runways. Warning signs shall be posted at possible entry points to this area.

(vi) *Overhead clearance.* For a rider-type carriage adequate overhead clear space above the carriage deck shall be provided for the full carriage runway length.

(vii) *Sweeping devices.* Carriage track sweeping devices shall be used to keep track rails clear of debris.

(viii) *Dogs.* Dogging devices shall be adequate to secure logs, cants, or boards, during sawing operations.

(2) *Head saws*—(i) *Band head saws.* (*a*) Band head saws shall not be operated at speeds in excess of those recommended by the manufacturer.

(*b*) Band head saws shall be thoroughly inspected for cracks, splits, broken teeth, and other defects. A bandsaw with a crack greater than one-tenth the width of the saw shall not be placed in service until width of saw is reduced to eliminate crack, until cracked section is removed, or crack development is stopped.

(*c*) Provisions shall be made for alerting and warning employees before starting band head saws, and measures shall be taken to insure that all persons are in the clear.

(ii) *Bandsaw wheels.* (*a*) No bandsaw wheel shall be run at a peripheral speed in excess of that recommended by the manufacturer. The manufacturer's recommended maximum speed shall be stamped in plainly legible figures on some portion of the wheel.

(*b*) Band head saw wheels shall be subjected to monthly inspections. Hubs, spokes, rims, bolts, and rivets shall be thoroughly examined in the course of such inspections. A loose or damaged hub, a rim crack, or loose spokes shall make the wheel unfit for service.

(*c*) Band wheels shall be completely encased or guarded, except for a portion of the upper wheel immediately around the point where the blade leaves the wheel, to permit operator to observe movement of equipment. Necessary ventilating and observation ports may be permitted. Substantial doors or gates are allowed for repair, lubrication, and saw changes; such doors or gates shall be closed securely during operation. Band head rigs shall be equipped with a saw catcher or guard of substantial construction.

(iii) *Single circular head saws.* (*a*) Circular head saws shall not be operated at speeds in excess of those specified by the manufacturer. Maximum speed shall be etched on the saw.

(*b*) Circular head saws shall be equipped with safety guides which can be readily adjusted without use of hand tools.

(*c*) The upper saw of a double circular mill shall be provided with a substantial hood or guard. A screen or other suitable device shall be placed so as to protect the sawyer from flying particles.

(*d*) All circular sawmills where live rolls are not used behind the head saw shall be equipped with a spreader wheel or splitter.

(iv) *Twin circular head saws.* Twin circular head saw rigs such as scrag saws shall meet the specifications for single circular head saws in subdivision (iii) of this subparagraph where applicable.

(v) *Whole-log sash gang saws (Swedish Gangs).* (*a*) Cranks, pitman rods, and other moving parts shall be adequately guarded.

(*b*) Feed rolls shall be enclosed by a cover over the top, front, and open ends except where guarded by location. Drive mechanism to feed rolls shall be enclosed.

(*c*) Carriage cradles of whole-log sash gang saws, Swedish gangs shall be of adequate height to prevent logs from kicking out while being loaded.

(3) *Resaws*—(i) *Band resaws.* Band resaws shall meet the specifications for band head saws as required by subparagraph (2) (i) of this paragraph.

(ii) *Circular gang resaws.* (*a*) Banks of circular gang resaws shall be guarded by a hood.

(*b*) Circular gang resaws shall be provided with safety fingers or other antikickback devices.

(*c*) Circular gang resaws shall not be operated at speeds exceeding those recommended by the manufacturer.

(*d*) Feed belts and drive pulleys shall be guarded in accordance with the requirements of § 1910.219.

(*e*) Feed rolls shall be guarded.

(*f*) Each circular gang resaw, except self-feed saws with a live roll or wheel at back of saw, shall be provided with spreaders.

(iii) *Sash gang resaws.* Sash gang resaws shall meet the safety specifications of whole-log sash gang saws in accordance with the requirements of subparagraph (2) (v) of this paragraph.

(4) *Trimmer saws*—(i) *Maximum speed.* Trimmer saws shall not be run at peripheral speeds in excess of those recommended by the manufacturer.

(ii) *Guards.* (*a*) Trimmer saws shall be guarded in front by adequate baffles to protect against flying debris and they shall be securely bolted to a substantial frame. These guards for a series of saws shall be set as close to the top of the trimmer table as is practical.

(*b*) The end saws on trimmers shall be guarded.

(*c*) The rear of trimmer saws shall have a guard the full width of the saws and as much wider as practical.

(iii) *Safety stops.* Automatic trimmer saws shall be provided with safety stops or hangers to prevent saws from dropping on table.

(5) *Edgers*—(i) *Location.* (*a*) Where vertical arbor edger saws are located ahead of the main saw, they shall be so guarded that an employee cannot contact any part of the edger saw from his normal position.

(*b*) Edgers shall not be located in the main roll case behind the head saws.

(ii) *Guards.* (*a*) The top and the openings in end and side frames of edgers shall be adequately guarded and gears and chains shall be fully housed. Guards may be hinged or otherwise arranged to permit oiling and the removal of saws.

(*b*) All edgers shall be equipped with pressure feed rolls.

(*c*) Pressure feed rolls on edgers shall be guarded against accidental contact.

(iii) *Antikickback devices.* Edgers shall be provided with safety fingers or other approved methods of preventing kickbacks or guarding against them. A barricade in line with the edger, if properly fenced off, may be used if safety fingers are not feasible to install.

(*a*) A controlling device shall be installed and located so that the operator can stop the feed mechanism without releasing the tension of the pressure rolls.

(iv) Live rolls and tailing devices in back of edger shall operate at a speed not less than the speed of the edger feed rolls.

(6) *Planers*—(i) *Guards.* (*a*) All cutting heads shall be guarded.

(*b*) Side head hoods shall be of sufficient height to safeguard the head setscrew.

(*c*) Pressure feed rolls and "pineapples" shall be guarded.

(*d*) Levers or controls shall be so arranged or guarded as to reduce the possibility of accidental operation.

(*e*) *Dry kilns and facilities*—(1) *Kiln foundations.* Dry kilns shall be constructed upon solid foundations to prevent tracks from sagging.

(2) *Passageways.* A passageway shall be provided to give adequate clearance on at least one side or in the center of end-piled kilns and on two sides of cross-piled kilns.

(3) *Doors*—(i) *Main kiln doors.* (*a*) Main kiln doors shall be provided with a method of holding them open while kiln is being loaded.

(*b*) Counterweights on vertical lift doors shall be boxed or otherwise guarded.

(*c*) Adequate means shall be provided to firmly secure main doors, when they are disengaged from carriers and hangers, to prevent toppling.

(ii) *Escape doors.* (*a*) If operating procedures require access to kilns, kilns shall be provided with escape doors that operate easily from the inside, swing in the direction of exit, and are located in or near the main door at the end of the passageway.

(*b*) Escape doors shall be of adequate height and width to accommodate an average size man.

(4) *Pits.* Pits shall be well ventilated, drained, and lighted, and shall be large enough to safely accommodate the kiln operator together with operating devices such as valves, dampers, damper rods, and traps.

(5) *Steam mains.* All high-pressure steam mains located in or adjacent to an operating pit shall be covered with heat-insulating material.

(6) *Ladders.* A fixed ladder, in accordance with the requirements of § 1910.27 or other adequate means shall be provided to permit access to the roof. Where controls and machinery are mounted on the roof, a permanent stairway with standard handrail shall be installed in accordance with the requirements of § 1910.24.

(7) *Chocks.* A means shall be provided for chocking or blocking cars.

(8) *Kiln tender room.* A warm room shall be provided for kiln employees to stay in during cold weather after leaving a hot kiln.

(9) *Mechanical equipment.* All belts, pulleys, blowers, and other exposed moving equipment used in or about kilns shall be guarded in accordance with the requirements of § 1910.219.

(g) *Personal protective equipment.* The requirements for personal protective equipment specified in subpart I shall be complied with.

(h) *Sanitation requirements.* The requirements of § 1910.141 shall govern sanitation practices.

(i) *Fire protection.* The requirements of Subpart L of this part shall be complied with in providing the necessary fire protection for sawmills.

(j) *Additional delay in effective date.* The requirements of this § 1910.265 shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated in this section. In which event, the standard shall be effective under this section upon the commencement of the Walsh-Healey requirement.

§ 1910.266 Pulpwood logging.

(a) *Application—(1) General.* This section applies to pulpwood logging operations including but not limited to the operations of felling, limbing, marking, bucking, loading, skidding, prehauling and other operations associated with the preparation and movement of pulpwood timber from the stump to the point of delivery. The provisions of this section do not apply to logging operations relating to sawlogs, veneer bolts, poles, piling and other forest products.

(2) *Standards incorporated by reference.* Standards covering issues of occupational safety and health which are of general application without regard to any specific industry are incorporated by reference in paragraphs of this section and made applicable to pulpwood logging. All such standards shall be construed according to the rules of construction set out in § 1910.05.

(b) *Definitions applicable to this section—(1) Arch.* The term "arch" means an extension to rear section of a vehicle used in skidding used to raise the forward part of a load clear of the ground.

(2) *Back cut (felling cut).* The term "back cut" means the final cut in a felling operation made on the opposite side from the undercut.

(3) *Backfill.* The term "backfill" means excavated material used to build up a road higher than the original level.

(4) *Ballistic nylon.* The term "ballistic nylon" means a fabric of high tensile properties designed to provide protection from lacerations.

(5) *Borrow.* The term "borrow" means road construction material which is taken to another location for use. The source area is called "borrow pit."

(6) *Buck.* The term "buck" means the process of severing a tree into sections (logs or bolts).

(7) *Choker.* The term "choker" means a length of wire rope or chain with a loop or noose at one end used to secure trees or sections of trees for skidding.

(8) *Debark.* The term "debark" means the action of removing bark from trees or sections of trees. Debark generally denotes mechanical means as opposed to manual peeling. Synonyms are "bark" and "barking".

(9) *Fairlead.* The term "fairlead" means an arrangement of horizontal, and sometimes vertical, rollers usually mounted at the end of an arch to allow free play of wire rope during winching.

(10) *Fell.* The term "fell" means the process of severing a tree from the stump so that it drops to the ground. Note that "fell" and "feller" are used in this standard. The terms "fall" and "faller" are commonly used in the Western United States and they have the same meaning as "fell" and "feller".

(11) *Grade (see slope).* The term "grade" means the slope of a surface such as a roadway. Also, the elevation of a real or planned surface or structure.

(12) *Guarded.* The term "guarded" means protected by a cover, shield, rail, or other device, or by location, so as to reduce the probability of injury.

(13) *Guyline.* The term "guyline" means a line used to stay or support spar trees, booms, etc.

(14) *Landing.* The term "landing" means any area where wood is concentrated. It is also called "yard," "deck," "brow."

(15) *Lodged tree.* The term "lodged tree" means a tree that has not fallen to the ground after being partly or wholly separated from its stump or otherwise displaced from its natural position.

(16) *Pickaroon.* The term "pickaroon" means a device with a head similar to an axe but with a point rather than a blade mounted on the end of a handle which is used to assist in the lifting and placement of bolts of wood.

(17) *Prehaul.* The term "prehaul" means the hauling of forest products by off-the-road vehicles, nonhighway transport, or other movement prior to highway or rail movement, where the pulpwood travels clear of the ground. The term "forward" has the same meaning.

(18) *Riprap.* The term "riprap" means rock, metal stipping, or wooden timbers used to contain and stabilize earth embankments and fills.

(19) *Root wad.* The term "root wad" means the ball of roots which extends above ground level when a tree is pushed over by wind or other means.

(20) *Skid.* The term "skid" means the movement of bolts, logs, or trees by pulling or towing across the terrain. It may be accomplished by a stationary machine, a moving vehicle, or animal. The term is also called "yarding". The definitive feature is contact between the terrain and the product during movement.

(21) *Slope (see grade).* The term "slope" is a term of measurement in percent and means the increase in height over the distance measured. An increase of 1 foot over a distance of 5 feet is expressed as a 20 percent slope.

(22) *Snag.* The term "snag" means any dead standing tree or portion thereof remaining standing.

(23) *Spring pole.* The term "spring pole" means a section of tree, sapling, limb, etc. which is, by virtue of its arrangement with relation to other materials, under tension.

(24) *Undercut.* The term "undercut" means a notch cut in a tree to guide the tree in felling.

(25) *Widow maker.* The term "widow maker" means an overhanging limb or section or tree which could become dislodged and drop to the ground (see also "lodged tree").

(26) *Wood hook.* The terms "wood hook" and "pulp hook" mean a device to be held in one hand which is fitted with a pointed section. The device is used to assist in the manual piling and handling of bolts of wood (see Pickaroon).

(c) *General requirements—(1) Clothing, personal protective devices, and first aid.*

(i) Gloves shall be provided for use when working with wire rope in any form.

(ii) Safety boots or shoes (excluding low cut shoes) shall be provided in accordance with American National Standard for Men's Safety-Toe Footwear, Z41.1—1967.

(iii) Safety helmets of approved design in accordance with American National Standard for Safety Requirements for Industrial Head Protection, A89.1—1969 shall be provided.

(iv) Eye or face protection in accordance with American National Standard for Practice for Occupational and Educational Eye and Face Protection, Z87.1—1968 shall be provided for use where chips and sawdust or flying particles are present.

(v) Dust masks in accordance with American National Standard Practices for Respiratory Protection Z88.2—1969 shall be provided for use where conditions warrant.

(vi) Protection against the effects of noise exposure shall be provided when the sound levels exceed those shown in Table G–16 of § 1910.95 when measured on the A scale of a standard sound level meter at slow response.

(vii) First aid kits sufficient for the number of employees shall be provided at the work site and on all transport vehicles. In all areas where poisonous snakes may exist, snake bite kits shall be a part of the regular first aid equipment. First aid kits shall be regularly inspected and replenished.

(2) *Handtools.* (i) The employer shall be responsible for the safe condition of tools when furnished by him and user shall inspect tool to assure safe condition.

(ii) Handles shall be sound, straight and tight fitting.

(iii) Driven tools shall be dressed to remove any mushrooming.

(iv) Cutting tools shall be kept sharp and properly shaped.

(v) Wood hoods and pickaroons of good grade steel shall be used.

(vi) Tools shall be used for purposes for which they were designed.

(vii) Hands tools shall be sheathed or boxed if transported in a vehicle with personnel. If not contained in a box, the sheathed tools shall be fastened to the vehicle.

(viii) Proper storage facilities shall be provided for hand tools. Tools shall be stored in the provided location at all times when not in use.

(ix) Periodic inspections shall be made to assure all tools are serviceable and others removed from use.

(3) *Environmental conditions.* (i) All work shall terminate and employees moved to a place of safety during electrical storms and periods of high winds or other unusual weather conditions are dangerous to personnel.

(ii) Dead, broken, or rotted limbs or trees that are a hazard (widow makers) shall be felled or otherwise removed before commencing logging operations, building roads, trails or landing, in their vicinity.

(4) *Work areas.* (i) All persons shall be instructed to work within the vocal range of other workmen unless a procedure has been established for periodically checking their location and welfare.

(ii) All men shall be accounted for at the end of each work day.

(iii) An approved (Underwriters Laboratories or Factory Mutual Engineering Corp.) fire extinguisher shall be provided at locations where machines are operating and/or on each vehicle.

(iv) Fuel shall be stored only in approved (Underwriters Laboratories or Factory Mutual Engineering Corp.) well-marked containers located for safe access for fueling vehicles and equipment at a safe distance from all fire hazards.

(5) *Chain saw operations.* (i) Chain saw operators shall be instructed to daily inspect the saws daily to assure that all handles and guards are in place and tight, that all controls function properly, and that the muffler is operative.

(ii) Chain saw operators shall be instructed to follow manufacturer's instructions as to operation and adjustment.

(iii) Chain saw operators shall be instructed to fuel the saw only in safe areas and not under conditions conducive to fire such as near men smoking, hot engine, etc.

(iv) Chain saw operators shall be instructed to hold the saw with both hands during operation.

(v) Chain saw operators shall be instructed to start the saw at least 10 feet away from fueling area.

(vi) Chain saw operators shall be instructed to start the saw only on the ground or when otherwise firmly supported.

(vii) Chain saw operators shall be instructed to be certain of footing and to clear away brush which might interfere before starting to cut.

(viii) Chain saw operators shall be instructed not to use engine fuel for starting fires or as a cleaning solvent.

(ix) Chain saw operators shall be instructed to shut off the saw when carrying it for a distance greater than from tree to tree or in hazardous conditions such as slippery surfaces or heavy underbrush. The saw shall be at idle speed when carried short distances.

(x) Chain saw operators shall be instructed to carry the saw in a manner to prevent contact with the chain and muffler.

(xi) Chain saw operators shall be instructed not to use the saw to cut directly overhead or at a distance that would require the operator to relinquish a safe grip on the saw.

(6) *Stationary and mobile equipment operation.* (i) Equipment operators shall be instructed as to the manufacturers recommendations for equipment operation, maintenance, safe practices, and site operating procedures.

(ii) Equipment shall be kept free of flammable material.

(iii) Equipment shall be kept free of any material which might contribute to slipping and falling.

(iv) Engine of equipment shall be shut down during fueling, servicing, and repairs except where operation is required for adjustment.

(v) Equipment shall be inspected for evidence of failure or incipient failure.

(vi) The equipment operator shall be instructed to walk completely around machine and assure that no obstacles for personnel are in the area before startup.

(vii) The equipment operator shall be instructed to start and operate equipment only from the operator's station or from safe area recommended by the manufacturer.

(viii) Seat belt shall be provided on mobile equipment.

(ix) The equipment operator shall be instructed to check all controls for proper function and response before starting working cycle.

(x) The equipment operator shall be instructed to ground or secure all movable elements when not in use.

(xi) The equipment operator shall be advised of the load capacity and operating speed of the equipment.

(xii) The equipment operator shall be advised of the stability limitations of the equipment.

(xiii) The equipment operator shall be instructed to maintain adequate distance from other equipment and personnel.

(xiv) Where signalmen are used, the equipment operator shall be instructed to operate the equipment only on signal from the designated signalman and only when signal is distinct and clearly understood.

(xv) The equipment operator shall be instructed not to operate movable elements (boom, grapple, load, etc.) close to or over personnel.

(xvi) The equipment operator shall be instructed to signal his intention before operation when personnel are in or near the working area.

(xvii) The equipment operator shall be instructed to dismount and stand clear for all loading and unloading of his mobile vehicle by other mobile equipment. The dismounted operator shall be visible to loader operator.

(xviii) The equipment operator shall be instructed to operate equipment in a manner that will not place undue shock loads on wire rope.

(xix) The equipment operator shall be instructed not to permit riders or observers on the machine unless approved seating and protection is provided.

(xx) The equipment operator shall be instructed to shut down the engine when the equipment is stopped, apply brake locks and ground moving elements before he dismounts.

(xxi) The equipment operator shall be instructed, when any equipment is transported from one job location to another, to transport it on a vehicle of sufficient rated capacity and the equipment shall be properly secured during transit.

(xxii) When any equipment is being moved or operated in the vicinity of an electric distribution line a minimum clearance of ten feet shall be maintained between the electric distribution line and all elements of the machine.

(7) *Explosives.* Only trained and experienced personnel shall handle or use explosives. Usage shall comply with the requirements of § 1910.109.

(d) *Equipment protective devices—stationary and mobile equipment*—(1) *Operator's manual.* There shall be an operator's manual or operating instructions with each machine. It will describe operation, maintenance, and safe practices.

(2) *Protective canopy.* A protective canopy shall be provided for the operator of mobile equipment. It shall be so constructed as to protect the operator from injury due to falling trees or limbs, saplings or branches which might enter the compartment side areas, and snapping winch lines or other objects.

(i) The canopy shall be of adequate size so as not to impair the operator's movements.

(ii) The canopy framework shall consist of at least two arches, either transverse or longitudinal. If transverse, one arch shall be installed behind the operator and one immediately in front of the operator. They shall be joined at the top by at least two longitudinal braces. There shall be two braces which shall act as deflecting guards extending from the leading edge of the forward arch to the front part of the frame of the tractor. If longitudinal arches are used, they shall be extended from behind the operator to the front part of the frame and each arch shall have an intermediate support located immediately ahead of the operator so that ingress or egress is not impeded. Regardless of the type of construction used, the fabrication and method of connecting to the tractor shall be of such design as to develop a strength equivalent to the upright members.

(iii) The overhead covering shall be of solid material and extend the full width of the canopy.

(iv) The power portion of cab shall be completely enclosed with solid material, except at entrances, to prevent the operator from being injured from obstacles entering the cab.

(v) The upper rear portion of cab shall be fully enclosed with open mesh material with openings of such a size as to reject the entrance of an object larger than 1¾ inch in diameter. It shall provide maximum readward visibility.

(vi) Open mesh shall be extended forward as far as possible from the rear corners of the cab sides so as to give the maximum protection against obstacles, branches, etc., entering the cab area.

(vii) Deflectors shall also be installed ahead of the operator to deflect whipping saplings and branches. These shall be located so as to not impede ingress or egress from the compartment.

(viii) The entrance opening of the canopy shall be not less than 52 inches in vertical height.

(ix) Where glass is used it shall be safety glass. An approved substitute may be used.

(*a*) An additional metal screen shall be used where glass alone is not adequate operator protection.

(*b*) Provision shall be made to clean glass to assure adequate visibility.

(3) *Guards.* Guards shall be provided for exposed moving elements such as shafts, pulleys, belts, conveyors, and gears in accordance with § 1910.219 and American National Standard Safety Code for Conveyors, Cableways, and Related Equipment, B20.1—1957. Guards shall be in place at all times machine is in operation.

(4) *Mufflers.* Mufflers provided by the manufacturer or their equivalent shall be in place at all times the machine is in operation.

(5) *Guylines.* Guylines shall be arranged in such manner that stresses will be imposed on not less than two guylines. Stumps used for anchoring guylines shall be carefully chosen as to position and strength. They shall be tied back if necessary. Standing trees shall not be used for this purpose.

(6) *Stability and reliability.* Crane and loader stability and boom reliability shall be in accordance with American National Standard Safety Code for Cranes, Derricks and Hoists Overhead and Gantry Cranes, B30.2—1967, and American National Standard Safety Code for Cranes, Derricks and Hoists—Crawler, Locomotive, and Truck Cranes, B30.5—1968.

(e) *Pulpwood harvesting*—(1) *Felling, general.* (i) Work areas shall be assigned such that a tree cannot fall into an adjacent work area. The recommended distance between workers is twice the height of trees being felled.

(ii) When trees may fall into public roads a flagman shall be assigned to direct traffic.

(iii) Workers shall be instructed not to approach a feller closer than twice the height of trees being felled until the feller has acknowledged the signal of approach.

(iv) Lodged trees shall be pulled to the ground at first opportunity with mechanical equipment or animal.

(v) Workers shall be instructed not to work under a lodged tree.

(vi) Special precautions shall be taken to prevent felling trees into powerlines.

(vii) If a tree does make contact with a powerline the power company shall be notified immediately and all personnel shall remain clear of the area until power company personnel advises that conditions are safe.

(2) *Manual felling.* (i) The feller shall be instructed to plan retreat path and clear path as necessary before cut is started.

(ii) The feller shall be instructed to appraise situation for dead limbs, the lean of tree to be cut, wind conditions, location of other trees and other hazards and exercise proper precautions before cut is started.

(iii) Undercuts shall be about one-third the diameter of the tree to guide tree and reduce possibility of splitting. (Local practice where small diameter trees are felled without being undercut is acceptable if the direction of fall is controlled by the practice.)

(iv) Back or felling cut shall be parallel to the inner edge of the undercut and approximately two inches higher than the undercut.

(v) The saw shall be shut off before feller starts his retreat.

(vi) On terrain where trees are likely to slide or roll fellers shall be instructed to fell trees from the uphill side and arrange to keep uphill from previously felled trees.

(3) *Bucking.* (i) Bucking on slopes shall be from the uphill side unless the log has been securely blocked to prevent rolling or swinging.

(ii) Spring poles and trees under stress shall be cut so that employee is clear when the tension is released. (This is accomplished by cutting under the bend.)

(iii) Trees piled for bucking shall be piled in an orderly parallel manner that minimizes hazard to employees.

(4) *Limbing.* Spring poles and limbs under stress shall be cut in such a manner that the employee is clear when tension is released.

(5) *Mechanical debarking and delimbing.* Guarding shall be provided so as to protect employees from flying chunks, logs, chips, bark, limps, and other material and to prevent the worker from contacting moving parts.

(6) *Skidding and prehauling, general*—(i) Only a designated, trained operator shall operate a skid or prehaul machine.

(ii) Choker setters shall work on uphill side of log.

(iii) No passenger personnel shall ride on a prehaul vehicle, logs, pallets, skid pans or other load unless adequate seating and protection is provided except on animal powered wagons.

(iv) Chokers shall be positioned near the end of the log or tree length to allow turning of the prehaul vehicle, to prevent the penetration of the operator station and to reduce possibility of striking the wheel or track.

(v) During winching, the equipment shall be positioned so that the winch line is in alignment with the long axis of the prehaul machine.

(vi) A stuck or inoperative vehicle shall be towed. A loaded pallet shall not be pushed.

(vii) Stakes shall not be added to permit a load beyond the rated capacity of pallets and trailers.

(viii) The operator shall be instructed to be observant and cautious of height of load and vehicle when traveling under trees, limbs, and other overhead obstructions.

(7) *Skidding and prehauling equipment requirements.* (i) Arches, fairleads, drawbars, hitches and bumpers or fenders shall be designed and constructed to allow a minimum radius vehicle turn without the load contacting a rear tire or the rear of a track assembly.

(ii) Towed equipment such as skid pans, pallets and trailers shall be attached in such a manner as to allow a full 90° turn, prevent overrunning of the towed vehicle, and assure control of the towed equipment.

(iii) Animal towed equipment shall be equipped with a hand brake within reach of the driver.

(iv) Prehaulers shall have a means for securely retaining pallets or pulpwood.

(v) Prehaulers shall have a means of securely retaining loader for transport when so equipped.

(vi) Provision shall be made to securely fasten and to protect all tools and material on the carrier.

(8) *Personnel transport.* (i) The driver shall be properly licensed.

(ii) Flammable liquids shall not be transported on personnel carriers unless a safe and adequate compartment is provided.

(iii) Seats shall be securely fastened.

(9) *Off highway truck transport.* Truck drivers shall be instructed to stop their vehicles, dismount, check and tighten loose load binders, either just before or immediately after leaving a private road to enter a public road.

(10) *Manual loading.* (i) The carrier shall be positioned to provide safe working clearance between carrier and pile.

(ii) Proper lifting techniques shall be used, i.e., straight back and bend knees.

(iii) The stick shall be placed in the carrier in such manner that it is or will be properly secured.

(iv) Manual handling shall be limited to a weight consistent with safe practices.

(11) *Machine loading.* (i) Piles shall be located to provide a safe work area.

(ii) Only the machine operator and slingman, where used, shall be in the work area.

(iii) The load shall be positioned for balance and to prevent slippage or loss. Slings shall be placed to secure and balance the load.

(12) *Storage.* Piles shall be located and constructed in a manner to provide safe working area around them.

(13) *Banding and piling bundles.* (i) Steel bands in good condition shall be used.

(ii) Bands shall be placed when bundle is close to ground.

(iii) No part of the body shall be under the bundle at any time. Bundles shall be placed on runners. Bundles may be double stacked with top end bundle one half or more back from the lower rank end bundle.

(14) *Chipping (in-woods locations).* (i) Access covers or doors shall not be opened until the drum or disk is at a complete stop.

(ii) Infeed and discharge ports shall be designed to prevent contact by personnel with disc, knives, or blower blades.

(15) *Roads and trials, general.* (i) Roads shall be maintained and hazardous conditions corrected.

(ii) Where vision is limited warnings shall be posted.

(iii) Curve radii shall be the maximum consistent with terrain.

(iv) When nightwork is necessary adequate lighting shall be provided.

(v) Local road standards and maximum weight of traffic expected shall be used as guides for materials, construction features and drainage.

(16) *Road and trail pioneering and earthwork.* (i) Banks at the borrow area shall be sloped to prevent slides.

(ii) Backfill shall be adequately compacted.

(iii) Roadside banks shall be sloped or stabilized to prevent slides.

(iv) Overhanging banks, large rocks and debris shall be removed or secured.

(v) Where riprap is used the material and design shall assure safe containment of material.

(vi) Trees or snags which may fall into the road shall be felled.

(17) *Road and trail drainage.* (i) Drainage shall be provided to prevent washouts and landslides.

(ii) Culverts shall be of adequate strength and of a size to handle maximum runoff.

(iii) Where necessary, ditches and banks shall be stabilized by vegetation, riprap or other adequate means.

(18) *Road and trail surfacing.* Road surface shall be properly compacted, graded and crowned.

(19) *Bridges.* (i) Construction shall provide for maximum anticipated loads and side thrust with a substantial safety factor.

(ii) Bridges shall be decked and curbed.

(f) Additional delay in effective date.

The requirements of this § 1910.266 shall be effective on February 15, 1972, unless before that date any employment or place of employment becomes subject to any safety or health standard which is published in 41 CFR Part 50–204 by virtue of the application of the Walsh-Healey Public Contracts Act (41 U.S.C. 35–45) and which is incorporated by reference in this section. In which event, the standard shall be effective under this section upon the commencement of the Walsh-Healey requirement.

§ 1910.267 Agricultural operations.

(a)(1) The standards referenced in the remaining subparagraphs of this paragraph apply to the indicated operations, whether or not they include as a part of, agricultural operations.

(2) Sanitation in temporary labor camps—§ 1910.142.

(3) Storage and handling of anhydrous ammonia—§ 1910.111 (a) and (b).

(4) Pulpwood logging—§ 1910.226.

(5) Slow-moving vehicles—§ 1910.145.

(b) Except to the extent specified in paragraph (a) of this section, the standards contained in Subparts B through S of this part do not apply to agricultural operations.

(c) The development of standards having more general application to agricultural operations will be the subject of study under section 6 of the Act.

§ 1910.268 Sources of standards.

Sec.		*Source*
1910.261	---	ANSI P1.1—1969, Safety Standard for Pulp, Paper, and Paperboard Mills.
1910.262	---	ANSI L1.1—1956, Textile Safety Code.
1910.263	---	ANSI Z50.1—1947, Safety Code for Bakery Equipment.
1910.264	---	ANSI Z8.1—1961, Safety Code for Laundry Machinery and Operations.
1910.265	---	ANSI O2.1—1969, Safety Requirements for Sawmills.
1910.266	---	ANSI O3.1—1970, Pulpwood Logging Safety Standards.

§ 1910.269 Standards organizations.

Specific standards of the following organizations have been referenced in this subpart. Copies of the referenced standards may be obtained from the issuing organizations. The names and addresses of the issuing organizations are as follows:

American National Standards Institute (ANSI), 1430 Broadway, New York, NY 10018.

National Fire Protection Association (NFPA), 60 Batterymarch Street, Boston, MA 02110.

American Society of Mechanical Engineers, Inc., United Engineering Center, 345 East 47th Street, New York, NY 10017.

Institute of Markers of Explosives, 420 Lexington Avenue, New York, NY 10017.

Underwriters Laboratories, Inc., 207 East Ohio Street, Chicago, IL 60611.

Subpart S—Electrical

§ 1910.308 Application.

(a) *General.* Sections 1910.310 through 1910.328 adopt as national consensus standards, and publish, certain articles of the National Electrical Code NFPA 70—1968 which are listed in § 1910.330. Articles of the National Electrical Code NFPA 70—1968, which are not so published, are also adopted as national concensus standards and are incorporated by reference in this subpart.

(b) *Coverage of subpart.* (1) This subpart covers the electric conductors and equipment installed within or on public and private buildings and other premises, including yards, carnival and parking lots, and industrial substations; also the conductors that connect the installations to a supply of electricity, and other outside conductors adjacent to the premises; also mobile homes and travel trailers.

(2) This subpart does not cover installation in ships, watercraft, railway rolling stock, aircraft or automotive vehicles, installations underground in mines, installations of railways for generation, transformation, transmission or distribution of power used exclusively for operation of rolling stock or installations used exclusively for signaling and communication purposes, installation of communication equipment under exclusive control of communication utilities, located outdoors or in building spaces used exclusively for such installations, installations under the exclusive control of electric utilities for the purpose of communication, metering or for the generation, control, transformation, transmission and distribution of electric energy located in buildings used exclusively for utilities for such purposes or located outdoors on property owned or leased by the utility or on public highways, streets, roads, etc., or outdoors by established rights on private property.

(d) *Definition applicable to this subpart.* "Approved" as used in this subpart means listed or approved by at least one of the following nationally recognized testing laboratories: Underwriters Laboratories, Inc.; Factory Mutual Engineering Corp.

§ 1910.309 National Electrical Code.

All electrical installations and utilization equipment shall be installed and maintained in accordance with the provisions of the National Electrical Code NFPA 70—1968 (ANSI C–1—1968).

§ 1910.310 General.

(a) *Voltages.* Throughout this subpart the voltage considered shall be that at which the circuit operates, whether the current is supplied by a battery, generator, transformer, rectifier, or a thermopile.

(b) *Conductor gages.* Conductor sizes are given in American Wire Gage (AWG).

(c) *Conductors.* Conductors normally used to carry current shall be of copper unless otherwise provided in this subpart. Where the conductor material is not specified, the sizes given in this subpart shall apply to copper conductors. Where other materials are used, the size shall be changed accordingly.

(d) *Deteriorating agencies.* Unless approved for the purposes, no conductors or equipment shall be located in damp or wet locations; where exposed to gases, fumes, vapors, liquids or other agents having a deteriorating effect on the conductors or equipment; nor where exposed to excessive temperatures.

(e) *Mechanical execution of work.* Electrical equipment shall be installed in a neat and workmanlike manner.

(f) *Mounting of equipment.* Electrical equipment shall be firmly secured to the surface on which it is mounted. Wooden plugs driven into holes in masonry, concrete, plaster or similar materials shall not be depended on for security.

(g) *Connections to terminals.* Connection of conductors to terminal parts shall insure a thoroughly good connection without damaging the conductors and shall be made by means of pressure connectors (including setscrew type), solder lugs or splices to flexible leads except that No. 8 or smaller solid conductors and No. 10 or smaller stranded conductors may be connected by means of clamps or screws with terminal plates having upturned lugs. Terminals for more than one conductor shall be of a type approved for the purpose.

Because of different characteristics of copper and aluminum, devices such as pressure connectors and soldering lugs shall be suitable for the material of the conductor and shall be properly installed

and used. Materials such as solder, fluxes, inhibitors, and compounds, where employed, shall be suitable for the use and shall be of a type which will not adversely affect the conductors, installation, or equipment.

(h) *Splicers.* Conductors shall be spliced or joined with splicing devices approved for the use or by brazing welding or soldering with a fusible metal or alloy. Soldered splices shall first be so spliced or joined as to be mechanically and electrically and secure without solder and then soldered. All splices and joints and the free ends of conductors shall be covered with an insulation equivalent to that of the conductors.

(i) *Working space about electrical equipment (600 volts or less).* Sufficient access and working space shall be provided and maintained about all electrical equipment to permit ready and safe operation and maintenance of such equipment.

(1) *Working clearances.* Except as elsewhere required or permitted in this subpart the dimension of the working space in the direction of access to live parts, operating at not more than 600 volts, which are likely to require examination, adjustment, servicing or maintenance while alive, shall not be less than indicated in Table S–1. Distances are to be measured from the live parts if such are exposed or from the enclosure front or opening when such are enclosed.

TABLE S-1—WORKING CLEARANCES

Voltage to ground	Minimum clear distance—Condition		
	(i)	(ii)	(iii)
	Feet	*Feet*	*Feet*
0–150	2½	2½	3
151–600	2½	3½	4

Where the "Conditions" are as indicated in subdivisions (i), (ii), and (iii) of this subparagraph.

(i) Exposed live part on one side and no live or grounded part on the other side of the working space or exposed live parts on both sides effectively guarded by suitable wood or other insulated wire or insulated bus bars operating at not more than 300 volts shall not be considered live parts.

(ii) Exposed live parts on one side and grounded parts on the other side. Concrete, brick, or tile walls shall be considered as grounded.

(iii) Exposed live parts on both sides of the work space (not guarded as provided in subdivision (i) of this subparagraph) with the operator between.

(iv) *Exception.* Working space is not required in back of assemblies such as dead-front switchboards or control centers when there are no renewable or adjustable parts such as fuses or switches on the back and when all connections are accessible from other locations than the back. Smaller spaces may be permitted where it is judged that the particular arrangement of the installation will provide adequate accessibility.

(2) *Clear spaces.* Working space required by this section shall not be used for storage. When normally enclosed live parts are exposed for inspection or servicing, the working space, if in a passageway or general open space, shall be suitably guarded.

(3) *Access and entrance to working space.* At least one entrance of sufficient area shall be provided to give access to the working space about electrical equipment.

(4) *Front working space.* In all cases where there are live parts normally exposed on the front of switchboards or control centers, the working space in front of such boards or panels shall be not less than 3 feet.

(5) *Illumination.* Adequate illumination shall be provided for all working spaces about switchboards and control centers.

(6) *Headroom.* The minimum headroom of working spaces about switchboards or control centers where there are live parts exposed at any time, shall be 6¼ feet.

(j) *Guarding of live parts.* (Not more than 600 volts.)

(1) *Enclosures.* Except as elsewhere required or permitted by this subpart, live parts of electrical equipment operating at 50 volts or more shall be guarded against accidental contact by approved cabinets or other forms of approved enclosures, or any of the methods listed in subdivisions (i) through (v) of this subparagraph.

(i) By location in a room, vault, or similar enclosure which is accessible only to qualified persons.

(ii) By suitable permanent, substantial partitions or screens so arranged that only qualified persons will have access to the space within reach of the live parts. Any openings in such partitions or screens shall be so sized and located that persons are not likely to come into accidental contact with the live parts or to bring conducting objects into contact with them.

(iii) By a guard rail, provided the live parts operate at 600 volts or less and provided the location is such as to make contact with live parts unlikely.

(iv) By location on a suitable balcony, gallery, or platform so elevated and arranged as to exclude unqualified persons.

(v) By elevation at least 8 feet above the floor or other working surface.

(2) *Guards.* In locations where equipment would be exposed to physical damage, enclosures or guards shall be so arranged and of such strength as to prevent such damage.

(3) *Entrances.* Entrances to rooms and other guarded locations containing exposed live parts shall be marked with conspicuous warning signs forbidding unqualified persons to enter.

(k) *Arcing parts.* Parts of electrical equipment which in ordinary operation produce arcs, sparks, flames or molten metal, shall be enclosed unless separated and isolated from all combustible material.

(l) *Light and power from railway conductors.* Circuits for lighting and power shall not be connected to any system containing trolley wires with a ground return, except in electric railway cars, car houses, power houses, or passenger and freight stations operated in connection with electric railways.

(m) *Insulation resistance.* All wiring shall be so installed that when completed the system will be free from short circuits and from grounds other than as provided in section 1910.314.

(n) *Marking.* The manufacturer's name, trademark, or other descriptive marking by which the organization responsible for the product may be identified, shall be placed on all electrical equipment. Other markings shall be provided giving voltage, current, wattage, or other ratings as are prescribed elsewhere in this subpart.

(o) *Identification.* Each disconnecting means required by this subpart for motors and appliances, and each service, feeder or branch circuit at the point where it originates, shall be legibly marked to indicate its purpose unless located and arranged so the purpose is evident. The marking shall be of sufficient durability to withstand the environment involved.

§ 1910.311 [Reserved]

§ 1910.312 Overcurrent protection.

(a) *Protection of equipment.* Equipment shall be protected against overcurrent.

(b) *Interrupting capacity.* Devices intended to break current shall have an interrupting capacity sufficient for the voltage employed and for the current which must be interrupted.

(c) *Circuit impedance and other characteristics.* The overcurrent protective devices, the total impedance, and other characteristics of the circuit to be protected shall be so selected and coordinated as to permit the circuit protective devices used to clear a fault without the occurrence of extensive damage to the electrical components of the circuit. This fault may be assumed to be between two or more of the circuit conductors; or between any circuit conductor and the grounding conductor or enclosing metal raceway.

(d) *Location in premises.* Overcurrent devices shall be located where they will be not exposed to physical damage and not in the vicinity of easily ignitible material.

(e) *Enclosures for overcurrent devices*—(1) *General.* Overcurrent devices shall be enclosed in cutout boxes or cabinets, unless a part of a specially approved assembly which affords equivalent protection, or unless mounted on switchboards, panelboards or controllers located in rooms or enclosures free from easily ignitible material and dampness. The operating handle of a circuit breaker may be accessible without opening a door or cover.

(2) *Damp or wet locations.* Enclosures for overcurrent devices in damp or wet locations shall be of a type approved for such locations and shall be mounted so there is at least one-fourth inch air space between the enclosure and the wall or other supporting surface.

(f) *Arcing or suddenly moving parts.* Arcing or suddenly moving parts shall

comply with subparagraph (1) and (2) of this paragraph.

(1) *Location.* Fuses and circuit breakers shall be so located or shielded that persons will not be burned or otherwise injured by their operation.

(2) *Suddenly moving parts.* Handles or levers of circuit breakers, and similar parts which may move suddenly in such a way that persons in the vicinity are liable to be injured by being struck by them, shall be guarded or isolated.

§ 1910.313 [Reserved]

§ 1910.314 Grounding.

(a) *Circuit and system grounding*—(1) *Two-wire direct-current systems.* Two-wire direct-current systems supplying interior wiring, and operating at not more than 300 volts between conductors, shall be grounded, unless such system is used for supplying industrial equipment in limited areas and the circuit is equipped with a ground detector.

(2) *Three-wire direct-current systems.* The neutral conductor of all three-wire direct-current systems supplying interior wiring shall be grounded.

(3) *Alternating-current systems.* Secondary alternating-current systems supplying interior wiring, and interior alternating-current wiring systems, except those covered in subparagraphs (4), (5), and (6) of this paragraph, shall be grounded when they can be so grounded that the maximum voltage to ground does not exceed 150 volts. Where a service conductor is uninsulated the system shall be grounded.

(4) *Furnace circuits.* Electric furnace circuits need not be grounded.

(5) *Electric crane circuits.* Circuits for electric cranes operating over combustible fibers in Class III hazardous locations shall not be grounded.

(6) *Circuits of less than 50 volts.* Circuits of less than 50 volts need not be grounded, except as provided in this subparagraph.

(i) Where supplied by transformers from systems of more than 150 volts to ground, except as provided in paragraph (d)(4)(iii) of this section.

(ii) Where supplied by transformers from ungrounded systems.

(iii) Where run overhead outside buildings.

(b) *Location of grounding connections.* The grounding of wiring systems, circuits, arresters, cable armor, conduit, or other metal raceways as a protective measure shall be so arranged that there will be no objectionable passage of current over the grounding conductors. The temporary currents set up under accidental conditions, while the grounding conductors are performing their intended protective functions, are not to be considered as objectionable. Where an objectionable flow of current occurs over a grounding conductor, due to the use of multiple grounds, one or more of such grounds shall be abandoned or their location shall be changed, or the continuity of the conductor between the grounding connections shall be suitably interrupted, or other means satisfactory shall be taken to limit the current.

(c) *Enclosure grounding.*—(1) *Service conductor enclosures.* Service raceways, service cable sheaths or armoring, when of metal, shall be grounded.

(2) *Other conductor enclosures.* Metal enclosures for conductors shall be grounded, except they need not be grounded in runs of less than 25 feet which are free from probable contact with ground, grounded metal, metal lath or conductive thermal insulation and which, where within reach from grounded surfaces, are guarded against contact by persons.

(3) *Spacing from lightning rods.* Metal enclosures of conductors shall, wherever practicable, be kept at least 6 feet away from lightning rod conductors. Where it is not practicable to secure 6 feet separations, they shall be bonded together.

(d) *Equipment grounding*—(1) *Fixed equipment—general.* Under any of the conditions of this subparagraph exposed, noncurrent-carrying metal parts of fixed equipment, which are liable to become energized, shall be grounded:

(i) Where equipment is supplied by means of metal-clad wiring;

(ii) Where equipment is located in a wet location and is not insulated;

(iii) Where equipment is located within reach of a person who can make contact with any grounded surface or object;

(iv) Where equipment is located within reach of a person standing on the ground;

(v) Where equipment is in a hazardous location;

(vi) Where equipment is in electrical contact with metal or metal lath;

(vii) Where equipment operates with any terminal at more than 150 volts to ground, except as provided in this subdivision:

(*a*) Enclosures for switches or circuit breakers where accessible to qualified persons only;

(*b*) Metal frames of electrically heated devices, in which case the frames shall be permanently and effectively insulated from ground;

(*c*) Transformers mounted on wooden poles at a height of more than 8 feet from the ground.

(2) *Fixed equipment—specific.* Exposed, noncurrent-carrying metal parts of the kinds of equipment provided in this subparagraph, regardless of voltage, shall be grounded:

(i) The frames of stationary motors shall be grounded where any of the conditions of this subdivision (i) exist:

(*a*) Supplied by means of metal-enclosed wiring.

(*b*) Located in a wet place and not isolated nor guarded.

(*c*) In a hazardous location.

(*d*) The motor operates with any terminal at more than 150 volts to ground. Grounding of the motor frame is preferable, but where the frame of the motor is not grounded, it shall be permanently and effectively insulated from the ground.

(ii) Controller cases for motors, except lined covers of snap switches;

(iii) Electric equipment of elevators and cranes;

(iv) Electric equipment in garages, theaters and motion picture studios, except pendant lampholders on circuits of not more than 150 volts to ground;

(v) Motion picture projection equipment;

(vi) Electric signs and associated equipment, unless these are inaccessible to unauthorized persons and are also insulated from ground and from other conductive objects;

(vii) Generator and motor frames in an electrically operated organ, unless the generator is effectively insulated both from ground and from the motor driving it;

(viii) Switchboard frames and structures supporting switching equipment, except that frames of direct-current, single-polarity switchboards need not be grounded where effectively insulated;

(ix) Equipment supplied by Class 1 and Class 2 remote control and signaling circuits where paragraph (a) of this section requires those circuits to be grounded.

(3) *Nonelectrical equipment.* The metal parts provided for in this subparagraph shall be grounded.

(i) Frames and tracks of electrically operated cranes;

(ii) The metal frame of a nonelectrically driven elevator car to which electric conductors are attached;

(iii) Hand-operated metal shifting ropes or cables of electric elevators;

(iv) Metal enclosures such as partitions, grill work, etc., around equipment carrying voltages in excess of 750 volts between conductors, unless in substations or vaults under the sole control of the supply company.

(4) *Equipment connected by cord and plug.* Under any of the conditions of this subparagraph, exposed noncurrent carrying metal parts of cord and plug connected equipment, which are liable to become energized, shall be grounded:

(i) In hazardous locations;

(ii) When operated at more than 150 volts to ground except:

(*a*) Motors, where guarded;

(*b*) Metal frames of electrically heated appliances exempted by subparagraph (5) of this paragraph.

(iii) In other than residential occupancies,

(*a*) Refrigerators, freezers, air conditioners, and

(*b*) Clothes washing, clothes drying and dishwashing machines, sump pumps and

(*c*) Portable, hand held, motor operated tools, and appliances of the following types; drills, hedge clippers, lawn mowers, wet scrubbers, sanders and saws, and

(*d*) Cord and plug connected appliances used in damp or wet locations, or by persons standing on the ground or on metal floors or working inside of metal tanks or

(*e*) Portable tools which are likely to be used in wet and conductive locations, except:

(*1*) Portable tools which are likely to be used in wet and conductive locations need

not be grounded where supplied through an insulating transformer with ungrounded secondary of not over 50 volts.

(2) Portable tools covered by subdivisions (c), (d), and (e), of this subdivision and appliances covered by subdivision (c) of this subdivision protected by an approval system of double insulation, or its equivalent, need not be grounded. Where such an approved system is employed, the equipment shall be distinctively marked.

(5) *Grounding.* Metal frames of portable, stationary, and fixed electrically heated appliances, operating on circuits above 150 volts to ground, shall be grounded in the manner specified in this section.

Refrigerators, freezers and air conditioners shall comply with the requirements of subparagraphs (1), (2), and (4) of this paragraph.

(6) *Spacing from lightning rods.* Metal frames and enclosures of electric equipment shall, wherever practicable, be kept at least 6 feet away from lightning rod conductors. Where it is not practicable to secure 6 feet separation, they shall be bonded together.

(e) *Methods of grounding*—(1) *Effective grounding.* The path to ground from circuits, equipment, and conductor enclosures shall be permanent and continuous and shall have ample carrying capacity to conduct safely any currents liable to be imposed on it, and shall have impedance sufficiently low to limit the potential above ground and to facilitate the operation of the overcurrent devices in the circuit.

(2) *Common use of grounding conductor.* The grounding conductor of a wiring system shall also be used for grounding equipment, conduit and other metal raceways or enclosures for conductors, including service conduit or cable sheath and service equipment. Exception: The grounding connection may be made to a grounded cold water pipe near the equipment.

(3) *Equipment on structural metal.* (i) Electric equipment secured to and in contact with the grounded structural metal frame of a building, shall be deemed to be grounded.

(ii) Metal car frames supported by metal hoisting cables attached to or running over sheaves or drums of elevator machines shall be deemed to be grounded where the machine is grounded in accordance with this subpart.

(f) *Bonding*—(1) *Bonding at service equipment.* The electrical continuity of the grounding circuit for the equipment and enclosures as provided in this subparagraph shall be assured by one of the means of subparagraph (2) of this paragraph.

(i) The service raceways or service cable armor or sheath, except as provided in section 230—63(b) and section 250—55 of the National Electrical Code NFPA 70—1968 (ANSI C-1—1968):

(ii) All service equipment enclosures containing service entrance conductors, including meter fittings, boxes or the like, interposed in the service raceway or armor;

(iii) Any conduit or armor which forms part of the grounding conductor to the service raceway.

(2) *Continuity at service equipment.* Electrical continuity at service equipment shall be assured by:

(i) Bonding equipment to the grounded service conductor.

(ii) Threaded couplings and threaded bosses on enclosures with joints shall be made up wrenchtight where rigid conduit is involved.

(iii) Threadless couplings made up tight for rigid metal conduit and electrical metallic tubing.

(iv) Bonding jumpers meeting the other requirements of this section. Bonding jumpers shall be used around concentric or eccentric knockouts which are punched or otherwise formed so as to impair the electrical connection to ground.

(v) Otherwise devices (not locknuts and bushings) approved for the purpose.

(g) *Instrument transformers, relays, etc.*—(1) *Instrument transformer circuits.* The secondary circuits of current and potential instrument transformers shall be grounded where the primary windings are connected to circuits of 300 volts or more to ground, and where on switchboards, shall be grounded irrespective of voltage, except that such circuits need not be grounded where the primary windings are connected to circuits of 750 volts or less and no live parts or wiring are exposed or accessible to other than qualified persons.

(2) *Instrument transformer cases.* Cases or frames of instrument transformers shall be grounded where accessible to other than qualified persons, except that case or frames of current transformers, the primaries of which are not over 150 volts of ground and which are used exclusively to supply current to meters, need not be grounded.

(3) *Cases of instruments, meters and relays—operating voltage 750 or less.* Instruments, meters and relays which operate with windings or working parts at 750 volts or less shall be grounded as indicated in this subparagraph.

(i) Instruments, meters, and relays not located on switchboards, which operate with windings or working parts at 300 volts or more to ground, and accessible to other than qualified persons, shall have the cases and other exposed metal parts grounded;

(ii) Instruments, meters, and relays (whether operated from current and potential transformers, or connected directly in the circuit) on switchboards having no live parts on the front of the panels shall have the cases grounded;

(iii) Instruments, meters, and relays (whether operated from current and potential transformers, or connected directly in the circuit) on switchboards having exposed live parts on the front of panels shall not have their cases grounded. Mats of insulating rubber or other suitable floor insulation, shall be provided for the operator where the voltage to ground exceeds 150.

(4) *Cases of instruments meters and relays—operating voltage over 750.* Where instruments meters and relays have current-carrying parts over 750 volts to ground, they shall be isolated by elevation or protected by suitable barriers, grounded metal or insulating covers or guards. Their cases shall not be grounded, except in electrostatic ground detectors the internal ground segments of the instrument are connected to the instrument case and grounded; the ground detector shall be isolated by elevation.

§ 1910.315 Outlet, switch, and junction boxes, and fittings.

(a) *Round boxes.* Round boxes shall not be used where conduits or connectors requiring the use of locknuts or bushings are to be connected to the side of the box.

(b) *Nonmetallic boxes.* Nonmetallic boxes approved for the purpose may be used only with open wiring on insulators, concealed knob-and-tube work, nonmetallic sheathed cable, and with approved nonmetallic conduit.

(c) *Metallic boxes.* Where used with knob-and-tube work or nonmetallic sheathed cable, and mounted on metal or metal lath ceilings or walls, such boxes shall be insulated from their supports and from the metal or metal lath, or shall be grounded.

(d) *Damp or wet locations.* In damp or wet locations, boxes and fittings shall be so placed or equipped as to prevent moisture or water from entering and accumulating within the box or fitting. Boxes and fittings in wet locations shall be weatherproof.

(e) *Number of conductors in a box.* Boxes shall be of sufficient size to provide free space for all conductors enclosed in the box. The provisions of this paragraph shall apply to terminal housings supplied with motors. Subparagraphs (1) and (2) of this paragraph do not apply to conductors used for rewiring existing raceways.

(1) *Maximum number.* The maximum number of conductors, including grounding conductors, but not counting fixture wires, permitted in outlet and junction boxes shall be as in Tables S-2 and S-3 with the exceptions noted.

(i) Tables S-2 and S-3 apply where no fittings or devices, such as fixture studs, cable clamps, hickeys, switches or receptacles are contained in the box. Where one or more fixture studs, cable clamps, or hickeys are contained in the box, the number of conductors shall be one less than shown in Tables S-2, S-3, and S-4 with a further deduction of one conductor for one or several flush devices mounted on the same strap. A conductor running through the box is counted as one conductor and each conductor originating outside the box and terminating inside the box is counted as one conductor. Conductors of which no part leaves the box are not to be counted in the above computation. If single flush boxes are ganged, and each section is occupied by a flush device or combination of flush devices on the same strap, the limitations will apply to each section individually.

TABLE S-2—DEEP BOXES

Box dimensions, inches trade size	Cubic inch cap	Maximum number of conductors			
		No. 14	No. 12	No. 10	No. 8
3¼ x 1½ octagonal	10.9	5	4	4	3
3½ x 1½ octagonal	11.9	5	5	4	3
4 x 1½ octagonal	17.1	8	7	6	5
4 x 2⅛ octagonal	23.6	11	10	9	7
4 x 1½ square	22.6	11	10	9	7
4 x 2⅛ square	31.9	15	14	12	10
4 11/16 x 1½ square	32.2	16	14	12	10
4 11/16 x 2⅛ square	46.4	23	20	18	15
3 x 2 x 1½ device	7.9	3	3	3	2
3 x 2 x 2 device	10.7	5	4	4	3
3 x 2 x 2¼ device	11.3	5	5	4	3
3 x 2 x 2½ device	13	6	5	5	4
3 x 2 x 2¾ device	14.6	7	6	5	4
3 x 2 x 3½ device	18.3	9	8	7	6
4 x 2⅛ x 1½ device	11.1	5	4	4	3
4 x 2⅛ x 1⅞ device	13.9	6	6	5	4
4 x 2⅛ x 2⅛ device	15.6	7	6	6	5

TABLE S-3—SHALLOW BOXES

Box dimensions, inches trade size	Maximum number of conductors		
	No. 14	No. 12	No. 10
3¼	4	4	3
4	6	6	4
1¼ x 4 square	9	7	6
4 11/16	8	6	6

NOTE: Any box less than 1½ inch deep is considered to be a shallow box.

(2) *Conductor sizes.* For combinations or conductor sizes not shown in Tables S-2 and S-3, Table S-4 shall apply.

TABLE S-4.—VOLUME REQUIRED PER CONDUCTOR

Size of Conductor:	*Free space within box for each conductor (cubic inches)*
No. 14	2.
No. 12	2.25
No. 10	2.5
No. 8	3.
No. 6	5.

(3) *Boxes.* Boxes, other than those described in Tables S-2 and S-3, shall be durably and legibly marked by the manufacturer with their cubic inch content. All boxes shall be durably and legibly marked with the manufacturer's name or trademark.

(f) *Conductors entering boxes or fittings.* Conductors entering boxes or fittings shall be protected from abrasion, and shall conform to subparagraphs (1), (2), and (3) of this paragraph.

(1) *Openings to be closed.* Openings through which conductors enter shall be adequately closed.

(2) *Metal boxes and fittings.* Where metal outlet boxes or fittings are installed with open wiring or concealed knob-and-tube work, conductors shall enter through insulating bushings or, in dry places, through flexible tubing extending from the last insulating support and firmly secured to the box or fitting. Where raceway or cable is installed with metal outlet boxes or fittings, the raceway or cable shall be secured to such boxes and fittings.

(3) *Nonmetallic boxes.* Where nonmetallic boxes are used with open wiring or concealed knob-and-tube work, the conductors shall enter through individual holes. Where flexible tubing is used to encase the conductor, the tubing shall extend from the last insulating support and may be run into the box or terminate at the wall of the box. If nonmetallic sheathed cable is used, the cable assembly shall enter the box through a knockout opening. Clamping of individual conductors or cables to the box is not required where supported within 8 inches of the box. Where nonmetallic conduit is installed with nonmetallic boxes or fittings, the conduit shall be secured to such boxes and fittings in a manner consistent with the requirements of this subpart.

(g) *Unused openings.* Unused openings in boxes and fittings shall be effectively closed to afford protection substantially equivalent to that of the wall of the box or fitting. Metal plugs or plates used with nonmetallic boxes or fittings shall be recessed at least one-fourth inch from the outer surface.

(h) *Boxes enclosing flush devices.* Boxes used to enclose flush devices shall be of such design that the devices will be completely enclosed on back and sides, and that substantial support for the devices will be provided. Screws for supporting the box shall not be used in attachment of the device contained therein.

(i) *In wall or ceiling.* In walls or ceilings of concrete, tile or other noncombustible material, boxes and fittings shall be so installed that the front edge of the box or fitting will not set back of the finished surface more than one-fourth inch. In walls and ceilings constructed of wood or other combustible material, outlet boxes and fittings shall be flush with the finished surface or project therefrom.

(j) *Repairing plaster.* Except on walls or ceilings of concrete, tile, or other noncombustible material, a plaster surface which is broken or incomplete shall be repaired so that there will be no gaps or open spaces at the edge of the box or fitting.

(k) *Exposed extensions.* In making an exposed extension from an existing outlet of concealed wiring, a box, extension ring or blank cover shall be mounted over the original box and electrically and mechanically secured to it. The extension shall then be connected to this box in the manner prescribed for the method of wiring employed in making the extension.

(l) *Supports.* (1) Boxes shall be securely and rigidly fastened to the surface upon which they are mounted, or securely and rigidly embedded in concrete or masonry. Except as otherwise provided in this paragraph, boxes shall be supported from a structural member of the building either directly or by using a substantial and approved metallic or wooden brace. If of wood the brace shall not be less than nominal 1 inch thickness. If of metal it shall be corrosion resistant and shall be not less than 0.0239 inch thick (No. 24 MSG).

(2) Where mounted in new walls in which no structural members are provided or in existing walls in previously occupied buildings, boxes less than 100 cubic inches in size, specifically approved for the purpose, shall be affixed with approved anchors or clamps so as to provide a rigid and secure installation.

(3) Threaded boxes or fittings less than 100 cubic inches in size, which do not contain devices or support fixtures may be considered adequately supported if two or more conduits are threaded into the box wrenchtight and are supported within 3 feet of the box on two or more sides as is required by this paragraph.

(m) *Depth of outlet boxes for concealed work.* Outlet boxes for concealed work shall have an internal depth of at least 1½ inches, except that where the installation of such a box will result in injury to the building structure or is impracticable, a box not less than one-half inch internal depth may be installed.

(n) *Covers and canopies.* In completed installations each outlet box shall be provided with a cover unless a fixture canopy is used.

(1) *Nonmetallic boxes.* Nonmetallic covers and plates or metallic covers and plates may be used with nonmetallic outlet boxes. When metallic covers or plates are used, they shall comply with the grounding requirements of § 1910.314 (d) (1).

(2) *Canopy or pan.* Where a fixture canopy or pan is used, any combustible wall or ceiling finish exposed between the edge of the canopy or pan and the outlet box shall be covered with noncombustible material.

(3) *Flexible cords.* Covers of outlet boxes having holes through which flexible cord pendants pass, shall be provided with bushings designed for the purpose or shall have smooth, well-rounded surfaces on which the cords may bear. So-called hardrubber or composition bushings shall not be used.

(4) *Covers.* All pull boxes, junction boxes and fittings shall be provided with covers approved for the purpose. Where metallic covers are used, they shall comply with the grounding requirements of § 1910.314(d) (1).

(o) *Accessibility of junction, pull, and outlet boxes.* Junction, pull, and outlet boxes shall be so installed that the wiring contained in them may be rendered accessible without removing any part of the building, sidewalk, or paving.

§ 1910.316 Flexible cords and cables.

(a) *General.* Flexible cords and cables and their associated fittings shall be suitable for the condition of use and location.

(b) *Use*—(1) *Permissible usage.* Flexible cord may be used only for:

(i) Pendants;

(ii) Wiring of fixtures;

(iii) Connection of portable lamps or appliances;

(iv) Elevator cables;

(v) Wiring of cranes and hoists;

(vi) Connection of stationary equipment to facilitate their frequent interchange; or

(vii) Prevention of the transmission of noise or vibration; or

(viii) Facilitating the removal or disconnection of fixed or stationary appliances for maintenance or repair.

(2) *Attachment plugs.* Where used as permitted in subparagraph (1) (iii), (vi), and (viii) of this subparagraph, each flexible cord shall be equipped with an attachment plug and shall be energized from an approved receptacle outlet.

(c) *Prohibited uses.* Except where installed in data processing systems flexible cord shall not be used as a substitute for the fixed wiring of a structure, where run through holes in walls, ceilings, or floors; where run through doorways, windows, or similar openings; where attached to building surfaces or where concealed behind building walls, ceilings, or floors.

(d) *Splices.* Flexible cord shall be used only in continuous length without splice or tap.

(e) *Pull at joints and terminals.* Flexible cords shall be so connected to devices and to fittings that tension will not be transmitted to joints or terminal screws. This shall be accomplished by a knot in the cord, winding with tape, by a special fitting designed for that purpose, or by other means which will prevent a pull on the cord from being directly transmitted to joints or terminal screws.

§ 1910.317 [Reserved]

§ 1910.318 Transformers.

(a) *General*—(1) *Guarding.* Transformers shall be guarded as provided in this subparagraph.

(i) Appropriate provisions shall be made to minimize the possibility of damage to transformers from external causes where the transformers are located where they are exposed to physical damage.

(ii) Dry-type transformers shall be provided with a noncombustible moisture-resistant case or enclosure which will provide reasonable protection against the accidental insertion of foreign objects.

(iii) The transformer installation shall conform with the provisions for guarding of live parts in section 1910.310(i).

(iv) The operating voltage of exposed live parts of transformer installations shall be indicated by signs or visible markings on the equipment or structures.

(2) *Grounding.* Exposed noncurrent carrying metal parts of transformer installations including fences, guards, etc., shall be grounded where required under the conditions and in the manner prescribed for electrical equipment and other exposed metal parts in section 1910.314.

(3) *Marking.* Each transformer shall be provided with a nameplate giving the name of the manufacturer; rated kilovolt-amperes, frequency, primary, and secondary voltage; and the amount and kind of insulating liquid where used, when the transformer rating exceeds 25 kva. Where Class B insulation is used in the construction of dry-type transformers rated more than 100 kva the nameplate shall indicate the temperature rise for this insulation system.

(b) *Specific provisions applicable to different types of transformers*—(1) *Dry-type transformers installed indoors.* Transformers rate 112½ kva or less shall have a separation of at least 12 inches from combustible material unless separated therefrom by a fire-resistant heat-insulating barrier, or unless of a rating not exceeding 600 volts and completely enclosed except for ventilating openings.

Transformers of more than 112½ kva rating shall be installed in a transformer room of fire-resistant construction unless they are constructed with 80° C. rise (Clss B) or 150° C. rise (Class H) insulation, and are separated from combustible material not less than 6 feet horizontally and 12 feet vertically or are separated therefrom by a fire-resistant heat-insulating barrier.

Transformers rated more than 35,000 volts shall be installed in a vault.

(2) *Askarel-insulated transformers installed indoors.* Askarel-insulated transformers rated in excess of 25 kva shall be furnished with a pressure-relief vent. Where installed in a poorly ventilated place they shall be furnished with a means for absorbing any gases generated by arcing inside the case, or the pressure relief vent shall be connected to a chimney or flue which will carry such gases outside the building. Askarel-insulated transformers rated more than 35,000 volts shall be installed in a vault.

(3) *Oil-insulated transformers installed indoors.* Oil-insulated transformers shall be installed in a vault constructed as specified in this section except:

(i) Vaults for transformers not over 112½ kva total capacity may be constructed of reinforced concrete not less than 4 inches thick.

(ii) For transformers not over 600 volts a vault is not required provided suitable arrangements are made where necessary to prevent a transformer oil fire igniting other materials, and the total transformer capacity in one location does not exceed 10 kva in a section of the building classified as combustible, or 75 kva where the surrounding structure is classified as fire-resistant construction.

(iii) Electric furnace transformers of a total rating not exceeding 75 kva may be installed without a vault in a building or room of fire-resistant construction provided suitable arrangements are made to prevent a transformer oil fire spreading to other combustible material.

(iv) Transformers may be installed in a building which does not conform with the provisions specified in this subpart for transformer vaults, provided neither the building nor its contents present a fire hazard to any other building or property, and provided the building is used only in supplying electric service and the interior is accessible only to qualified persons.

(4) *Oil-insulated transformers installed outdoors.* Combustible material, combustible buildings, and parts of buildings, fire escapes, door and window openings, shall be safeguarded from fires originating in oil-insulated transformers installed on, attached to, or adjacent to a building or combustible material. Space separations, fire-resistant barriers, automatic water spray systems and enclosures which confine the oil of a ruptured transformer tank are recognized safeguards. One or more of these safeguards shall be applied according to the degree of hazard involved in cases where the transformer installation presents a fire hazard. Oil enclosures may consist of fire-resistant dikes, curbed areas or basins, or trenches filled with coarse crushed stone. Oil enclosures shall be provided with trapped drains in cases where the exposure and the quantity of oil involved are such that removal of oil is important.

(c) *Provisions for transformer vaults*—(1) *Location.* Vaults shall be located where they can be ventilated to the outside air without using flues or ducts wherever such an arrangement is practicable.

(2) *Walls, roof, and floor.* The walls and roofs of vaults shall be constructed of reinforced concrete, brick, load bearing tile, concrete block, or other fire resistive construction which have adequate structural strength for the conditions, and a minimum fire resistance of 2½ hours according to NFPA 251—1969, Standard Methods of Fire Tests of Building Construction and Materials. The floors of vaults in contact with the earth shall be of concrete not less than 4 inches thick but when the vault is constructed with a vacant space or other stories below it, the floor shall have adequate structural strength for the load imposed thereon and a minimum fire resistance of 2½ hours.

(3) *Doorways.* Vault doorways shall be protected as provided in this subparagraph.

(i) Each doorway leading into a building shall be provided with a tight-fitting door of a type approved for openings in Class A situations as defined in NFPA 80—1970, Standard for Fire Doors and Windows.

(ii) A door sill or curb of sufficient height to confine within the vault the oil from the largest transformer shall be provided and in no case shall the height be less than 4 inches.

(iii) Entrance doors shall be equipped with locks, and doors shall be kept locked, access being allowed only to qualified persons. Locks and latches shall be so arranged that the door may be readily and quickly opened from the inside.

(4) *Ventilation.* The ventilation shall be adequate to prevent a transformer temperature in excess of the values prescribed in ANSI C–57.12.00—1968, American National Standard General Requirements for Distribution, Power and Regulating Transformers and Shunt Reactors.

(5) *Ventilation openings.* When required by subparagraph (4) of this paragraph openings for ventilation shall be provided in accordance with this subparagraph.

(i) Ventilation openings shall be located as far away as possible from doors, windows, fire escapes, and combustible material.

(ii) Vaults ventilated by natural circulation of air may have roughly half of the total area of openings required for ventilation in one or more openings near the floor and the remainder in one or more openings in the roof or in the sidewalls near the roof; or all of the area required for ventilation may be provided in one or more openings in or near the roof.

(iii) In the case of vaults ventilated to an outdoor area without using ducts or flues the combined net area of all ventilating openings after deducting the area occupied by screens, gratings, or louvers, shall be not less than 3 square inches per kva of transformer capacity in service, except that the net area shall be not less than 1 square foot for any capacity under 50 kva.

(iv) Ventilation openings shall be covered with durable gratings, screens, or louvers, according to the treatment required in order to avoid unsafe conditions.

(v) Where automatic dampers are used in the ventilation openings of vaults containing oil-insulated transformers, the actuating device should be made to function at a temperature resulting from fire and not at a temperature which might prevail as a result of an over heated transformer or bank of transformers, automatic dampers should be designed and constructed to minimize the possibility of accidental closing.

(vi) Ventilating ducts shall be constructed of fire-resistant material.

(6) *Drainage.* Where practicable, vaults containing more than 100 kva transformer capacity shall be provided with a drain or other means which will carry off any accumulation of oil or water in the vault unless local conditions make this impracticable. The floor shall be pitched to the drain when provided.

(7) *Water pipes and accessories.* Any pipe or duct systems foreign to the electrical installation should not enter or pass through a transformer vault. Where the presence of such foreign systems cannot be avoided, appurtenances thereto which require maintenance at regular intervals shall not be located inside the vault. Arrangements shall be made where necessary to avoid possible trouble from condensation leaks and breaks in such foreign systems. Piping or other facilities provided for fire protection or for water-cooled transformers are not deemed to be foreign to the electrical installation.

(8) *Storage in vaults.* Materials shall not be stored in transformer vaults.

§ 1910.319 [Reserved]

§ 1910.320 Appliances.

(a) *General*—(1) *Application.* This section shall apply to electric appliances used in any occupancy.

(2) *Live parts.* Appliances shall have no live parts normally exposed to contact, except for toasters, grills or other appliances in which the current-carrying parts at high temperatures are necessarily exposed.

(3) *Motor-operated appliances.* The requirements of Article 422 of the National Electrical Code NFPA 70—1968 (ANSI C-1—1968) apply to motor-operated appliances.

(b) *Installation of appliances*—(1) *Flexible cords.* Flexible cords used to connect appliances shall comply with the provisions of this subparagraph.

(i) All smoothing irons and portable electrically heated appliances rated at more than 50 watts and which produce temperatures in excess of 121° C. (250° F.) on surfaces with which the cord is liable to be in contact shall be provided with one of the types of approved heater cords.

(ii) All other portable electrically heated appliances shall be connected with one of the approved types of cord.

(iii) Flexible cord may be used for connection of portable appliances, connection of stationary appliances to facilitate their frequent interchange or prevention of the transmission of noise or vibration or facilitating the removal or disconnection of fixed appliances for maintenance or repair.

(2) *Portable immersion heaters.* Electric heaters of the portable immersion type shall be so constructed and installed that current-carrying parts are effectively insulated from electrical contact with the substance in which immersed.

(3) *Protection of combustible material.* Each electrically heated appliance that is obviously intended by size, weight, and service to be located in a fixed position shall be so placed as to provide ample protection between the appliance and adjacent combustible material.

(4) *Stands for portable appliances.* Each smoothing iron and other portable electrically heated appliance which is intended to be applied to combustible material shall be equipped with an approved stand which may be a separate piece of equipment or may be a part of the appliance.

(5) *Signals for heated appliances.* Each electrically heated appliance, or group of electrically heated appliances, intended to be applied to combustible material, shall be installed in connection with a signal unless the appliance is provided with an integral temperature-limiting device.

(6) *Water heaters.* Each water heater shall be equipped with temperature-limiting means in addition to the control thermostat to disconnect all ungrounded conductors, and such means shall be installed to sense maximum water temperature; trip-free, manually reset, or it shall use a replacement element; in addition to any other devices protecting the tank against excessive temperature or pressure, or both.

(7) *Infrared lamp industrial heating appliances.* (i) Infrared heating lamps rated at 300 watts or less may be used with lampholders of the medium-base, unswitched porcelain type, or other types approved for the purpose.

(ii) Screw-shell lampholders shall not be used with infrared lamps over 300 watts rating unless the lampholders are especially approved for the purpose.

(iii) Lampholders may be connected to any of the branch circuits and, in industrial occupancies, may be operated in series on circuits of more than 150 volts to ground provided the voltage rating of the lampholders is not less than the circuit voltage.

(iv) Each section panel or strip carrying a number of infrared lampholders (including the internal wiring of such section, panel or strip) is considered an appliance. The terminal connection block of each such assembly is deemed an individual outlet.

(8) *Grounding.* Metal frames of portable, stationary and fixed electrically heated appliances, operating on circuits above 150 volts to ground, shall be grounded in the manner specified in section 1910.314, provided, however, that where this is impracticable, grounding may be omitted in which case the frames shall be permanently and effectively insulated from the ground.

(9) Refrigerators, freezers, and air conditioners shall comply with the requirements of section 1910.314(d) (1), (2), and (4).

(9) *Wall-mounted ovens and counter-mounted cooking units.* (i) Wall-mounted ovens and counter-mounted cooking units complete with provisions for mounting and for making electrical connections shall be considered as fixed appliances.

(ii) A separable connector or a plug and receptacle combination in the supply line to an oven or cooking unit used only for ease in servicing or for installation shall:

(*a*) Not be installed as the disconnecting means required by paragraph (c)(1) of this section.

(*b*) Be approved for the temperature of the space in which it is located.

(c) *Control and protection of appliances.*—(1) *Disconnecting means.* Each appliance shall be provided with a means for disconnection from all ungrounded conductors as required by subparagraphs (2) through (7) of this paragraph. Where an appliance is supplied by more than one source the disconnecting means shall be grouped and identified.

(2) *Disconnection of fixed appliances.* (i) For fixed appliances rated at not over 300 volts or one-eighth horsepower, the branch circuit overcurrent device may serve as the disconnection means.

(ii) For fixed appliances of greater rating the branch circuit switch or circuit breaker may, where readily accessible to the user of the appliance, serve as the disconnecting means.

(3) *Disconnection of portable appliances.* (i) For portable appliances a separable connector or an attachment plug and receptacle may serve as the disconnecting means.

(ii) The rating of a receptacle or of a separable connector shall not be less than the rating of any applicance connected thereto, except that demand factors authorized elsewhere in this subpart may be applied.

(iii) Attachment plugs and connectors shall conform to the provisions of this subdivision.

(*a*) They shall be so constructed and installed as to guard against inadvertent contact with live parts.

(*b*) They shall be capable of interrupting their rated current without hazard to the operator.

(c) They shall be so designed that they will not fit into receptacles of lesser rating.

(4) *Disconnection of stationary appliances.* (i) For stationary appliances rated at not over 300 volt amperes or one-eighth horsepower, the branch-circuit overcurrent device may serve as the disconnecting means.

(ii) For stationary appliances of greater rating the branch-circuit switch or circuit breaker may, where readily accessible to the user of the appliance, serve as the disconnecting means.

(iii) For cord-connected appliances such as freestanding household-type ranges and clothes dryers, a separable connector or an attachment plug and receptacle may serve as the disconnecting means. Attachment plugs and connectors shall conform to subparagraph (3)(iii) of this pargaraph.

(5) *Unit switches as disconnecting means.* Unit switches which are a part of an appliance shall not be considered as taking the place of the disconnecting means required by paragraph (c) of this section, unless there are other means for disconnection. The branch-circuit switch or circuit breaker, where readily accessible to the user of the appliance, may be used for this purpose.

(6) *Switch and circuit breaker to be indicating.* Switches and circuit breakers used as disconnecting means shall be of the indicating type.

(7) *Location of disconnecting means for motor-driven appliances.* When a switch or circuit breaker serves as the disconnecting means for a stationary or fixed motor-driven appliance of more than one-eighth horsepower, it shall be located within sight of the motor controller or shall be capable of being locked in the open position.

§ 1910.321 [Reserved]

§ 1910.322 Hazardous locations, general.

(a) *Application.* (1) The provisions of sections 1910.322, .324, .326, and .328 apply to locations in which the apparatus and wiring are subject to the conditions indicated by the following classifications. It is intended that each room, section or area (including motor and generator rooms, and rooms for the enclosure of control equipment) shall be considered individually in determining its classification. Except as modified in sections 1910.322, .324, .326, and .328 all other applicable rules contained in this subpart shall apply to electrical apparatus and wiring installed in hazardous locations.

Equipment and associated wiring approved as intrinsically safe may be installed in any hazardous location for which it is approved, and the provisions of sections 1910.322, .324, .326, and .328 and Articles 504–517 of the National Electrical Code NFPA 70–1968 (ANSI C–1–1968) need not apply to such installation. Intrinsically safe equipment and wiring are incapable of releasing sufficient electrical energy under normal or abnormal conditions to cause ignition of a specific hazardous atmospheric mixture. Abnormal conditions will include accidental damage to any part of the equipment or wiring, insulation or other failure of electrical components, application of overvoltage, adjustment and maintenance operations, and other similar conditions.

(3) All conduit referred to in this subpart shall be threaded with standard conduit cutting die which provides three-quarter-inch taper per foot. Such conduit shall be made up wrench tight to minimize sparking when fault current flows through the conduit system. Where it is impractical to make a threaded joint tight, a bonding jumper shall be utilizied.

(b) *Special precaution.* (1) The intent of sections 1910.322, .324, .326, and .328 is to require a form of construction of equipment and of installation that will insure safe performance under conditions of proper use and maintenance.

(2) The characteristics of various atmospheric mixtures of hazardous gases, vapors, and dusts depend on the specific hazardous material involved. It is necessary therefore that equipment be approved not only for the class of location but also for the specific gas, vapor, or dust that will be present.

(3) For purposes of testing and approval, various atmospheric mixtures have been grouped on the basis of their hazardous characteristics, and facilities have been made available for testing and approval of equipment for use in the following atmospheric groups:

Group A, Atmospheres containing acetylene;

Group B, Atmospheres containing hydrogen, or gases or vapors of equivalent hazard such as manufactured gas;

Group C, Atmospheres containing ethyl ether vapors, ethylene, or cyclopropane;

Group D, Atmospheres containing gasoline, hexane, naptha, benzine, butane, propane, alcohol, acetone, benzol, lacquer solvent vapors, or natural gases;

Group E, Atmospheres containing metal dust, including aluminum magnesium, and their commercial alloys, and other metals of similarly hazardous characteristics.

Group F, Atmospheres containing carbon black, coal, or coke dust;

Group G, Atmospheres containing flour, starch, or grain dusts.

(c) *Class 1 locations.* Class I locations are those in which flammable gases or vapors are or may be present in the air in quantities sufficient to produce explosive or ignitible mixtures. Class 1 locations shall include:

(1) *Class 1, Division 1.* Locations in which hazardous concentrations of flammable gases or vapors exist continuously, intermittently, or periodically under normal operating conditions; in which hazardous concentrations of such gases or vapors may exist frequently because of repair or maintenance operations or because of leakage; or in which breakdown or faulty operations of equipment or processes which might release hazardous concentrations of flammable gases or vapors, might also cause simultaneous failure of electrical equipment.

(2) *Class 1, Division 2.* (i) Locations in which volatile flammable liquids or flammable gases are handled, processed or used, but in which the hazardous liquids, vapors, or gases will normally be confined within closed containers or closed systems from which they can escape only in case of accidental rupture or breakdown of such containers or systems or in case of abnormal operation of equipment; in which hazardous concentrations of gases or vapors are normally prevented by positive mechanical ventilation, but which might become hazardous through failure or abnormal operation of the ventilating equipment; or which are adjacent to Class 1, Division 1 locations, and to which hazardous concentrations of gases or vapors might occasionally be communicated unless such communication is prevented by adequate positive-pressure ventilation from a source of clean air, and effective safeguards against ventilation failure are provided.

(ii) Electrical conduits and their associated enclosures separated from process fluids by a single seal or barrier shall be classed as Division 2 locations if the outside of conduit and enclosures is a nonhazardous area.

(d) *Class II locations.* Class II locations are those which are hazardous because of the presence of combustible dust. Class II locations shall include:

(1) *Class II, Division 1.* Locations in which combustible dust is or may be in suspension in the air continuously, intermittently, or periodically under normal operating conditions, in quantities sufficient to produce explosive or ignitible mixtures; where mechanical failure or abnormal operation of machinery or equipment might cause such mixtures to be produced, and might also provide a source of ignition through simultaneous failure of electrical equipment, operation of protection devices, or from other causes; or in which dusts of an electrically conducting nature may be present.

(2) *Class II, Division 2.* Locations in which combustible dust will not normally be in suspension in the air, or will not be likely to be thrown into suspension by the normal operation of equipment or apparatus, in quantities sufficient to produce explosive or ignitible mixtures; but where deposits or accumulations of such dust may be sufficient to interfere with the safe dissipation of heat from electrical equipment or apparatus; or where such deposits or accumulations of dust on, in, or in the vicinity of electrical equipment might be ignited by arcs, sparks or burning material from such equipment.

(e) *Class III locations.* Class III locations are those which are hazardous because of the presence of easily ignitible fibers or flyings, but in which such fibers or flyings are not likely to be in suspension in air in quantities sufficient to produce ignitible mixtures. Class III locations shall include:

(1) *Class III, Division 1.* Locations in which easily ignitible fibers or materials producing combustible flyings are handled, manufactured or used.

(2) *Class III, Division 2.* Locations in which easily ignitible fibers are stored or handled (except in process of manufacture).

§ 1910.323 [Reserved]

§ 1910.324 **Class I installations—hazardous locations.**

(a) *General.* The general rules of this subpart shall apply to the installation of electrical wiring and equipment in locations classified as Class I under section 1910.322(c) except as modified by this section.

(b) *Transformers and capacitors.* The installation of transformers and capacitors shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, transformers and capacitors shall conform to:

(i) Transformers and capacitors containing a liquid that will burn shall be installed only in vaults, which shall conform to sections 1910.318(c)(1) through (2) inclusive, and in addition, there shall be no door or other communicating opening between the vault and the hazardous area, ample ventilation shall be provided for the continuous removal of hazardous gases or vapor, vent openings or ducts shall lead to a safe location outside of buildings, and vent ducts and openings shall be of sufficient area to relieve explosion pressures within the vault, and all portions of vent ducts within the buildings shall be of reinforced concrete construction.

(ii) Transformers and capacitors which do not contain a liquid that will burn shall be installed in vaults conforming to the requirements of subdivision (i) of this subparagraph or be approved for Class I locations (explosion proof).

(2) *Class I Division 2.* In Class I, Division 2 locations, transformers and capacitors shall conform to 1910.318(b).

(c) *Meters, instruments and relays.* The installation of meters, instruments and relays shall conform to:

(1) *Class I, Division 1.* In Class I Division 1 location, meters, instruments and relays, including kilowatt-hour meters, instrument transformers and resistors, rectifiers, and termionic tubes, shall be provided with enclosures approved for Class I locations.

(2) *Class I, Division 2.* In Class I, Division 2 locations, meters, instruments and relays shall conform to:

(i) Switches and circuit breakers, and make and break contacts of push buttons, relays, and alarm bells or horns, shall have enclosures approved for Class I locations, unless general purpose enclosures are provided, and current interrupting contacts are immersed in oil; enclosed within a chamber hermetically sealed against the entrance of gases or vapors; or in circuits which under normal conditions do not release sufficient energy to ignite a specific hazardous atmospheric mixture.

(ii) Resistors, resistance devices, thermionic tubes, and rectifiers, which are used in or in connection with meters, instruments and relays, shall conform to subparagraph (1) of this paragraph except that enclosures may be of general purpose type when such equipment is without make and break or sliding contacts (other than as provided in subdivision (i) of this subparagraph) and when the maximum operating temperature of any exposed surface will not exceed eighty percent (80%) of the ignition temperature in degrees centigrade of the gas or vapor involved as determined by ANSI Z11.189—1966, American National Standard Method of Test for Autoignition Temperature of Liquid Petroleum Products.

(iii) Transformer windings, impedance coils, solenoids, and windings which do not incorporate sliding or make and break contacts shall be provided with enclosures which may be of the general purpose type.

(iv) Where an assembly is made up of components for which general purpose enclosures are acceptable under subdivisions (i), (ii), and (iii) of this subparagraph, a single general purpose enclosure is acceptable for the assembly. Where such an assembly includes any of the equipment described in subdivision (ii) of this subparagraph, the maximum obtainable surface temperature of any component of the assembly shall be clearly and permanently indicated on the outside of the enclosure.

(v) Where general purpose enclosures are permitted under subdivisions (i), (ii), (iii), and (iv) of this subparagraph, fuses for overcurrent protection of the instrument circuits may be mounted in general purpose enclosures provided such fuses do not exceed 3 ampere rating at 120 volts and provided each such fuse is preceded by a switch conforming to subdivision (i) of this subparagraph.

(vi) To facilitate replacements, process control instruments may be connected through flexible cord, attachment plug, and receptacle, provided;

(*a*) A switch conforming to subdivision (i) of this subparagraph is provided so that the plug is not depended on to interrupt current, and

(*b*) Current does not exceed 3 amperes at 120 volts, and

(*c*) Power supply cord does not exceed 3 feet, is of a type approved for extra hard usage or for hard usage if protected by location and is supplied through a plug and receptacle of the locking and grounding type, and

(*d*) Only necessary receptacles are provided, and

(*e*) The receptable carries a label warning against unplugging under load.

(d) *Wiring methods.* Wiring methods shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, threaded rigid metal conduit or Type MI cable with termination fittings approved for the location shall be the wiring method employed. All boxes, fittings, and joints shall be threaded for connection to conduit or cable terminations, and shall be explosion proof. Threaded joints shall be made up with at least five threads fully engaged. Type MI cable shall be installed and supported in a manner to avoid tensile stress at the termination fittings. Where necessary to employ flexible connections, as at motor terminals, flexible fittings approved for Class I locations (explosion proof) shall be used.

(2) *Class I, Division 2.* In Class I, Division 2 locations, threaded rigid metal conduit or Types MI, MC, or ALS cable with approved termination fittings shall be the wiring method employed. Type MI, MC, or ALS cable shall be installed in a manner to avoid tensile stress at the termination fittings. Boxes, fittings, and joints need not be explosion proof except as required by paragraph (e)(2)(i), and (ii) of this section. Where provision must be made for limited flexibility, as at motor terminals, flexible metal fittings, flexible metal conduit with approved fittings, or flexible cord approved for extra hard usage and provided with approved bushed fittings shall be used. An additional conductor for grounding shall be included in the flexible cord unless other acceptable means of grounding are provided.

(e) *Sealing and drainage.* Seals are provided in conduit and cable systems to prevent the passage of gases, vapors or flames from one portion of the electrical installation to another through the conduit. Such communication through Type MI cable is inherently prevented by construction of the cable, but sealing compound is used in cable termination fittings to exclude moisture and other fluids from the cable insulation, and shall be of a type approved for the conditions of use. Seals in conduit and cable systems shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, seals shall be located as provided in this subparagraph.

(i) In each conduit run entering an enclosure for switches, circuit breakers, fuses, relays, resistors, or other apparatus which may produce arcs, sparks or high temperatures. Seals shall be placed as close as practicable and in no case more than 18 inches from such enclosures. There shall be no junction box or similar enclosure in the conduit run between the sealing fitting and the apparatus enclosure.

(ii) In each conduit run of 2-inch size or larger entering the enclosure or fitting housing terminals, splices or taps, and within 18 inches of such enclosure or fitting.

(iii) In each conduit run leaving the Class I, Division 1 hazardous area. The sealing fitting may be located on either side of the boundary of such hazardous area, but shall be so designed and installed that any gases or vapors which may enter the conduit system, within the Division 1 hazardous area, will not enter or be communicated to the conduit beyond the seal. There shall be no union, coupling, box, or fitting in the conduit between the sealing fitting and the point at which the conduit leaves the Division 1 hazardous area.

(2) *Class I, Division 2.* In Class I, Division 2 locations, seals shall be located as provided in this subparagraph.

(i) For connections to enclosures which are required to be approved for Class I locations, seals shall be provided in conformance to subparagraphs (1)

(i) and (ii) of this paragraph. All portions of the conduit run or nipple between the seal and such enclosure shall conform to paragraph (d)(1) of this section.

(ii) In each conduit run passing from the Class I, Division 2 hazardous area into a nonhazardous area. The sealing fitting may be located on either side of the boundary of such hazardous area, but shall be so designed and installed that any gases or vapors which may enter the conduit system, within the Division 2 hazardous area, will not enter or be communicated to the conduit beyond the seal. Rigid conduit shall be used between the seal fitting and the point at which the conduit leaves the hazardous area, and a threaded connection shall be used at the sealing fitting. There shall be no union, coupling, box or fitting in the conduit between the sealing fitting and the point at which the conduit leaves the hazardous area.

(3) *Class I, Divisions 1 and 2.* Where seals are required, they shall conform to the requirements contained in this subparagraph.

(i) Enclosures for connections or for equipment shall be provided with approved integral means for sealing, or sealing fittings approved for Class I locations shall be used. Sealing fittings shall be accessible.

(ii) Sealing compound shall be approved for the purpose, shall not be affected by the surrounding atmosphere or liquids, and shall not have a melting point of less than 93° C. (200° F.).

(iii) In the completed seal, the minimum thickness of the sealing compound shall be not less than the trade size of the conduit, and in no case less than five-eighths inch.

(iv) Splices and taps shall not be made in fittings intended only for sealing with compound, nor shall other fittings in which splices or taps are made be filled with compound.

(v) In an assembly where equipment which may produce arcs, sparks or high temperatures is located in a compartment separate from the compartment containing splices or taps, and an integral seal is provided where conductors pass from one compartment to the other, the entire assembly shall be approved for Class I locations. Seals in conduit connections to the compartment containing splices or taps shall be provided in Class I, Division 1 locations where required by subparagraph (1)(ii) of this paragraph.

(4) *Drainage.*

(i) Where there is probability that liquid or other condensed vapor may be trapped within enclosures for control equipment or at any point in the raceway system, means shall be provided to prevent accumulation or to permit periodic draining of such liquid or condensed vapor.

(ii) Where there is probability that liquid or condensed vapor may accumulate within motors or generators, joints, and conduit systems shall be arranged to minimize entrance of liquid. If means to prevent accumulation or to permit periodic draining are judged necessary, such means shall be provided at the time of manufacture, and shall be deemed an integral part of the machine.

(iii) Canned pumps, process connections for flow, pressure or analysis measurements, etc., frequently depend upon a single seal diagram or tube to prevent process fluids from entering the electrical conduit system. An additional approved seal or barrier shall be provided with an adequate drain between the seals in such a manner that leaks would be obvious.

(f) *Switches, circuit breakers, motor controllers, and fuses.* Switches, circuit breakers, motor controllers, and fuses shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, switches, circuit breakers, motor controllers, and fuses, including push buttons, relays and similar devices, shall be provided with enclosures, and the enclosure in each case together with the enclosed apparatus shall be approved as a complete assembly for use in Class I locations.

(2) *Class I, Division 2.* Switches, circuit breakers, motor controllers and fuses in Class I, Division 2 locations shall conform to:

(i) Circuit breakers, motor controllers, and switches intended to interrupt current in the normal performance of the function for which they are installed shall be provided with enclosures approved for Class I locations, unless general purpose enclosures are provided and the interruption of current occurs within a chamber hermetically sealed against the entrance of gases and vapor, or the current interrupting contacts are oil-immersed and the device is approved for locations of this class and division.

(ii) Enclosures for disconnecting and isolating switches without fuses and which are not intended to interrupt current may be of general purpose type.

(iii) For the protection of motors, appliances and lamps, except as provided in subdivision (iv) of this subparagraph, standard plug or cartridge fuses may be used provided they are placed within enclosures approved for the purpose and for the location, or fuses of a type in which the operating element is immersed in oil or other approved liquid, or is enclosed within a chamber hermetically sealed against the entrance of gases and vapors may be used provided they are approved for the purpose and are placed within general purpose enclosures.

(iv) When not more than 10 sets of approved enclosed fuses, or not more than 10 circuit breakers which are not intended to be used as switches for the interruption of current, are installed for branch or feeder circuit protection in any one room, area or section of this class and division, the enclosures for such fuses or circuit breakers may be of general purpose type, provided the fuses or circuit breakers are for the protection of circuits or feeders supplying lamps in fixed positions only.

(g) *Control transformers and resistors.* Transformers, impedance coils and resistors used as or in conjunction with control equipment for motors, generators and appliances shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, transformers, impedance coils and resistors, together with any switching mechanism associated with them, shall be provided with enclosures approved for Class I locations (explosion proof).

(2) *Class I, Division 2.* In Class I, Division 2 locations, control transformers and resistors shall conform to:

(i) Switching mechanisms used in conjunction with transformers, impedance coils and resistors shall conform to paragraph (f)(2) of this section.

(ii) Enclosures for windings of transformers, solenoids or impedance coils may be of the general purpose types.

(iii) Resistors shall be provided with enclosures and the assembly shall be approved for Class I locations, unless resistance is nonvariable and maximum operating temperature, in degrees centigrade, will not exceed eighty percent (80%) of the ignition temperature of the gas or vapor involved as determined by ANSI Z11.89—1966, American National Standard Method of Test for Autoignition Temperature of Liquid Petroleum Products.

(h) *Motors and generators.* Motors and generators shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, motors, generators and other rotating electrical machinery shall be approved for Class I locations (explosion proof); or of the totally enclosed type supplied with positive-pressure ventilation from a source of clean air with discharge to a safe area, so arranged to prevent energizing of the machine until ventilation has been established and the enclosure has been purged with at least ten (10) volumes of air, and also arranged to automatically deenergize the equipment when the air supply fails; or of the totally enclosed inert-gas-filled type supplied with a suitable reliable source of inert gas for pressuring the enclosure, with devices provided to insure a positive pressure in the enclosure and arranged to automatically deenergize the equipment when the gas supply fails. Totally enclosed motors, other than those approved for Class I locations, shall have no external surface with an operating temperature in degrees Centigrade in excess of eighty percent (80%) of the ignition temperature of the gas or vapor involved, as determined by ANSI Z11.89—1966, American National Standard Method of Test for Autoignition Temperature of Liquid Petroleum Products. Appropriate devices shall also be provided to detect any increase in temperature of the motor beyond design limits and automatically deenergize the equipment. Auxiliary equipment shall be of a type approved for the location in which it is installed.

(2) *Class I, Division 2.* In Class I, Division 2 locations, motors, generators, and other rotating electrical machinery in which are employed sliding contacts, centrifugal or other types of switching mechanism (including motor overcurrent devices), or integral resistance devices, either while starting or while

running, shall be approved for Class I locations (explosion proof), unless such sliding contacts, switching mechanisms and resistance devices are provided with enclosures approved for such locations.

(i) *Lighting fixtures.* Lamps shall be installed in fixtures which shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, lighting fixtures shall conform to the requirements of this subparagraph.

(i) Each fixture shall be approved as a complete assembly for locations of this class, and shall be clearly marked to indicate the maximum wattage of lamps for which it is approved. Fixtures intended for portable use shall be specifically approved as a complete assembly for that use.

(ii) Each fixture shall be protected against physical damage by a suitable guard or by location.

(iii) Pendant fixtures shall be suspended by and supplied through threaded rigid conduit stems and threaded joints shall be provided with setscrews or other effective means to prevent loosening. For stems longer than 12 inches, permanent and effective bracing against laterial displacement shall be provided at a level not more than 12 inches above the lower end of the stem, or flexibility in the form of a fitting or flexible connector approved for the purpose and for the location shall be provided not more than 12 inches from the point of attachment to the supporting box or fitting.

(iv) Boxes, box assemblies or fittings used for the support of lighting fixtures shall be approved for the purpose and for Class I locations.

(2) *Class I, Division 2.* In Class I, Division 2 locations, lighting fixtures shall conform to the requirements of this subparagraph.

(i) Portable lamps shall conform to subparagraph (1)(i) of this paragraph.

(ii) Lighting fixtures for fixed lighting shall be protected from physical damage by suitable guards or by location. Where there is danger that falling sparks or hot metal from lamps or fixtures might ignite localized concentrations of flammable vapors or gases, suitable enclosures or other effective protective means shall be provided. Where lamps are of a size or type which may, under normal operating conditions, reach surface temperatures exceeding eighty percent (80%) of the ignition temperature in degrees centigrade of the gas or vapor involved, as determined by ANSI Z11.89—1966, American National Standard Method of Test for Autoignition temperature of Liquid Petroleum Products, fixtures shall conform to subparagraph (1)(i) of this paragraph.

(iii) Pendant fixtures shall be suspended by threaded rigid conduit stems or by other means consistent with the requirements of this part. For rigid stems longer than 12 inches, permanent and effective bracing against lateral displacement shall be provided at a level not more than 12 inches above the lower end of the stem, or flexibility in the form of a fitting or flexible connector approved for the purpose shall be provided not more than 12 inches from the point of attachment to the supporting box or fitting.

(iv) Boxes, box assemblies, or fittings used for the support of lighting fixtures shall be approved for the purpose.

(v) Switches which are a part of an assembled fixture or of an individual lampholder shall conform to the requirements of paragraph (f)(2)(i) of this section.

(vi) Starting and control equipment for mercury-vapor and fluorescent lamps shall conform to the requirements of paragraph (g)(2) of this section.

(j) *Utilization equipment, fixed and portable.* Utilization equipment, fixed and portable, shall conform to:

(1) *Class I, Division 1.* In Class I, Division 1 locations, utilization equipment, including electrically heated and motor-driven equipment shall be approved for Class I locations.

(2) *Class I, Division 2.* In Class I, Division 2 locations, utilization equipment, fixed and portable, shall conform to the requirements of this subparagraph.

(i) Electrically heated utilization equipment shall be approved for Class I locations.

(ii) Motors of motor-driven utilization equipment shall conform to paragraph (h)(2) of this section.

(iii) Switches, circuit breakers and fuses shall conform to paragraph (f)(2) of this section.

(k) *Flexible cords, Class I, Divisions 1 and 2.* A flexible cord may be used only for connection between a portable lamp or other portable utilization equipment and the fixed portion of its supply circuit and where used shall be of a type approved for extra hard usage; contain, in addition to the conductors of the circuit, a grounding conductor; be connected to terminals or to supply conductors in a manner consistent with the requirements of this subpart; be supported by clamps or by other suitable means in such a manner that there will be no tension on the terminal connections; and suitable seals shall be provided where the flexible cord enters boxes, fittings or enclosures of explosion-proof type.

(l) *Receptacles and attachments plugs, Class I, Divisions 1 and 2.* Receptacles and attachment plugs shall be of the type providing for connection to the grounding conductor of the flexible cord, and shall be approved for Class I locations, except as provided in paragraph (c)(2)(vi) of this section.

(m) *Conductor insulation Class I, Divisions 1 and 2.* Where condensed vapors or liquids may collect on or come in contact with the insulation on conductors, such insulation shall be of a type approved for use under such conditions or the insulation shall be protected by a sheath of lead or by other approved means.

(n) *Signal, alarm, remote-control and communication systems.* Signal, alarm, remote-control and communication systems shall conform to the requirements of this subparagraph.

(1) *Class I, Division 1.* In Class I, Division 1 locations, all apparatus and equipment of signaling, alarm, remote-control and communication systems, irrespective of voltage, shall be approved for Class I locations, and all wiring shall conform to paragraphs (d)(1), (e)(1), and (e)(3) of this section.

(2) *Class I, Division 2.* In Class I, Division 2 locations, signal, alarm, remote-control and communication systems shall conform to the requirements of this subparagraph.

(i) Switches and circuit breakers, and make and break contacts of push buttons, relays, and alarm bells or horns, shall have enclosures approved for Class I locations, unless general purpose enclosures are provided and current interrupting contacts are immersed in oil; or enclosed within a chamber hermetically sealed against the entrance of gases or vapors; or in circuits which under normal conditions do not release sufficient energy to ignite a specific hazardous atmospheric mixture.

(ii) Resistors, resistance devices, thermionic tubes and rectifiers shall conform to paragraph (c)(2)(ii) of this section.

(iii) Enclosures which may be of general purpose type shall be provided for lightning protective devices and for fuses.

(iv) All wiring shall conform to paragraphs (d)(2), (e)(2), and (e)(3) of this section.

(o) *Live parts, Class I, Divisions 1 and 2.* There shall be no exposed live parts.

(p) *Grounding, Class I, Divisions 1 and 2.* Wiring and equipment shall be grounded in conformity with the requirements of this paragraph.

(1) *Exposed parts.* The exposed noncurrent-carrying metal parts of equipment such as the frames or metal exteriors of motors, fixed or portable lamps or other utilization equipment, lighting fixtures, cabinets, cases and conduit, shall be grounded as specified in § 1910.314.

(2) *Bonding.* The locknut-bushing and double-locknut types of contacts shall not be depended upon for bonding purposes, but bonding jumpers with proper fittings or other approved means shall be used. Such means of bonding shall apply to all intervening raceways, fittings, boxes, enclosures, etc. between hazardous areas and the point of grounding for service equipment. Where flexible conduit is used as permitted in paragraph (d)(2) of this section, bonding jumpers with proper fittings shall be provided around such conduit.

(3) *Lightning protection.* Each ungrounded service conductor of a wiring system in a Class I location, when supplied from an overhead line in an area where lightning disturbances are prevalent, shall be protected by an approved lightning protective device.

Lightning protective devices shall be connected to the service conductors on the supply side of the service disconnecting means, and shall be bonded to the raceway system at the service entrance.

(4) *Grounded service conductor bonded to raceway.* Wiring in a Class I location, when supplied from a grounded alternating current supply system in which a grounded conductor is a part of the service, shall have the grounded service conductor bonded to the raceway system and to the grounding conductor for the raceway system. The bonding connection to the grounded service conductor shall be made on the supply side of the service disconnecting means.

(5) *Transformer ground bonded to raceway.* Wiring in a Class I location, when supplied from a grounded alternating current supply system in which no grounded conductor is a part of the service, shall be provided with a metallic connection between the supply system ground and the raceway system at the service entrance. The metallic connection shall have an ampacity not less than one-fifth that of the service conductors, and shall in no case be smaller than No. 10 when of soft copper, or No. 12 when of medium or hard-drawn copper.

(6) *Multiple grounds.* Where, in the application of § 1910.314(b) it is necessary to abandon one or more grounding connections to avoid objectionable passage of current over the grounding conductors, the connection required in subparagraphs (4) and (5) of this paragraph shall not be abandoned while any other grounding connection remains connected to the supply system.

§ 1910.325 [Reserved]

§ 1910.326 Class II Installations—Hazardous Locations.

(a) *General.* (i) The general rules of this subpart shall apply to the installation of electrical wiring and apparatus in locations classified as Class II under section 1910.324(e) except as modified by this section.

(ii) "Dust-ignition-proof," as used in this section shall mean enclosed in a manner which will exclude ignitible amounts of dusts or amounts which might affect performance or rating and which, when installation and protection are in conformance with this subpart, will not permit arcs, sparks or heat otherwise generated or liberated inside of the enclosure, to cause ignition of exterior accumulations or atmospheric suspensions of a specified dust on or in the vicinity of the enclosure.

(iii) Equipment installed in Class II locations shall be able to function at full rating without developing surface temperatures high enough to cause excessive dehydration or gradual carbonization of any organic dust deposits that may occur. Dust which is carbonized or is excessively dry is highly susceptible to spontaneous ignition. In general, maximum surface temperatures under actual operating conditions shall not exceed 165° C. (329° F.) for equipment which is not subject to overloading, and 120° C. (248° F.) for equipment such as motors, power transformers, etc., which may be overloaded.

(b) *Transformers and capacitors.* The installation of transformers and capacitors shall conform to the requirements of this subparagraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, transformers and capacitors shall conform to the requirements of this subparagraph.

(i) Transformers and capacitors containing a liquid that will burn shall be installed only in vaults conforming to section 1910.318(c), and in addition doors or other openings communicating with the hazardous area shall have self-closing fire doors on both sides of the wall, and the doors shall be carefully fitted and provided with suitable seals (such as weather stripping) to minimize the entrance of dust into the vault; vent openings and ducts shall communicate only with the outside air; and suitable pressure-relief openings communicating with the outside air shall be provided.

(ii) Transformers and capacitors which do not contain a liquid that will burn shall be installed in vaults conforming to section 1910.318(c) or be approved as a complete assembly including terminal connections for Class II locations.

(iii) No transformer or capacitor shall be installed in a location where dust from magnesium, aluminum, aluminum bronze powders, or other metals of similarly hazardous characteristics may be present.

(2) *Class II, Division 2.* In Class II, Division 2 locations, transformers and capacitors shall conform to the requirements of this paragraph.

(i) Transformers and capacitors containing a liquid that will burn shall be installed in vaults conforming to section 1910.318(c).

(ii) Transformers containing askarel and rated in excess of 25 kv.-a shall be provided with pressure-relief vents; be provided with means for absorbing any gases generated by arcing inside the case, or the pressure-relief vents shall be connected to a chimney or flue which will carry such gases outside the building and have an air space of not less than 6 inches between the transformer cases and any adjacent combustible material.

(iii) Dry-type transformers shall be installed in vaults or shall have their windings and terminal connections enclosed in tight metal housings without ventilating or other openings; and operate at voltages not exceeding 600 volts.

(c) *Surge protection, Class II, Division 1 and 2.* (i) In geographical locations where lightning disturbances are prevalent, wiring systems in Class II locations shall, when supplied from overhead lines, be suitably protected against high-voltage surges. This protection shall include suitable lightning protective devices, interconnection of all grounds, and surge-protective capacitors. (ii) Interconnection of all grounds shall include grounds for primary and secondary lightning protective devices, secondary system grounds if any, and grounds of conduit and equipment of the interior wiring system. For ungrounded secondary systems, secondary lightning protective devices may be provided both at the service and at the point where the secondary system receives its supply, and the intervening secondary conductors may be accepted as the metallic connection between the secondary protective devices, provided grounds for the primary and secondary devices are metallically interconnected at the supply end of the secondary system and the secondary devices are grounded to the raceway system at the load end of the secondary system.

(iii) Surge protective capacitors shall be of a type especially designed for the duty, shall be connected to each ungrounded service conductor, and shall be grounded to the interior conduit system. Capacitors shall be protected by 30-ampere fuses of suitable type and voltage rating, or by automatic circuit breakers of suitable type and rating and shall be connected to the supply conductors on the supply side of the service disconnecting means.

(d) *Wiring methods.* Wiring methods shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, threaded rigid metal conduit or Type MI cable with termination fittings approved for the location shall be the wiring method employed. Type MI cable shall be installed and supported in a manner to avoid tensile stress at the termination fittings.

(i) Fittings and boxes shall be provided with threaded bosses for connection to conduit or cable terminations, shall have close fitting covers, and shall have no openings (such as holes for attachment screws) through which dust might enter, or through which sparks or burning material might escape. Fittings and boxes in which taps, joints or terminal connections are made, or which are used in locations where dusts are of an electrically conducting nature shall be dust-ignition-proof and approved for Class II locations.

(ii) Where necessary to employ flexible connections, dust-tight flexible connectors, flexible metal conduit with approved fittings, or flexible cord approved for extra-hard usage and provided with bushed fittings shall be used, except that where dusts are of an electrically conducing nature, flexible metal conduit shall not be used, and flexible cords shall be provided with dust-tight seals at both ends. An additional conductor for grounding shall be provided in the flexible cord unless other means of grounding are provided which are consistent with the requirements of this section. Where flexible connections are subject to oil or other corrosive conditions, the insulation of the conductors shall be of a type approved for the condition or shall be protected by means of a suitable sheath.

(2) *Class II, Division 2.* In Class II, Division 2 locations, rigid metal conduit, electrical metallic tubing, or Types MI, MC, or ALS cable with approved termination fittings or dust-tight wireways shall be the wiring method employed.

(i) Wireways, and fittings and boxes in which taps, joints or terminal con-

nections are made, shall be designed to minimize the entrance of dust, and shall be provided with telescoping or close fitting covers, or other effective means to prevent the escape of sparks or burning material; and shall have no openings (such as holes for attachment screws) through which, after installation, sparks or burning material might escape or through which adjacent combustible material might be ignited.

(ii) Where flexible connections are necessary the provisions of subparagraph (1)(ii) of this paragraph shall apply.

(e) *Sealing, Class II, Divisions 1 and 2.* Where a raceway provides communication between an enclosure which is required to be dust-ignition-proof and one which is not, suitable means shall be provided to prevent the entrance of dust into the dust-ignition-proof enclosure through the raceway. This means may be a permanent and effective seal; a horizontal section not less than 10 feet long in the raceway; or a vertical section of raceway not less than 5 feet long and extending downward from the dust-ignition-proof enclosures. Sealing fittings shall be accessible.

(f) *Switches, circuit breakers, motor controllers, and fuses.* Switches, circuit breakers, motor controllers, and fuses shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, switches, circuit breakers, motor controllers, and fuses shall conform to the requirements of this subparagraph.

(i) Switches, circuit breakers, motor controllers, and fuses, including push buttons, relays, and similar devices, which are intended to interrupt current in the normal performance of the function for which they are installed, or which are installed where dusts of an electrically conducting nature may be present, shall be provided with dust-ignition-proof enclosures which, together with the enclosed apparatus in each case, shall be approved as a complete assembly for Class II locations.

(ii) Disconnecting and isolating switches containing no fuses and not intended to interrupt current, and which are not installed where dusts may be of an electrically conducting nature, shall be provided with tight metal enclosures which shall be designed to minimize the entrance of dust, and which shall be equipped with telescoping or close fitting covers, or with other effective means to prevent the escape of sparks or burning material; and have no openings (such as holes for attachment screws) through which, after installation, sparks or burning material might escape, or through which exterior accumulations of dust or adjacent combustible material might be ignited.

(iii) In locations where dust from magnesium, aluminum, aluminum bronze powders, or other metals of similarly hazardous characteristics may be present, fuses, switches, motor controllers and circuit breakers shall have enclosures specifically approved for such locations.

(2) *Class II, Division 2.* In Class II, Division 2 locations, enclosures for fuses, switches, circuit breakers, and motor controllers including push buttons, relays, and similar devices, shall conform to the requirements of subparagraph (1)(ii) of this paragraph.

(g) *Control transformers and resistors.* Transformers, solenoids, impedence coils and resistors used as or in conjunction with control equipment for motors, generators and appliances shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, control transformers, solenoids, impedance coils, and resistors, and any overcurrent devices or switching mechanisms associated with them shall have dust-ignition-proof enclosures approved for Class II locations. No control transformer, impedance coil, or resistor shall be installed in a location where dust from magnesium, aluminum, aluminum bronze powders, or other metals of similarly hazardous characteristics may be present unless provided with an enclosure specifically approved for such locations.

(2) *Class II, Division 2.* In Class II, Division 2 locations, transformers, and resistors shall conform to the requirements of this subparagraph.

(i) Switching mechanisms (including overcurrent devices) associated with control transformers, solenoids, impedance coils, and resistors, shall be provided with enclosures conforming to paragraph (f)(1)(ii) of this section.

(ii) Where not located in the same enclosure with switching mechanisms, control transformers, solenoids, and impedance coils shall be provided with tight metal housings without ventilating openings.

(iii) Resistors and resistance devices shall have dust-ignition-proof enclosures approved for Class II locations, except that where the maximum normal operating temperature of the resistor will not exceed 120° C. (248° F.) nonadjustable resistors and resistors which are part of an automatically timed starting sequence may have enclosures conforming to subdivision (ii) of this subparagraph.

(h) *Motors and generators.* Motors and generators shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, motors, generators, and other rotating electrical machinery should be dust-ignition-proof or totally enclosed pipe ventilated and shall be approved for Class II locations.

(2) *Class II, Division 2.* (i) Motors, generators, and other rotating electrical machinery shall be dust-ignition-proof or totally enclosed pipe ventilated.

(ii) Exception: If accumulations of nonconducting, nonabrasive dust will be moderate, and if machines can be easily reached for routine cleaning and maintenance, the following may be installed:

(*a*) Standard open-type machines without sliding contacts, centrifugal or other types of switching mechanism (including motor overcurrent devices) or integral resistance devices.

(*b*) Standard open-type machines with such contacts, switching mechanisms or resistance devices enclosed within tight metal housings without ventilating or other openings.

(*c*) Self-cleaning textile motors of the squirrel-cage type.

(i) *Ventilating piping.* Vent pipes for motors, generators or other rotating electrical machinery, or for enclosures for electrical apparatus or equipment, shall be of metal not lighter than No. 24 USS gage, or of equally substantial noncombustible material, and shall lead directly to a source of clean air outside of buildings; be screened at the outer ends to prevent the entrance of small animals or birds; be protected against physical damage and against rusting or other corrosive influences. In addition, vent pipes shall conform to the remaining requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division locations, vent pipes, including their connections to motors or to the dust-ignition-proof enclosures for other equipment or apparatus, shall be dust-tight throughout their length. For metal pipes, seams and joints shall be riveted (or bolted) and soldered; welded; or rendered dust-tight by some other equally effective means.

(2) *Class II, Division 2.* In Class II, Division 2 locations, vent pipes and their connections shall be sufficiently tight to prevent the entrance of appreciable quantities of dust into the ventilated equipment or enclosure, and to prevent the escape of sparks, flame or burning material which might ignite dust accumulations or combustible material in the vicinity. For metal pipes, lock seams and riveted or welded joints may be used, and tight-fitting slip joints may be used where some flexibility is necessary as at connections to motors.

(j) *Utilization equipment, fixed and portable.* Utilization equipment, fixed and portable, shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, utilization equipment, including electrically heated and motor-driven equipment, shall be dust-ignition-proof approved for Class II locations. Where dust from magnesium, aluminum, aluminum bronze powders, or other metals of similarly hazardous characteristics may be present, such equipment shall be specifically approved for such locations.

(2) *Class II, Division 2.* In Class, Division 2 locations, utilization equipment, fixed and portable, shall conform to the requirements of this subparagraph.

(i) Electrically heated utilization equipment shall be dust-ignition-proof approved for Class II locations.

(ii) Motors of motor-driven utilization equipment shall conform to paragraph (h)(2) of this section.

(iii) Enclosures for switches, circuit breakers, and fuses shall conform to paragraph (f)(1)(ii) of this section.

(iv) Transformers, solenoids, impedance coils and resistors shall conform to paragraph (g)(2) of this section.

(k) *Lighting fixtures.* Lamps shall be installed in fixtures which shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, lighting fixtures for fixed and portable lighting shall conform to the requirements of this subparagraph.

(i) Each fixture shall be dust-ignition-proof and approved for Class II locations, and shall be clearly marked to indicate the maximum wattage of the lamp for which it is approved. In locations where dust from magnesium, aluminum, aluminum bronze powders, or other metals of similarly hazardous characteristics may be present, fixtures for fixed or portable lighting, and all auxiliary equipment, shall be specifically approved for such locations.

(ii) Each fixture shall be protected against physical damage by a suitable guard or by location.

(iii) Pendant fixtures shall be suspended by threaded rigid conduit stems or chains with approved fittings, or by approved flexible fixture fittings. For rigid stems longer than 12 inches, permanent and effective bracing against lateral displacement shall be provided at a level not more than 12 inches above the lower end of the stem, or flexibility in the form of a fitting or a flexible connector approved for the purpose and for the location shall be provided not more than 12 inches from the point of attachment to the supporting box or fitting. Threaded joints shall be provided with set-screws or other effective means to prevent loosening. Where wiring between an outlet box or fitting and a pendant fixture is not enclosed in conduit, flexible cord approved for hard usage shall be used, and suitable seals shall be provided where the cord enters the fixture and the outlet box or fitting. Flexible cord shall not serve as the supporting means for a fixture.

(iv) Boxes, box assemblies or fittings used for the support of lighting fixtures shall be approved for the purpose and for Class II locations.

(2) *Class II, Division 2.* In Class II, Division 2 locations, lighting fixtures shall conform to the requirements of this subparagraph.

(i) Portable lamps shall be dust-ignition-proof and approved for Class II locations. They shall be clearly marked to indicate the maximum wattage of lamps for which they are approved.

(ii) Lighting fixtures for fixed lighting, when not of a type approved for Class II locations, shall provide enclosures for lamps and lampholders which shall be designed to minimize the deposit of dust on lamps and to prevent the escape of sparks, burning material or hot metal. Each fixture shall be clearly marked to indicate the maximum wattage of lamp which may be used without exceeding a maximum exposed surface temperature of 165° C. (329° F.) under normal conditions of use.

(iii) Lighting fixtures for fixed lighting shall be protected from physical damage by suitable guards or by location.

(iv) Pendant fixtures shall be suspended by threaded rigid conduit stems or chains with approved fittings, or by approved flexible fixture fittings.

For rigid stems longer than 12 inches permanent and effective bracing against lateral displacement shall be provided at a level not more than 12 inches above the lower end of the stem, or flexibility in the form of a fitting or a flexible connector approved for the purpose shall be provided not more than 12 inches from the point of attachment to the supporting box or fitting. When wiring between an outlet box or fitting and a pendant fixture is not enclosed in conduit, flexible cord approved for hard usage shall be used. Flexible cord shall not serve as the supporting means for a fixture.

(v) Boxes, box assemblies, and fittings used for the support of lighting fixtures shall be approved for that purpose.

(vi) Starting and control equipment for mercury vapor and fluorescent lamps shall conform to the requirement of paragraph (g)(2) of this section.

(l) *Flexible cords, Class II, Divisions 1 and 2.* Flexible cords used in Class II locations shall be of a type approved for extra hard usage; contain, in addition to the conductors of the circuit, a grounding conductor; be connected to terminals or to supply conductors in an approved manner; be supported by clamps or by other suitable means in such a manner that there will be no tension on the terminal connections; and be provided with suitable seals to prevent the entrance of dust where the flexible cord enters boxes or fittings which are required to be dust-ignition-proof.

(m) *Receptacle and attachment plugs*—(1) *Class II, Division 1.* In Class II, Division 1 locations, receptacles and attachment plugs shall be of the type providing for connection of the grounding conductor of the flexible cord, and shall be dust-ignition-proof approved for Class II locations.

(2) *Class II, Division 2.* In Class II, Division 2 locations, receptacles and attachment plugs shall be of the type providing for connection to the grounding conductor of the flexible cord, and shall be so designed that connection to the supply circuit cannot be made or broken while live parts are exposed.

(n) *Signal, alarm, remote-control, and local loud-speaker intercommunication systems.* Signal, alarm, remote-control, and local loud-speaker intercommunication systems shall conform to the requirements of this paragraph.

(1) *Class II, Division 1.* In Class II, Division 1 locations, signal, alarm, remote-control, and local loud-speaker intercommunication systems shall conforms to the requirements of this subparagraph.

(i) Where accidental damage or breakdown of insulation might cause arcs, sparks, or high temperatures, rigid metal conduit, electrical metallic tubing, or Type MI cable with approved termination fittings shall be the wiring method employed. For conduit or electrical metallic tubing, the number of conductors shall be limited only by the requirement that the cross sectional area of all conductors shall not exceed 40 percent of the area of the raceway. Where limited flexibility is desirable or where exposure to physical damage is not severe, flexible cord approved for extra hard usage may be used.

(ii) Switches, circuit breakers, relays, contactors, and fuses which may interrupt other than voice currents, and current-breaking contacts for bells, horns, howlers, sirens and other devices in which sparks or arcs may be produced, shall be provided with enclosures approved for the location, unless current-breaking contacts are immersed in oil, or unless the interruption of current occurs within a chamber sealed against the entrance of dust, in which case enclosures may be of general purpose type.

(iii) Resistors, transformers, and choke coils which may carry other than voice currents, and rectifiers, thermionic tubes, and other heat generating equipment or apparatus shall be provided with dust-ignition-proof enclosures approved for Class II locations.

(iv) Motors, generators and other rotating electrical machinery shall conform to paragraph (h)(1) of this section.

(v) Where dusts are of an electrically conducting nature, all wiring and equipment shall be approved for Class II locations.

(vi) Where dust from magnesium, aluminum, aluminum bronze powders, or other metals of similarly hazardous characteristics may be present, all apparatus and equipment shall be specifically approved for such conditions.

(2) *Class II, Division 2.* In Class II, Division 2 locations, signal, alarm, remote-control and local loud-speaker intercommunication systems shall conform to the requirements of this subparagraph.

(i) Enclosures shall conform to subparagraph (1)(ii) of this paragraph or contacts shall have tight metal enclosures designed to minimize the entrance of dust, and shall have telescoping or tight fitting covers and no openings through which, after installation, sparks or burning material might escape.

(ii) The windings and terminal connections of transformers and choke coils shall be provided with tight metal enclosures without ventilating openings.

(iii) Resistors, resistance devices, thermionic tubes, and rectifiers shall conform to subparagraph (1)(iii) of this paragraph, except that enclosures for thermionic tubes, nonadjustable resistors or rectifiers for which maximum operating temperature will not exceed 120° C. (248° F.) may be of general purpose type.

(iv) Motors, generators, and other rotating electrical machinery shall conform to paragraph (h)(2) of this section.

(o) *Live parts, Class II, Divisions 1 and 2.* Wiring and equipment shall be grounded in conformity with this paragraph.

(1) *Exposed parts.* The exposed non-current-carrying metal parts of equipment such as the frames or metal exteriors of motors, fixed or portable lamps or other utilization equipment, lighting fixtures, cabinets, cases, and conduit, shall be grounded as specified in section 1910.314.

(2) *Bonding.* The locknut-bushing and double-locknut types of contact shall not be depended upon for bonding purposes, but bonding jumpers with fittings, or bonding locknuts, gaskets, rounding

wedge lugs, and adapters approved by Underwriters Laboratories, Inc., shall be used. Such means of bonding shall apply to all intervening raceways, fittings, boxes, enclosures, etc., between hazardous areas and the point of grounding for service equipment. Where flexible conduit is used as permitted in paragraph (d) of this section, bonding jumpers with proper fittings shall be provided around such conduit.

(3) *Lightning protection.* Each ungrounded service conductor of a wiring system in a Class II location, when supplied from an ungrounded overhead electrical supply system in an area where lightning disturbances are prevalent, shall be protected by an approved lightning protective device. Lightning protective devices shall be connected to the service conductors on the supply side of the service disconnecting means, and shall be bonded to the raceway system at the service entrance.

(4) *Grounded service conductor bonded to raceway.* Wiring in a Class II location, when supplied from a grounded alternating-current supply system in which a grounded conductor is a part of the service, shall have the grounded service conductor bonded to the raceway system and to the grounding conductor for the raceway system. The bonding connection to the grounded service conductor shall be made on the supply side of the service disconnecting means.

(5) *Transformer ground bonded to raceway.* Wiring in a Class II location, where supplied from a grounded alternating-current supply system in which no grounded conductor is a part of the service, shall be provided with a metallic connection between the supply system ground and the raceway system at the service entrance. The metallic connection shall have an ampacity not less than one-fifth that of the service conductors, and shall in no case be smaller than No. 10 when of soft copper, or No. 12 when of medium or hard-drawn copper .

(6) *Multiple grounds.* Where, in the application of section 1910.314(b), it is necessary to abandon one or more grounding connections to avoid objectionable passage of current over the grounding conductors, the connection required in subparagraphs (4) and (5) of this paragraph shall not be abandoned while any other grounding connection remains connected to the supply system.

§ 1910.327 [Reserved]

§ 1910.328 Class III Installations—Hazardous Locations.

(a) *General.* (i) The general provisions of this subpart shall apply to the installation of electrical wiring and apparatus in locations classified as Class III under section 1910.322(e) except as modified by this section.

(ii) Equipment installed in Class III location shall be able to function at full rating without developing surface temperatures high enough to cause excessive dehydration or gradual carbonization of accumulated fibers or flyings. Organic material which is carbonized or is excessively dry is highly susceptible to spontaneous ignition. In general, maximum surface temperatures under operating conditions shall not exceed 165°C. (329° F.) for equipment which is not subject to overloading, and 120° C. (248° F.) for equipment such as motors, power transformers, etc., which may be overloaded.

(b) *Transformers and capacitors, Class III, Divisions 1 and 2.* Transformers and capacitors shall conform to section 1910.326(b)(2).

(c) *Wiring methods.* Wiring methods shall conform to the requirements of this paragraph.

(1) *Class III, Division 1.* In Class III, Division 1 locations, rigid metal conduit, or approved Type MI, MC, or ALS cables shall be the wiring method employed.

(i) Fittings and boxes in which taps, joints or terminal connections are made shall be provided with telescoping or close fitting covers, or other effective means to prevent the escape of sparks or burning material; and shall have no openings (such as holes for attachment screws) through which, after installation, sparks or burning material might escape, or through which adjacent combustible material might be ignited.

(ii) Where flexible connections are necessary the provisions of § 1910.326 (d)(1)(ii) shall apply.

(2) *Class III, Division 2.* In Class III, Division 2 locations, the wiring method shall conform to subparagraph (1) of this paragraph, except that in sections, compartments or areas used solely for storage and containing no machinery, open wiring on insulators may be employed when installed to conform to Article 320, National Fire Protection Association (NFPA) No. 70—1968, National Electrical Code, Open Wiring on Insulators, but only on condition that protection as required by Section 320–12, NFPA No. 70—1968, be provided where conductors are not run in roof spaces, and well out of reach of sources of physical damage.

(d) *Switches, circuit breakers, motor controllers, and fuses, Class III, Divisions 1 and 2.* Switches, circuit breakers, motor controllers, and fuses, including push buttons, relays, and similar devices, shall be provided with tight metal enclosures designed to minimize entrance of fibers and flyings, and which shall be equipped with telescoping or close fitting covers, or with other effective means to prevent escape of sparks or burning material; and have no openings (such as holes for attachment screws) through which, after installation, sparks or burning material might escape or through which exterior accumulations of fibers or flyings or adjacent combustible material might be ignited.

(e) *Control transformers and resistors, Class III, Divisions 1 and 2.* Transformers, impedance coils and resistors used as or in conjunction with control equipment for motors, generators and appliances, shall conform to section 1910.326(g)(2), with the exception that, in Class III, Division 1 locations, when these devices are in the same enclosure with switching devices of such control equipment and are used only for starting or short time duty, the enclosure shall conform to the requirements of paragraph (d) of this section.

(f) *Motors and generators.* Motors and generators shall conform to the requirements of this paragraph.

(1) *Class III, Division 1.* In Class III, Division 1 locations, motors, generators, and other rotating electrical machinery shall be totally enclosed not ventilated, totally enclosed pipe ventilated, or totally enclosed fan cooled, except that in locations where only moderate accumulations of lint and flyings will be likely to collect on, in, or in the vicinity of a rotating electrical machine, and where such machine is readily accessible for routine cleaning and maintenance, self-cleaning textile motors of the squirrel-cage type, standard open type machines without sliding contacts, centrifugal or other types of switching mechanism (including motor overload devices), or standard open type machines having such contacts, switching mechanisms or resistance devices enclosed within tight metal housings without ventilating or other openings, may be installed.

(2) *Class III, Division 2.* In Class III, Division 2 locations, motors, generators, and other rotating electrical machinery shall be totally enclosed not ventilated, totally enclosed pipe ventilated, or totally enclosed fan cooled.

(3) *Partially enclosed type, Class III, Divisions 1 and 2.* Motors, generators or other rotating, electrical machinery of the partially enclosed or splash-proof type shall not be installed in Class III locations.

(g) *Ventilating piping, Class III, Divisions 1 and 2.* Vent pipes for motors, generators, or other rotating electrical machinery or for enclosures for electrical apparatus or equipment, shall be of metal not lighter than No. 24 USS gage, or of equally substantial noncombustible material, and shall lead directly to a source of clean air outside of buildings; be screened at the outer ends to prevent the entrance of small animals or birds; be protected against physical damage and against rusting or other corrosive influences; and vent pipes and their connections shall be sufficiently tight to prevent the entrance of appreciable quantities of fibers or flyings into the ventilated equipment or enclosure, and to prevent the escape of sparks, flame or burning material which might ignite accumulations of fibers or flyings or combustible material in the vicinity. For metal pipes, lock seams and riveted or welded joints may be used, and tight fitting slip joints may be used where some flexibility is necessary as at connections to motors.

(h) *Utilization equipment, fixed and portable, Class III, Divisions 1 and 2.* Utilization equipment shall conform to the requirements of this paragraph.

(1) *Heaters.* Electrically heated utilization equipment shall be approved for Class III locations.

(2) *Motors.* Motors of motor-driven utilization equipment shall conform to paragraph (f)(2) of this section.

(3) *Switches, circuit breakers, motor controllers, and fuses.* Switches, circuit breakers, motor controllers, and fuses

shall conform to paragraph (d) of this section.

(i) *Lighting fixtures, Class III, Divisions 1 and 2.* Lamps shall be installed in fixtures which shall conform to the requirements of this paragraph.

(1) *Fixed lighting.* Lighting fixtures for fixed lighting shall provide enclosures for lamps and lampholders which shall be designed to minimize entrance of fibers and flyings, and to prevent the escape of sparks, burning material or hot metal. Each fixture shall be clearly marked to show wattage of lamp which may be used without exceeding a maximum exposed surface temperature of 165° C. (329° F.) under operating conditions of use.

(2) *Physical damage.* A fixture which may be exposed to physical damage shall be protected by a suitable guard.

(3) *Pendant fixtures.* Pendant fixtures shall be suspended by stems of threaded rigid conduit or threaded metal tubing of equivalent thickness. For stems longer than 12 inches, permanent and effective bracing against lateral displacement shall be provided at a level not more than 12 inches above the lower end of the stem, or flexibility in the form of a fitting or a flexible connector approved for the purpose shall be provided not more than 12 inches from the point of attachment to the supporting box or fitting.

(4) *Supports.* Boxes, box assemblies, or fittings used for the support of lighting fixtures shall be of a type approved for the purpose.

(5) *Portable lamps.* Portable lamps shall be equipped with handles and protected with substantial guards, and lampholders shall be of unswitched type with no exposed metal parts and without provision for receiving attachment plugs. In all other respects, portable lamps shall conform to subparagraph (1) of this paragraph.

(j) *Flexible cords, Class III, Divisions 1 and 2.* Flexible cords shall conform to § 1910.326(l).

(k) *Receptacles and attachment plugs, Class III, Divisions 1 and 2.* Receptacles and attachment plugs shall conform to section 1910.326(m)(2).

(l) *Signal, alarm, remote-control, and local loud-speaker intercommunication systems, Class III, Divisions 1 and 2.* Signal, alarm, remote-control and local loud-speaker intercommunication systems shall conform to § 1910.326(n)(1).

(m) *Electric cranes and hoists, and similar equipment, Class III, Divisions 1 and 2.* Where installed for operation over combustible fibers or accumulations of flyings, traveling cranes, and hoists for material handling, traveling cleaners for textile machinery, and similar equipment shall conform to the requirements of this paragraph.

(1) *Power supply.* Power supply to contact conductors shall be isolated from all other systems and shall be ungrounded, and shall be equipped with an acceptable recording ground detector which will give an alarm and will automatically deenergize the contact conductors in case of a fault to ground, or with an acceptable ground fault indicator which will give a visual and audible alarm, and maintain the alarm as long as power is supplied to the system and the ground fault remains.

(2) *Contact conductors.* Contact conductors shall be so located or guarded as to be inaccessible to other than authorized persons, and shall be protected against accidental contact with foreign objects.

(3) *Current conductors.* Current collectors shall be arranged or guarded to confine normal sparking and to prevent escape of sparks or hot particles. To reduce sparking, two or more separate surfaces of contact shall be provided for each contact conductor. Reliable means shall be provided to keep contact conductors and current collectors free of accumulations of lint or flyings.

(4) *Control equipment.* Control equipment shall conform to paragraph (d) and (e) of this section.

(n) *Electric trucks.* Electric trucks shall conform to section 1910.178 of this part.

(o) *Storage-battery charging equipment, Class III, Divisions 1 and 2.* Storage-battery charging equipment shall be located in separate rooms built or lined with substantial noncombustible materials so constructed as to adequately exclude flyings or lint, and shall be well ventilated.

(p) *Live parts, Class III, Divisions 1 and 2.* There shall be no exposed live parts except as provided in paragraph (m) of this section.

(q) *Grounding, Class III, Divisions 1 and 2.* Wiring and equipment shall be grounded in conformity with section 1910.326(p).

§ 1910.329 Additional delay in effective date.

The requirements of this Subpart S shall be effective on February 15, 1972.

§ 1910.330 Sources of standards.

This Subpart S is derived from the National Electric Code, National Fire Protection Association (NFPA) 70—1968. The following table identifies the specific Articles of the National Electrical Code from which the sections in this Subpart are derived:

Sec.	*Article and title*
1910.308	90, Introduction.
1910.310	110, General.
1910.312	240, Overcurrent Protection.
1910.314	250, Grounding.
1910.315	370, Outlet, Switch, and Junction Boxes, and Fittings.
1910.316	400, Flexible Cords and Cables.
1910.318	450, Transformers and Transformer Vaults.
1910.320	422, Appliances.
1910.322	500, Hazardous Locations.
1910.324	501, Class I Installations—Hazardous Locations.
1910.326	502, Class II Installations—Hazardous Locations.
1910.328	503, Class III Installations—Hazardous Locations.

§ 1910.331 Standards organizations.

Specific standards of the following organizations have been referenced in this subpart. Copies of the referenced materials may be obtained from the issuing organizations.

American National Standards Institute, 1430 Broadway, New York, NY 10018.

National Fire Protection Association. 60 Batterymarch Street, Boston, MA 02110.

[FR Doc.71-6792 Filed 5-28-71;8:45 am]

PUBLIC PAPERS OF THE PRESIDENTS OF THE UNITED STATES

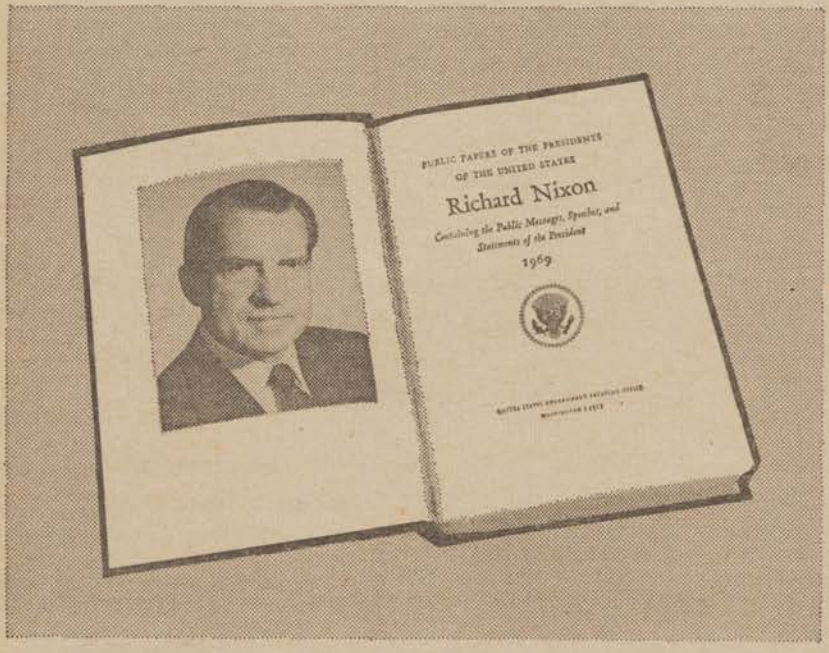

Richard Nixon — 1969

1183 Pages – Price: $14.50

CONTENTS

- Messages to the Congress
- Public speeches and letters
- The President's news conferences
- Radio and television reports to the American people
- Remarks to informal groups

PUBLISHED BY

Office of the Federal Register
National Archives and Records Service
General Services Administration

ORDER FROM

Superintendent of Documents
U.S. Government Printing Office
Washington, D.C. 20402

PRIOR VOLUMES

Volumes covering the administrations of Presidents Truman, Eisenhower, Kennedy, and Johnson are available at varying prices from the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402.