



NBS TECHNICAL NOTE **900**

U.S. DEPARTMENT OF COMMERCE / National Bureau of Standards

Deflection Performance Criteria for Floors

QC
100
U5753
No. 900
1976
c.2

NATIONAL BUREAU OF STANDARDS

The National Bureau of Standards¹ was established by an act of Congress March 3, 1901. The Bureau's overall goal is to strengthen and advance the Nation's science and technology and facilitate their effective application for public benefit. To this end, the Bureau conducts research and provides: (1) a basis for the Nation's physical measurement system, (2) scientific and technological services for industry and government, (3) a technical basis for equity in trade, and (4) technical services to promote public safety. The Bureau consists of the Institute for Basic Standards, the Institute for Materials Research, the Institute for Applied Technology, the Institute for Computer Sciences and Technology, and the Office for Information Programs.

THE INSTITUTE FOR BASIC STANDARDS provides the central basis within the United States of a complete and consistent system of physical measurement; coordinates that system with measurement systems of other nations; and furnishes essential services leading to accurate and uniform physical measurements throughout the Nation's scientific community, industry, and commerce. The Institute consists of the Office of Measurement Services, the Office of Radiation Measurement and the following Center and divisions:

Applied Mathematics — Electricity — Mechanics — Heat — Optical Physics — Center for Radiation Research: Nuclear Sciences; Applied Radiation — Laboratory Astrophysics² — Cryogenics² — Electromagnetics² — Time and Frequency².

THE INSTITUTE FOR MATERIALS RESEARCH conducts materials research leading to improved methods of measurement, standards, and data on the properties of well-characterized materials needed by industry, commerce, educational institutions, and Government; provides advisory and research services to other Government agencies; and develops, produces, and distributes standard reference materials. The Institute consists of the Office of Standard Reference Materials, the Office of Air and Water Measurement, and the following divisions:

Analytical Chemistry — Polymers — Metallurgy — Inorganic Materials — Reactor Radiation — Physical Chemistry.

THE INSTITUTE FOR APPLIED TECHNOLOGY provides technical services to promote the use of available technology and to facilitate technological innovation in industry and Government; cooperates with public and private organizations leading to the development of technological standards (including mandatory safety standards), codes and methods of test; and provides technical advice and services to Government agencies upon request. The Institute consists of the following divisions and Centers:

Standards Application and Analysis — Electronic Technology — Center for Consumer Product Technology: Product Systems Analysis; Product Engineering — Center for Building Technology: Structures, Materials, and Life Safety; Building Environment; Technical Evaluation and Application — Center for Fire Research: Fire Science; Fire Safety Engineering.

THE INSTITUTE FOR COMPUTER SCIENCES AND TECHNOLOGY conducts research and provides technical services designed to aid Government agencies in improving cost effectiveness in the conduct of their programs through the selection, acquisition, and effective utilization of automatic data processing equipment; and serves as the principal focus within the executive branch for the development of Federal standards for automatic data processing equipment, techniques, and computer languages. The Institute consists of the following divisions:

Computer Services — Systems and Software — Computer Systems Engineering — Information Technology.

THE OFFICE FOR INFORMATION PROGRAMS promotes optimum dissemination and accessibility of scientific information generated within NBS and other agencies of the Federal Government; promotes the development of the National Standard Reference Data System and a system of information analysis centers dealing with the broader aspects of the National Measurement System; provides appropriate services to ensure that the NBS staff has optimum accessibility to the scientific information of the world. The Office consists of the following organizational units:

Office of Standard Reference Data — Office of Information Activities — Office of Technical Publications — Library — Office of International Relations — Office of International Standards.

¹ Headquarters and Laboratories at Gaithersburg, Maryland, unless otherwise noted; mailing address Washington, D.C. 20234.

² Located at Boulder, Colorado 80302.

Deflection Performance Criteria for Floors

t, Technical note, no. 900.

R. A. Crist and J. R. Shaver

Center for Building Technology
Institute for Applied Technology
National Bureau of Standards
Washington, D. C. 20234

NATIONAL BUREAU
OF STANDARDS
LIBRARY
APR 29 1976
not CCCI
QC100
U575:
no. 900
1976
C.2

Sponsored by

Department of Housing and Urban Development
Office of Policy Development and Research
Washington, D.C. 20410



U.S. DEPARTMENT OF COMMERCE, Elliot L. Richardson, Secretary

James A. Baker, III, Under Secretary

Dr. Betsy Ancker-Johnson, Assistant Secretary for Science and Technology

U.S. NATIONAL BUREAU OF STANDARDS, Ernest Ambler, Acting Director

///

Issued April 1976

National Bureau of Standards Technical Note 900

Nat. Bur. Stand. (U.S.), Tech. Note 900, 29 pages (Apr. 1976)

CODEN: NBTNAE

U.S. GOVERNMENT PRINTING OFFICE
WASHINGTON: 1976

Table of Contents

	<u>Page</u>
Notation	iv
Abstract	v
1. Introduction	1
2. Background	1
3. Traditional Floor Performance Criteria	2
4. Development of Improved Floor Performance Criteria	3
4.1 Vibration Criteria for Floor Performance.	3
4.2 Criteria for Human Perception to Vertical Vibration	6
4.3 Derivation of Mathematical Model for Floor Deflection	6
4.4 Calibration of Human Response to Equivalent Static Deflections.	8
4.5 Floor Performance Criteria.	9
5. Future Floor Performance Criteria.	10
6. Summary.	12
7. References	14

The following symbols are used in this report:

Δ	= Deflection
L	= Span
T	= Natural period of floor system
k	= Floor system stiffness
m	= Floor system mass
T_f	= Forced vibration time
f	= frequency
ν	= Damping ratio
x	= Half-amplitude of peak-to-peak displacement
S_a, S_v, S	= Peak to peak amplitude acceleration, velocity and displacement, respectively
C_a, C_v, C_s	= Calibration constants
w	= Uniform static floor load
a	= Width of floor
E	= Elastic constant for floor
I	= Moment of inertia
P	= Static live load
d_v	= Equivalent vertical deflection
g	= Acceleration of gravity, 32.2 ft/sec^2 , 9.8 m/sec^2
$F(t)$	= Random forcing function
$G(t)$	= Deterministic floor system characteristics
$Y(t)$	= Random floor response
$D(t)$	= Random human response to vibration

Abstract

Serviceability performance criteria for floor systems are discussed in terms of their static and dynamic components. Development of traditional static stiffness criteria is given along with a review of their strengths and weaknesses. Criteria for serviceable floors are presented from a vibration viewpoint and the derivation of an improved criterion is given. A new approach for future vibration criteria is described.

words: Deflection; dynamic; floor systems; human response; performance criteria; serviceability; static; vibration.

1. Introduction

This report covers the development of performance criteria for structural floor systems with the focus being on that part of the criteria which is related to serviceability. The report is based on a portion of the research done in a broader study* (Structural Deflections [1])^{1/} at the National Bureau of Standards.

The design of floors for serviceability has been in existence for many years. A serviceable floor is one that meets the needs for which it is intended for everyday use. Seldom, if at all, does a serviceability design requirement equal a stress design requirement, i.e., a life safety requirement. Floors that are safe are not necessarily serviceable; however, floors that are serviceable generally are safe. Safety here refers to collapse and endangering human life.

Deflection criteria for the design of floors can appear in a hierarchy (figure 1) beginning with a performance statement. The examples in figure 1 converge from the generality of a performance statement to the specificity of technical engineering publications, research publications, and engineering texts and are the types of statements applicable to occupant comfort of floors. The differentiation made in the hierarchy given in figure 1 does not always appear in current practice. Performance statements occur in a specification without any other component of the hierarchy. This leaves the designer in a quandry as to what is "comfortable" or "uncomfortable". For an adequate design the entire hierarchy has to be followed through which requires more time, effort and professional skill than a mere check of deflection for an arbitrary superimposed uniform liveload, for example.

This report will show some principal examples of existing floor performance criteria, develop a new stage of floor performance criteria and then hypothesize an advanced stage of floor performance criteria. A complete state of the art and literature survey has been produced [1] in the broader study, thus no attempt will be made to survey the literature. New items will be given that have appeared after the publication of the literature survey. Even though the emphasis in this report is on floor deflections or vibrations, other horizontal framing systems such as roofs and stairways can be considered in the same category but their serviceability requirements must be carefully evaluated before they are related to floors. For instance, roofs may not be subject to the dynamic considerations of human comfort but should be required to not deflect excessively under static loading to prevent damage to partitions or ceilings below. Conversely, stairways or footbridges (especially connections between multistory structures) may be subjected to much more pronounced dynamic foot traffic than an average floor and thus dynamic design should be considered for different loadings than those used for floors.

2. Background

The performance of floor systems has been the recent concern of owners, builders, occupants and the engineer. This concern has increased as demonstrated by the recent publications on the subject which have been essentially non-existent in the past [1,2,3,4]. Rigorous design procedures, higher allowable stresses and new construction materials result in effectively more flexible floor systems than have been constructed in the past. Traditionally, floor deflection considerations have been essentially ignored or "taken care of" by the present criterion which requires that a horizontal member shall not have a deflection greater than 1/360 of the span for a prescribed live load. More flexible floor systems are being introduced in the modern structure and they frequently show a lack of serviceability because of unsatisfactory deflection performance, i.e., vibration disturbance to occupants, rattling cupboards that set on the floor, vibration of ceiling covers

* Research sponsored by the Office of Policy Development and Research, Department of Housing and Urban Development, Washington, D.C. 20410

^{1/} Numbers in brackets refer to literature references listed in Section 7 of this report.

(attached to floors), cracking, nonload bearing partition damage, etc. Some of these systems meet the present deflection criterion which indicates that the criteria is either inadequate or that it is not being applied appropriately.

The deflection problem can be broken down into its elements as is described in reference [1]. Figure 2 shows this breakdown which not only applies to the floor deflection problem but also to structural engineering problems in general; however, it will be used in this report with respect to the floor deflection problem.

Many different floor deflection criteria are possible by a thorough application of figure 2. However, the most pertinent appear to be:

The static system deflection should be controlled to limit

- 1) Human response to static deflection
- 2) Subsystem response to static deflection

The dynamic system deflection should be controlled to limit

- 1) Dynamic whole body vibration
- 2) Audible perception to motion
- 3) Dynamic visual perception to motion
- 4) Dynamic subsystem system response

Previously, the above have been encompassed in the panacea criterion of a deflection limit linearly related to the span of the floor as previously stated. It is obvious that with the introduction of the dimension of time for dynamic deflection and sensory perception simple criteria such as 1/360-of-the-span deflection limitation cannot be adequate for all cases.

Definition of dynamic and static deflections is not a simple matter. Generally speaking all deflections are dynamic, i.e., time dependent. Some approximations can be made which separate dynamic and static deflections for most practical purposes. A static load causing a static deflection is one which is slowly applied and released. Slowly refers to the duration of time for application and release of the load as compared to the natural period of the structure. If the ratio of time for load application and release to the natural period is large, the load and corresponding deflection can be considered static. Conversely, if this ratio is small, the load and corresponding deflection are dynamic and the dimension of time has to be considered. It also must be realized that in the dynamic case, inertial forces are significant and must be considered to create equilibrium. This report considers both static and dynamic floor deflection problems which are within the scope of these approximations for static and dynamic loads.

3. Traditional Floor Performance Criteria

As previously stated, criteria have to be separated into their static and dynamic components, before rationale can be applied to their derivation and use. The static and less complex problem will be considered first.

Existing serviceability criteria for structural floor systems use a static deflection limitation for both static and dynamic loads which has evolved from the experience obtained in using this type of criteria for over 150 years. These criteria are based on limiting the maximum deflection that can occur under a specified load in the floor system to insure that unpleasing asthetic conditions such as sagging, cracks, jammed doors, and undue loading of partitions does not occur. For most residential floor systems this means the maximum deflection in a joist is specified to prevent localized distortions, visible sagging and cracking. However, the most serious consequence of excessive floor deflection is the subsequent damage to other building components such as ceilings and partitions. Besides unsightly cracking in these components other effects like misalignment and malfunctioning of interior doors can occur. These deflection limitations were believed to indirectly also satisfy vibration serviceability criteria.

The historical development of these criteria have been traced by Russel [5] who credits the first recorded mention of such a limitation to Thomas Tredgold, an English civil engineer who suggested a maximum deflection of $L/480$ to prevent cracking in plastered ceilings where L is the span length of the floor. He also recognized the importance of stiffness in order to allow walking on a floor without vibrating objects in the room.

Subsequent development or improvement of the deflection limitation has been based on the experience gained from beams designed by such criteria. A later publication by Kidder [6] indicated that $1/360$ of the span was not too much deflection to permit in floor joists since a floor is seldom subjected to its full load and then only for a short period of time. This recommended change recognized that serviceability specifications should be related to the service loads. The 1931 edition of Kidder-Parker's Architects and Builders Handbook indicates that a stiffness factor of a beam (Δ/L) based on experience should be $1/360$ when the beam supported a plastered ceiling. It also suggests that because the deflection due to dead loads except for the plaster, has already taken place, the appropriate design standard should state: the deflection due to live load must not exceed $1/360$ of the span in inches. In this statement of the criterion, the limitation is related to a specific situation, support of plastered ceilings, in order to prevent damage. As can be seen from this brief historical development of serviceability requirements, the development of the criterion has been toward one which prevents damage to structural components from static service loads. Implicitly it was believed from the onset of this criteria that this would also satisfy the needs of occupants for dynamic service loads on floor systems.

Present deflection limitations may take one of two forms, either a restriction on the maximum span to depth of beam ratio or maximum deflection under a given static loading condition. This type of criteria appears in wood, metal and concrete specifications. However, present deflection requirements even though applied to both static and dynamic loads may be sufficient for the static condition but not the dynamic one.

As pointed out by Clarke, Neville and Houghton-Evans [7] there is considerable confusion as to what the static deflection limit should be for a particular case. This is because while there is a good deal of literature on how to predict deflection, statements on allowable values are usually limited to a brief note that limits such as $1/360$ are "customary" and have "worked well in the past". Also, there is little information available on which to judge the rationality of such rules.

It appears that the most appropriate criteria for static loads are still a restriction on the deflection under a given load or a restriction on the span to depth ratio. However, the shortcoming of current criteria is that the designer is not given a range of choices of deflection or span/depth allowable for a given situation. That is, he is given no guidance on what type of design will result, cracking but not readily visible, deflection that cause no distress to hung ceilings, but may damage partitions below or above, etc. The question also arises as who should determine deflection/span/depth ratios desirable for a given structure. This probably should be done on the level of the owner where he decides to tolerate certain deflections which give him an assigned risk of distress. The lower the risk, the higher the cost of the structure and vice versa. This approach has been proposed for lateral deflection requirements in tall structures subjected to wind loads [8].

Much more research would have to be completed before a quantification of static deflection risk can be made. Most risk assignments will have to be made on "good judgement" with the obvious trend of less deflection allowed corresponding to a decreased risk of an unserviceable floor system.

4. Improved Floor Performance Criteria

4.1 Vibration Criteria for Floor Performance

With the increased use of high strength materials, larger spans and generally more flexible construction, it has become apparent that the simple live load deflection or span to depth ratio limitations are not always sufficient to prevent annoying floor vibrations. As a result, modern standards require that due consideration be given to the design of floor sys-

tems for vibration. Typically statements are often like the one found in the Specification for the Design, Fabrication and Erection of Structural Steel, AISC [9], which states,

"Beams and girders supporting large open floor areas free of partitions or other sources of damping, where transient vibrations due to pedestrian traffic might not be acceptable, shall be designed with due regard for vibration."

The Guide Criteria for the Evaluation of Operation BREAKTHROUGH Housing Systems [10] goes further by recommending that,

"transient vibrations induced by human activity should decay to 0.2 of their initial displacement-amplitude within a time not to exceed 1/2 second."

Also, steady-state vibration is to be isolated or, where this is not possible, a human perception curve (deflection amplitude versus frequency), based on the Lenzen modified curves [11] of Reiher and Meister [12], should be satisfied. However it was recognized in the BREAKTHROUGH Guide Criteria that this criterion was tentative since further research was needed.

The International Organization for Standardization recently published a standard, Guide for the Evaluation of Human Exposure to Whole-Body Vibration, ISO 2631 [13]. This guide is written with a general approach for application to many vibratory environments. It is applicable to vibrations transmitted to the body as a whole through the supporting surface; such as the feet of a standing human or the buttocks of a seated human, and covers a frequency range of 1 to 80 Hz for steady state, periodic vibration, random vibration with a distributed frequency spectrum and continuous shock excitation when the energy is contained within the 1 to 80 Hz range. All allowable vibrations are given in terms of direction of transmission, frequency and rms (root-mean-square) acceleration with regard to satisfying the three general criteria of preserving comfort, working efficiency, and safety or health.

As can be seen from the brief discussion of the three standards, each is lacking with regard to consideration of all the vibration components which are necessary for a serviceable vibration design. The ISO Guide contains all of the essential components; however, much of it must be qualified through further research as there are insufficient data for all areas to be covered in floor design for vibration.

Consideration of dynamic floor deflections is a much more complex problem than the static case. In considering floor vibration criteria, the following items are to be considered:

1. Transient vibration
2. Steady-state vibration
3. Damping
4. Resonance
5. Type of occupancy
6. Type of structure
7. Structure location

Transient forcing functions are the most difficult to define in the floor vibration problem; yet are the most prevalent loads to occur. Transient vibration generally takes the form of non-stationary random vibration as classically defined in engineering mechanics. This is what makes it difficult to treat them as discrete and singly definable events. It is the consideration of this random nature that leads to the future criteria covered later in this report. However, for the development presented here transient forcing functions will be approximated as discrete events. Transient vibration has to be defined in terms of response of the structure. It has been observed [11] that if a floor has a response of 5 to 10 cycles then the initial response is the most perceptible and the vibration thereafter is not as perceptible. If this response is due to a single discrete event such as a single footfall, then multiple discrete events would appear as shown in figure 3, where T is the fundamental or lowest natural period of the structural system.

$$T = 2\pi\sqrt{k/m} \quad k = \text{floor system stiffness} \quad (4.1)$$
$$m = \text{floor system mass}$$

Assuming that the human response is transient in nature (from Lenzen's observations) then at a minimum (where two footfalls are adjacent), the transients considered as footfalls would occur at intervals

$$T_f + 10T \quad 0 < T_f < 2T \quad (4.2)$$

where T_f represents the forced vibration phase of the footfall and $10T$ represents the duration of the free vibration phase. The primary assumption here is that the transient vibration is represented by the chain of damped responses as shown in figure 3 with the time characteristics given. Damping has to be defined with this approach or the transient chain could become effectively steady state if damping were too small. As previously stated, the assumption will be made that if a vibration damps out within 5 to 10 cycles the initial peak is responded to by the human and if greater than 10 cycles response is similar to that of a steady-state vibration.

"Damping out" is a vague area with respect to human response data, thus it will be defined here for the purposes of this development. Damping for this case will be assumed to be viscous and expressed in the form of the critical damping ratio and is given by

$$\frac{x_n}{x_0} = e^{-2\pi nv/(1-v^2)^{1/2}}$$

or for $v \ll 1$

$$\frac{x_n}{x_0} = e^{-2\pi nv} \quad (4.3)$$

where

x = displacement amplitude

$n=0,1,2,\dots$ = refer to successive deflection peaks increasing with time

v = fraction at critical damping

The displacement magnitude of equation 4.3 is applicable only to the free vibration portion of the response and not to the forced vibration part, thus any determination of damping has to be from the free part of the vibration. An estimate has to be made of the duration of the forcing function, say the footfall. A footfall [15] time history (figure 4) varies in duration from 50 to 100 msec (milliseconds). Most floors have a lowest natural frequency varying

$$3 < f_1 < 35 \text{ Hz} [14, 16, 17]$$

or periods varying $30 < T_1 < 300$ msec. It appears reasonable to assume for this development that the forcing function will not be acting on the floor after the first cycle of response. Thus, response after the first cycle will be the free portion of vibration. From the observation that the human responds only to the initial pulse of a transient if it damps out within 5 to 10 cycles, an assumption is made that "damping out" will be approximated by the tenth cycle damping to 25 percent of that of the second cycle, where the first cycle of free vibration is the second cycle of response. In terms of damping this means in equation 4.3

$$\frac{x_9}{x_1} = 0.25$$

substituting into equation 4.3

$$0.25 = e^{-2\pi nv}$$

and solving for the fraction of critical damping

$$v = 0.0276$$

or 2.76% of critical damping.

Residential floors with partitions, furniture and carpeting have been observed to have critical damping ratio's varying $7 < \nu < 13$ percent [16] whereas commercial building floors have been observed to have damping vary $1.9 < \nu < 4.9$ percent [14]. This shows that damping is generally less than 10% and equation 4.3 for damping is within less than 1% error.

With the rationale that transient vibration is a chain of damped discrete responses, an equivalent static floor deflection limitation as a function of frequency will be developed. An empirical static deflection amplitude will be used as a measure of the dynamic component of motion for a person walking on a floor. The deflection limit to be developed is based on the concept that human response is proportional to the velocity of vibration and that residential wood-joist floors currently in service meet a deflection limit of 1/360 of the span for a uniformly distributed live load of 40 psf (1.9 kN/m^2), are acceptable with respect to comfort. As the development progresses the qualifications of these assumptions will be made.

4.2 Criteria for Human Perception to Vertical Vibrations

It has been shown by previous researchers [1,2,12,13,14] that human response to vertical vibration can be expressed in terms of acceleration, velocity or displacement as follows:

$$S_a = C_a f \quad \dots \quad (4.4a)$$

$$S_v = C_v \quad \dots \quad (4.4b) \quad (4.4)$$

$$S = C_s \frac{1}{f} \quad \dots \quad (4.4c)$$

Equations 4.4 represents a given level of human sensitivity to vibration varying from threshold to possible physical damage. This simplified representation of human response is not applicable to an unlimited frequency bandwidth. It has been shown that equations 4.4 are applicable to frequencies above 8 Hz and below 100 Hz [13]. However, for the observed lowest natural frequency of floors currently in service, it suffices for this development to use the approximations to human response represented by equations 4.4. Other references claim that equations 4.4 apply to frequency ranges from 1 to 80 Hz which still bounds almost all floors that are usually encountered in practice. It should be noted that equations 4.4 represent constant velocity human response criteria. Equations 4.4 will be used subsequently to relate human response to known floor characteristics.

4.3 Derivation of Mathematical Model for Floor Deflection

Two models will be used to develop an expression for equivalent static floor deflection: a uniformly loaded plate and a line loaded plate. The deflection at the center line of the span of an elastic plate with two opposite edges simply supported (figure 5a) is approximated by

$$\Delta = \frac{5 w a L^4}{384 EI} \quad (4.5)$$

where w is expressed in force per unit area and a is the width of the plate parallel to the supported edges. The uniformly loaded plate (equation 4.5) represents the current model used in determining allowable floor deflections, i.e., the deflection shall not exceed a given amount generally based as a fraction of the span when it is subjected to a uniformly distributed live load.

The deflection at the centerline of the span of a line loaded plate with two opposite edges simply supported (figure 5b) is approximated by

$$\Delta = \frac{PL^3}{48EI} \quad (4.6)$$

where P is distributed along a line at the center of the span over the width of the plate, a . The line load model is introduced for the purpose of simulating static application of a

human at a position in the floor that causes maximum deflection. It is not likely that a human would represent a point load but rather a line load as presented in the model. A distribution length of the line load will be assumed to be the width of the floor activated by the human.

These two models (figure 5) will be combined to formulate a calibration equation for use in relating human response to static floor deflection. Solving equation 4.5 for EI results in

$$EI = \frac{5 waL^4}{384 \Delta} \quad (4.7)$$

From equation 4.7, EI is calculated for a uniformly loaded plate with two opposite edges simply supported with a center line deflection that is equal to 1/360 of the span, i.e.,

$$\Delta = \frac{L}{360}$$

then

$$\frac{\Delta}{L} = \frac{1}{360} \quad (4.8)$$

Substituting equation 4.8 into equation 4.7 results in

$$EI = A waL^3 \quad (4.9)$$

where

$$A = \frac{5 \times 360}{384}$$

Let the line loaded plate (equation 4.6) have the same EI as the uniformly loaded plate in which the center line deflection is equal to 1/360. Substituting equation 4.9 into equation 4.6 results in,

$$\Delta = \frac{P}{225wa} \quad (4.10)$$

where the units of the respective variables are

P in F (force)

a in L (length)

w in F/L²

Equation 4.10 results in an expression for the deflection of a line loaded plate which has a stiffness measured by EI which is limited by a deflection determined from a uniformly distributed load. The majority of static deflection criteria require that the deflection not exceed L/360 as determined from a uniformly distributed live load of 40 psf (1.9 kN/m²) [1]. Substituting this live load into equation 4.10 results in

$$\Delta = \frac{P}{9000a} \quad (4.11)$$

where P and a are in lb and ft respectively and Δ is in ft.

From the model represented by equation 4.6 it is assumed that an equivalent static human live load can be represented by a line load distributed over the width of the plate. Assuming a nominal human weight of 150 lb. and substituting into equation 4.11 results in

$$\Delta = \frac{0.0166}{a}$$

where Δ is in feet or for convenience,

$$\Delta = \frac{0.20}{a} \quad (4.12a)$$

where Δ is in inches and a is in feet.

Also for the SI system of units

$$\Delta = \frac{1.55}{a} \quad (4.12b)$$

where Δ is in mm and a is in meters.

Equations 4.12 are then the static calibration equations which will be correlated with the constant velocity criterion for human response.

4.4 Calibration of Human Response to Equivalent Static Deflections

It was previously established in Section 4.2 that the assumption of a constant velocity response for humans to vertical vibrations is reasonable for the frequency range that is encountered in floors currently in service. The constant velocity criterion as expressed by equation 4.4a,

$$S_a = C_a f$$

can be shown to be related to deflection if the assumption of steady state vibration is made.

$$S_a = 4\pi^2 f^2 S \quad (4.13)$$

where

$$S_a = \text{peak to peak acceleration}$$

$$S = \text{peak to peak deflection}$$

Solving equation 4.13 in terms of deflection and substituting Δ (half-amplitude deflection) results in a constant velocity criterion in terms of deflection.

$$\Delta = C \frac{1}{f} \quad (4.14)$$

which is similar to equation 4.4c.

The constant, C , of equation 4.14 will be used as a calibration constant to relate the dynamic deflection of the constant velocity criterion (4.4c) to the equivalent static deflection of equations 4.12. Equating equation 4.14 and 4.12a

$$C \frac{1}{f} = \frac{0.20}{a}$$

reduces to

$$C = 0.20 \frac{f}{a} \quad (4.15a)$$

where, a is in feet and f is in Hz.

Also for the SI system of units,

$$C = 1.55 \frac{f}{a} \quad (4.15b)$$

where, a is in meters.

Considering that the majority of experience of acceptable floor performance is gained through wood joist systems, data obtained from these systems will be used to establish the calibration constant, C . Table 1 summarizes these data. In order to calculate C , consistent values of a (the distribution width of the line load), the width of the plate, and the natural frequency need to be established. Data are generally only available for the lowest natural frequency (first mode of vibration) therefore this value will be used in the calculation of C . Without extensive study which is beyond the scope of this report, the active floor width is difficult to establish. For the purposes of this derivation it will be

assumed that the active floor width will be either the span of the floor or ten times the nominal joist spacing. The smaller value of these two will be used which follows from

$$a_{\min} \rightarrow \Delta_{\min} \quad \text{by equation 4.12}$$

$$a_{\min} \rightarrow \Delta_{\max} \quad \text{by equation 4.14}$$

$$a_{\min} \rightarrow C_{\min} \quad \text{by equation 4.15}$$

The value of C (table 1) varies from 0.181 to 0.640 thus equation 4.14 is bounded by

$$0.180 \frac{1}{f} < \Delta < 0.670 \frac{1}{f}$$

or approximately

$$\frac{2}{11} \frac{1}{f} < \Delta < \frac{2}{3} \frac{1}{f}$$

which gives the boundary equations

$$\Delta = \frac{2}{11} \frac{1}{f} \quad (4.16a)$$

$$\Delta = \frac{2}{3} \frac{1}{f} \quad (4.16b)$$

where Δ is in inches and f in Hz. Also for the SI system of units,

$$\Delta = 1.4 \frac{1}{f} \quad (4.16c)$$

$$\Delta = 5.0 \frac{1}{f} \quad (4.16d)$$

where Δ is in mm and f is in Hz.

The data (table 1) are plotted on figure 6. The envelopes of equations 4.16 are also shown. Equations 4.16 bound all of the data which were selected to calculate the calibration coefficient, C. For comparative purposes the ISO reduced comfort boundary and fatigue decreased proficiency boundary both for the one minute duration vibration [13] and the Lenzen modified Reiher-Meister boundary [11] are also shown in figure 6. It should be noted that both the ISO and the Lenzen modified Reiher-Meister curves indicate that equations 4.16 establish a boundary of vibration perception that is definitely above that of a threshold preception. Lenzen refers to the range above his curve as strongly perceptible. The ISO refers to their perception range as fatigue-decreased proficiency boundary for one minute of vibration. A time factor is not necessarily attached to the Lenzen curve; however, Lenzen does infer that the curve applies to transient vibration because it was modified from the steady-state vibration curves originally established by Reiher-Meister [12]. It can be generally said from previous researchers' work [1] that as the vibration duration decreases, the human sensitivity to that vibration also decreases which infers that if the vibration duration were less than 1 minute, that the boundaries established by equations 4.16 would be in the approximate range of decreased proficiency according to ISO [13]. Without further extensive comparisons, calibrations and analysis, it will only be possible to represent a trend of response to floor vibrations by way of the use of equations 4.16. It can be said that equations 4.16 undoubtedly represent a range of flexibility of floors that are currently in use and that do have perceptible vibrations due to human traffic. However, due to the experience gained in these floors the level of vibration probably will cause some discomfort and human reaction but not to an unacceptable level.

4.5 Performance Criteria

Improved floor performance criteria have been developed in the previous sections which can be stated as follows:

- (1) The stiffness of a floor supporting human activity in a building with all partitions in place shall be such that its maximum deflection under a 150-lb static

line load, distributed over a floor width not greater than the span or 10 times the joist spacing, whichever is smaller and applied at a location producing the greatest deflection, is within the following limit:

$$d_v \leq \frac{2}{3f}$$

where d_v is in inches and f is the lowest natural frequency in units of Hz.

(2) A floor in the building carrying foot traffic and with surface coverings, partitions, furniture and any other items representative of normal occupancy in place, shall be adequately damped so that when subjected to a load of duration less than $1/f$, there will be a reduction in the deflection amplitude in the 10th cycle of vibration to less than $1/4$ of the amplitude in the 2nd cycle of vibration.

(3) Under the effect of steady-state vibrations and irregular vibrations exceeding $10/f$ seconds in duration or regularly repeated transient vibrations caused by service conditions:

- Any floor supporting human activity installed in the building and with surface coverings, partitions, furnishings and other items representative of normal occupancy in place shall not exceed an acceleration of 0.004 g rms.
- The natural frequency of any structural element or assembly shall be less than 0.7 times or greater than 2.0 times the frequency of any dynamic excitations to which it is exposed unless vibration isolation is provided.

These criteria address transient vibrations and damping in parts 1 and 2. Steady-state vibrations and resonance are covered in part 3. The maximum acceleration level specified for steady-state vibration and certain other forms of vibration excitation in part 3a is a constant acceleration criteria covering the frequency range anticipated for floors. This value corresponds approximately to the ISO Standard [13], 24-hour reduced comfort level in the 4 to 8 Hz range. It is intended that this acceleration level approximate a median perception level for most floors encountered. However, according to the more sophisticated approach of the ISO Standard [13], the 4 mg (millig) specification above 8 Hz is only an approximation and should be improved as more research data becomes available. The resonance specification given in part 3b is based on the standard deflection magnification versus frequency curve found in most engineering vibration texts [20]. This development is primarily with residences in mind and should be applicable to floor systems used for this type of occupancy. Further research is needed to account for types of occupancy and structural floor systems as well as location of the structure.

5. Future Floor Performance Criteria

Efforts to deal with the problem of perceptible floor vibrations has generally been through experimental techniques. The procedure has been to design the floor system using the traditional static stiffness concept and then attempt to assess its vibrational adequacy by questionable physical tests. A lack of knowledge about the proper forcing function to simulate human activity on floor systems and a similar deficiency in information on human response to this type of input has produced a concern about the validity of the results from this procedure. Furthermore, this type of experimental technique assumes that both human activity and occupant response can be characterized in a deterministic manner when realistically they both are random variables.

This realization that human activity on floor systems and occupant response to this activity are random variables becomes clear if one considers the character of these variables. For example, in walking, variations in weight, gait, heel-to-ball of foot contact and foot wear of individuals will all effect the instantaneous value of the dynamic loading produced by this type of activity. Hence, it is very difficult to predict the instantaneous value with any certainty for a given instant in time. An examination of the literature indicates that no definitive study has been made to determine the statistical data needed to characterize footfall as a random variable.

A thorough study of the nature of human response to vibration points out the many variables that are involved, such as vibration input where intensity, frequency, direction and duration must be considered; psychological influences in the form of mental state, motivation and experience; and physical influences from sound and sight. Considering this multiplicity of parameters, it is obvious that the only way to classify human response is also as a random variable.

Thus, the dynamic response of a floor system subjected to human activity represents a random physical phenomenon which cannot be described by an explicit mathematical relationship because each observation of the phenomenon will be unique. It should be pointed out that it is not the structural floor systems which are considered to be a random variable because, although there are several types of systems, their dynamic properties can from an engineering viewpoint, be described deterministically. Rather it is the forcing function (human activity) and the human response to this activity which must be considered as random processes; thus making the overall problem of human response to floor vibrations induced by human activity a random vibration problem. This can be more clearly visualized in functional form:

$$F(t) \rightarrow G(t) \rightarrow Y(t) \rightarrow D(t) \quad (5.1)$$

where $F(t)$ is the random forcing function, $G(t)$ is the deterministic floor system characteristics, $Y(t)$ is the random response of the floor system and $D(t)$ is the random human response to the floor vibration, $Y(t)$.

Even though sufficient information is not presently available to describe the forcing function as a random variable it is possible to measure the random response of a floor system when subjected to human activity and compare it to human response.

A recent report, Correlation of Floor Vibration to Human Response [21], describes a random variable methodology for floor vibration evaluation. This methodology is based on physical testing and subsequent analysis and comparison of the dynamic response of floor systems to human activity.

Consequently a new approach to the problem of perceptible floor vibrations has been developed which leads to improved performance criteria for serviceability of floor systems. A performance statement of the type presented in figure 1 has as a design standard a limitation on the vertical acceleration level that can occur under normal in-service conditions and a specification on the minimum amount of damping the floor system must possess. A basis for this type of performance statement has been presented in a standard proposed by Splittgerber [22] which provides vibration and shock limits for occupants of buildings.

Splittgerber's proposal is based on the ISO Guide for the Evaluation of Human Exposure to Whole-Body Vibration [13] which gives allowable root-mean-square (rms) acceleration at different frequencies of vibration. The ISO Guide is applicable to periodic (sinusoidal) vibration as well as narrow-band or wide-band random vibration within a frequency range from 1 Hz to 80 Hz. Allowable accelerations are specified in the Guide for the three general criteria of preserving comfort, working efficiency and safety or health.

Splittgerber proposes a modification, based on adjusting the ISO Guide reduced comfort limit, by applying a weighting factor to the allowable accelerations. Variation in the weighting factor account for the type of excitation (impulsive shock or vibration), occupancy (residential, office, workshop) and the time of day.

Figure 7 shows the ISO Guide [13] standard acceleration curve for the "reduced comfort level" with a correction applied to account for the environmental situation of private residences, hospitals, offices (curve A). This curve serves as the basis for Splittgerber's proposed standard and represents in his opinion good environmental standards for these occupancy types. Thus, for example, continuous or intermittent vibration levels which exceed those specified by curve A either during the day or night, would produce an increased number of complaints in hospitals. In residences, during the day, continuous or intermittent vibration levels could be increased by a factor of two for a minimum complaint level (curve B, figure 7). Splittgerber differentiates between intermittent vibration and impulsive shock in his standard by defining impulsive shock to be characterized by a rapid

build-up to a peak followed by decay while intermittent vibration may only last a few seconds but is characterized by a build-up to a level which is maintained for several cycles of vibration. Impulsive shock is typically produced by blasting, pile driving with an impact procedure, or a human jumping onto a floor. Examples of intermittent vibrations are traffic vibration, machinery starting up, humans walking across the floor, and modern pile driving methods which use vibrating columns. Impulsive shock levels for residences during the day could be increased by a factor of sixteen above curve A, if there are only one to three occurrences per day (curve C, figure 7). Finally, for vibration during the night, regardless of the type of excitation, the vibration level in residences can only be increased above curve A by a factor of 1.41 (curve D, figure 7) without causing increased complaints by occupants.

Plotted on figure 7 for purposes of comparison is Lenzen's [11] modification for transient vibration of the original Reiher-Meister work [12] on steady-state vibrations. Lenzen's modification considers transient vibrations to be a single pulse while Splittergerber's definition for intermittent vibration is a vibration which may last only a few seconds but is characterized by a build-up to a level which is maintained for several cycles. Realistically, Lenzen's definition fits the vibration produced by a single footfall or someone jumping with Splittergerber's definition fitting the vibration produced by walking or running. The cross-hatched area on figure 7 denotes the slightly perceptible range for Lenzen's modification which is again claimed to represent a minimum complaint level. Lenzen's definition is more consistent with Splittergerber's impulsive shock criteria. It can be seen from figure 7 that there is good agreement between these two definitions for $f > 8$ Hz with a divergence of the two below this frequency. The reason for this divergence remains obscure with the information that is available at this time.

Plotted as a triangle on figure 7 is the rms acceleration of 0.95 mg at 16 Hz as determined from a 40 second continuous walking test record. The procedure for obtaining the walking record and its subsequent analysis is given in reference 21. The methodology in reference 15 considers the response of the floor as a non-stationary random process. As can be seen from figure 7, the treatment of the walking record as an intermittent vibration, gives a resulting rms acceleration slightly below the standard curve and well below the minimum complaint level. The floor system tested was in-service and assumed to be acceptable in the absence of major complaints from the occupants.

This indicates that Splittergerber's proposed standard may well be quite reasonable as a basis for performance criteria for vibration of floor systems. However, considerably more data from floors in-service must be obtained before a definite conclusion can be made. Also, additional work needs to be done so that a designer can be given guidance on how to apply this type of approach in the design stage of a given floor system.

6. Summary

Existing performance criteria for the serviceability design of structural floor systems use a static deflection limitation for both static and dynamic loads which has evolved from the experience obtained in using this type of criteria for over 150 years. These criteria are based on limiting the maximum deflection that can occur under a specified load in the floor system to prevent damage to the structure and unpleasing asthetic conditions. In addition, it is generally believed that this limitation would also satisfy vibration serviceability requirements. Present deflection limitations may take one of two forms, either a restriction on the maximum span-to-depth ratio or maximum deflection under a given static loading condition. The current deflection requirement for both static and dynamic service loads appears to be sufficient for the static loads but not always for the dynamic ones. Another shortcoming of current criteria is that the designer is given no guidance as to what level of risk would result from using different deflection limitations.

With the increased use of high strength materials, larger spans and generally more flexible construction, it has become apparent to the engineering community that the present criteria does not always prevent perceptible floor vibrations. Present standards have recognized this by the inclusion of statements which require that due consideration be given to the dynamic characteristics of floor systems in the design of those floors which are subjected

to dynamic loading by pedestrian traffic. Three current vibration criteria are discussed and improved floor performance criteria for dynamic loading of floor systems are developed. These improved criteria treat transient vibration as a chain of damped discrete responses and give an equivalent static deflection limitation as a function of frequency. The relationship developed is calibrated so as to include floor systems currently in use and designed by the traditional stiffness procedure. These floors were generally considered to be acceptable by occupants, although some do exhibit perceptible vibrations when subjected to human traffic.

A new approach to the problem of perceptible floor vibrations is presented which could lead to future performance criteria for vibration serviceability of floor systems. This approach is based on the assumption that human activity which produces floor vibration and the occupant response to this vibration are random variables. A recent proposed ISO standard for Vibration and Shock Limits for Occupants of Buildings is discussed which would act as a basis for future performance criteria. Data for one residential in-service floor system subjected to a continuous walking test and analyzed as random data are compared with the standard and found to be below the minimum complaint level. However, more research is required before this new type of criterion can be fully developed and implemented.

7. References

1. Galambos, T.V., Gould, P.L., Ravindra, M.R., Suryoutomo, H., Crist, R.A., "Structural Deflections - A Literature and State-of-the-Art Survey," Building Science Series 47, National Bureau of Standards, Washington, D.C., October 1973.
2. Wiss, J.F. Parmelee, R.A., "Human Perception of Transient Vibrations," Journal of the Structural Division, ASCE, Vol. 100, No. ST4, April 1974, pp. 773-787.
3. Galambos, T.V., Vibration of Steel Joist-Concrete Slab Floors, Steel Joist Institute, Technical Digest No. 5, 1974.
4. Lenzen, K.H., "Vibration of Floor Systems of Tall Buildings," ASCE-IABSE International Conference Preprints, Vol. 11.17, Lehigh University, Bethlehem, Pa., August 1972.
5. Russell, W.A., "Deflection Characteristics of Residential Wood Joist Floor Systems," Housing Research Paper 30, HHFA, Washington, D.C., 1954.
6. Kidder, F.E., "The Architects and Builders Pocket-Book," Library of Congress, Washington, D.C., 1885.
7. Clarke, C.V., Neville, A.M., Houghton-Evans, W., "Deflection - Problems and Treatment in Various Countries," Deflections of Concrete Structures, SP-43, American Concrete Institute, 1974.
8. Reed, J.W., "Wind Induced Motion and Human Discomfort in Tall Buildings," Structures Publication No. 310, Civil Engineering Department, M.I.T., November 1971.
9. Specification for the Design, Fabrication and Erection of Structural Steel for Buildings, American Institute of Steel Construction, New York, February, 1969.
10. Design and Evaluation of: Operation Breakthrough Housing Systems, U.S. Department of Housing and Urban Development, National Bureau of Standards Report 10 200, September, 1970.
11. Lenzen, K.H., Dorsett, L.P., "Effect of the Variation of Structural Parameters on the Vibrational Characteristics of Steel Joist-Concrete Slab Floor Systems and Suggested Designs," Studies in Engineering Mechanics No. 32, Univ. of Kansas, Lawrence, Kansas, August, 1968.
12. Reiher, H., Meister, F.J., "The Sensitivity of Humans to Vibrations," Forschung auf den Gebiete des Ingenieurwesens, Vol. 2, No. 11, November, 1931.
13. "Guide for the Evaluation of Human Exposure to Whole-Body Vibration," International Standard, ISO 2631, International Organization for Standardization, Sept, 1974.
14. Lenzen, K.H., "Vibration of Steel Joist-Concrete Slab Floor Systems - Final Report," Studies in Engineering Mechanics No. 16, Center for Research in Engineering Science, The University of Kansas, Lawrence, Kansas, August 1962.
15. Harper, F.C., Warlow, W.J., Clarke, B.L., "The Forces Applied to the Floor by the Foot in Walking," National Building Studies, Research Paper 32, Building Research Station, Watford, England, January 1961.
16. Crist, R.A., "Floor Vibration Tests Kalamazoo, Michigan, BREAKTHROUGH Site," Department of Housing and Urban Development, National Bureau of Standards, Report 10 410, February, 1972.
17. Onysko, D.M., "Performance of Wood-Joist Floor Systems - A Review," Forest Products Laboratory, Information Report OP-X-24, Ottawa, Ontario, Canada, January, 1970.

18. Hurst, H.T., "Part II - Residential Floor Vibrations as Influenced by Various Stages of Construction," The Wood Frame House as a Structural Unit, Department of Agricultural Engineering Bulletin 573, Virginia Polytechnic Institute, Blacksburg, Virginia, October, 1966.
19. Lew, H.S., Davis, L.J., "Transient Vibration Tests on Wood-Joist Floors," U.S. Department of Housing and Urban Development, National Bureau of Standards Report 10 248, June, 1970.
20. Jacobsen, L.S., Ayre, R.S., "Engineering Vibrations," McGraw-Hill Book Company, Inc., New York, New York, 1958.
21. Shaver, J.R., "Correlation of Floor Vibration to Human Response," U.S. Department of Housing and Urban Development, National Bureau of Standards Report, In publication.
22. Splitterber, H., "Vibration and Shock Limits for Occupants of Buildings," ISO/TC 108/SC4/WG2, Draft Proposal Document ISO/I08/4N19, January 1, 1975.

TABLE I

Source	Descript.	Distribution		Lowest Nat. fre. f	C_f^* Eq. 4.15a	Δ^* Eq. 4.12a
		Span L	width, a 10xjoist spacing			
		ft	ft	Hz	Hz/ft	in
VPI [17]	wood joist	<u>13.28</u>	13.3	12-30	.1801-.4519	.015
NBS [18]	H1(FH1)4	20.5	<u>10</u>	13	.260	.020
	H2(FH2)5	<u>13</u>	<u>20</u>	24	.369	.015
	H3(FH3)5	<u>12.5</u>	13.3	26	.416	.016
	A1-4	<u>14.5</u>	<u>13.3</u>	23	.396	.015
	A1-4	<u>10.25</u>	<u>13.3</u>	22	.429	.020
NBS [16]	A	11.08	<u>10</u>	32	.640	.020
	A	<u>11.08</u>	<u>13.3</u>	30	.541	.018
	B	<u>11.08</u>	20	29	.524	.018
	C	<u>13.08</u>	43.4	21	.321	.015

*Calculated from a_{min} (underscored)

Note: 1 ft = 0.3048 meters (exactly)
1 in = 25.4 mm (exactly)

PERFORMANCE STATEMENT

Floors shall not be annoying to occupants

GENERALIZED SPECIFICATION STANDARD

Serviceable floors shall not have excessive vertical accelerations

DESIGN STANDARD

Serviceable floors for residences shall not have accelerations exceeding (x) gs rms and shall have no less than (y) percent of critical damping

DESIGN GUIDES

Methods of loading floors for floor response (in both the design stage and the field on in-service systems) and Methods of calculating floor response

DETAILED REFERENCES

Technical Engineering Publications
Research Publications
Engineering Texts

Figure 1. Example Heirachy of Criteria for Floors

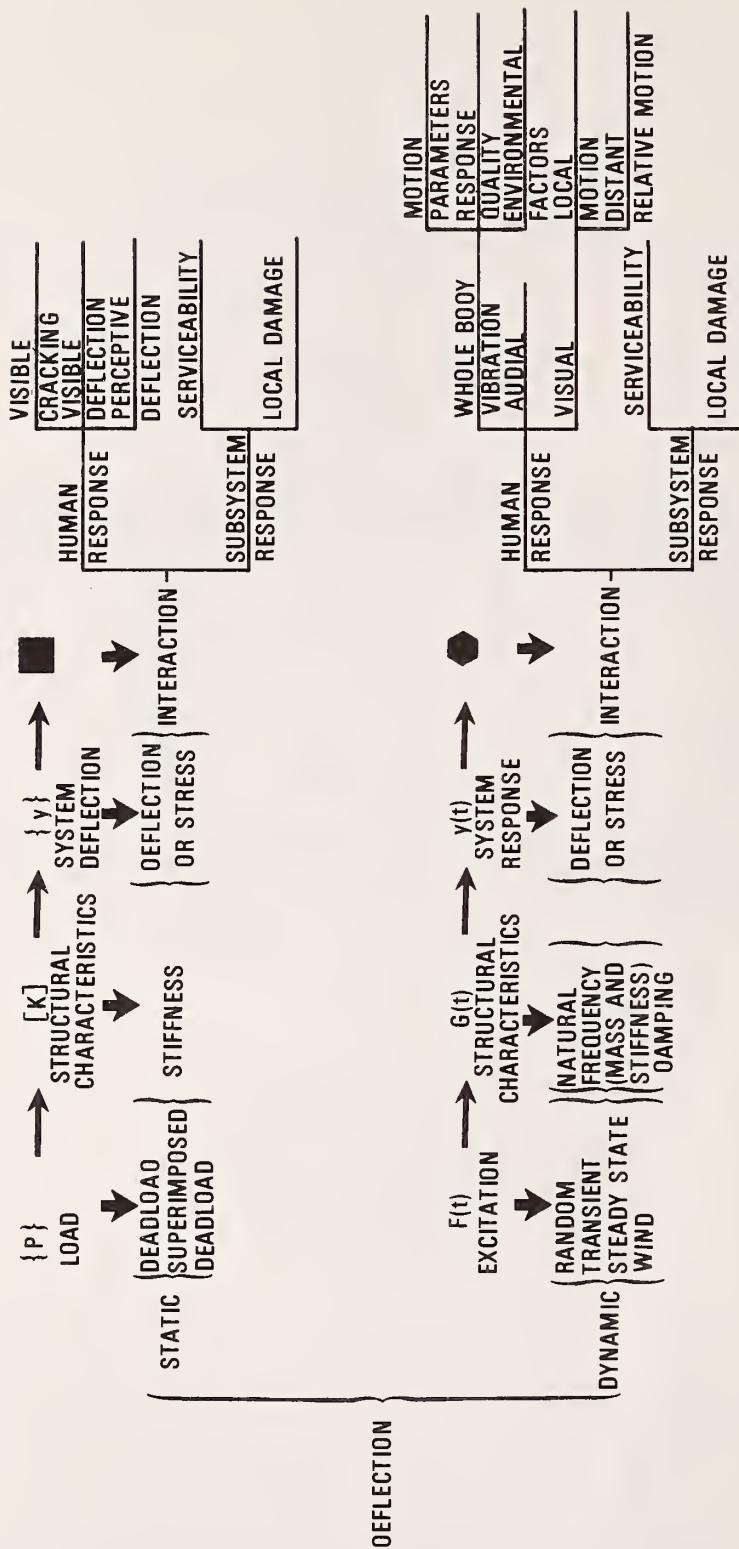


Figure 2. Problem Statement, Structural Deflections

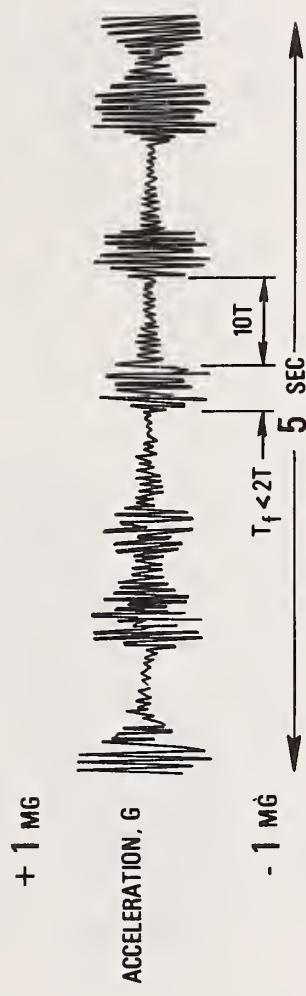


Figure 3. Transient Response from Footfall

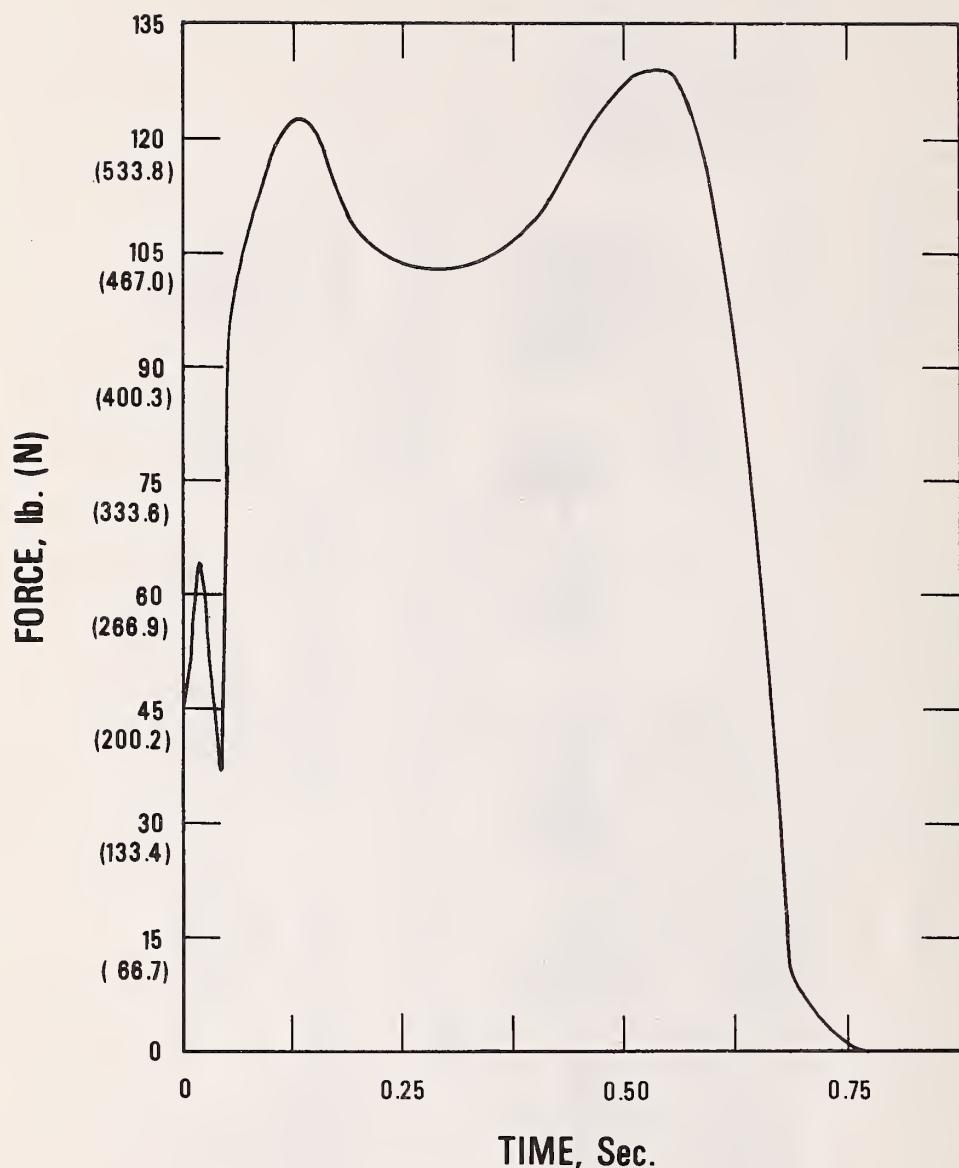


Figure 4. Footfall Time History (15)

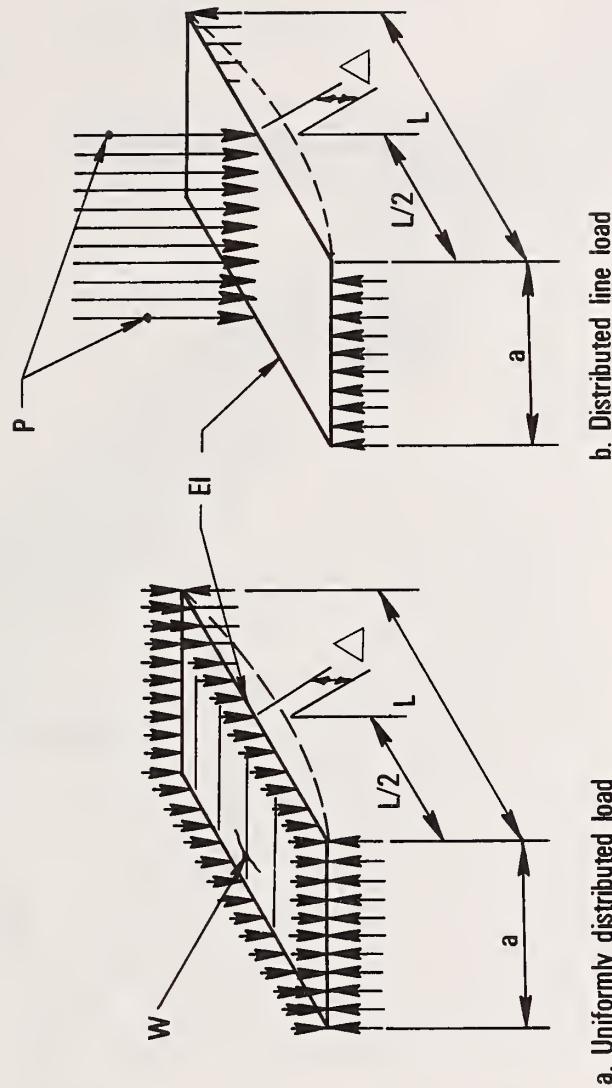


Figure 5. Models for Deflection Calculations

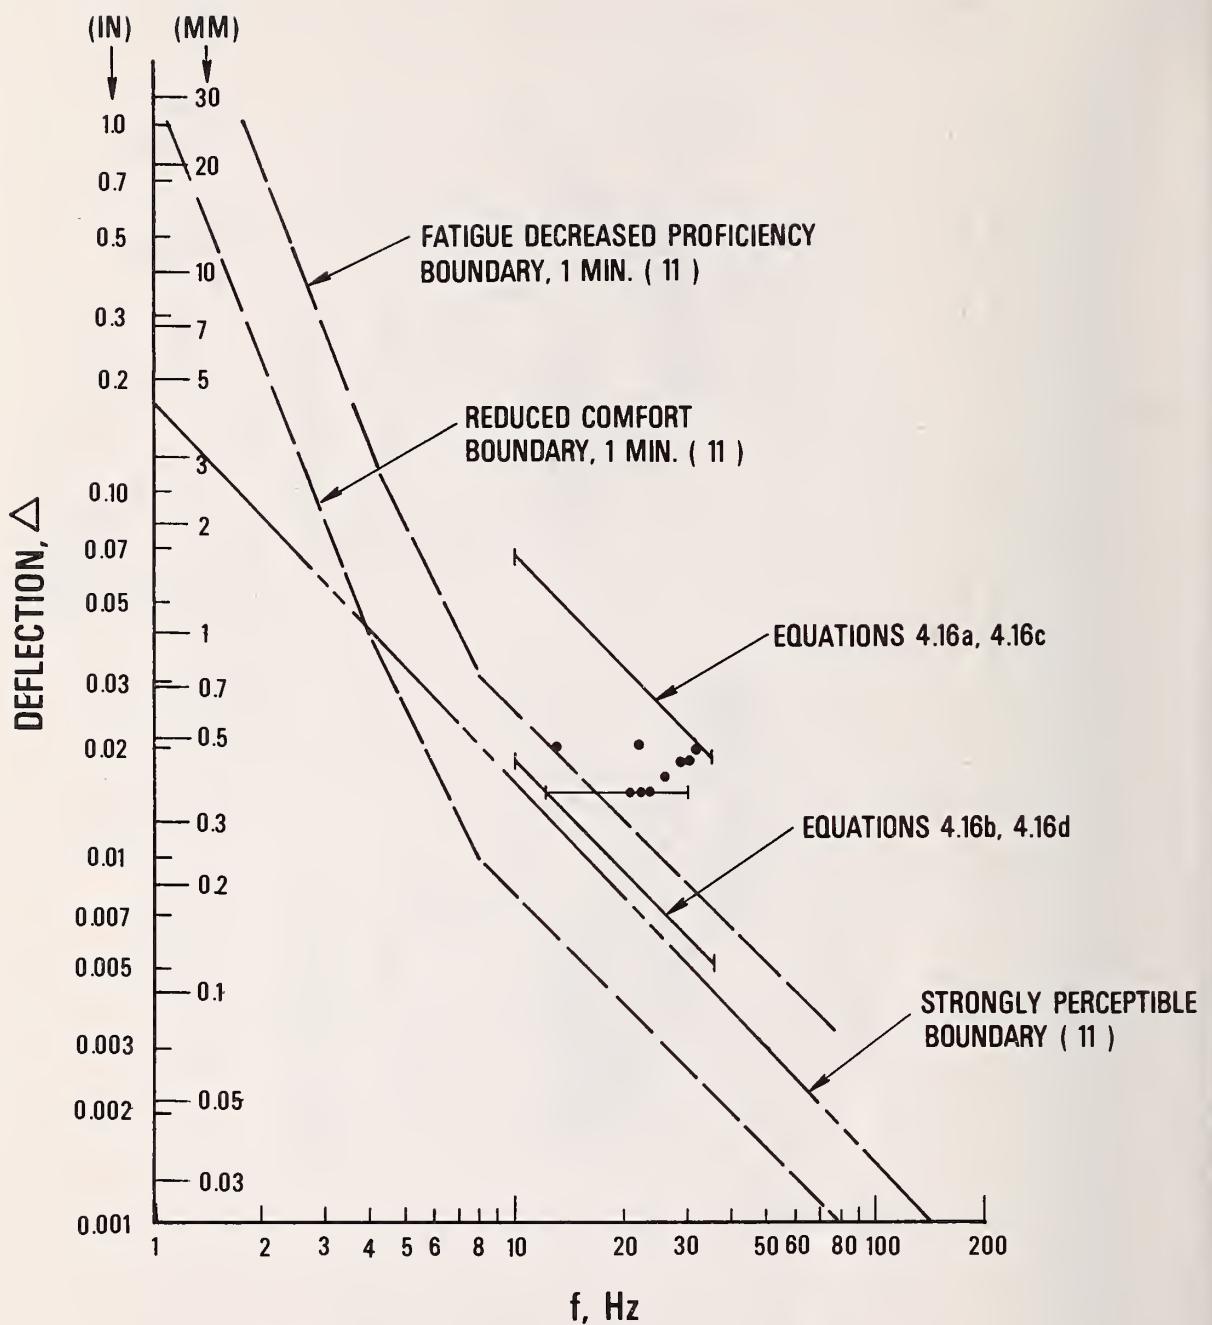


Figure 6. Comparison of Human Response to Vertical Vibration, Deflection Vs. Frequency

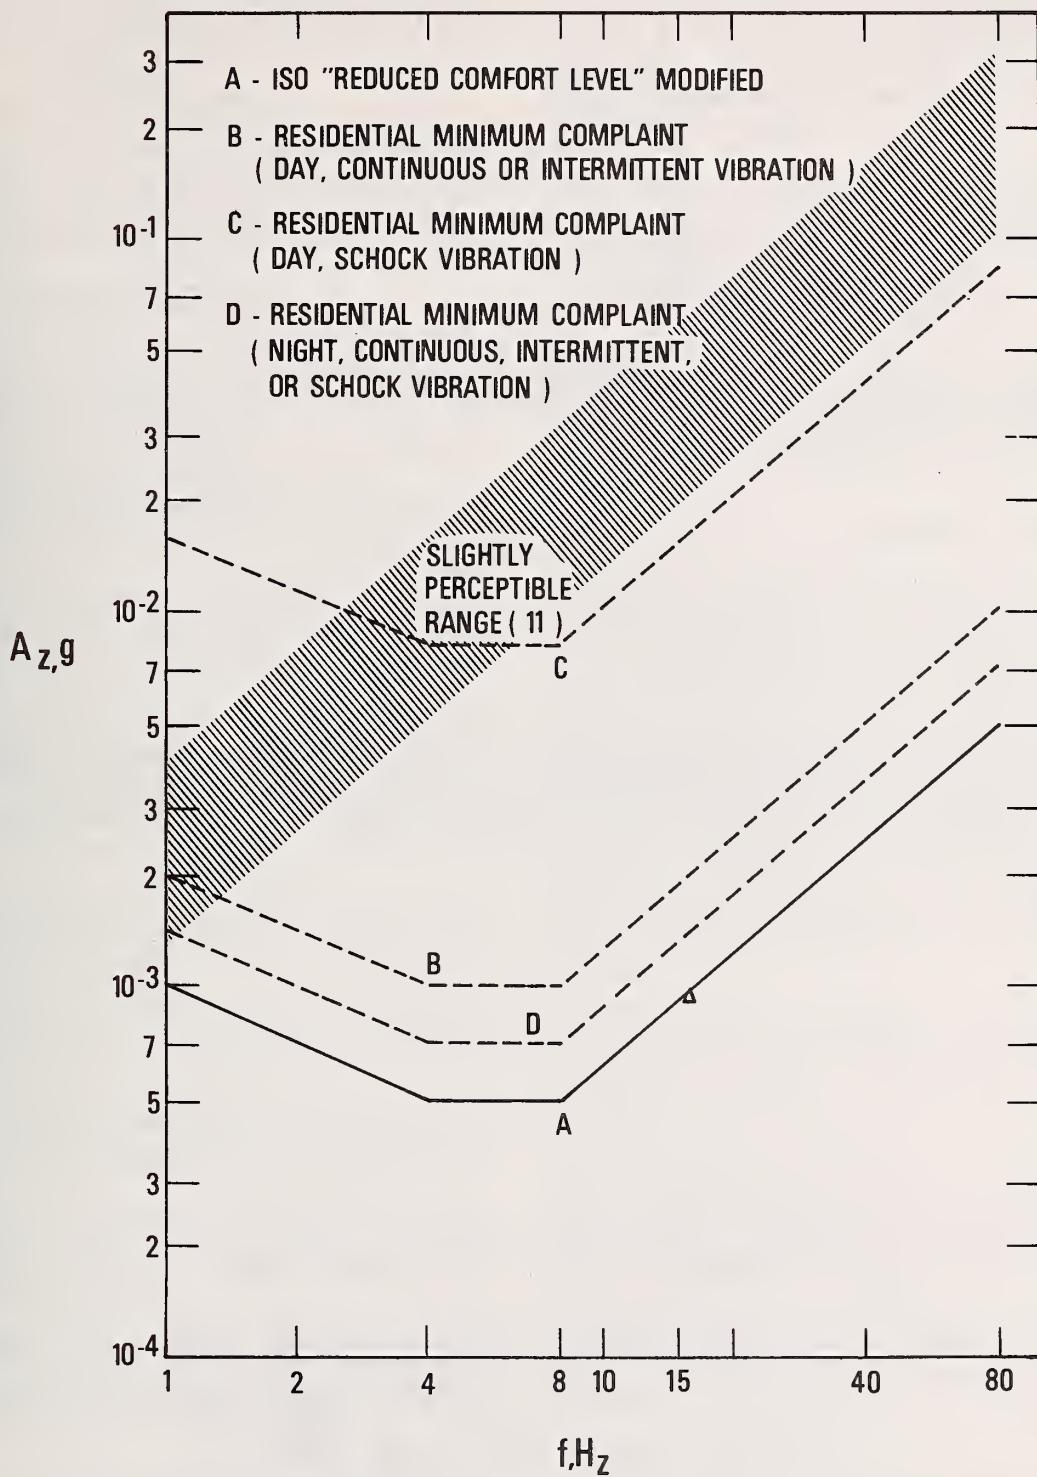


Figure 7. Human Response to Vertical Vibration, Acceleration vs. Frequency

U.S. DEPT. OF COMM. BIBLIOGRAPHIC DATA SHEET		1. PUBLICATION OR REPORT NO. NBS TN-900	2. Gov't Accession No.	3. Recipient's Accession No.
4. TITLE AND SUBTITLE Deflection Performance Criteria for Floors		5. Publication Date April 1976		
7. AUTHOR(S) R.A. Crist and J.R. Shaver		6. Performing Organization Code 461.01		
9. PERFORMING ORGANIZATION NAME AND ADDRESS NATIONAL BUREAU OF STANDARDS DEPARTMENT OF COMMERCE WASHINGTON, D.C. 20234		10. Project/Task/Work Unit No. 4618381		
12. Sponsoring Organization Name and Complete Address (Street, City, State, ZIP) Department of Housing and Urban Development Office of Policy Development and Research Washington, D.C. 20410		11. Contract/Grant No.		
15. SUPPLEMENTARY NOTES		13. Type of Report & Period Covered Final		
16. ABSTRACT (A 200-word or less factual summary of most significant information. If document includes a significant bibliography or literature survey, mention it here.) Serviceability performance criteria for floor systems are discussed in terms of their static and dynamic components. Development of traditional static stiffness criteria is given along with a review of their strengths and weaknesses. Criteria for serviceable floors are presented from a vibration viewpoint and the derivation of an improved criterion is given. A new approach for future vibration criteria is described.		14. Sponsoring Agency Code Same as #12		
17. KEY WORDS (six to twelve entries; alphabetical order; capitalize only the first letter of the first key word unless a proper name; separated by semicolons) Deflection; dynamic; floor systems; human responses; performance criteria; serviceability; static; vibration.		19. SECURITY CLASS (THIS REPORT) UNCL ASSIFIED		
18. AVAILABILITY <input type="checkbox"/> Unlimited <input type="checkbox"/> For Official Distribution. Do Not Release to NTIS <input checked="" type="checkbox"/> Order From Sup. of Doc., U.S. Government Printing Office Washington, D.C. 20402, SD Cat. No. C13.46:700 <input type="checkbox"/> Order From National Technical Information Service (NTIS) Springfield, Virginia 22151		21. NO. OF PAGES 29		
		20. SECURITY CLASS (THIS PAGE) UNCLASSIFIED		
		22. Price \$.75		

NBS TECHNICAL PUBLICATIONS

PERIODICALS

JOURNAL OF RESEARCH reports National Bureau of Standards research and development in physics, mathematics, and chemistry. It is published in two sections, available separately:

• Physics and Chemistry (Section A)

Papers of interest primarily to scientists working in these fields. This section covers a broad range of physical and chemical research, with major emphasis on standards of physical measurement, fundamental constants, and properties of matter. Issued six times a year. Annual subscription: Domestic, \$17.00; Foreign, \$21.25.

• Mathematical Sciences (Section B)

Studies and compilations designed mainly for the mathematician and theoretical physicist. Topics in mathematical statistics, theory of experiment design, numerical analysis, theoretical physics and chemistry, logical design and programming of computers and computer systems. Short numerical tables. Issued quarterly. Annual subscription: Domestic, \$9.00; Foreign, \$11.25.

DIMENSIONS/NBS (formerly Technical News Bulletin)—This monthly magazine is published to inform scientists, engineers, businessmen, industry, teachers, students, and consumers of the latest advances in science and technology, with primary emphasis on the work at NBS. The magazine highlights and reviews such issues as energy research, fire protection, building technology, metric conversion, pollution abatement, health and safety, and consumer product performance. In addition, it reports the results of Bureau programs in measurement standards and techniques, properties of matter and materials, engineering standards and services, instrumentation, and automatic data processing.

Annual subscription: Domestic, \$9.45; Foreign, \$11.85.

NONPERIODICALS

Monographs—Major contributions to the technical literature on various subjects related to the Bureau's scientific and technical activities.

Handbooks—Recommended codes of engineering and industrial practice (including safety codes) developed in cooperation with interested industries, professional organizations, and regulatory bodies.

Special Publications—Include proceedings of conferences sponsored by NBS, NBS annual reports, and other special publications appropriate to this grouping such as wall charts, pocket cards, and bibliographies.

Applied Mathematics Series—Mathematical tables, manuals, and studies of special interest to physicists, engineers, chemists, biologists, mathematicians, computer programmers, and others engaged in scientific and technical work.

National Standard Reference Data Series—Provides quantitative data on the physical and chemical properties of materials, compiled from the world's literature and critically evaluated. Developed under a world-wide

program coordinated by NBS. Program under authority of National Standard Data Act (Public Law 90-396).

NOTE: At present the principal publication outlet for these data is the *Journal of Physical and Chemical Reference Data (JPCRD)* published quarterly for NBS by the American Chemical Society (ACS) and the American Institute of Physics (AIP). Subscriptions, reprints, and supplements available from ACS, 1155 Sixteenth St. N. W., Wash. D. C. 20056.

Building Science Series—Disseminates technical information developed at the Bureau on building materials, components, systems, and whole structures. The series presents research results, test methods, and performance criteria related to the structural and environmental functions and the durability and safety characteristics of building elements and systems.

Technical Notes—Studies or reports which are complete in themselves but restrictive in their treatment of a subject. Analogous to monographs but not so comprehensive in scope or definitive in treatment of the subject area. Often serve as a vehicle for final reports of work performed at NBS under the sponsorship of other government agencies.

Voluntary Product Standards—Developed under procedures published by the Department of Commerce in Part 10, Title 15, of the Code of Federal Regulations. The purpose of the standards is to establish nationally recognized requirements for products, and to provide all concerned interests with a basis for common understanding of the characteristics of the products. NBS administers this program as a supplement to the activities of the private sector standardizing organizations.

Federal Information Processing Standards Publications (FIPS PUBS)—Publications in this series collectively constitute the *Federal Information Processing Standards Register*. Register serves as the official source of information in the Federal Government regarding standards issued by NBS pursuant to the Federal Property and Administrative Services Act of 1949 as amended, Public Law 89-306 (79 Stat. 1127), and as implemented by Executive Order 11717 (38 FR 12315, dated May 11, 1973) and Part 6 of Title 15 CFR (Code of Federal Regulations).

Consumer Information Series—Practical information, based on NBS research and experience, covering areas of interest to the consumer. Easily understandable language and illustrations provide useful background knowledge for shopping in today's technological marketplace.

NBS Interagency Reports (NBSIR)—A special series of interim or final reports on work performed by NBS for outside sponsors (both government and non-government). In general, initial distribution is handled by the sponsor; public distribution is by the National Technical Information Service (Springfield, Va. 22161) in paper or microfiche form.

Order NBS publications (except NBSIR's and Bibliographic Subscription Services) from: Superintendent of Documents, Government Printing Office, Washington, D.C. 20402.

BIBLIOGRAPHIC SUBSCRIPTION SERVICES

The following current-awareness and literature-survey bibliographies are issued periodically by the Bureau: **Cryogenic Data Center Current Awareness Service**

A literature survey issued biweekly. Annual subscription: Domestic, \$20.00; foreign, \$25.00.

Liquefied Natural Gas. A literature survey issued quarterly. Annual subscription: \$20.00.

Superconducting Devices and Materials. A literature

survey issued quarterly. Annual subscription: \$20.00. Send subscription orders and remittances for the preceding bibliographic services to National Bureau of Standards, Cryogenic Data Center (275.02) Boulder, Colorado 80302.

Electromagnetic Metrology Current Awareness Service
Issued monthly. Annual subscription: \$24.00. Send subscription order and remittance to Electromagnetics Division, National Bureau of Standards, Boulder, Colo. 80302.

U.S. DEPARTMENT OF COMMERCE
National Bureau of Standards

Washington, D.C. 20234

OFFICIAL BUSINESS

Penalty for Private Use, \$300

POSTAGE AND FEES PAID
U.S. DEPARTMENT OF COMMERCE
COM-215



SPECIAL FOURTH-CLASS RATE
BOOK



75 YEARS
NBS
1901-1976