



# NBS TECHNICAL NOTE 974

U.S. DEPARTMENT OF COMMERCE / National Bureau of Standards

## Corrosion of Metallic Pipes Transporting Potable Water— Laboratory Testing Methods

## NATIONAL BUREAU OF STANDARDS

The National Bureau of Standards<sup>1</sup> was established by an act of Congress March 3, 1901. The Bureau's overall goal is to strengthen and advance the Nation's science and technology and facilitate their effective application for public benefit. To this end, the Bureau conducts research and provides: (1) a basis for the Nation's physical measurement system, (2) scientific and technological services for industry and government, (3) a technical basis for equity in trade, and (4) technical services to promote public safety. The Bureau's technical work is performed by the National Measurement Laboratory, the National Engineering Laboratory, and the Institute for Computer Sciences and Technology.

**THE NATIONAL MEASUREMENT LABORATORY** provides the national system of physical and chemical and materials measurement; coordinates the system with measurement systems of other nations and furnishes essential services leading to accurate and uniform physical and chemical measurement throughout the Nation's scientific community, industry, and commerce; conducts materials research leading to improved methods of measurement, standards, and data on the properties of materials needed by industry, commerce, educational institutions, and Government; provides advisory and research services to other Government Agencies; develops, produces, and distributes Standard Reference Materials; and provides calibration services. The Laboratory consists of the following centers:

Absolute Physical Quantities<sup>2</sup> — Radiation Research — Thermodynamics and Molecular Science — Analytical Chemistry — Materials Science.

**THE NATIONAL ENGINEERING LABORATORY** provides technology and technical services to users in the public and private sectors to address national needs and to solve national problems in the public interest; conducts research in engineering and applied science in support of objectives in these efforts; builds and maintains competence in the necessary disciplines required to carry out this research and technical service; develops engineering data and measurement capabilities; provides engineering measurement traceability services; develops test methods and proposes engineering standards and code changes; develops and proposes new engineering practices; and develops and improves mechanisms to transfer results of its research to the ultimate user. The Laboratory consists of the following centers:

Applied Mathematics — Electronics and Electrical Engineering<sup>2</sup> — Mechanical Engineering and Process Technology<sup>2</sup> — Building Technology — Fire Research — Consumer Product Technology — Field Methods.

**THE INSTITUTE FOR COMPUTER SCIENCES AND TECHNOLOGY** conducts research and provides scientific and technical services to aid Federal Agencies in the selection, acquisition, application, and use of computer technology to improve effectiveness and economy in Government operations in accordance with Public Law 89-306 (40 U.S.C. 759), relevant Executive Orders, and other directives; carries out this mission by managing the Federal Information Processing Standards Program, developing Federal ADP standards guidelines, and managing Federal participation in ADP voluntary standardization activities; provides scientific and technological advisory services and assistance to Federal Agencies; and provides the technical foundation for computer-related policies of the Federal Government. The Institute consists of the following divisions:

Systems and Software — Computer Systems Engineering — Information Technology.

<sup>1</sup>Headquarters and Laboratories at Gaithersburg, Maryland, unless otherwise noted; mailing address Washington, D.C. 20234.

<sup>2</sup>Some divisions within the center are located at Boulder, Colorado, 80303.

JUN 21 1978

Not a ...

62

100

45753

974

C.2

# Corrosion of Metallic Pipes Transporting Potable Water—Laboratory Testing Methods


† Technical Note

Jean N. Andre

Centre Scientifique du Batiment  
Paris, France

James R. Clifton

Center for Building Technology  
National Engineering Laboratory  
National Bureau of Standards  
Washington, D.C. 20234



---

U.S. DEPARTMENT OF COMMERCE, Juanita M. Kreps, Secretary

Dr. Sidney Harman, Under Secretary

Jordan J. Baruch, Assistant Secretary for Science and Technology

U.S. NATIONAL BUREAU OF STANDARDS, Ernest Ambler, Director

Issued June 1978

## National Bureau of Standards Technical Note 974

Nat. Bur. Stand. (U.S.), Tech. Note 974, 36 pages (June 1978)

CODEN: NBTNAE

U.S. GOVERNMENT PRINTING OFFICE

WASHINGTON: 1978

---

For sale by the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402  
(Order by SD Catalog No. C13.46.974), Stock No. 003-003-01945-3 Price \$1.40

(Add 25 percent additional for other than U.S. mailing).

# TABLE OF CONTENTS

PAGE

1. INTRODUCTION . . . . .	1
2. LABORATORY SIMULATION OF PIPE CORROSION . . . . .	3
2.1 Properties of Metallic Pipes . . . . .	3
2.2 Chemical Composition of Water . . . . .	6
2.2.1 Salts . . . . .	6
2.2.2 Dissolved $\text{CO}_2(\text{g})$ and $\text{O}_2(\text{g})$ . . . . .	7
2.2.3 Test Water . . . . .	8
2.3 Flow Rate of Water . . . . .	10
2.4 Water Temperature . . . . .	12
2.5 Water Pressure . . . . .	13
2.6 Prevention of Extraneous Corrosion . . . . .	14
3. CORROSION RATE MEASUREMENTS . . . . .	15
3.1 Weight Loss Measurements . . . . .	19
3.2 Electrochemical Measurements . . . . .	21
4. SUMMARY AND CONCLUSIONS. . . . .	26
5. REFERENCES . . . . .	27

## LIST OF TABLES

	PAGE
1. Comparison Between Calculated and Measured Weight Losses	25

## LIST OF FIGURES

1. Schematic of Pipeline Used During Corrosion Studies	4
2. Water Reservoir	5
3. Connection System Developed to Prevent Crevice Corrosion	16
4. Pipe Specimen Holder Assemblies	17
5. Different Corrosion Rate Behaviors Based on Actual Measurements	20
6. Schematic of Circuit for Making Polarization Resistance Measurements	22
7. Schematic Indicating Location of Reference and Counter Electrodes	23



CORROSION OF METALLIC PIPES TRANSPORTING  
POTABLE WATER - A LABORATORY TESTING METHOD

by

Jean N. Andre and James R. Clifton

A pipeline was constructed and experimental methods developed to determine the effects of several important factors on the corrosion of pipes. These factors included the composition, temperature and flow rate of the water, and type of metal. Components of the pipeline were carefully selected or designed to prevent the occurrence of extraneous corrosion.

The rates of corrosion of galvanized steel and copper pipes were measured by direct weight loss measurements and by polarization resistance methods. It appears that the polarization resistance technique is a useful tool which may be used in a variety of corrosion studies of pipe in aqueous media.

Key words: Copper pipe; corrosion; corrosion measurement; galvanized steel pipe; metal pipes; potable water; resistance polarization.

## 1. INTRODUCTION

In the first phase of a program being undertaken to investigate the processes associated with corrosion of pipes in buildings, the factors affecting the corrosion of pipes transporting potable water are being studied. Many factors affect both the type of corrosion and the corrosion rate of pipes [1-11]. Natural waters are complex media and their chemical

composition, as characterized by pH, dissolved salts, and dissolved gases, is an important factor influencing the corrosion rate of pipes. Other important factors include the flow rate and temperature of the water and obviously the type of metal used in producing the pipe. To ascertain the relative importance of these factors an experimental test design, test methods and test apparatus have been developed. Their development is described in this report.

Included in the development of test methods was the identification and modification of existing corrosion measurement techniques and procedures which would provide the desired information. A commonly used method is based on measuring the weight change of test specimens; however, this method is normally used to obtain results integrated over a long period of time, usually months. The average corrosion rate over such a long period may not be the corrosion parameter controlling the service life of the pipe. Frequently, the corrosion rate changes significantly with time and the magnitude of the corrosion rate at the end of an experiment could be the controlling parameter. Therefore, methods for measuring instantaneous or quasi-instantaneous corrosion rate were reviewed and the resistance polarization method was selected. Its applicability for measuring the corrosion of pipes is discussed in this report.

In addition to investigating the factors affecting the corrosion of pipes, a preliminary assessment of the efficiency of silicates in reducing the corrosion rates of metallic pipes has been made. A common method of controlling corrosion in aqueous media is to use inhibitors, but in potable water the type and the quantities of inhibitors which can be used are



limited because of health considerations. Silicates, phosphates, polyphosphates, zinc salts, carbonates and hydroxides are common inhibitors which are often added to potable water in Europe. Similar inhibitors are also added to some water systems in the United States. Recently, a literature review was conducted by J. N. Andre of corrosion in natural waters, which included the use of polyphosphates (or condensed phosphates) as inhibitors in potable water; the review was published by the Centre Scientifique et Technique du Batiment (CSTB) [12].

## 2. LABORATORY SIMULATION OF PIPE CORROSION

The experimental test design and the test apparatus developed to investigate the effects of factors associated with corrosion of pipes in buildings are discussed in this section. An important aspect of this work was the fabrication of a functional pipeline, which is shown in Figures 1 and 2. The components and operation of the pipeline are also described herein.

### 2.1 Properties of Metallic Pipes

One of the most important features affecting the corrosion of commonly used metals for pipes (black steel, copper, and galvanized steel) is the condition of the interior pipe surfaces, presence of scale or containment films, and smoothness of interior surfaces. Metallurgical features, such as the carbon content of steel (in the range of mild steels), appear to be of secondary importance with pipes of the same metal and their effects are generally uniform from one pipe to another [12]. Therefore, test specimens were fabricated from commercially available black steel, copper and galvanized

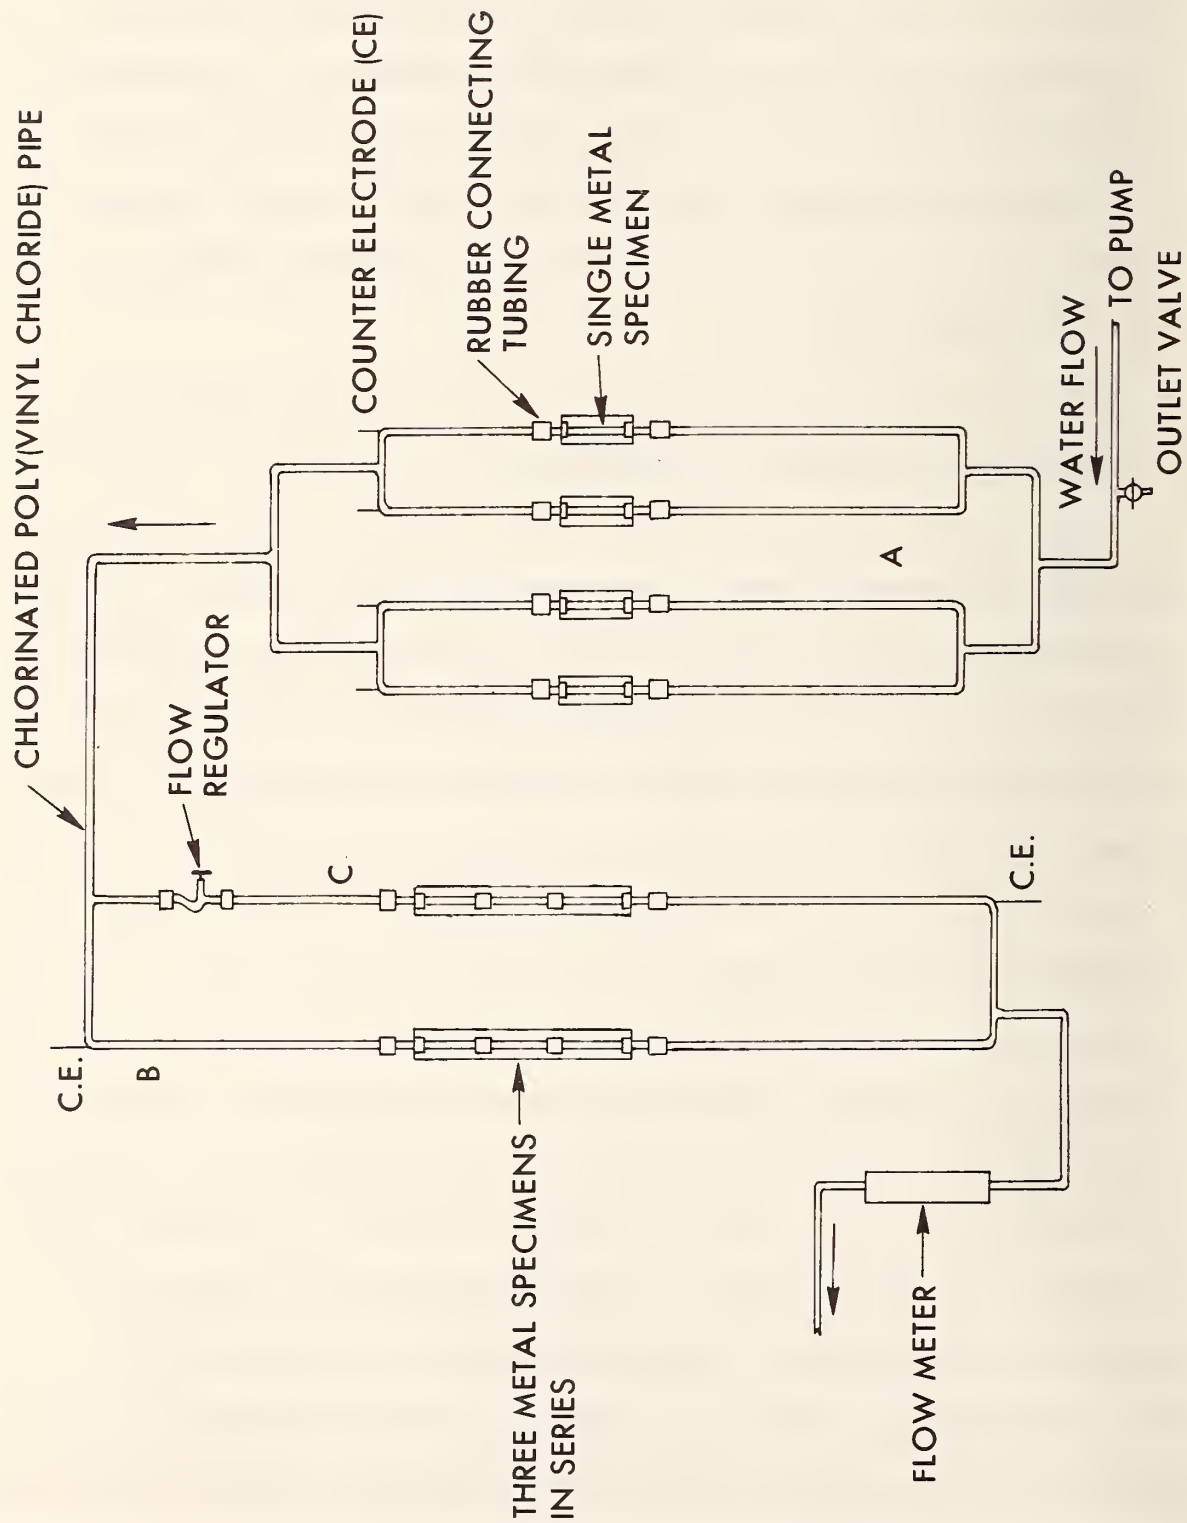


Figure 1. Schematic of Pipeline Used During Corrosion Studies.

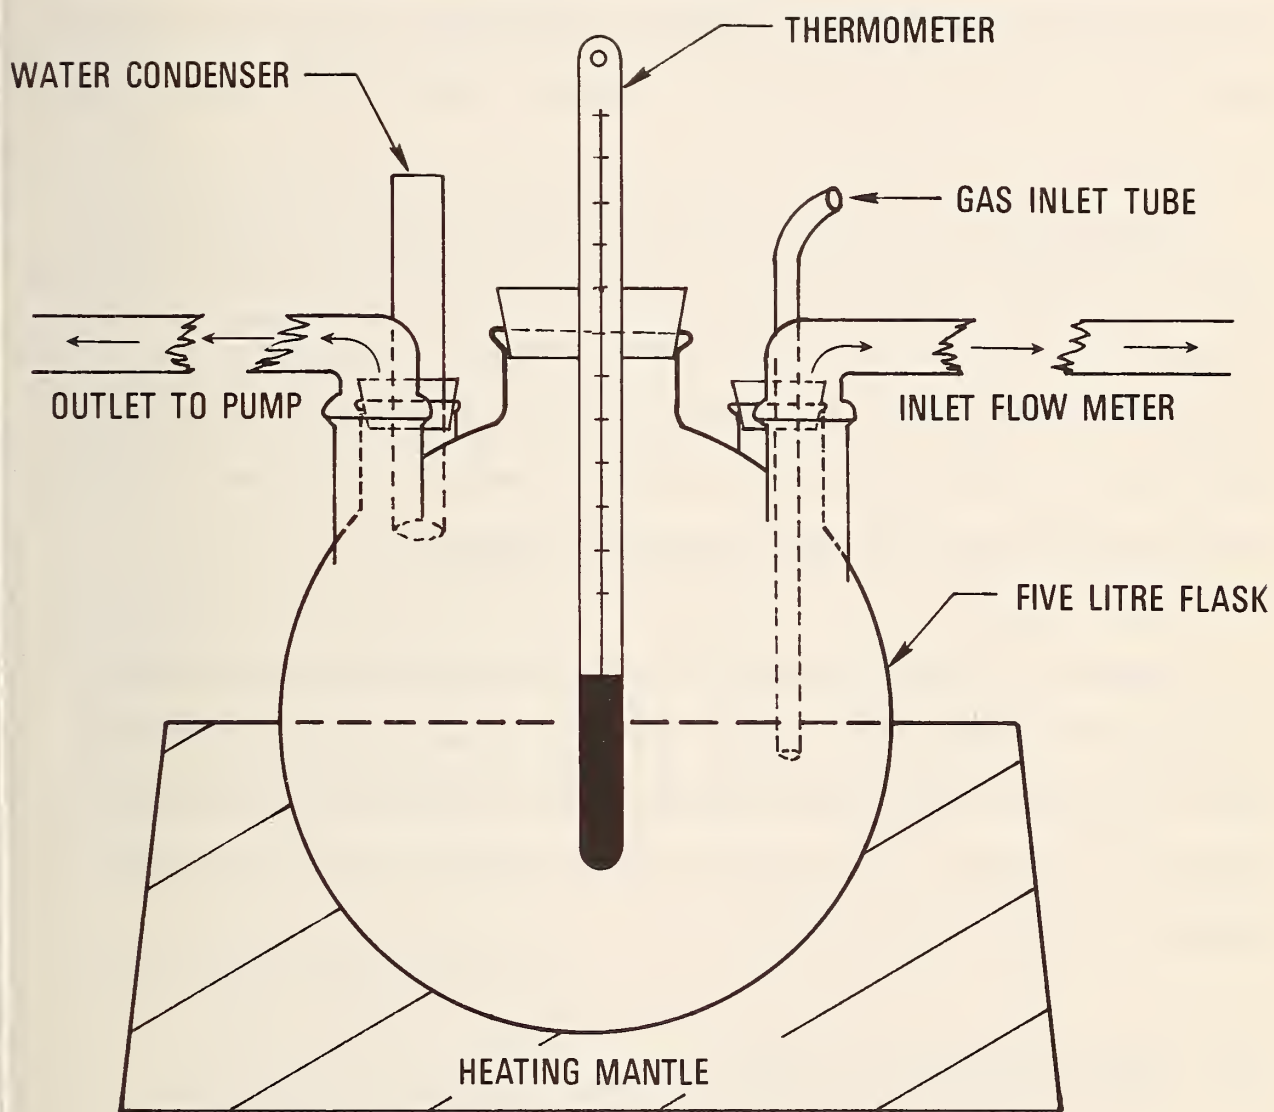


Figure 2. Schematic of Water Reservoir.

steel pipes and used without being subjected to heat treatment. The quality of the galvanized coating on galvanized steel often varies from pipe to pipe and may even vary on a specific pipe. Test specimens were made from pipes of the same origin to minimize metallurgical differences. Only small differences were found in the corrosion behavior of samples taken from the same source.

Test specimens, 10 cm in length were cut from 1.3 cm i.d pipe using a lathe. This small diameter made it possible to obtain a high water flow rate using a low capacity pump (maximum pumping rate of 21 litres/minute). Cutting with the lathe facilitated the preparation of clean and smooth cross sections which could be fitted tightly into plastic connectors. Furthermore, cutting with the lathe did not damage the galvanized coating.

Immediately prior to use, test specimens were (1) cleaned in ethanol, (2) immersed in hydrochloric acid (1 minute in concentrated acid for black steel and copper samples, about 3 seconds in a 1 Normal solution for galvanized test specimens), (3) rinsed in distilled water, then (4) dried with ethanol, and (5) finally weighed.

## 2.2 Chemical Composition of Water

### 2.2.1 Salts

The salts normally present in natural water can be divided into two main categories, (1) those responsible for the carbonate hardness of water and (2) soluble salts. The salts responsible for the carbonate hardness of water are calcium and magnesium carbonates and their bicarbonates.


These salts are only slightly soluble and if supersaturating conditions are attained the salts will precipitate and slowly form protective scales on the walls of the pipes [4, 7].

The commonly encountered soluble salts having the greatest effect on corrosion are the alkali chlorides, sulfates, nitrates, and sodium carbonate and bicarbonate. One process by which these salts can increase corrosion rates is by increasing the conductivity of water. Sulfate and chloride ions have especially great influences on the corrosion rate and type of corrosion.

The effects of other impurities in water such as organic matter, which is often present in surface water, or naturally occurring silicates (sometimes referred to as the cristalloidic form) are difficult to reproduce. These impurities are generally considered to have beneficial effects [13] in controlling corrosion and no attempt was made to incorporate them in our study.

#### 2.2.2 Dissolved $\text{CO}_2(\text{g})$ and $\text{O}_2(\text{g})$


The two gases which usually have the most significant affect on the corrosion of water-transportating pipes are  $\text{O}_2(\text{g})$  and  $\text{CO}_2(\text{g})$ . The amount of dissolved  $\text{CO}_2(\text{g})$  controls the pH of the water as indicated by the simplified equation:



The  $\text{CO}_2$  content also affects the extent of scaling by carbonates.



The amount of oxygen dissolved is very important because the electrode reaction:



is generally the main cathodic reaction involved in the corrosion process. This reaction is, in most cases, diffusion controlled, which means that its rate is dependent on the oxygen concentration gradient next to the pipe walls. If the oxygen at the wall surface is consumed at a rate rapid enough to substantially drop the oxygen concentration, then the diffusion rate of oxygen will control the cathodic reaction. At a specific temperature, the main factors affecting the diffusion rate of oxygen are the oxygen concentration in the bulk solution, and the thickness of the diffusion layer between the bulk solution and the water-metal interface.

### 2.2.3 Test Water

To evaluate the effects of dissolved salts and gases on the corrosion of pipes, experimental waters were made by adding the desired salts and gases to distilled water. The pH's of the solutions were lowered by bubbling  $\text{CO}_2(\text{g})$  through them or increased by flushing dissolved  $\text{CO}_2(\text{g})$  from the solutions with  $\text{N}_2(\text{g})$ . For example, the pH was lowered with  $\text{CO}_2(\text{g})$  to permit the complete solution of  $\text{CaCO}_3$  and  $\text{MgCO}_3$ . The gas content in the test water was controlled during studies by continuously bubbling a mixture of  $\text{O}_2(\text{g})$  and  $\text{CO}_2(\text{g})$  through the water (Fig. 2).

The corrosion process itself progressively changes the composition of the water. Oxygen and eventually  $\text{CO}_2(\text{g})$  are depleted if they are not replaced and the concentrations of metallic ions coming from the corrosion of the pipes are increased if they are not precipitated as oxides, hydroxides, or carbonates. The scaling process in a water of positive Langelier index<sup>1/</sup> will progressively reduce the concentration of calcium and magnesium carbonates. In a large operational system the water is continuously being changed which is difficult to do in a laboratory controlled experiment because of the need to adjust the composition of the test water. The effect of the corrosion process on water composition may be minimized by using a very high ratio of corroding surface to volume of test water.<sup>2/</sup> However, a more realistic approach would be obtained by using a ratio similar to the one encountered in the field. A value of  $140 \text{ cm}^2/\text{litre}$  is given [13] as being a sufficient value for the ratio of  $\frac{\text{corroding surface}}{\text{volume of water}}$ , if the test water is replaced every five hours. In the present experiments, a ratio of  $65 \text{ cm}^2/\text{litre}$  was used and the test water was replaced approximately every 24 hours. In non-scaling water, as used in our first experiments, this replacement rate appeared to be sufficient. In conditions where scaling is to be expected, the replacement time should be determined by monitoring changes in the composition of the water. It is felt that concentration changes of less than 20 percent would have little effect on the corrosion rate.

---

<sup>1/</sup>Langelier index is the difference between the actual pH of the water and the pH this water would have once brought in equilibrium with calcium carbonate [4].

<sup>2/</sup>Corroding surface indicates the internal surface area of the pipe system in contact with the water.

## 2.3 Flow Rate of Water

The Reynolds number,  $RV = \frac{\rho DV}{\mu}$  (where  $\rho$  is the fluid density,  $V$  is the average fluid velocity,  $D$  is the pipe diameter, and  $\mu$  is the fluid viscosity), has been developed based on fluid dynamic considerations [14] and is regarded as being a more significant parameter than the average fluid velocity when considering corrosion. In the present study, the internal diameter of the pipe is the same for every test specimen, 1.3 cm, and  $\rho$  and  $\mu$  are known for water as a function of temperature. Therefore, measuring the average water velocity with a flowmeter is sufficient to determine the Reynolds number at a given temperature. The transition between turbulent and laminar flow which occurs around  $RV = 2000$  [14] corresponds, for a diameter of 1.3 cm, to a velocity of approximately 7 cm/s at 60°C.

The corrosion rate is affected by the thickness of the boundary layer<sup>3/</sup> because the chemical species involved in the corrosion processes must pass through this layer. An increase in velocity of the water decreases the thickness of this boundary layer and accelerates mass transfer processes [15, 16, 17]. The smoothness of the pipe walls also affects the thickness of the boundary layer.

A moderately high water velocity is generally a favorable condition for preventing localized corrosion because the strong stirring action helps to prevent the formation of concentration cells. At higher velocities

---

<sup>3/</sup>Thin zone of flowing water in the immediate vicinity of the surface of the pipe [14].

corrosion-erosion (impingement attack) may occur. In addition, high water velocities can influence the deposited film characteristics by causing the removal of loose or slightly adherent deposits.

In this work, the effects of a range of velocities, low velocity (less than .07 m/s), medium velocity (.4-.6 m/s), and high velocity (around 2 m/s), were investigated. After passing through the pump, (see Fig. 1) the water was separated into four equal portions during passage through segment A of the pipe network (medium flow), then the water was recombined and passed through segment B (high flow), except for a small amount which passed through segment C (low flow). The flow through segment C was regulated by a needle valve. The needle valve was calibrated by collecting and measuring the water flowing through segment C during a specific time interval. The bulk flow was measured by the flowmeter F. The low flow was probably laminar and the medium and high flows were considered to be turbulent.

Two experiments have been carried out to determine the effects of the flow rate of water on corrosion. The first experiment lasted one month and consisted of exposing copper pipes at 60°C to a test water with a pH between 8.3 to 8.5 (measured at ambient temperature). No attempt was made to measure the pH at 60°C and the water was aerated with room air. The test water initially contained 80 ppm of  $\text{CaCO}_3$ , 225 pm of  $\text{NaHCO}_3$ , 60 ppm of  $\text{NaCl}$ , and 20 ppm of  $\text{MgSO}_4 \cdot 7\text{H}_2\text{O}$ . Under these conditions, the corrosion rate was little affected by changes in the water velocity. For an exposed surface of 43.3  $\text{cm}^2$ , the average weight loss was 12 mg for low flow (ca .07 m/s), in medium flow (0.37 m/s) the weight loss was 16 mg, and in high flow (1.5 m/s), the weight loss was 10 mg. In the second experiment, galvanized steel was



tested at 60°C for 60 days. The test water was similar to that used in the previous experiment except that the pH was lowered to 6 (measured at ambient temperature) by bubbling CO<sub>2(g)</sub> through the solution. Under these conditions, the corrosion rate was significantly dependent on the water velocity. The average weight losses were 1.4 g at high velocity (2.7 m/s), 0.46 g at medium velocity (0.46 m/s), and 2 g at low velocity (ca. .07 m/s) for samples with exposed surfaces of approximately 40 cm<sup>2</sup>. Visual inspection of the galvanized test specimens indicated that localized corrosion took place at low velocity. These results clearly indicate that the flow rate of the transported water can significantly affect the corrosion rate of certain types of metallic pipes.

In obtaining information on the effect of a range of water velocities on the corrosion rate, constant water velocities were used, that is each velocity was kept constant. In real systems, however, there are alternate periods of low, medium and high water velocities. While it is possible to reproduce those conditions in the laboratory the interpretation of the results would be more difficult.

## 2.4 Water Temperature

Temperature is an important variable which affects the kinetics of chemical reactions. The reaction rates of many activation controlled processes are roughly doubled for every 10°C increase. While diffusion controlled processes are less affected by temperature, they are slightly accelerated because diffusion rates are temperature dependent. The temperature may also effect the thermodynamic equilibrium controlling the phase stability of oxides and hydroxides, and the solubilities of salts



and gases in water. Considering the materials used in water supply systems and the range of temperatures encountered (10 to 70°C) an increase in temperature will usually increase the corrosion rate.

In our apparatus, water is heated in a 5 litre round bottom glass flask by a jacket heater with controlled power (Fig. 2). The temperature of the laboratory is relatively constant and consequently heat losses are fairly uniform, therefore 60°C is easily obtained within  $\pm 2^\circ\text{C}$ . Significant changes in temperature only occur when a portion of the test water is replaced. At this time, the temperature would decrease by as much as 15°C, however in less than one hour the temperature increased back to its original value. The temperature difference between the inlet water and the outlet water in the flask was found to be less than 0.5°C. The temperature in the branch with the low flow (segment C, Fig. 1) appears to be slightly lower than that in the main part of the pipeline. In further experiments this problem will be eliminated by wrapping the low flow branch with a thermal insulation material.

## 2.5 Water Pressure

The main influence of externally applied pressure on corrosion rates in water appears to be to increase the solubility of  $\text{O}_2$  and  $\text{CO}_2$  gases. Similar results can be obtained by bubbling through the water gaseous mixtures of  $\text{O}_2$  and  $\text{CO}_2$  with, if desired, high partial pressures of either gas.

The experimental pipe system was not pressurized, it was connected to the atmosphere of the room through a water-cooled condenser to avoid excessive evaporation of the test water.

## 2.6 Prevention of Extraneous Corrosion

Components of the pipeline were carefully selected or designed to prevent the occurrence of corrosion extraneous to the scope of this work, such as deposition, crevice, and galvanic corrosion.

Copper ions in concentrations less than 1 ppm can cause the deposition corrosion of metallic pipes such as black steel and galvanized steel [7]. Such small concentrations can be readily generated by the corrosion of copper or copper alloy parts, especially in a recirculating system. As a consequence, an apparatus for testing black steel and galvanized pipes has to be free of components containing copper or copper alloys. Separate pipelines were setup to test copper pipes, black steel, and galvanized pipes individually and there are no copper components in the pipeline used for the study of black steel and galvanized pipe. For example, the pump has an epoxy body and epoxy impeller, the flow meter has a stainless steel body and glass flow tube, and the needle valve consists of a glass housing and poly(tetrafluorethylene) adjustable needle.

A method was developed to connect test specimens to the water loop in such a way that neither differential aeration nor unusual turbulence occurred at the junctions. This connection system shown in Figure 3 has prevented the occurrence of any corrosion localized (crevice corrosion) at the edges of the

specimens. The plastic used for the connector was initially poly(tetrafluorethylene) but at 60°C this material crept so much that leaks developed at the metal-plastic joints and therefore is being replaced with chlorinated poly(vinyl chloride) which has performed satisfactorily to date.

Galvanic corrosion is prevented by constructing the pipe network (Figure 1) from 1.3 cm i.d. chlorinated poly(vinyl chloride) pipe. All other components, such as the pump, needle valve, test specimen holders, were connected to the pipeline with chemically and thermally resistant synthetic tubing. Three pipe specimens tested in series in branches B and C (Figure 1) were separated from each other with chlorinated poly(vinyl chloride) spacers (Figure 4).

### 3. CORROSION RATE MEASUREMENTS

Classical corrosion studies on metallic pipes usually involved visual observation of the samples, weight loss measurements and, if pitting took place, measurements of the depth and density of pits. These techniques are not entirely satisfactory because visual observation gives only qualitative information on the extent and rate of corrosion.

Weight loss measurements and the measurement of pits are destructive in that the actual state of the sample is changed during cleaning of the sample; also only the amount of corrosion is determined, whereas the rate of corrosion may be more important. As the measured weight values are often scattered, a number of identical samples should be tested to check the reliability of the results (for example, 3 samples were tested in the

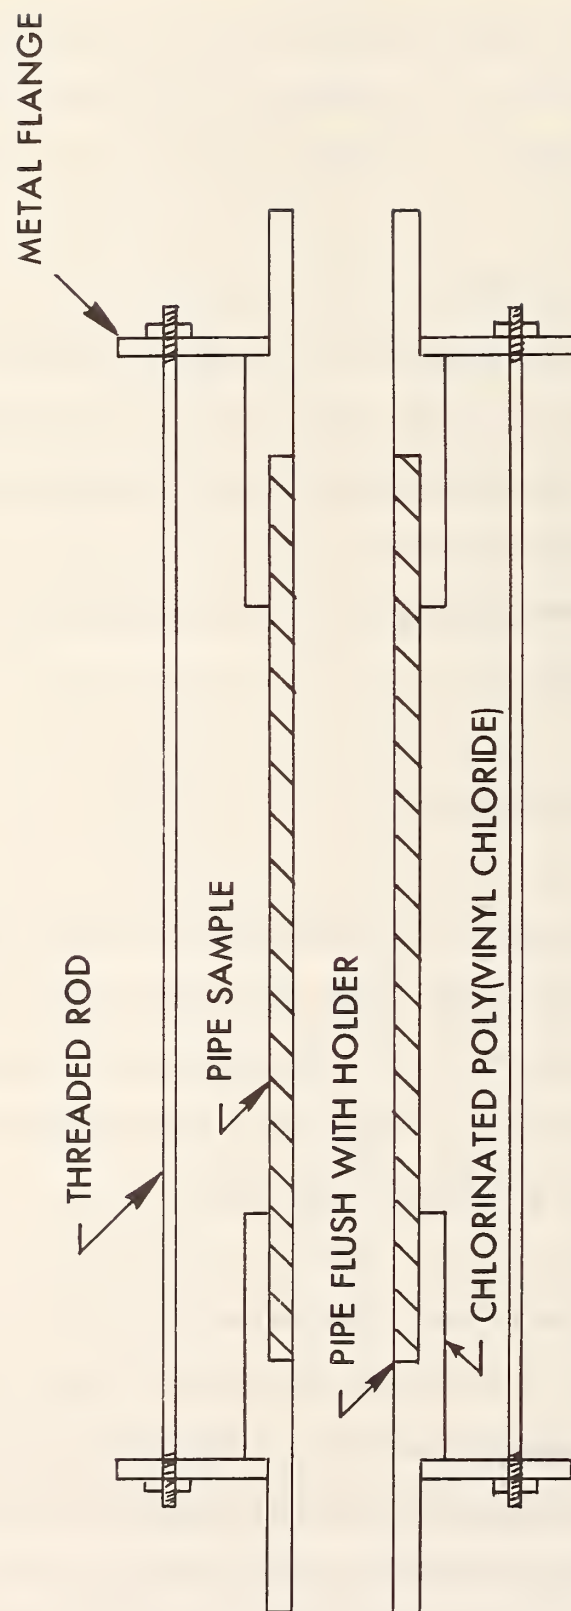


Figure 3. Connection System Developed to Prevent  
Crevice Corrosion

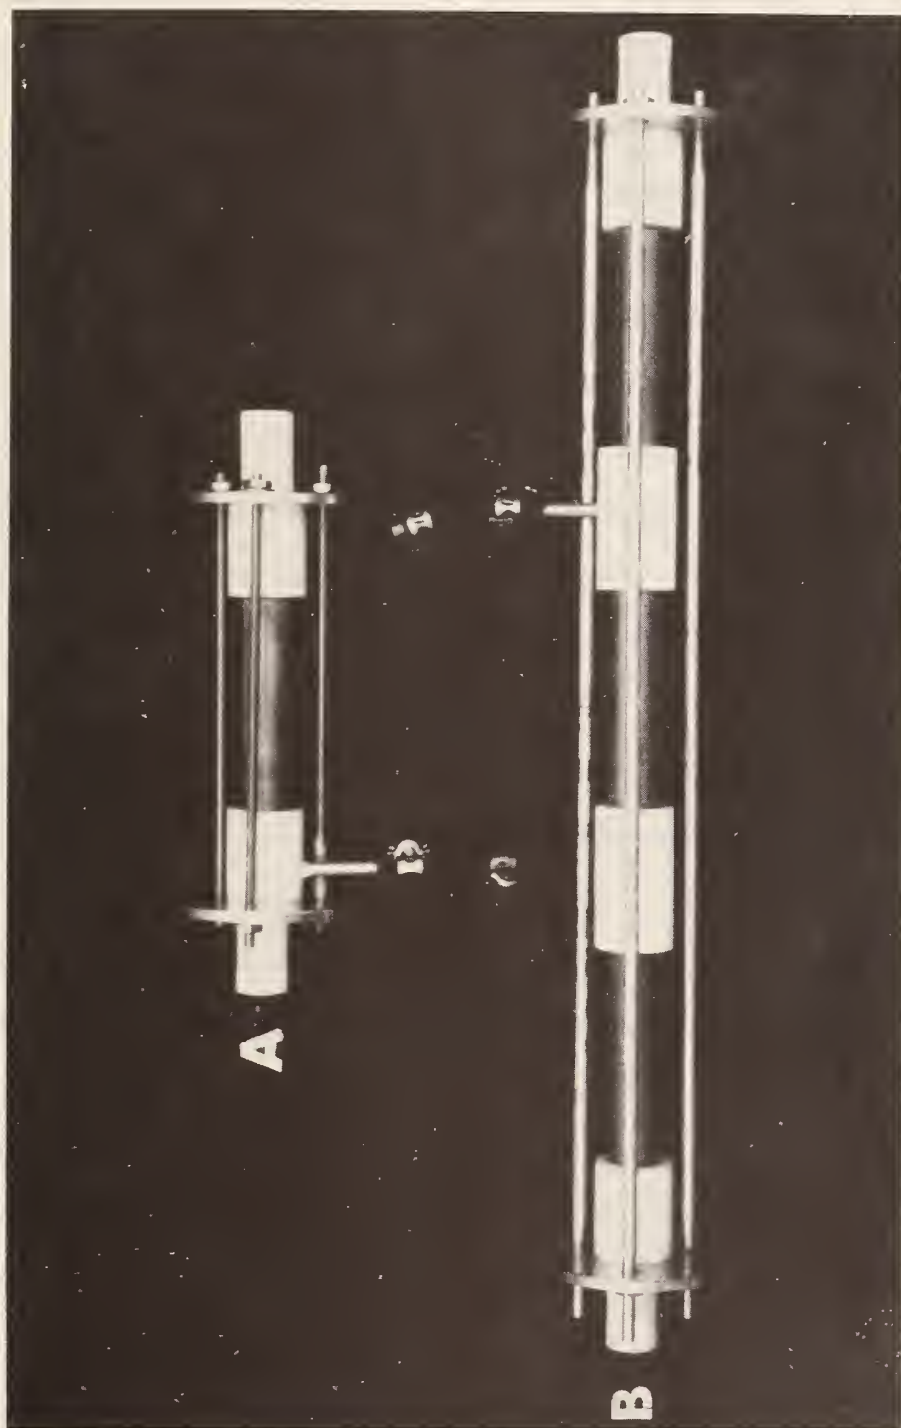


Figure 4. Pipe Specimen Holder Assemblies. A. Single Pipe Specimen.  
B. Three Pipe Specimens in Series Separated by Chlorinated  
Poly(Vinyl Chloride) Spacers.



present study). Considering the destructive character of the measurements and the necessity of using several samples for each measurement, the desirability of employing methods for the nondestructive, instantaneous measurements of the corrosion rate is understandable.

Several electrochemical techniques have been developed for nondestructive corrosion rate measurements. Of these methods, polarization resistance measurements [18, 19] appear to be most appropriate for measuring the corrosion of metallic pipe. It has been shown that under proper conditions the corrosion current,  $I_c$ , of a metal specimen in a solution is proportional to the applied voltage,  $\Delta V$ , usually 10 millivolts. The formula is:

$$I_c = \frac{K}{RP} = \frac{K \Delta I}{\Delta V} \quad (3)$$

where  $RP$  (polarization resistance) is the ratio  $\Delta V / \Delta I$  and  $K$  is a constant whose value depends on the specific metal.

A value of 35 volts was used for  $K$  when calculating  $I_c$  for zinc, iron and copper. This value was obtained by assuming a Tafel slope of 60 mv/decade, two electron oxidation processes, and that the cathodic reaction is diffusion controlled [4]. As the polarization resistance method involves only small changes of electrical potential from the open circuit corrosion potential, the actual corrosion state of the sample should not be seriously altered by the measurement. Therefore, measurements can be taken on samples in situ as many times as desired. The polarization resistance method is sensitive to small changes in the corrosion condition of metals and when coupled with weight loss measurements to check its validity, it is a very useful tool.

Open circuit corrosion potentials and polarization resistance measurements were taken after 1, 2, 3, 4, 6 and 8 weeks of testing. At the end of the test period, the test specimens were visually inspected, weighed, then cleaned and reweighed, and finally the cleaned surfaces were inspected for evidence of pitting. The early polarization resistance studies indicated the necessity of taking additional measurements at 1, 3, and 10 days because it was found that corrosion rate changes rapidly during the first two weeks of the test. Actual measured curves are shown in Figure 5 illustrating different corrosion rate behaviors. These curves indicate the importance of commencing the taking of corrosion measurements at early test periods and also that the duration of the testing is very important. Our first results, and those of other laboratories [6], indicate that a minimum time is required before the corrosion rate is stable. It appears that a reasonable period for short-term experiments would be at least 2 months. Under some conditions, a sufficiently stable rate may be realized in less than 2 months, but such processes as the formation of a protective scale are usually slow and may not form within a short test period.

When investigating a specific problem, long-term testing is usually feasible, but in a systematic testing program a reasonably short period must be selected based on some understanding of the corrosion processes taking place.

### 3.1 Weight Loss Measurements

Test specimens were cleaned and then weighed before being placed in the pipe network. After the experiment was completed the samples were

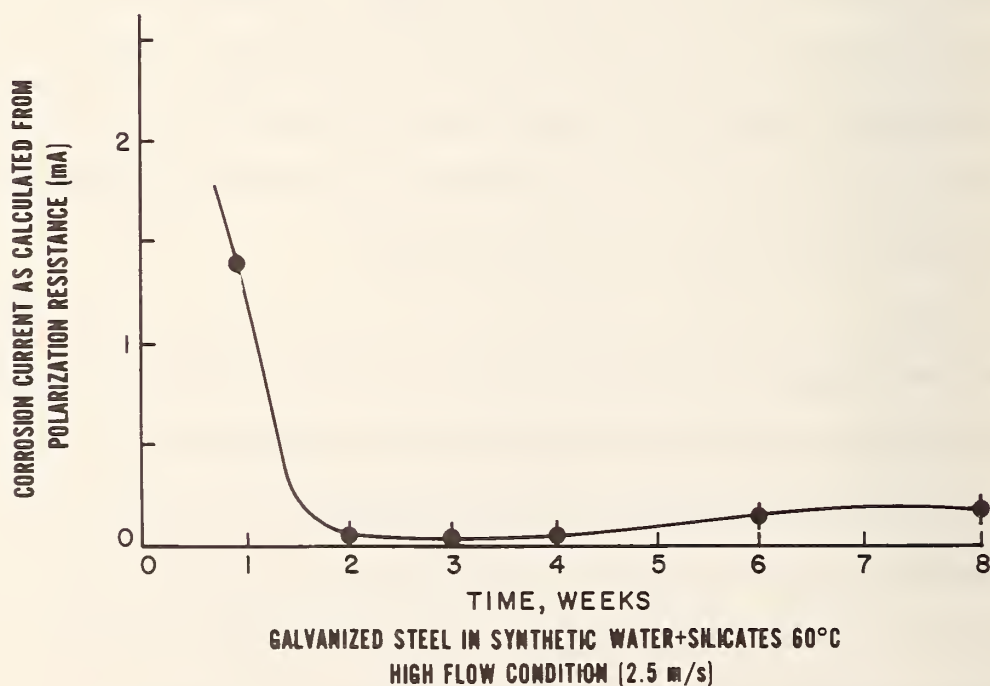
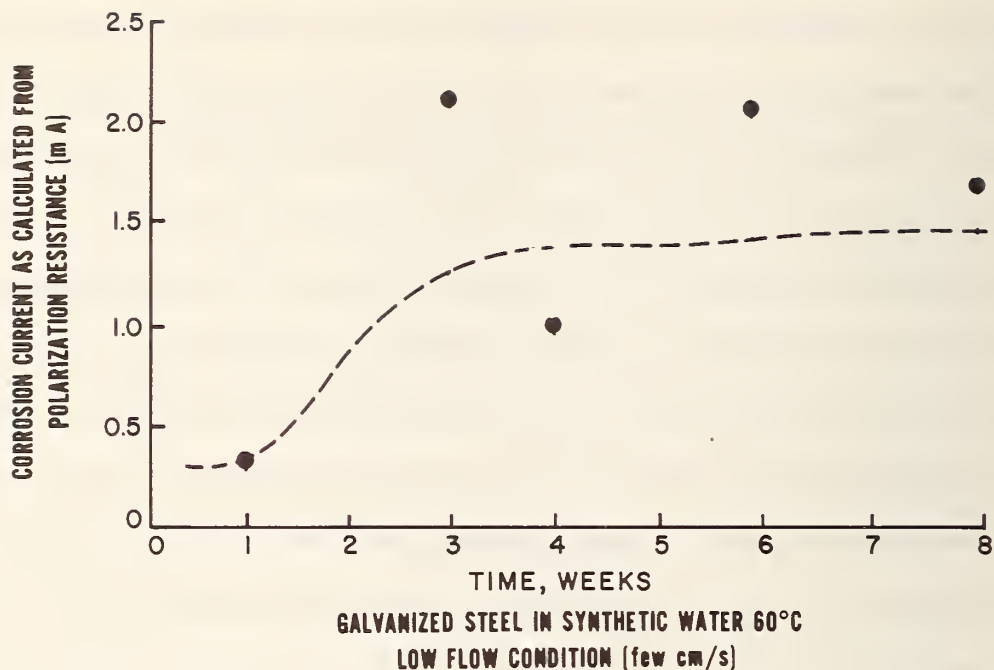


Figure 5. Different Corrosion Rate Behaviors Based on Actual Measurement. The Corrosion Rate Shown by Curve A was Initially Low then Rapidly Increased and did not Completely Stabilize even after 2 Months of Testing. The Initial High Corrosion Rate Shown by Curve B Rapidly Decreased then Gradually Increased.

cleaned again. The cleaning agent for copper was either concentrated hydrochloric acid or hydrofluoric acid. A preliminary test indicated that these cleaning agents did not produce any significant corrosion of copper (1 mg) when the immersion time was approximately 15 minutes. The cleaning of galvanized steel was accomplished with a saturated aqueous solution of ammonium acetate and a soft brush. A galvanized specimen lost up to 20 mg when subjected to the cleaning process for 15 minutes. Therefore, this cleaning method should be used only when, at least, medium corrosion rates are anticipated. It was suitable for our first experiment with galvanized steel, in which the measured weight losses were between 0.5 g and 2.5 g. Black steel test specimens were cleaned with Clarke solution (2 parts of  $\text{Sb}_2\text{O}_3$ , 5 parts of  $\text{SnCl}_2$ , and 100 parts of concentrated  $\text{HCl}$ , by weight). All the samples were dried with ethanol and weighed to within 0.5 mg.

### 3.2 Electrochemical Measurements

The circuit used for polarization resistance measurements is shown in the schematic of Figure 6. A saturated calomel electrode was used as the reference electrode and a stainless steel rod was the counter electrode. The geometry of the system used for making preliminary polarization resistance measurements with copper specimens is shown in Figure 7. Different results were obtained if made with counter electrode 1, counter electrode 2, or with sample 2 as the counter electrode (Figure 7A). There was more than a tenfold difference between the weight loss calculated from polarization resistance measurements and the actual measured weight losses. An investigation indicates that IR drop was influencing the polarization measurements.



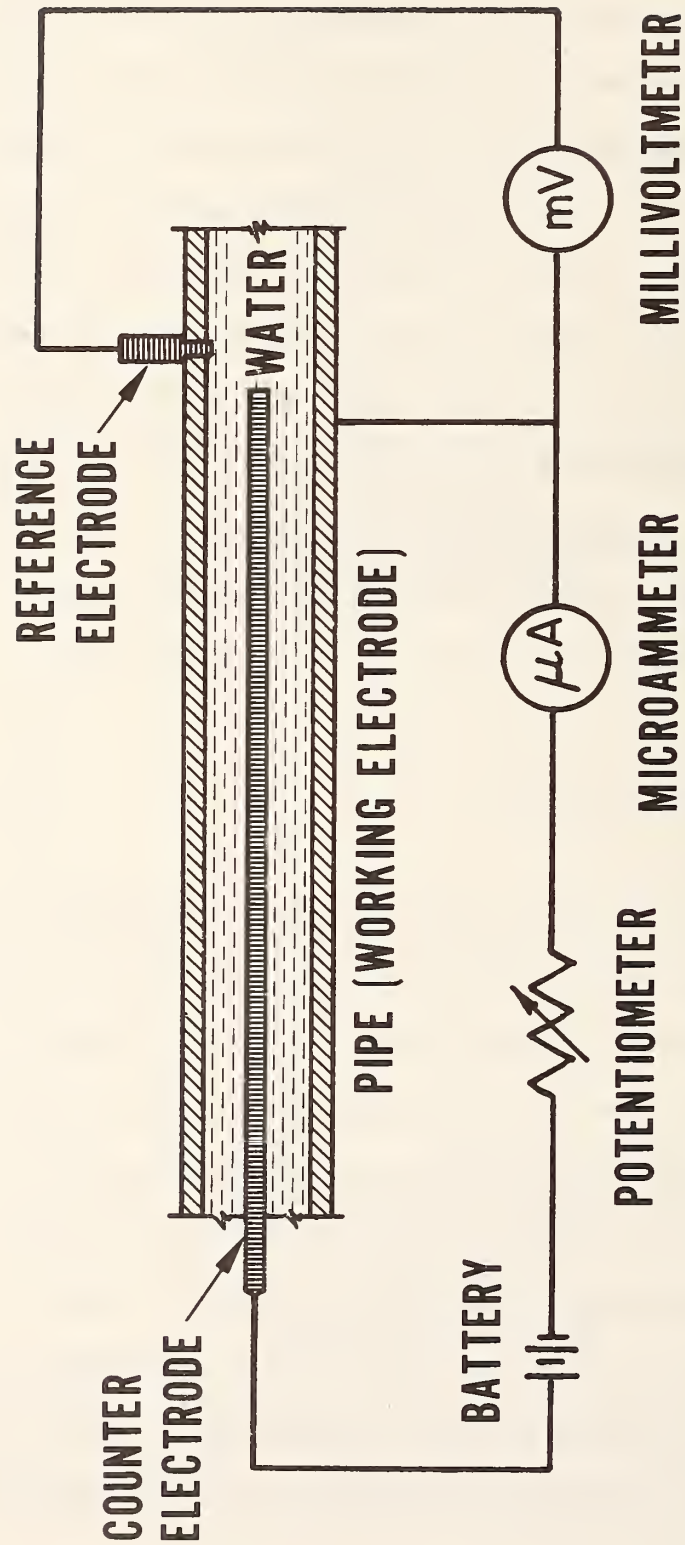


Figure 6. Schematic of Circuit for Making Polarization Resistance Measurements



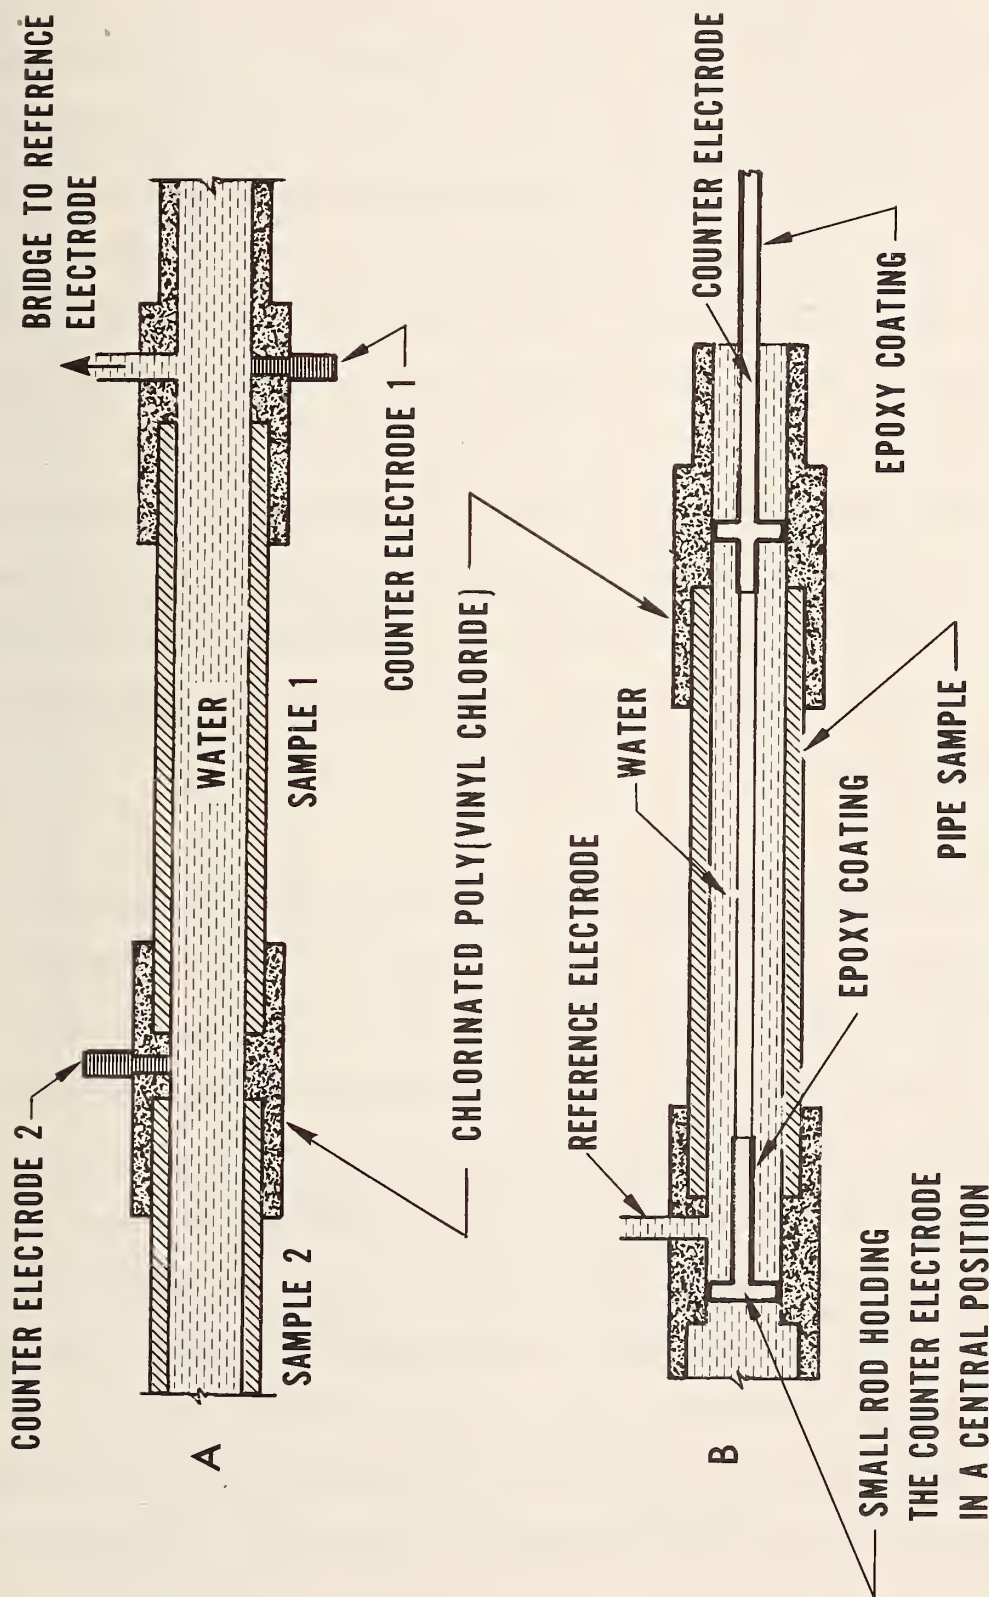


Figure 7. Schematic Indicating Location of Reference and Counter Electrodes. Position of Counter Electrodes in A gave Rise to High IR Drop. No Noticeable IR Drop was Detected with the Counter Electrode being Located as Shown in B.

Even with specimens as short as 10 cm, it appears that a homogeneous potential field was not induced by the applied current. In subsequent experiments, the system was modified. The counter electrode consisted of a cylindrical stainless steel rod, 3 mm diameter, placed along the axis of the specimen (Figure 7B). That portion of the counter electrode which extended beyond the specimen was covered with an epoxy coating. The reference electrode was positioned as near as possible to the edge of the sample. The calculated weight losses from polarization resistance measurement of galvanized steel and copper test specimens using this arrangement were within a factor of 2 of the measured weight losses (Table 1). These results are very encouraging considering the assumptions made in calculating weight losses based on polarization resistance measurements. It does appear, however, that a few weight loss measurements need to be made to calibrate the polarization resistance technique if it is to be used for quantitative measurements of the corrosion rate.

A few other difficulties were encountered during making the electrochemical measurements. One problem which is inherent in electrochemical measurements carried out in flowing hot water, is the instability of the open circuit corrosion potentials. Random fluctuations of sometimes more than 10 mV were observed. These fluctuations necessitated changing the electrical potential by more than 10 mV during polarization resistance measurements. This introduces an additional error in the determination of the corrosion current. When the open circuit potential was highly unstable, a potential change higher than the usual value of  $\pm 10$  mV was imposed; however, the potential change was kept as low as possible so that the conditions for valid polarization resistance measurements could be met. Measurement of

TABLE 1. COMPARISON BETWEEN CALCULATED AND MEASURED WEIGHT LOSSES

Composition of Test Water <sup>1/</sup>	Flow Rates (m/s)	Weight Loss Determined by Weighing Samples (g)	Weight Loss Calculated from Resistance Polarization Measurements (g)
Galvanized steel			
CaCO <sub>3</sub> , 80 ppm			
NaHCO <sub>3</sub> , 225 ppm	~0.07	1.68	2.7
NaCl, 60 ppm			
MgSO <sub>4</sub> ·7H <sub>2</sub> O, 20 ppm	0.46	0.46	0.3
pH, 6.0	2.7	1.40	0.6
10 ppm of sodium silicate added to above	~0.07	0.86	0.9
	0.46	0.47	0.3
	2.7	1.1	0.9
Copper			
CaCO <sub>3</sub> , 50 ppm			
NaHCO <sub>3</sub> , 225 ppm	~0.07	.119	.101
NaCl, 50 ppm			
MgSO <sub>4</sub> ·7H <sub>2</sub> O, 128 ppm	0.37 <sup>2/</sup>	.106	.178
pH, 7.5	1.5 <sup>2/</sup>	.140	.211
10 ppm of sodium silicate added to above	~0.07	.103	.124
	0.37	.100	.107
	1.5	.107	.114

<sup>1/</sup> Experimental temperature was 60°C, pH measured at 23°C.<sup>2/</sup> Inside surface of copper pipe was scaled with a continuous carbonate film.

potential changes were made when the potential was sufficiently stable, generally 10 to 60 seconds after the current was applied.

#### 4. SUMMARY AND CONCLUSIONS

The effects of the composition of water (characterized by pH, dissolved salts and dissolved gases), the flow rate of the water and a silicate inhibitor on the corrosion of galvanized and copper pipes have been investigated. The experimental test design and testing apparatus developed for this investigation provides a reasonable simulation of field conditions and contains considerable flexibility. The advantages of such laboratory testing are that selected variables can be studied in a relatively short test period and at modest cost. Certainly field use is the ultimate test; however, laboratory data are needed to develop performance criteria to form the basis of selecting durable materials for field use.

The polarization resistance technique gave satisfactory results in this preliminary study of the corrosion of metallic pipes transporting water. Furthermore, it appears that the polarization resistance technique is a useful tool which may be used in a variety of corrosion studies on pipe carried out in aqueous media [20, 21]. However, the results from polarization resistance measurements should be correlated with results from actual weight loss measurements and with visual inspection of test specimens for the detection of localized corrosion, especially pitting.

## 5. REFERENCES

1. G. Butler and H. Ison, Corrosion and Its Prevention in Water (Leonard Hills Books, London, 1966).
2. U. R. Evans, Corrosion and Oxidation of Metals: Scientific Principles and Practical Applications, pp. 87-131, 160-164, 205 (Edward Arnold Publishers Ltd., London, 1969).
3. H. H. Uhlig, Corrosion Handbook, pp. 496-506, 953-965 (John Wiley and Sons, Inc., New York, 1948).
4. H. H. Uhlig, Corrosion and Corrosion Control, 2nd ed. (John Wiley and Sons, Inc., New York, 1971).
5. M. F. Obrecht, M. Pourbaix, Corrosion of Metals in Potable Water Systems, J.A.W.W.A. 59, 977 (1967).
6. T. E. Larson, Corrosion by Domestic Waters, Illinois State Water Survey Bulletin 49 (Urbana, 1975).
7. NACE Basic Corrosion Course, Chapters 7, 8 (National Association of Corrosion Engineers, Houston, 1971).
8. W. F. Langelier, The Analytical Control of Anticorrosion Water Treatment, J.A.W.W.A. 28, 1500 (1936).



9. L. Legrand and G. Poirier, *Theorie des Eaux Naturelles* (Eyrulles, Paris, 1972).
10. H. Campbell, A Review: Pitting Corrosion of Copper and Its Alloys, pp. 625-635, in *Localized Corrosion* (National Association of Corrosion Engineers, Houston, 1974).
11. Second Corrosion Study of Pipe Exposed to Domestic Waters, National Association of Corrosion Engineers Report 7B170 (Houston, 1970).
12. J. N. Andre and M. Rubaud, *Utilisation des Phosphates Condenses dans la lutte Contre la Corrosion des Reseaux de Distribution d'eau en Immeubles*, Cahiers du Centre Scientifique du Batiment (Grenoble, France, November 1976).
13. T. E. Larson, *Corrosion Phenomena - Causes and Cures*, Chapter 8, *Water Quality Treatment*, 3rd ed., pp. 295-312 (McGraw-Hill Book Co., New York, 1971).
14. H. Rouse, *Elementary Mechanics of Fluids* (John Wiley and Sons, Inc., New York, 1964).
15. G. Butler and H. Ison, The Influence of Movement and Temperature on Corrosion of Mild Steel, Water Circulation Apparatus and Test in Teddington Water, *J. Appl. Chem.* 10, 80 (February, 1960).

16. G. Butler and E. G. Stoud, The Influence of Movement and Temperature on the Corrosion of Mild Steel, Part I, J. Appl. Chem. 10, p. 80 (1960); Part II, J. Appl. Chem. 15, p. 325 (1965); and Part III, Brit. J. Corros. I, p. 110 (1965).
17. A. J. Romeo, R. T. Surinde, and R. Eliassen, Proceedings of the American Society of Civil Engineers, Vol. 84, #SA4, July 1958, paper 1702.
18. M. Stern and A. L. Geary, Electrochemical Polarization, J. Electrochem. Soc. 104, 56 (1957).
19. M. Stern, A Method for Determining Corrosion Rates from Linear Polarization Data, Corrosion 14, 440t (1958).
20. M. Stern and E. D. Weisert, Experimental Observation on the Relation between Polarization Resistance and Corrosion Rate, Proc. Am. Soc. Testing Mater. Proc. 59, 1280 (1959).
21. T. E. Larson and R. V. Skold, Measurement of the Instantaneous Corrosion Rate by means of Polarization Data, Corrosion 13, 139 (1957).
22. R. W. Lane, C. H. Neff and S. W. Schilsky, Silicate Treatment to Inhibit Corrosion of Hot, Potable Water Systems, NTIS AD-767902.

U.S. DEPT. OF COMM. BIBLIOGRAPHIC DATA SHEET	1. PUBLICATION OR REPORT NO. NBS TN 974	2. Gov't Accession No.	3. Recipient's Accession No.
4. TITLE AND SUBTITLE  Corrosion of Metallic Pipes Transporting Potable Water-Laboratory Testing Methods		5. Publication Date  June 1978	
		6. Performing Organization Code	
7. AUTHOR(S) Jean N. Andre and James R. Clifton		8. Performing Organ. Report No.	
9. PERFORMING ORGANIZATION NAME AND ADDRESS  Centre Scientifique du Batiment National Bureau of Standards Paris, France Department of Commerce Washington, DC 20234		10. Project/Task/Work Unit No.	
		11. Contract/Grant No.	
12. Sponsoring Organization Name and Complete Address (Street, City, State, ZIP) Same as 9.		13. Type of Report & Period Covered  Final	
		14. Sponsoring Agency Code	
15. SUPPLEMENTARY NOTES			
<p>16. ABSTRACT (A 200-word or less factual summary of most significant information. If document includes a significant bibliography or literature survey, mention it here.)</p> <p>Many factors affect both the form of and the corrosion of pipes transporting potable water including the composition, temperature and flow rate of the water, type of metal and the physical condition of the pipe. A pipeline was constructed and experimental methods developed to determine the effects of the above factors on the corrosion of pipes. Components of the pipeline were carefully selected or designed to prevent the occurrence of extraneous corrosion.</p> <p>The rate of corrosion of galvanized steel and copper pipes were measured by direct weight losses measurements and by polarization resistance methods. It appears that the polarization resistance technique is a useful tool which may be used in a variety of corrosion studies of pipe in aqueous media.</p>			
<p>17. KEY WORDS (six to twelve entries; alphabetical order; capitalize only the first letter of the first key word unless a proper name; separated by semicolons)</p> <p>Copper pipe; corrosion; corrosion measurement; galvanized steel pipe; metal pipes; potable water; resistance polarization.</p>			
<p>18. AVAILABILITY <input checked="" type="checkbox"/> Unlimited</p> <p><input type="checkbox"/> For Official Distribution. Do Not Release to NTIS</p> <p><input checked="" type="checkbox"/> Order From Sup. of Doc., U.S. Government Printing Office Washington, D.C. 20402, <u>SD Stock No. 003-003-</u></p> <p><input type="checkbox"/> Order From National Technical Information Service (NTIS) Springfield, Virginia 22151</p>		<p>19. SECURITY CLASS (THIS REPORT)</p> <p>UNCLASSIFIED</p>	<p>21. NO. OF PAGES</p> <p>36</p>
		<p>20. SECURITY CLASS (THIS PAGE)</p> <p>UNCLASSIFIED</p>	<p>22. Price</p> <p>\$1.40</p>

There's  
a new  
look  
to...

# DIMENSIONS



... the monthly magazine of the National Bureau of Standards. Still featured are special articles of general interest on current topics such as consumer product safety and building technology. In addition, new sections are designed to . . . **PROVIDE SCIENTISTS** with illustrated discussions of recent technical developments and work in progress . . . **INFORM INDUSTRIAL MANAGERS** of technology transfer activities in Federal and private labs. . . **DESCRIBE TO MANUFACTURERS** advances in the field of voluntary and mandatory standards. The new DIMENSIONS/NBS also carries complete listings of upcoming conferences to be held at NBS and reports on all the latest NBS publications, with information on how to order. Finally, each issue carries a page of News Briefs, aimed at keeping scientist and consumer alike up to date on major developments at the Nation's physical sciences and measurement laboratory.

(please detach here)

## SUBSCRIPTION ORDER FORM

Enter my Subscription To DIMENSIONS/NBS at \$12.50. Add \$3.15 for foreign mailing. No additional postage is required for mailing within the United States or its possessions. Domestic remittances should be made either by postal money order, express money order, or check. Foreign remittances should be made either by international money order, draft on an American bank, or by UNESCO coupons.

☐ Remittance Enclosed  
(Make checks payable to Superintendent of Documents)

☐ Charge to my Deposit Account No.

### Send Subscription to:

NAME-FIRST, LAST																							
COMPANY NAME OR ADDITIONAL ADDRESS LINE																							
STREET ADDRESS																							
CITY												STATE				ZIP CODE							

PLEASE PRINT

**MAIL ORDER FORM TO:**  
Superintendent of Documents  
Government Printing Office  
Washington, D.C. 20402



# Waste Heat Management Guidebook



A typical plant can save about 20 percent of its fuel—just by installing waste heat recovery equipment. But with so much equipment on the market, how do you decide what's right for you?

Find the answers to your problems in the *Waste Heat Management Guidebook*, a new handbook from the Commerce Department's National Bureau of Standards and the Federal Energy Administration.

The *Waste Heat Management Guidebook* is designed to help you, the cost-conscious engineer or manager, learn how to capture and recycle heat that is normally lost to the environment during industrial and commercial processes.

The heart of the guidebook is 14 case studies of companies that have recently installed waste heat recovery systems and profited. One of these applications may be right for you, but even if it doesn't fit exactly, you'll find helpful approaches to solving many waste heat recovery problems.

In addition to case studies, the guidebook contains information on:

- sources and uses of waste heat
- determining waste heat requirements
- economics of waste heat recovery
- commercial options in waste heat recovery equipment
- instrumentation
- engineering data for waste heat recovery
- assistance for designing and installing waste heat systems

To order your copy of the *Waste Heat Management Guidebook*, send \$2.75 per copy (check or money order) to Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402. A discount of 25 percent is given on orders of 100 copies or more mailed to one address.

The *Waste Heat Management Guidebook* is part of the EPIC industrial energy management program aimed at helping industry and commerce adjust to the increased cost and shortage of energy.



# NBS TECHNICAL PUBLICATIONS

## PERIODICALS

**JOURNAL OF RESEARCH**—The Journal of Research of the National Bureau of Standards reports NBS research and development in those disciplines of the physical and engineering sciences in which the Bureau is active. These include physics, chemistry, engineering, mathematics, and computer sciences. Papers cover a broad range of subjects, with major emphasis on measurement methodology, and the basic technology underlying standardization. Also included from time to time are survey articles on topics closely related to the Bureau's technical and scientific programs. As a special service to subscribers each issue contains complete citations to all recent NBS publications in NBS and non-NBS media. Issued six times a year. Annual subscription: domestic \$17.00; foreign \$21.25. Single copy, \$3.00 domestic; \$3.75 foreign.

Note: The Journal was formerly published in two sections: Section A "Physics and Chemistry" and Section B "Mathematical Sciences."

### DIMENSIONS/NBS

This monthly magazine is published to inform scientists, engineers, businessmen, industry, teachers, students, and consumers of the latest advances in science and technology, with primary emphasis on the work at NBS. The magazine highlights and reviews such issues as energy research, fire protection, building technology, metric conversion, pollution abatement, health and safety, and consumer product performance. In addition, it reports the results of Bureau programs in measurement standards and techniques, properties of matter and materials, engineering standards and services, instrumentation, and automatic data processing.

Annual subscription: Domestic, \$12.50; Foreign \$15.65.

## NONPERIODICALS

**Monographs**—Major contributions to the technical literature on various subjects related to the Bureau's scientific and technical activities.

**Handbooks**—Recommended codes of engineering and industrial practice (including safety codes) developed in cooperation with interested industries, professional organizations, and regulatory bodies.

**Special Publications**—Include proceedings of conferences sponsored by NBS, NBS annual reports, and other special publications appropriate to this grouping such as wall charts, pocket cards, and bibliographies.

**Applied Mathematics Series**—Mathematical tables, manuals, and studies of special interest to physicists, engineers, chemists, biologists, mathematicians, computer programmers, and others engaged in scientific and technical work.

**National Standard Reference Data Series**—Provides quantitative data on the physical and chemical properties of materials, compiled from the world's literature and critically evaluated. Developed under a world-wide program coordinated by NBS. Program under authority of National Standard Data Act (Public Law 90-396).

NOTE: At present the principal publication outlet for these data is the Journal of Physical and Chemical Reference Data (JPCRD) published quarterly for NBS by the American Chemical Society (ACS) and the American Institute of Physics (AIP). Subscriptions, reprints, and supplements available from ACS, 1155 Sixteenth St. N.W., Wash., D.C. 20056.

**Building Science Series**—Disseminates technical information developed at the Bureau on building materials, components, systems, and whole structures. The series presents research results, test methods, and performance criteria related to the structural and environmental functions and the durability and safety characteristics of building elements and systems.

**Technical Notes**—Studies or reports which are complete in themselves but restrictive in their treatment of a subject. Analogous to monographs but not so comprehensive in scope or definitive in treatment of the subject area. Often serve as a vehicle for final reports of work performed at NBS under the sponsorship of other government agencies.

**Voluntary Product Standards**—Developed under procedures published by the Department of Commerce in Part 10, Title 15, of the Code of Federal Regulations. The purpose of the standards is to establish nationally recognized requirements for products, and to provide all concerned interests with a basis for common understanding of the characteristics of the products. NBS administers this program as a supplement to the activities of the private sector standardizing organizations.

**Consumer Information Series**—Practical information, based on NBS research and experience, covering areas of interest to the consumer. Easily understandable language and illustrations provide useful background knowledge for shopping in today's technological marketplace.

Order above NBS publications from: Superintendent of Documents, Government Printing Office, Washington, D.C. 20402.

Order following NBS publications—NBSIR's and FIPS from the National Technical Information Services, Springfield, Va. 22161.

**Federal Information Processing Standards Publications (FIPS PUB)**—Publications in this series collectively constitute the Federal Information Processing Standards Register. Register serves as the official source of information in the Federal Government regarding standards issued by NBS pursuant to the Federal Property and Administrative Services Act of 1949 as amended, Public Law 89-306 (79 Stat. 1127), and as implemented by Executive Order 11717 (38 FR 12315, dated May 11, 1973) and Part 6 of Title 15 CFR (Code of Federal Regulations).

**NBS Interagency Reports (NBSIR)**—A special series of interim or final reports on work performed by NBS for outside sponsors (both government and non-government). In general, initial distribution is handled by the sponsor; public distribution is by the National Technical Information Services (Springfield, Va. 22161) in paper copy or microfiche form.

## BIBLIOGRAPHIC SUBSCRIPTION SERVICES

The following current-awareness and literature-survey bibliographies are issued periodically by the Bureau:

**Cryogenic Data Center Current Awareness Service.** A literature survey issued biweekly. Annual subscription: Domestic, \$25.00; Foreign, \$30.00.

**Liquidified Natural Gas.** A literature survey issued quarterly. Annual subscription: \$20.00.

**Superconducting Devices and Materials.** A literature survey issued quarterly. Annual subscription: \$30.00. Send subscription orders and remittances for the preceding bibliographic services to National Bureau of Standards, Cryogenic Data Center (275.02) Boulder, Colorado 80302.

**U.S. DEPARTMENT OF COMMERCE**  
**National Bureau of Standards**  
Washington, D.C. 20234

OFFICIAL BUSINESS

Penalty for Private Use, \$300

POSTAGE AND FEES PAID  
U.S. DEPARTMENT OF COMMERCE  
COM-215



SPECIAL FOURTH-CLASS RATE  
BOOK

---