

June 2002

# EMF

Electric and Magnetic Fields  
Associated with the  
Use of Electric Power



Questions  
&  
Answers



prepared by the  
National Institute of Environmental Health Sciences  
National Institutes of Health

**EMF RAPID**  
Electric and Magnetic Fields Research and Public Information Dissemination Program

sponsored by the  
NIEHS/DOE EMF RAPID Program

---

# C Contents

|                                                                                                                                               |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------|-----------|
| <b>Introduction</b>                                                                                                                           | <b>2</b>  |
| <b>1 EMF Basics</b>                                                                                                                           | <b>4</b>  |
| Reviews basic terms about electric and magnetic fields.                                                                                       |           |
| <b>2 Evaluating Potential Health Effects</b>                                                                                                  | <b>10</b> |
| Explains how scientific studies are conducted and evaluated to assess possible health effects.                                                |           |
| <b>3 Results of EMF Research</b>                                                                                                              | <b>16</b> |
| Summarizes results of EMF-related research including epidemiological, clinical, and laboratory studies.                                       |           |
| <b>4 Your EMF Environment</b>                                                                                                                 | <b>28</b> |
| Discusses typical magnetic exposures in homes and workplaces and identifies common EMF sources.                                               |           |
| <b>5 EMF Exposure Standards</b>                                                                                                               | <b>46</b> |
| Describes standards and guidelines established by state, national, and international safety organizations for some EMF sources and exposures. |           |
| <b>6 National and International EMF Reviews</b>                                                                                               | <b>50</b> |
| Presents the findings and recommendations of major EMF research reviews including the EMF RAPID Program.                                      |           |
| <b>7 References</b>                                                                                                                           | <b>58</b> |
| Selected references on EMF topics.                                                                                                            |           |

---

# **I**ntroduction

Since the mid-twentieth century, electricity has been an essential part of our lives. Electricity powers our appliances, office equipment, and countless other devices that we use to make life safer, easier, and more interesting. Use of electric power is something we take for granted. However, some have wondered whether the electric and magnetic fields (EMF) produced through the generation, transmission, and use of electric power [power-frequency EMF, 50 or 60 hertz (Hz)] might adversely affect our health. Numerous research studies and scientific reviews have been conducted to address this question.

Unfortunately, initial studies of the health effects of EMF did not provide straightforward answers. The study of the possible health effects of EMF has been particularly complex and results have been reviewed by expert scientific panels in the United States and other countries. This booklet summarizes the results of these reviews. Although questions remain about the possibility of health effects related to EMF, recent reviews have substantially reduced the level of concern.

The largest evaluation to date was led by two U.S. government institutions, the National Institute of Environmental Health Sciences (NIEHS) of the National Institutes of Health and the Department of Energy (DOE), with input from a wide range of public and private agencies. This evaluation, known as the Electric and Magnetic Fields Research and Public Information Dissemination (EMF RAPID) Program, was a six-year project with the goal of providing scientific evidence to determine whether exposure to power-frequency EMF involves a potential risk to human health.

---

In 1999, at the conclusion of the EMF RAPID Program, the NIEHS reported to the U.S. Congress that the overall scientific evidence for human health risk from EMF exposure is weak. No consistent pattern of biological effects from exposure to EMF had emerged from laboratory studies with animals or with cells. However, epidemiological studies (studies of disease incidence in human populations) had shown a fairly consistent pattern that associated potential EMF exposure with a small increased risk for leukemia in children and chronic lymphocytic leukemia in adults. Since 1999, several other assessments have been completed that support an association between childhood leukemia and exposure to power-frequency EMF. These more recent reviews, however, do not support a link between EMF exposures and adult leukemias. For both childhood and adult leukemias, interpretation of the epidemiological findings has been difficult due to the absence of supporting laboratory evidence or a scientific explanation linking EMF exposures with leukemia.

EMF exposures are complex and exist in the home and workplace as a result of all types of electrical equipment and building wiring as well as a result of nearby power lines. This booklet explains the basic principles of electric and magnetic fields, provides an overview of the results of major research studies, and summarizes conclusions of the expert review panels to help you reach your own conclusions about EMF-related health concerns.


# 1

## EMF Basics

*This chapter reviews terms you need to know to have a basic understanding of electric and magnetic fields (EMF), compares EMF with other forms of electromagnetic energy, and briefly discusses how such fields may affect us.*

### Q What are electric and magnetic fields?

**A** Electric and magnetic fields (EMF) are invisible lines of force that surround any electrical device. Power lines, electrical wiring, and electrical equipment all produce EMF. There are many other sources of EMF as well (see pages 33–35). The focus of this booklet is on power-frequency EMF—that is, EMF associated with the generation, transmission, and use of electric power.

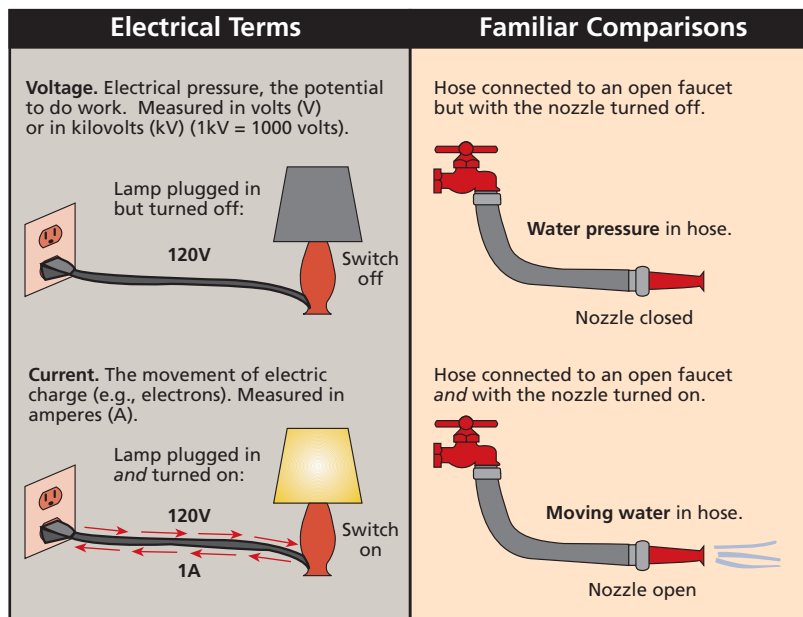

Voltage produces an electric field and current produces a magnetic field.

Electric fields are produced by voltage and increase in strength as the voltage increases. The electric field strength is measured in units of volts per meter (V/m). Magnetic fields result from the flow of current through wires or electrical devices and increase in strength as the current increases. Magnetic fields are measured in units of gauss (G) or tesla (T).



Most electrical equipment has to be turned on, i.e., current must be flowing, for a magnetic field to be produced. Electric fields are often present even when the equipment is switched off, as long as it remains connected to the source of electric power. Brief bursts

of EMF (sometimes called “transients”) can also occur when electrical devices are turned on or off.


Electric fields are shielded or weakened by materials that conduct electricity—even materials that conduct poorly, including trees, buildings, and human skin. Magnetic fields, however, pass through most materials and are therefore more difficult to shield. Both electric fields and magnetic fields decrease rapidly as the distance from the source increases.

Even though electrical equipment, appliances, and power lines produce both electric and magnetic fields, most recent research has focused on potential health effects of magnetic field exposure. This is because some epidemiological studies have reported an increased cancer risk associated with estimates of magnetic field exposure (see pages 19 and 20 for a summary of these studies). No similar associations have been reported for electric fields; many of the studies examining biological effects of electric fields were essentially negative.

### A Comparison of Electric and Magnetic Fields
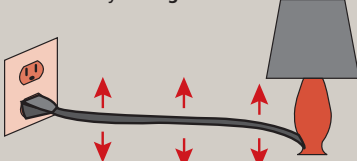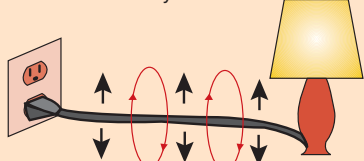
| Electric Fields                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            | Magnetic Fields                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <ul style="list-style-type: none"> <li>Produced by <b>voltage</b>.</li> </ul>  <p>Lamp plugged in but turned off. Voltage produces an electric field.</p> <ul style="list-style-type: none"> <li>Measured in <b>volts per meter (V/m)</b> or in <b>kilovolts per meter (kV/m)</b>.</li> <li><b>Easily shielded</b> (weakened) by conducting objects such as trees and buildings.</li> <li>Strength decreases rapidly with increasing distance from the source.</li> </ul> | <ul style="list-style-type: none"> <li>Produced by <b>current</b>.</li> </ul>  <p>Lamp plugged in and turned on. Current now produces a magnetic field also.</p> <ul style="list-style-type: none"> <li>Measured in <b>gauss (G)</b> or <b>tesla (T)</b>.</li> <li><b>Not easily shielded</b> (weakened) by most material.</li> <li>Strength decreases rapidly with increasing distance from the source.</li> </ul> |


An appliance that is plugged in and therefore connected to a source of electricity has an electric field even when the appliance is turned off. To produce a magnetic field, the appliance must be plugged in and turned on so that the current is flowing.

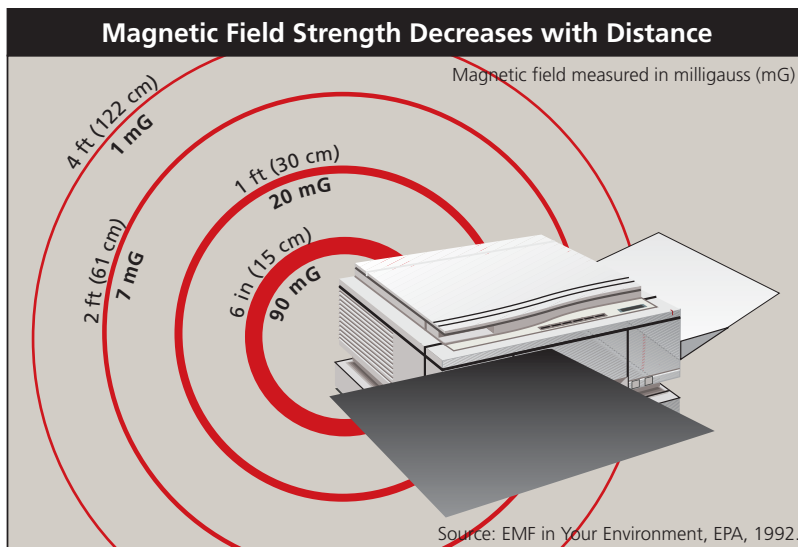

You cannot see a magnetic field, but this illustration represents how the strength of the magnetic field can diminish just 1–2 feet (30–61 centimeters) from the source. This magnetic field is a 60-Hz power-frequency field.

## Characteristics of electric and magnetic fields

Electric fields and magnetic fields can be characterized by their wavelength, frequency, and amplitude (strength). The graphic below shows the waveform of an alternating electric or magnetic field. The direction of the field alternates from one polarity to the opposite and back to the first polarity in a period of time called one cycle. Wavelength describes the distance between a peak on the wave and the next peak of the same polarity. The frequency of the field, measured in hertz (Hz), describes the number of cycles that occur in one second. Electricity in North America alternates through 60 cycles per second, or 60 Hz. In many other parts of the world, the frequency of electric power is 50 Hz.

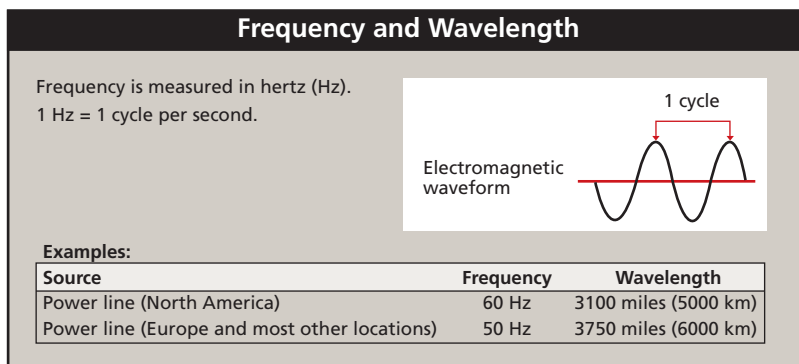

## Q How is the term EMF used in this booklet?

A The term “EMF” usually refers to electric and magnetic fields at extremely low frequencies such as those associated with the use of electric power. The term EMF can be used in a much broader sense as well, encompassing electromagnetic fields with low or high frequencies (see page 8).

### Measuring EMF: Common Terms

#### Electric fields

Electric field strength is measured in volts per meter (V/m) or in kilovolts per meter (kV/m). 1 kV = 1000 V

#### Magnetic fields

Magnetic fields are measured in units of gauss (G) or tesla (T). Gauss is the unit most commonly used in the United States. Tesla is the internationally accepted scientific term. 1 T = 10,000 G

Since most environmental EMF exposures involve magnetic fields that are only a fraction of a tesla or a gauss, these are commonly measured in units of microtesla ( $\mu$ T) or milligauss (mG). A milligauss is 1/1,000 of a gauss. A microtesla is 1/1,000,000 of a tesla. 1 G = 1,000 mG; 1 T = 1,000,000  $\mu$ T

To convert a measurement from microtesla ( $\mu$ T) to milligauss (mG), multiply by 10.

1  $\mu$ T = 10 mG; 0.1  $\mu$ T = 1 mG

---

When we use EMF in this booklet, we mean extremely low frequency (ELF) electric and magnetic fields, ranging from 3 to 3,000 Hz (see page 8). This range includes power-frequency (50 or 60 Hz) fields. In the ELF range, electric and magnetic fields are not coupled or interrelated in the same way that they are at higher frequencies. So, it is more useful to refer to them as “electric and magnetic fields” rather than “electromagnetic fields.” In the popular press, however, you will see both terms used, abbreviated as EMF.

This booklet focuses on extremely low frequency EMF, primarily power-frequency fields of 50 or 60 Hz, produced by the generation, transmission, and use of electricity.

## **Q How are power-frequency EMF different from other types of electromagnetic energy?**


**A** X-rays, visible light, microwaves, radio waves, and EMF are all forms of electromagnetic energy. One property that distinguishes different forms of electromagnetic energy is the frequency, expressed in hertz (Hz). Power-frequency EMF, 50 or 60 Hz, carries very little energy, has no ionizing effects, and usually has no thermal effects (see page 8). Just as various chemicals affect our bodies in different ways, various forms of electromagnetic energy can have very different biological effects (see “Results of EMF Research” on page 16).

Some types of equipment or operations simultaneously produce electromagnetic energy of different frequencies. Welding operations, for example, can produce electromagnetic energy in the ultraviolet, visible, infrared, and radio-frequency ranges, in addition to power-frequency EMF. Microwave ovens produce 60-Hz fields of several hundred milligauss, but they also create microwave energy inside the oven that is at a much higher frequency (about 2.45 billion Hz). We are shielded from the higher frequency fields inside the oven by its casing, but we are not shielded from the 60-Hz fields.

Cellular telephones communicate by emitting high-frequency electric and magnetic fields similar to those used for radio and television broadcasts. These radio-frequency and microwave fields are quite different from the extremely low frequency EMF produced by power lines and most appliances.

## **Q How are alternating current sources of EMF different from direct current sources?**

**A** Some equipment can run on either alternating current (AC) or direct current (DC). In most parts of the United States, if the equipment is plugged into a household wall socket, it is using AC electric current that reverses direction in the electrical wiring—or alternates—60 times per second, or at 60 hertz (Hz). If the equipment uses batteries, then electric current flows in one direction only. This

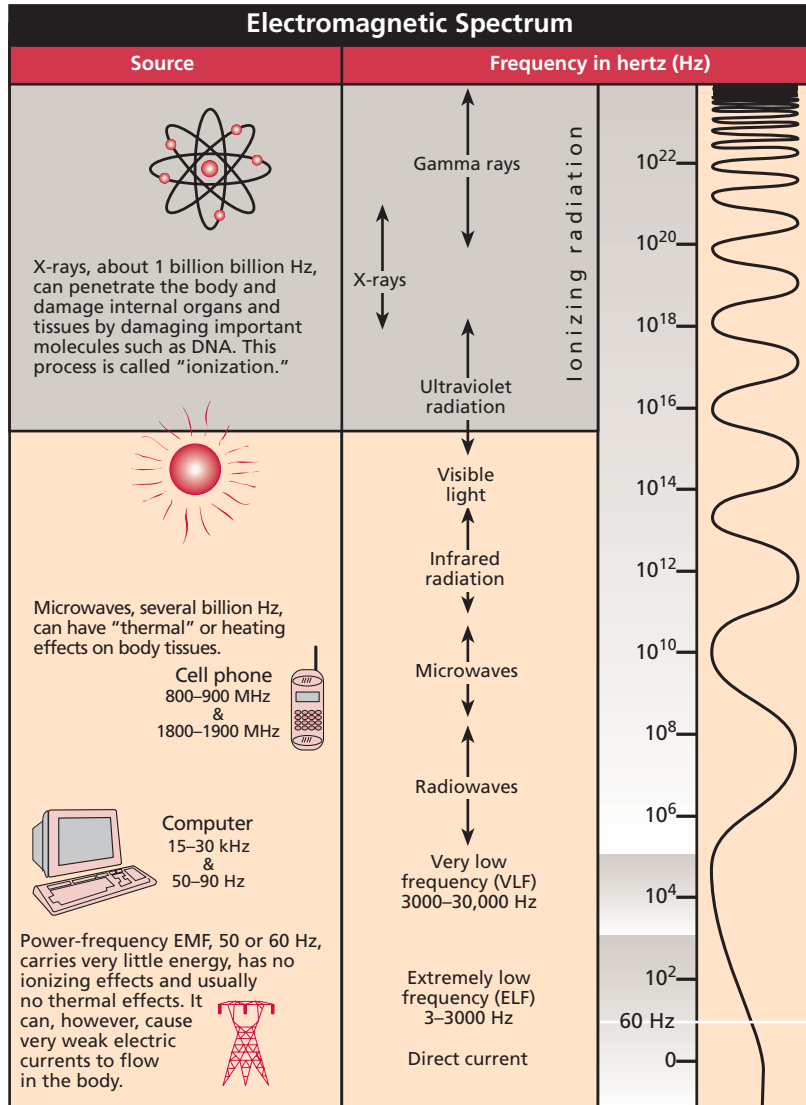

The wavy line at the right illustrates the concept that the higher the frequency, the more rapidly the field varies. The fields do not vary at 0 Hz (direct current) and vary trillions of times per second near the top of the spectrum. Note that  $10^4$  means  $10 \times 10 \times 10 \times 10$  or 10,000 Hz. 1 kilohertz (kHz) = 1,000 Hz. 1 megahertz (MHz) = 1,000,000 Hz.

---

produces a “static” or stationary magnetic field, also called a direct current field. Some battery-operated equipment can produce time-varying magnetic fields as part of its normal operation.

## **Q What happens when I am exposed to EMF?**

**A** In most practical situations, DC electric power does not induce electric currents in humans. Strong DC magnetic fields are present in some industrial environments, can induce significant currents when a person moves, and may be of concern for other reasons, such as potential effects on implanted medical devices (see page 47 for more information on pacemakers and other medical devices).

AC electric power produces electric and magnetic fields that create weak electric currents in humans. These are called “induced currents.” Much of the research on how EMF may affect human health has focused on AC-induced currents.

### **Electric fields**

A person standing directly under a high-voltage transmission line may feel a mild shock when touching something that conducts electricity. These sensations are caused by the strong electric fields from the high-voltage electricity in the lines. They occur only at close range because the electric fields rapidly become weaker as the distance from the line increases. Electric fields may be shielded and further weakened by buildings, trees, and other objects that conduct electricity.

### **Magnetic fields**

Alternating magnetic fields produced by AC electricity can induce the flow of weak electric currents in the body. However, such currents are estimated to be smaller than the measured electric currents produced naturally by the brain, nerves, and heart.

## **Q Doesn't the earth produce EMF?**

**A** Yes. The earth produces EMF, mainly in the form of static fields, similar to the fields generated by DC electricity. Electric fields are produced by air turbulence and other atmospheric activity. The earth's magnetic field of about 500 mG is thought to be produced by electric currents flowing deep within the earth's core. Because these fields are static rather than alternating, they do not induce currents in stationary objects as do fields associated with alternating current. Such static fields can induce currents in moving and rotating objects.


# 2

## Evaluating Potential Health Effects

*This chapter explains how scientific studies are conducted and evaluated to assess potential health effects.*

### **Q** How do we evaluate whether EMF exposures cause health effects?

**A** Animal experiments, laboratory studies of cells, clinical studies, computer simulations, and human population (epidemiological) studies all provide valuable information. When evaluating evidence that certain exposures cause disease, scientists consider results from studies in various disciplines. No single study or type of study is definitive.

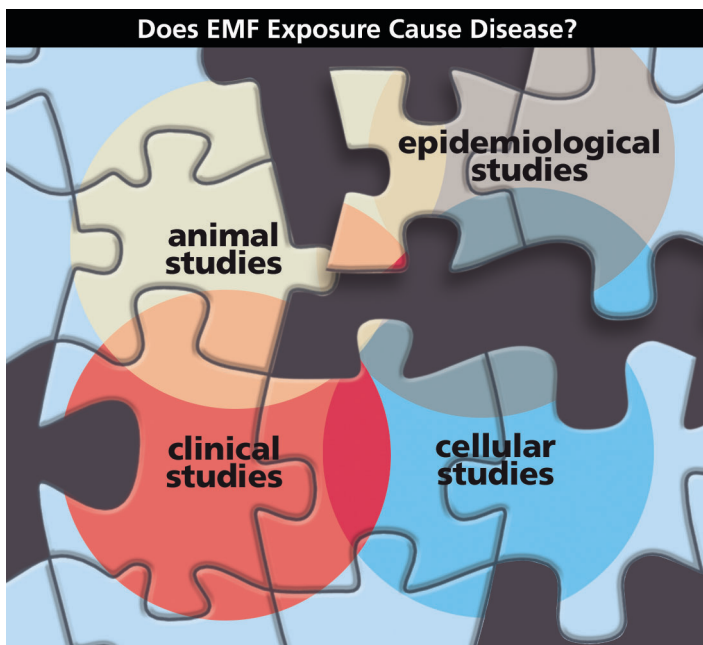

Laboratory studies and human studies provide pieces of the puzzle, but no single study can give us the whole picture.

### **Laboratory studies**

Laboratory studies with cells and animals can provide evidence to help determine if an agent such as EMF causes disease. Cellular studies can increase our understanding of the biological mechanisms by which disease occurs. Experiments with animals provide a means to observe effects of specific agents under carefully controlled conditions. Neither cellular nor animal studies, however, can recreate the complex nature of the whole human organism and its environment. Therefore, we must use caution in applying the results of cellular or animal studies directly to humans or concluding that a lack of an effect in laboratory studies proves that an agent is safe. Even with these limitations, cellular and animal studies have proven very

useful over the years for identifying and understanding the toxicity of numerous chemicals and physical agents.

Very specific laboratory conditions are needed for researchers to be able to detect EMF effects, and experimental exposures are not easily comparable to human exposures. In most cases, it is not clear how EMF actually produces the effects observed in some experiments. Without understanding how the effects occur, it is difficult to evaluate how laboratory results relate to human health effects.

Some laboratory studies have reported that EMF exposure can produce biological effects, including changes in functions of cells and tissues and subtle changes in hormone levels in animals. It is important to distinguish between a biological effect and a health effect. Many biological effects are within the normal range of variation and are not necessarily harmful. For example, bright light has a biological effect on our eyes, causing the pupils to constrict, which is a normal response.

## Clinical studies

In clinical studies, researchers use sensitive instruments to monitor human physiology during controlled exposure to environmental agents. In EMF studies, volunteers are exposed to electric or magnetic fields at higher levels than those commonly encountered in everyday life. Researchers measure heart rate, brain activity, hormonal levels, and other factors in exposed and unexposed groups to look for differences resulting from EMF exposure.

## Epidemiology

A valuable tool to identify human health risks is to study a human population that has experienced the exposure. This type of research is called epidemiology.

The epidemiologist observes and compares groups of people who have had or have not had certain diseases and exposures to see if the risk of disease is different between the exposed and unexposed groups. The epidemiologist does not control the exposure and cannot experimentally control all the factors that might affect the risk of disease.



Most researchers agree that epidemiology—the study of patterns and possible causes of diseases—is one of the most valuable tools to identify human health risks.

---

## **Q How do we evaluate the results of epidemiological studies of EMF?**

**A** Many factors need to be considered when determining whether an agent causes disease. An exposure that an epidemiological study associates with increased risk of a certain disease is not always the actual cause of the disease. To judge whether an agent actually causes a health effect, several issues are considered.

### **Strength of association**

The stronger the association between an exposure and disease, the more confident we can be that the disease is due to the exposure being studied. With cigarette smoking and lung cancer, the association is very strong—20 times the normal risk. In the studies that suggest a relationship between EMF and certain rare cancers, the association is much weaker (see page 19).

### **Dose-response**

Epidemiological data are more convincing if disease rates increase as exposure levels increase. Such dose-response relationships have appeared in only a few EMF studies.

### **Consistency**

Consistency requires that an association found in one study appears in other studies involving different study populations and methods. Associations found consistently are more likely to be causal. With regard to EMF, results from different studies sometimes disagree in important ways, such as what type of cancer is associated with EMF exposure. Because of this inconsistency, scientists cannot be sure whether the increased risks are due to EMF or other factors.

### **Biological plausibility**

When associations are weak in an epidemiological study, results of laboratory studies are even more important to support the association. Many scientists remain skeptical about an association between EMF exposure and cancer because laboratory studies thus far have not shown any consistent evidence of adverse health effects, nor have results of experimental studies revealed a plausible biological explanation for such an association.

### **Reliability of exposure information**

Another important consideration with EMF epidemiological studies is how the exposure information was obtained. Did the researchers simply estimate people's EMF exposures based on their job titles or how their houses were wired, or did they actually conduct EMF measurements? What did they measure (electric fields, magnetic fields, or both)? How often were the EMF measurements made and at

---

what time? In how many different places were the fields measured? More recent studies have included measurements of magnetic field exposure. Magnetic fields measured at the time a study is conducted can only estimate exposures that occurred in previous years (at the time a disease process may have begun). Lack of comprehensive exposure information makes it more difficult to interpret the results of a study, particularly considering that everyone in the industrialized world has been exposed to EMF.

## **Confounding**

Epidemiological studies show relationships or correlations between disease and other factors such as diet, environmental conditions, and heredity. When a disease is correlated with some factor, it does not necessarily mean that the correlated factor causes the disease. It could mean that the factor occurs together with some other factor, not measured in the study, that actually causes the disease. This is called confounding.

For example, a study might show that alcohol consumption is correlated with lung cancer. This could occur if the study group consists of people who drink and also smoke tobacco, as often happens. In this example, alcohol use is correlated with lung cancer, but cigarette smoking is a confounding factor and the true cause of the disease.

## **Statistical significance**

Researchers use statistical methods to determine the likelihood that the association between exposure and disease is due simply to chance. For a result to be considered “statistically significant,” the association must be stronger than would be expected to occur by chance alone.

## **Meta-analysis**

One way researchers try to get more information from epidemiological studies is to conduct a meta-analysis. A meta-analysis combines the summary statistics of many studies to explore their differences and, if appropriate, calculates an overall summary risk estimate. The main challenge faced by researchers performing meta-analyses is that populations, measurements, evaluation techniques, participation rates, and potential confounding factors vary in the original studies. These differences in the studies make it difficult to combine the results in a meaningful way.

## **Pooled analysis**

Pooled analysis combines the original data from several studies and conducts a new analysis on the primary data. It requires access to the original data from individual studies and can only include diseases or factors included in all the studies, but it has the advantage that the same parameters can be applied to all studies. As with meta-analysis, pooled analysis is still subject to the limitations of the experimental

design of the original studies (for example, evaluation techniques, participation rates, etc.). Pooled analysis differs from meta-analysis, which combines the summary statistics from different studies, not their original data.

## **Q How do we characterize EMF exposure?**

**A** No one knows which aspect of EMF exposure, if any, affects human health. Because of this uncertainty, in addition to the field strength, we must ask how long an exposure lasts, how it varies, and at what time of day or night it occurs. House wiring, for example, is often a significant source of EMF exposure for an individual, but the magnetic fields produced by the wiring depend on the amount of current flowing. As heating, lighting, and appliance use varies during the day, magnetic field exposure will also vary.

For many studies, researchers describe EMF exposures by estimating the average field strength. Some scientists believe that average exposure may not be the best measurement of EMF exposure and that other parameters, such as peak exposure or time of exposure, may be important.

## **Q What is the average field strength?**

**A** In EMF studies, the information reported most often has been a person's EMF exposure averaged over time (average field strength). With cancer-causing chemicals, a person's average exposure over many years can be a good way to predict his or her chances of getting the disease.

There are different ways to calculate average magnetic field exposures. One method involves having a person wear a small monitor that takes many measurements over a work shift, a day, or longer. Then the average of those measurements is calculated. Another method involves placing a monitor that takes many measurements in a residence over a 24-hour or 48-hour period. Sometimes averages are calculated for people with the same occupation, people working in similar environments, or people using several brands of the same type or similar types of equipment.

## **Q How is EMF exposure measured in epidemiological studies?**

**A** Epidemiologists study patterns and possible causes of diseases in human populations. These studies are usually observational rather than experimental.

This means that the researcher observes and compares groups of people who have had certain diseases and exposures and looks for possible "associations." The epidemiologist must find a way to estimate the exposure that people had at an earlier time.

### **Association**

In epidemiology, a positive association between an exposure (such as EMF) and a disease is not necessarily proof that the exposure *caused* the disease. However, the more often the exposure and disease occur together, the stronger the association, and the stronger is the possibility that the exposure may increase the risk of the disease.

Some exposure estimates for residential studies have been based on designation of households in terms of “wire codes.” In other studies, measurements have been made in homes, assuming that EMF levels at the time of the measurement are similar to levels at some time in the past. Some studies involved “spot measurements.” Exposure levels change as a person moves around in his or her environment, so spot measurements taken at specific locations only approximate the complex variations in exposure a person experiences. Other studies measured magnetic fields over a 24-hour or 48-hour period. Exposure levels for some occupational studies are measured by having certain employees wear personal monitors. The data taken from these monitors are sometimes used to estimate typical exposure levels for employees with certain job titles. Researchers can then estimate exposures using only an employee’s job title and avoid measuring exposures of all employees.

## **Methods to Estimate EMF Exposure**

### **Wire Codes**

A classification of homes based on characteristics of power lines outside the home (thickness of the wires, wire configuration, etc.) and their distance from the home. This information is used to code the homes into groups with higher and lower predicted magnetic field levels.

### **Spot Measurement**

An instantaneous or very short-term (e.g., 30-second) measurement taken at a designated location.

### **Time-Weighted Average**

A weighted average of exposure measurements taken over a period of time that takes into account the time interval between measurements. When the measurements are taken with a monitor at a fixed sampling rate, the time-weighted average equals the arithmetic mean of the measurements.

### **Personal Monitor**

An instrument that can be worn on the body for measuring exposure over time.

### **Calculated Historical Fields**

An estimate based on a theoretical calculation of the magnetic field emitted by power lines using historical electrical loads on those lines.

# 3

## Results of EMF Research

*This chapter summarizes the results of EMF research worldwide, including epidemiological studies of children and adults, clinical studies of how humans react to typical EMF exposures, and laboratory research with animals and cells.*

### **Q** Is there a link between EMF exposure and childhood leukemia?

**A** Despite more than two decades of research to determine whether elevated EMF exposure, principally to magnetic fields, is related to an increased risk of childhood leukemia, there is still no definitive answer. Much progress has been made, however, with some lines of research leading to reasonably clear answers and others remaining unresolved. The best available evidence at this time leads to the following answers to specific questions about the link between EMF exposure and childhood leukemia:

*Is there an association between power line configurations (wire codes) and childhood leukemia? No.*

*Is there an association between measured fields and childhood leukemia? Yes, but the association is weak, and it is not clear whether it represents a cause-and-effect relationship.*

### **Q** What is the epidemiological evidence for evaluating a link between EMF exposure and childhood leukemia?

**A** The initial studies, starting with the pioneering research of Dr. Nancy Wertheimer and Ed Leeper in 1979 in Denver, Colorado, focused on power line configurations near homes. Power lines were systematically evaluated and coded for their presumed ability to produce elevated magnetic fields in homes and classified into groups with higher and lower predicted magnetic field levels (see discussion of wire codes on page 15). Although the first study and two that followed in Denver and Los Angeles showed an association between wire codes indicative of elevated magnetic fields and childhood leukemia, larger, more recent studies in the central part of the United States and in several provinces of Canada did not find such an

association. In fact, combining the evidence from all the studies, we can conclude with some confidence that wire codes are not associated with a measurable increase in the risk of childhood leukemia.

The other approach to assessing EMF exposure in homes focused on the measurements of magnetic fields. Unlike wire codes, which are only applicable in North America due to the nature of the electric power distribution system, measured fields have been studied in relation to childhood leukemia in research conducted around the world, including Sweden, England, Germany, New Zealand, and Taiwan. Large, detailed studies have recently been completed in the United States, Canada, and the United Kingdom that provide the most evidence for making an evaluation. These studies have produced variable findings, some reporting small associations, others finding no associations.

After reviewing all the data, the U.S. National Institute of Environmental Health Sciences (NIEHS) concluded in 1999 that the evidence was weak, but that it was still sufficient to warrant limited concern. The NIEHS rationale was that no individual epidemiological study provided convincing evidence linking magnetic field exposure with childhood leukemia, but the overall pattern of results for some methods of measuring exposure suggested a weak association between increasing exposure to EMF and increasing risk of childhood leukemia. The small number of cases in these studies made it impossible to firmly demonstrate this association. However, the fact that similar results had been observed in studies of different populations using a variety of study designs supported this observation.

A major challenge has been to determine whether the most highly elevated, but rarely encountered, levels of magnetic fields are associated with an increased risk of leukemia. Early reports focused on the risk associated with exposures above 2 or 3 milligauss, but the more recent studies have been large enough to also provide some information on levels above 3 or 4 milligauss. It is estimated that 4.5% of homes in the United States have magnetic fields above 3 milligauss, and 2.5% of homes have levels above 4 milligauss.

### **National Cancer Institute Study**

In 1997, after eight years of work, Dr. Martha Linet and colleagues at the National Cancer Institute (NCI) reported the results of their study of childhood acute lymphoblastic leukemia (ALL). The case-control study involved more than 1,000 children living in 9 eastern and midwestern U.S. states and is the largest epidemiological study of childhood leukemia to date in the United States. To help resolve the question of wire code versus measured magnetic fields, the NCI researchers carried out both types of exposure assessment. Overall, Linet reported little evidence that living in homes with higher measured magnetic-field levels was a disease risk and found no evidence that living in a home with a high wire code configuration increased the risk of ALL in children.

### **United Kingdom Childhood Cancer Study**

In December 1999, Sir Richard Doll and colleagues in the United Kingdom announced that the largest study of childhood cancer ever undertaken—involving nearly 4,000 children with cancer in England, Wales, and Scotland—found no evidence of excess risk of childhood leukemia or other cancers from exposure to power-frequency magnetic fields. It should be noted, however, that because most power lines in the United Kingdom are underground, the EMF exposures of these children were mostly lower than 0.2 microtesla or 2 milligauss.

## What is Cancer?

### Cancer

"Cancer" is a term used to describe at least 200 different diseases, all involving uncontrolled cell growth. The frequency of cancer is measured by the incidence—the number of new cases diagnosed each year. Incidence is usually described as the number of new cases diagnosed per 100,000 people per year.

The incidence of cancer in adults in the United States is 382 per 100,000 per year, and childhood cancers account for about 1% of all cancers. The factors that influence risk differ among the forms of cancer. Known risk factors such as smoking, diet, and alcohol contribute to specific types of cancer. (For example, smoking is a known risk factor for lung cancer, bladder cancer, and oral cancer.) For many other cancers, the causes are unknown.

### Leukemia

Leukemia describes a variety of cancers that arise in the bone marrow where blood cells are formed. The leukemias represent less than 4% of all cancer cases in adults but are the most common form of cancer in children. For children age 4 and under, the incidence of childhood leukemia is approximately 6 per 100,000 per year, and it decreases with age to about 2 per 100,000 per year for children 10 and older. In the United States, the incidence of adult leukemia is about 10 cases per 100,000 people per year. Little is known about what causes leukemia, although genetic factors play a role. The only known causes are ionizing radiation, benzene, and other chemicals and drugs that suppress bone marrow function, and a human T-cell leukemia virus.

### Brain Cancer

Cancer of the central nervous system (the brain and spinal cord) is uncommon, with incidence in the United States now at about 6 cases in 100,000 people per year. The causes of the disease are largely unknown, although a number of studies have reported an association with certain occupational chemical exposures. Ionizing radiation to the scalp is a known risk factor for brain cancer. Factors associated with an increased risk for other types of cancer—such as smoking, diet, and excessive alcohol use—have not been found to be associated with brain cancer.

To determine what the integrated information from all the studies says about magnetic fields and childhood leukemia, two groups have conducted pooled analyses in which the original data from relevant studies were integrated and analyzed. One report (Greenland et al., 2000) combined 12 relevant studies with magnetic field measurements, and the other considered 9 such studies (Ahlbom et al., 2000). The details of the two pooled analyses are different, but their findings are similar. There is weak evidence for an association (relative risk of approximately 2) at exposures above 3 mG. However, few individuals had high exposures in these studies; therefore, even combining all studies, there is uncertainty about the strength of the association.

The following table summarizes the results for the epidemiological studies of EMF exposure and childhood leukemia analyzed in the pooled analysis by Greenland et al. (2000). The focus of the summary review was the magnetic fields that occurred three months prior to diagnosis. The results were derived from either calculated historical fields or multiple measurements of magnetic fields. The North American

## Residential Exposure to Magnetic Fields and Childhood Leukemia

| First author     | Magnetic field category (mG) |            |             |            |             |            |
|------------------|------------------------------|------------|-------------|------------|-------------|------------|
|                  | >1 – ≤2 mG                   |            | >2 – ≤3 mG  |            | >3 mG       |            |
|                  | Estimate                     | 95% CL     | Estimate    | 95% CL     | Estimate    | 95% CL     |
| Coghill          | 0.54                         | 0.17, 1.74 | No controls |            | No controls |            |
| Dockerty         | 0.65                         | 0.26, 1.63 | 2.83        | 0.29, 27.9 | No controls |            |
| Feychting        | 0.63                         | 0.08, 4.77 | 0.90        | 0.12, 7.00 | 4.44        | 1.67, 11.7 |
| Linnet           | 1.07                         | 0.82, 1.39 | 1.01        | 0.64, 1.59 | 1.51        | 0.92, 2.49 |
| London           | 0.96                         | 0.54, 1.73 | 0.75        | 0.22, 2.53 | 1.53        | 0.67, 3.50 |
| McBride          | 0.89                         | 0.62, 1.29 | 1.27        | 0.74, 2.20 | 1.42        | 0.63, 3.21 |
| Michaelis        | 1.45                         | 0.78, 2.72 | 1.06        | 0.27, 4.16 | 2.48        | 0.79, 7.81 |
| Olsen            | 0.67                         | 0.07, 6.42 | No cases    |            | 2.00        | 0.40, 9.93 |
| Savitz           | 1.61                         | 0.64, 4.11 | 1.29        | 0.27, 6.26 | 3.87        | 0.87, 17.3 |
| Tomenius         | 0.57                         | 0.33, 0.99 | 0.88        | 0.33, 2.36 | 1.41        | 0.38, 5.29 |
| Tynes            | 1.06                         | 0.25, 4.53 | No cases    |            | No cases    |            |
| Verkasalo        | 1.11                         | 0.14, 9.07 | No cases    |            | 2.00        | 0.23, 17.7 |
| Study summary    | 0.95                         | 0.80, 1.12 | 1.06        | 0.79, 1.42 | 1.69*       | 1.25, 2.29 |
| **United Kingdom | 1 – <2 mG                    |            | 2 – <4 mG   |            | ≥4 mG       |            |
|                  | 0.84                         | 0.57, 1.24 | 0.98        | 0.50, 1.93 | 1.00        | 0.30, 3.37 |

95% CL = 95% confidence limits.

Source: Greenland et al., 2000.

\* Mantel-Haenszel analysis ( $p = 0.01$ ). Maximum-likelihood summaries differed by less than 1% from these summaries; based on 2,656 cases and 7,084 controls. Adjusting for age, sex, and other variables had little effect on summary results.

\*\* These data are from a recent United Kingdom study not included in the Greenland analysis but included in another pooled analysis (Ahlbom et al. 2000). The United Kingdom study included 1,073 cases and 2,224 controls.

For this table, the column headed "estimate" describes the relative risk. Relative risk is the ratio of the risk of childhood leukemia for those in a magnetic field exposure group compared to persons with exposure levels of 1.0 mG or less. For example, Coghill estimated that children with exposures between 1 and 2 mG have 0.54 times the risk of children whose exposures were less than 1 mG. London's study estimates that children whose exposures were greater than 3 mG have 1.53 times the risk of children whose exposures were less than 1 mG. The column headed "95% CL" (confidence limits) describes how much random variation is in the estimate of relative risk. The estimate may be off by some amount due to random variation, and the width of the confidence limits gives some notion of that variation. For example, in Coghill's estimate of 0.54 for the relative risk, values as low as 0.17 or as high as 1.74 would not be statistically significantly different from the value of 0.54. Note there is a wide range of estimates of relative risk across the studies and wide confidence limits for many studies. In light of these findings, the pooling of results can be extremely helpful to calculate an overall estimate, much better than can be obtained from any study taken alone.

studies (Linnet, London, McBride, Savitz) were 60 Hz; all other studies were 50 Hz. Results from the recent study from the United Kingdom (see page 17) are also included in the table. This study was included in the analysis by Ahlbom et al. (2000). The relative risk estimates from the individual studies show little or no association of magnetic fields with childhood leukemia. The study summary for the pooled analysis by Greenland et al. (2000) shows a weak association between childhood leukemia and magnetic field exposures greater 3 mG.

## Q Is there a link between EMF exposure and childhood brain cancer or other forms of cancer in children?

A Although the earliest studies suggested an association between EMF exposure and all forms of childhood cancer, those initial findings have not been confirmed by other studies. At present, the available series of studies indicates no association between EMF exposure and childhood cancers other than leukemia. Far fewer of these studies have been conducted than studies of childhood leukemia.

## Q Is there a link between residential EMF exposure and cancer in adults?

A The few studies that have been conducted to address EMF and adult cancer do not provide strong evidence for an association. Thus, a link has not been established between residential EMF exposure and adult cancers, including leukemia, brain cancer, and breast cancer (see table below).

**Residential Exposure to Magnetic Fields and Adult Cancer**

| First author         | Location       | Type of exposure data          | Results (odds ratios) |                     |             |
|----------------------|----------------|--------------------------------|-----------------------|---------------------|-------------|
|                      |                |                                | Leukemia              | CNS tumors          | All cancers |
| Coleman              | United Kingdom | Calculated historical fields   | 0.92                  | NA                  | NA          |
| Feychting and Ahlbom | Sweden         | Calculated & spot measurements | 1.5*                  | 0.7                 | NA          |
| Li                   | Taiwan         | Calculated historical fields   | 1.4*                  | 1.1                 | NA          |
| Li                   | Taiwan         | Calculated historical fields   |                       | 1.1 (breast cancer) |             |
| McDowall             | United Kingdom | Calculated historical fields   | 1.43                  | NA                  | 1.03        |
| Severson             | Seattle        | Wire codes & spot measurements | 0.75                  | NA                  | NA          |
| Wrensch              | San Francisco  | Wire codes & spot measurements | NA                    | 0.9                 | NA          |
| Youngson             | United Kingdom | Calculated historical fields   | 1.88                  | NA                  | NA          |


CNS = central nervous system.

\*The number is statistically significant (greater than expected by chance).

Study results are listed as "odds ratios" (OR). An odds ratio of 1.00 means there was no increase or decrease in risk. In other words, the odds that the people in the study who had the disease (in this case, cancer) and were exposed to a particular agent (in this case, EMF) are the same as for the people in the study who did not have the disease. An odds ratio greater than 1 may occur simply by chance, unless it is statistically significant.

## Q Have clusters of cancer or other adverse health effects been linked to EMF exposure?

A An unusually large number of cancers, miscarriages, or other adverse health effects that occur in one area or over one period of time is called a “cluster.” Sometimes clusters provide an early warning of a health hazard. But most of the time the reason for the cluster is not known. There have been no proven instances of cancer clusters linked with EMF exposure.

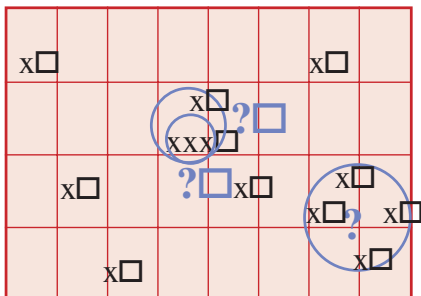

The definition of a “cluster” depends on how large an area is included. Cancer cases (x's in illustration) in a city, neighborhood, or workplace may occur in ways that suggest a cluster due to a common environmental cause. Often these patterns turn out to be due to chance. Delineation of a cluster is subjective—where do you draw the circles?

## Q If EMF does cause or promote cancer, shouldn't cancer rates have increased along with the increased use of electricity?

A Not necessarily. Although the use of electricity has increased greatly over the years, EMF exposures may not have increased. Changes in building wiring codes and in the design of electrical appliances have in some cases resulted in lower magnetic field levels. Rates for various types of cancer have shown both increases and decreases through the years, due in part to improved prevention, diagnosis, reporting, and treatment.



---

## **Q Is there a link between EMF exposure in electrical occupations and cancer?**

**A** For almost as long as we have been concerned with residential exposure to EMF and childhood cancers, researchers have been studying workplace exposure to EMF and adult cancers, focusing on leukemia and brain cancer. This research began with surveys of job titles and cancer risks, but has progressed to include very large, detailed studies of the health of workers, especially electric utility workers, in the United States, Canada, France, England, and several Northern European countries. Some studies have found evidence that suggests a link between EMF exposure and both leukemia and brain cancer, whereas other studies of similar size and quality have not found such associations.

### **California**

A 1993 study of 36,000 California electric utility workers reported no strong, consistent evidence of an association between magnetic fields and any type of cancer.

### **Canada/France**

A 1994 study of more than 200,000 utility workers in 3 utility companies in Canada and France reported no significant association between all leukemias combined and cumulative exposure to magnetic fields. There was a slight, but not statistically significant, increase in brain cancer. The researchers concluded that the study did not provide clear-cut evidence that magnetic field exposures caused leukemia or brain cancer.

### **North Carolina**

Results of a 1995 study involving more than 138,000 utility workers at 5 electric utilities in the United States did not support an association between occupational magnetic field exposure and leukemia, but suggested a link to brain cancer.

### **Denmark**

In 1997 a study of workers employed in all Danish utility companies reported a small, but statistically significant, excess risk for all cancers combined and for lung cancer. No excess risk was observed for leukemia, brain cancers, or breast cancer.

### **United Kingdom**

A 1997 study among electrical workers in the United Kingdom did not find an excess risk for brain cancer. An extension of this work reported in 2001 also found no increased risk for brain cancer.

Efforts have also been made to pool the findings across several of the above studies to produce more accurate estimates of the association between EMF and cancer (Kheifets et al., 1999). The combined summary statistics across studies provide insufficient evidence for an association between EMF exposure in the workplace and either leukemia or brain cancer.

## **Q Have studies of workers in other industries suggested a link between EMF exposure and cancer?**

**A** One of the largest studies to report an association between cancer and magnetic field exposure in a broad range of industries was conducted in Sweden (1993). The study included an assessment of EMF exposure in 1,015 different workplaces and involved more than 1,600 people in 169 different occupations. An association was reported between estimated EMF exposure and increased risk for chronic lymphocytic leukemia. An association was also reported between exposure to magnetic fields and brain cancer, but there was no dose-response relationship.

Another Swedish study (1994) found an excess risk of lymphocytic leukemia among railway engine drivers and conductors. However, the total cancer incidence (all tumors included) for this group of workers was lower than in the general Swedish population. A study of Norwegian railway workers found no evidence for an association between EMF exposure and leukemia or brain cancer. Although both positive and negative effects of EMF exposure have been reported, the majority of studies show no effects.



## **Q Is there a link between EMF exposure and breast cancer?**

**A** Researchers have been interested in the possibility that EMF exposure might cause breast cancer, in part because breast cancer is such a common disease in adult women. Early studies identified a few electrical workers with male breast cancer, a very rare disease. A link between EMF exposure and alterations in the hormone melatonin was considered a possible hypothesis (see page 24). This idea provided motivation to conduct research addressing a possible link between EMF exposure and breast cancer. Overall, the published epidemiological studies have not shown such an association.

## **Q What have we learned from clinical studies?**

**A** Laboratory studies with human volunteers have attempted to answer questions such as,

- Does EMF exposure alter normal brain and heart function?*
- Does EMF exposure at night affect sleep patterns?*
- Does EMF exposure affect the immune system?*
- Does EMF exposure affect hormones?*

The following kinds of biological effects have been reported. Keep in mind that a biological effect is simply a measurable change in some biological response. It may or may not have any bearing on health.

---

## **Heart rate**

An inconsistent effect on heart rate by EMF exposure has been reported. When observed, the biological response is small (on average, a slowing of about three to five beats per minute), and the response does not persist once exposure has ended.

Two laboratories, one in the United States and one in Australia, have reported effects of EMF on heart rate variability. Exposures used in these experiments were relatively high (about 300 mG), and lower exposures failed to produce the effect. Effects have not been observed consistently in repeated experiments.

## **Sleep electrophysiology**

A laboratory report suggested that overnight exposure to 60-Hz magnetic fields may disrupt brain electrical activity (EEG) during night sleep. In this study subjects were exposed to either continuous or intermittent magnetic fields of 283 mG. Individuals exposed to the intermittent magnetic fields showed alterations in traditional EEG sleep parameters indicative of a pattern of poor and disrupted sleep. Several studies have reported no effect with continuous exposure.

## **Hormones, immune system, and blood chemistry**

Several clinical studies with human volunteers have evaluated the effects of power-frequency EMF exposure on hormones, the immune system, and blood chemistry. These studies provide little evidence for any consistent effect.

## **Melatonin**

The hormone melatonin is secreted mainly at night and primarily by the pineal gland, a small gland attached to the brain. Some laboratory experiments with cells and animals have shown that melatonin can slow the growth of cancer cells, including breast cancer cells. Suppressed nocturnal melatonin levels have been observed in some studies of laboratory animals exposed to both electric and magnetic fields. These observations led to the hypothesis that EMF exposure might reduce melatonin and thereby weaken one of the body's defenses against cancer.

Many clinical studies with human volunteers have now examined whether various levels and types of magnetic field exposure affect blood levels of melatonin. Exposure of human volunteers at night to power-frequency EMF under controlled laboratory conditions has no apparent effect on melatonin. Some studies of people exposed to EMF at work or at home do report evidence for a small suppression of melatonin. It is not clear whether the decreases in melatonin reported under environmental conditions are related to the presence of EMF exposure or to other factors.

---

## **Q What effects of EMF have been reported in laboratory studies of cells?**

**A** Over the years, scientists have conducted more than 1,000 laboratory studies to investigate potential biological effects of EMF exposure. Most have been *in vitro* studies; that is, studies carried out on cells isolated from animals and plants, or on cell components such as cell membranes. Other studies involved animals, mainly rats and mice. In general, these studies do not demonstrate a consistent effect of EMF exposure.

Most *in vitro* studies have used magnetic fields of 1,000 mG (100  $\mu$ T) or higher, exposures that far exceed daily human exposures. In most incidences, when one laboratory has reported effects of EMF exposure on cells, other laboratories have not been able to reproduce the findings. For such research results to be widely accepted by scientists as valid, they must be replicated—that is, scientists in other laboratories should be able to repeat the experiment and get similar results. Cellular studies have investigated potential EMF effects on cell proliferation and differentiation, gene expression, enzyme activity, melatonin, and DNA. Scientists reviewing the EMF research literature find overall that the cellular studies provide little convincing evidence of EMF effects at environmental levels.

## **Q Have effects of EMF been reported in laboratory studies in animals?**

**A** Researchers have published more than 30 detailed reports on both long-term and short-term studies of EMF exposures in laboratory animals (bioassays). Long-term animal bioassays constitute an important group of studies in EMF research. Such studies have a proven record for predicting the carcinogenicity of chemicals, physical agents, and other suspected cancer-causing agents. In the EMF studies, large groups of mice or rats were continuously exposed to EMF for two years or longer and were then evaluated for cancer. The U.S. National Toxicology Program (<http://ntp-server.niehs.nih.gov/>) has an extensive historical database for hundreds of different chemical and physical agents evaluated using this model. EMF long-term bioassays examined leukemia, brain cancer, and breast cancer—the diseases some epidemiological studies have associated with EMF exposure (see pages 16–23).

Several different approaches have been used to evaluate effects of EMF exposure in animal bioassays. To investigate whether EMF could promote cancer after genetic damage had occurred, some long-term studies used cancer initiators such as ultraviolet light, radiation, or certain chemicals that are known to cause genetic damage. Researchers compared groups of animals treated with cancer initiators to groups treated with cancer initiators and then exposed to EMF, to see if EMF exposure promoted the cancer growth (initiation-promotion model). Other studies tested the cancer promotion potential of EMF using mice that were predisposed to cancer because they had defects in the genes that control cancer.

| Animal Leukemia Studies: Long-Term, Continuous Exposure Studies, Two or More Years in Length |                      |                                                                                       |           |
|----------------------------------------------------------------------------------------------|----------------------|---------------------------------------------------------------------------------------|-----------|
| First author                                                                                 | Sex/species          | Exposure/animal numbers                                                               | Results   |
| Babbitt (U.S.)                                                                               | Female mice          | 14,000 mG, 190 or 380 mice per group.<br>Some groups treated with ionizing radiation. | No effect |
| Boorman (U.S.)                                                                               | Male and female rats | 20 to 10,000 mG, 100 per group                                                        | No effect |
| McCormick (U.S.)                                                                             | Male and female mice | 20 to 10,000 mG, 100 per group                                                        | No effect |
| Mandeville (Canada)                                                                          | Female rats          | 20 to 20,000 mG, 50 per group<br><i>In utero</i> exposure                             | No effect |
| Yasui (Japan)                                                                                | Male and female rats | 5,000 to 50,000 mG, 50 per group                                                      | No effect |

10 milligauss (mG) = 1 microtesla (μT) = 0.001 millitesla (mT)

### Leukemia

Fifteen animal leukemia studies have been completed and reported. Most tested for effects of exposure to power-frequency (60-Hz) magnetic fields using rodents. Results of these studies were largely negative. The Babbitt study evaluated the subtypes of leukemia. The data provide no support for the reported epidemiology findings of leukemia from EMF exposure. Many scientists feel that the lack of effects seen in these laboratory leukemia studies significantly weakens the case for EMF as a cause of leukemia.

### Breast cancer

Researchers in the Ukraine, Germany, Sweden, and the United States have used initiation-promotion models to investigate whether EMF exposure promotes breast cancer in rats.

The results of these studies are mixed; while the German studies showed some effects, the Swedish and U.S. studies showed none. Studies in Germany reported effects on the numbers of tumors and tumor volume. A National Toxicology Program long-term bioassay performed without the use of other cancer-initiating substances showed no effects of EMF exposure on the development of mammary tumors in rats and mice.

The explanation for the observed difference among these studies is not readily apparent. Within the limits of the experimental rodent model of mammary carcinogenesis, no conclusions are possible regarding a promoting effect of EMF on chemically induced mammary cancer.

### Other cancers

Tests of EMF effects on skin cancer, liver cancer, and brain cancer have been conducted using both initiation-promotion models and non-initiated long-term bioassays. All are negative.

Three positive studies were reported for a co-promotion model of skin cancer in mice. The mice were exposed to EMF plus cancer-causing chemicals after cancers

---

had already been initiated. The same research team as well as an independent laboratory were unable to reproduce these results in subsequent experiments.

### **Non-cancer effects**

Many animal studies have investigated whether EMF can cause health problems other than cancer. Researchers have examined many endpoints, including birth defects, immune system function, reproduction, behavior, and learning. Overall, animal studies do not support EMF effects on non-cancer endpoints.

## **Q Can EMF exposure damage DNA?**

**A** Studies have attempted to determine whether EMF has genotoxic potential; that is, whether EMF exposure can alter the genetic material of living organisms. This question is important because genotoxic agents often also cause cancer or birth defects. Studies of genotoxicity have included tests on bacteria, fruit flies, and some tests on rats and mice. Nearly 100 studies on EMF genotoxicity have been reported. Most evidence suggests that EMF exposure is not genotoxic. Based on experiments with cells, some researchers have suggested that EMF exposure may inhibit the cell's ability to repair normal DNA damage, but this idea remains speculative because of the lack of genotoxicity observed in EMF animal studies.

# 4

## Your EMF Environment

*This chapter discusses typical magnetic field exposures in home and work environments and identifies common EMF sources and field intensities associated with these sources.*

### **Q** How do we define EMF exposure?

**A** Scientists are still uncertain about the best way to define “exposure” because experiments have yet to show which aspect of the field, if any, may be relevant to reported biological effects. Important aspects of exposure could be the highest intensity, the average intensity, or the amount of time spent above a certain baseline level. The most widely used measure of EMF exposure has been the time-weighted average magnetic field level (see discussion on page 15).


### **Q** How is EMF exposure measured?

**A** Several kinds of personal exposure meters are now available. These automatically record the magnetic field as it varies over time. To determine a person’s EMF exposure, the personal exposure meter is usually worn at the waist or is placed as close as possible to the person during the course of a work shift or day.

EMF can also be measured using survey meters, sometimes called “gaussmeters.” These measure the EMF levels in a given location at a given time. Such measurements do not necessarily reflect personal EMF exposure because they are not always taken at the distance from the EMF source that the person would typically be from the source. Measurements are not always made in a location for the same amount of time that a person spends there. Such “spot measurements” also fail to capture variations of the field over time, which can be significant.

## Q What are some typical EMF exposures?

A The figure below is an example of data collected with a personal exposure meter.

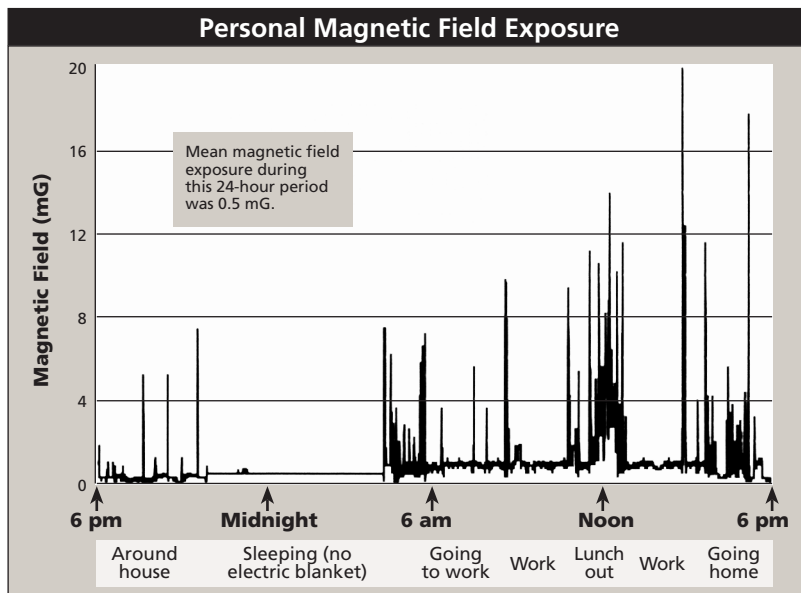

In the above example, the magnetic field was measured every 1.5 seconds over a period of 24 hours. For this person, exposure at home was very low. The occasional spikes (short exposure to high fields) occurred when the person drove or walked under power lines or over underground power lines or was close to appliances in the home or office.

Several studies have used personal exposure meters to measure field exposure in different environments. These studies tend to show that appliances and building wiring contribute to the magnetic field exposure that most people receive while at home. People living close to high voltage power lines that carry a lot of current tend to have higher overall field exposures. As shown on page 32, there is considerable variation among houses.

## Q What are typical EMF exposures for people living in the United States?

A Most people in the United States are exposed to magnetic fields that average less than 2 milligauss (mG), although individual exposures vary.

The following table shows the estimated average magnetic field exposure of the U.S. population, according to a study commissioned by the U.S. government as part

of the EMF Research and Public Information Dissemination (EMF RAPID) Program (see page 50). This study measured magnetic field exposure of about 1,000 people of all ages randomly selected among the U.S. population. Participants wore or carried with them a small personal exposure meter and kept a diary of their activities both at home and away from home. Magnetic field values were automatically recorded twice a second for 24 hours. The study reported that exposure to magnetic fields is similar in different regions of the country and similar for both men and women.

| Estimated Average Magnetic Field Exposure of the U.S. Population |                        |                             |                            |
|------------------------------------------------------------------|------------------------|-----------------------------|----------------------------|
| Average 24-hour field (mG)                                       | Population exposed (%) | 95% confidence interval (%) | People exposed* (millions) |
| > 0.5                                                            | 76.3                   | 73.8–78.9                   | 197–211                    |
| > 1                                                              | 43.6                   | 40.9–46.5                   | 109–124                    |
| > 2                                                              | 14.3                   | 11.8–17.3                   | 31.5–46.2                  |
| > 3                                                              | 6.3                    | 4.7–8.5                     | 12.5–22.7                  |
| > 4                                                              | 3.6                    | 2.5–5.2                     | 6.7–13.9                   |
| > 5                                                              | 2.42                   | 1.65–3.55                   | 4.4–9.5                    |
| > 7.5                                                            | 0.58                   | 0.29–1.16                   | 0.77–3.1                   |
| > 10                                                             | 0.46                   | 0.20–1.05                   | 0.53–2.8                   |
| > 15                                                             | 0.17                   | 0.035–0.83                  | 0.09–2.2                   |

\*Based on a population of 267 million. This table summarizes some of the results of a study that sampled about 1,000 people in the United States. In the first row, for example, we find that 76.3% of the sample population had a 24-hour average exposure of greater than 0.5 mG. Assuming that the sample was random, we can use statistics to say that we are 95% confident that the percentage of the overall U.S. population exposed to greater than 0.5 mG is between 73.8% and 78.9%. Source: Zaffanella, 1993.

The following table shows average magnetic fields experienced during different types of activities. In general, magnetic fields are greater at work than at home.

| Estimated Average Magnetic Field Exposure of the U.S. Population for Various Activities |                        |     |      |        |        |
|-----------------------------------------------------------------------------------------|------------------------|-----|------|--------|--------|
| Average field (mG)                                                                      | Population exposed (%) |     |      |        |        |
|                                                                                         | Home                   | Bed | Work | School | Travel |
| > 0.5                                                                                   | 69                     | 48  | 81   | 63     | 87     |
| > 1                                                                                     | 38                     | 30  | 49   | 25     | 48     |
| > 2                                                                                     | 14                     | 14  | 20   | 3.5    | 13     |
| > 3                                                                                     | 7.8                    | 7.2 | 13   | 1.6    | 4.1    |
| > 4                                                                                     | 4.7                    | 4.7 | 8.0  | < 1    | 1.5    |
| > 5                                                                                     | 3.5                    | 3.7 | 4.6  |        | 1.0    |
| > 7.5                                                                                   | 1.2                    | 1.6 | 2.5  |        | 0.5    |
| > 10                                                                                    | 0.9                    | 0.8 | 1.3  |        | < 0.2  |
| > 15                                                                                    | 0.1                    | 0.1 | 0.9  |        |        |

Source: Zaffanella, 1993.

## Q What levels of EMF are found in common environments?

A Magnetic field exposures can vary greatly from site to site for any type of environment. The data shown in the following table are median measurements taken at four different sites for each environment category.

| EMF Exposures in Common Environments        |                  |                    |               |                  |                    |
|---------------------------------------------|------------------|--------------------|---------------|------------------|--------------------|
| Magnetic fields measured in milligauss (mG) |                  |                    |               |                  |                    |
| Environment                                 | Median* exposure | Top 5th percentile | Environment   | Median* exposure | Top 5th percentile |
| OFFICE BUILDING                             |                  |                    | MACHINE SHOP  |                  |                    |
| Support staff                               | 0.6              | 3.7                | Machinist     | 0.4              | 6.0                |
| Professional                                | 0.5              | 2.6                | Welder        | 1.1              | 24.6               |
| Maintenance                                 | 0.6              | 3.8                | Engineer      | 1.0              | 5.1                |
| Visitor                                     | 0.6              | 2.1                | Assembler     | 0.5              | 6.4                |
| SCHOOL                                      |                  |                    | Office staff  | 0.7              | 4.7                |
| Teacher                                     | 0.6              | 3.3                | GROCERY STORE |                  |                    |
| Student                                     | 0.5              | 2.9                | Cashier       | 2.7              | 11.9               |
| Custodian                                   | 1.0              | 4.9                | Butcher       | 2.4              | 12.8               |
| Administrative staff                        | 1.3              | 6.9                | Office staff  | 2.1              | 7.1                |
| HOSPITAL                                    |                  |                    | Customer      | 1.1              | 7.7                |
| Patient                                     | 0.6              | 3.6                |               |                  |                    |
| Medical staff                               | 0.8              | 5.6                |               |                  |                    |
| Visitor                                     | 0.6              | 2.4                |               |                  |                    |
| Maintenance                                 | 0.6              | 5.9                |               |                  |                    |

\*The median of four measurements. For this table, the median is the average of the two middle measurements.  
Source: National Institute for Occupational Safety and Health.


## Q What EMF field levels are encountered in the home?

### A Electric fields

Electric fields in the home, on average, range from 0 to 10 volts per meter. They can be hundreds, thousands, or even millions of times weaker than those encountered outdoors near power lines. Electric fields directly beneath power lines may vary from a few volts per meter for some overhead distribution lines to several thousands of volts per meter for extra high voltage power lines. Electric fields from power lines rapidly become weaker with distance and can be greatly reduced by walls and roofs of buildings.

### Magnetic fields

Magnetic fields are not blocked by most materials. Magnetic fields encountered in homes vary greatly. Magnetic fields rapidly become weaker with distance from the source.

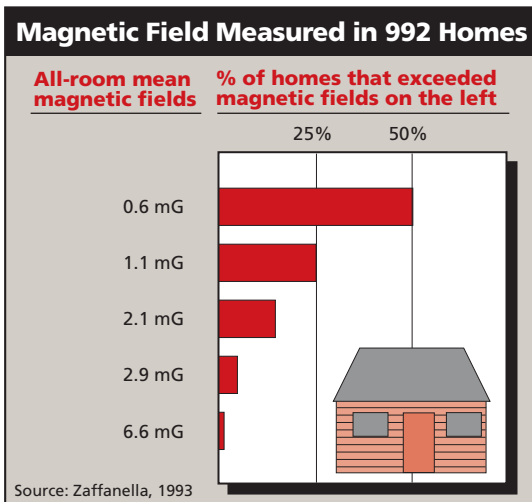


The chart on the left summarizes data from a study by the Electric Power Research Institute (EPRI) in which spot measurements of magnetic fields were made in the center of rooms in 992 homes throughout the United States. Half of the houses studied had magnetic field measurements of 0.6 mG or less, when the average of measurements from all the rooms in the house was calculated (the all-room mean magnetic field). The all-room mean magnetic field for all houses studied was 0.9 mG. The measurements were made away from electrical appliances and reflect primarily the fields from household wiring and outside power lines.

If you are comparing the information in this chart with measurements in your own home, keep in mind that this chart shows averages of measurements taken throughout the homes, not the single highest measurement found in the home.

## Q What are EMF levels close to electrical appliances?

A Magnetic fields close to electrical appliances are often much stronger than those from other sources, including magnetic fields directly under power lines. Appliance fields decrease in strength with distance more quickly than do power line fields.

The following table, based on data gathered in 1992, lists the EMF levels generated by common electrical appliances. Magnetic field strength (magnitude) does not depend on how large, complex, powerful, or noisy the appliance is. Magnetic fields near large appliances are often weaker than those near small devices. Appliances in your home may have been redesigned since the data in the table were collected, and the EMF they produce may differ considerably from the levels shown here.

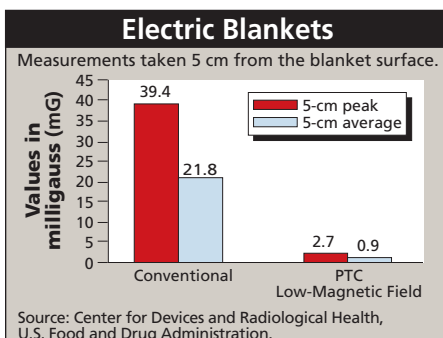

The graph shows magnetic fields produced by electric blankets, including conventional 110-V electric blankets as well as the PTC (positive temperature coefficient) low-magnetic-field blankets. The fields were measured at a distance of about 2 inches from the blanket's surface, roughly the distance from the blanket to the user's internal organs. Because of the wiring, magnetic field strengths vary from point to point on the blanket. The graph reflects this and gives both the peak and the average measurement.

| Sources of Magnetic Fields (mG)*             |     |     |    |    |                                               |      |     |    |    |
|----------------------------------------------|-----|-----|----|----|-----------------------------------------------|------|-----|----|----|
| Distance from source                         |     |     |    |    | Distance from source                          |      |     |    |    |
|                                              | 6"  | 1'  | 2' | 4' |                                               | 6"   | 1'  | 2' | 4' |
| <b>Office Sources</b>                        |     |     |    |    | <b>Workshop Sources</b>                       |      |     |    |    |
| <b>AIR CLEANERS</b>                          |     |     |    |    | <b>BATTERY CHARGERS</b>                       |      |     |    |    |
| Lowest                                       | 110 | 20  | 3  | –  | Lowest                                        | 3    | 2   | –  | –  |
| Median                                       | 180 | 35  | 5  | 1  | Median                                        | 30   | 3   | –  | –  |
| Highest                                      | 250 | 50  | 8  | 2  | Highest                                       | 50   | 4   | –  | –  |
| <b>COPY MACHINES</b>                         |     |     |    |    | <b>DRILLS</b>                                 |      |     |    |    |
| Lowest                                       | 4   | 2   | 1  | –  | Lowest                                        | 100  | 20  | 3  | –  |
| Median                                       | 90  | 20  | 7  | 1  | Median                                        | 150  | 30  | 4  | –  |
| Highest                                      | 200 | 40  | 13 | 4  | Highest                                       | 200  | 40  | 6  | –  |
| <b>FAX MACHINES</b>                          |     |     |    |    | <b>POWER SAWS</b>                             |      |     |    |    |
| Lowest                                       | 4   | –   | –  | –  | Lowest                                        | 50   | 9   | 1  | –  |
| Median                                       | 6   | –   | –  | –  | Median                                        | 200  | 40  | 5  | –  |
| Highest                                      | 9   | 2   | –  | –  | Highest                                       | 1000 | 300 | 40 | 4  |
| <b>FLUORESCENT LIGHTS</b>                    |     |     |    |    | <b>ELECTRIC SCREWDRIVERS (while charging)</b> |      |     |    |    |
| Lowest                                       | 20  | –   | –  | –  | Lowest                                        | –    | –   | –  | –  |
| Median                                       | 40  | 6   | 2  | –  | Median                                        | –    | –   | –  | –  |
| Highest                                      | 100 | 30  | 8  | 4  | Highest                                       | –    | –   | –  | –  |
| <b>ELECTRIC PENCIL SHARPENERS</b>            |     |     |    |    |                                               |      |     |    |    |
| Lowest                                       | 20  | 8   | 5  | –  | Distance from source                          |      |     |    |    |
| Median                                       | 200 | 70  | 20 | 2  | 1' 2' 4'                                      |      |     |    |    |
| Highest                                      | 300 | 90  | 30 | 30 |                                               |      |     |    |    |
| <b>VIDEO DISPLAY TERMINALS (see page 48)</b> |     |     |    |    | <b>Living/Family Room Sources</b>             |      |     |    |    |
| <b>(PCs with color monitors)**</b>           |     |     |    |    | <b>CEILING FANS</b>                           |      |     |    |    |
| Lowest                                       | 7   | 2   | 1  | –  | Lowest                                        | –    | –   | –  | –  |
| Median                                       | 14  | 5   | 2  | –  | Median                                        | 3    | –   | –  | –  |
| Highest                                      | 20  | 6   | 3  | –  | Highest                                       | 50   | 6   | 1  | –  |
|                                              |     |     |    |    | <b>WINDOW AIR CONDITIONERS</b>                |      |     |    |    |
| <b>Bathroom Sources</b>                      |     |     |    |    | Lowest                                        | –    | –   | –  | –  |
| <b>HAIR DRYERS</b>                           |     |     |    |    | Median                                        | 3    | 1   | –  | –  |
| Lowest                                       | 1   | –   | –  | –  | Highest                                       | 20   | 6   | 4  | –  |
| Median                                       | 300 | 1   | –  | –  | <b>COLOR TELEVISIONS**</b>                    |      |     |    |    |
| Highest                                      | 700 | 70  | 10 | 1  | Lowest                                        | –    | –   | –  | –  |
| <b>ELECTRIC SHAVERS</b>                      |     |     |    |    | Median                                        | 7    | 2   | –  | –  |
| Lowest                                       | 4   | –   | –  | –  | Highest                                       | 20   | 8   | 4  | –  |
| Median                                       | 100 | 20  | –  | –  |                                               |      |     |    |    |
| Highest                                      | 600 | 100 | 10 | 1  |                                               |      |     |    |    |

Continued

### Sources of Magnetic Fields (mG)\*

|                           | Distance from source |     |    |    |                                          | Distance from source |    |    |    |
|---------------------------|----------------------|-----|----|----|------------------------------------------|----------------------|----|----|----|
|                           | 6"                   | 1'  | 2' | 4' |                                          | 6"                   | 1' | 2' | 4' |
| <b>Kitchen Sources</b>    |                      |     |    |    | <b>Kitchen Sources</b>                   |                      |    |    |    |
| <b>BLENDERS</b>           |                      |     |    |    | <b>ELECTRIC OVENS</b>                    |                      |    |    |    |
| Lowest                    | 30                   | 5   | –  | –  | Lowest                                   | 4                    | 1  | –  | –  |
| Median                    | 70                   | 10  | 2  | –  | Median                                   | 9                    | 4  | –  | –  |
| Highest                   | 100                  | 20  | 3  | –  | Highest                                  | 20                   | 5  | 1  | –  |
| <b>CAN OPENERS</b>        |                      |     |    |    | <b>ELECTRIC RANGES</b>                   |                      |    |    |    |
| Lowest                    | 500                  | 40  | 3  | –  | Lowest                                   | 20                   | –  | –  | –  |
| Median                    | 600                  | 150 | 20 | 2  | Median                                   | 30                   | 8  | 2  | –  |
| Highest                   | 1500                 | 300 | 30 | 4  | Highest                                  | 200                  | 30 | 9  | 6  |
| <b>COFFEE MAKERS</b>      |                      |     |    |    | <b>REFRIGERATORS</b>                     |                      |    |    |    |
| Lowest                    | 4                    | –   | –  | –  | Lowest                                   | –                    | –  | –  | –  |
| Median                    | 7                    | –   | –  | –  | Median                                   | 2                    | 2  | 1  | –  |
| Highest                   | 10                   | 1   | –  | –  | Highest                                  | 40                   | 20 | 10 | 10 |
| <b>DISHWASHERS</b>        |                      |     |    |    | <b>TOASTERS</b>                          |                      |    |    |    |
| Lowest                    | 10                   | 6   | 2  | –  | Lowest                                   | 5                    | –  | –  | –  |
| Median                    | 20                   | 10  | 4  | –  | Median                                   | 10                   | 3  | –  | –  |
| Highest                   | 100                  | 30  | 7  | 1  | Highest                                  | 20                   | 7  | –  | –  |
| <b>FOOD PROCESSORS</b>    |                      |     |    |    | <b>Bedroom Sources</b>                   |                      |    |    |    |
| Lowest                    | 20                   | 5   | –  | –  | <b>DIGITAL CLOCK****</b>                 |                      |    |    |    |
| Median                    | 30                   | 6   | 2  | –  | Lowest                                   | –                    | –  | –  |    |
| Highest                   | 130                  | 20  | 3  | –  | Median                                   | 1                    | –  | –  |    |
| <b>GARBAGE DISPOSALS</b>  |                      |     |    |    | High                                     | 8                    | 2  | 1  |    |
| Lowest                    | 60                   | 8   | 1  | –  | <b>ANALOG CLOCKS</b>                     |                      |    |    |    |
| Median                    | 80                   | 10  | 2  | –  | <b>(conventional clockface)****</b>      |                      |    |    |    |
| Highest                   | 100                  | 20  | 3  | –  | Lowest                                   | 1                    | –  | –  |    |
| <b>MICROWAVE OVENS***</b> |                      |     |    |    | Median                                   | 15                   | 2  | –  |    |
| Lowest                    | 100                  | 1   | 1  | –  | Highest                                  | 30                   | 5  | 3  |    |
| Median                    | 200                  | 4   | 10 | 2  | <b>BABY MONITOR (unit nearest child)</b> |                      |    |    |    |
| Highest                   | 300                  | 200 | 30 | 20 | Lowest                                   | 4                    | –  | –  | –  |
| <b>MIXERS</b>             |                      |     |    |    | Median                                   | 6                    | 1  | –  | –  |
| Lowest                    | 30                   | 5   | –  | –  | Highest                                  | 15                   | 2  | –  | –  |
| Median                    | 100                  | 10  | 1  | –  |                                          |                      |    |    |    |
| Highest                   | 600                  | 100 | 10 | –  |                                          |                      |    |    |    |

Continued

| Sources of Magnetic Fields (mG)* |     |    |    |    |                                                                                                                                                                                                                                                   |     |     |    |    |
|----------------------------------|-----|----|----|----|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----|-----|----|----|
| Distance from source             |     |    |    |    | Distance from source                                                                                                                                                                                                                              |     |     |    |    |
|                                  | 6"  | 1' | 2' | 4' |                                                                                                                                                                                                                                                   | 6"  | 1'  | 2' | 4' |
| <b>Laundry/Utility Sources</b>   |     |    |    |    | <b>Laundry/Utility Sources</b>                                                                                                                                                                                                                    |     |     |    |    |
| <b>ELECTRIC CLOTHES DRYERS</b>   |     |    |    |    | <b>PORTABLE HEATERS</b>                                                                                                                                                                                                                           |     |     |    |    |
| Lowest                           | 2   | –  | –  | –  | Lowest                                                                                                                                                                                                                                            | 5   | 1   | –  | –  |
| Median                           | 3   | 2  | –  | –  | Median                                                                                                                                                                                                                                            | 100 | 20  | 4  | –  |
| Highest                          | 10  | 3  | –  | –  | Highest                                                                                                                                                                                                                                           | 150 | 40  | 8  | 1  |
| <b>WASHING MACHINES</b>          |     |    |    |    | <b>VACUUM CLEANERS</b>                                                                                                                                                                                                                            |     |     |    |    |
| Lowest                           | 4   | 1  | –  | –  | Lowest                                                                                                                                                                                                                                            | 100 | 20  | 4  | –  |
| Median                           | 20  | 7  | 1  | –  | Median                                                                                                                                                                                                                                            | 300 | 60  | 10 | 1  |
| Highest                          | 100 | 30 | 6  | –  | Highest                                                                                                                                                                                                                                           | 700 | 200 | 50 | 10 |
| <b>IRONS</b>                     |     |    |    |    | <b>SEWING MACHINES</b>                                                                                                                                                                                                                            |     |     |    |    |
| Lowest                           | 6   | 1  | –  | –  | Home sewing machines can produce magnetic fields of 12 mG at chest level and 5 mG at head level. Magnetic fields as high as 35 mG at chest level and 215 mG at knee level have been measured from industrial sewing machine models (Sobel, 1994). |     |     |    |    |
| Median                           | 8   | 1  | –  | –  |                                                                                                                                                                                                                                                   |     |     |    |    |
| Highest                          | 20  | 3  | –  | –  |                                                                                                                                                                                                                                                   |     |     |    |    |

Source: EMF In Your Environment, U.S. Environmental Protection Agency, 1992.

- \* Dash (–) means that the magnetic field at this distance from the operating appliance could not be distinguished from background measurements taken before the appliance had been turned on.
- \*\* Some appliances produce both 60-Hz and higher frequency fields. For example, televisions and computer screens produce fields at 10,000-30,000 Hz (10-30 kHz) as well as 60-Hz fields.
- \*\*\* Microwave ovens produce 60-Hz fields of several hundred milligauss, but they also create microwave energy inside the appliance that is at a much higher frequency (about 2.45 billion hertz). We are shielded from the higher frequency fields but not from the 60-Hz fields.
- \*\*\*\* Most digital clocks have low magnetic fields. In some analog clocks, however, higher magnetic fields are produced by the motor that drives the hands. In the above table, the clocks are electrically powered using alternating current, as are all the appliances described in these tables.

**Q What EMF levels are found near power lines?**

**A** Power transmission lines bring power from a generating station to an electrical substation. Power distribution lines bring power from the substation to your home. Transmission and distribution lines can be either overhead or underground. Overhead lines produce both electric fields and magnetic fields. Underground lines do not produce electric fields above ground but may produce magnetic fields above ground.

**Power transmission lines**

Typical EMF levels for transmission lines are shown in the chart on page 37. At a distance of 300 feet and at times of average electricity demand, the magnetic fields from many lines can be similar to typical background levels found in most homes. The distance at which the magnetic field from the line becomes indistinguishable from typical background levels differs for different types of lines.

---

## **Power distribution lines**

Typical voltage for power distribution lines in North America ranges from 4 to 24 kilovolts (kV). Electric field levels directly beneath overhead distribution lines may vary from a few volts per meter to 100 or 200 volts per meter. Magnetic fields directly beneath overhead distribution lines typically range from 10 to 20 mG for main feeders and less than 10 mG for laterals. Such levels are also typical directly above underground lines. Peak EMF levels, however, can vary considerably depending on the amount of current carried by the line. Peak magnetic field levels as high as 70 mG have been measured directly below overhead distribution lines and as high as 40 mG above underground lines.

## **Q How strong is the EMF from electric power substations?**


**A** In general, the strongest EMF around the outside of a substation comes from the power lines entering and leaving the substation. The strength of the EMF from equipment within the substations, such as transformers, reactors, and capacitor banks, decreases rapidly with increasing distance. Beyond the substation fence or wall, the EMF produced by the substation equipment is typically indistinguishable from background levels.

## **Q Do electrical workers have higher EMF exposure than other workers?**


**A** Most of the information we have about occupational EMF exposure comes from studies of electric utility workers. It is therefore difficult to compare electrical workers' EMF exposures with those of other workers because there is less information about EMF exposures in work environments other than electric utilities. Early studies did not include actual measurements of EMF exposure on the job but used job titles as an estimate of EMF exposure among electrical workers. Recent studies, however, have included extensive EMF exposure assessments.

A report published in 1994 provides some information about estimated EMF exposures of workers in Los Angeles in a number of electrical jobs in electric utilities and other industries. Electrical workers had higher average EMF exposures (9.6 mG) than did workers in other jobs (1.7 mG). For this study, the category "electrical workers" included electrical engineering technicians, electrical engineers, electricians, power line workers, power station operators, telephone line workers, TV repairers, and welders.

## Typical EMF Levels for Power Transmission Lines\*

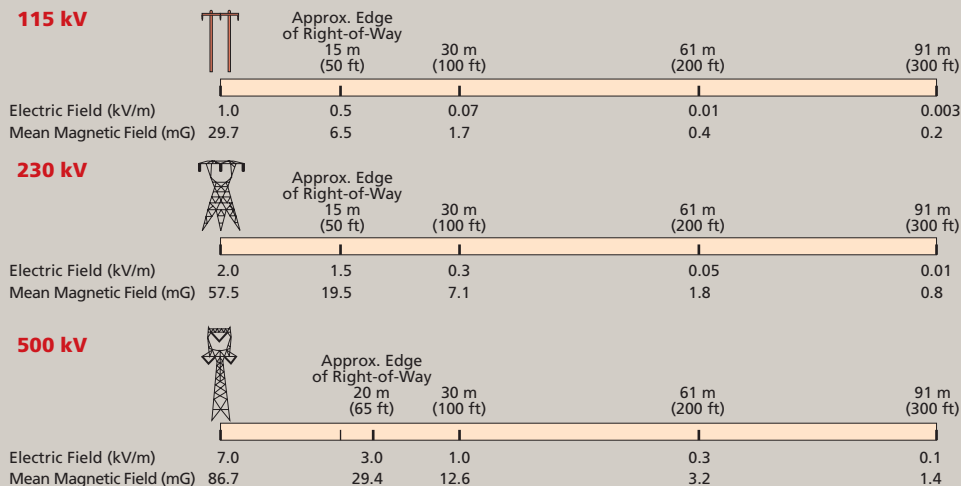

### Magnetic Field from a 500-kV Transmission Line Measured on the Right-of-Way Every 5 Minutes for 1 Week

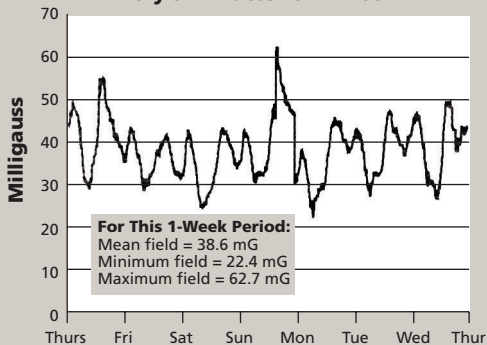

Electric fields from power lines are relatively stable because line voltage doesn't change very much. Magnetic fields on most lines fluctuate greatly as current changes in response to changing loads. Magnetic fields must be described statistically in terms of averages, maximums, etc. The magnetic fields above are means calculated for 321 power lines for 1990 annual mean loads. During peak loads (about 1% of the time), magnetic fields are about twice as strong as the mean levels above. The graph on the left is an example of how the magnetic field varied during one week for one 500-kV transmission line.

\*These are typical EMFs at 1 m (3.3 ft) above ground for various distances from power lines in the Pacific Northwest. They are for general information. For information about a specific line, contact the utility that operates the line.


Source: Bonneville Power Administration, 1994.

## Q What are possible EMF exposures in the workplace?

A The figures below are examples of magnetic field exposures determined with exposure meters worn by four workers in different occupations. These measurements demonstrate how EMF exposures vary among individual workers. They do not necessarily represent typical EMF exposures for workers in these occupations.


### Magnetic Field Exposures of Workers (mG)

#### Sewing machine operator in garment factory

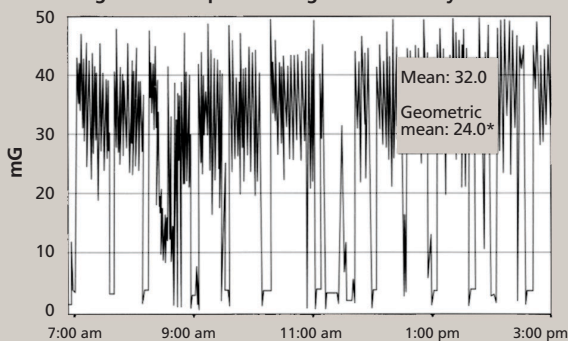


The sewing machine operator worked all day, took a 1-hour lunch break at 11:15 am, and took 10-minute breaks at 8:55 am and 2:55 pm.

#### Maintenance mechanic

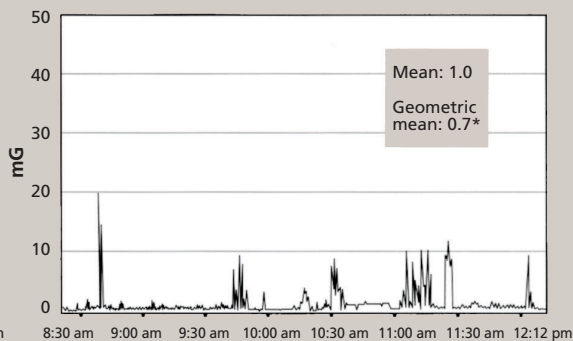


The mechanic repaired a compressor at 9:45 am and 11:10 am.

#### Electrician

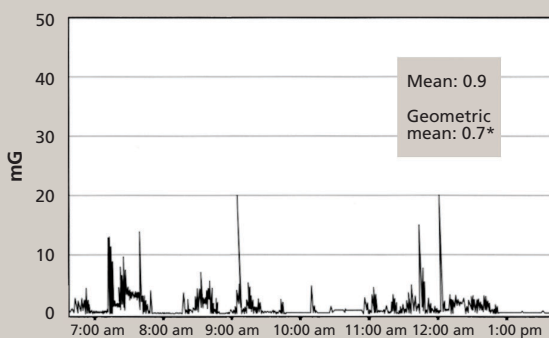

The electrician repaired a large air-conditioning motor at 9:10 am and at 11:45 am.

#### Government office worker

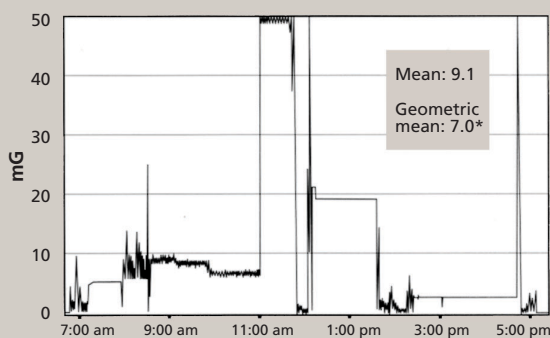

The government worker was at the copy machine at 8:00 am, at the computer from 11:00 am to 1:00 pm and also from 2:30 pm to 4:30 pm.

\*The geometric mean is calculated by squaring the values, adding the squares, and then taking the square root of the sum.  
Source: National Institute for Occupational Safety and Health and U.S. Department of Energy.

The tables below and on page 41 can give you a general idea about magnetic field levels for different jobs and around various kinds of electrical equipment. It is important to remember that EMF levels depend on the actual equipment used in

| <b>EMF Measurements During a Workday</b>                                                                                                                                                                                                                |                                       |                               |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------|-------------------------------|
| Industry and occupation                                                                                                                                                                                                                                 | ELF magnetic fields<br>measured in mG |                               |
|                                                                                                                                                                                                                                                         | Median for<br>occupation*             | Range for 90%<br>of workers** |
| <b>ELECTRICAL WORKERS IN VARIOUS INDUSTRIES</b>                                                                                                                                                                                                         |                                       |                               |
| Electrical engineers                                                                                                                                                                                                                                    | 1.7                                   | 0.5–12.0                      |
| Construction electricians                                                                                                                                                                                                                               | 3.1                                   | 1.6–12.1                      |
| TV repairers                                                                                                                                                                                                                                            | 4.3                                   | 0.6–8.6                       |
| Welders                                                                                                                                                                                                                                                 | 9.5                                   | 1.4–66.1                      |
| <b>ELECTRIC UTILITIES</b>                                                                                                                                                                                                                               |                                       |                               |
| Clerical workers without computers                                                                                                                                                                                                                      | 0.5                                   | 0.2–2.0                       |
| Clerical workers with computers                                                                                                                                                                                                                         | 1.2                                   | 0.5–4.5                       |
| Line workers                                                                                                                                                                                                                                            | 2.5                                   | 0.5–34.8                      |
| Electricians                                                                                                                                                                                                                                            | 5.4                                   | 0.8–34.0                      |
| Distribution substation operators                                                                                                                                                                                                                       | 7.2                                   | 1.1–36.2                      |
| Workers off the job (home, travel, etc.)                                                                                                                                                                                                                | 0.9                                   | 0.3–3.7                       |
| <b>TELECOMMUNICATIONS</b>                                                                                                                                                                                                                               |                                       |                               |
| Install, maintenance, & repair technicians                                                                                                                                                                                                              | 1.5                                   | 0.7–3.2                       |
| Central office technicians                                                                                                                                                                                                                              | 2.1                                   | 0.5–8.2                       |
| Cable splicers                                                                                                                                                                                                                                          | 3.2                                   | 0.7–15.0                      |
| <b>AUTO TRANSMISSION MANUFACTURE</b>                                                                                                                                                                                                                    |                                       |                               |
| Assemblers                                                                                                                                                                                                                                              | 0.7                                   | 0.2–4.9                       |
| Machinists                                                                                                                                                                                                                                              | 1.9                                   | 0.6–27.6                      |
| <b>HOSPITALS</b>                                                                                                                                                                                                                                        |                                       |                               |
| Nurses                                                                                                                                                                                                                                                  | 1.1                                   | 0.5–2.1                       |
| X-ray technicians                                                                                                                                                                                                                                       | 1.5                                   | 1.0–2.2                       |
| <b>SELECTED OCCUPATIONS FROM ALL ECONOMIC SECTORS</b>                                                                                                                                                                                                   |                                       |                               |
| Construction machine operators                                                                                                                                                                                                                          | 0.5                                   | 0.1–1.2                       |
| Motor vehicle drivers                                                                                                                                                                                                                                   | 1.1                                   | 0.4–2.7                       |
| School teachers                                                                                                                                                                                                                                         | 1.3                                   | 0.6–3.2                       |
| Auto mechanics                                                                                                                                                                                                                                          | 2.3                                   | 0.6–8.7                       |
| Retail sales                                                                                                                                                                                                                                            | 2.3                                   | 1.0–5.5                       |
| Sheet metal workers                                                                                                                                                                                                                                     | 3.9                                   | 0.3–48.4                      |
| Sewing machine operators                                                                                                                                                                                                                                | 6.8                                   | 0.9–32.0                      |
| Forestry and logging jobs                                                                                                                                                                                                                               | 7.6                                   | 0.6–95.5***                   |
| Source: National Institute for Occupational Safety and Health.<br>ELF (extremely low frequency)—frequencies 3–3,000 Hz.                                                                                                                                 |                                       |                               |
| * The median is the middle measurement in a sample arranged by size. These personal exposure measurements reflect the median magnitude of the magnetic field produced by the various EMF sources and the amount of time the worker spent in the fields. |                                       |                               |
| ** This range is between the 5th and 95th percentiles of the workday averages for an occupation.                                                                                                                                                        |                                       |                               |
| *** Chain saw engines produce strong magnetic fields that are not pure 60-Hz fields.                                                                                                                                                                    |                                       |                               |

the workplace. Different brands or models of the same type of equipment can have different magnetic field strengths. It is also important to keep in mind that the strength of a magnetic field decreases quickly with distance.

If you have questions or want more information about your EMF exposure at work, your plant safety officer, industrial hygienist, or other local safety official can be a good source of information. The National Institute for Occupational Safety and Health (NIOSH) is asked occasionally to conduct health hazard evaluations in workplaces where EMF is a suspected cause for concern. For further technical assistance contact NIOSH at 800-356-4674.

## **Q What are some typical sources of EMF in the workplace?**

**A** Exposure assessment studies so far have shown that most people's EMF exposure at work comes from electrical appliances and tools and from the building's power



supply. People who work near transformers, electrical closets, circuit boxes, or other high-current electrical equipment may have 60-Hz magnetic field exposures of hundreds of milligauss or more. In offices, magnetic field levels are often similar to those found at home, typically 0.5 to 4.0 mG. However, these levels can increase dramatically near certain types of equipment.

| EMF Spot Measurements                                                  |                          |                                                |                                                                          |
|------------------------------------------------------------------------|--------------------------|------------------------------------------------|--------------------------------------------------------------------------|
| Industry and sources                                                   | ELF magnetic fields (mG) | Other frequencies                              | Comments                                                                 |
| <b>ELECTRICAL EQUIPMENT USED IN MACHINE MANUFACTURING</b>              |                          |                                                |                                                                          |
| Electric resistance heater                                             | 6,000–14,000             | VLF                                            |                                                                          |
| Induction heater                                                       | 10–460                   | High VLF                                       |                                                                          |
| Hand-held grinder                                                      | 3,000                    | —                                              | Tool exposures measured at operator's chest.                             |
| Grinder                                                                | 110                      | —                                              | Tool exposures measured at operator's chest.                             |
| Lathe, drill press, etc.                                               | 1–4                      | —                                              | Tool exposures measured at operator's chest.                             |
| <b>ALUMINUM REFINING</b>                                               |                          |                                                |                                                                          |
| Aluminum pot rooms                                                     | 3.4–30                   | Very high static field                         | Highly-rectified DC current (with an ELF ripple) refines aluminum.       |
| Rectification room                                                     | 300–3,300                | High static field                              |                                                                          |
| <b>STEEL FOUNDRY</b>                                                   |                          |                                                |                                                                          |
| Ladle refinery                                                         |                          |                                                |                                                                          |
| Furnace active                                                         | 170–1,300                | High ULF from the ladle's big magnetic stirrer | Highest ELF field was at the chair of control room operator.             |
| Furnace inactive                                                       | 0.6–3.7                  | High ULF from the ladle's big magnetic stirrer | Highest ELF field was at the chair of control room operator.             |
| Electrogalvanizing unit                                                | 2–1,100                  | High VLF                                       |                                                                          |
| <b>TELEVISION BROADCASTING</b>                                         |                          |                                                |                                                                          |
| Video cameras (studio and minicams)                                    | 7.2–24.0                 | VLF                                            |                                                                          |
| Video tape degaussers                                                  | 160–3,300                | —                                              | Measured 1 ft away.                                                      |
| Light control centers                                                  | 10–300                   | —                                              | Walk-through survey.                                                     |
| Studio and newsrooms                                                   | 2–5                      | —                                              | Walk-through survey.                                                     |
| <b>HOSPITALS</b>                                                       |                          |                                                |                                                                          |
| Intensive care unit                                                    | 0.1–220                  | VLF                                            | Measured at nurse's chest.                                               |
| Post-anesthesia care unit                                              | 0.1–24                   | VLF                                            |                                                                          |
| Magnetic resonance imaging (MRI)                                       | 0.5–280                  | Very high static field, VLF and RF             | Measured at technician's work locations.                                 |
| <b>TRANSPORTATION</b>                                                  |                          |                                                |                                                                          |
| Cars, minivans, and trucks                                             | 0.1–125                  | Most frequencies less than 60 Hz               | Steel-belted tires are the principal ELF source for gas/diesel vehicles. |
| Bus (diesel powered)                                                   | 0.5–146                  | Most frequencies less than 60 Hz               |                                                                          |
| Electric cars                                                          | 0.1–81                   | Some elevated static fields                    |                                                                          |
| Chargers for electric cars                                             | 4–63                     | —                                              | Measured 2 ft from charger.                                              |
| Electric buses                                                         | 0.1–88                   | —                                              | Measured at waist. Fields at ankles 2-5 times higher.                    |
| Electric train passenger cars                                          | 0.1–330                  | 25 & 60 Hz power on U.S. trains                | Measured at waist. Fields at ankles 2-5 times higher.                    |
| Airliner                                                               | 0.8–24.2                 | 400 Hz power on airliners                      | Measured at waist.                                                       |
| <b>GOVERNMENT OFFICES</b>                                              |                          |                                                |                                                                          |
| Desk work locations                                                    | 0.1–7                    | —                                              | Peaks due to laser printers.                                             |
| Desks near power center                                                | 18–50                    | —                                              |                                                                          |
| Power cables in floor                                                  | 15–170                   | —                                              |                                                                          |
| Building power supplies                                                | 25–1,800                 | —                                              |                                                                          |
| Can opener                                                             | 3,000                    | —                                              | Appliance fields measured 6 in. away.                                    |
| Desktop cooling fan                                                    | 1,000                    | —                                              | Appliance fields measured 6 in. away.                                    |
| Other office appliances                                                | 10–200                   | —                                              |                                                                          |
| Source: National Institute for Occupational Safety and Health, 2001.   |                          |                                                |                                                                          |
| ULF (ultra low frequency)—frequencies above 0, below 3 Hz.             |                          |                                                |                                                                          |
| ELF (extremely low frequency)—frequencies 3–3,000 Hz.                  |                          |                                                |                                                                          |
| VLF (very low frequency)—frequencies 3,000–30,000 Hz (3–30 kilohertz). |                          |                                                |                                                                          |

---


## **Q** What EMF exposure occurs during travel?

**A** Inside a car or bus, the main sources of magnetic field exposure are those you pass by (or under) as you drive, such as power lines. Car batteries involve direct current (DC) rather than alternating current (AC). Alternators can create EMF, but at frequencies other than 60 Hz. The rotation of steel-belted tires is also a source of EMF.

Most trains in the United States are diesel powered. Some electrically powered trains operate on AC, such as the passenger trains between Washington, D.C. and New Haven, Connecticut. Measurements taken on these trains using personal exposure monitors have suggested that average 60-Hz magnetic field exposures for passengers and conductors may exceed 50 mG. A U.S. government-sponsored exposure assessment study of electric rail systems found average 60-Hz magnetic field levels in train operator compartments that ranged from 0.4 mG (Boston high speed trolley) to 31.1 mG (North Jersey transit). The graph on the next page shows average and maximum magnetic field measurements in operator compartments of several electric rail systems. It illustrates that 60 Hz is one of several electromagnetic frequencies to which train operators are exposed.

Workers who maintain the tracks on electric rail lines, primarily in the northeastern United States, also have elevated magnetic field exposures at both 25 Hz and 60 Hz. Measurements taken by the National Institute for Occupational Safety and Health show that typical average daily exposures range from 3 to 18 mG, depending on how often trains pass the work site.

Rapid transit and light rail systems in the United States, such as the Washington D.C. Metro and the San Francisco Bay Area Rapid Transit, run on DC electricity. These DC-powered trains contain equipment that produces AC fields. For example, areas of strong AC magnetic fields have been measured on the Washington Metro close to the floor, during braking and acceleration, presumably near equipment located underneath the subway cars.

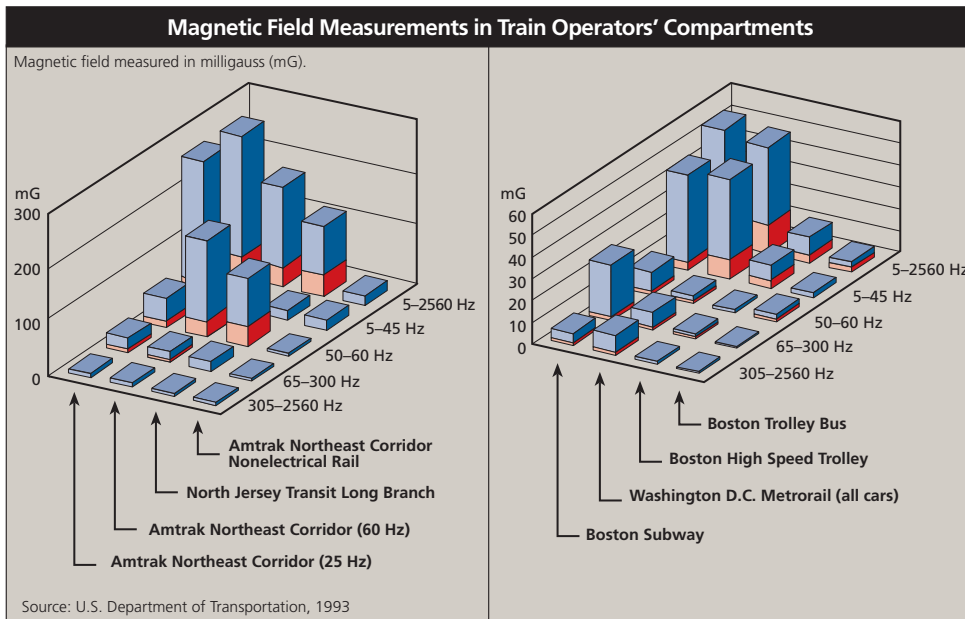

These graphs illustrate that 60 Hz is one of several electromagnetic frequencies to which train operators are exposed. The maximum exposure is the top of the blue (upper) portion of the bar; the average exposure is the top of the red (lower) portion.

## Q How can I find out how strong the EMF is where I live and work?

A The tables throughout this chapter can give you a general idea about magnetic field levels at home, for different jobs, and around various kinds of electrical equipment. For specific information about EMF from a particular power line, contact the utility that operates the line. Some will perform home EMF measurements.

You can take your own EMF measurements with a magnetic field meter. For a spot measurement to provide a useful estimate of your EMF exposure, it should be taken at a time of day and location when and where you are typically near the equipment. Keep in mind that the strength of a magnetic field drops off quickly with distance.

Independent technicians will conduct EMF measurements for a fee. Search the Internet under “EMF meters” or “EMF measurement.” You should investigate the experience and qualifications of commercial firms, since governments do not standardize EMF measurements or certify measurement contractors.

At work, your plant safety officer, industrial hygienist, or other local safety official can be a good source of information. The National Institute for Occupational Safety and Health (NIOSH) sometimes conducts health hazard evaluations in workplaces where EMF is a suspected cause for concern. For further technical assistance, contact NIOSH at 800-356-4674.

## **Q** How much do computers contribute to my EMF exposure?

**A** Personal computers themselves produce very little EMF. However, the video display terminal (VDT) or monitor provides some magnetic field exposure unless it



is of the new flat-panel design. Conventional VDTs containing cathode ray tubes use magnetic fields to produce the image on the screen, and some emission of those magnetic fields is unavoidable. Unlike most other appliances which produce predominantly 60-Hz magnetic fields, VDTs emit magnetic fields in both the extremely low frequency (ELF) and very low frequency (VLF) frequency ranges (see page 8). Many newer VDTs have been designed to minimize magnetic field emissions, and those identified as “TCO’99 compliant” meet a standard for low emissions (see page 48).

## **Q** What can be done to limit EMF exposure?

**A** Personal exposure to EMF depends on three things: the strength of the magnetic field sources in your environment, your distance from those sources, and the time you spend in the field.

If you are concerned about EMF exposure, your first step should be to find out where the major EMF sources are and move away from them or limit the time you spend near them. Magnetic fields from appliances decrease dramatically about an arm’s length away from the source. In many cases, rearranging a bed, a chair, or a work area to increase your distance from an electrical panel or some other EMF source can reduce your EMF exposure.

---

Another way to reduce EMF exposure is to use equipment designed to have relatively low EMF emissions. Sometimes electrical wiring in a house or a building can be the source of strong magnetic field exposure. Incorrect wiring is a common source of higher-than-usual magnetic fields. Wiring problems are also worth correcting for safety reasons.

In its 1999 report to Congress, the National Institute of Environmental Health Sciences suggested that the power industry continue its current practice of siting power lines to reduce EMF exposures.

There are more costly actions, such as burying power lines, moving out of a home, or restricting the use of office space that may reduce exposures. Because scientists are still debating whether EMF is a hazard to health, it is not clear that the costs of such measures are warranted. Some EMF reduction measures may create other problems. For instance, compacting power lines reduces EMF but increases the danger of accidental electrocution for line workers.

We are not sure which aspects of the magnetic field exposure, if any, to reduce. Future research may reveal that EMF reduction measures based on today's limited understanding are inadequate or irrelevant. No action should be taken to reduce EMF exposure if it increases the risk of a known safety hazard.

# 5

## EMF Exposure Standards

*This chapter describes standards and guidelines established by state, national, and international safety organizations for some EMF sources and exposures.*

### **Q** Are there exposure standards for 60-Hz EMF?

**A** In the United States, there are no federal standards limiting occupational or residential exposure to 60-Hz EMF.

At least six states have set standards for transmission line electric fields; two of these also have standards for magnetic fields (see table below). In most cases, the maximum fields permitted by each state are the maximum fields that existing lines produce at maximum load-carrying conditions. Some states further limit electric field strength at road crossings to ensure that electric current induced into large metal objects such as trucks and buses does not represent an electric shock hazard.

| State Transmission Line Standards and Guidelines |                                                              |                     |                |                                                                                                       |
|--------------------------------------------------|--------------------------------------------------------------|---------------------|----------------|-------------------------------------------------------------------------------------------------------|
| State                                            | Electric Field                                               |                     | Magnetic Field |                                                                                                       |
|                                                  | On R.O.W.*                                                   | Edge R.O.W.         | On R.O.W.      | Edge R.O.W.                                                                                           |
| Florida                                          | 8 kV/m <sup>a</sup><br>10 kV/m <sup>b</sup>                  | 2 kV/m              | —              | 150 mG <sup>a</sup> (max. load)<br>200 mG <sup>b</sup> (max. load)<br>250 mG <sup>c</sup> (max. load) |
| Minnesota                                        | 8 kV/m                                                       | —                   | —              | —                                                                                                     |
| Montana                                          | 7 kV/m <sup>d</sup>                                          | 1 kV/m <sup>e</sup> | —              | —                                                                                                     |
| New Jersey                                       | —                                                            | 3 kV/m              | —              | —                                                                                                     |
| New York                                         | 11.8 kV/m<br>11.0 kV/m <sup>f</sup><br>7.0 kV/m <sup>d</sup> | 1.6 kV/m            | —              | 200 mG (max. load)                                                                                    |
| Oregon                                           | 9 kV/m                                                       | —                   | —              | —                                                                                                     |

\*R.O.W. = right-of-way (or in the Florida standard, certain additional areas adjoining the right-of-way). kV/m = kilovolt per meter. One kilovolt = 1,000 volts. <sup>a</sup>For lines of 69-230 kV. <sup>b</sup>For 500 kV lines. <sup>c</sup>For 500 kV lines on certain existing R.O.W. <sup>d</sup>Maximum for highway crossings. <sup>e</sup>May be waived by the landowner. <sup>f</sup>Maximum for private road crossings.

Two organizations have developed voluntary occupational exposure guidelines for EMF exposure. These guidelines are intended to prevent effects, such as induced currents in cells or nerve stimulation, which are known to occur at high magnitudes, much higher (more than 1,000 times higher) than EMF levels found typically in

occupational and residential environments. These guidelines are summarized in the tables on the right.

The International Commission on Non-Ionizing Radiation Protection (ICNIRP) concluded that available data regarding potential long-term effects, such as increased risk of cancer, are insufficient to provide a basis for setting exposure restrictions.

The American Conference of Governmental Industrial Hygienists (ACGIH) publishes “Threshold Limit Values” (TLVs) for various physical agents. The TLVs for 60-Hz EMF shown in the table are identified as guides to control exposure; they are not intended to demarcate safe and dangerous levels.

#### ICNIRP Guidelines for EMF Exposure

| Exposure (60 Hz) | Electric field | Magnetic field   |
|------------------|----------------|------------------|
| Occupational     | 8.3 kV/m       | 4.2 G (4,200 mG) |
| General Public   | 4.2 kV/m       | 0.833 G (833 mG) |

International Commission on Non-Ionizing Radiation Protection (ICNIRP) is an organization of 15,000 scientists from 40 nations who specialize in radiation protection.  
Source: ICNIRP, 1998.

#### ACGIH Occupational Threshold Limit Values for 60-Hz EMF

|                                                               | Electric field | Magnetic field   |
|---------------------------------------------------------------|----------------|------------------|
| Occupational exposure should not exceed                       | 25 kV/m        | 10 G (10,000 mG) |
| Prudence dictates the use of protective clothing above        | 15 kV/m        | –                |
| Exposure of workers with cardiac pacemakers should not exceed | 1 kV/m         | 1 G (1,000 mG)   |

American Conference of Governmental Industrial Hygienists (ACGIH) is a professional organization that facilitates the exchange of technical information about worker health protection. It is not a government regulatory agency.  
Source: ACGIH, 2001.

## Q Does EMF affect people with pacemakers or other medical devices?

A According to the U.S. Food and Drug Administration (FDA), interference from EMF can affect various medical devices including cardiac pacemakers and implantable defibrillators. Most current research in this area focuses on higher frequency sources such as cellular phones, citizens band radios, wireless computer links, microwave signals, radio and television transmitters, and paging transmitters.

Sources such as welding equipment, power lines at electric generating plants, and rail transportation equipment can produce lower frequency EMF strong enough to interfere with some models of pacemakers and defibrillators. The occupational exposure guidelines developed by ACGIH state that workers with cardiac pacemakers should not be exposed to a 60-Hz magnetic field greater than 1 gauss (1,000 mG) or a 60-Hz electric field greater than 1 kilovolt per meter (1,000 V/m) (see ACGIH guidelines above). Workers who are concerned about EMF exposure effects on pacemakers, implantable defibrillators, or other implanted electronic medical devices should consult their doctors or industrial hygienists.

---

Nonelectronic metallic medical implants (such as artificial joints, pins, nails, screws, and plates) can be affected by high magnetic fields such as those from magnetic resonance imaging (MRI) devices and aluminum refining equipment, but are generally unaffected by the lower fields from most other sources.

The FDA MedWatch program is collecting information about medical device problems thought to be associated with exposure to or interference from EMF. Anyone experiencing a problem that might be due to such interference is encouraged to call and report it (800-332-1088).

## **Q What about products advertised as producing low or reduced magnetic fields?**

**A** Virtually all electrical appliances and devices emit electric and magnetic fields. The strengths of the fields vary appreciably both between types of devices and among manufacturers and models of the same type of device. Some appliance manufacturers are designing new models that, in general, have lower EMF than older models. As a result, the words “low field” or “reduced field” may be relative to older models and not necessarily relative to other manufacturers or devices. At this time, there are no domestic or international standards or guidelines limiting the EMF emissions of appliances.

The U.S. government has set no standards for magnetic fields from computer monitors or video display terminals (VDTs). The Swedish Confederation of Professional Employees (TCO) established in 1992 a standard recommending strict limits on the EMF emissions of computer monitors. The VDTs should produce magnetic fields of no more than 2 mG at a distance of 30 cm (about 1 ft) from the front surface of the monitor and 50 cm (about 1 ft 8 in) from the sides and back of the monitor. The TCO'92 standard has become a *de facto* standard in the VDT industry worldwide. A 1999 standard, promulgated by the Swedish TCO (known as the TCO'99 standard), provides for international and environmental labeling of personal computers. Many computer monitors marketed in the U.S. are certified as compliant with TCO'99 and are thereby assured to produce low magnetic fields.

Beware of advertisements claiming that the federal government has certified that the advertised equipment produces little or no EMF. The federal government has no such general certification program for the emissions of low-frequency EMF. The U.S. Food and Drug Administration's Center for Devices and Radiological Health (CDRH) does certify medical equipment and equipment producing high levels of ionizing radiation or microwave radiation. Information about certain devices as well as general information about EMF is available from the CDRH at 888-463-6332.

---

## **Q Are cellular telephones and towers sources of EMF exposure?**

**A** Cellular telephones and towers involve radio-frequency and microwave-frequency electromagnetic fields (see page 8). These are in a much higher frequency range than are the power-frequency electric and magnetic fields associated with the transmission and use of electricity.

The U.S. Federal Communications Commission (FCC) licenses communications systems that use radio-frequency and microwave electromagnetic fields and ensures that licensed facilities comply with exposure standards. Public information on this topic is published on two FCC Internet sites: <http://www.fcc.gov/oet/info/documents/bulletins/#56> and <http://www.fcc.gov/oet/rfsafety/>

The U.S. Food and Drug Administration also provides information about cellular telephones on its web site (<http://www.fda.gov/cdrh/ocd/mobilphone.html>).



## National and International EMF Reviews

*This chapter presents the findings and recommendations of major EMF research reviews, including the U.S. government's EMF RAPID Program.*

### **Q** What have national and international agencies concluded about the impact of EMF exposure on human health?

**A** Since 1995, two major U.S. reports have concluded that limited evidence exists for an association between EMF exposure and increased leukemia risk, but that when all the scientific evidence is considered, the link between EMF exposure and cancer is weak. The World Health Organization in 1997 reached a similar conclusion.

The two reports were the U.S. National Academy of Sciences report in 1996 and, in 1999, the National Institute of Environmental Health Sciences report to the U.S. Congress at the end of the U.S. EMF Research and Public Information Dissemination (RAPID) Program.

### **The U.S. EMF RAPID Program**



Initiated by the U.S. Congress and established by law in 1992, the U.S. EMF Research and Public Information Dissemination (EMF RAPID) Program set out to study whether exposure to electric and magnetic fields produced by the generation, transmission, or use of electric power posed a risk to human health. For more information

about the EMF RAPID Program, visit the web site (<http://www.niehs.nih.gov/emfrapid>).

The U.S. Department of Energy (DOE) administered the overall EMF RAPID Program, but health effects research and risk assessment were supervised by the National Institute of Environmental Health Sciences (NIEHS), a branch of the U.S. National Institutes of Health (NIH). Together, DOE and NIEHS oversaw more than 100 cellular and animal studies, as well as engineering and exposure assessment studies. Although the EMF RAPID Program did not fund any additional epidemiological studies, an analysis of the many studies already conducted was an important part of its final report.

The electric power industry contributed about half, or \$22.5 million, of the \$45 million eventually spent on EMF research over the course of the EMF RAPID Program. The NIEHS received \$30.1 million from this program for research, public outreach, administration, and the health assessment evaluation of extremely low frequency (ELF) EMF. The DOE received approximately \$15 million from this program for engineering and EMF mitigation research. The NIEHS contributed an additional \$14.5 million for support of extramural and intramural research

#### **EMF RAPID Program Interagency Committee**

- National Institute of Environmental Health Sciences
- Department of Energy
- Department of Defense
- Department of Transportation
- Environmental Protection Agency
- Federal Energy Regulatory Commission
- National Institute of Standards and Technology
- Occupational Safety and Health Administration
- Rural Electrification Administration

including long-term toxicity and carcinogenicity studies conducted by the National Toxicology Program.

An interagency committee was established by the President of the United States to provide oversight and program management support for the EMF RAPID Program. The interagency committee included representatives from NIEHS, DOE, and seven other federal agencies with EMF-related responsibilities.


The EMF RAPID Program also received advice from a National EMF Advisory Committee (NEMFAC), which included representatives from citizen groups, labor, utilities, the National Academy of Sciences, and other groups. They met regularly with DOE and NIEHS staff to express their views. NEMFAC meetings were open to the public. The EMF RAPID Program sponsored citizen participation in some scientific meetings as well. A broad group of citizens reviewed all major public information materials produced for the program.

### **NIEHS Working Group Report 1998**

In preparation for the EMF RAPID Program's goal of reporting to the U.S. Congress on possible health effects from exposure to EMF from power lines, the NIEHS convened an expert working group in June 1998. Over 9 days, about 30 scientists conducted a complete review of EMF studies, including those sponsored by the EMF RAPID Program and others. Their conclusions offered guidance to the NIEHS as it prepared its report to Congress.

Using criteria developed by the International Agency for Research on Cancer, a majority of the members of the working group concluded that exposure to power-frequency EMF is a possible human carcinogen.

The majority called their opinion "a conservative public health decision based on limited evidence for an increased occurrence of childhood leukemias and an increased occurrence of chronic lymphocytic leukemia (CLL) in occupational settings." For these

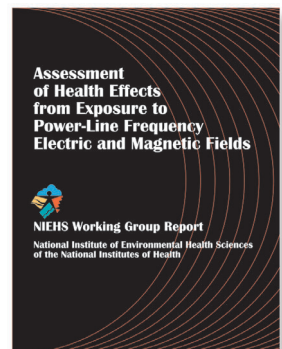

diseases, the working group reported that animal and cellular studies neither confirm nor deny the epidemiological studies' suggestion of a disease risk. This report is available on the NIEHS EMF RAPID web site (<http://www.niehs.nih.gov/emfrapid>).

## NIEHS Report to Congress at Conclusion of EMF RAPID Program

In June 1999, the NIEHS reported to the U.S. Congress that scientific evidence for an EMF-cancer link is weak.

The following are excerpts from the 1999 NIEHS report:

The NIEHS believes that the probability that ELF-EMF exposure is truly a health hazard is currently small. The weak epidemiological associations and lack of any laboratory support for these associations provide only marginal, scientific support that exposure to this agent is causing any degree of harm.


The scientific evidence suggesting that extremely low frequency EMF exposures pose any health risk is weak. The strongest evidence for health effects comes from associations observed in human populations with two forms of cancer: childhood leukemia and chronic lymphocytic leukemia in occupationally exposed adults. While the support from individual studies is weak, the epidemiological studies demonstrate, for some methods of measuring exposure, a fairly consistent pattern of a small, increased risk with increasing exposure that is somewhat weaker for chronic lymphocytic leukemia than for childhood leukemia. In contrast, the mechanistic studies and the animal toxicology literature fail to demonstrate any consistent pattern across studies, although sporadic findings of biological effects (including increased cancers in animals) have been reported. No indication of increased leukemias in experimental animals has been observed.

The full report is available on the NIEHS EMF RAPID web site (<http://www.niehs.nih.gov/emfrapid>).

No regulatory action was recommended or taken based on the NIEHS report. The NIEHS director, Dr. Kenneth Olden, told the Congress that, in his opinion, the conclusion of the NIEHS report was not sufficient to warrant aggressive regulatory action.

The NIEHS did not recommend adopting EMF standards for electric appliances or burying electric power lines. Instead, it recommended providing public information about practical ways to reduce EMF exposure. The NIEHS also suggested that power companies and utilities "continue siting power lines to reduce exposures and . . . explore ways to reduce the creation of magnetic fields around transmission and distribution lines without creating new hazards." The NIEHS encouraged manufacturers to reduce magnetic fields at a minimal cost, but noted that the risks do not warrant expensive redesign of electrical appliances.

The NIEHS also encouraged individuals who are concerned about EMF in their homes to check to see if their homes are properly wired and grounded, since incorrect wiring or other code violations are a common source of higher-than-usual magnetic fields.

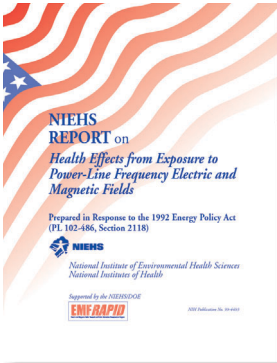

---

## National Academy of Sciences Report

In October 1996, a National Research Council committee of the National Academy of Sciences (NAS) released its evaluation of research on potential associations between EMF exposure and cancer, reproduction, development, learning, and behavior. The report concluded:

Based on a comprehensive evaluation of published studies relating to the effects of power-frequency electric and magnetic fields on cells, tissues, and organisms (including humans), the conclusion of the committee is that the current body of evidence does not show that exposure to these fields presents a human-health hazard. Specifically, no conclusive and consistent evidence shows that exposures to residential electric and magnetic fields produce cancer, adverse neurobehavioral effects, or reproductive and developmental effects.

The NAS report focused primarily on the association of childhood leukemia with the proximity of the child's home to power lines. The NAS panel found that although a link between EMF exposure and increased risk for childhood leukemia was observed in studies that had estimated EMF exposure using the wire code method (distance of home from power line), such a link was not found in studies that had included actual measurements of magnetic fields at the time of the study. The panel called for more research to pinpoint the unexplained factors causing small increases in childhood leukemia in houses close to power lines.

## World Health Organization International EMF Project

The World Health Organization (WHO) International EMF Project, with headquarters in Geneva, Switzerland, was launched at a 1996 meeting with representatives of 23 countries attending. It was intended to respond to growing concerns in many member states over possible EMF health effects and to address the conflict between such concerns and technological and economic progress. In its advisory role, the WHO International EMF Project is now reviewing laboratory and epidemiological evidence, identifying gaps in scientific knowledge, developing an agenda for future research, and developing risk communication booklets and other public information. The WHO International EMF Project is funded with contributions from governments and institutions and is expected to provide an overall EMF health risk assessment. Additional information about this program can be found on the WHO EMF web site (<http://www.who.int/peh-emf>).

As part of this project, in 1997 a working group of 45 scientists from around the world surveyed the evidence for adverse



---

EMF health effects. They reported that, “taken together, the findings of all published studies are suggestive of an association between childhood leukemia and estimates of ELF (extremely low frequency or power-frequency) magnetic fields.”

Much like the 1996 U.S. NAS report, the WHO report noted that living in homes near power lines was associated with an approximate 1.5-fold excess risk of childhood leukemia. But unlike the NAS panel, WHO scientists had seen the results of the 1997 U.S. National Cancer Institute study of EMF and childhood leukemia (see page 17). This work showed even more strongly the inconsistency between results of studies that used a wire code to estimate EMF exposure and studies that actually measured magnetic fields.

Regarding health effects other than cancer, the WHO scientists reported that the epidemiological studies “do not provide sufficient evidence to support an association between extremely-low-frequency magnetic-field exposure and adult cancers, pregnancy outcome, or neurobehavioural disorders.”

### **World Health Organization International Agency for Research on Cancer**

The WHO International Agency for Research on Cancer (IARC) produces a monograph series that reviews the scientific evidence regarding potential carcinogenicity associated with exposure to environmental agents. An international scientific panel of 21 experts from 10 countries met in June 2001 to review the scientific evidence regarding the potential carcinogenicity of static and ELF (extremely low frequency or power-frequency) EMF. The panel categorized its conclusions for carcinogenicity based on the IARC classification system—a system that evaluates the strength of evidence from epidemiological, laboratory (human and cellular), and mechanistic studies. The panel classified power-frequency EMF as “possibly carcinogenic to humans” based on a fairly consistent statistical association between a doubling of risk of childhood leukemia and magnetic field exposure above 0.4 microtesla (0.4  $\mu$ T, 4 milligauss or 4 mG).

In contrast, they found no consistent evidence that childhood EMF exposures are associated with other types of cancer or that adult EMF exposures are associated with increased risk for any kind of cancer. The IARC panel reported that no consistent carcinogenic effects of EMF exposure have been observed in experimental animals and that there is currently no scientific explanation for the observed association between childhood leukemia and EMF exposure. Further information can be obtained at the IARC web sites (<http://www.iarc.fr> and <http://monographs.iarc.fr>).

### **International Commission on Non-Ionizing Radiation Protection**

The International Commission on Non-Ionizing Radiation Protection (ICNIRP) issued exposure guidelines to guard against known adverse effects such as stimulation of nerves and muscles at very high EMF levels, as well as shocks and burns caused by touching objects that conduct electricity (see page 47). In April 1998, ICNIRP revised its exposure guidelines and characterized as “unconvincing” the evidence for an association between everyday power-frequency EMF and cancer.

---

## **European Union**

In 1996, a European Union (EU) advisory panel provided an overview of the state of science and standards among EU countries. With respect to power-frequency EMF, the panel members said that there is no clear evidence that exposure to EMF results in an increased risk of cancer.

## **Australia—Radiation Advisory Committee Report to Parliament**

In 1997, Australia's Radiation Advisory Committee briefly reviewed the EMF scientific literature and advised the Australian Parliament that, overall, there is insufficient evidence to come to a firm conclusion regarding possible health effects from exposure to power-frequency magnetic fields.

The committee also reported that “the weight of opinion as expressed in the U.S. National Academy of Sciences report, and the negative results from the National Cancer Institute study (Linnet et al., 1997) would seem to shift the balance of probability more towards there being no identifiable health effects” (see pages 17 and 53).

## **Canada—Health Canada Report**

In December 1998, a working group of public health officers at Health Canada, the federal agency that manages Canada's health care system, issued a review of the scientific literature regarding power-frequency EMF health effects. They found the evidence to be insufficient to conclude that EMF causes a risk of cancer.

The report concluded that while EMF effects may be observed in biological systems in a laboratory, no adverse health effects have been demonstrated at the levels to which humans and animals are typically exposed.

As for epidemiology, 25 years of study results are inconsistent and inconclusive, the panel said, and a plausible EMF-cancer mechanism is missing. Health Canada pledged to continue monitoring EMF research and to reassess this position as new information becomes available.

## **Germany—Ordinance 26**

On January 1, 1997, Germany became the first nation to adopt a national rule on EMF exposure for the general public. Ordinance 26 applies only to facilities such as overhead and underground transmission and distribution lines, transformers, switchgear and overhead lines for electric-powered trains. Both electric (5 kV/m) and magnetic field exposure limits (1 Gauss) are high enough that they are unlikely to be encountered in ordinary daily life. The ordinance also requires that precautionary measures be taken on a case-by-case basis when electric facilities are sited or upgraded near homes, hospital, schools, day care centers, and playgrounds.

---

## **Great Britain—National Radiological Protection Board Report**

The National Radiological Protection Board (NRPB) in Great Britain advises the government of the United Kingdom regarding standards of protection for exposure to non-ionizing radiation. The NRPB's advisory group on non-ionizing radiation periodically reviews new developments in EMF research and reports its findings. Results of the advisory group's latest review were published in 2001. The report reviewed residential and occupational epidemiological studies, as well as cellular, animal, and human volunteer studies that had been published.

The advisory group noted that there is “some epidemiological evidence that prolonged exposure to higher levels of power frequency magnetic fields is associated with a small risk of leukaemia in children.” Specifically, the NRPB advisory group's analysis suggests “that relatively heavy average exposures of 0.4  $\mu$ T [4 mG] or more are associated with a doubling of the risk of leukaemia in children under 15 years of age.” The group pointed out, however, that laboratory experiments have provided “no good evidence that extremely low frequency electromagnetic fields are capable of producing cancer.”

## **Scandinavia—EMF Developments**

In October 1995, a group of Swedish researchers and government officials published a report about EMF exposure in the workplace. This “Criteria Group” reviewed EMF scientific literature and, using the IARC classification system, ranked occupational EMF exposure as “possibly carcinogenic to humans.” They also endorsed the Swedish government's 1994 policy statement that public exposure limits to EMFs were not needed, but that people might simply want to use caution with EMFs.

In 1996, five Swedish government agencies further explained their precautionary advice about EMF. EMF exposure should be reduced, they said, but only when practical, without great inconvenience or cost.

Health experts in Norway, Denmark, and Finland generally agreed in reviews published in the 1990s that if an EMF health risk exists, it is small. They acknowledged that a link between residential magnetic fields and childhood leukemia cannot be confirmed or denied. In 1994, several Norwegian government ministries also recommended increasing the distance between residences and electrical facilities, if it could be done at low cost and with little inconvenience.

## **Q What other U.S. organizations have reported on EMF?**

### **A American Medical Association**

In 1995, the American Medical Association advised physicians that no scientifically documented health risk had been associated with “usually occurring” EMF, based on a review of EMF epidemiological, laboratory studies, and major literature reviews.

### **American Cancer Society**

In 1996, the American Cancer Society released a review of 20 years of EMF epidemiological research including occupational studies and residential studies of

---

adult and childhood cancer. The society noted that some data support a possible relationship of magnetic field exposure with leukemia and brain cancer, but further research may not be justified if studies continue to find uncertain results. Of particular interest is the summary of results from eight studies of risk from use of household appliances with relatively high magnetic fields, such as electric blankets and electric razors. The summary suggested that there is no persuasive evidence for increased risk with more frequent or longer use of these appliances.

### **American Physical Society**

The American Physical Society (APS) represents thousands of U.S. physicists. Responding to the NIEHS Working Group's conclusion that EMF is a possible human carcinogen, the APS executive board voted in 1998 to reaffirm its 1995 opinion that there is "no consistent, significant link between cancer and power line fields."

### **California's Department of Health Services**

In 1996, California's Department of Health Services (DHS) began an ambitious five-year effort to assess possible EMF public health risk and offer guidance to school administrators and other decision-makers. The California Electric and Magnetic Fields (EMF) Program is a research, education, and technical assistance program concerned with the possible health effects of EMF from power lines, appliances, and other uses of electricity. The program's goal is to find a rational and fair approach to dealing with the potential risks, if any, of exposure to EMF. This is done through research, policy analysis, and education. The web site has educational materials on EMF and related health issues for individuals, schools, government agencies, and professional organizations (<http://www.dhs.ca.gov/ps/deodc/ehib/emf>).

## **Q What can we conclude about EMF at this time?**

**A** Electricity is a beneficial part of our daily lives, but whenever electricity is generated, transmitted, or used, electric and magnetic fields are created. Over the past 25 years, research has addressed the question of whether exposure to power-frequency EMF might adversely affect human health. For most health outcomes, there is no evidence that EMF exposures have adverse effects. There is some evidence from epidemiology studies that exposure to power-frequency EMF is associated with an increased risk for childhood leukemia. This association is difficult to interpret in the absence of reproducible laboratory evidence or a scientific explanation that links magnetic fields with childhood leukemia.

EMF exposures are complex and come from multiple sources in the home and workplace in addition to power lines. Although scientists are still debating whether EMF is a hazard to health, the NIEHS recommends continued education on ways of reducing exposures. This booklet has identified some EMF sources and some simple steps you can take to limit your exposure. For your own safety, it is important that any steps you take to reduce your exposures do not increase other obvious hazards such as those from electrocution or fire. At the current time in the United States, there are no federal standards for occupational or residential exposure to 60-Hz EMF.



# References

*Selected references on EMF topics.*

## Basic Science

Kovetz A. Electromagnetic Theory. New York: Oxford University Press (2000).

Vanderlinde J. Classical Electromagnetic Theory. New York: Wiley (1993).

## EMF Levels and Exposures

Dietrich FM & Jacobs WL. Survey and Assessment of Electric and Magnetic (EMF) Public Exposure in the Transportation Environment. Report of the U. S. Department of Transportation. NTIS Document PB99-130908. Arlington, VA: National Technical Information Service (1999).

Kaune WT. Assessing human exposure to power-frequency electric and magnetic fields. Environmental Health Perspectives 101:121-133 (1993).

Kaune WT & Zaffanella L. Assessing historical exposure of children to power frequency magnetic fields. Journal of Exposure Analysis Environmental Epidemiology 4:149-170 (1994).

Tarone RE, Kaune WT, Linet MS, Hatch EE, Kleinerman RA, Robison LL, Boice JD & Wacholder S. Residential wire codes: Reproducibility and relation with measured magnetic fields. Occupational and Environmental Medicine 55:333-339 (1998).

U.S. Environmental Protection Agency. EMF in your environment: magnetic field measurements of everyday electrical devices. Washington, DC: Office of Radiation and Indoor Air, Radiation Studies Division, U.S. Environmental Protection Agency, Report No. 402-R-92-008 (1992).

Zaffanella L. Survey of residential magnetic field sources. Volume 1: Goals, Results and Conclusions. EPRI Report No. TR-102759. Palo Alto, CA: Electric Power Research Institute (EPRI), 1993;1-224.

## EMF Standards and Regulations

Documentation of the Threshold Limit Values and Biological Exposure Indices, 7th Ed. Publication No. 0100. Cincinnati, OH: American Conference of Governmental Industrial Hygienists (2001).

- 
- ICNIRP International Commission on Non-Ionizing Radiation Protection. Guidelines for Limiting Exposure to Time-Varying Electric, Magnetic, and Electromagnetic Fields (up to 300 GHz). *Health Physics* 74:494-522 (1998).
- Swedish National Board of Occupational Safety and Health. Low-Frequency Electrical and Magnetic Fields (SNBOSH): The Precautionary Principle for National Authorities. Guidance for Decision-Makers. Solna (1996).
- U.S. Department of Transportation, F.R.A. Safety of High Speed Guided Ground Transportation Systems, Magnetic and Electric Field Testing of the Amtrak Northeast Corridor and New Jersey Coast Line Rail Systems, Volume I: Analysis. Washington, DC: Office of Research and Development (1993).

## **Residential Childhood Cancer Studies**

- Ahlbom A, Day N, Feychting M, Roman E, Skinner J, Dockerty J, Linet M, McBride M, Michaelis J, Olsen JH, Tynes T & Verkasalo PK. A pooled analysis of magnetic fields and childhood leukemia. *British Journal of Cancer* 83:692-698 (2000).
- Coghill RW, Steward J & Philips A. Extra low frequency electric and magnetic fields in the bedplace of children diagnosed with leukemia: A case-control study. *European Journal of Cancer Prevention* 5:153-158 (1996).
- Dockerty JD, Elwood JM, Skegg DC, & Herbison GP. Electromagnetic field exposures and childhood cancers in New Zealand. *Cancer Causes and Control* 9:299-309 (1998).
- Feychting M & Ahlbom A. Magnetic fields and cancer in children residing near Swedish high-voltage power lines. *American Journal of Epidemiology* 138:467-481 (1993).
- Greenland S, Sheppard AR, Kaune WT, Poole C & Kelsh MA. A pooled analysis of magnetic fields, wire codes and childhood leukemia. EMF Study Group. *Epidemiology* 11:624-634 (2000).
- Linet MS, Hatch EE, Kleinerman RA, Robison LL, Kaune WT, Friedman DR, Severson RK, Haines CM, Hartsock CT, Niwa S, Wacholder S & Tarone RE. Residential exposure to magnetic fields and acute lymphoblastic leukemia in children. *New England Journal of Medicine* 337:1-7 (1997).

- London SJ, Thomas DC, Bowman JD, Sobel E, Cheng TC & Peters JM. Exposure to residential electric and magnetic fields and risk of childhood leukemia. *American Journal of Epidemiology* 134:923-937 (1991).
- McBride ML, Gallagher RP, Thériault G, Armstrong BG, Tamaro S, Spinelli JJ, Deadman JE, Fincham B, Robson D & Choi W. Power-frequency electric and magnetic fields and risk of childhood leukemia in Canada. *American Journal of Epidemiology* 149:831-842 (1999).
- Michaelis J, Schuz J, Meinert R, Zemann E, Grigat JP, Kaatsch P, Kaletsch U, Miesner A, Brinkmann K, Kalkner W, & Karner H. Combined risk estimates for two German population-based case-control studies on residential magnetic fields and childhood leukemia. *Epidemiology* 9:92-94 (1998).
- Olsen JH, Nielsen A & Schulgen G. Residence near high voltage facilities and risk of cancer in children. *British Medical Journal* 307:891-895 (1993).
- Savitz DA, Wachtel H, Barnes FA, John EM & Tvrđik JG. Case-control study of childhood cancer and exposure to 60-Hz magnetic fields. *American Journal of Epidemiology* 128:21-38 (1988).
- Tomenius L. 50-Hz electromagnetic environment and the incidence of childhood tumors in Stockholm county. *Bioelectromagnetics* 7:191-207 (1986).
- Tynes T & Haldorsen T. Electromagnetic fields and cancer in children residing near Norwegian high-voltage power lines. *American Journal of Epidemiology* 145:219-226 (1997).
- UK Childhood Cancer Study Investigators. Exposure to power frequency magnetic fields and the risk of childhood cancer: a case/control study. *Lancet* 354:1925-1931 (1999).
- Verkasalo PK, Pukkala E, Hongisto MY, Valjus JE, Jarvinen PJ, Heikkilä KV & Koskenvuo M. Risk of cancer in Finnish children living close to power lines. *British Medical Journal* 307:895-899 (1993).

## **Residential Adult Cancer Studies**

- Coleman MP, Bell CM, Taylor HL & Primie-Zakelj M. Leukemia and residence near electricity transmission equipment: a case-control study. *British Journal of Cancer* 60:793-798 (1989).
- Feychting M & Ahlbom A. Magnetic fields, leukemia, and central nervous system tumors in Swedish adults residing near high-voltage power lines. *Epidemiology* 5:501-509 (1994).
- Li CY, Thériault G & Lin RS. Residential exposure to 60-hertz magnetic fields and adult cancers in Taiwan. *Epidemiology* 8:25-30 (1997).
- McDowall ME. Mortality of persons resident in the vicinity of electricity transmission facilities. *British Journal of Cancer* 53:271-279 (1986).
- Severson RK, Stevens RG, Kaune WT, Thomas DB, Heuser L, Davis S & Sever LE. Acute nonlymphocytic leukemia and residential exposure to power frequency magnetic fields. *American Journal of Epidemiology* 128:10-20 (1988).

---

Wrensch M, Yost M, Miike R, Lee G & Touchstone J. Adult glioma in relation to residential power-frequency electromagnetic field exposures in the San Francisco Bay area. *Epidemiology* 10:523-527 (1999).

Youngson JH, Clayden AD, Myers A & Cartwright RA. A case/control study of adult haematological malignancies in relation to overhead powerlines. *British Journal of Cancer* 63:977-985 (1991).

## **Occupational EMF Cancer Studies**

Coogan PF, Clapp RW, Newcomb PA, Wenzl TB, Bogdan G, Mittendorf R, Baron JA & Longnecker MP. Occupational exposure to 60-Hertz magnetic fields and risk of breast cancer in women. *Epidemiology* 7:459-464 (1996).

Floderus B, Persson T, Stenlund C, Wennberg A, Ost A, & Knave B. Occupational exposure to electromagnetic fields in relation to leukemia and brain tumors: a case-control study in Sweden. *Cancer Causes Control* 4:465-476 (1993).

Floderus B, Tornqvist S, & Stenlund C. Incidence of selected cancers in Swedish railway workers, 1961-79. *Cancer Causes Control* 5:189-194 (1994).

Sorahan T, Nichols L, van Tongeren M, & Harrington JM. Occupational exposure to magnetic fields relative to mortality from brain tumours: updated and revised findings from a study of United Kingdom electricity generation and transmission workers, 1973-97. *Occupational and Environmental Medicine* 58(10):626-630 (2001).

Johansen C, & Olsen JH Risk of cancer among Danish utility workers - A nationwide cohort study. *American Journal of Epidemiology*, 147:548-555 (1998).

Kheifets LI, Gilbert ES, Sussman SS, Guenel P, Sahl JD, Savitz DA, & Theriault G. Comparative analyses of the studies of magnetic fields and cancer in electric utility workers: studies from France, Canada, and the United States. *Occupational and Environmental Medicine* 56(8):567-574 (1999).

London SJ, Bowman JD, Sobel E, Thomas DC, Garabrant DH, Pearce N, Bernstein L & Peters JM. Exposure to magnetic fields among electrical workers in relation to leukemia risk in Los Angeles County. *American Journal of Industrial Medicine* 26:47-60 (1994).

Matanoski GM, Breyse PN & Elliott EA. Electromagnetic field exposure and male breast cancer. *Lancet* 337:737 (1991).

Sahl JD, Kelsh MA, & Greenland S. Cohort and nested case-control studies of hematopoietic cancers and brain cancer among utility worker. *Epidemiology* 4:21-32 (1994).

Savitz DA & Loomis DP. Magnetic field exposure in relation to leukemia and brain cancer mortality among electric utility workers. *American Journal of Epidemiology* 141:123-134 (1995).

Sorahan T, Nichols L, van Tongeren M, & Harrington JM. Occupational exposure to magnetic fields relative to mortality from brain tumours: updated and revised findings from a study of United Kingdom electricity generation and transmission workers, 1973-97. *Occupational and Environmental Medicine* 58:626-630 (2001).

---

Thériault G, Goldberg M, Miller AB, Armstrong B, Guénel P, Deadman J, Imbernon E, To T, Chevalier A, Cyr D, & Wall C. Cancer risks associated with occupational exposure to magnetic fields among electric utility workers in Ontario and Quebec, Canada and France: 1970–1989. *American Journal of Epidemiology* 139:550-572 (1994).

Tynes T, Jynge H, & Vistnes AI. Leukemia and brain tumors in Norwegian railway workers, a nested case-control study. *American Journal of Epidemiology* 139:645-653 (1994).

## **Laboratory Animal EMF Studies**

Anderson LE, Boorman GA, Morris JE, Sasser LB, Mann PC, Grumbein SL, Hailey JR, McNally A, Sills RC & Haseman JK. Effect of 13-week magnetic field exposures on DMBA-initiated mammary gland carcinomas in female Sprague-Dawley rats. *Carcinogenesis* 20:1615-1620 (1999).

Baum A, Mevissen M, Kamino K, Mohr U & Löschner W. A histopathological study on alterations in DMBA-induced mammary carcinogenesis in rats with 50 Hz, 100 mT magnetic field exposure. *Carcinogenesis* 16:119-125 (1995).

Babbitt JT, Kharazi AI, Taylor JMG, Rafferty CN, Kovatch R, Bonds CB, Mirell SG, Frumkin E, Dietrich F, Zhuang D & Hahn TJM. Leukemia/lymphoma in mice exposed to 60-Hz magnetic fields: Results of the chronic exposure study TR-110338. Los Angeles: Electric Power Research Institute (EPRI) (1998).

Babbitt JT, Kharazi AI, Taylor JMG, Rafferty CN, Kovatch R, Bonds CB, Mirell SG, Frumkin E, Dietrich F, Zhuang D & Hahn TJM. Leukemia/lymphoma in mice exposed to 60-Hz magnetic fields: Results of the chronic exposure study, Second Edition. Electric Power Research Institute (EPRI) and B. C. Hydro, Palo Alto, California and Burnaby, British Columbia, Canada (1999).

Boorman GA, Anderson LE, Morris JE, Sasser LB, Mann PC, Grumbein SL, Hailey JR, McNally A, Sills RC & Haseman JK. Effect of 26-week magnetic field exposures in a DMBA initiation-promotion mammary gland model in Sprague-Dawley rats. *Carcinogenesis* 20:899-904 (1999).

Boorman GA, McCormick DL, Findlay JC, Hailey JR, Gauger JR, Johnson TR, Kovatch RM, Sills RC & Haseman JK. Chronic toxicity/oncogenicity of 60 Hz (power frequency) magnetic fields in F344/N rats. *Toxicological Pathology* 27:267-278 (1999).

Boorman GA, McCormick DL, Ward JM, Haseman JK & Sills RC. Magnetic fields and mammary cancer in rodents: A critical review and evaluation of published literature. *Radiation Research* 153:617-626 (2000).

Boorman GA, Rafferty CN, Ward JM & Sills RC. Leukemia and lymphoma incidence in rodents exposed to low-frequency magnetic fields. *Radiation Research* 153:627-636 (2000).

Ekström T, Mild KH & Holmberg B. Mammary tumours in Sprague-Dawley rats after initiation with DMBA followed by exposure to 50 Hz electromagnetic fields in a promotional scheme. *Cancer Letters* 123:107-111 (1998).

- 
- Mandeville R, Franco E, Sidrac-Ghali S, Paris-Nadon L, Rocheleau N, Mercier G, Desy M & Gaboury L. Evaluation of the potential carcinogenicity of 60 Hz linear sinusoidal continuous-wave magnetic fields in Fisher F344 rats. *Federation of the American Society of Experimental Biology Journal* 11:1127-1136 (1997).
- McCormick DL, Boorman GA, Findlay JC, Hailey JR, Johnson TR, Gauger JR, Pletcher JM, Sills RC & Haseman JK. Chronic toxicity/oncogenicity of 60 Hz (power frequency) magnetic fields in B6C3F1 mice. *Toxicological Pathology* 27:279-285 (1999).
- Mevissen M, Lerchl A, Szamel M & Löscher W. Exposure of DMBA-treated female rats in a 50-Hz, 50 microTesla magnetic field: Effects on mammary tumor growth, melatonin levels and T-lymphocyte activation. *Carcinogenesis* 17:903-910 (1996).
- Yasui M, Kikuchi T, Ogawa M, Otaka Y, Tsuchitani M & Iwata H. Carcinogenicity test of 50 Hz sinusoidal magnetic fields in rats. *Bioelectromagnetics* 18:531-540 (1997).

### **Laboratory Cellular EMF Studies**

- Balcer-Kubiczek EK, Harrison GH, Zhang XF, Shi ZM, Abraham JM, McCready WA, Ampey LL, III, Meltzer SJ, Jacobs MC, & Davis CC. Rodent cell transformation and immediate early gene expression following 60-Hz magnetic field exposure. *Environmental Health Perspectives* 104:1188-1198 (1996).
- Boorman GA, Owen RD, Lotz WG & Galvin MJ, Jr. Evaluation of *in vitro* effects of 50 and 60 Hz magnetic fields in regional EMF exposure facilities. *Radiation Research* 153:648-657 (2000).
- Lacy-Hulbert A, Metcalfe JC, & Hesketh R. Biological responses to electromagnetic fields. *Federation of the American Society of Experimental Biology (FASEB) Journal* 12:395-420 (1998).
- Morehouse CA & Owen RD. Exposure of Daudi cells to low-frequency magnetic fields does not elevate MYC steady-state mRNA levels. *Radiation Research* 153:663-669 (2000).
- Snawder JE, Edwards RM, Conover DL & Lotz WG. Effect of magnetic field exposure on anchorage-independent growth of a promoter-sensitive mouse epidermal cell line (JB6). *Environmental Health Perspectives* 107:195-198 (1999).
- Wey HE, Conover DL, Mathias P, Toraason MA & Lotz WG. 50-Hz magnetic field and calcium transients in Jurkat cells: Results of a research and public information dissemination (RAPID) program study. *Environmental Health Perspectives* 108:135-140 (2000).

### **National Reviews of EMF Research**

- American Medical Association. Council on Scientific Affairs. *Effects of Electric and Magnetic Fields*. Chicago: American Medical Association (December 1994).
- National Institute for Occupational Safety and Health, National Institute of Environmental Health Sciences, U.S. Department of Energy. *Questions and Answers: EMF in the Workplace. Electric and Magnetic Fields Associated with the Use of Electric Power*. Report No. DOE/GO-10095-218 (September 1996).

---

National Radiological Protection Board. ELF Electromagnetic Fields and the Risk of Cancer. Volume 12:1, Chilton, Didcot, Oxon, UK OX11 0RQ (2001).

National Research Council, Committee on the Possible Effects of Electromagnetic Fields on Biologic Systems. Possible Health Effects of Exposure to Residential Electric and Magnetic Fields. Washington: National Academy Press (1997).

National Institute of Environmental Health Sciences Report on Health Effects from Exposure to Power-Line Frequency Electric and Magnetic Fields. NIH Publication No. 99-4493. Research Triangle Park, National Institute of Environmental Health Sciences (1999).

Portier CJ & Wolfe MS, Eds. Assessment of Health Effects from Exposure to Power-Line Frequency Electric and Magnetic Fields—NIEHS Working Group Report NIH Publication No. 98-3981. Research Triangle Park, National Institute of Environmental Health Sciences (1998).